



OH2200203 ERIE CO MARGARETTA DISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2013

DISTRIBUTION MONITORING SCHEDULE

Table with 4 columns: Sampling Location, Facility ID, Facility Name, Facility Class. Values: DS1, ERIE CO. MARGARETTA DIST DISTRIBUTION, CLASS 1, DS000.

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100 6 Sample(s) Required between 1/1/2013 and 1/31/2013 ... 6 Sample(s) Required between 12/1/2013 and 12/31/2013

TOTAL CHLORINE - 1000 6 Sample(s) Required between 1/1/2013 and 1/31/2013 ... 6 Sample(s) Required between 12/1/2013 and 12/31/2013

Samples should be collected at the same time and place as the Total Coliform samples.

Table with 4 columns: Sampling Location, Facility ID, Facility Name, Facility Class. Values: DS1, ERIE CO. MARGARETTA DIST DISTRIBUTION, CLASS 1, DS201, 803 EAST BAYVIEW.

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 2/8/2013 and 2/14/2013 ... 1 Sample(s) Required between 11/8/2013 and 11/14/2013

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950



OH2200203 ERIE CO MARGARETTA DISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2013**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: ERIE CO. MARGARETTA DIST DISTRIBUTION	Facility Class: CLASS 1
	SMP ID: DS202	BILLINGS ROAD	

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/8/2013 and 2/14/2013
	1 Sample(s) Required between 5/8/2013 and 5/14/2013
	1 Sample(s) Required between 8/8/2013 and 8/14/2013
	1 Sample(s) Required between 11/8/2013 and 11/14/2013

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950



OH2200403 ERIE CO HURON EAST DISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2013**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: ERIE CO. HURON EAST DIST DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2013 and 1/31/2013
	2 Sample(s) Required between 2/1/2013 and 2/28/2013
	2 Sample(s) Required between 3/1/2013 and 3/31/2013
	2 Sample(s) Required between 4/1/2013 and 4/30/2013
	2 Sample(s) Required between 5/1/2013 and 5/31/2013
	2 Sample(s) Required between 6/1/2013 and 6/30/2013
	2 Sample(s) Required between 7/1/2013 and 7/31/2013
	2 Sample(s) Required between 8/1/2013 and 8/31/2013
	2 Sample(s) Required between 9/1/2013 and 9/30/2013
	2 Sample(s) Required between 10/1/2013 and 10/31/2013
	2 Sample(s) Required between 11/1/2013 and 11/30/2013
	2 Sample(s) Required between 12/1/2013 and 12/31/2013

TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2013 and 1/31/2013
	2 Sample(s) Required between 2/1/2013 and 2/28/2013
	2 Sample(s) Required between 3/1/2013 and 3/31/2013
	2 Sample(s) Required between 4/1/2013 and 4/30/2013
	2 Sample(s) Required between 5/1/2013 and 5/31/2013
	2 Sample(s) Required between 6/1/2013 and 6/30/2013
	2 Sample(s) Required between 7/1/2013 and 7/31/2013
	2 Sample(s) Required between 8/1/2013 and 8/31/2013
	2 Sample(s) Required between 9/1/2013 and 9/30/2013
	2 Sample(s) Required between 10/1/2013 and 10/31/2013
	2 Sample(s) Required between 11/1/2013 and 11/30/2013
	2 Sample(s) Required between 12/1/2013 and 12/31/2013

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: ERIE CO. HURON EAST DIST DISTRIBUTION EAST CLEVELAND ROAD	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/8/2013 and 2/14/2013
	1 Sample(s) Required between 5/8/2013 and 5/14/2013
	1 Sample(s) Required between 8/8/2013 and 8/14/2013
	1 Sample(s) Required between 11/8/2013 and 11/14/2013

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950

OH2200603 ERIE CO PERKINS DISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2013**
DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: ERIE CO. PERKINS DISTRIC DISTRIBUTION	Facility Class: CLASS 1
	SMP ID: DS000		

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required
ASBESTOS - 1094	Not Required
TOTAL COLIFORM (TCR) - 3100	15 Sample(s) Required between 1/1/2013 and 1/31/2013 15 Sample(s) Required between 2/1/2013 and 2/28/2013 15 Sample(s) Required between 3/1/2013 and 3/31/2013 15 Sample(s) Required between 4/1/2013 and 4/30/2013 15 Sample(s) Required between 5/1/2013 and 5/31/2013 15 Sample(s) Required between 6/1/2013 and 6/30/2013 15 Sample(s) Required between 7/1/2013 and 7/31/2013 15 Sample(s) Required between 8/1/2013 and 8/31/2013 15 Sample(s) Required between 9/1/2013 and 9/30/2013 15 Sample(s) Required between 10/1/2013 and 10/31/2013 15 Sample(s) Required between 11/1/2013 and 11/30/2013 15 Sample(s) Required between 12/1/2013 and 12/31/2013
TOTAL CHLORINE - 1000	15 Sample(s) Required between 1/1/2013 and 1/31/2013 15 Sample(s) Required between 2/1/2013 and 2/28/2013 15 Sample(s) Required between 3/1/2013 and 3/31/2013 15 Sample(s) Required between 4/1/2013 and 4/30/2013 15 Sample(s) Required between 5/1/2013 and 5/31/2013 15 Sample(s) Required between 6/1/2013 and 6/30/2013 15 Sample(s) Required between 7/1/2013 and 7/31/2013 15 Sample(s) Required between 8/1/2013 and 8/31/2013 15 Sample(s) Required between 9/1/2013 and 9/30/2013 15 Sample(s) Required between 10/1/2013 and 10/31/2013 15 Sample(s) Required between 11/1/2013 and 11/30/2013 15 Sample(s) Required between 12/1/2013 and 12/31/2013

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: ERIE CO. PERKINS DISTRIC DISTRIBUTION	Facility Class: CLASS 1
	SMP ID: DS201	KELLEY ROAD TANK	

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/8/2013 and 2/14/2013 1 Sample(s) Required between 5/8/2013 and 5/14/2013 1 Sample(s) Required between 8/8/2013 and 8/14/2013 1 Sample(s) Required between 11/8/2013 and 11/14/2013

Sample for all the analytes listed below:
TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950

OH2200603 ERIE CO PERKINS DISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2013**
DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: ERIE CO. PERKINS DISTRIC DISTRIBUTION HAYES AVENUE (ROUTE FOUR TOW	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/8/2013 and 2/14/2013
	1 Sample(s) Required between 5/8/2013 and 5/14/2013
	1 Sample(s) Required between 8/8/2013 and 8/14/2013
	1 Sample(s) Required between 11/8/2013 and 11/14/2013

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS203	Facility Name: ERIE CO. PERKINS DISTRIC DISTRIBUTION HARRIS ROAD TANK	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/8/2013 and 2/14/2013
	1 Sample(s) Required between 5/8/2013 and 5/14/2013
	1 Sample(s) Required between 8/8/2013 and 8/14/2013
	1 Sample(s) Required between 11/8/2013 and 11/14/2013

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS204	Facility Name: ERIE CO. PERKINS DISTRIC DISTRIBUTION RAMADA STREET	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/8/2013 and 2/14/2013
	1 Sample(s) Required between 5/8/2013 and 5/14/2013
	1 Sample(s) Required between 8/8/2013 and 8/14/2013
	1 Sample(s) Required between 11/8/2013 and 11/14/2013

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950



OH2200703 ERIE CO HURON SOUTH DISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2013

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: DS1 SMP ID: DS000 Facility Name: ERIE CO.HURON SOUTH DIST DISTRIBUTION Facility Class: CLASS 1

Table with 2 columns: Chemicals and Monitoring Requirements. Lists parameters like LEAD, ASBESTOS, TOTAL COLIFORM, and TOTAL CHLORINE with their respective sampling frequencies and dates.

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: DS1 SMP ID: DS201 Facility Name: ERIE CO.HURON SOUTH DIST DISTRIBUTION Facility Class: CLASS 1

Table with 2 columns: Chemicals and Monitoring Requirements. Lists parameters like DISINFECTION BYPRODUCTS with their respective sampling frequencies and dates.

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950



OH2200803 ERIE CO VERMILION DISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2013

DISTRIBUTION MONITORING SCHEDULE

Table with 4 columns: Sampling Location, Facility ID, Facility Name, Facility Class. Values: DS1, DS000, ERIE CO. VERMILION DIST DISTRIBUTION, CLASS 1

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

TOTAL COLIFORM (TCR) - 3100 1 Sample(s) Required between 1/1/2013 and 1/31/2013 ... 12/1/2013 and 12/31/2013

TOTAL CHLORINE - 1000 1 Sample(s) Required between 1/1/2013 and 1/31/2013 ... 12/1/2013 and 12/31/2013

Samples should be collected at the same time and place as the Total Coliform samples.

Table with 4 columns: Sampling Location, Facility ID, Facility Name, Facility Class. Values: DS1, DS201, ERIE CO. VERMILION DIST DISTRIBUTION, CLASS 1

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 2/8/2013 and 2/14/2013 ... 11/8/2013 and 11/14/2013

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950



OH2200903 ERIE CO HURON WEST DISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2013

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: ERIE CO. HURON WEST DIST DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required
ASBESTOS - 1094	Not Required
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2013 and 1/31/2013 1 Sample(s) Required between 2/1/2013 and 2/28/2013 1 Sample(s) Required between 3/1/2013 and 3/31/2013 1 Sample(s) Required between 4/1/2013 and 4/30/2013 1 Sample(s) Required between 5/1/2013 and 5/31/2013 1 Sample(s) Required between 6/1/2013 and 6/30/2013 1 Sample(s) Required between 7/1/2013 and 7/31/2013 1 Sample(s) Required between 8/1/2013 and 8/31/2013 1 Sample(s) Required between 9/1/2013 and 9/30/2013 1 Sample(s) Required between 10/1/2013 and 10/31/2013 1 Sample(s) Required between 11/1/2013 and 11/30/2013 1 Sample(s) Required between 12/1/2013 and 12/31/2013
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2013 and 1/31/2013 1 Sample(s) Required between 2/1/2013 and 2/28/2013 1 Sample(s) Required between 3/1/2013 and 3/31/2013 1 Sample(s) Required between 4/1/2013 and 4/30/2013 1 Sample(s) Required between 5/1/2013 and 5/31/2013 1 Sample(s) Required between 6/1/2013 and 6/30/2013 1 Sample(s) Required between 7/1/2013 and 7/31/2013 1 Sample(s) Required between 8/1/2013 and 8/31/2013 1 Sample(s) Required between 9/1/2013 and 9/30/2013 1 Sample(s) Required between 10/1/2013 and 10/31/2013 1 Sample(s) Required between 11/1/2013 and 11/30/2013 1 Sample(s) Required between 12/1/2013 and 12/31/2013

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: ERIE CO. HURON WEST DIST DISTRIBUTION BOOS ROAD TOWER	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2013 and 9/30/2013

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950



OH2201011 HURON CITY

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 2253912	Facility Name: HURON CITY	Facility Class: CLASS 3
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2013**

Chemicals	Monitoring Requirements		
INORGANICS	1 Sample(s) Required between 1/1/2013 and 5/31/2013		
<i>Sample for all the analytes listed below:</i>			
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020			
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085			
NITRITE - 1041	Not Required		
NITRATE - 1040	1 Sample(s) Required between	1/1/2013 and	1/31/2013
	1 Sample(s) Required between	2/1/2013 and	2/28/2013
	1 Sample(s) Required between	3/1/2013 and	3/31/2013
	1 Sample(s) Required between	4/1/2013 and	4/30/2013
	1 Sample(s) Required between	5/1/2013 and	5/31/2013
	1 Sample(s) Required between	6/1/2013 and	6/30/2013
	1 Sample(s) Required between	7/1/2013 and	7/31/2013
	1 Sample(s) Required between	8/1/2013 and	8/31/2013
	1 Sample(s) Required between	9/1/2013 and	9/30/2013
	1 Sample(s) Required between	10/1/2013 and	10/31/2013
	1 Sample(s) Required between	11/1/2013 and	11/30/2013
	1 Sample(s) Required between	12/1/2013 and	12/31/2013
RADIOLOGICALS	Not Required		
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	4/1/2013 and	4/30/2013
	1 Sample(s) Required between	5/1/2013 and	5/31/2013
	1 Sample(s) Required between	6/1/2013 and	6/30/2013
<i>Sample for all the analytes listed below:</i>			
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037			
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2013 and 5/31/2013		
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between	1/1/2013 and	1/31/2013
	1 Paired Sample Set Required between	2/1/2013 and	2/28/2013
	1 Paired Sample Set Required between	3/1/2013 and	3/31/2013
	1 Paired Sample Set Required between	4/1/2013 and	4/30/2013
	1 Paired Sample Set Required between	5/1/2013 and	5/31/2013
	1 Paired Sample Set Required between	6/1/2013 and	6/30/2013
	1 Paired Sample Set Required between	7/1/2013 and	7/31/2013
	1 Paired Sample Set Required between	8/1/2013 and	8/31/2013
	1 Paired Sample Set Required between	9/1/2013 and	9/30/2013
	1 Paired Sample Set Required between	10/1/2013 and	10/31/2013
	1 Paired Sample Set Required between	11/1/2013 and	11/30/2013
	1 Paired Sample Set Required between	12/1/2013 and	12/31/2013

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



OH2201011 HURON CITY

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2013

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: HURON, CITY OF DISTRIBUTION	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

TOTAL COLIFORM (TCR) - 3100	8 Sample(s) Required between 1/1/2013 and 1/31/2013
	8 Sample(s) Required between 2/1/2013 and 2/28/2013
	8 Sample(s) Required between 3/1/2013 and 3/31/2013
	8 Sample(s) Required between 4/1/2013 and 4/30/2013
	8 Sample(s) Required between 5/1/2013 and 5/31/2013
	8 Sample(s) Required between 6/1/2013 and 6/30/2013
	8 Sample(s) Required between 7/1/2013 and 7/31/2013
	8 Sample(s) Required between 8/1/2013 and 8/31/2013
	8 Sample(s) Required between 9/1/2013 and 9/30/2013
	8 Sample(s) Required between 10/1/2013 and 10/31/2013
	8 Sample(s) Required between 11/1/2013 and 11/30/2013
	8 Sample(s) Required between 12/1/2013 and 12/31/2013

TOTAL CHLORINE - 1000	8 Sample(s) Required between 1/1/2013 and 1/31/2013
	8 Sample(s) Required between 2/1/2013 and 2/28/2013
	8 Sample(s) Required between 3/1/2013 and 3/31/2013
	8 Sample(s) Required between 4/1/2013 and 4/30/2013
	8 Sample(s) Required between 5/1/2013 and 5/31/2013
	8 Sample(s) Required between 6/1/2013 and 6/30/2013
	8 Sample(s) Required between 7/1/2013 and 7/31/2013
	8 Sample(s) Required between 8/1/2013 and 8/31/2013
	8 Sample(s) Required between 9/1/2013 and 9/30/2013
	8 Sample(s) Required between 10/1/2013 and 10/31/2013
	8 Sample(s) Required between 11/1/2013 and 11/30/2013
	8 Sample(s) Required between 12/1/2013 and 12/31/2013

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: HURON, CITY OF DISTRIBUTION HYDRANT UNVERSITY DR S	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/1/2013 and 2/7/2013
	1 Sample(s) Required between 5/1/2013 and 5/7/2013
	1 Sample(s) Required between 8/1/2013 and 8/7/2013
	1 Sample(s) Required between 11/1/2013 and 11/7/2013

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950



OH2201011 HURON CITY

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2013

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: HURON, CITY OF DISTRIBUTION HYDRANT LINCOLN/WASHINGTON	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/1/2013 and 2/7/2013
	1 Sample(s) Required between 5/1/2013 and 5/7/2013
	1 Sample(s) Required between 8/1/2013 and 8/7/2013
	1 Sample(s) Required between 11/1/2013 and 11/7/2013

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950



OH2201111 KELLEYS ISLAND VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 2253913	Facility Name: KELLEYS ISLAND VILLAGE	Facility Class: CLASS 3
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2013

Chemicals Monitoring Requirements

INORGANICS 1 Sample(s) Required between 1/1/2013 and 5/31/2013

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 1/1/2013 and 1/31/2013
1 Sample(s) Required between 2/1/2013 and 2/28/2013
1 Sample(s) Required between 3/1/2013 and 3/31/2013
1 Sample(s) Required between 4/1/2013 and 4/30/2013
1 Sample(s) Required between 5/1/2013 and 5/31/2013
1 Sample(s) Required between 6/1/2013 and 6/30/2013
1 Sample(s) Required between 7/1/2013 and 7/31/2013
1 Sample(s) Required between 8/1/2013 and 8/31/2013
1 Sample(s) Required between 9/1/2013 and 9/30/2013
1 Sample(s) Required between 10/1/2013 and 10/31/2013
1 Sample(s) Required between 11/1/2013 and 11/30/2013
1 Sample(s) Required between 12/1/2013 and 12/31/2013

RADIOLOGICALS Not Required

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 4/1/2013 and 6/30/2013

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 1/1/2013 and 5/31/2013

TOTAL ORGANIC CARBON (TOC) 1 Paired Sample Set Required between 1/1/2013 and 1/31/2013
1 Paired Sample Set Required between 2/1/2013 and 2/28/2013
1 Paired Sample Set Required between 3/1/2013 and 3/31/2013
1 Paired Sample Set Required between 4/1/2013 and 4/30/2013
1 Paired Sample Set Required between 5/1/2013 and 5/31/2013
1 Paired Sample Set Required between 6/1/2013 and 6/30/2013
1 Paired Sample Set Required between 7/1/2013 and 7/31/2013
1 Paired Sample Set Required between 8/1/2013 and 8/31/2013
1 Paired Sample Set Required between 9/1/2013 and 9/30/2013
1 Paired Sample Set Required between 10/1/2013 and 10/31/2013
1 Paired Sample Set Required between 11/1/2013 and 11/30/2013
1 Paired Sample Set Required between 12/1/2013 and 12/31/2013

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



OH2201111 KELLEYS ISLAND VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2013**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: KELLEYS ISLAND VILLAGE DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2013 and 9/30/2013
-------------------------------	--

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2013 and 1/31/2013
	1 Sample(s) Required between 2/1/2013 and 2/28/2013
	1 Sample(s) Required between 3/1/2013 and 3/31/2013
	1 Sample(s) Required between 4/1/2013 and 4/30/2013
	1 Sample(s) Required between 5/1/2013 and 5/31/2013
	1 Sample(s) Required between 6/1/2013 and 6/30/2013
	1 Sample(s) Required between 7/1/2013 and 7/31/2013
	1 Sample(s) Required between 8/1/2013 and 8/31/2013
	1 Sample(s) Required between 9/1/2013 and 9/30/2013
	1 Sample(s) Required between 10/1/2013 and 10/31/2013
	1 Sample(s) Required between 11/1/2013 and 11/30/2013
	1 Sample(s) Required between 12/1/2013 and 12/31/2013

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2013 and 1/31/2013
	1 Sample(s) Required between 2/1/2013 and 2/28/2013
	1 Sample(s) Required between 3/1/2013 and 3/31/2013
	1 Sample(s) Required between 4/1/2013 and 4/30/2013
	1 Sample(s) Required between 5/1/2013 and 5/31/2013
	1 Sample(s) Required between 6/1/2013 and 6/30/2013
	1 Sample(s) Required between 7/1/2013 and 7/31/2013
	1 Sample(s) Required between 8/1/2013 and 8/31/2013
	1 Sample(s) Required between 9/1/2013 and 9/30/2013
	1 Sample(s) Required between 10/1/2013 and 10/31/2013
	1 Sample(s) Required between 11/1/2013 and 11/30/2013
	1 Sample(s) Required between 12/1/2013 and 12/31/2013

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: KELLEYS ISLAND VILLAGE DISTRIBUTION 110 LAYIN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/1/2013 and 1/7/2013
	1 Sample(s) Required between 4/1/2013 and 4/7/2013
	1 Sample(s) Required between 7/1/2013 and 7/7/2013



OH2201111 KELLEYS ISLAND VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2013**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: KELLEYS ISLAND VILLAGE DISTRIBUTION	Facility Class: CLASS 1
	SMP ID: DS201	110 LAYIN	

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 10/1/2013 and 10/7/2013

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950



OH2201212 MILAN VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 2253914	Facility Name: MILAN WTP	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2013**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2013 and 5/31/2013
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 3	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH2201212 MILAN VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2013**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: MILAN, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2013 and 1/31/2013
	2 Sample(s) Required between 2/1/2013 and 2/28/2013
	2 Sample(s) Required between 3/1/2013 and 3/31/2013
	2 Sample(s) Required between 4/1/2013 and 4/30/2013
	2 Sample(s) Required between 5/1/2013 and 5/31/2013
	2 Sample(s) Required between 6/1/2013 and 6/30/2013
	2 Sample(s) Required between 7/1/2013 and 7/31/2013
	2 Sample(s) Required between 8/1/2013 and 8/31/2013
	2 Sample(s) Required between 9/1/2013 and 9/30/2013
	2 Sample(s) Required between 10/1/2013 and 10/31/2013
	2 Sample(s) Required between 11/1/2013 and 11/30/2013
	2 Sample(s) Required between 12/1/2013 and 12/31/2013

TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2013 and 1/31/2013
	2 Sample(s) Required between 2/1/2013 and 2/28/2013
	2 Sample(s) Required between 3/1/2013 and 3/31/2013
	2 Sample(s) Required between 4/1/2013 and 4/30/2013
	2 Sample(s) Required between 5/1/2013 and 5/31/2013
	2 Sample(s) Required between 6/1/2013 and 6/30/2013
	2 Sample(s) Required between 7/1/2013 and 7/31/2013
	2 Sample(s) Required between 8/1/2013 and 8/31/2013
	2 Sample(s) Required between 9/1/2013 and 9/30/2013
	2 Sample(s) Required between 10/1/2013 and 10/31/2013
	2 Sample(s) Required between 11/1/2013 and 11/30/2013
	2 Sample(s) Required between 12/1/2013 and 12/31/2013

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: MILAN, VILLAGE OF DISTRIBUTION 58 LOCKWOOD RD	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/1/2013 and 2/7/2013
	1 Sample(s) Required between 5/1/2013 and 5/7/2013
	1 Sample(s) Required between 8/1/2013 and 8/7/2013
	1 Sample(s) Required between 11/1/2013 and 11/7/2013

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950



OH2201212 MILAN VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2013**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: MILAN, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
	SMP ID: DS202	13317 RILEY RD	

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/1/2013 and 2/7/2013
	1 Sample(s) Required between 5/1/2013 and 5/7/2013
	1 Sample(s) Required between 8/1/2013 and 8/7/2013
	1 Sample(s) Required between 11/1/2013 and 11/7/2013

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950



OH2201411 SANDUSKY CITY

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 2253916	Facility Name: SANDUSKY CITY	Facility Class: CLASS 4
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2013**

Chemicals	Monitoring Requirements		
INORGANICS	1 Sample(s) Required between 1/1/2013 and 5/31/2013		
<i>Sample for all the analytes listed below:</i>			
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020			
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085			
NITRITE - 1041	Not Required		
NITRATE - 1040	1 Sample(s) Required between	1/1/2013 and	1/31/2013
	1 Sample(s) Required between	2/1/2013 and	2/28/2013
	1 Sample(s) Required between	3/1/2013 and	3/31/2013
	1 Sample(s) Required between	4/1/2013 and	4/30/2013
	1 Sample(s) Required between	5/1/2013 and	5/31/2013
	1 Sample(s) Required between	6/1/2013 and	6/30/2013
	1 Sample(s) Required between	7/1/2013 and	7/31/2013
	1 Sample(s) Required between	8/1/2013 and	8/31/2013
	1 Sample(s) Required between	9/1/2013 and	9/30/2013
	1 Sample(s) Required between	10/1/2013 and	10/31/2013
	1 Sample(s) Required between	11/1/2013 and	11/30/2013
	1 Sample(s) Required between	12/1/2013 and	12/31/2013
RADIOLOGICALS	Not Required		
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	4/1/2013 and	4/30/2013
	1 Sample(s) Required between	5/1/2013 and	5/31/2013
	1 Sample(s) Required between	6/1/2013 and	6/30/2013
<i>Sample for all the analytes listed below:</i>			
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037			
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	1/1/2013 and	3/31/2013
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between	1/1/2013 and	1/31/2013
	1 Paired Sample Set Required between	2/1/2013 and	2/28/2013
	1 Paired Sample Set Required between	3/1/2013 and	3/31/2013
	1 Paired Sample Set Required between	4/1/2013 and	4/30/2013
	1 Paired Sample Set Required between	5/1/2013 and	5/31/2013
	1 Paired Sample Set Required between	6/1/2013 and	6/30/2013
	1 Paired Sample Set Required between	7/1/2013 and	7/31/2013
	1 Paired Sample Set Required between	8/1/2013 and	8/31/2013
	1 Paired Sample Set Required between	9/1/2013 and	9/30/2013
	1 Paired Sample Set Required between	10/1/2013 and	10/31/2013
	1 Paired Sample Set Required between	11/1/2013 and	11/30/2013
	1 Paired Sample Set Required between	12/1/2013 and	12/31/2013

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



OH2201411 SANDUSKY CITY

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2013

DISTRIBUTION MONITORING SCHEDULE

Table with 4 columns: Sampling Location, Facility ID, Facility Name, Facility Class. Values: DS1, SANDUSKY, CITY OF DISTRIBUTION, CLASS 2.

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100 30 Sample(s) Required between 1/1/2013 and 1/31/2013 ... 12/1/2013 and 12/31/2013

TOTAL CHLORINE - 1000 30 Sample(s) Required between 1/1/2013 and 1/31/2013 ... 12/1/2013 and 12/31/2013

Samples should be collected at the same time and place as the Total Coliform samples.

Table with 4 columns: Sampling Location, Facility ID, Facility Name, Facility Class. Values: DS201, SANDUSKY, CITY OF DISTRIBUTION, CLASS 2.

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 3/1/2013 and 3/7/2013 ... 12/1/2013 and 12/7/2013

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950

OH2201411 SANDUSKY CITY

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2013**
DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: SANDUSKY, CITY OF DISTRIBUTION 795 BARDSHAR RD.	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 3/1/2013 and 3/7/2013
	1 Sample(s) Required between 6/1/2013 and 6/7/2013
	1 Sample(s) Required between 9/1/2013 and 9/7/2013
	1 Sample(s) Required between 12/1/2013 and 12/7/2013

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS203	Facility Name: SANDUSKY, CITY OF DISTRIBUTION 2235 STAHLWOOD DR.	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 3/1/2013 and 3/7/2013
	1 Sample(s) Required between 6/1/2013 and 6/7/2013
	1 Sample(s) Required between 9/1/2013 and 9/7/2013
	1 Sample(s) Required between 12/1/2013 and 12/7/2013

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS204	Facility Name: SANDUSKY, CITY OF DISTRIBUTION 1024 CEMENT AVE.	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 3/1/2013 and 3/7/2013
	1 Sample(s) Required between 6/1/2013 and 6/7/2013
	1 Sample(s) Required between 9/1/2013 and 9/7/2013
	1 Sample(s) Required between 12/1/2013 and 12/7/2013

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950



OH2201511 VERMILION CITY

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 2253917	Facility Name: VERMILION CITY	Facility Class: CLASS 3
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2013**

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 1/1/2013 and 5/31/2013

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2013 and 1/31/2013
 1 Sample(s) Required between 2/1/2013 and 2/28/2013
 1 Sample(s) Required between 3/1/2013 and 3/31/2013
 1 Sample(s) Required between 4/1/2013 and 4/30/2013
 1 Sample(s) Required between 5/1/2013 and 5/31/2013
 1 Sample(s) Required between 6/1/2013 and 6/30/2013
 1 Sample(s) Required between 7/1/2013 and 7/31/2013
 1 Sample(s) Required between 8/1/2013 and 8/31/2013
 1 Sample(s) Required between 9/1/2013 and 9/30/2013
 1 Sample(s) Required between 10/1/2013 and 10/31/2013
 1 Sample(s) Required between 11/1/2013 and 11/30/2013
 1 Sample(s) Required between 12/1/2013 and 12/31/2013

RADIOLOGICALS Not Required

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1

1 Sample(s) Required between 4/1/2013 and 4/30/2013
 1 Sample(s) Required between 5/1/2013 and 5/31/2013
 1 Sample(s) Required between 6/1/2013 and 6/30/2013

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 4/1/2013 and 6/30/2013

TOTAL ORGANIC CARBON (TOC)

1 Paired Sample Set Required between 1/1/2013 and 1/31/2013
 1 Paired Sample Set Required between 2/1/2013 and 2/28/2013
 1 Paired Sample Set Required between 3/1/2013 and 3/31/2013
 1 Paired Sample Set Required between 4/1/2013 and 4/30/2013
 1 Paired Sample Set Required between 5/1/2013 and 5/31/2013
 1 Paired Sample Set Required between 6/1/2013 and 6/30/2013
 1 Paired Sample Set Required between 7/1/2013 and 7/31/2013
 1 Paired Sample Set Required between 8/1/2013 and 8/31/2013
 1 Paired Sample Set Required between 9/1/2013 and 9/30/2013
 1 Paired Sample Set Required between 10/1/2013 and 10/31/2013
 1 Paired Sample Set Required between 11/1/2013 and 11/30/2013
 1 Paired Sample Set Required between 12/1/2013 and 12/31/2013

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



OH2201511 VERMILION CITY

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2013

DISTRIBUTION MONITORING SCHEDULE

Table with 4 columns: Sampling Location, Facility ID, Facility Name, Facility Class. Values: DS1, VERMILION, CITY OF DISTRIBUTION, CLASS 1.

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100 10 Sample(s) Required between 1/1/2013 and 1/31/2013 ... 12/1/2013 and 12/31/2013

TOTAL CHLORINE - 1000 10 Sample(s) Required between 1/1/2013 and 1/31/2013 ... 12/1/2013 and 12/31/2013

Samples should be collected at the same time and place as the Total Coliform samples.

Table with 4 columns: Sampling Location, Facility ID, Facility Name, Facility Class. Values: DS201, HELEN DR. @ LIBERTY, CLASS 1.

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 1/1/2013 and 1/7/2013 ... 10/1/2013 and 10/7/2013

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950



OH2201511 VERMILION CITY

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2013

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: VERMILION, CITY OF DISTRIBUTION 1141 VERMILION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/1/2013 and 1/7/2013
	1 Sample(s) Required between 4/1/2013 and 4/7/2013
	1 Sample(s) Required between 7/1/2013 and 7/7/2013
	1 Sample(s) Required between 10/1/2013 and 10/7/2013

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS203	Facility Name: VERMILION, CITY OF DISTRIBUTION HTMH POORMAN RD.	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/1/2013 and 1/7/2013
	1 Sample(s) Required between 4/1/2013 and 4/7/2013
	1 Sample(s) Required between 7/1/2013 and 7/7/2013
	1 Sample(s) Required between 10/1/2013 and 10/7/2013

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS204	Facility Name: VERMILION, CITY OF DISTRIBUTION 960 SUNNYSIDE RD.	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/1/2013 and 1/7/2013
	1 Sample(s) Required between 4/1/2013 and 4/7/2013
	1 Sample(s) Required between 7/1/2013 and 7/7/2013
	1 Sample(s) Required between 10/1/2013 and 10/7/2013

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950



OH2201703 ERIE CO VERMILION W DISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2013

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: ERIE CO WATER VERMILION WEST DISTRICT Facility Class: CLASS 1
Location SMP ID: DS000

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2013 and 9/30/2013

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: http://epa.ohio.gov/ddagw/reporting.aspx

TOTAL COLIFORM (TCR) - 3100 1 Sample(s) Required between 1/1/2013 and 1/31/2013
1 Sample(s) Required between 2/1/2013 and 2/28/2013
1 Sample(s) Required between 3/1/2013 and 3/31/2013
1 Sample(s) Required between 4/1/2013 and 4/30/2013
1 Sample(s) Required between 5/1/2013 and 5/31/2013
1 Sample(s) Required between 6/1/2013 and 6/30/2013
1 Sample(s) Required between 7/1/2013 and 7/31/2013
1 Sample(s) Required between 8/1/2013 and 8/31/2013
1 Sample(s) Required between 9/1/2013 and 9/30/2013
1 Sample(s) Required between 10/1/2013 and 10/31/2013
1 Sample(s) Required between 11/1/2013 and 11/30/2013
1 Sample(s) Required between 12/1/2013 and 12/31/2013

TOTAL CHLORINE - 1000 1 Sample(s) Required between 1/1/2013 and 1/31/2013
1 Sample(s) Required between 2/1/2013 and 2/28/2013
1 Sample(s) Required between 3/1/2013 and 3/31/2013
1 Sample(s) Required between 4/1/2013 and 4/30/2013
1 Sample(s) Required between 5/1/2013 and 5/31/2013
1 Sample(s) Required between 6/1/2013 and 6/30/2013
1 Sample(s) Required between 7/1/2013 and 7/31/2013
1 Sample(s) Required between 8/1/2013 and 8/31/2013
1 Sample(s) Required between 9/1/2013 and 9/30/2013
1 Sample(s) Required between 10/1/2013 and 10/31/2013
1 Sample(s) Required between 11/1/2013 and 11/30/2013
1 Sample(s) Required between 12/1/2013 and 12/31/2013

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Facility ID: DS1 Facility Name: ERIE CO WATER VERMILION WEST DISTRICT Facility Class: CLASS 1
Location SMP ID: DS201 BARNES ROAD

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 11/8/2013 and 11/14/2013

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950



OH2201803 NORTHERN OHIO RURAL WATER - NW DISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2013**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **NORTHERN OHIO RURAL WATER - NW DISTR** Facility Class: **CLASS 1**
SMP ID: **DS000**

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

TOTAL COLIFORM (TCR) - 3100
6 Sample(s) Required between 1/1/2013 and 1/31/2013
6 Sample(s) Required between 2/1/2013 and 2/28/2013
6 Sample(s) Required between 3/1/2013 and 3/31/2013
6 Sample(s) Required between 4/1/2013 and 4/30/2013
6 Sample(s) Required between 5/1/2013 and 5/31/2013
6 Sample(s) Required between 6/1/2013 and 6/30/2013
6 Sample(s) Required between 7/1/2013 and 7/31/2013
6 Sample(s) Required between 8/1/2013 and 8/31/2013
6 Sample(s) Required between 9/1/2013 and 9/30/2013
6 Sample(s) Required between 10/1/2013 and 10/31/2013
6 Sample(s) Required between 11/1/2013 and 11/30/2013
6 Sample(s) Required between 12/1/2013 and 12/31/2013

TOTAL CHLORINE - 1000
6 Sample(s) Required between 1/1/2013 and 1/31/2013
6 Sample(s) Required between 2/1/2013 and 2/28/2013
6 Sample(s) Required between 3/1/2013 and 3/31/2013
6 Sample(s) Required between 4/1/2013 and 4/30/2013
6 Sample(s) Required between 5/1/2013 and 5/31/2013
6 Sample(s) Required between 6/1/2013 and 6/30/2013
6 Sample(s) Required between 7/1/2013 and 7/31/2013
6 Sample(s) Required between 8/1/2013 and 8/31/2013
6 Sample(s) Required between 9/1/2013 and 9/30/2013
6 Sample(s) Required between 10/1/2013 and 10/31/2013
6 Sample(s) Required between 11/1/2013 and 11/30/2013
6 Sample(s) Required between 12/1/2013 and 12/31/2013

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: **DS1** Facility Name: **NORTHERN OHIO RURAL WATER - NW DISTR** Facility Class: **CLASS 1**
SMP ID: **DS201** **CR 212 SAMPLING STATION**

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS
1 Sample(s) Required between 2/1/2013 and 2/7/2013
1 Sample(s) Required between 5/1/2013 and 5/7/2013
1 Sample(s) Required between 8/1/2013 and 8/7/2013
1 Sample(s) Required between 11/1/2013 and 11/7/2013

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950



OH2201803 NORTHERN OHIO RURAL WATER - NW DISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2013**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: NORTHERN OHIO RURAL WATER - NW DISTR	Facility Class: CLASS 1
	SMP ID: DS202	CR 185 AND CR 195 SAMPLING STA'	

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/1/2013 and 2/7/2013
	1 Sample(s) Required between 5/1/2013 and 5/7/2013
	1 Sample(s) Required between 8/1/2013 and 8/7/2013
	1 Sample(s) Required between 11/1/2013 and 11/7/2013

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 TTHM - 2950

OH2230411 CAMP PATMOS

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CAMP PATMOS DISTRIBUTION
Location SMP ID: DS000	Facility Source: Surface Water
Facility Class: CLASS 1	


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	4 Sample(s) Required between 5/1/2013 and 5/31/2013
	4 Sample(s) Required between 6/1/2013 and 6/30/2013
	4 Sample(s) Required between 7/1/2013 and 7/31/2013
	4 Sample(s) Required between 8/1/2013 and 8/31/2013
	4 Sample(s) Required between 9/1/2013 and 9/30/2013
	4 Sample(s) Required between 10/1/2013 and 10/31/2013

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 2253920	Facility Name: CAMP PATMOS
Location SMP ID: EP001	Facility Source: Surface Water
Facility Class: CLASS 3	

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 5/1/2013 and 5/31/2013
	1 Sample(s) Required between 6/1/2013 and 6/30/2013
	1 Sample(s) Required between 7/1/2013 and 7/31/2013
	1 Sample(s) Required between 8/1/2013 and 8/31/2013
	1 Sample(s) Required between 9/1/2013 and 9/30/2013
	1 Sample(s) Required between 10/1/2013 and 10/31/2013

Where to Collect Samples For a Small Public Water System

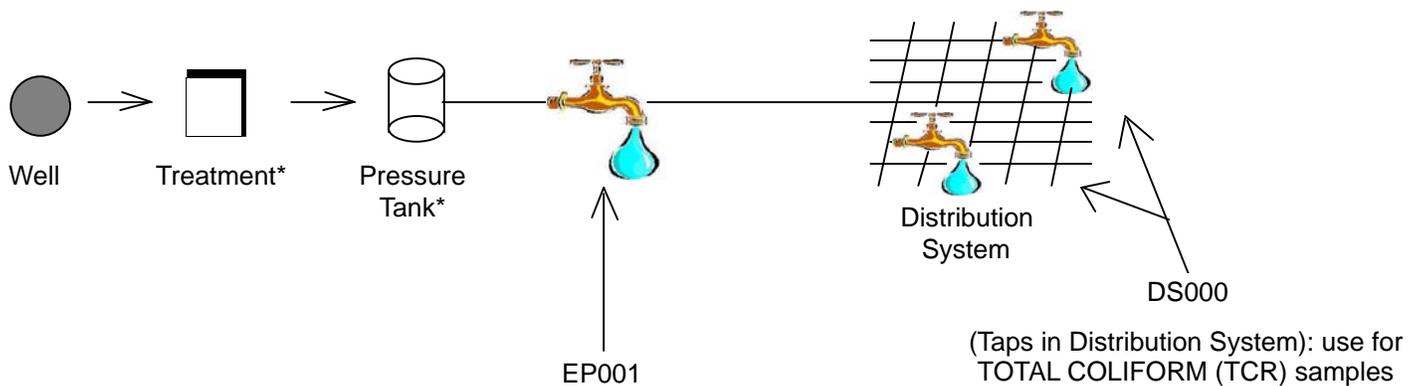

(First available tap after treatment*): use for NITRATE and NITRITE samples

* If system does not have treatment, EP001 is the first tap after the well.