



**OH0700011 BARNESVILLE**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>752965</b>	Facility Name: <b>BARNESVILLE</b>	Facility Class: <b>CLASS 3</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Surface Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014**

Chemicals	Monitoring Requirements
-----------	-------------------------

INORGANICS	1 Sample(s) Required between 1/1/2014 and 5/31/2014
------------	---

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020  
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2014 and 1/31/2014
	1 Sample(s) Required between 2/1/2014 and 2/28/2014
	1 Sample(s) Required between 3/1/2014 and 3/31/2014
	1 Sample(s) Required between 4/1/2014 and 4/30/2014
	1 Sample(s) Required between 5/1/2014 and 5/31/2014
	1 Sample(s) Required between 6/1/2014 and 6/30/2014
	1 Sample(s) Required between 7/1/2014 and 7/31/2014
	1 Sample(s) Required between 8/1/2014 and 8/31/2014
	1 Sample(s) Required between 9/1/2014 and 9/30/2014
	1 Sample(s) Required between 10/1/2014 and 10/31/2014
	1 Sample(s) Required between 11/1/2014 and 11/30/2014
	1 Sample(s) Required between 12/1/2014 and 12/31/2014

RADIOLOGICALS	1 Sample(s) Required between 1/1/2014 and 5/31/2014
---------------	---

Sample for all the analytes listed below:

GROSS ALPHA - 4002 RADIUM-228 - 4030

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2014 and 6/30/2014
---	---

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2014 and 5/31/2014
----------------------------------	---



**OH0700011 BARNESVILLE**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>BARNESVILLE, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

<b>Chemicals</b>	<b>Monitoring Requirements</b>
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

TOTAL COLIFORM (TCR) - 3100	7 Sample(s) Required between 1/1/2014 and 1/31/2014
	7 Sample(s) Required between 2/1/2014 and 2/28/2014
	7 Sample(s) Required between 3/1/2014 and 3/31/2014
	7 Sample(s) Required between 4/1/2014 and 4/30/2014
	7 Sample(s) Required between 5/1/2014 and 5/31/2014
	7 Sample(s) Required between 6/1/2014 and 6/30/2014
	7 Sample(s) Required between 7/1/2014 and 7/31/2014
	7 Sample(s) Required between 8/1/2014 and 8/31/2014
	7 Sample(s) Required between 9/1/2014 and 9/30/2014
	7 Sample(s) Required between 10/1/2014 and 10/31/2014
	7 Sample(s) Required between 11/1/2014 and 11/30/2014
	7 Sample(s) Required between 12/1/2014 and 12/31/2014

TOTAL CHLORINE - 1000	7 Sample(s) Required between 1/1/2014 and 1/31/2014
	7 Sample(s) Required between 2/1/2014 and 2/28/2014
	7 Sample(s) Required between 3/1/2014 and 3/31/2014
	7 Sample(s) Required between 4/1/2014 and 4/30/2014
	7 Sample(s) Required between 5/1/2014 and 5/31/2014
	7 Sample(s) Required between 6/1/2014 and 6/30/2014
	7 Sample(s) Required between 7/1/2014 and 7/31/2014
	7 Sample(s) Required between 8/1/2014 and 8/31/2014
	7 Sample(s) Required between 9/1/2014 and 9/30/2014
	7 Sample(s) Required between 10/1/2014 and 10/31/2014
	7 Sample(s) Required between 11/1/2014 and 11/30/2014
	7 Sample(s) Required between 12/1/2014 and 12/31/2014

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>BARNESVILLE, VILLAGE OF DISTRIBUTION</b> <b>36460 BARNESVILLE-BETHESDA RC</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

<b>Chemicals</b>	<b>Monitoring Requirements</b>
------------------	--------------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/1/2014 and 1/7/2014 at SMP: DS201
	1 Sample(s) Required between 4/1/2014 and 4/7/2014 at SMP: DS201
	1 Sample(s) Required between 7/1/2014 and 7/7/2014 at SMP: DS201
	1 Sample(s) Required between 10/1/2014 and 10/7/2014 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH0700011 BARNESVILLE**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>BARNESVILLE, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>DS202</b>	<b>598 WATT AVENUE</b>	

<b>Chemicals</b>	<b>Monitoring Requirements</b>		
DISINFECTION BYPRODUCTS	1 Sample(s) Required between	1/1/2014 and	1/7/2014 at SMP: DS202
	1 Sample(s) Required between	4/1/2014 and	4/7/2014 at SMP: DS202
	1 Sample(s) Required between	7/1/2014 and	7/7/2014 at SMP: DS202
	1 Sample(s) Required between	10/1/2014 and	10/7/2014 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH0700114 BELLAIRE PUBLIC WATER SYSTEM

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>752966</b>	Facility Name: <b>BELLAIRE PWS</b>	Facility Class: <b>CLASS 3</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Surface Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014

Chemicals	Monitoring Requirements
-----------	-------------------------

INORGANICS	1 Sample(s) Required between 1/1/2014 and 5/31/2014
------------	---

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020  
 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2014 and 1/31/2014
	1 Sample(s) Required between 2/1/2014 and 2/28/2014
	1 Sample(s) Required between 3/1/2014 and 3/31/2014
	1 Sample(s) Required between 4/1/2014 and 4/30/2014
	1 Sample(s) Required between 5/1/2014 and 5/31/2014
	1 Sample(s) Required between 6/1/2014 and 6/30/2014
	1 Sample(s) Required between 7/1/2014 and 7/31/2014
	1 Sample(s) Required between 8/1/2014 and 8/31/2014
	1 Sample(s) Required between 9/1/2014 and 9/30/2014
	1 Sample(s) Required between 10/1/2014 and 10/31/2014
	1 Sample(s) Required between 11/1/2014 and 11/30/2014
	1 Sample(s) Required between 12/1/2014 and 12/31/2014

RADIOLOGICALS	1 Sample(s) Required between 1/1/2014 and 5/31/2014
---------------	---

Sample for all the analytes listed below:

GROSS ALPHA - 4002 RADIUM-228 - 4030

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2014 and 6/30/2014
---	---

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2014 and 3/31/2014
	1 Sample(s) Required between 4/1/2014 and 6/30/2014
	1 Sample(s) Required between 7/1/2014 and 9/30/2014
	1 Sample(s) Required between 10/1/2014 and 12/31/2014

TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 1/1/2014 and 1/31/2014
	1 Paired Sample Set Required between 2/1/2014 and 2/28/2014
	1 Paired Sample Set Required between 3/1/2014 and 3/31/2014
	1 Paired Sample Set Required between 4/1/2014 and 4/30/2014
	1 Paired Sample Set Required between 5/1/2014 and 5/31/2014
	1 Paired Sample Set Required between 6/1/2014 and 6/30/2014
	1 Paired Sample Set Required between 7/1/2014 and 7/31/2014
	1 Paired Sample Set Required between 8/1/2014 and 8/31/2014
	1 Paired Sample Set Required between 9/1/2014 and 9/30/2014
	1 Paired Sample Set Required between 10/1/2014 and 10/31/2014
	1 Paired Sample Set Required between 11/1/2014 and 11/30/2014
	1 Paired Sample Set Required between 12/1/2014 and 12/31/2014

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



**OH0700114 BELLAIRE PUBLIC WATER SYSTEM**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>BELLAIRE DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required
ASBESTOS - 1094	Not Required
TOTAL COLIFORM (TCR) - 3100	5 Sample(s) Required between 1/1/2014 and 1/31/2014 5 Sample(s) Required between 2/1/2014 and 2/28/2014 5 Sample(s) Required between 3/1/2014 and 3/31/2014 5 Sample(s) Required between 4/1/2014 and 4/30/2014 5 Sample(s) Required between 5/1/2014 and 5/31/2014 5 Sample(s) Required between 6/1/2014 and 6/30/2014 5 Sample(s) Required between 7/1/2014 and 7/31/2014 5 Sample(s) Required between 8/1/2014 and 8/31/2014 5 Sample(s) Required between 9/1/2014 and 9/30/2014 5 Sample(s) Required between 10/1/2014 and 10/31/2014 5 Sample(s) Required between 11/1/2014 and 11/30/2014 5 Sample(s) Required between 12/1/2014 and 12/31/2014
TOTAL CHLORINE - 1000	5 Sample(s) Required between 1/1/2014 and 1/31/2014 5 Sample(s) Required between 2/1/2014 and 2/28/2014 5 Sample(s) Required between 3/1/2014 and 3/31/2014 5 Sample(s) Required between 4/1/2014 and 4/30/2014 5 Sample(s) Required between 5/1/2014 and 5/31/2014 5 Sample(s) Required between 6/1/2014 and 6/30/2014 5 Sample(s) Required between 7/1/2014 and 7/31/2014 5 Sample(s) Required between 8/1/2014 and 8/31/2014 5 Sample(s) Required between 9/1/2014 and 9/30/2014 5 Sample(s) Required between 10/1/2014 and 10/31/2014 5 Sample(s) Required between 11/1/2014 and 11/30/2014 5 Sample(s) Required between 12/1/2014 and 12/31/2014

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>BELLAIRE DISTRIBUTION</b> <b>57625 PINCH RUN RD</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2014 and 9/30/2014 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH0700114 BELLAIRE PUBLIC WATER SYSTEM**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>BELLAIRE DISTRIBUTION</b> <b>6000 NORTH GUERNSEY ST</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

<b>Chemicals</b>	<b>Monitoring Requirements</b>
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2014 and 9/30/2014 at SMP: DS202

*Sample for all the analytes listed below:*

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH0700315 BELMONT PUBLIC WATER SYSTEM**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>752968</b>	Facility Name: <b>BELMONT PUBLIC WATER SYSTEM STU 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>
		Facility Class: <b>CLASS 1</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	1 Sample(s) Required between 1/1/2014 and 5/31/2014
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2014 and 3/31/2014
RADIOLOGICALS	1 Sample(s) Required between 1/1/2014 and 5/31/2014
<i>Sample for all the analytes listed below:</i>	
GROSS ALPHA - 4002 RADIUM-228 - 4030	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2014 and 5/31/2014
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 3	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2014 and 5/31/2014



**OH0700315 BELMONT PUBLIC WATER SYSTEM**

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>BELMONT, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2014 and	1/31/2014
	1 Sample(s) Required between	2/1/2014 and	2/28/2014
	1 Sample(s) Required between	3/1/2014 and	3/31/2014
	1 Sample(s) Required between	4/1/2014 and	4/30/2014
	1 Sample(s) Required between	5/1/2014 and	5/31/2014
	1 Sample(s) Required between	6/1/2014 and	6/30/2014
	1 Sample(s) Required between	7/1/2014 and	7/31/2014
	1 Sample(s) Required between	8/1/2014 and	8/31/2014
	1 Sample(s) Required between	9/1/2014 and	9/30/2014
	1 Sample(s) Required between	10/1/2014 and	10/31/2014
	1 Sample(s) Required between	11/1/2014 and	11/30/2014
	1 Sample(s) Required between	12/1/2014 and	12/31/2014

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2014 and	1/31/2014
	1 Sample(s) Required between	2/1/2014 and	2/28/2014
	1 Sample(s) Required between	3/1/2014 and	3/31/2014
	1 Sample(s) Required between	4/1/2014 and	4/30/2014
	1 Sample(s) Required between	5/1/2014 and	5/31/2014
	1 Sample(s) Required between	6/1/2014 and	6/30/2014
	1 Sample(s) Required between	7/1/2014 and	7/31/2014
	1 Sample(s) Required between	8/1/2014 and	8/31/2014
	1 Sample(s) Required between	9/1/2014 and	9/30/2014
	1 Sample(s) Required between	10/1/2014 and	10/31/2014
	1 Sample(s) Required between	11/1/2014 and	11/30/2014
	1 Sample(s) Required between	12/1/2014 and	12/31/2014

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>BELMONT, VILLAGE OF DISTRIBUTION</b> <b>42481 GREEN ST.</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2014 and 9/30/2014 at SMP: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH0700315 BELMONT PUBLIC WATER SYSTEM**

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>BELMONT, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>DS202</b>	<b>HYDRANT 321 E. MAIN ST.</b>	

<b>Chemicals</b>	<b>Monitoring Requirements</b>
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2014 and 9/30/2014 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH0700412 BELMONT CO. SANITARY DISTRICT 3 PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>752969</b>	Facility Name: <b>BELMONT CO SD 3</b>	Facility Class: <b>CLASS 3</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 1/1/2014 and 5/31/2014
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2014 and 5/31/2014
RADIOLOGICALS	1 Sample(s) Required between 1/1/2014 and 5/31/2014
<i>Sample for all the analytes listed below:</i>	
GROSS ALPHA - 4002 RADIUM-228 - 4030	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2014 and 5/31/2014
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 4/1/2014 and 6/30/2014



**OH0700412 BELMONT CO. SANITARY DISTRICT 3 PWS**

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>BELMONT CO. SAN. DIST. 3 DISTRIBUTION</b>	Facility Class: <b>CLASS 2</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	30 Sample(s) Required between 6/1/2014 and 9/30/2014
-------------------------------	--

*Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>*

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	25 Sample(s) Required between 1/1/2014 and 1/31/2014
	25 Sample(s) Required between 2/1/2014 and 2/28/2014
	25 Sample(s) Required between 3/1/2014 and 3/31/2014
	25 Sample(s) Required between 4/1/2014 and 4/30/2014
	25 Sample(s) Required between 5/1/2014 and 5/31/2014
	25 Sample(s) Required between 6/1/2014 and 6/30/2014
	25 Sample(s) Required between 7/1/2014 and 7/31/2014
	25 Sample(s) Required between 8/1/2014 and 8/31/2014
	25 Sample(s) Required between 9/1/2014 and 9/30/2014
	25 Sample(s) Required between 10/1/2014 and 10/31/2014
	25 Sample(s) Required between 11/1/2014 and 11/30/2014
	25 Sample(s) Required between 12/1/2014 and 12/31/2014

TOTAL CHLORINE - 1000	25 Sample(s) Required between 1/1/2014 and 1/31/2014
	25 Sample(s) Required between 2/1/2014 and 2/28/2014
	25 Sample(s) Required between 3/1/2014 and 3/31/2014
	25 Sample(s) Required between 4/1/2014 and 4/30/2014
	25 Sample(s) Required between 5/1/2014 and 5/31/2014
	25 Sample(s) Required between 6/1/2014 and 6/30/2014
	25 Sample(s) Required between 7/1/2014 and 7/31/2014
	25 Sample(s) Required between 8/1/2014 and 8/31/2014
	25 Sample(s) Required between 9/1/2014 and 9/30/2014
	25 Sample(s) Required between 10/1/2014 and 10/31/2014
	25 Sample(s) Required between 11/1/2014 and 11/30/2014
	25 Sample(s) Required between 12/1/2014 and 12/31/2014

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>BELMONT CO. SAN. DIST. 3 DISTRIBUTION</b> <b>COUNTY GARAGE ARMSTRONG MII</b>	Facility Class: <b>CLASS 2</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/8/2014 and 1/14/2014 at SMP: DS201
	1 Sample(s) Required between 4/8/2014 and 4/14/2014 at SMP: DS201
	1 Sample(s) Required between 7/8/2014 and 7/14/2014 at SMP: DS201

**OH0700412 BELMONT CO. SANITARY DISTRICT 3 PWS**

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014****DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>BELMONT CO. SAN. DIST. 3 DISTRIBUTION</b> <b>COUNTY GARAGE ARMSTRONG MII</b>	Facility Class: <b>CLASS 2</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 10/8/2014 and 10/14/2014 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>BELMONT CO. SAN. DIST. 3 DISTRIBUTION</b> <b>69841 STATE ROUTE 149</b>	Facility Class: <b>CLASS 2</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/8/2014 and 1/14/2014 at SMP: DS202
	1 Sample(s) Required between 4/8/2014 and 4/14/2014 at SMP: DS202
	1 Sample(s) Required between 7/8/2014 and 7/14/2014 at SMP: DS202
	1 Sample(s) Required between 10/8/2014 and 10/14/2014 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS203</b>	Facility Name: <b>BELMONT CO. SAN. DIST. 3 DISTRIBUTION</b> <b>MEAD TWP. GARAGE</b>	Facility Class: <b>CLASS 2</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/8/2014 and 1/14/2014 at SMP: DS203
	1 Sample(s) Required between 4/8/2014 and 4/14/2014 at SMP: DS203
	1 Sample(s) Required between 7/8/2014 and 7/14/2014 at SMP: DS203
	1 Sample(s) Required between 10/8/2014 and 10/14/2014 at SMP: DS203

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS204</b>	Facility Name: <b>BELMONT CO. SAN. DIST. 3 DISTRIBUTION</b> <b>BCSSD OFFICE ST. RT. 331</b>	Facility Class: <b>CLASS 2</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/8/2014 and 1/14/2014 at SMP: DS204
	1 Sample(s) Required between 4/8/2014 and 4/14/2014 at SMP: DS204
	1 Sample(s) Required between 7/8/2014 and 7/14/2014 at SMP: DS204
	1 Sample(s) Required between 10/8/2014 and 10/14/2014 at SMP: DS204

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

**OH0700511 BETHESDA PUBLIC WATER SYSTEM**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014****DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>BETHESDA, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required
ASBESTOS - 1094	Not Required
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2014 and 1/31/2014 2 Sample(s) Required between 2/1/2014 and 2/28/2014 2 Sample(s) Required between 3/1/2014 and 3/31/2014 2 Sample(s) Required between 4/1/2014 and 4/30/2014 2 Sample(s) Required between 5/1/2014 and 5/31/2014 2 Sample(s) Required between 6/1/2014 and 6/30/2014 2 Sample(s) Required between 7/1/2014 and 7/31/2014 2 Sample(s) Required between 8/1/2014 and 8/31/2014 2 Sample(s) Required between 9/1/2014 and 9/30/2014 2 Sample(s) Required between 10/1/2014 and 10/31/2014 2 Sample(s) Required between 11/1/2014 and 11/30/2014 2 Sample(s) Required between 12/1/2014 and 12/31/2014
TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2014 and 1/31/2014 2 Sample(s) Required between 2/1/2014 and 2/28/2014 2 Sample(s) Required between 3/1/2014 and 3/31/2014 2 Sample(s) Required between 4/1/2014 and 4/30/2014 2 Sample(s) Required between 5/1/2014 and 5/31/2014 2 Sample(s) Required between 6/1/2014 and 6/30/2014 2 Sample(s) Required between 7/1/2014 and 7/31/2014 2 Sample(s) Required between 8/1/2014 and 8/31/2014 2 Sample(s) Required between 9/1/2014 and 9/30/2014 2 Sample(s) Required between 10/1/2014 and 10/31/2014 2 Sample(s) Required between 11/1/2014 and 11/30/2014 2 Sample(s) Required between 12/1/2014 and 12/31/2014

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>BETHESDA, VILLAGE OF DISTRIBUTION</b> <b>429 SOUTH MAIN STREET</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/1/2014 and 1/7/2014 at SMP: DS201 1 Sample(s) Required between 4/1/2014 and 4/7/2014 at SMP: DS201 1 Sample(s) Required between 7/1/2014 and 7/7/2014 at SMP: DS201 1 Sample(s) Required between 10/1/2014 and 10/7/2014 at SMP: DS201

**Sample for all the analytes listed below:**

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH0700511 BETHESDA PUBLIC WATER SYSTEM**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>BETHESDA, VILLAGE OF DISTRIBUTION</b> <b>112 SOUTH MAIN ST</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

<b>Chemicals</b>	<b>Monitoring Requirements</b>
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/1/2014 and 1/7/2014 at SMP: DS202
	1 Sample(s) Required between 4/1/2014 and 4/7/2014 at SMP: DS202
	1 Sample(s) Required between 7/1/2014 and 7/7/2014 at SMP: DS202
	1 Sample(s) Required between 10/1/2014 and 10/7/2014 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH0700612 BRIDGEPORT PUBLIC WATER SYSTEM**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>752971</b>	Facility Name: <b>BRIDGEPORT WTP</b>	Facility Class: <b>CLASS 2</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	1 Sample(s) Required between 1/1/2014 and 5/31/2014
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2014 and 5/31/2014
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2014 and 5/31/2014
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 2	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 3	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 4	1 Sample(s) Required between 4/1/2014 and 6/30/2014
<i>Sample for all the analytes listed below:</i>	
BENZO (A) PYRENE - 2306 DI(2-ETHYLHEXYL) - ADIPATE - 2035 DI(2-ETHYLHEXYL) - PHTHALATE - 2039 ENDOTHALL - 2033	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2014 and 3/31/2014 1 Sample(s) Required between 4/1/2014 and 6/30/2014 1 Sample(s) Required between 7/1/2014 and 9/30/2014 1 Sample(s) Required between 10/1/2014 and 12/31/2014



**OH0700612 BRIDGEPORT PUBLIC WATER SYSTEM**

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>BRIDGEPORT, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

TOTAL COLIFORM (TCR) - 3100	3 Sample(s) Required between	1/1/2014 and 1/31/2014
	3 Sample(s) Required between	2/1/2014 and 2/28/2014
	3 Sample(s) Required between	3/1/2014 and 3/31/2014
	3 Sample(s) Required between	4/1/2014 and 4/30/2014
	3 Sample(s) Required between	5/1/2014 and 5/31/2014
	3 Sample(s) Required between	6/1/2014 and 6/30/2014
	3 Sample(s) Required between	7/1/2014 and 7/31/2014
	3 Sample(s) Required between	8/1/2014 and 8/31/2014
	3 Sample(s) Required between	9/1/2014 and 9/30/2014
	3 Sample(s) Required between	10/1/2014 and 10/31/2014
	3 Sample(s) Required between	11/1/2014 and 11/30/2014
	3 Sample(s) Required between	12/1/2014 and 12/31/2014

TOTAL CHLORINE - 1000	3 Sample(s) Required between	1/1/2014 and 1/31/2014
	3 Sample(s) Required between	2/1/2014 and 2/28/2014
	3 Sample(s) Required between	3/1/2014 and 3/31/2014
	3 Sample(s) Required between	4/1/2014 and 4/30/2014
	3 Sample(s) Required between	5/1/2014 and 5/31/2014
	3 Sample(s) Required between	6/1/2014 and 6/30/2014
	3 Sample(s) Required between	7/1/2014 and 7/31/2014
	3 Sample(s) Required between	8/1/2014 and 8/31/2014
	3 Sample(s) Required between	9/1/2014 and 9/30/2014
	3 Sample(s) Required between	10/1/2014 and 10/31/2014
	3 Sample(s) Required between	11/1/2014 and 11/30/2014
	3 Sample(s) Required between	12/1/2014 and 12/31/2014

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>BRIDGEPORT, VILLAGE OF DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2014 and 9/30/2014 at SMP: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH0700612 BRIDGEPORT PUBLIC WATER SYSTEM**

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>BRIDGEPORT, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>DS202</b>	<b>ADDRESS NOT KNOWN</b>	

<b>Chemicals</b>	<b>Monitoring Requirements</b>
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2014 and 9/30/2014 at SMP: DS202

**Sample for all the analytes listed below:**

- 1) **TOTAL HALOACETIC ACIDS (HAA5) – 2456**
- 2) **TTHM - 2950**



OH0700912 FLUSHING VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>FLUSHING, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between 1/1/2014 and 1/31/2014

1 Sample(s) Required between 2/1/2014 and 2/28/2014

1 Sample(s) Required between 3/1/2014 and 3/31/2014

1 Sample(s) Required between 4/1/2014 and 4/30/2014

1 Sample(s) Required between 5/1/2014 and 5/31/2014

1 Sample(s) Required between 6/1/2014 and 6/30/2014

1 Sample(s) Required between 7/1/2014 and 7/31/2014

1 Sample(s) Required between 8/1/2014 and 8/31/2014

1 Sample(s) Required between 9/1/2014 and 9/30/2014

1 Sample(s) Required between 10/1/2014 and 10/31/2014

1 Sample(s) Required between 11/1/2014 and 11/30/2014

1 Sample(s) Required between 12/1/2014 and 12/31/2014

TOTAL CHLORINE - 1000

1 Sample(s) Required between 1/1/2014 and 1/31/2014

1 Sample(s) Required between 2/1/2014 and 2/28/2014

1 Sample(s) Required between 3/1/2014 and 3/31/2014

1 Sample(s) Required between 4/1/2014 and 4/30/2014

1 Sample(s) Required between 5/1/2014 and 5/31/2014

1 Sample(s) Required between 6/1/2014 and 6/30/2014

1 Sample(s) Required between 7/1/2014 and 7/31/2014

1 Sample(s) Required between 8/1/2014 and 8/31/2014

1 Sample(s) Required between 9/1/2014 and 9/30/2014

1 Sample(s) Required between 10/1/2014 and 10/31/2014

1 Sample(s) Required between 11/1/2014 and 11/30/2014

1 Sample(s) Required between 12/1/2014 and 12/31/2014

Samples should be collected at the same time and place as the Total Coliform samples.

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>FLUSHING, VILLAGE OF DISTRIBUTION</b> <b>154 NORTHWEST ST.</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2014 and 9/30/2014 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2014

2014 DISTRIBUTION SCHEDULE

**OH0700912 FLUSHING VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

*Groundwater Rule Substantial Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>FLUSHING, VILLAGE OF DISTRIBUTION</b> <b>223 PEARL ST.</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

<b>Chemicals</b>	<b>Monitoring Requirements</b>
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2014 and 9/30/2014 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH0701112 HOLLOWAY PUBLIC WATER SYSTEM

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>752973</b>	Facility Name: <b>HOLLOWAY WTP</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 1/1/2014 and 5/31/2014
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2014 and 5/31/2014
RADIOLOGICALS	1 Sample(s) Required between 1/1/2014 and 5/31/2014
<i>Sample for all the analytes listed below:</i>	
GROSS ALPHA - 4002 RADIUM-228 - 4030	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2014 and 5/31/2014
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2014 and 5/31/2014



**OH0701112 HOLLOWAY PUBLIC WATER SYSTEM**

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>HOLLOWAY, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2014 and	1/31/2014
	1 Sample(s) Required between	2/1/2014 and	2/28/2014
	1 Sample(s) Required between	3/1/2014 and	3/31/2014
	1 Sample(s) Required between	4/1/2014 and	4/30/2014
	1 Sample(s) Required between	5/1/2014 and	5/31/2014
	1 Sample(s) Required between	6/1/2014 and	6/30/2014
	1 Sample(s) Required between	7/1/2014 and	7/31/2014
	1 Sample(s) Required between	8/1/2014 and	8/31/2014
	1 Sample(s) Required between	9/1/2014 and	9/30/2014
	1 Sample(s) Required between	10/1/2014 and	10/31/2014
	1 Sample(s) Required between	11/1/2014 and	11/30/2014
	1 Sample(s) Required between	12/1/2014 and	12/31/2014

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2014 and	1/31/2014
	1 Sample(s) Required between	2/1/2014 and	2/28/2014
	1 Sample(s) Required between	3/1/2014 and	3/31/2014
	1 Sample(s) Required between	4/1/2014 and	4/30/2014
	1 Sample(s) Required between	5/1/2014 and	5/31/2014
	1 Sample(s) Required between	6/1/2014 and	6/30/2014
	1 Sample(s) Required between	7/1/2014 and	7/31/2014
	1 Sample(s) Required between	8/1/2014 and	8/31/2014
	1 Sample(s) Required between	9/1/2014 and	9/30/2014
	1 Sample(s) Required between	10/1/2014 and	10/31/2014
	1 Sample(s) Required between	11/1/2014 and	11/30/2014
	1 Sample(s) Required between	12/1/2014 and	12/31/2014

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>HOLLOWAY, VILLAGE OF DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2014 and 9/30/2014 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2014

2014 ENTRY POINT SCHEDULE

**OH0701212 MARTINS FERRY PUBLIC WATER SYSTEM**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>752974</b>	Facility Name: <b>MARTINS FERRY WTP</b>	Facility Class: <b>CLASS 2</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
BROMATE - 1011	1 Sample(s) Required between 1/1/2014 and 1/31/2014 1 Sample(s) Required between 2/1/2014 and 2/28/2014 1 Sample(s) Required between 3/1/2014 and 3/31/2014 1 Sample(s) Required between 4/1/2014 and 4/30/2014 1 Sample(s) Required between 5/1/2014 and 5/31/2014 1 Sample(s) Required between 6/1/2014 and 6/30/2014 1 Sample(s) Required between 7/1/2014 and 7/31/2014 1 Sample(s) Required between 8/1/2014 and 8/31/2014 1 Sample(s) Required between 9/1/2014 and 9/30/2014 1 Sample(s) Required between 10/1/2014 and 10/31/2014 1 Sample(s) Required between 11/1/2014 and 11/30/2014 1 Sample(s) Required between 12/1/2014 and 12/31/2014
INORGANICS	1 Sample(s) Required between 1/1/2014 and 5/31/2014
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2014 and 5/31/2014
RADIOLOGICALS	1 Sample(s) Required between 1/1/2014 and 5/31/2014
<i>Sample for all the analytes listed below:</i>	
GROSS ALPHA - 4002 RADIUM-228 - 4030	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2014 and 5/31/2014
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2014 and 5/31/2014



**OH0701212 MARTINS FERRY PUBLIC WATER SYSTEM**

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>MARTINS FERRY DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	20 Sample(s) Required between 6/1/2014 and 9/30/2014
-------------------------------	--

*Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>*

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	10 Sample(s) Required between 1/1/2014 and 1/31/2014
	10 Sample(s) Required between 2/1/2014 and 2/28/2014
	10 Sample(s) Required between 3/1/2014 and 3/31/2014
	10 Sample(s) Required between 4/1/2014 and 4/30/2014
	10 Sample(s) Required between 5/1/2014 and 5/31/2014
	10 Sample(s) Required between 6/1/2014 and 6/30/2014
	10 Sample(s) Required between 7/1/2014 and 7/31/2014
	10 Sample(s) Required between 8/1/2014 and 8/31/2014
	10 Sample(s) Required between 9/1/2014 and 9/30/2014
	10 Sample(s) Required between 10/1/2014 and 10/31/2014
	10 Sample(s) Required between 11/1/2014 and 11/30/2014
	10 Sample(s) Required between 12/1/2014 and 12/31/2014

TOTAL CHLORINE - 1000	10 Sample(s) Required between 1/1/2014 and 1/31/2014
	10 Sample(s) Required between 2/1/2014 and 2/28/2014
	10 Sample(s) Required between 3/1/2014 and 3/31/2014
	10 Sample(s) Required between 4/1/2014 and 4/30/2014
	10 Sample(s) Required between 5/1/2014 and 5/31/2014
	10 Sample(s) Required between 6/1/2014 and 6/30/2014
	10 Sample(s) Required between 7/1/2014 and 7/31/2014
	10 Sample(s) Required between 8/1/2014 and 8/31/2014
	10 Sample(s) Required between 9/1/2014 and 9/30/2014
	10 Sample(s) Required between 10/1/2014 and 10/31/2014
	10 Sample(s) Required between 11/1/2014 and 11/30/2014
	10 Sample(s) Required between 12/1/2014 and 12/31/2014

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>MARTINS FERRY DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2014 and 9/30/2014 at SMP: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH0701212 MARTINS FERRY PUBLIC WATER SYSTEM**

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>MARTINS FERRY DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

<b>Chemicals</b>	<b>Monitoring Requirements</b>
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2014 and 9/30/2014 at SMP: DS202

**Sample for all the analytes listed below:**

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH0701303 MORRISTOWN PUBLIC WATER SYSTEM**

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>MORRISTOWN, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2014 and 9/30/2014

*Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>*

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between 1/1/2014 and 1/31/2014  
1 Sample(s) Required between 2/1/2014 and 2/28/2014  
1 Sample(s) Required between 3/1/2014 and 3/31/2014  
1 Sample(s) Required between 4/1/2014 and 4/30/2014  
1 Sample(s) Required between 5/1/2014 and 5/31/2014  
1 Sample(s) Required between 6/1/2014 and 6/30/2014  
1 Sample(s) Required between 7/1/2014 and 7/31/2014  
1 Sample(s) Required between 8/1/2014 and 8/31/2014  
1 Sample(s) Required between 9/1/2014 and 9/30/2014  
1 Sample(s) Required between 10/1/2014 and 10/31/2014  
1 Sample(s) Required between 11/1/2014 and 11/30/2014  
1 Sample(s) Required between 12/1/2014 and 12/31/2014

TOTAL CHLORINE - 1000

1 Sample(s) Required between 1/1/2014 and 1/31/2014  
1 Sample(s) Required between 2/1/2014 and 2/28/2014  
1 Sample(s) Required between 3/1/2014 and 3/31/2014  
1 Sample(s) Required between 4/1/2014 and 4/30/2014  
1 Sample(s) Required between 5/1/2014 and 5/31/2014  
1 Sample(s) Required between 6/1/2014 and 6/30/2014  
1 Sample(s) Required between 7/1/2014 and 7/31/2014  
1 Sample(s) Required between 8/1/2014 and 8/31/2014  
1 Sample(s) Required between 9/1/2014 and 9/30/2014  
1 Sample(s) Required between 10/1/2014 and 10/31/2014  
1 Sample(s) Required between 11/1/2014 and 11/30/2014  
1 Sample(s) Required between 12/1/2014 and 12/31/2014

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>MORRISTOWN, VILLAGE OF DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2014 and 9/30/2014 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH0701412 POWHATAN POINT PUBLIC WATER SYSTEM**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>752976</b>	Facility Name: <b>POWHATAN POINT STU 1</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS <i>Sample for all the analytes listed below:</i> ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	1 Sample(s) Required between 1/1/2014 and 5/31/2014
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 7/1/2014 and 9/30/2014
RADIOLOGICALS <i>Sample for all the analytes listed below:</i> GROSS ALPHA - 4002 RADIUM-228 - 4030	1 Sample(s) Required between 1/1/2014 and 5/31/2014
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 <i>Sample for all the analytes listed below:</i> ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	1 Sample(s) Required between 1/1/2014 and 5/31/2014
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 2	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 3	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 4 <i>Sample for all the analytes listed below:</i> BENZO (A) PYRENE - 2306 DI(2-ETHYLHEXYL) - ADIPATE - 2035 DI(2-ETHYLHEXYL) - PHTHALATE - 2039 ENDOTHALL - 2033	1 Sample(s) Required between 4/1/2014 and 6/30/2014
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2014 and 5/31/2014



**OH0701412 POWHATAN POINT PUBLIC WATER SYSTEM**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>760325</b>	Facility Name: <b>POWHATAN POINT STU 2</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP002</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	1 Sample(s) Required between 1/1/2014 and 5/31/2014
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2014 and 3/31/2014 1 Sample(s) Required between 4/1/2014 and 6/30/2014 1 Sample(s) Required between 7/1/2014 and 9/30/2014 1 Sample(s) Required between 10/1/2014 and 12/31/2014
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2014 and 5/31/2014
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 2	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 3	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 4	1 Sample(s) Required between 4/1/2014 and 6/30/2014
<i>Sample for all the analytes listed below:</i>	
BENZO (A) PYRENE - 2306 DI(2-ETHYLHEXYL) - ADIPATE - 2035 DI(2-ETHYLHEXYL) - PHTHALATE - 2039 ENDOTHALL - 2033	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2014 and 5/31/2014



**OH0701412 POWHATAN POINT PUBLIC WATER SYSTEM**

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>POWHATAN POINT, VILLAGE DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required
ASBESTOS - 1094	Not Required
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2014 and 1/31/2014 2 Sample(s) Required between 2/1/2014 and 2/28/2014 2 Sample(s) Required between 3/1/2014 and 3/31/2014 2 Sample(s) Required between 4/1/2014 and 4/30/2014 2 Sample(s) Required between 5/1/2014 and 5/31/2014 2 Sample(s) Required between 6/1/2014 and 6/30/2014 2 Sample(s) Required between 7/1/2014 and 7/31/2014 2 Sample(s) Required between 8/1/2014 and 8/31/2014 2 Sample(s) Required between 9/1/2014 and 9/30/2014 2 Sample(s) Required between 10/1/2014 and 10/31/2014 2 Sample(s) Required between 11/1/2014 and 11/30/2014 2 Sample(s) Required between 12/1/2014 and 12/31/2014
TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2014 and 1/31/2014 2 Sample(s) Required between 2/1/2014 and 2/28/2014 2 Sample(s) Required between 3/1/2014 and 3/31/2014 2 Sample(s) Required between 4/1/2014 and 4/30/2014 2 Sample(s) Required between 5/1/2014 and 5/31/2014 2 Sample(s) Required between 6/1/2014 and 6/30/2014 2 Sample(s) Required between 7/1/2014 and 7/31/2014 2 Sample(s) Required between 8/1/2014 and 8/31/2014 2 Sample(s) Required between 9/1/2014 and 9/30/2014 2 Sample(s) Required between 10/1/2014 and 10/31/2014 2 Sample(s) Required between 11/1/2014 and 11/30/2014 2 Sample(s) Required between 12/1/2014 and 12/31/2014

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>POWHATAN POINT, VILLAGE DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2014 and 9/30/2014 at SMP: DS201

**Sample for all the analytes listed below:**

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH0701412 POWHATAN POINT PUBLIC WATER SYSTEM**

System Type: Community

Operating Period: 1/1 to 12/31

*Groundwater Rule Substantial Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>POWHATAN POINT, VILLAGE DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>DS202</b>	<b>ADDRESS NOT KNOWN</b>	

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 7/1/2014 and 9/30/2014 at SMP: DS202

*Sample for all the analytes listed below:*

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH0701516 ST. CLAIRSVILLE CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>752977</b>	Facility Name: <b>SAINT CLAIRSVILLE WTP</b>	Facility Class: <b>CLASS 3</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Surface Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 1/1/2014 and 5/31/2014
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020	
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2014 and 1/31/2014 1 Sample(s) Required between 2/1/2014 and 2/28/2014 1 Sample(s) Required between 3/1/2014 and 3/31/2014 1 Sample(s) Required between 4/1/2014 and 4/30/2014 1 Sample(s) Required between 5/1/2014 and 5/31/2014 1 Sample(s) Required between 6/1/2014 and 6/30/2014 1 Sample(s) Required between 7/1/2014 and 7/31/2014 1 Sample(s) Required between 8/1/2014 and 8/31/2014 1 Sample(s) Required between 9/1/2014 and 9/30/2014 1 Sample(s) Required between 10/1/2014 and 10/31/2014 1 Sample(s) Required between 11/1/2014 and 11/30/2014 1 Sample(s) Required between 12/1/2014 and 12/31/2014
RADIOLOGICALS	1 Sample(s) Required between 1/1/2014 and 5/31/2014
<i>Sample for all the analytes listed below:</i>	
GROSS ALPHA - 4002 RADIUM-228 - 4030	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2014 and 6/30/2014
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2014 and 5/31/2014
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 1/1/2014 and 1/31/2014 1 Paired Sample Set Required between 2/1/2014 and 2/28/2014 1 Paired Sample Set Required between 3/1/2014 and 3/31/2014 1 Paired Sample Set Required between 4/1/2014 and 4/30/2014 1 Paired Sample Set Required between 5/1/2014 and 5/31/2014 1 Paired Sample Set Required between 6/1/2014 and 6/30/2014 1 Paired Sample Set Required between 7/1/2014 and 7/31/2014 1 Paired Sample Set Required between 8/1/2014 and 8/31/2014 1 Paired Sample Set Required between 9/1/2014 and 9/30/2014 1 Paired Sample Set Required between 10/1/2014 and 10/31/2014 1 Paired Sample Set Required between 11/1/2014 and 11/30/2014 1 Paired Sample Set Required between 12/1/2014 and 12/31/2014

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



OH0701516 ST. CLAIRSVILLE CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>ST. CLAIRSVILLE, CITY OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

TOTAL COLIFORM (TCR) - 3100	6 Sample(s) Required between 1/1/2014 and 1/31/2014
	6 Sample(s) Required between 2/1/2014 and 2/28/2014
	6 Sample(s) Required between 3/1/2014 and 3/31/2014
	6 Sample(s) Required between 4/1/2014 and 4/30/2014
	6 Sample(s) Required between 5/1/2014 and 5/31/2014
	6 Sample(s) Required between 6/1/2014 and 6/30/2014
	6 Sample(s) Required between 7/1/2014 and 7/31/2014
	6 Sample(s) Required between 8/1/2014 and 8/31/2014
	6 Sample(s) Required between 9/1/2014 and 9/30/2014
	6 Sample(s) Required between 10/1/2014 and 10/31/2014
	6 Sample(s) Required between 11/1/2014 and 11/30/2014
	6 Sample(s) Required between 12/1/2014 and 12/31/2014

TOTAL CHLORINE - 1000	6 Sample(s) Required between 1/1/2014 and 1/31/2014
	6 Sample(s) Required between 2/1/2014 and 2/28/2014
	6 Sample(s) Required between 3/1/2014 and 3/31/2014
	6 Sample(s) Required between 4/1/2014 and 4/30/2014
	6 Sample(s) Required between 5/1/2014 and 5/31/2014
	6 Sample(s) Required between 6/1/2014 and 6/30/2014
	6 Sample(s) Required between 7/1/2014 and 7/31/2014
	6 Sample(s) Required between 8/1/2014 and 8/31/2014
	6 Sample(s) Required between 9/1/2014 and 9/30/2014
	6 Sample(s) Required between 10/1/2014 and 10/31/2014
	6 Sample(s) Required between 11/1/2014 and 11/30/2014
	6 Sample(s) Required between 12/1/2014 and 12/31/2014

Samples should be collected at the same time and place as the Total Coliform samples.

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>ST. CLAIRSVILLE, CITY OF DISTRIBUTION</b> <b>122 OVERBAUGH AVENUE</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/1/2014 and 1/7/2014 at SMP: DS201
	1 Sample(s) Required between 4/1/2014 and 4/7/2014 at SMP: DS201
	1 Sample(s) Required between 7/1/2014 and 7/7/2014 at SMP: DS201
	1 Sample(s) Required between 10/1/2014 and 10/7/2014 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH0701516 ST. CLAIRSVILLE CITY PWS**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>ST. CLAIRSVILLE, CITY OF DISTRIBUTION</b> <b>100 NORTH MARKET STREET</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

<b>Chemicals</b>	<b>Monitoring Requirements</b>		
DISINFECTION BYPRODUCTS	1 Sample(s) Required between	1/1/2014 and	1/7/2014 at SMP: DS202
	1 Sample(s) Required between	4/1/2014 and	4/7/2014 at SMP: DS202
	1 Sample(s) Required between	7/1/2014 and	7/7/2014 at SMP: DS202
	1 Sample(s) Required between	10/1/2014 and	10/7/2014 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH0701612 SHADYSIDE PUBLIC WATER SYSTEM

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>752978</b>	Facility Name: <b>SHADYSIDE WTP</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 1/1/2014 and 5/31/2014
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2014 and 5/31/2014
RADIOLOGICALS	1 Sample(s) Required between 1/1/2014 and 5/31/2014
<i>Sample for all the analytes listed below:</i>	
GROSS ALPHA - 4002 RADIUM-228 - 4030	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2014 and 5/31/2014
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 2	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 3	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 4	1 Sample(s) Required between 4/1/2014 and 6/30/2014
<i>Sample for all the analytes listed below:</i>	
BENZO (A) PYRENE - 2306 DI(2-ETHYLHEXYL) - ADIPATE - 2035 DI(2-ETHYLHEXYL) - PHTHALATE - 2039 ENDOTHALL - 2033	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2014 and 5/31/2014



**OH0701612 SHADYSIDE PUBLIC WATER SYSTEM**

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>SHADYSIDE, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required
ASBESTOS - 1094	Not Required
TOTAL COLIFORM (TCR) - 3100	4 Sample(s) Required between 1/1/2014 and 1/31/2014 4 Sample(s) Required between 2/1/2014 and 2/28/2014 4 Sample(s) Required between 3/1/2014 and 3/31/2014 4 Sample(s) Required between 4/1/2014 and 4/30/2014 4 Sample(s) Required between 5/1/2014 and 5/31/2014 4 Sample(s) Required between 6/1/2014 and 6/30/2014 4 Sample(s) Required between 7/1/2014 and 7/31/2014 4 Sample(s) Required between 8/1/2014 and 8/31/2014 4 Sample(s) Required between 9/1/2014 and 9/30/2014 4 Sample(s) Required between 10/1/2014 and 10/31/2014 4 Sample(s) Required between 11/1/2014 and 11/30/2014 4 Sample(s) Required between 12/1/2014 and 12/31/2014
TOTAL CHLORINE - 1000	4 Sample(s) Required between 1/1/2014 and 1/31/2014 4 Sample(s) Required between 2/1/2014 and 2/28/2014 4 Sample(s) Required between 3/1/2014 and 3/31/2014 4 Sample(s) Required between 4/1/2014 and 4/30/2014 4 Sample(s) Required between 5/1/2014 and 5/31/2014 4 Sample(s) Required between 6/1/2014 and 6/30/2014 4 Sample(s) Required between 7/1/2014 and 7/31/2014 4 Sample(s) Required between 8/1/2014 and 8/31/2014 4 Sample(s) Required between 9/1/2014 and 9/30/2014 4 Sample(s) Required between 10/1/2014 and 10/31/2014 4 Sample(s) Required between 11/1/2014 and 11/30/2014 4 Sample(s) Required between 12/1/2014 and 12/31/2014

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>SHADYSIDE, VILLAGE OF DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2014 and 9/30/2014 at SMP: DS201

**Sample for all the analytes listed below:**

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2014

2014 DISTRIBUTION SCHEDULE

**OH0701612 SHADYSIDE PUBLIC WATER SYSTEM**

System Type: Community

Operating Period: 1/1 to 12/31

*Groundwater Rule Substantial Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>SHADYSIDE, VILLAGE OF DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

<b>Chemicals</b>	<b>Monitoring Requirements</b>
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2014 and 9/30/2014 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH0701703 YORK TOWNSHIP WATER AUTHORITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>YORK TOWNSHIP WATER AUTH DISTRIBUTIC</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between	1/1/2014	and	1/31/2014
1 Sample(s) Required between	2/1/2014	and	2/28/2014
1 Sample(s) Required between	3/1/2014	and	3/31/2014
1 Sample(s) Required between	4/1/2014	and	4/30/2014
1 Sample(s) Required between	5/1/2014	and	5/31/2014
1 Sample(s) Required between	6/1/2014	and	6/30/2014
1 Sample(s) Required between	7/1/2014	and	7/31/2014
1 Sample(s) Required between	8/1/2014	and	8/31/2014
1 Sample(s) Required between	9/1/2014	and	9/30/2014
1 Sample(s) Required between	10/1/2014	and	10/31/2014
1 Sample(s) Required between	11/1/2014	and	11/30/2014
1 Sample(s) Required between	12/1/2014	and	12/31/2014

TOTAL CHLORINE - 1000

1 Sample(s) Required between	1/1/2014	and	1/31/2014
1 Sample(s) Required between	2/1/2014	and	2/28/2014
1 Sample(s) Required between	3/1/2014	and	3/31/2014
1 Sample(s) Required between	4/1/2014	and	4/30/2014
1 Sample(s) Required between	5/1/2014	and	5/31/2014
1 Sample(s) Required between	6/1/2014	and	6/30/2014
1 Sample(s) Required between	7/1/2014	and	7/31/2014
1 Sample(s) Required between	8/1/2014	and	8/31/2014
1 Sample(s) Required between	9/1/2014	and	9/30/2014
1 Sample(s) Required between	10/1/2014	and	10/31/2014
1 Sample(s) Required between	11/1/2014	and	11/30/2014
1 Sample(s) Required between	12/1/2014	and	12/31/2014

Samples should be collected at the same time and place as the Total Coliform samples.

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>YORK TOWNSHIP WATER AUTH DISTRIBUTIC</b>	Facility Class: <b>CLASS 1</b>
<b>ADDRESS NOT KNOWN</b>			

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2014 and 9/30/2014 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH0701803 BELMONT CO. SEWER DISTRICT 1B PWS**

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>BELMONT CO. SWR DIST 1B DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**Chemicals Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 Not Required

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100

2 Sample(s) Required between 1/1/2014 and 1/31/2014

2 Sample(s) Required between 2/1/2014 and 2/28/2014

2 Sample(s) Required between 3/1/2014 and 3/31/2014

2 Sample(s) Required between 4/1/2014 and 4/30/2014

2 Sample(s) Required between 5/1/2014 and 5/31/2014

2 Sample(s) Required between 6/1/2014 and 6/30/2014

2 Sample(s) Required between 7/1/2014 and 7/31/2014

2 Sample(s) Required between 8/1/2014 and 8/31/2014

2 Sample(s) Required between 9/1/2014 and 9/30/2014

2 Sample(s) Required between 10/1/2014 and 10/31/2014

2 Sample(s) Required between 11/1/2014 and 11/30/2014

2 Sample(s) Required between 12/1/2014 and 12/31/2014

TOTAL CHLORINE - 1000

2 Sample(s) Required between 1/1/2014 and 1/31/2014

2 Sample(s) Required between 2/1/2014 and 2/28/2014

2 Sample(s) Required between 3/1/2014 and 3/31/2014

2 Sample(s) Required between 4/1/2014 and 4/30/2014

2 Sample(s) Required between 5/1/2014 and 5/31/2014

2 Sample(s) Required between 6/1/2014 and 6/30/2014

2 Sample(s) Required between 7/1/2014 and 7/31/2014

2 Sample(s) Required between 8/1/2014 and 8/31/2014

2 Sample(s) Required between 9/1/2014 and 9/30/2014

2 Sample(s) Required between 10/1/2014 and 10/31/2014

2 Sample(s) Required between 11/1/2014 and 11/30/2014

2 Sample(s) Required between 12/1/2014 and 12/31/2014

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>BELMONT CO. SWR DIST 1B DISTRIBUTION</b> <b>68626 HILL STREET</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2014 and 9/30/2014 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH0701803 BELMONT CO. SEWER DISTRICT 1B PWS**

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2014**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>BELMONT CO. SWR DIST 1B DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>DS202</b>	<b>54568 NATIONAL ROAD</b>	

<b>Chemicals</b>	<b>Monitoring Requirements</b>
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2014 and 9/30/2014 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

**OH0733012 CAMP PRESMONT INC.**

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **CAMP PRESMONT INC. DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 7/1/2014 and 9/30/2014

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **752983** Facility Name: **CAMP PRESMONT INC**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2014 and 10/31/2014

**Where to Collect Samples For a Small Public Water System**

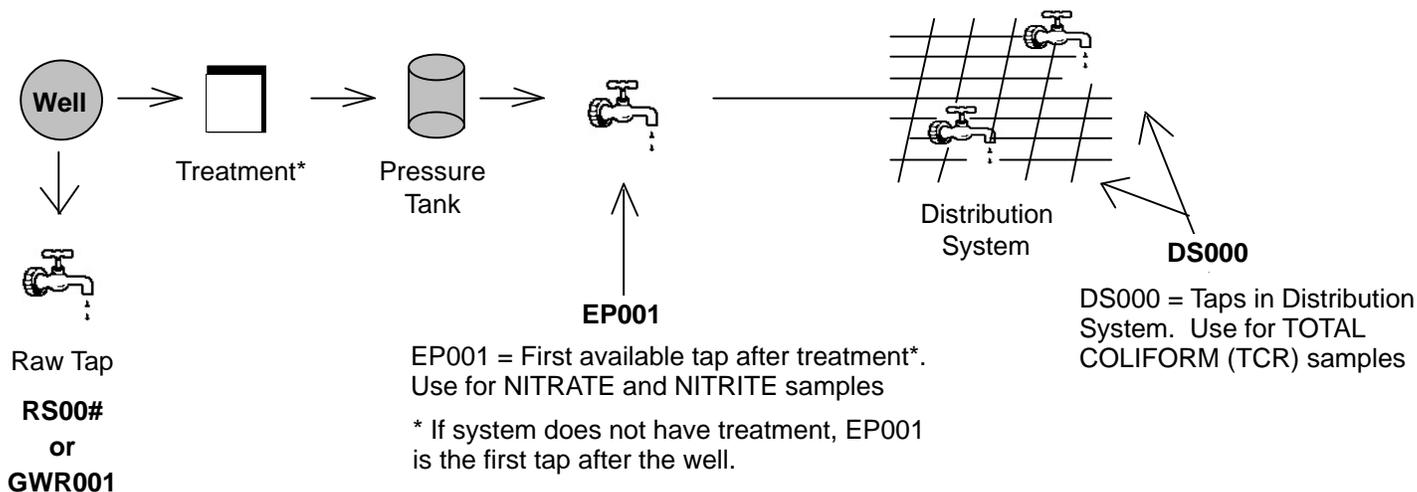

**Beginning January 1, 2014, failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH0735012 4-H CAMP PIEDMONT PWS**

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **4-H CAMP PIEDMONT DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2014 and 6/30/2014 1 Sample(s) Required between 7/1/2014 and 9/30/2014

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **752987** Facility Name: **4-H CAMP PIEDMONT**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2014 and 5/31/2014

**Where to Collect Samples For a Small Public Water System**

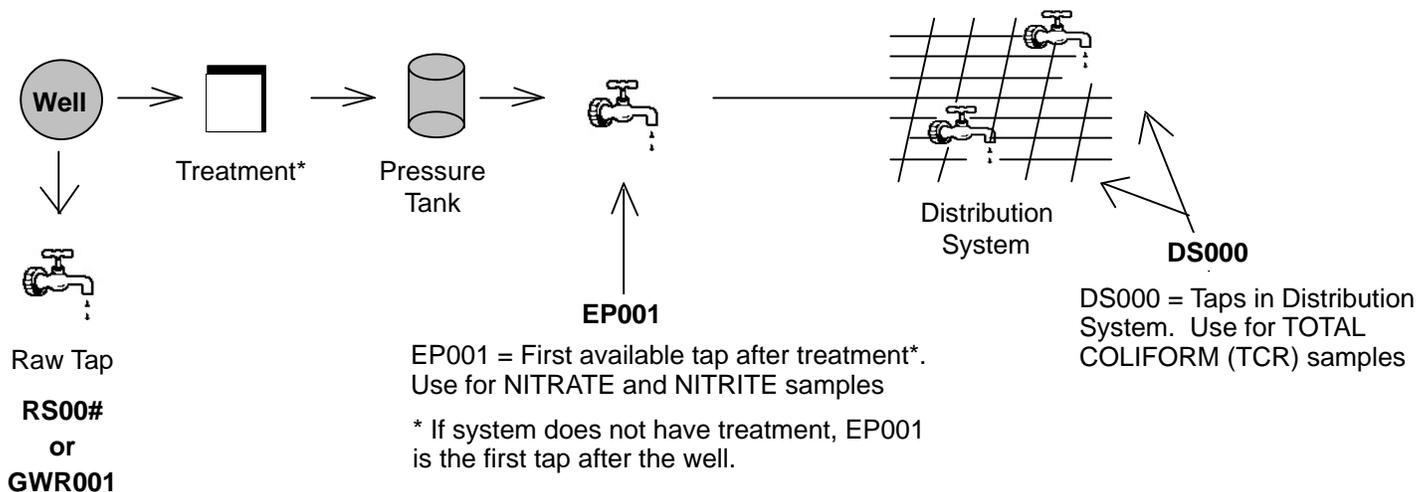

**Beginning January 1, 2014, failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH0735022 4-H CAMP PIEDMONT WELL 2 PWS**

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **4-H CAMP PIEDMONT WELL 2 DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2014 and 6/30/2014 1 Sample(s) Required between 7/1/2014 and 9/30/2014

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **752988** Facility Name: **4-H CAMP PIEDMONT WELL 2**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2014 and 5/31/2014

**Where to Collect Samples For a Small Public Water System**

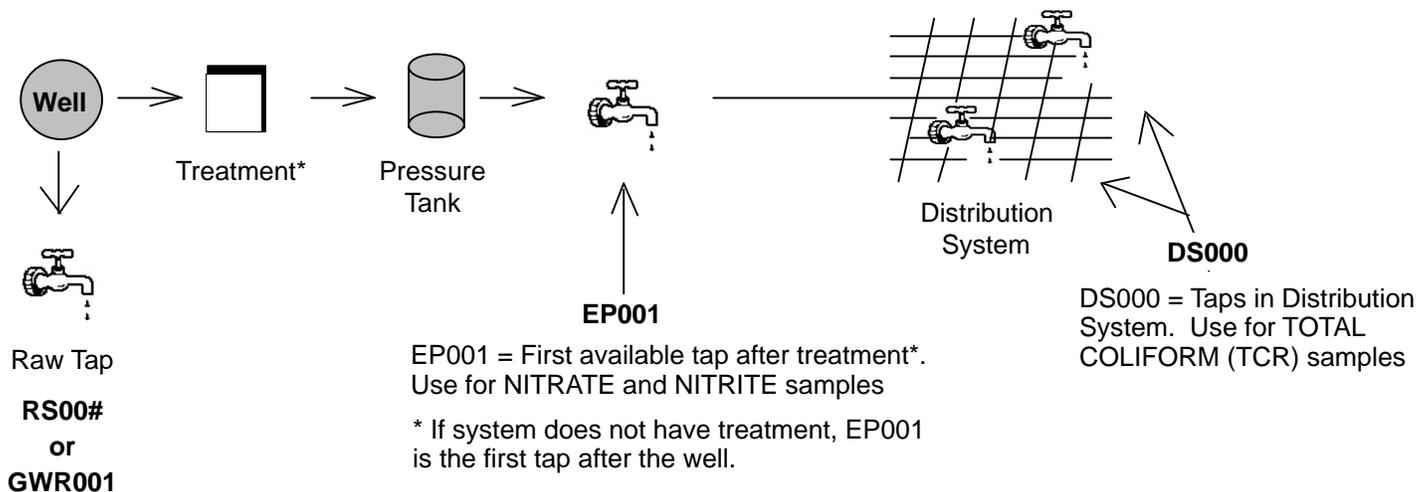

**Beginning January 1, 2014, failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH0735212 MWCD/PIEDMONT MARINA P-1 PWS**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **MWCD/PIEDMONT MARINA P-1 DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2014 and 6/30/2014 1 Sample(s) Required between 7/1/2014 and 9/30/2014 1 Sample(s) Required between 10/1/2014 and 12/31/2014

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **752989** Facility Name: **MWCD PIEDMONT MARINA P1**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2014 and 5/31/2014

**Where to Collect Samples For a Small Public Water System**

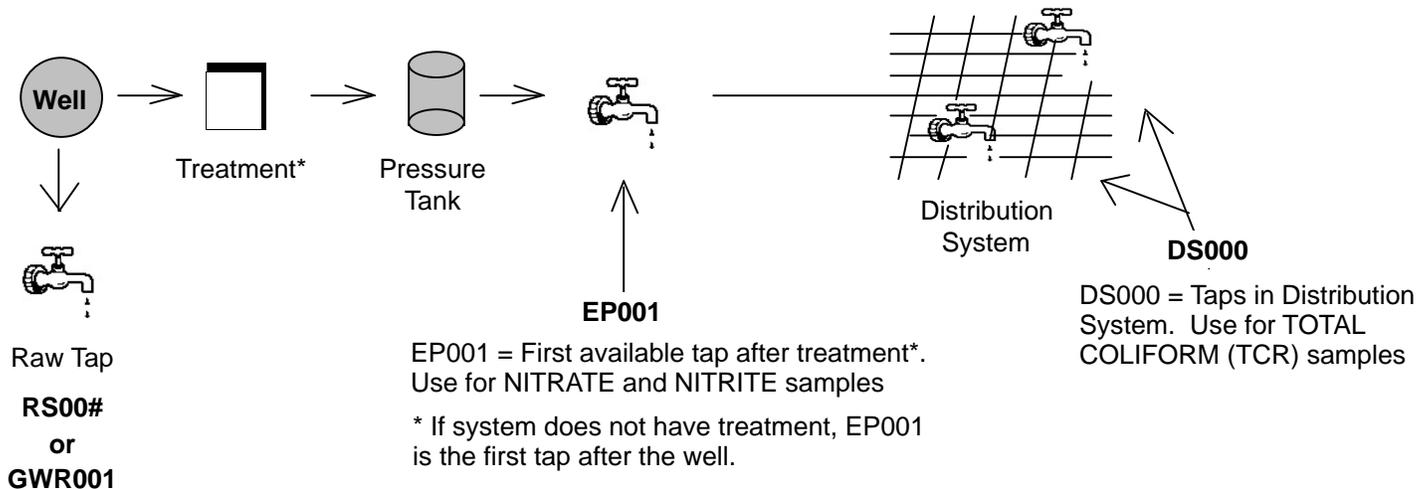

**Beginning January 1, 2014, failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH0735612 U-SAVE FOOD MART PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **U-SAVE FOOD MART DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2014 and 3/31/2014
	1 Sample(s) Required between 4/1/2014 and 6/30/2014
	1 Sample(s) Required between 7/1/2014 and 9/30/2014
	1 Sample(s) Required between 10/1/2014 and 12/31/2014

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **761442** Facility Name: **U-SAVE FOOD MART**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2014 and 5/31/2014

**Where to Collect Samples For a Small Public Water System**

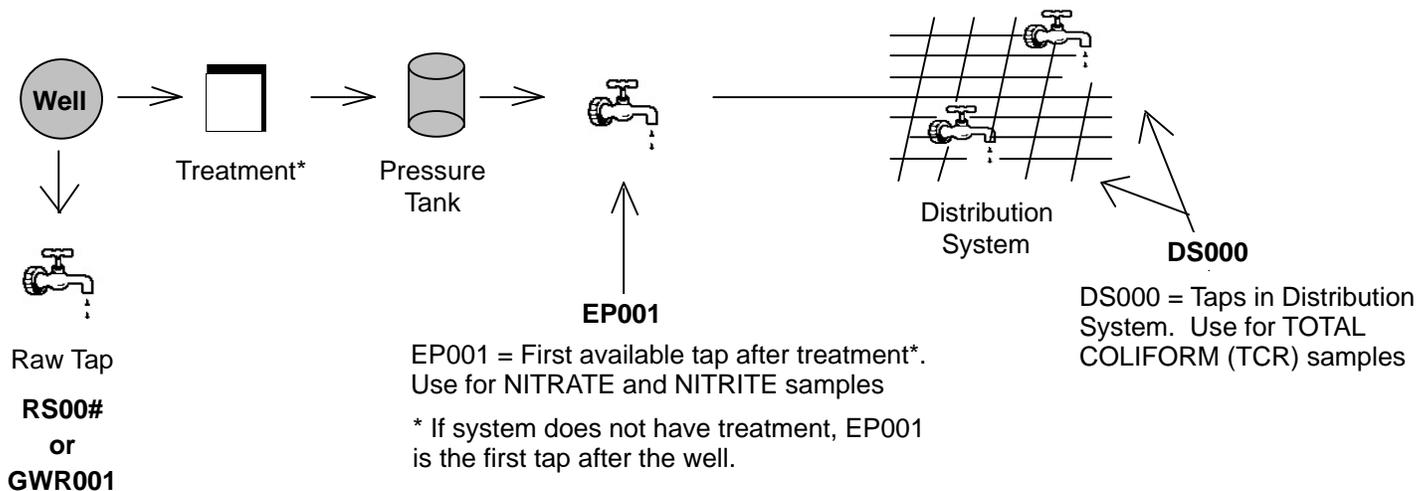

**Beginning January 1, 2014, failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH0735712 BELMONT BETTER HUNTING/FISHING CLUB PW**

System Type: Transient Noncommunity

Operating Period: 4/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **BELMONT BETTER HUNTING & FISHING CLUB DI**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2014 and 6/30/2014
	1 Sample(s) Required between 7/1/2014 and 9/30/2014
	1 Sample(s) Required between 10/1/2014 and 12/31/2014

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **761561** Facility Name: **BELMONT BETTER HUNTING & FISHING CLUB**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2014 and 5/31/2014

**Where to Collect Samples For a Small Public Water System**

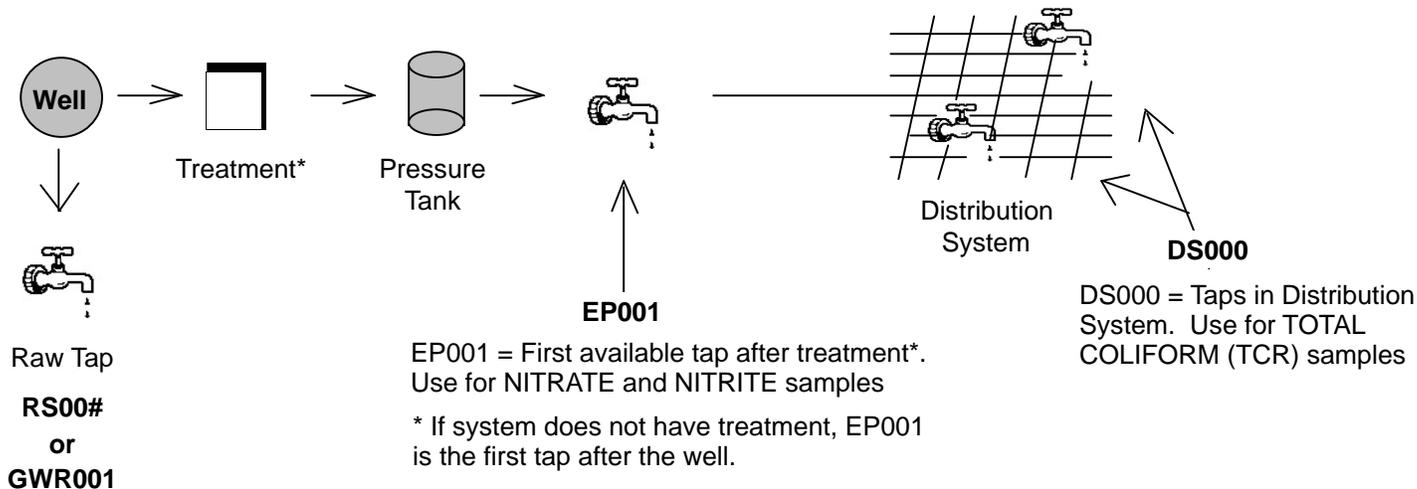

**Beginning January 1, 2014, failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**