



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

**OH1500112 BUTLER MOBILE CITY**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>1553394</b>	Facility Name: <b>BUTLER MOBILE CITY STU 1</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



**OH1500112 BUTLER MOBILE CITY**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>1560494</b>	Facility Name: <b>BUTLER MOBILE CITY STU 2</b>	
<b>Location</b>	SMP ID: <b>EP002</b>	Facility Source: <b>Ground Water</b>	Facility Class: <b>CLASS A</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH1500112 BUTLER MOBILE CITY

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: BUTLER MOBILE CITY DISTRIBUTION
Location SMP ID: DS000

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2015 and 9/30/2015

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: http://epa.ohio.gov/ddagw/reporting.aspx

TOTAL COLIFORM (TCR) - 3100 1 Sample(s) Required between 1/1/2015 and 1/31/2015
1 Sample(s) Required between 2/1/2015 and 2/28/2015
1 Sample(s) Required between 3/1/2015 and 3/31/2015
1 Sample(s) Required between 4/1/2015 and 4/30/2015
1 Sample(s) Required between 5/1/2015 and 5/31/2015
1 Sample(s) Required between 6/1/2015 and 6/30/2015
1 Sample(s) Required between 7/1/2015 and 7/31/2015
1 Sample(s) Required between 8/1/2015 and 8/31/2015
1 Sample(s) Required between 9/1/2015 and 9/30/2015
1 Sample(s) Required between 10/1/2015 and 10/31/2015
1 Sample(s) Required between 11/1/2015 and 11/30/2015
1 Sample(s) Required between 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000 1 Sample(s) Required between 1/1/2015 and 1/31/2015
1 Sample(s) Required between 2/1/2015 and 2/28/2015
1 Sample(s) Required between 3/1/2015 and 3/31/2015
1 Sample(s) Required between 4/1/2015 and 4/30/2015
1 Sample(s) Required between 5/1/2015 and 5/31/2015
1 Sample(s) Required between 6/1/2015 and 6/30/2015
1 Sample(s) Required between 7/1/2015 and 7/31/2015
1 Sample(s) Required between 8/1/2015 and 8/31/2015
1 Sample(s) Required between 9/1/2015 and 9/30/2015
1 Sample(s) Required between 10/1/2015 and 10/31/2015
1 Sample(s) Required between 11/1/2015 and 11/30/2015
1 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Facility ID: DS1 Facility Name: BUTLER MOBILE CITY DISTRIBUTION
Location SMP ID: DS201 ADDRESS NOT KNOWN

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

**OH1500312 COLUMBIANA CITY PWS**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>1553396</b>	Facility Name: <b>COLUMBIANA WTP</b>	Facility Class: <b>CLASS 3</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH1500312 COLUMBIANA CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

Table with 4 columns: Sampling Location, Facility ID, Facility Name, Facility Class. Values: DS1, COLUMBIANA, VILLAGE OF DISTRIBUTION, CLASS 1.

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100 7 Sample(s) Required between 1/1/2015 and 1/31/2015 ... 7 Sample(s) Required between 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000 7 Sample(s) Required between 1/1/2015 and 1/31/2015 ... 7 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Table with 4 columns: Sampling Location, Facility ID, Facility Name, Facility Class. Values: DS201, 14415 SOUTH AVE EXT, CLASS 1.

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



Effective Date: 01/01/2015

2015 DISTRIBUTION SCHEDULE

**OH1500312 COLUMBIANA CITY PWS**

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>COLUMBIANA, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>DS202</b>	<b>825 DANBURY WAY</b>	

<b>Chemicals</b>	<b>Monitoring Requirements</b>
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS202

*Sample for all the analytes listed below:*

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH1500811 EAST LIVERPOOL CITY

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>1553398</b>	Facility Name: <b>EAST LIVERPOOL WTP</b>	Facility Class: <b>CLASS 3</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Surface Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015

Chemicals	Monitoring Requirements
-----------	-------------------------

INORGANICS	1 Sample(s) Required between 1/1/2015 and 5/31/2015
------------	---

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020  
 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 1/31/2015
	1 Sample(s) Required between 2/1/2015 and 2/28/2015
	1 Sample(s) Required between 3/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 4/30/2015
	1 Sample(s) Required between 5/1/2015 and 5/31/2015
	1 Sample(s) Required between 6/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 7/31/2015
	1 Sample(s) Required between 8/1/2015 and 8/31/2015
	1 Sample(s) Required between 9/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 10/31/2015
	1 Sample(s) Required between 11/1/2015 and 11/30/2015
	1 Sample(s) Required between 12/1/2015 and 12/31/2015

RADIOLOGICALS	Not Required
---------------	--------------

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2015 and 6/30/2015
---	---

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2015 and 5/31/2015
----------------------------------	---

TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 1/1/2015 and 1/31/2015
	1 Paired Sample Set Required between 2/1/2015 and 2/28/2015
	1 Paired Sample Set Required between 3/1/2015 and 3/31/2015
	1 Paired Sample Set Required between 4/1/2015 and 4/30/2015
	1 Paired Sample Set Required between 5/1/2015 and 5/31/2015
	1 Paired Sample Set Required between 6/1/2015 and 6/30/2015
	1 Paired Sample Set Required between 7/1/2015 and 7/31/2015
	1 Paired Sample Set Required between 8/1/2015 and 8/31/2015
	1 Paired Sample Set Required between 9/1/2015 and 9/30/2015
	1 Paired Sample Set Required between 10/1/2015 and 10/31/2015
	1 Paired Sample Set Required between 11/1/2015 and 11/30/2015
	1 Paired Sample Set Required between 12/1/2015 and 12/31/2015

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



**OH1500811 EAST LIVERPOOL CITY**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>EAST LIVERPOOL, CITY OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	30 Sample(s) Required between 6/1/2015 and 9/30/2015
-------------------------------	--

*Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>*

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	10 Sample(s) Required between 1/1/2015 and 1/31/2015
	10 Sample(s) Required between 2/1/2015 and 2/28/2015
	10 Sample(s) Required between 3/1/2015 and 3/31/2015
	10 Sample(s) Required between 4/1/2015 and 4/30/2015
	10 Sample(s) Required between 5/1/2015 and 5/31/2015
	10 Sample(s) Required between 6/1/2015 and 6/30/2015
	10 Sample(s) Required between 7/1/2015 and 7/31/2015
	10 Sample(s) Required between 8/1/2015 and 8/31/2015
	10 Sample(s) Required between 9/1/2015 and 9/30/2015
	10 Sample(s) Required between 10/1/2015 and 10/31/2015
	10 Sample(s) Required between 11/1/2015 and 11/30/2015
	10 Sample(s) Required between 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000	10 Sample(s) Required between 1/1/2015 and 1/31/2015
	10 Sample(s) Required between 2/1/2015 and 2/28/2015
	10 Sample(s) Required between 3/1/2015 and 3/31/2015
	10 Sample(s) Required between 4/1/2015 and 4/30/2015
	10 Sample(s) Required between 5/1/2015 and 5/31/2015
	10 Sample(s) Required between 6/1/2015 and 6/30/2015
	10 Sample(s) Required between 7/1/2015 and 7/31/2015
	10 Sample(s) Required between 8/1/2015 and 8/31/2015
	10 Sample(s) Required between 9/1/2015 and 9/30/2015
	10 Sample(s) Required between 10/1/2015 and 10/31/2015
	10 Sample(s) Required between 11/1/2015 and 11/30/2015
	10 Sample(s) Required between 12/1/2015 and 12/31/2015

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>EAST LIVERPOOL, CITY OF DISTRIBUTION</b> <b>KWIK KING</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 3/8/2015 and 3/14/2015 at SMP: DS201
	1 Sample(s) Required between 6/8/2015 and 6/14/2015 at SMP: DS201
	1 Sample(s) Required between 9/8/2015 and 9/14/2015 at SMP: DS201

**OH1500811 EAST LIVERPOOL CITY**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>EAST LIVERPOOL, CITY OF DISTRIBUTION</b> <b>KWIK KING</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 12/8/2015 and 12/14/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>EAST LIVERPOOL, CITY OF DISTRIBUTION</b> <b>2051 LISBON ST (FOOD MART)</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 3/8/2015 and 3/14/2015 at SMP: DS202
	1 Sample(s) Required between 6/8/2015 and 6/14/2015 at SMP: DS202
	1 Sample(s) Required between 9/8/2015 and 9/14/2015 at SMP: DS202
	1 Sample(s) Required between 12/8/2015 and 12/14/2015 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS203</b>	Facility Name: <b>EAST LIVERPOOL, CITY OF DISTRIBUTION</b> <b>SEWER PLANT</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 3/8/2015 and 3/14/2015 at SMP: DS203
	1 Sample(s) Required between 6/8/2015 and 6/14/2015 at SMP: DS203
	1 Sample(s) Required between 9/8/2015 and 9/14/2015 at SMP: DS203
	1 Sample(s) Required between 12/8/2015 and 12/14/2015 at SMP: DS203

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS204</b>	Facility Name: <b>EAST LIVERPOOL, CITY OF DISTRIBUTION</b> <b>HYDR WITH FEW CUST DOWN STRE</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 3/8/2015 and 3/14/2015 at SMP: DS204
	1 Sample(s) Required between 6/8/2015 and 6/14/2015 at SMP: DS204
	1 Sample(s) Required between 9/8/2015 and 9/14/2015 at SMP: DS204
	1 Sample(s) Required between 12/8/2015 and 12/14/2015 at SMP: DS204

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

OH1500912 EAST PALESTINE CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>1553399</b>	Facility Name: <b>EAST PALESTINE PWS</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH1500912 EAST PALESTINE CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>EAST PALESTINE, CITY OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	5 Sample(s) Required between	1/1/2015	and	1/31/2015
	5 Sample(s) Required between	2/1/2015	and	2/28/2015
	5 Sample(s) Required between	3/1/2015	and	3/31/2015
	5 Sample(s) Required between	4/1/2015	and	4/30/2015
	5 Sample(s) Required between	5/1/2015	and	5/31/2015
	5 Sample(s) Required between	6/1/2015	and	6/30/2015
	5 Sample(s) Required between	7/1/2015	and	7/31/2015
	5 Sample(s) Required between	8/1/2015	and	8/31/2015
	5 Sample(s) Required between	9/1/2015	and	9/30/2015
	5 Sample(s) Required between	10/1/2015	and	10/31/2015
	5 Sample(s) Required between	11/1/2015	and	11/30/2015
	5 Sample(s) Required between	12/1/2015	and	12/31/2015

TOTAL CHLORINE - 1000	5 Sample(s) Required between	1/1/2015	and	1/31/2015
	5 Sample(s) Required between	2/1/2015	and	2/28/2015
	5 Sample(s) Required between	3/1/2015	and	3/31/2015
	5 Sample(s) Required between	4/1/2015	and	4/30/2015
	5 Sample(s) Required between	5/1/2015	and	5/31/2015
	5 Sample(s) Required between	6/1/2015	and	6/30/2015
	5 Sample(s) Required between	7/1/2015	and	7/31/2015
	5 Sample(s) Required between	8/1/2015	and	8/31/2015
	5 Sample(s) Required between	9/1/2015	and	9/30/2015
	5 Sample(s) Required between	10/1/2015	and	10/31/2015
	5 Sample(s) Required between	11/1/2015	and	11/30/2015
	5 Sample(s) Required between	12/1/2015	and	12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>EAST PALESTINE, CITY OF DISTRIBUTION</b> <b>900 EAST TAGGART STREET</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2015

2015 DISTRIBUTION SCHEDULE

**OH1500912 EAST PALESTINE CITY PWS**

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>EAST PALESTINE, CITY OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>DS202</b>	<b>1430 BROOKDALE AVENUE</b>	

<b>Chemicals</b>	<b>Monitoring Requirements</b>
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS202

*Sample for all the analytes listed below:*

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 05/15/2015

2015 ENTRY POINT SCHEDULE

**OH1501212 IVYSTONE WATER SYSTEM**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>1553402</b>	Facility Name: <b>IVYSTONE WATER SYSTEM</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH1501212 IVYSTONE WATER SYSTEM

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>IVYSTONE WATER SYSTEM DISTRIBUTION</b>
	SMP ID: <b>DS000</b>	

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2015	and	1/31/2015
	1 Sample(s) Required between	2/1/2015	and	2/28/2015
	1 Sample(s) Required between	3/1/2015	and	3/31/2015
	1 Sample(s) Required between	4/1/2015	and	4/30/2015
	1 Sample(s) Required between	5/1/2015	and	5/31/2015
	1 Sample(s) Required between	6/1/2015	and	6/30/2015
	1 Sample(s) Required between	7/1/2015	and	7/31/2015
	1 Sample(s) Required between	8/1/2015	and	8/31/2015
	1 Sample(s) Required between	9/1/2015	and	9/30/2015
	1 Sample(s) Required between	10/1/2015	and	10/31/2015
	1 Sample(s) Required between	11/1/2015	and	11/30/2015
	1 Sample(s) Required between	12/1/2015	and	12/31/2015

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2015	and	1/31/2015
	1 Sample(s) Required between	2/1/2015	and	2/28/2015
	1 Sample(s) Required between	3/1/2015	and	3/31/2015
	1 Sample(s) Required between	4/1/2015	and	4/30/2015
	1 Sample(s) Required between	5/1/2015	and	5/31/2015
	1 Sample(s) Required between	6/1/2015	and	6/30/2015
	1 Sample(s) Required between	7/1/2015	and	7/31/2015
	1 Sample(s) Required between	8/1/2015	and	8/31/2015
	1 Sample(s) Required between	9/1/2015	and	9/30/2015
	1 Sample(s) Required between	10/1/2015	and	10/31/2015
	1 Sample(s) Required between	11/1/2015	and	11/30/2015
	1 Sample(s) Required between	12/1/2015	and	12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>IVYSTONE WATER SYSTEM DISTRIBUTION</b>
	SMP ID: <b>DS201</b>	<b>ADDRESS NOT KNOWN</b>

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH1501412 LEETONIA VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>LEETONIA, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2015 and 1/31/2015
	2 Sample(s) Required between 2/1/2015 and 2/28/2015
	2 Sample(s) Required between 3/1/2015 and 3/31/2015
	2 Sample(s) Required between 4/1/2015 and 4/30/2015
	2 Sample(s) Required between 5/1/2015 and 5/31/2015
	2 Sample(s) Required between 6/1/2015 and 6/30/2015
	2 Sample(s) Required between 7/1/2015 and 7/31/2015
	2 Sample(s) Required between 8/1/2015 and 8/31/2015
	2 Sample(s) Required between 9/1/2015 and 9/30/2015
	2 Sample(s) Required between 10/1/2015 and 10/31/2015
	2 Sample(s) Required between 11/1/2015 and 11/30/2015
	2 Sample(s) Required between 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2015 and 1/31/2015
	2 Sample(s) Required between 2/1/2015 and 2/28/2015
	2 Sample(s) Required between 3/1/2015 and 3/31/2015
	2 Sample(s) Required between 4/1/2015 and 4/30/2015
	2 Sample(s) Required between 5/1/2015 and 5/31/2015
	2 Sample(s) Required between 6/1/2015 and 6/30/2015
	2 Sample(s) Required between 7/1/2015 and 7/31/2015
	2 Sample(s) Required between 8/1/2015 and 8/31/2015
	2 Sample(s) Required between 9/1/2015 and 9/30/2015
	2 Sample(s) Required between 10/1/2015 and 10/31/2015
	2 Sample(s) Required between 11/1/2015 and 11/30/2015
	2 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>LEETONIA, VILLAGE OF DISTRIBUTION</b> <b>HYDRANT AT COMMERCE AND INDI</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 3/1/2015 and 3/7/2015 at SMP: DS201
	1 Sample(s) Required between 6/1/2015 and 6/7/2015 at SMP: DS201
	1 Sample(s) Required between 9/1/2015 and 9/7/2015 at SMP: DS201
	1 Sample(s) Required between 12/1/2015 and 12/7/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH1501412 LEETONIA VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>LEETONIA, VILLAGE OF DISTRIBUTION</b> <b>490 PEARL</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 3/1/2015 and 3/7/2015 at SMP: DS202
	1 Sample(s) Required between 6/1/2015 and 6/7/2015 at SMP: DS202
	1 Sample(s) Required between 9/1/2015 and 9/7/2015 at SMP: DS202
	1 Sample(s) Required between 12/1/2015 and 12/7/2015 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

**OH1501512 LISBON VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>1553405</b>	Facility Name: <b>LISBON WATER DEPARTMENT</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Surface Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH1501512 LISBON VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>LISBON, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2015 and 9/30/2015
-------------------------------	--

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	3 Sample(s) Required between 1/1/2015 and 1/31/2015
	3 Sample(s) Required between 2/1/2015 and 2/28/2015
	3 Sample(s) Required between 3/1/2015 and 3/31/2015
	3 Sample(s) Required between 4/1/2015 and 4/30/2015
	3 Sample(s) Required between 5/1/2015 and 5/31/2015
	3 Sample(s) Required between 6/1/2015 and 6/30/2015
	3 Sample(s) Required between 7/1/2015 and 7/31/2015
	3 Sample(s) Required between 8/1/2015 and 8/31/2015
	3 Sample(s) Required between 9/1/2015 and 9/30/2015
	3 Sample(s) Required between 10/1/2015 and 10/31/2015
	3 Sample(s) Required between 11/1/2015 and 11/30/2015
	3 Sample(s) Required between 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000	3 Sample(s) Required between 1/1/2015 and 1/31/2015
	3 Sample(s) Required between 2/1/2015 and 2/28/2015
	3 Sample(s) Required between 3/1/2015 and 3/31/2015
	3 Sample(s) Required between 4/1/2015 and 4/30/2015
	3 Sample(s) Required between 5/1/2015 and 5/31/2015
	3 Sample(s) Required between 6/1/2015 and 6/30/2015
	3 Sample(s) Required between 7/1/2015 and 7/31/2015
	3 Sample(s) Required between 8/1/2015 and 8/31/2015
	3 Sample(s) Required between 9/1/2015 and 9/30/2015
	3 Sample(s) Required between 10/1/2015 and 10/31/2015
	3 Sample(s) Required between 11/1/2015 and 11/30/2015
	3 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>LISBON, VILLAGE OF DISTRIBUTION</b> <b>40890 SR 154</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2015

2015 DISTRIBUTION SCHEDULE

**OH1501512 LISBON VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>LISBON, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>DS202</b>	<b>ADDRESS NOT KNOWN</b>	

<b>Chemicals</b>	<b>Monitoring Requirements</b>
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS202

*Sample for all the analytes listed below:*

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH1501722 NEW WATERFORD VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>1560496</b>	Facility Name: <b>NEW WATERFORD - LINDSAY</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP002</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 2	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 3	1 Sample(s) Required between 4/1/2015 and 6/30/2015
<i>Sample for all the analytes listed below:</i>	
<i>BHC-GAMMA (LINDANE) - 2010 DIQUAT - 2032 GLYPHOSATE - 2034</i>	
<i>METHOXYCHLOR - 2015 POLYCHLORINATED BIPHENYLS (PCB) - 2383</i>	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 4	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH1501722 NEW WATERFORD VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>NEW WATERFORD, VLG. OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between	1/1/2015	and	1/31/2015
	2 Sample(s) Required between	2/1/2015	and	2/28/2015
	2 Sample(s) Required between	3/1/2015	and	3/31/2015
	2 Sample(s) Required between	4/1/2015	and	4/30/2015
	2 Sample(s) Required between	5/1/2015	and	5/31/2015
	2 Sample(s) Required between	6/1/2015	and	6/30/2015
	2 Sample(s) Required between	7/1/2015	and	7/31/2015
	2 Sample(s) Required between	8/1/2015	and	8/31/2015
	2 Sample(s) Required between	9/1/2015	and	9/30/2015
	2 Sample(s) Required between	10/1/2015	and	10/31/2015
	2 Sample(s) Required between	11/1/2015	and	11/30/2015
	2 Sample(s) Required between	12/1/2015	and	12/31/2015

TOTAL CHLORINE - 1000	2 Sample(s) Required between	1/1/2015	and	1/31/2015
	2 Sample(s) Required between	2/1/2015	and	2/28/2015
	2 Sample(s) Required between	3/1/2015	and	3/31/2015
	2 Sample(s) Required between	4/1/2015	and	4/30/2015
	2 Sample(s) Required between	5/1/2015	and	5/31/2015
	2 Sample(s) Required between	6/1/2015	and	6/30/2015
	2 Sample(s) Required between	7/1/2015	and	7/31/2015
	2 Sample(s) Required between	8/1/2015	and	8/31/2015
	2 Sample(s) Required between	9/1/2015	and	9/30/2015
	2 Sample(s) Required between	10/1/2015	and	10/31/2015
	2 Sample(s) Required between	11/1/2015	and	11/30/2015
	2 Sample(s) Required between	12/1/2015	and	12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>NEW WATERFORD, VLG. OF DISTRIBUTION</b> <b>3383 PINWOOD DRIVE</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2015

2015 DISTRIBUTION SCHEDULE

**OH1501722 NEW WATERFORD VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>NEW WATERFORD, VLG. OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>DS202</b>	<b>46834 TAYLOR STREET</b>	

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS202

*Sample for all the analytes listed below:*

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH1502011 SALEM CITY**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>1553407</b>	Facility Name: <b>SALEM WTP</b>	Facility Class: <b>CLASS 3</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Surface Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015**

Chemicals	Monitoring Requirements
-----------	-------------------------

INORGANICS	1 Sample(s) Required between 1/1/2015 and 5/31/2015
------------	---

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074    ARSENIC - 1005    BARIUM - 1010    BERYLLIUM, TOTAL - 1075    CADMIUM - 1015    CHROMIUM - 1020  
 CYANIDE - 1024    FLUORIDE - 1025    MERCURY - 1035    NICKEL - 1036    SELENIUM - 1045    THALLIUM, TOTAL - 1085

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 1/31/2015
	1 Sample(s) Required between 2/1/2015 and 2/28/2015
	1 Sample(s) Required between 3/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 4/30/2015
	1 Sample(s) Required between 5/1/2015 and 5/31/2015
	1 Sample(s) Required between 6/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 7/31/2015
	1 Sample(s) Required between 8/1/2015 and 8/31/2015
	1 Sample(s) Required between 9/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 10/31/2015
	1 Sample(s) Required between 11/1/2015 and 11/30/2015
	1 Sample(s) Required between 12/1/2015 and 12/31/2015

RADIOLOGICALS	Not Required
---------------	--------------

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2015 and 6/30/2015
---	---

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051    ATRAZINE - 2050    SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 4/1/2015 and 6/30/2015
----------------------------------	---

TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 1/1/2015 and 1/31/2015
	1 Paired Sample Set Required between 2/1/2015 and 2/28/2015
	1 Paired Sample Set Required between 3/1/2015 and 3/31/2015
	1 Paired Sample Set Required between 4/1/2015 and 4/30/2015
	1 Paired Sample Set Required between 5/1/2015 and 5/31/2015
	1 Paired Sample Set Required between 6/1/2015 and 6/30/2015
	1 Paired Sample Set Required between 7/1/2015 and 7/31/2015
	1 Paired Sample Set Required between 8/1/2015 and 8/31/2015
	1 Paired Sample Set Required between 9/1/2015 and 9/30/2015
	1 Paired Sample Set Required between 10/1/2015 and 10/31/2015
	1 Paired Sample Set Required between 11/1/2015 and 11/30/2015
	1 Paired Sample Set Required between 12/1/2015 and 12/31/2015

**A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.**



**OH1502011 SALEM CITY**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>SALEM, CITY OF DISTRIBUTION</b>	Facility Class: <b>CLASS 2</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	15 Sample(s) Required between	1/1/2015	and	1/31/2015
	15 Sample(s) Required between	2/1/2015	and	2/28/2015
	15 Sample(s) Required between	3/1/2015	and	3/31/2015
	15 Sample(s) Required between	4/1/2015	and	4/30/2015
	15 Sample(s) Required between	5/1/2015	and	5/31/2015
	15 Sample(s) Required between	6/1/2015	and	6/30/2015
	15 Sample(s) Required between	7/1/2015	and	7/31/2015
	15 Sample(s) Required between	8/1/2015	and	8/31/2015
	15 Sample(s) Required between	9/1/2015	and	9/30/2015
	15 Sample(s) Required between	10/1/2015	and	10/31/2015
	15 Sample(s) Required between	11/1/2015	and	11/30/2015
	15 Sample(s) Required between	12/1/2015	and	12/31/2015

TOTAL CHLORINE - 1000	15 Sample(s) Required between	1/1/2015	and	1/31/2015
	15 Sample(s) Required between	2/1/2015	and	2/28/2015
	15 Sample(s) Required between	3/1/2015	and	3/31/2015
	15 Sample(s) Required between	4/1/2015	and	4/30/2015
	15 Sample(s) Required between	5/1/2015	and	5/31/2015
	15 Sample(s) Required between	6/1/2015	and	6/30/2015
	15 Sample(s) Required between	7/1/2015	and	7/31/2015
	15 Sample(s) Required between	8/1/2015	and	8/31/2015
	15 Sample(s) Required between	9/1/2015	and	9/30/2015
	15 Sample(s) Required between	10/1/2015	and	10/31/2015
	15 Sample(s) Required between	11/1/2015	and	11/30/2015
	15 Sample(s) Required between	12/1/2015	and	12/31/2015

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>SALEM, CITY OF DISTRIBUTION</b> <b>2491 ST. RT 45 (KSU)</b>	Facility Class: <b>CLASS 2</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between	1/8/2015	and	1/14/2015	at SMP: DS201
	1 Sample(s) Required between	4/8/2015	and	4/14/2015	at SMP: DS201
	1 Sample(s) Required between	7/8/2015	and	7/14/2015	at SMP: DS201
	1 Sample(s) Required between	10/8/2015	and	10/14/2015	at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

**OH1502011 SALEM CITY**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>SALEM, CITY OF DISTRIBUTION</b> <b>1460 BROOKVIEW DR.</b>	Facility Class: <b>CLASS 2</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/8/2015 and 1/14/2015 at SMP: DS202
	1 Sample(s) Required between 4/8/2015 and 4/14/2015 at SMP: DS202
	1 Sample(s) Required between 7/8/2015 and 7/14/2015 at SMP: DS202
	1 Sample(s) Required between 10/8/2015 and 10/14/2015 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS203</b>	Facility Name: <b>SALEM, CITY OF DISTRIBUTION</b> <b>475 W. SECOND</b>	Facility Class: <b>CLASS 2</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/8/2015 and 1/14/2015 at SMP: DS203
	1 Sample(s) Required between 4/8/2015 and 4/14/2015 at SMP: DS203
	1 Sample(s) Required between 7/8/2015 and 7/14/2015 at SMP: DS203
	1 Sample(s) Required between 10/8/2015 and 10/14/2015 at SMP: DS203

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS204</b>	Facility Name: <b>SALEM, CITY OF DISTRIBUTION</b> <b>1098N ELLSWORTH</b>	Facility Class: <b>CLASS 2</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/8/2015 and 1/14/2015 at SMP: DS204
	1 Sample(s) Required between 4/8/2015 and 4/14/2015 at SMP: DS204
	1 Sample(s) Required between 7/8/2015 and 7/14/2015 at SMP: DS204
	1 Sample(s) Required between 10/8/2015 and 10/14/2015 at SMP: DS204

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

OH1502512 AQUA OHIO - TOMAHAWK UTILITIES

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>1553411</b>	Facility Name: <b>AQUA OHIO - TOMAHAWK</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



**OH1502512 AQUA OHIO - TOMAHAWK UTILITIES**

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2015 and 9/30/2015
-------------------------------	---

*Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>*

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 1/31/2015
	1 Sample(s) Required between 2/1/2015 and 2/28/2015
	1 Sample(s) Required between 3/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 4/30/2015
	1 Sample(s) Required between 5/1/2015 and 5/31/2015
	1 Sample(s) Required between 6/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 7/31/2015
	1 Sample(s) Required between 8/1/2015 and 8/31/2015
	1 Sample(s) Required between 9/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 10/31/2015
	1 Sample(s) Required between 11/1/2015 and 11/30/2015
	1 Sample(s) Required between 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2015 and 1/31/2015
	1 Sample(s) Required between 2/1/2015 and 2/28/2015
	1 Sample(s) Required between 3/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 4/30/2015
	1 Sample(s) Required between 5/1/2015 and 5/31/2015
	1 Sample(s) Required between 6/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 7/31/2015
	1 Sample(s) Required between 8/1/2015 and 8/31/2015
	1 Sample(s) Required between 9/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 10/31/2015
	1 Sample(s) Required between 11/1/2015 and 11/30/2015
	1 Sample(s) Required between 12/1/2015 and 12/31/2015

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201
-------------------------	---

*Sample for all the analytes listed below:*

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2015

2015 DISTRIBUTION SCHEDULE

**OH1502512 AQUA OHIO - TOMAHAWK UTILITIES**

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>DS202</b>	<b>ADDRESS NOT KNOWN</b>	

<b>Chemicals</b>	<b>Monitoring Requirements</b>
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS202

*Sample for all the analytes listed below:*

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

OH1502612 PREMIER PARK ESTATES LLC

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>1553412</b>	Facility Name: <b>PREMIER PARK ESTATES</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 10/1/2015 and 12/31/2015
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH1502612 PREMIER PARK ESTATES LLC

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>PREMIER PARK ESTATES DISTRIBUTION</b>
	SMP ID: <b>DS000</b>	

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2015 and 9/30/2015
-------------------------------	---

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 1/31/2015
	1 Sample(s) Required between 2/1/2015 and 2/28/2015
	1 Sample(s) Required between 3/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 4/30/2015
	1 Sample(s) Required between 5/1/2015 and 5/31/2015
	1 Sample(s) Required between 6/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 7/31/2015
	1 Sample(s) Required between 8/1/2015 and 8/31/2015
	1 Sample(s) Required between 9/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 10/31/2015
	1 Sample(s) Required between 11/1/2015 and 11/30/2015
	1 Sample(s) Required between 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2015 and 1/31/2015
	1 Sample(s) Required between 2/1/2015 and 2/28/2015
	1 Sample(s) Required between 3/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 4/30/2015
	1 Sample(s) Required between 5/1/2015 and 5/31/2015
	1 Sample(s) Required between 6/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 7/31/2015
	1 Sample(s) Required between 8/1/2015 and 8/31/2015
	1 Sample(s) Required between 9/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 10/31/2015
	1 Sample(s) Required between 11/1/2015 and 11/30/2015
	1 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>PREMIER PARK ESTATES DISTRIBUTION</b>
	SMP ID: <b>DS201</b>	<b>ADDRESS NOT KNOWN</b>

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

**OH1502712 AUBURN SKILLED NURSING AND REHABILITATIO**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>1553413</b>	Facility Name: <b>AUBURN SKILLED NURSING AND REHABILITATIO</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>
		Facility Class: <b>CLASS 1</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH1502712 AUBURN SKILLED NURSING AND REHABILITATIO

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

Table with 2 columns: Sampling Location and Facility Name/ID. Facility ID: DS1, Facility Name: AUBURN SKILLED NURSING AND REHAB DIS, SMP ID: DS000

Table with 2 columns: Chemicals and Monitoring Requirements. Lists monitoring schedules for TOTAL COLIFORM (TCR) - 3100 and TOTAL CHLORINE - 1000, including sample frequency and dates from 1/1/2015 to 12/31/2015.

Samples should be collected at the same time and place as the Total Coliform samples.

Table with 2 columns: Sampling Location and Facility Name/ID. Facility ID: DS1, Facility Name: AUBURN SKILLED NURSING AND REHAB DIS, SMP ID: DS201, ADDRESS NOT KNOWN

Table with 2 columns: Chemicals and Monitoring Requirements. Lists monitoring schedule for DISINFECTION BYPRODUCTS, including sample frequency and dates from 2/8/2015 to 11/14/2015 at SMP: DS201.

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



OH1502812 WASHINGTONVILLE VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

Table with 4 columns: Sampling Location, Facility ID, Facility Name, Facility Class. Values: DS1, WASHINGTONVILLE, VLG. OF DISTRIBUTION, CLASS 1.

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100 1 Sample(s) Required between 1/1/2015 and 1/31/2015 ... 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000 1 Sample(s) Required between 1/1/2015 and 1/31/2015 ... 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Table with 4 columns: Sampling Location, Facility ID, Facility Name, Facility Class. Values: DS201, 865 BOSTON ST., CLASS 1.

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 2/1/2015 and 2/7/2015 at SMP: DS201 ... 11/1/2015 and 11/7/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



**OH1502812 WASHINGTONVILLE VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>WASHINGTONVILLE, VLG. OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>DS202</b>	<b>40105 ST. RT. 14</b>	

<b>Chemicals</b>	<b>Monitoring Requirements</b>
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/1/2015 and 2/7/2015 at SMP: DS202
	1 Sample(s) Required between 5/1/2015 and 5/7/2015 at SMP: DS202
	1 Sample(s) Required between 8/1/2015 and 8/7/2015 at SMP: DS202
	1 Sample(s) Required between 11/1/2015 and 11/7/2015 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH1502911 BUCKEYE WATER DISTRICT - OHIO RIVER**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>1562275</b>	Facility Name: <b>BUCKEYE WATER DISTRICT-OHIO RIVER</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Surface Water</b>
		Facility Class: <b>CLASS 3</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015**

**Chemicals**

**Monitoring Requirements**

INORGANICS 1 Sample(s) Required between 1/1/2015 and 5/31/2015

*Sample for all the analytes listed below:*

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020  
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2015 and 1/31/2015

1 Sample(s) Required between 2/1/2015 and 2/28/2015

1 Sample(s) Required between 3/1/2015 and 3/31/2015

1 Sample(s) Required between 4/1/2015 and 4/30/2015

1 Sample(s) Required between 5/1/2015 and 5/31/2015

1 Sample(s) Required between 6/1/2015 and 6/30/2015

1 Sample(s) Required between 7/1/2015 and 7/31/2015

1 Sample(s) Required between 8/1/2015 and 8/31/2015

1 Sample(s) Required between 9/1/2015 and 9/30/2015

1 Sample(s) Required between 10/1/2015 and 10/31/2015

1 Sample(s) Required between 11/1/2015 and 11/30/2015

1 Sample(s) Required between 12/1/2015 and 12/31/2015

RADIOLOGICALS Not Required

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 4/1/2015 and 6/30/2015

*Sample for all the analytes listed below:*

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 1/1/2015 and 5/31/2015

TOTAL ORGANIC CARBON (TOC)

1 Paired Sample Set Required between 1/1/2015 and 1/31/2015

1 Paired Sample Set Required between 2/1/2015 and 2/28/2015

1 Paired Sample Set Required between 3/1/2015 and 3/31/2015

1 Paired Sample Set Required between 4/1/2015 and 4/30/2015

1 Paired Sample Set Required between 5/1/2015 and 5/31/2015

1 Paired Sample Set Required between 6/1/2015 and 6/30/2015

1 Paired Sample Set Required between 7/1/2015 and 7/31/2015

1 Paired Sample Set Required between 8/1/2015 and 8/31/2015

1 Paired Sample Set Required between 9/1/2015 and 9/30/2015

1 Paired Sample Set Required between 10/1/2015 and 10/31/2015

1 Paired Sample Set Required between 11/1/2015 and 11/30/2015

1 Paired Sample Set Required between 12/1/2015 and 12/31/2015

**A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.**



OH1502911 BUCKEYE WATER DISTRICT - OHIO RIVER

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

Table with 4 columns: Sampling Location, Facility ID, Facility Name, Facility Class. Values: DS1, DS000, BUCKEYE WATER DISTRICT-WELLSVILLE DISTRICT, CLASS 1

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 30 Sample(s) Required between 6/1/2015 and 9/30/2015

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: http://epa.ohio.gov/ddagw/reporting.aspx

TOTAL COLIFORM (TCR) - 3100 10 Sample(s) Required between 1/1/2015 and 1/31/2015, 10 Sample(s) Required between 2/1/2015 and 2/28/2015, 10 Sample(s) Required between 3/1/2015 and 3/31/2015, 10 Sample(s) Required between 4/1/2015 and 4/30/2015, 10 Sample(s) Required between 5/1/2015 and 5/31/2015, 10 Sample(s) Required between 6/1/2015 and 6/30/2015, 10 Sample(s) Required between 7/1/2015 and 7/31/2015, 10 Sample(s) Required between 8/1/2015 and 8/31/2015, 10 Sample(s) Required between 9/1/2015 and 9/30/2015, 10 Sample(s) Required between 10/1/2015 and 10/31/2015, 10 Sample(s) Required between 11/1/2015 and 11/30/2015, 10 Sample(s) Required between 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000 10 Sample(s) Required between 1/1/2015 and 1/31/2015, 10 Sample(s) Required between 2/1/2015 and 2/28/2015, 10 Sample(s) Required between 3/1/2015 and 3/31/2015, 10 Sample(s) Required between 4/1/2015 and 4/30/2015, 10 Sample(s) Required between 5/1/2015 and 5/31/2015, 10 Sample(s) Required between 6/1/2015 and 6/30/2015, 10 Sample(s) Required between 7/1/2015 and 7/31/2015, 10 Sample(s) Required between 8/1/2015 and 8/31/2015, 10 Sample(s) Required between 9/1/2015 and 9/30/2015, 10 Sample(s) Required between 10/1/2015 and 10/31/2015, 10 Sample(s) Required between 11/1/2015 and 11/30/2015, 10 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Table with 4 columns: Sampling Location, Facility ID, Facility Name, Facility Class. Values: DS1, DS201, BUCKEYE WATER DISTRICT-WELLSVILLE DISTRICT, CLASS 1

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 2/1/2015 and 2/7/2015 at SMP: DS201, 1 Sample(s) Required between 5/1/2015 and 5/7/2015 at SMP: DS201, 1 Sample(s) Required between 8/1/2015 and 8/7/2015 at SMP: DS201, 1 Sample(s) Required between 11/1/2015 and 11/7/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950

**OH1502911 BUCKEYE WATER DISTRICT - OHIO RIVER**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>BUCKEYE WATER DISTRICT-WELLSVILLE DISTRICT</b> <b>49100 FAIRWAY DR. F.H.#340</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/1/2015 and 2/7/2015 at SMP: DS202
	1 Sample(s) Required between 5/1/2015 and 5/7/2015 at SMP: DS202
	1 Sample(s) Required between 8/1/2015 and 8/7/2015 at SMP: DS202
	1 Sample(s) Required between 11/1/2015 and 11/7/2015 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS203</b>	Facility Name: <b>BUCKEYE WATER DISTRICT-WELLSVILLE DISTRICT</b> <b>13280 ECHO DELL RD. F.H.#72</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/1/2015 and 2/7/2015 at SMP: DS203
	1 Sample(s) Required between 5/1/2015 and 5/7/2015 at SMP: DS203
	1 Sample(s) Required between 8/1/2015 and 8/7/2015 at SMP: DS203
	1 Sample(s) Required between 11/1/2015 and 11/7/2015 at SMP: DS203

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS204</b>	Facility Name: <b>BUCKEYE WATER DISTRICT-WELLSVILLE DISTRICT</b> <b>49338 EAGLE DRIVE RD. F.H.#342</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/1/2015 and 2/7/2015 at SMP: DS204
	1 Sample(s) Required between 5/1/2015 and 5/7/2015 at SMP: DS204
	1 Sample(s) Required between 8/1/2015 and 8/7/2015 at SMP: DS204
	1 Sample(s) Required between 11/1/2015 and 11/7/2015 at SMP: DS204

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH1503012 WINONA WATER SUPPLY**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>1553417</b>	Facility Name: <b>WINONA WATER SUPPLY</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 2	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 3	1 Sample(s) Required between 4/1/2015 and 6/30/2015
<i>Sample for all the analytes listed below:</i>	
<i>BHC-GAMMA (LINDANE) - 2010 DIQUAT - 2032 GLYPHOSATE - 2034</i>	
<i>METHOXYCHLOR - 2015 POLYCHLORINATED BIPHENYLS (PCB) - 2383</i>	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 4	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH1503012 WINONA WATER SUPPLY

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>WINONA WATER SUPPLY DISTRIBUTION</b>
	SMP ID: <b>DS000</b>	

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2015 and 1/31/2015
	1 Sample(s) Required between	2/1/2015 and 2/28/2015
	1 Sample(s) Required between	3/1/2015 and 3/31/2015
	1 Sample(s) Required between	4/1/2015 and 4/30/2015
	1 Sample(s) Required between	5/1/2015 and 5/31/2015
	1 Sample(s) Required between	6/1/2015 and 6/30/2015
	1 Sample(s) Required between	7/1/2015 and 7/31/2015
	1 Sample(s) Required between	8/1/2015 and 8/31/2015
	1 Sample(s) Required between	9/1/2015 and 9/30/2015
	1 Sample(s) Required between	10/1/2015 and 10/31/2015
	1 Sample(s) Required between	11/1/2015 and 11/30/2015
	1 Sample(s) Required between	12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2015 and 1/31/2015
	1 Sample(s) Required between	2/1/2015 and 2/28/2015
	1 Sample(s) Required between	3/1/2015 and 3/31/2015
	1 Sample(s) Required between	4/1/2015 and 4/30/2015
	1 Sample(s) Required between	5/1/2015 and 5/31/2015
	1 Sample(s) Required between	6/1/2015 and 6/30/2015
	1 Sample(s) Required between	7/1/2015 and 7/31/2015
	1 Sample(s) Required between	8/1/2015 and 8/31/2015
	1 Sample(s) Required between	9/1/2015 and 9/30/2015
	1 Sample(s) Required between	10/1/2015 and 10/31/2015
	1 Sample(s) Required between	11/1/2015 and 11/30/2015
	1 Sample(s) Required between	12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>WINONA WATER SUPPLY DISTRIBUTION</b>
	SMP ID: <b>DS201</b>	<b>32070 CAMERON STREET</b>

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

**OH1503312 FARR HILL MHP**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>1553419</b>	Facility Name: <b>FARR HILL MHP</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH1503312 FARR HILL MHP

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: FARR HILL MHP DISTRIBUTION
Location SMP ID: DS000

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2015 and 9/30/2015

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: http://epa.ohio.gov/ddagw/reporting.aspx

TOTAL COLIFORM (TCR) - 3100 1 Sample(s) Required between 1/1/2015 and 1/31/2015
1 Sample(s) Required between 2/1/2015 and 2/28/2015
1 Sample(s) Required between 3/1/2015 and 3/31/2015
1 Sample(s) Required between 4/1/2015 and 4/30/2015
1 Sample(s) Required between 5/1/2015 and 5/31/2015
1 Sample(s) Required between 6/1/2015 and 6/30/2015
1 Sample(s) Required between 7/1/2015 and 7/31/2015
1 Sample(s) Required between 8/1/2015 and 8/31/2015
1 Sample(s) Required between 9/1/2015 and 9/30/2015
1 Sample(s) Required between 10/1/2015 and 10/31/2015
1 Sample(s) Required between 11/1/2015 and 11/30/2015
1 Sample(s) Required between 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000 1 Sample(s) Required between 1/1/2015 and 1/31/2015
1 Sample(s) Required between 2/1/2015 and 2/28/2015
1 Sample(s) Required between 3/1/2015 and 3/31/2015
1 Sample(s) Required between 4/1/2015 and 4/30/2015
1 Sample(s) Required between 5/1/2015 and 5/31/2015
1 Sample(s) Required between 6/1/2015 and 6/30/2015
1 Sample(s) Required between 7/1/2015 and 7/31/2015
1 Sample(s) Required between 8/1/2015 and 8/31/2015
1 Sample(s) Required between 9/1/2015 and 9/30/2015
1 Sample(s) Required between 10/1/2015 and 10/31/2015
1 Sample(s) Required between 11/1/2015 and 11/30/2015
1 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Facility ID: DS1 Facility Name: FARR HILL MHP DISTRIBUTION
Location SMP ID: DS201 ADDRESS NOT KNOWN

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

**OH1503412 GUILFORD LAKE ESTATES**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>1553420</b>	Facility Name: <b>GUILFORD LAKE ESTATES</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH1503412 GUILFORD LAKE ESTATES

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

Table with 2 columns: Sampling Location and Facility Name/ID. Facility ID: DS1, Facility Name: GUILFORD LAKE ESTATES DISTRIBUTION, SMP ID: DS000

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

Table for TOTAL COLIFORM (TCR) - 3100 with 12 rows of monitoring requirements between 1/1/2015 and 12/31/2015.

Table for TOTAL CHLORINE - 1000 with 12 rows of monitoring requirements between 1/1/2015 and 12/31/2015.

Samples should be collected at the same time and place as the Total Coliform samples.

Table with 2 columns: Sampling Location and Facility Name/ID. Facility ID: DS1, Facility Name: GUILFORD LAKE ESTATES DISTRIBUTION, SMP ID: DS201, 7443 SPILLWAY ROAD LOT 35 AND 3

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

**OH1503512 BREEZEWAY MOBILE MANOR**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>1553421</b>	Facility Name: <b>BREEZEWAY MOBILE MANOR</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH1503512 BREEZEWAY MOBILE MANOR

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: BREEZEWAY MOBILE MANOR DISTRIBUTION
Location SMP ID: DS000

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

TOTAL COLIFORM (TCR) - 3100 1 Sample(s) Required between 1/1/2015 and 1/31/2015
1 Sample(s) Required between 2/1/2015 and 2/28/2015
1 Sample(s) Required between 3/1/2015 and 3/31/2015
1 Sample(s) Required between 4/1/2015 and 4/30/2015
1 Sample(s) Required between 5/1/2015 and 5/31/2015
1 Sample(s) Required between 6/1/2015 and 6/30/2015
1 Sample(s) Required between 7/1/2015 and 7/31/2015
1 Sample(s) Required between 8/1/2015 and 8/31/2015
1 Sample(s) Required between 9/1/2015 and 9/30/2015
1 Sample(s) Required between 10/1/2015 and 10/31/2015
1 Sample(s) Required between 11/1/2015 and 11/30/2015
1 Sample(s) Required between 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000 1 Sample(s) Required between 1/1/2015 and 1/31/2015
1 Sample(s) Required between 2/1/2015 and 2/28/2015
1 Sample(s) Required between 3/1/2015 and 3/31/2015
1 Sample(s) Required between 4/1/2015 and 4/30/2015
1 Sample(s) Required between 5/1/2015 and 5/31/2015
1 Sample(s) Required between 6/1/2015 and 6/30/2015
1 Sample(s) Required between 7/1/2015 and 7/31/2015
1 Sample(s) Required between 8/1/2015 and 8/31/2015
1 Sample(s) Required between 9/1/2015 and 9/30/2015
1 Sample(s) Required between 10/1/2015 and 10/31/2015
1 Sample(s) Required between 11/1/2015 and 11/30/2015
1 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Facility ID: DS1 Facility Name: BREEZEWAY MOBILE MANOR DISTRIBUTION
Location SMP ID: DS201 ADDRESS NOT KNOWN

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

**OH1504112 GUILFORD HIGHLANDS MOBILE HOME PARK PWS**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>1560956</b>	Facility Name: <b>GUILFORD HIGHLANDS MOBILE HOME PARK</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>
		Facility Class: <b>CLASS A</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH1504112 GUILFORD HIGHLANDS MOBILE HOME PARK PWS

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>GUILFORD HIGHLANDS MOBILE HOME PARK</b>
	SMP ID: <b>DS000</b>	

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2015 and 9/30/2015
-------------------------------	---

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 1/31/2015
	1 Sample(s) Required between 2/1/2015 and 2/28/2015
	1 Sample(s) Required between 3/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 4/30/2015
	1 Sample(s) Required between 5/1/2015 and 5/31/2015
	1 Sample(s) Required between 6/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 7/31/2015
	1 Sample(s) Required between 8/1/2015 and 8/31/2015
	1 Sample(s) Required between 9/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 10/31/2015
	1 Sample(s) Required between 11/1/2015 and 11/30/2015
	1 Sample(s) Required between 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2015 and 1/31/2015
	1 Sample(s) Required between 2/1/2015 and 2/28/2015
	1 Sample(s) Required between 3/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 4/30/2015
	1 Sample(s) Required between 5/1/2015 and 5/31/2015
	1 Sample(s) Required between 6/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 7/31/2015
	1 Sample(s) Required between 8/1/2015 and 8/31/2015
	1 Sample(s) Required between 9/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 10/31/2015
	1 Sample(s) Required between 11/1/2015 and 11/30/2015
	1 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>GUILFORD HIGHLANDS MOBILE HOME PARK</b>
	SMP ID: <b>DS201</b>	<b>ADDRESS NOT KNOWN</b>

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

OH1530112 CENTURY CONTAINER, LLC

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>1553423</b>	Facility Name: <b>CENTURY INDUSTRIES CORP 2</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



Effective Date: 01/01/2015

2015 DISTRIBUTION SCHEDULE

**OH1530112 CENTURY CONTAINER, LLC**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **CENTURY INDUSTRIES CORP. DISTRIBUTION**  
**Location** SMP ID: **DS000**

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

*Samples should be collected at the same time and place as the Total Coliform samples.*

**OH1530812 BETHEL UNITED CHURCH OF CHRIST**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **BETHEL UN. CH. OF CHRIST DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553426** Facility Name: **BETHEL UNITED CHURCH OF CHRIST**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

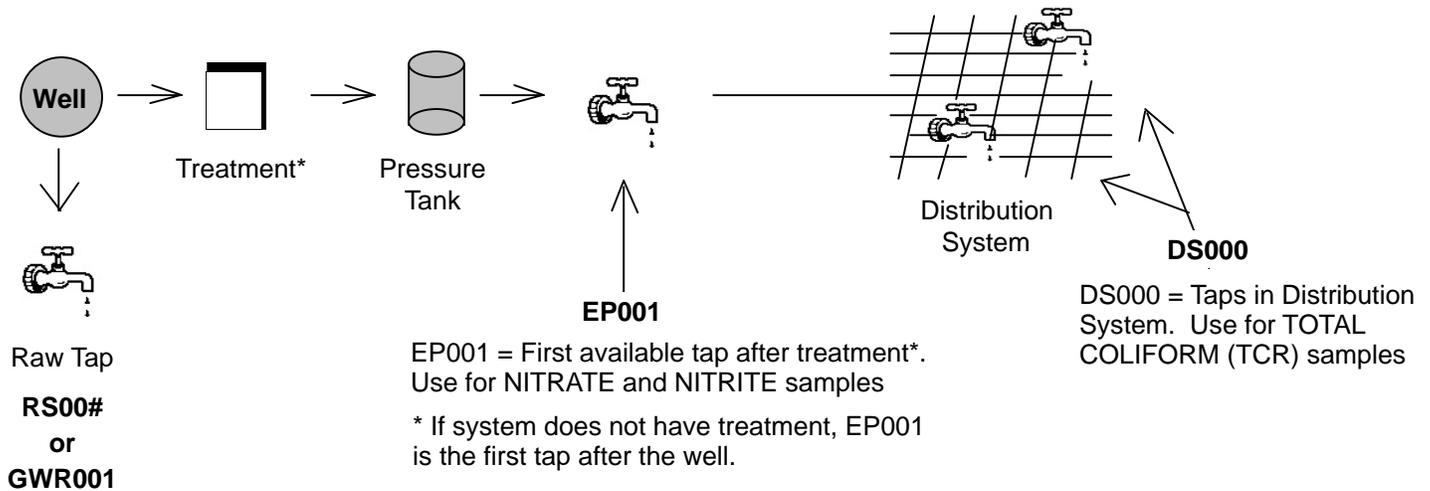

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1531112 GRACE CHAPEL - MINERVA**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> GRACE CHAPEL - MINERVA DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1553427	<b>Facility Name:</b> GRACE CHAPEL - MINERVA
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

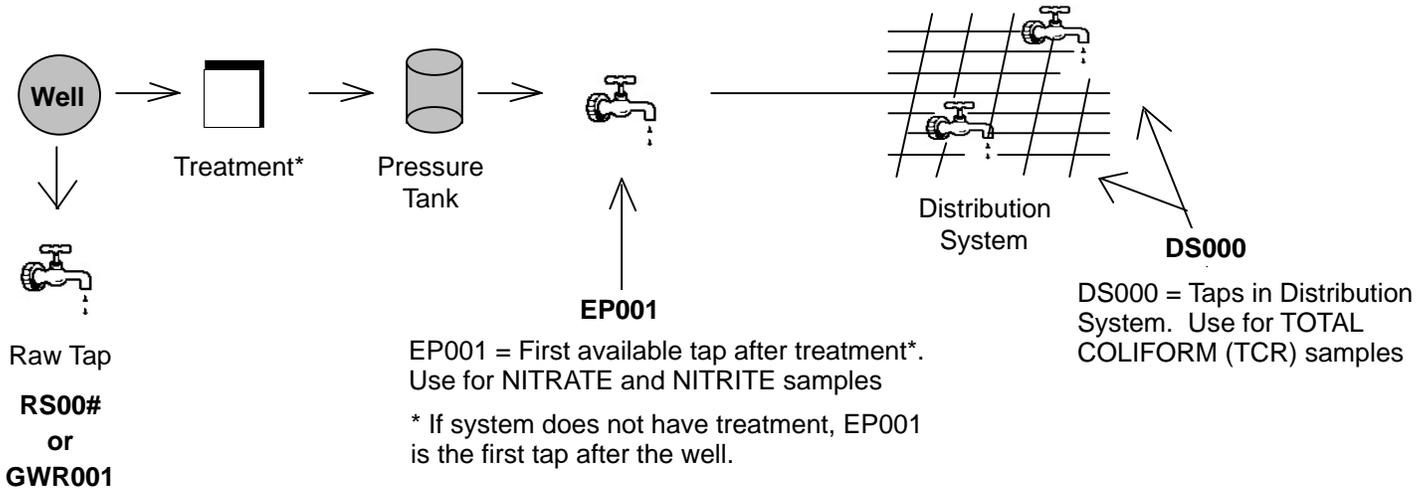

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1531412 HARVEST INN - HOMEWORTH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **HARVEST INN DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553428** Facility Name: **HARVEST INN**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

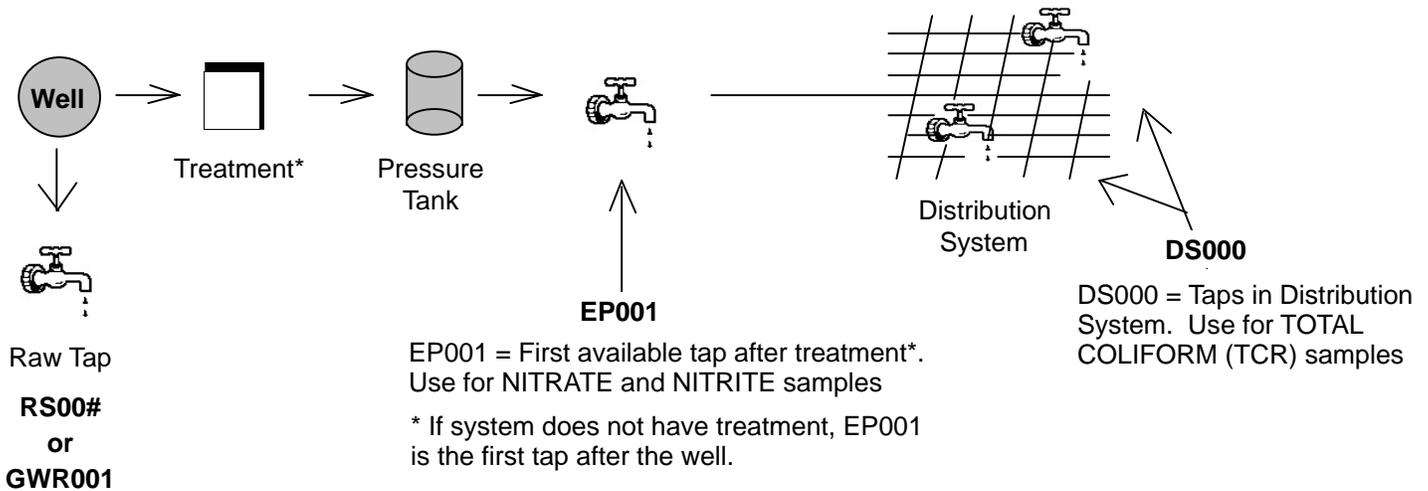

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1532212 MIDDLE SANDY EVANGELICAL PRESBYT. CHURCH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1 Facility Name: MIDDLESANDY EVENGELICALPRESBYT.CH DISTR.**  
**Location SMP ID: DS000 Facility Source: Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 1553432 Facility Name: MIDDLE SANDY EVANGELICAL PRESBYT. CHURCH**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

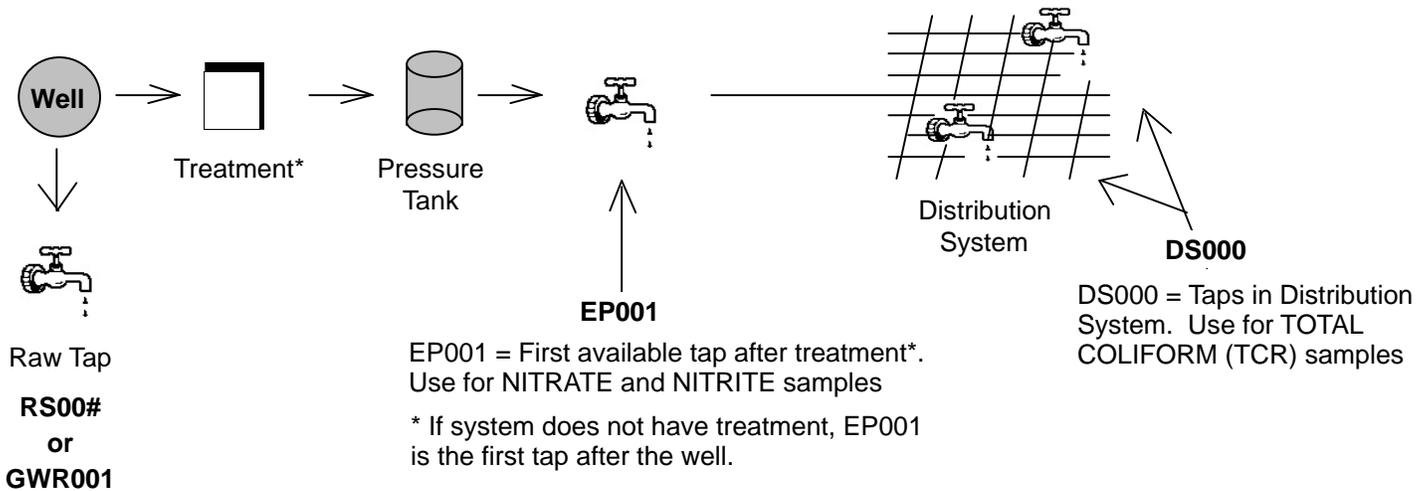

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

**OH1532412 OHIO DRILL AND TOOL CO.**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>1553433</b>	Facility Name: <b>OHIO DRILL &amp; TOOL CO</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



Effective Date: 01/01/2015

2015 DISTRIBUTION SCHEDULE

**OH1532412 OHIO DRILL AND TOOL CO.**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>OHIO DRILL &amp; TOOL CO. DISTRIBUTION</b>
	SMP ID: <b>DS000</b>	

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

**OH1532512 MINERVA COMMUNITY CHURCH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> MINERVA COMMUNITY CHURCH DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1553434	<b>Facility Name:</b> MINERVA COMMUNITY CHURCH
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 7/1/2015 and 9/30/2015

**Where to Collect Samples For a Small Public Water System**

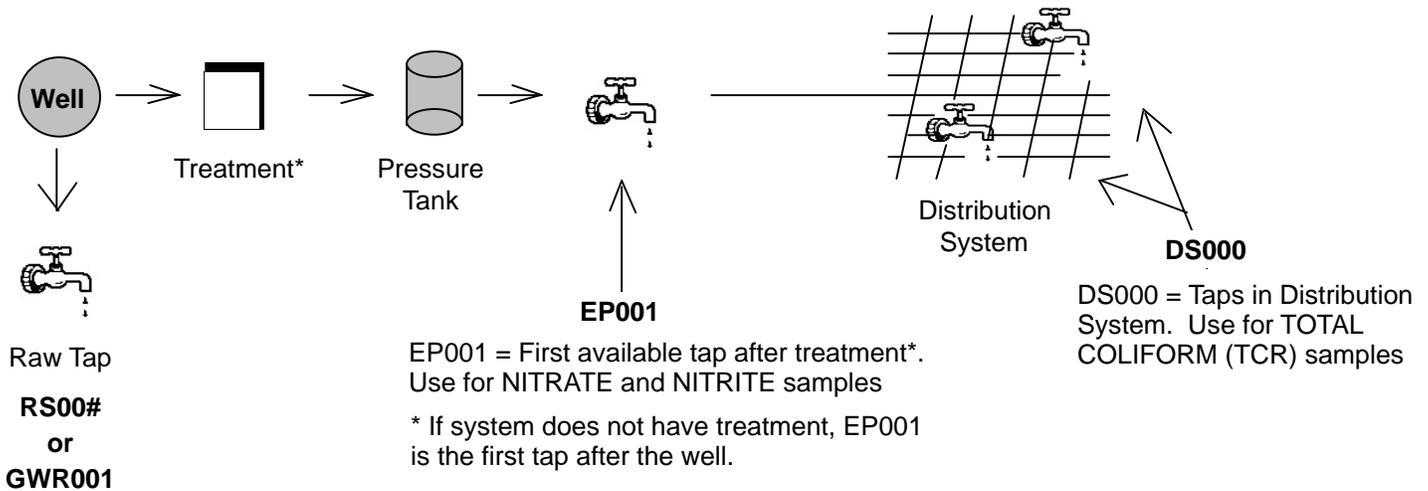

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1532712 READING CHURCH BRETHREN**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> READING CHURCH BRETHREN DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1553435	<b>Facility Name:</b> READING CHURCH BRETHREN
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

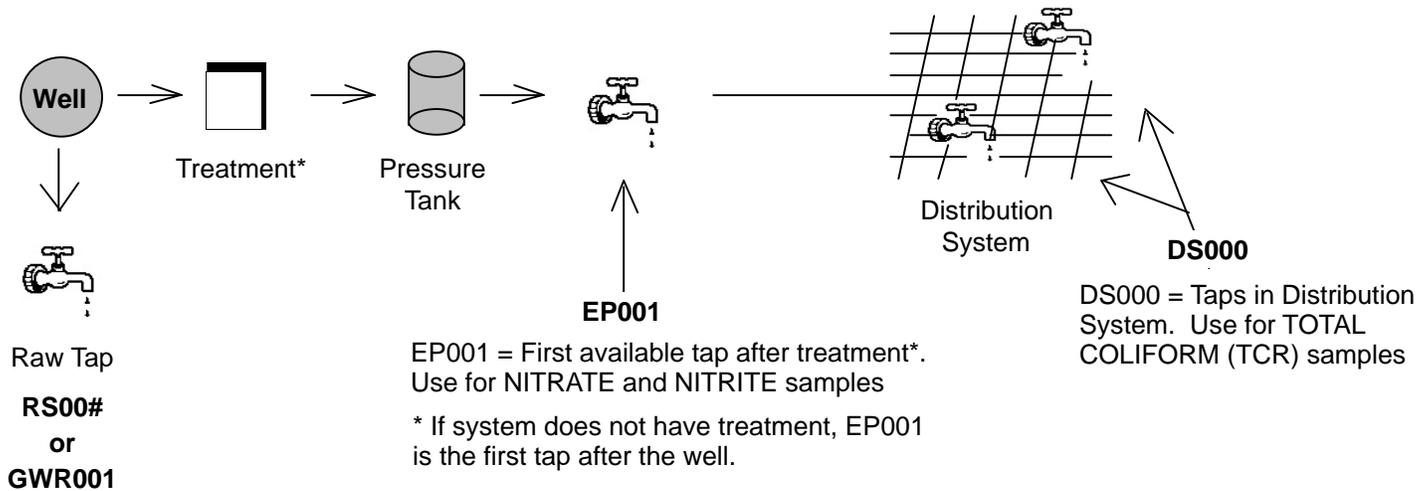

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1532912 SLEEPY HOLLOW CNTRY CLUB**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **SLEEPY HOLLOW CNTRY CLUB DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553436** Facility Name: **SLEEPY HOLLOW COUNTRY CLUB**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

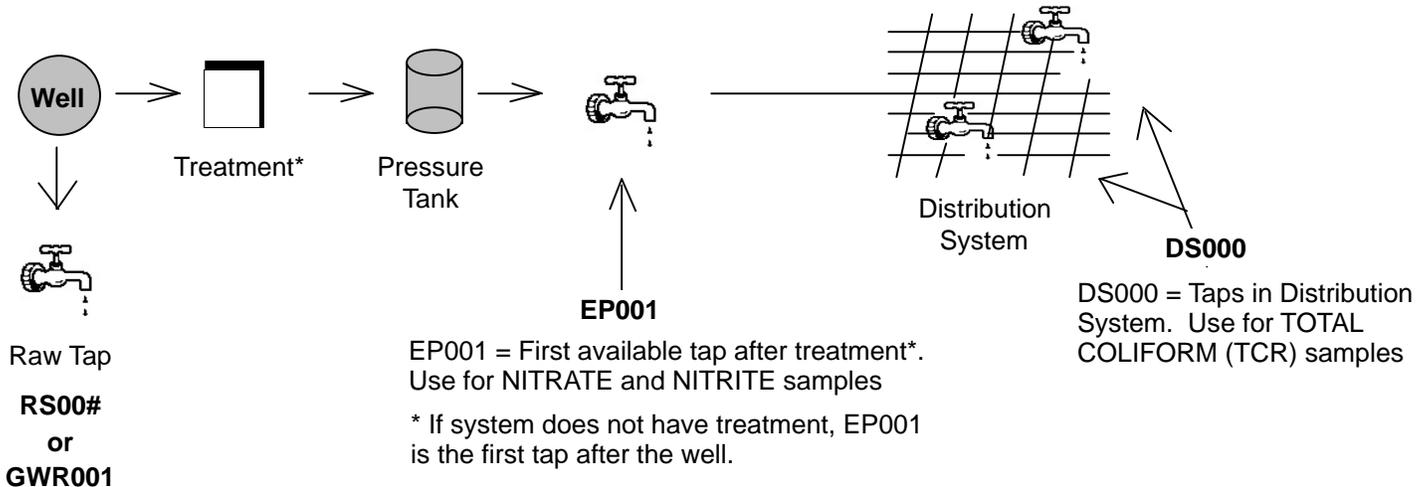

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1533512 WEST COMMUNITY CENTER**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **WEST COMMUNITY CENTER DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553437** Facility Name: **WEST COMMUNITY CENTER**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

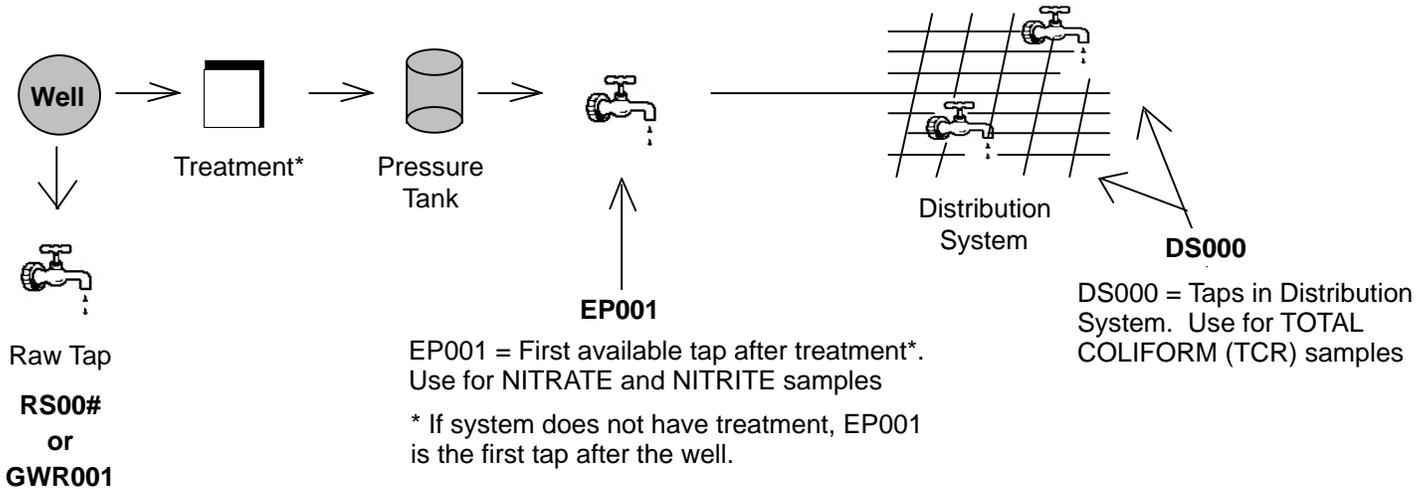

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1533612 WESTVILLE LAKE CAMPGROUND-ST**

System Type: Transient Noncommunity

Operating Period: 4/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **WESTVILLE LK CAMPGRND-ST DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553438** Facility Name: **WESTVILLE LK CAMPGRND ST**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

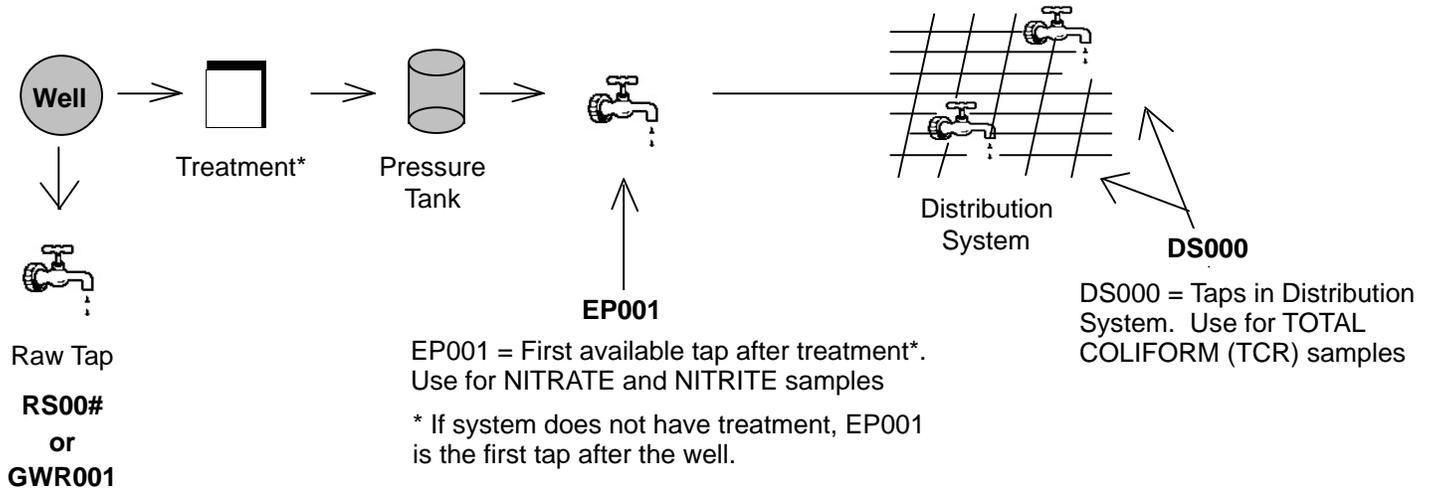

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1533622 WESTVILLE LAKE CAMPGROUND-BA**

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **WESTVILLE LK CAMPGRND-BA DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553439** Facility Name: **WESTVILLE LK CAMPGRND BA**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

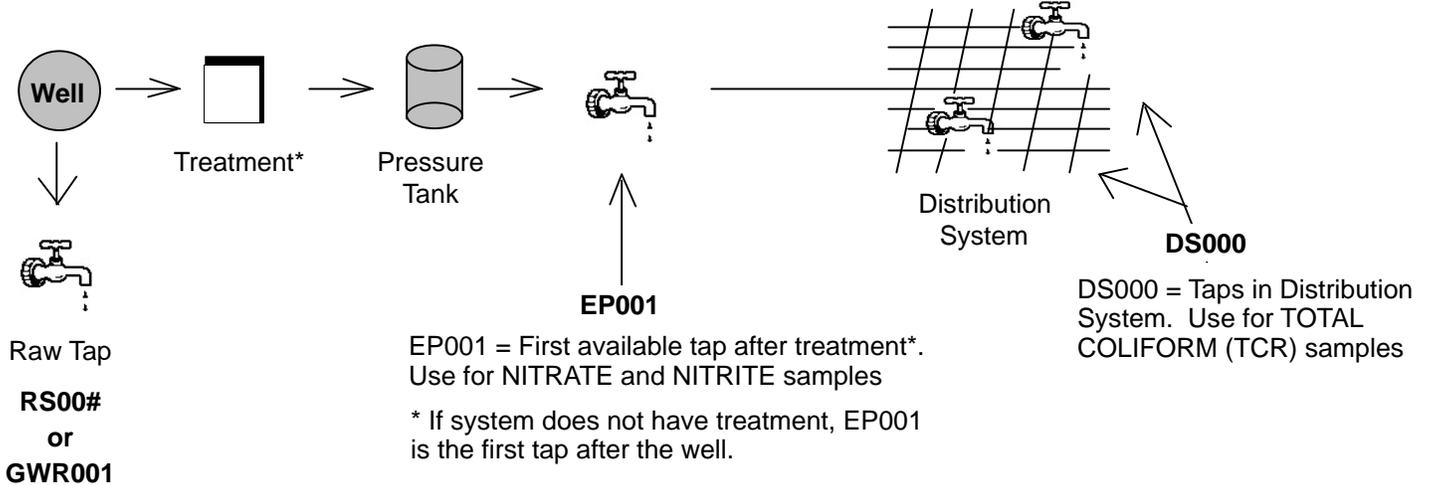

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**  
<http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

**Save a dime. Sample on time!**

**OH1533712 WESTVILLE LAKE C. C., INC.**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> WESTVILLE LAKE C.C., INC. DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1553440	<b>Facility Name:</b> WESTVILLE LAKE COUNTRY
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

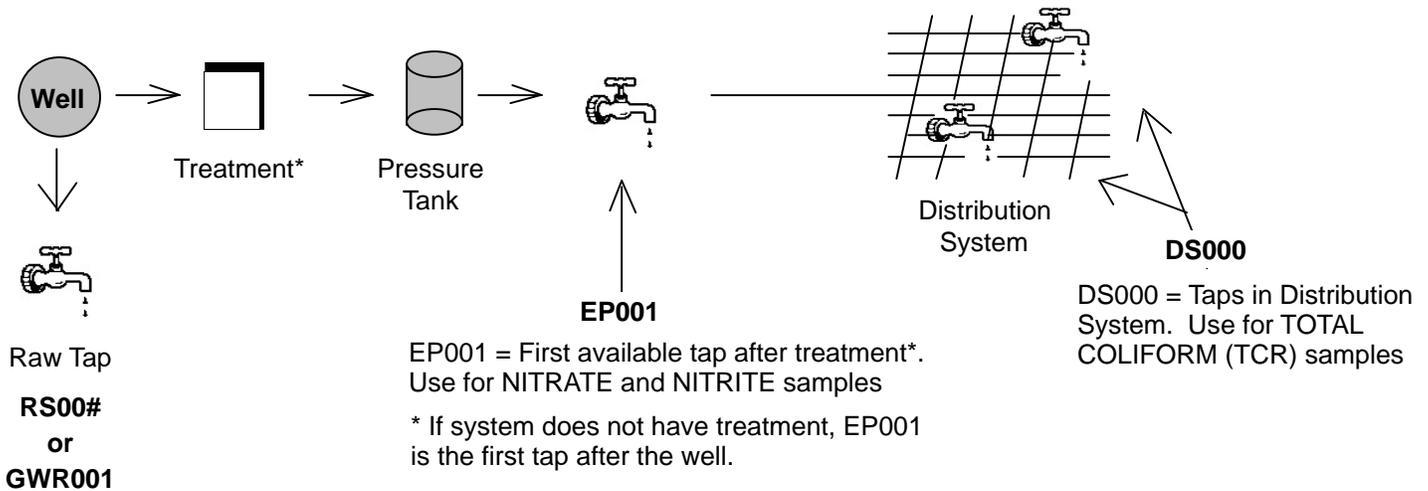

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1533912 7 AND 14 TRUCK STOP**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **7 & 14 TRUCK STOP DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553441** Facility Name: **7 & 14 TRUCK STOP**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

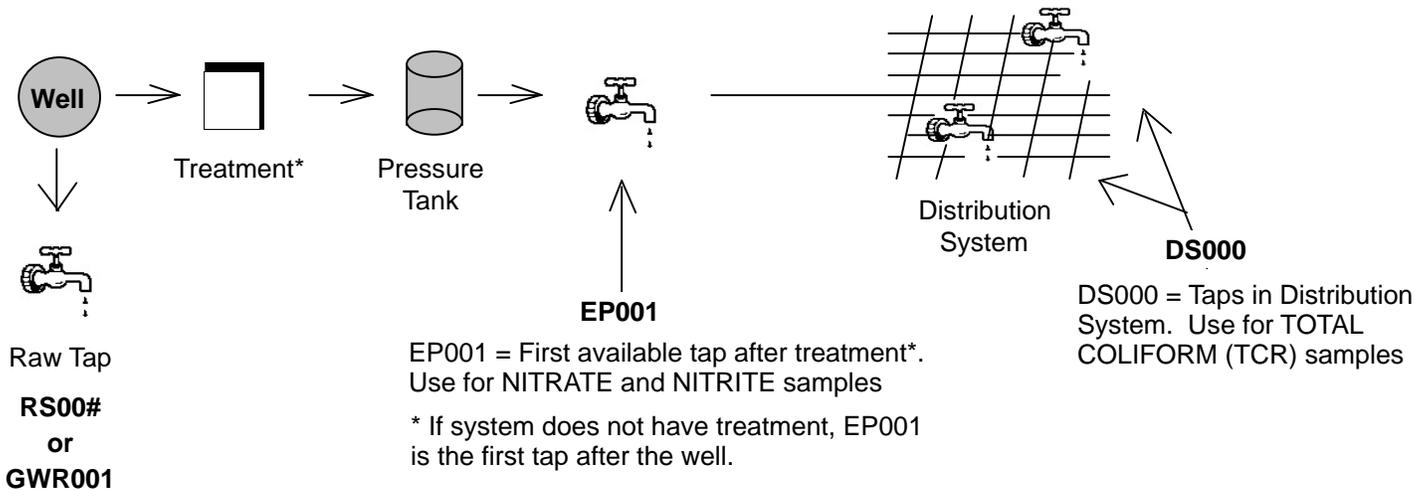

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1534412 ANDIS CONVENIENCE STORE PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **ANDIS CONVENIENCE STORE DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553444** Facility Name: **ANDIS CONVENIENCE STORE**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water** Facility Class: **CLASS A**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**Where to Collect Samples For a Small Public Water System**

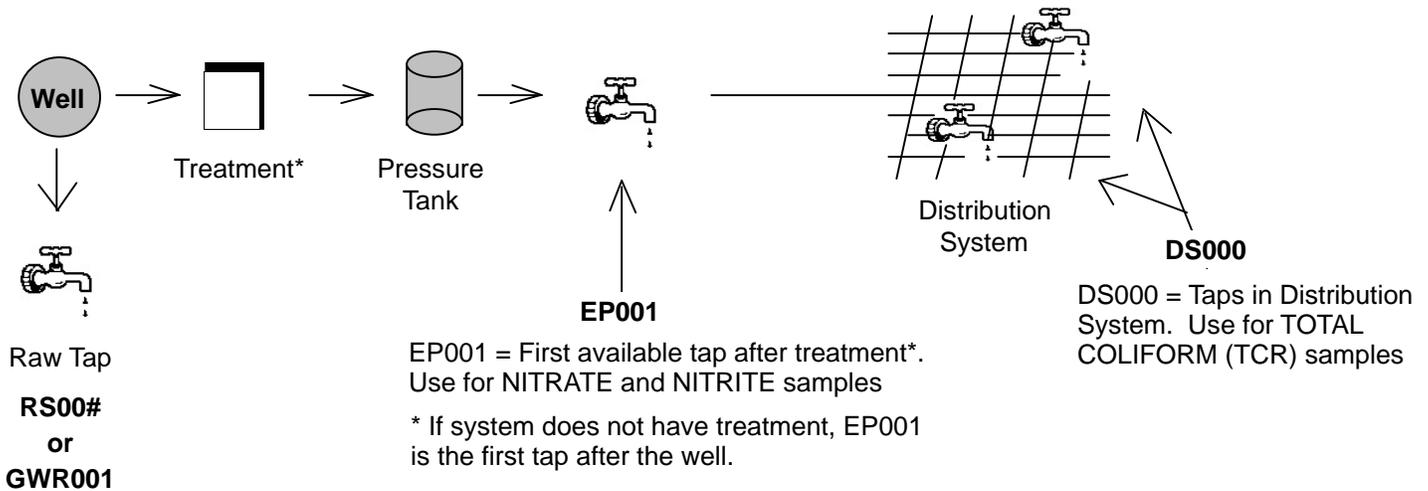

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

**OH1534512 CRESTVIEW LOCAL SCHOOLS**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>1553445</b>	Facility Name: <b>CRESTVIEW JR &amp; SR HS</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH1534512 CRESTVIEW LOCAL SCHOOLS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Table with 2 columns: Sampling Location, Facility ID: DS1, Facility Name: CRESTVIEW LOCAL SCHOOLS DISTRIBUTIO, SMP ID: DS000

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

TOTAL COLIFORM (TCR) - 3100 2 Sample(s) Required between 1/1/2015 and 1/31/2015 ... 2 Sample(s) Required between 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000 2 Sample(s) Required between 1/1/2015 and 1/31/2015 ... 2 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Table with 2 columns: Sampling Location, Facility ID: DS1, Facility Name: CRESTVIEW LOCAL SCHOOLS DISTRIBUTIO, SMP ID: DS201, ADDRESS NOT KNOWN

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



**OH1534512 CRESTVIEW LOCAL SCHOOLS**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>CRESTVIEW LOCAL SCHOOLS DISTRIBUTIO</b>
	SMP ID: <b>DS202</b>	<b>ADDRESS NOT KNOWN</b>

<b>Chemicals</b>	<b>Monitoring Requirements</b>
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

**OH1536612 BOJANGLES ROADHOUSE AND HONKY TONK**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **BOJANGLES ROADHOUSE AND HT DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553451** Facility Name: **BOJANGLES ROADHOUSE AND HONKY TONK**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

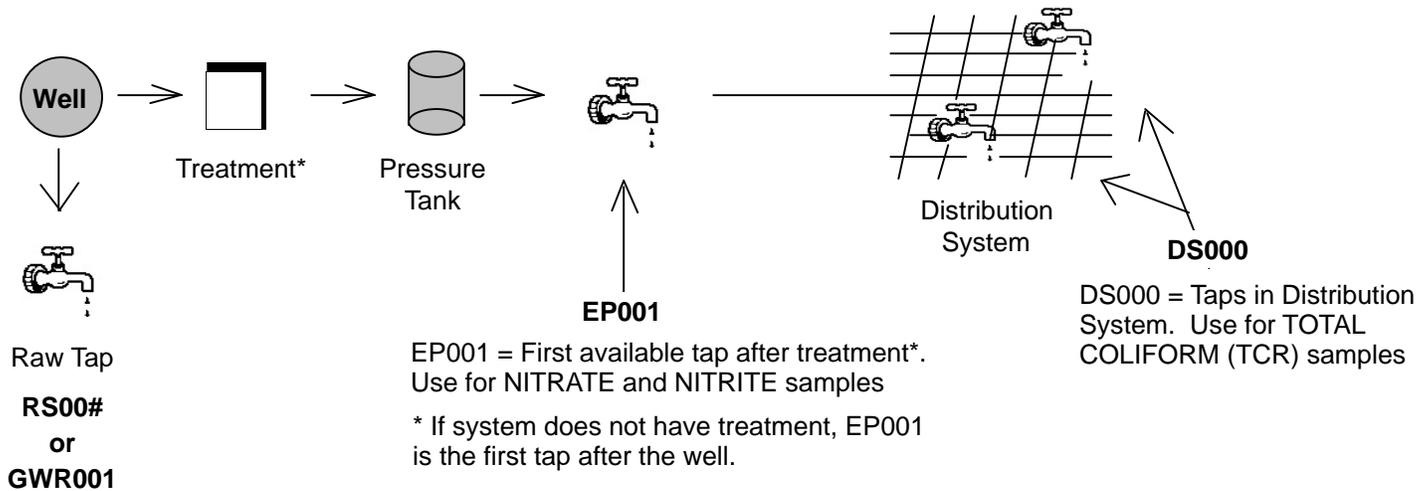

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

**OH1537512 ROGERS ELEMENTARY SCHOOL**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>1553456</b>	Facility Name: <b>BEAVER LOCAL ROGERS ELEM</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



Effective Date: 01/01/2015

2015 DISTRIBUTION SCHEDULE

**OH1537512 ROGERS ELEMENTARY SCHOOL**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **ROGERS ELEMENTARY SCHOOL DISTRIBUTI**  
**Location** SMP ID: **DS000**

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

**OH1538212 E FAIRFIELD UNITED METHODIST CHURCH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> E FAIRFIELD UN METH CH DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1553457	<b>Facility Name:</b> E FAIRFIELD UN METHODIST CHURCH
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

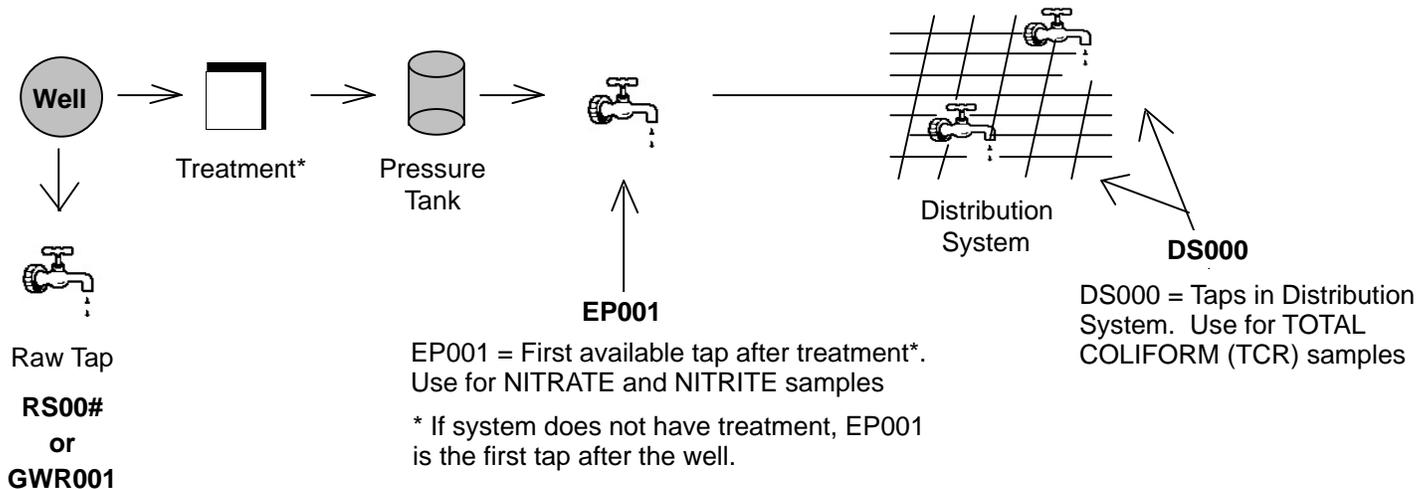

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1538712 Y-INN**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **Y-INN DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553458** Facility Name: **Y-INN**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

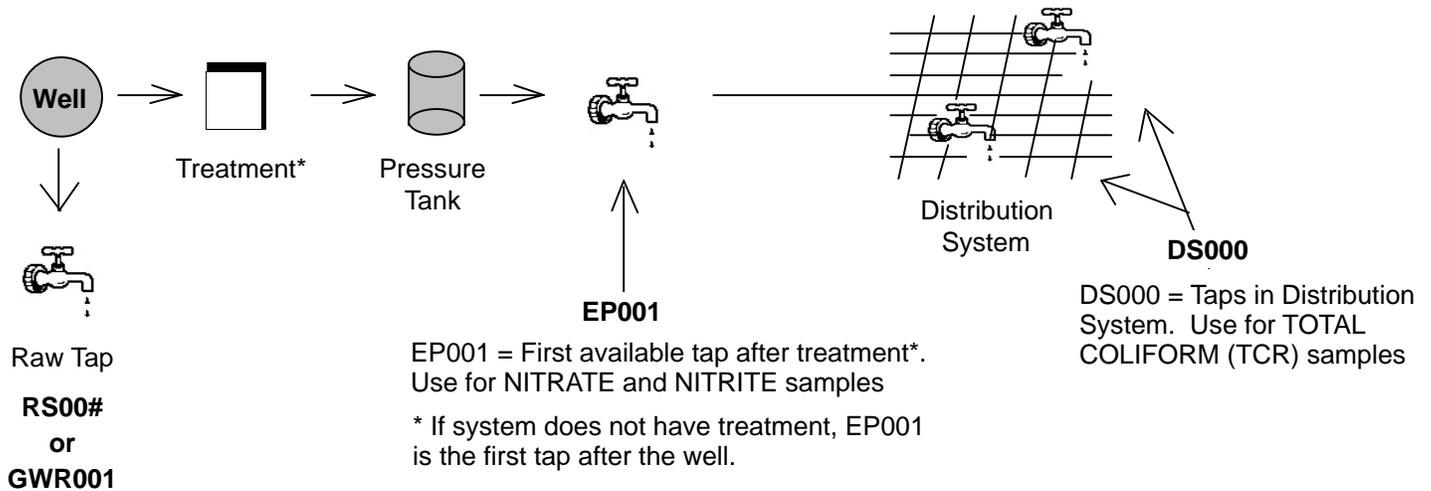

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1540712 EAST PALESTINE COUNTRY CLUB**

System Type: Transient Noncommunity

Operating Period: 3/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **EAST PALESTINE COUNTRY CLUB DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553464** Facility Name: **EAST PALESTINE COUNTRY CLUB**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 3/31/2015

**Where to Collect Samples For a Small Public Water System**

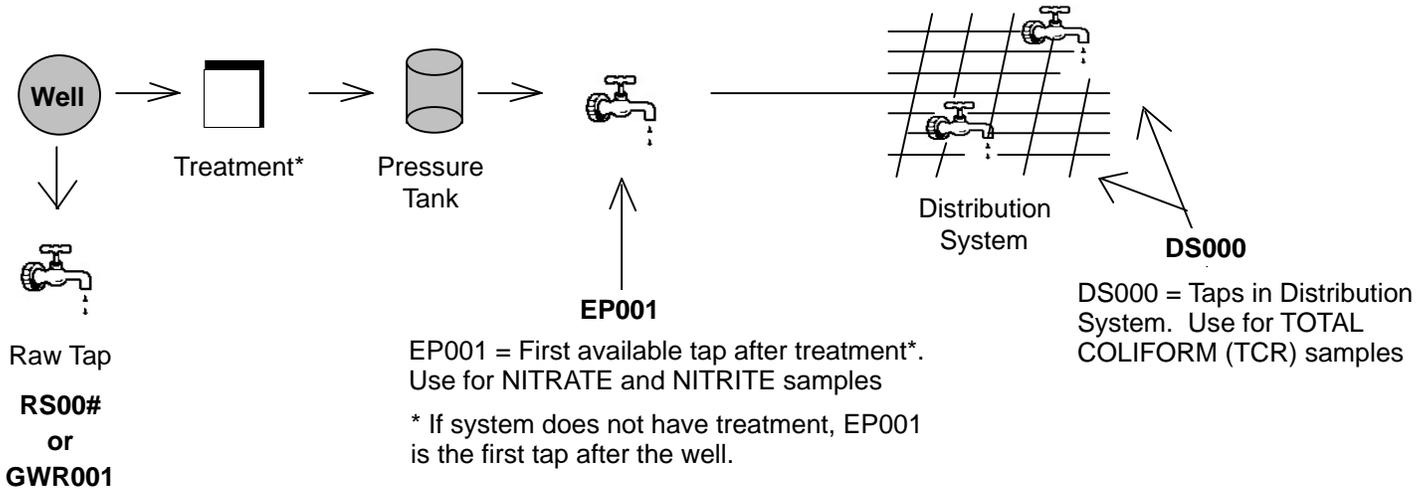

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1540812 EAST ROCHESTER UNITED METHODIST CHURCH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> E ROCHESTER METH. CHURCH DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1553465	<b>Facility Name:</b> E ROCHESTER METH CHURCH
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

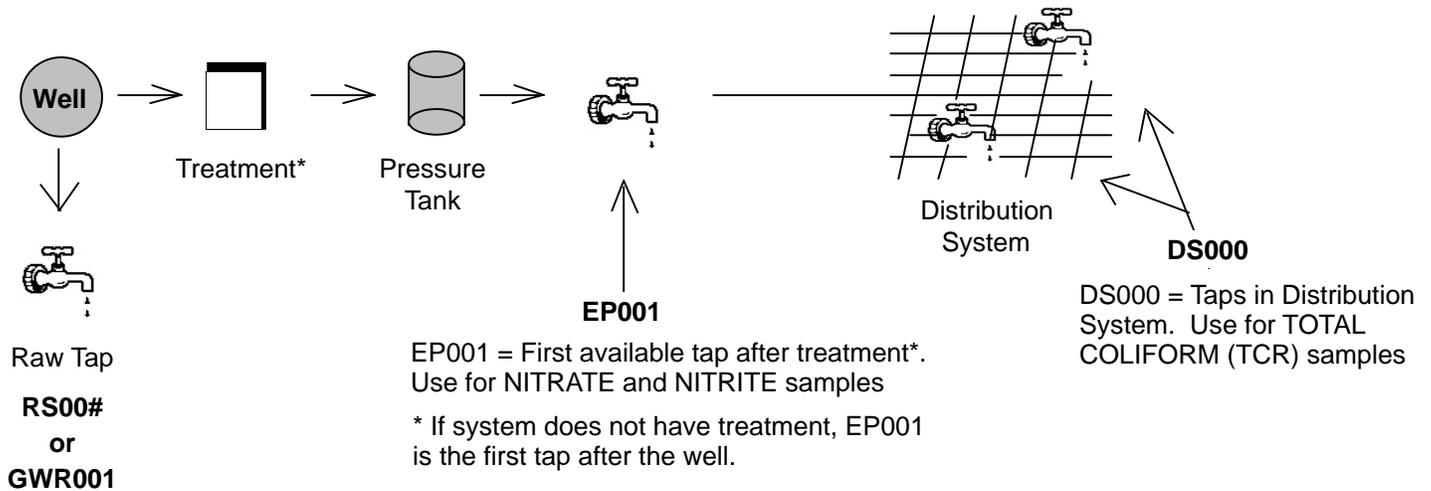

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1541312 FIRST BRETHREN CHURCH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **FIRST BRETHREN CHURCH DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553467** Facility Name: **FIRST BRETHREN CHURCH**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

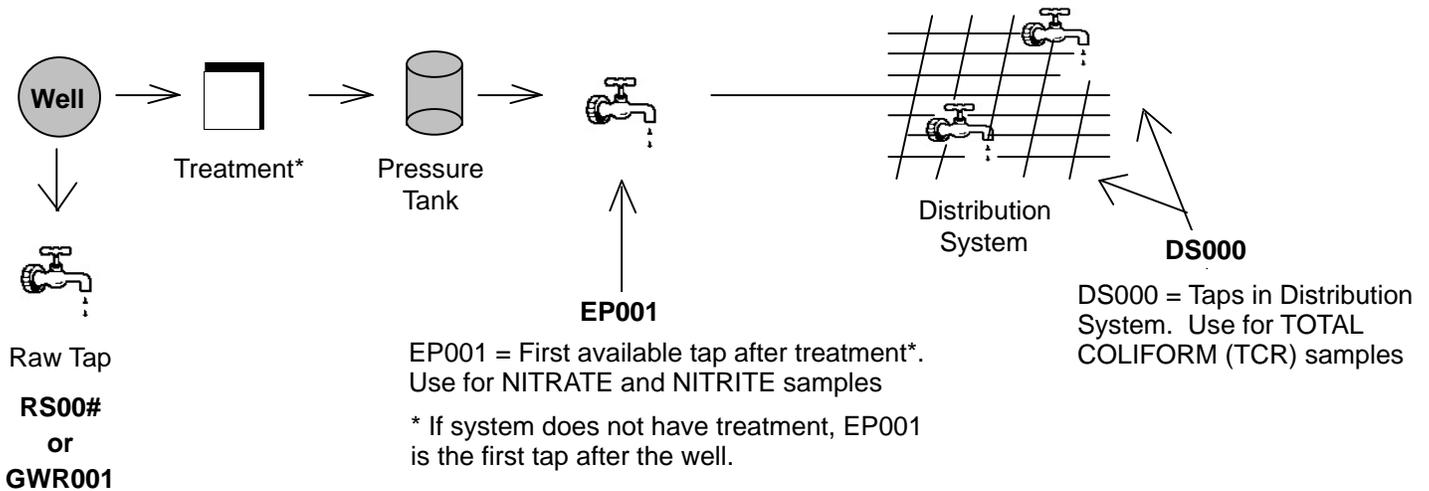

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1541412 FOREST LANES**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **FOREST LANES DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553468** Facility Name: **FOREST LANES**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

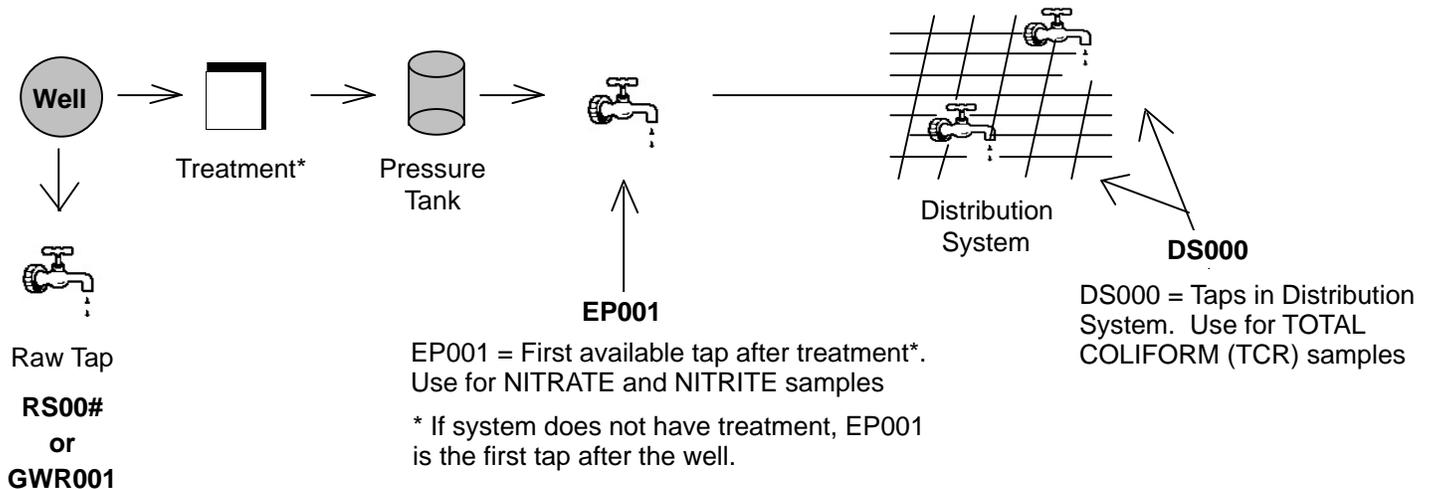

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1542312 THIRD GENERATION**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **THIRD GENERATION DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553469** Facility Name: **THIRD GENERATION**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 3/31/2015

**Where to Collect Samples For a Small Public Water System**

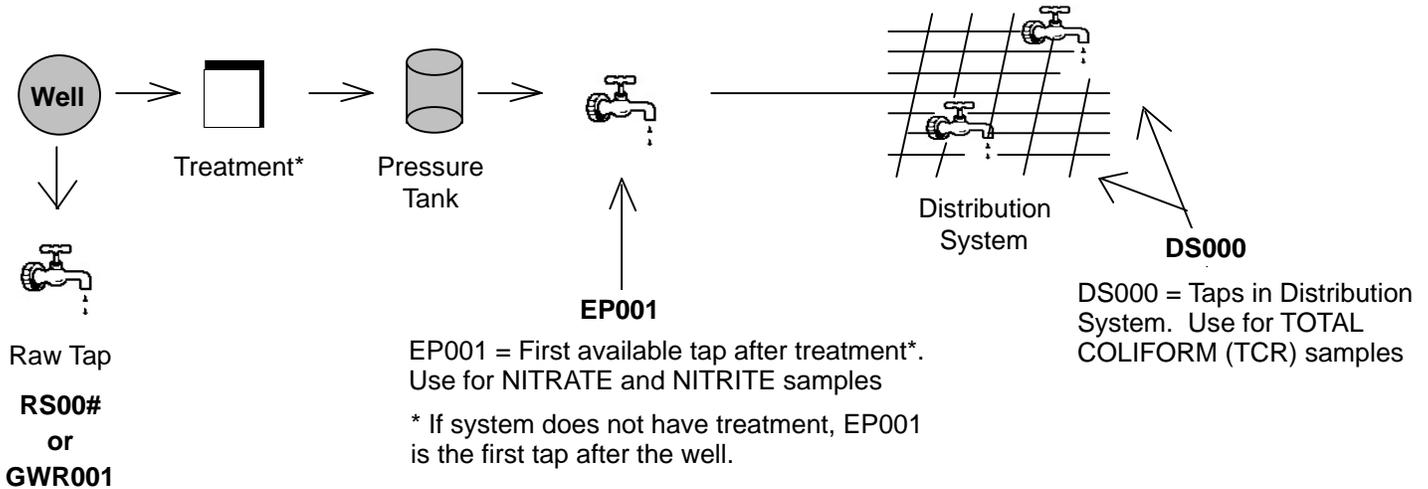

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1542812 LOCK 24 RESTAURANT**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **LOCK 24 RESTAURANT DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553470** Facility Name: **LOCK 24 RESTAURANT**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

**Where to Collect Samples For a Small Public Water System**

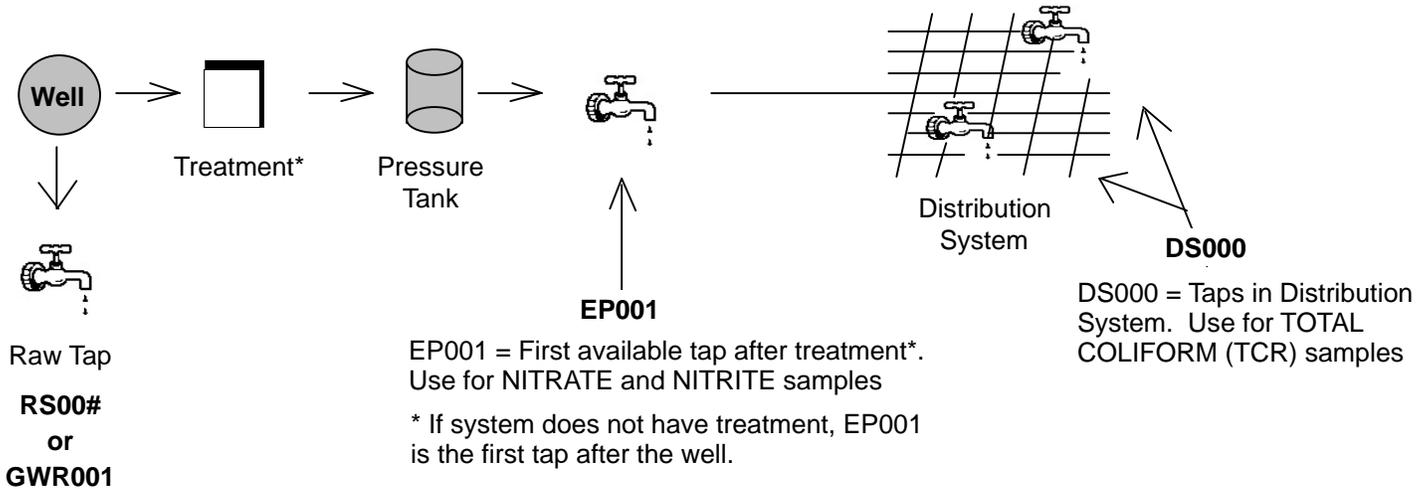

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1543612 OLD STAGECOACH INN**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> OLD STAGECOACH INN DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1553474	<b>Facility Name:</b> OLD STAGECOACH INN
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

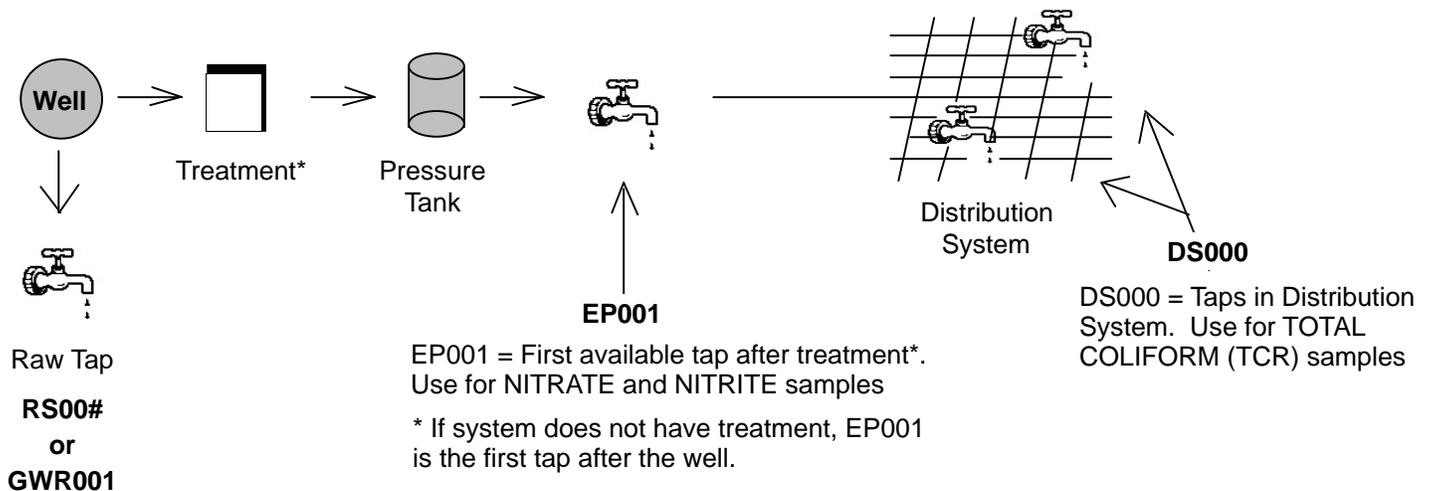

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1543812 LAKE PNA SPORTSMAN CLUB PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **LAKE PNA SPORTSMAN CLUB DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553475** Facility Name: **LAKE PNA SPORTSMAN CLUB**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

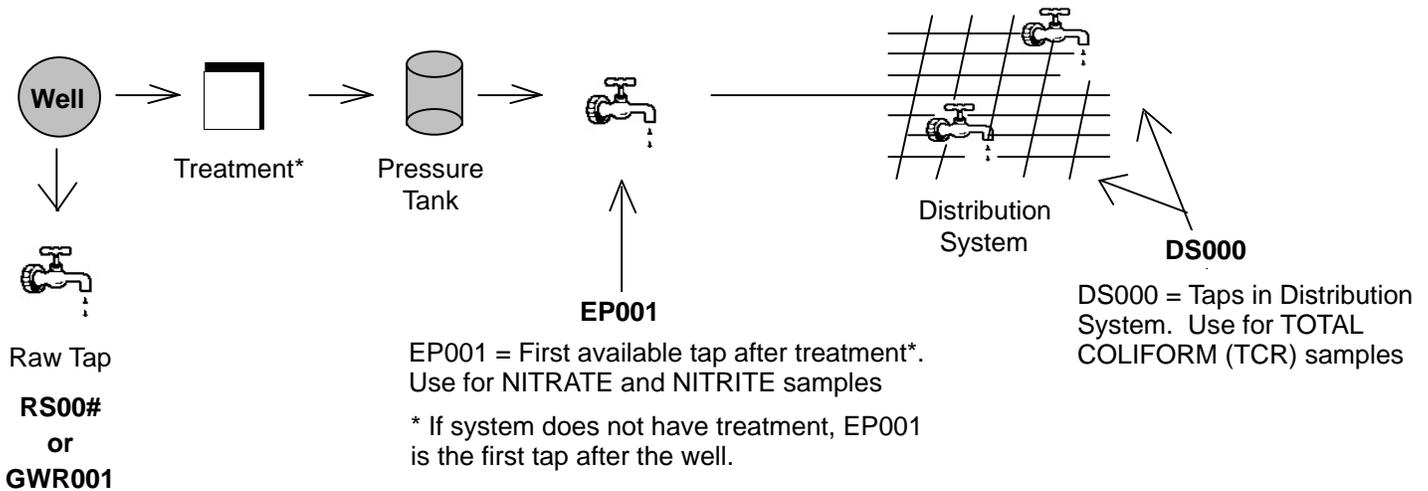

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1543912 PINKYS LOUNGE PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **PINKYS LOUNGE DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553476** Facility Name: **PINKYS LOUNGE**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

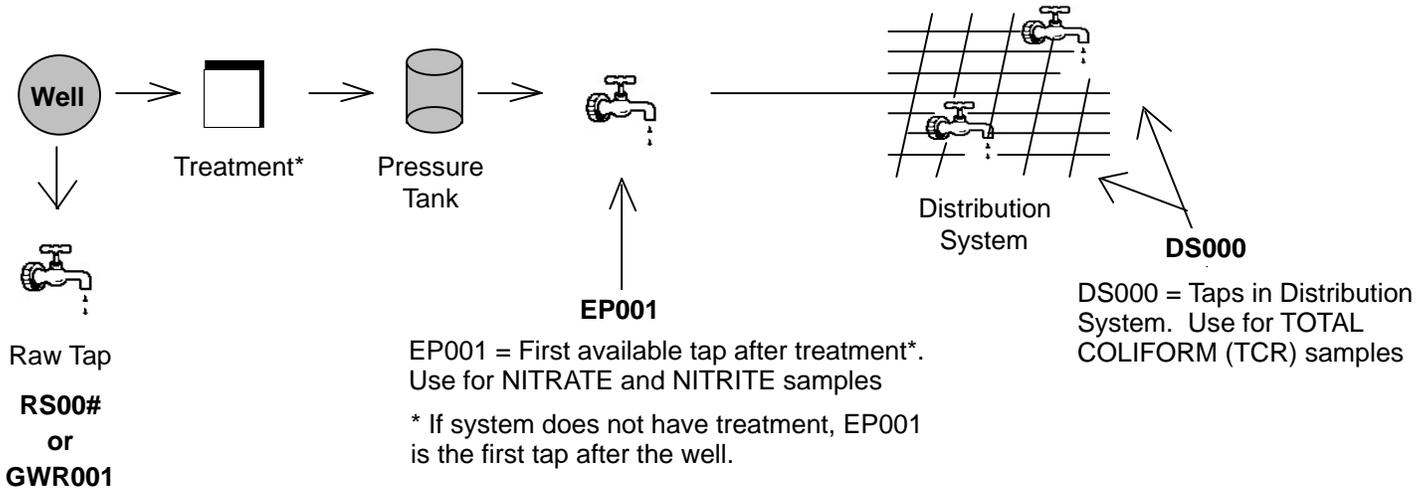

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1544212 ROGERS ASSEMBLY OF GOD**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> ROGERS ASSEMBLY OF GOD DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1553478	<b>Facility Name:</b> ROGERS ASSEMBLY OF GOD
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

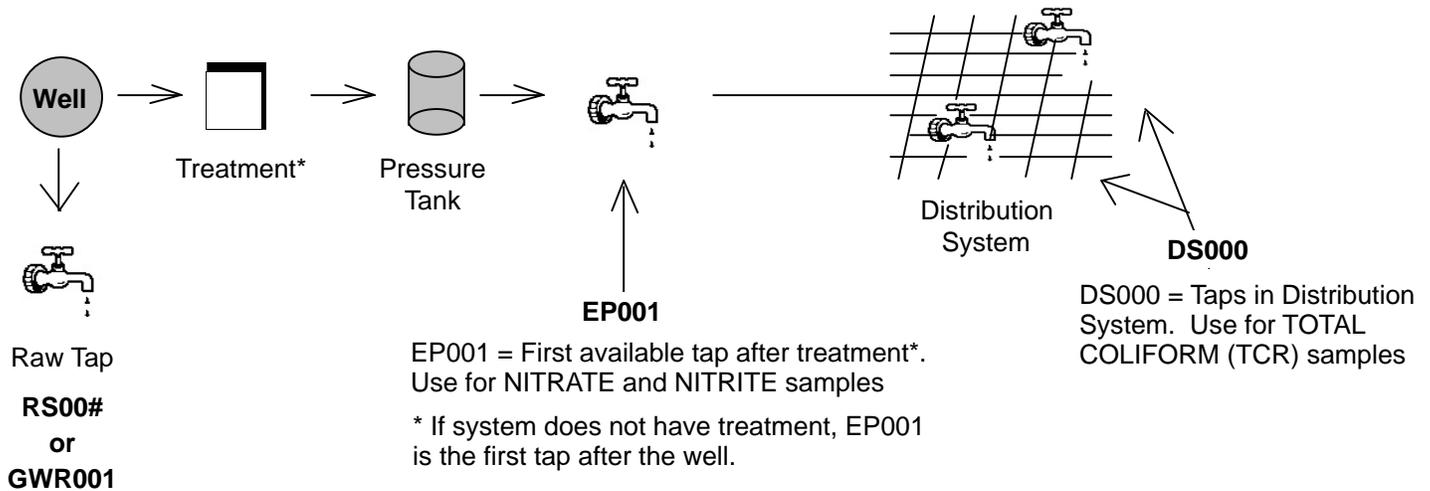

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1544312 ROGERS COMMUNITY AUCTION**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> ROGERS COMMUNITY AUCTION DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1553479	<b>Facility Name:</b> ROGERS COMMUNITY AUCTION	
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water	<b>Facility Class:</b> CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

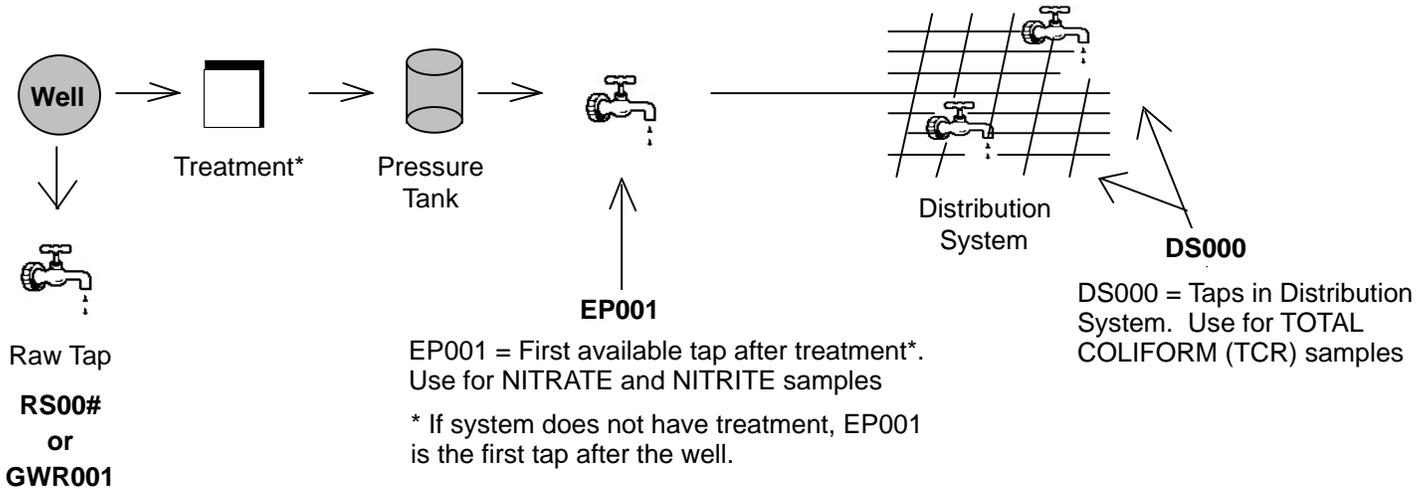

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1544412 THE PIT STOP LLC**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **THE PIT STOP LLC**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553480** Facility Name: **THE PIT STOP LLC**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

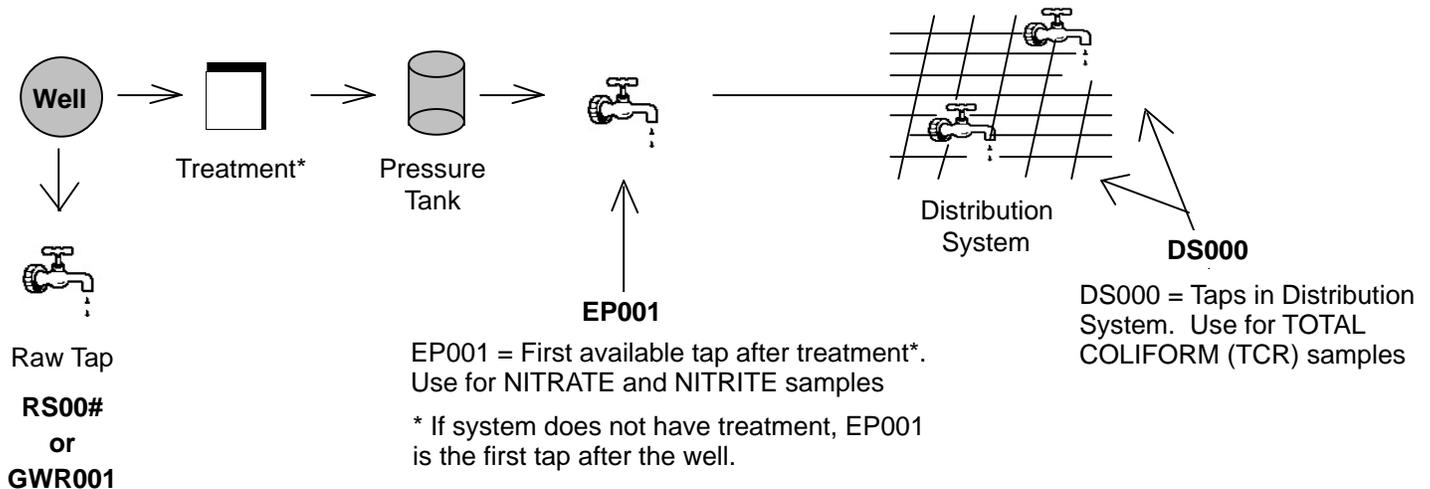

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1544512 TRINITY FRIENDS CHURCH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **TRINITY FRIENDS CHURCH DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553481** Facility Name: **TRINITY FRIENDS CHURCH**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

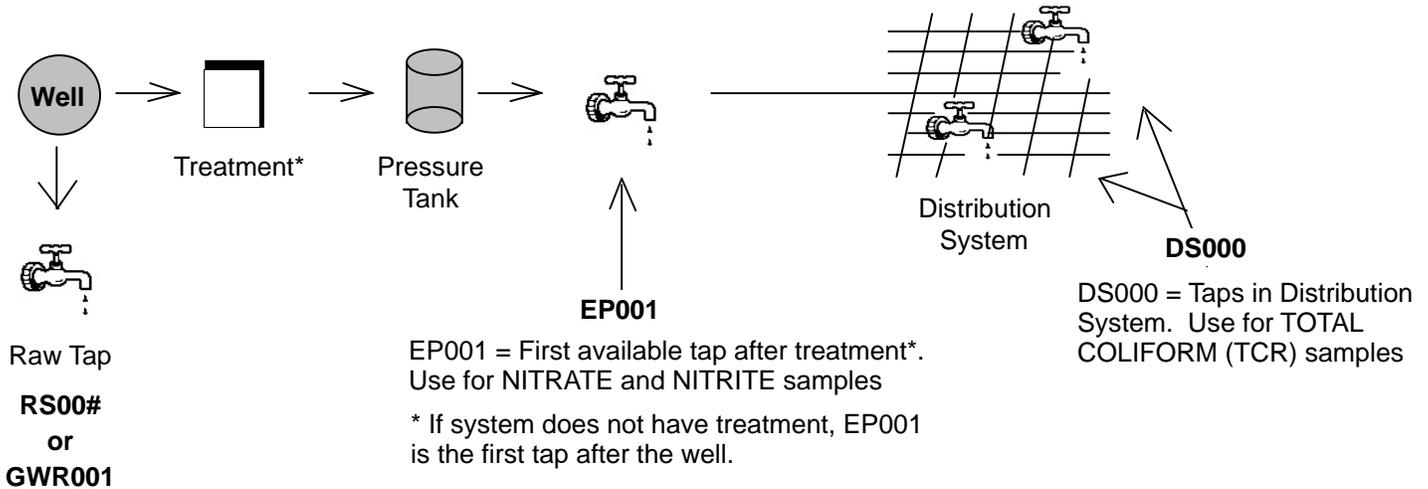

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

**OH1544612 UNITED LOCAL HIGH SCHOOL**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>1553482</b>	Facility Name: <b>UNITED HIGH SCHOOL</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required

**OH1544612 UNITED LOCAL HIGH SCHOOL**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>UNITED LOCAL HIGH SCHOOL DISTRIBUTION</b>
	SMP ID: <b>DS000</b>	

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>UNITED LOCAL HIGH SCHOOL DISTRIBUTION</b>
	SMP ID: <b>DS201</b>	<b>ADDRESS NOT KNOWN</b>

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>UNITED LOCAL HIGH SCHOOL DISTRIBUTION</b>
	SMP ID: <b>DS202</b>	<b>ADDRESS NOT KNOWN</b>

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

**OH1544712 UNITED LOCAL ELEMENTARY**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>1553483</b>	Facility Name: <b>UNITED LOCAL ELEMENTARY</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH1544712 UNITED LOCAL ELEMENTARY

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: UNITED LOCAL ELEMENTARY DISTRIBUTION
Location SMP ID: DS000

Table with 2 columns: Chemicals and Monitoring Requirements. Rows include LEAD - 1030 AND COPPER - 1022 (Not Required), TOTAL COLIFORM (TCR) - 3100 (4 sampling events), and TOTAL CHLORINE - 1000 (4 sampling events).

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Facility ID: DS1 Facility Name: UNITED LOCAL ELEMENTARY DISTRIBUTION
Location SMP ID: DS201 ADDRESS NOT KNOWN

Table with 2 columns: Chemicals and Monitoring Requirements. Row: DISINFECTION BYPRODUCTS (1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201)

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950

Sampling Facility ID: DS1 Facility Name: UNITED LOCAL ELEMENTARY DISTRIBUTION
Location SMP ID: DS202 ADDRESS NOT KNOWN

Table with 2 columns: Chemicals and Monitoring Requirements. Row: DISINFECTION BYPRODUCTS (1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS202)

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950

**OH1545312 AVALON FAMILY RESTAURANT**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **AVALON FAMILY RESTAURANT DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553485** Facility Name: **AVALON FAMILY RESTAURANT**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

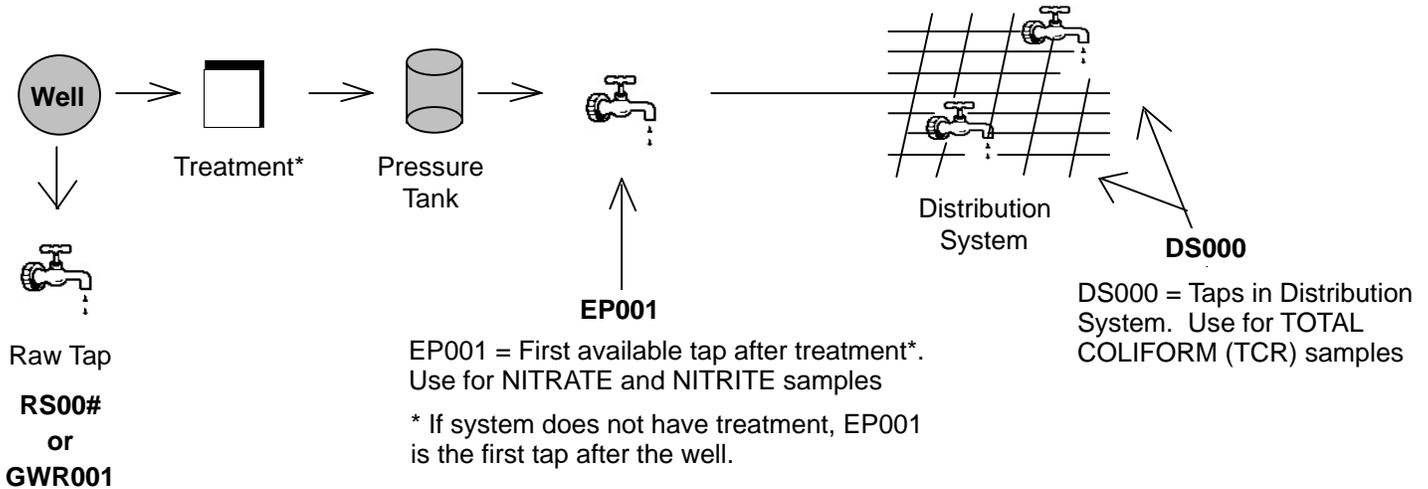

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

**OH1545412 EAST OHIO MACHINERY**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>1553486</b>	Facility Name: <b>EAST OHIO MACHINERY</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



Effective Date: 01/01/2015

2015 DISTRIBUTION SCHEDULE

**OH1545412 EAST OHIO MACHINERY**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>EAST OHIO MACHINERY DISTRIBUTION</b>
	SMP ID: <b>DS000</b>	

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2015 and 9/30/2015
<i>Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <a href="http://epa.ohio.gov/ddagw/reporting.aspx">http://epa.ohio.gov/ddagw/reporting.aspx</a></i>	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

**OH1546112 DAMASCUS UNITED METHODIST CHURCH**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>1553488</b>	Facility Name: <b>DAMASCUS UN METHODIST CHURCH</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>
		Facility Class: <b>CLASS A</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH1546112 DAMASCUS UNITED METHODIST CHURCH

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: DAMASCUS UN METH CHURCH DISTRIBUTIO
Location SMP ID: DS000

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2015 and 9/30/2015

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: http://epa.ohio.gov/ddagw/reporting.aspx

TOTAL COLIFORM (TCR) - 3100 1 Sample(s) Required between 1/1/2015 and 3/31/2015
1 Sample(s) Required between 4/1/2015 and 6/30/2015
1 Sample(s) Required between 7/1/2015 and 9/30/2015
1 Sample(s) Required between 10/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000 1 Sample(s) Required between 1/1/2015 and 3/31/2015
1 Sample(s) Required between 4/1/2015 and 6/30/2015
1 Sample(s) Required between 7/1/2015 and 9/30/2015
1 Sample(s) Required between 10/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Facility ID: DS1 Facility Name: DAMASCUS UN METH CHURCH DISTRIBUTIO
Location SMP ID: DS201 ADDRESS NOT KNOWN

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950

**OH1546412 HANOVERTON CHURCH OF CHRIST**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **HANOVERTON CH OF CHRIST DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553489** Facility Name: **HANOVERTON CHURCH OF CHRIST**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 4/1/2015 and 6/30/2015

**Where to Collect Samples For a Small Public Water System**

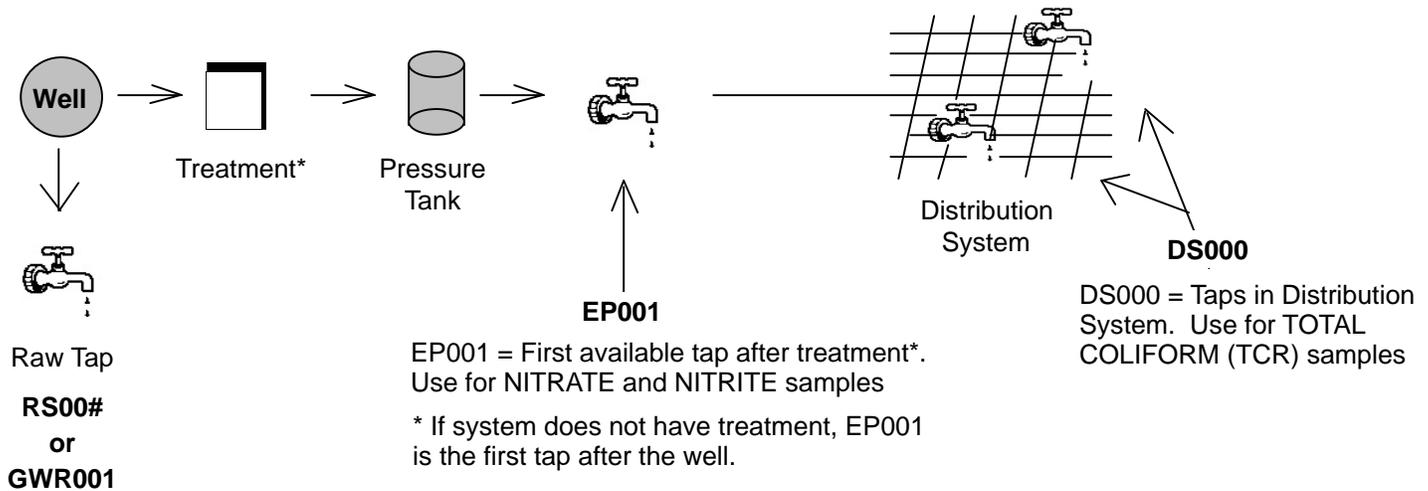

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1546612 HANOVERTON CHRISTIAN CHURCH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **HANOVERTON CHRISTIAN CH DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553490** Facility Name: **HANOVERTON CHRISTIAN CHURCH**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

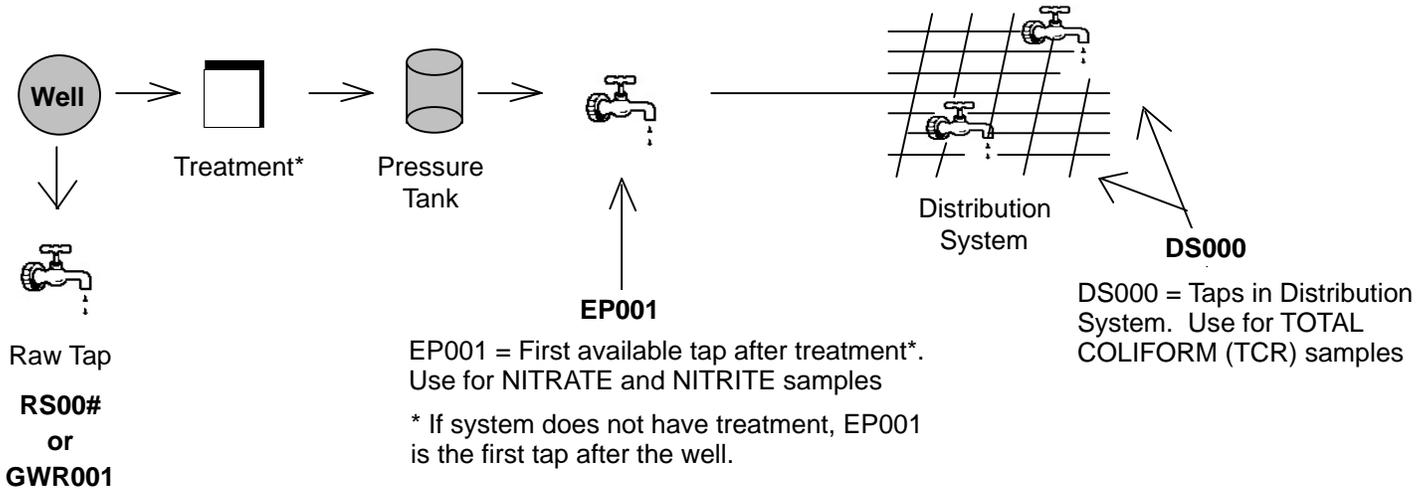

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1547612 GUILFORD LAKE GRILLE PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> GUILFORD LAKE GRILLE DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1553494	<b>Facility Name:</b> GUILFORD LAKE GRILLE
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

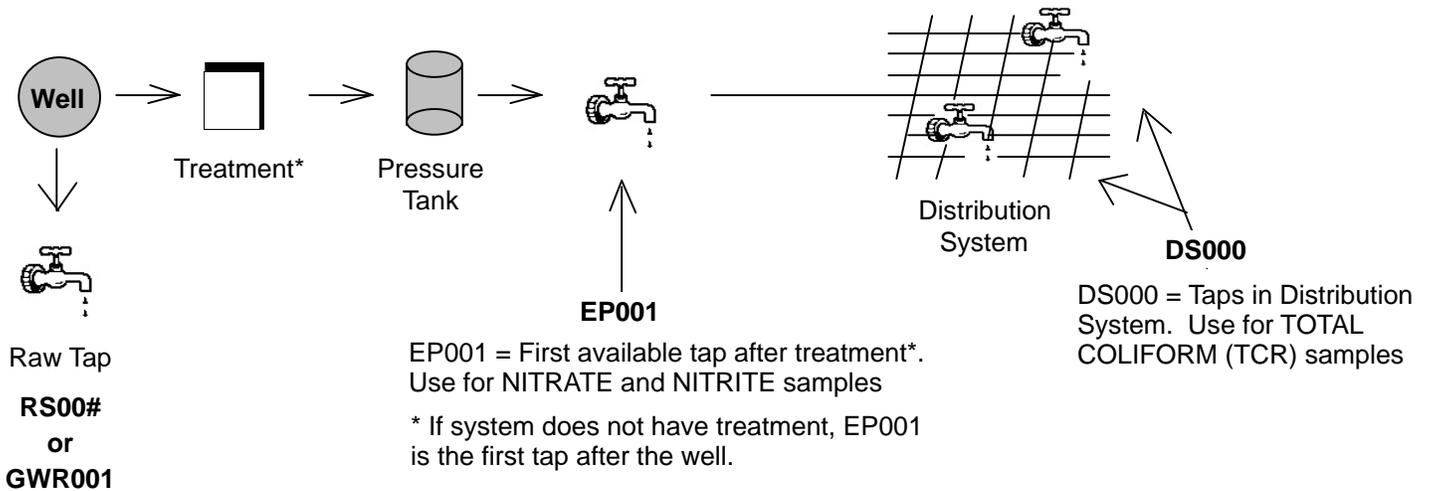

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1547812 ODNR-BEAVER CREEK/HORSE 1 PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **ODNR-BEAVER CR/HORSE 1 DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553495** Facility Name: **ODNR BEAVER CR PK-HORSEMANS 1**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

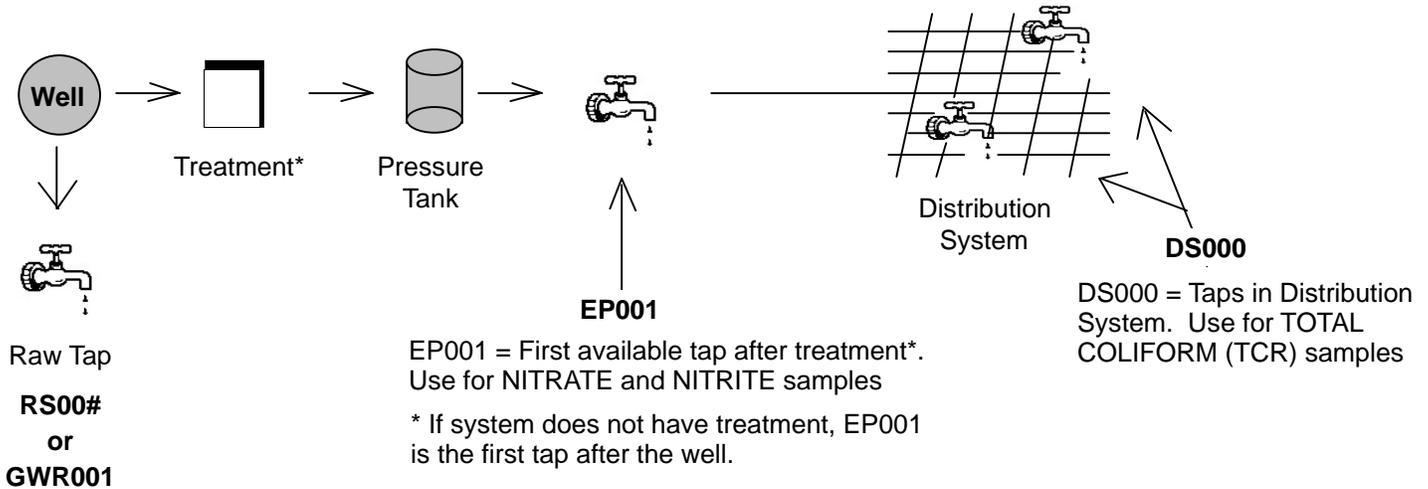

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1548012 ODNR-BEAVER CREEK/FAMILY CAMPGROUND**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **ODNR-BEAVER CR/CAMPGRD DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553497** Facility Name: **ODNR BEAVER CREEK/CAMPGROUND**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

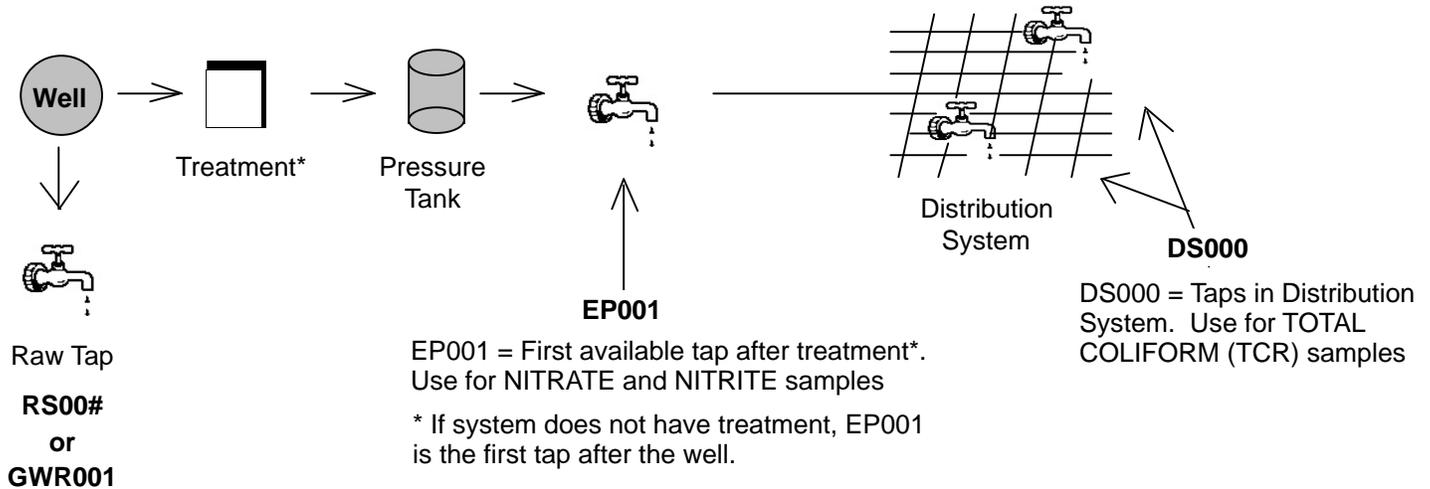

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1548812 PHILLIPS CHRISTIAN CHURCH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **PHILLIPS CHRISTIAN CHURC DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553501** Facility Name: **PHILLIPS CHRISTIAN CHURCH**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

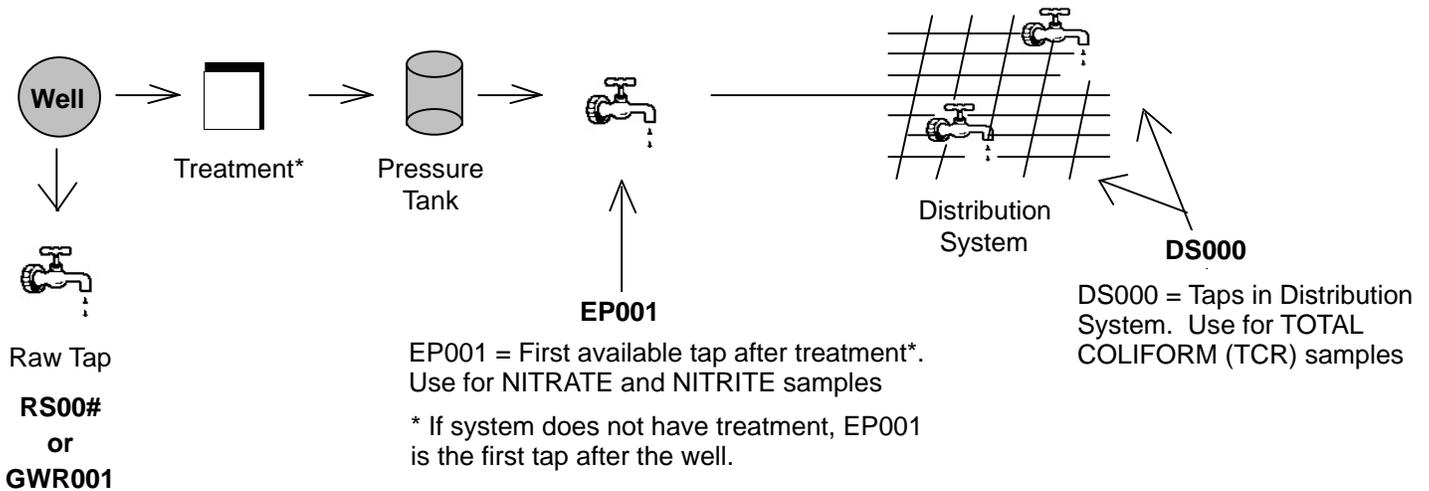

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

**OH1549412 SOUTHERN LOCAL SCHOOL CAMPUS K-12TH**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>1553505</b>	Facility Name: <b>SOUTHERN LOCAL SCHOOL CAMPUS</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>
		Facility Class: <b>CLASS 1</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required

**OH1549412 SOUTHERN LOCAL SCHOOL CAMPUS K-12TH**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>SOUTHERN L. SCHOOL CAMPUS DISTRIBUTI</b>
	SMP ID: <b>DS000</b>	

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>SOUTHERN L. SCHOOL CAMPUS DISTRIBUTI</b>
	SMP ID: <b>DS201</b>	<b>ADDRESS NOT KNOWN</b>

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>SOUTHERN L. SCHOOL CAMPUS DISTRIBUTI</b>
	SMP ID: <b>DS202</b>	<b>ADDRESS NOT KNOWN</b>

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

**OH1549812 WINONA FRIENDS CHURCH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> WINONA FRIENDS CHURCH DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1553507	<b>Facility Name:</b> WINONA FRIENDS CHURCH
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

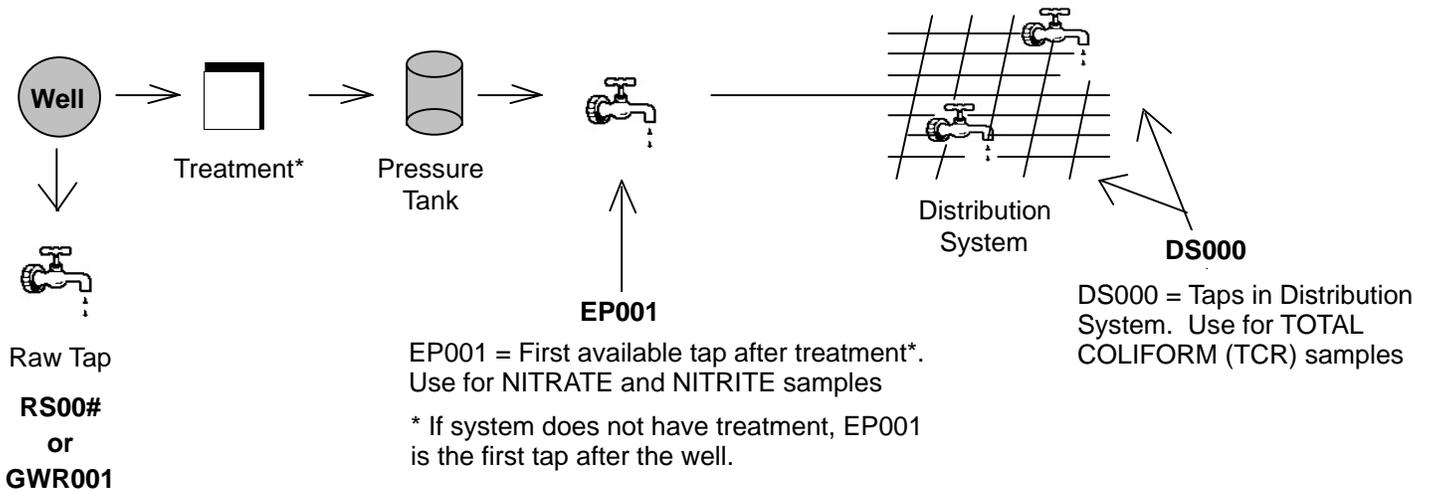

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1550612 ODNR-GUILDFORD LAKE STATE PARK-BEACH**

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **ODNR-GUILDFORD/BEACH DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553509** Facility Name: **ODNR-GUILDFORD/BEACH**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

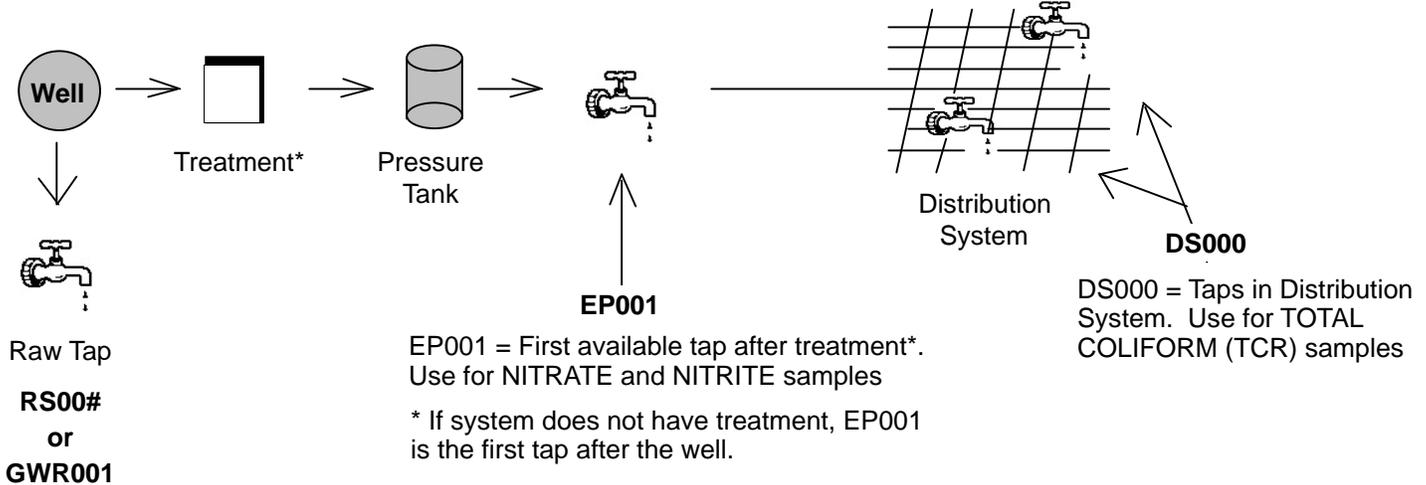

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**  
<http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

**Save a dime. Sample on time!**

**OH1550712 ODNR-GUILFORD LAKE STATE PARK - CAMPGROU**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **ODNR-GUILDFORD/CAMPGRD DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553510** Facility Name: **ODNR-GUILDFORD/CAMPGROUND**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

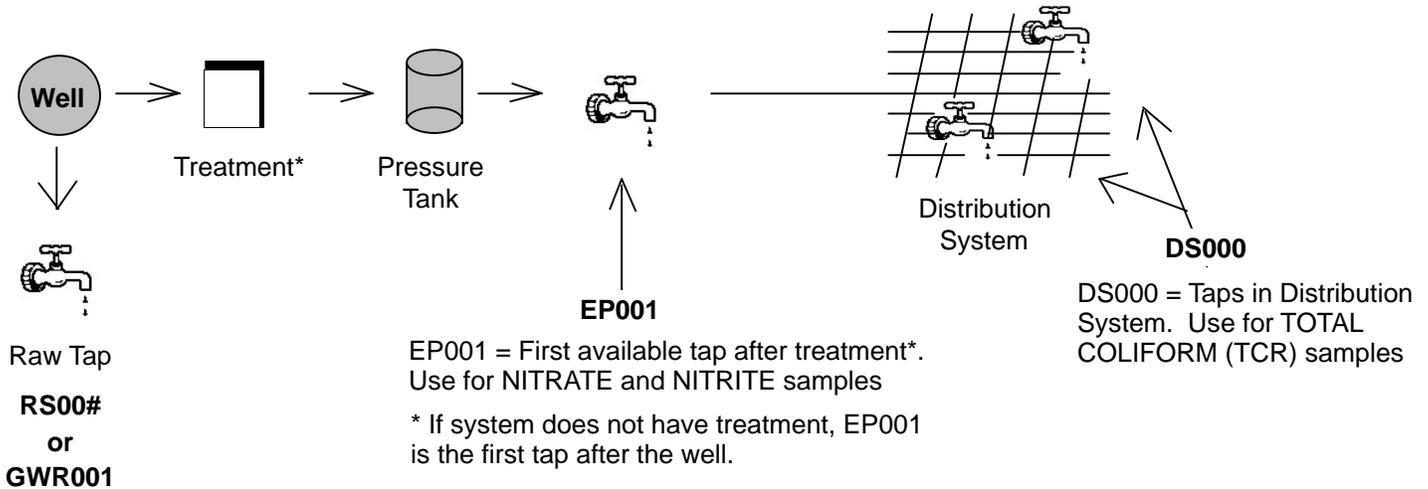

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1551212 CAMP MCKINLEY BSA DINING PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> CAMP MCKINLEY,BSA-DINING DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1553511	<b>Facility Name:</b> CAMP MCKINLEY, BSA-DINING
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

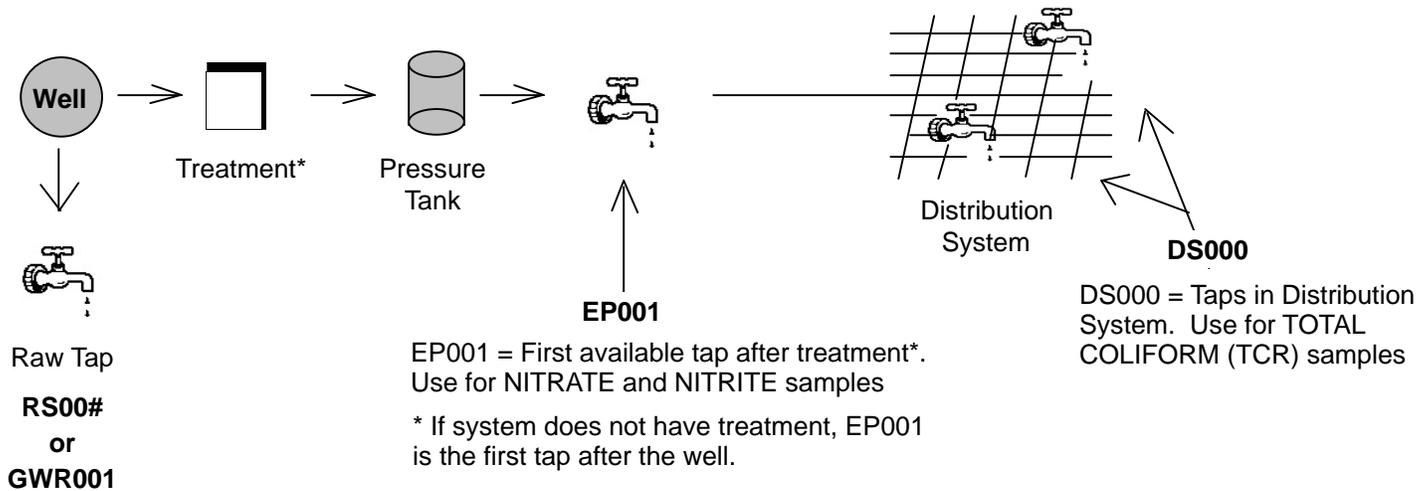

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1551312 CAMP MCKINLEY BSA-POOL PWS**

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> CAMP MCKINLEY,BSA-POOL DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1553512	<b>Facility Name:</b> CAMP MCKINLEY, BSA-POOL
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

**Where to Collect Samples For a Small Public Water System**

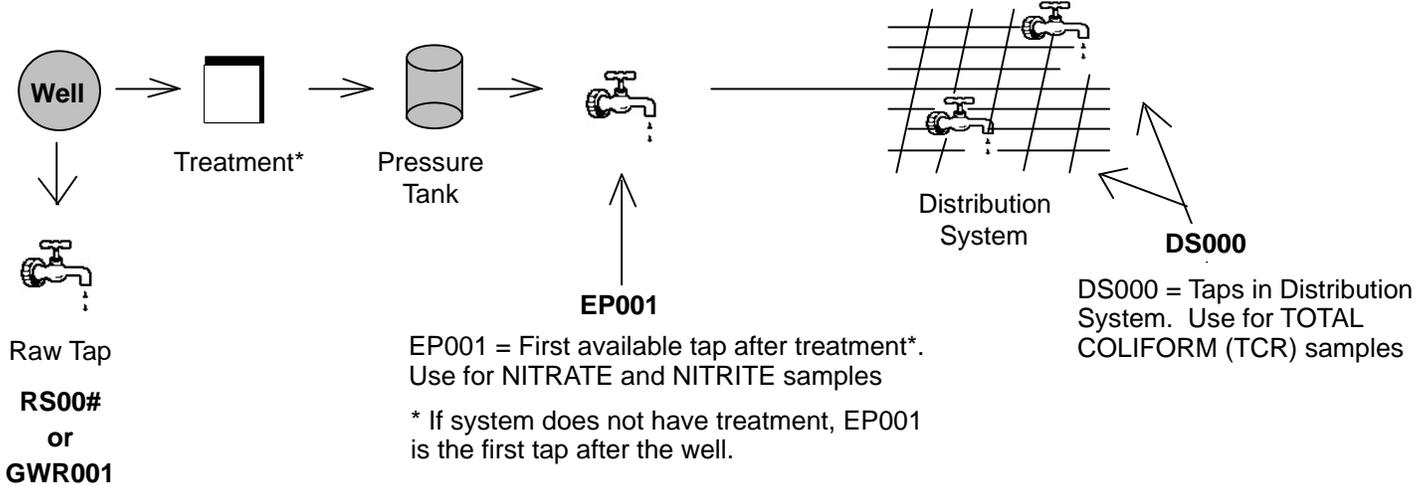

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**  
**<http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>**

**Save a dime. Sample on time!**

**OH1552012 CLEWELLS LANDING PWS**

System Type: Transient Noncommunity

Operating Period: 4/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **CLEWELLS LANDING DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553515** Facility Name: **CLEWELLS LANDING**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

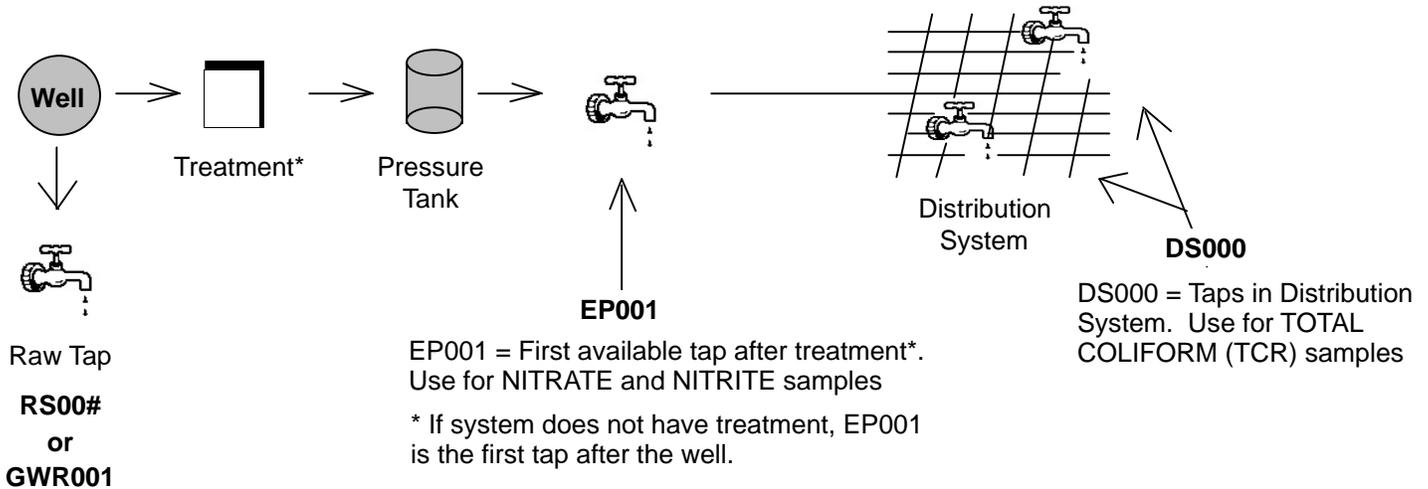

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1552112 COPELAND HILLS GOLF**

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> COPELAND HILLS GOLF DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1553516	<b>Facility Name:</b> COPELAND HILLS GOLF
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

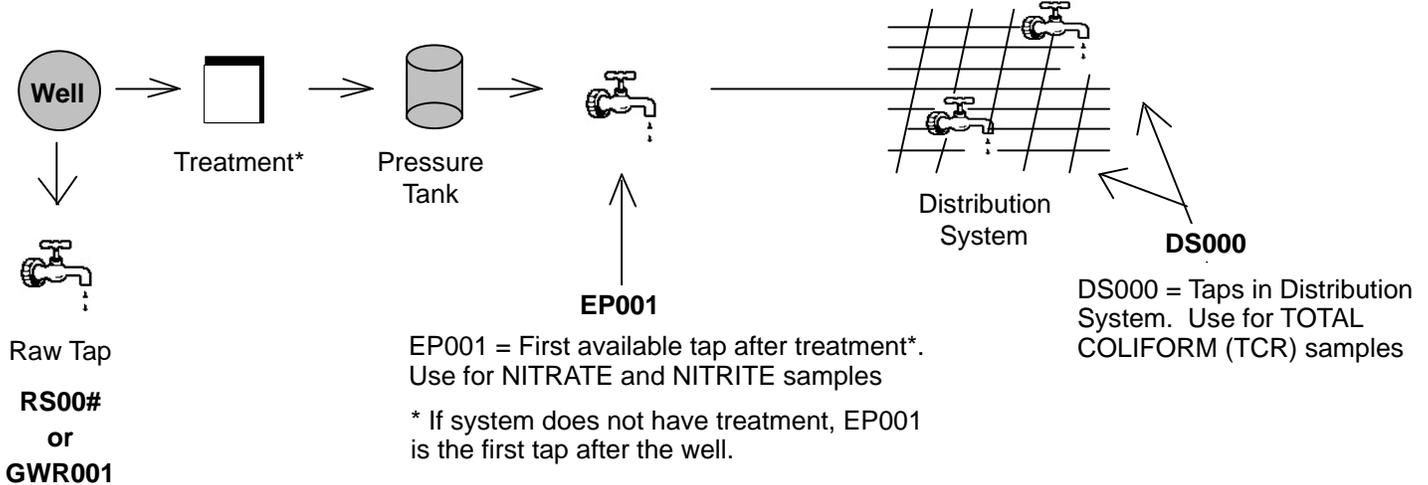

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**  
<http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

**Save a dime. Sample on time!**

**OH1552912 TIMASHAMIE FAMILY CAMPGROUND**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **TIMASHAMIE FAMILY CAMPGR DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553517** Facility Name: **TIMASHAMIE FAMILY CAMPGROUND**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water** Facility Class: **CLASS A**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

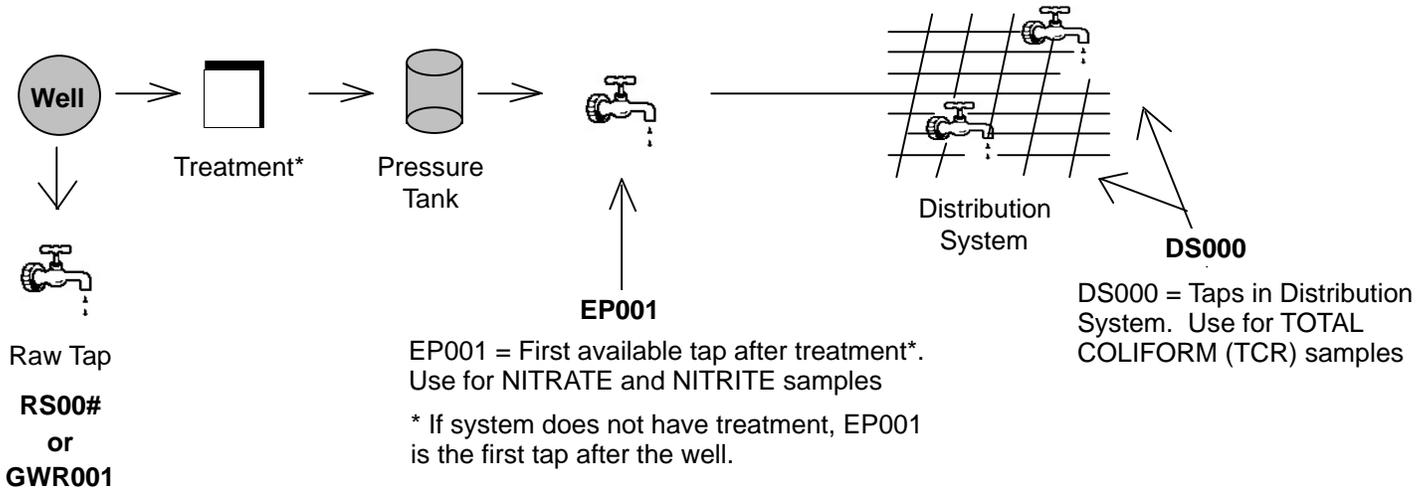

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1553512 HIST. SANDY AND BEAVER CAMP**

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **HIST. SANDY & BEAVER CAMP DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553519** Facility Name: **HISTORICAL SANDY AND BEAVER**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

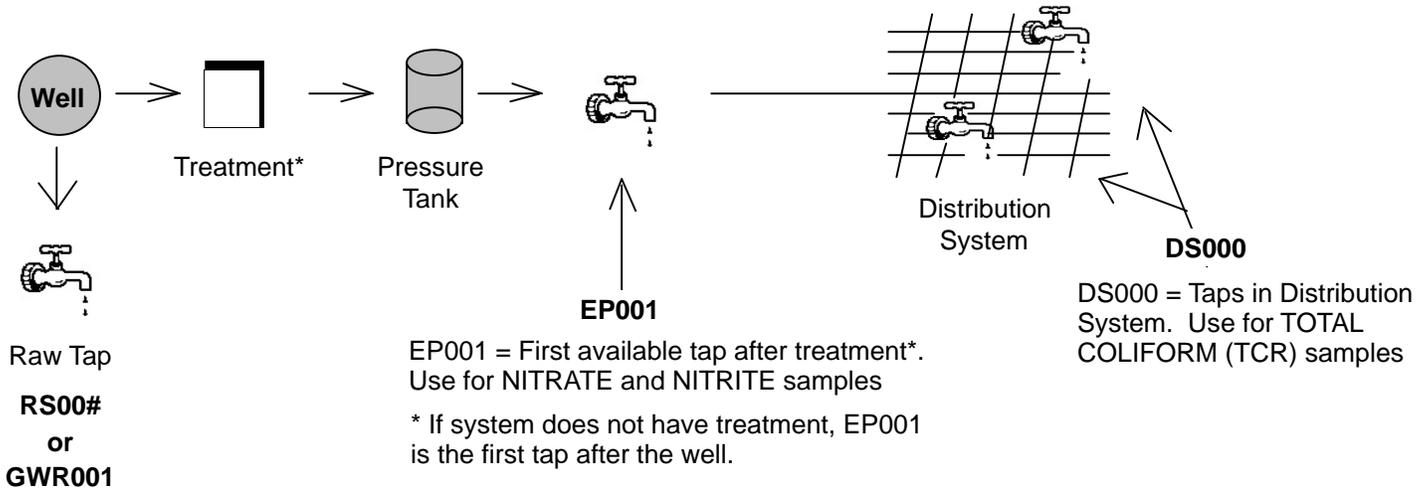

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1553712 RAINBOW LAKES**

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **RAINBOW LAKES DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553520** Facility Name: **RAINBOW LAKES**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

**Where to Collect Samples For a Small Public Water System**

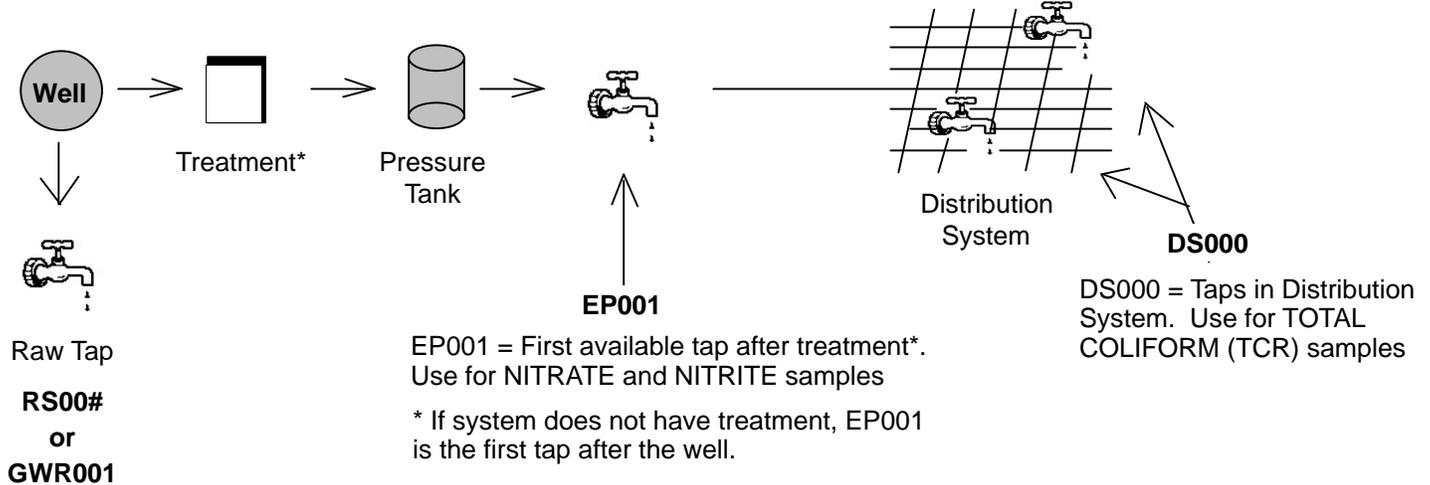

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**  
<http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

**Save a dime. Sample on time!**

**OH1554412 VALLEY DRIVE-IN**

System Type: Transient Noncommunity

Operating Period: 3/1 to 11/30

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **VALLEY DRIVE-IN DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553521** Facility Name: **VALLEY DRIVE-IN**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

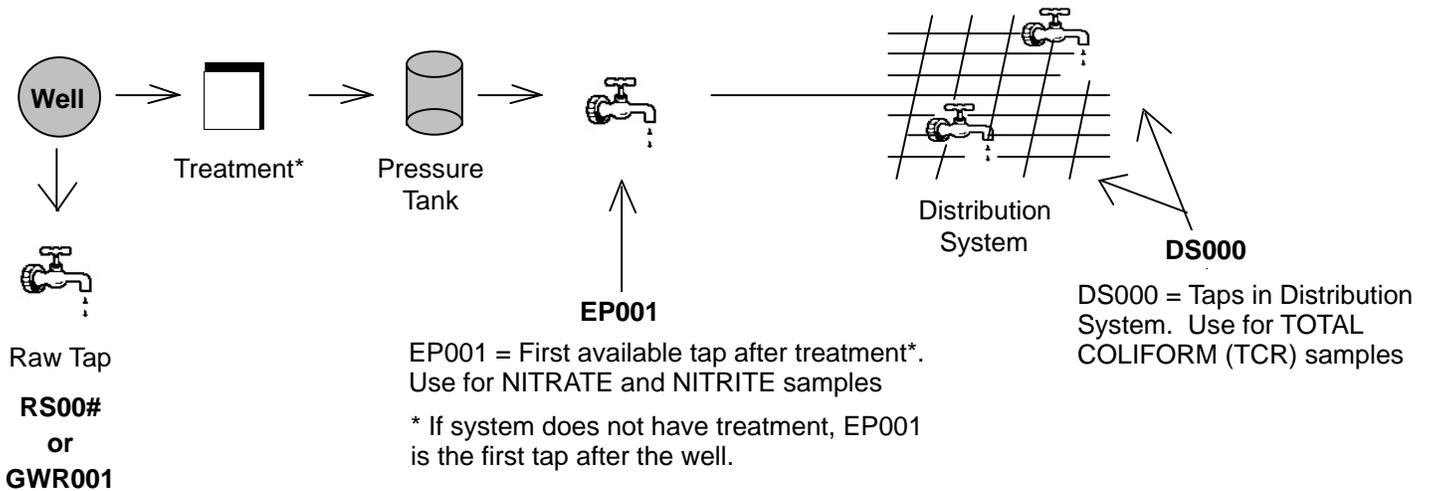

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1554512 WILDWOOD ACRES FAMILY CAMPGROUND**

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **WILDWOOD ACRES FAMILY CAMPGROUND DIST**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553522** Facility Name: **WILDWOOD ACRES FAMILY CAMPGROUND**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

**Where to Collect Samples For a Small Public Water System**

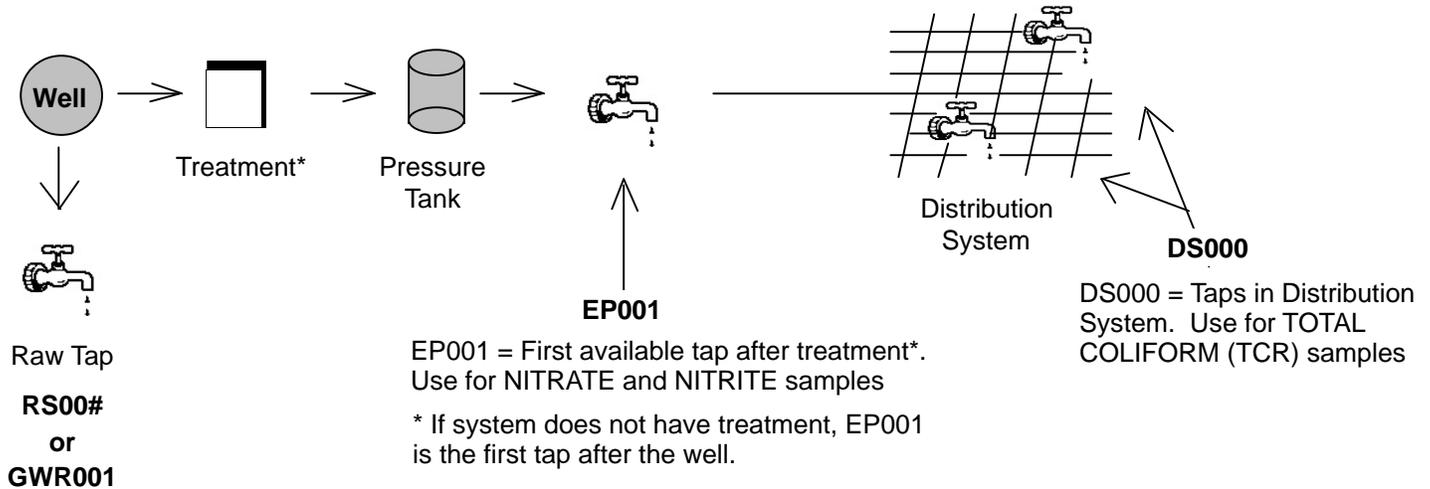

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1554812 DAMASCUS FRIENDS CHURCH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> DAMASCUS FRIENDS CHURCH DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1553523	<b>Facility Name:</b> DAMASCUS FRIENDS CHURCH	
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water	<b>Facility Class:</b> CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

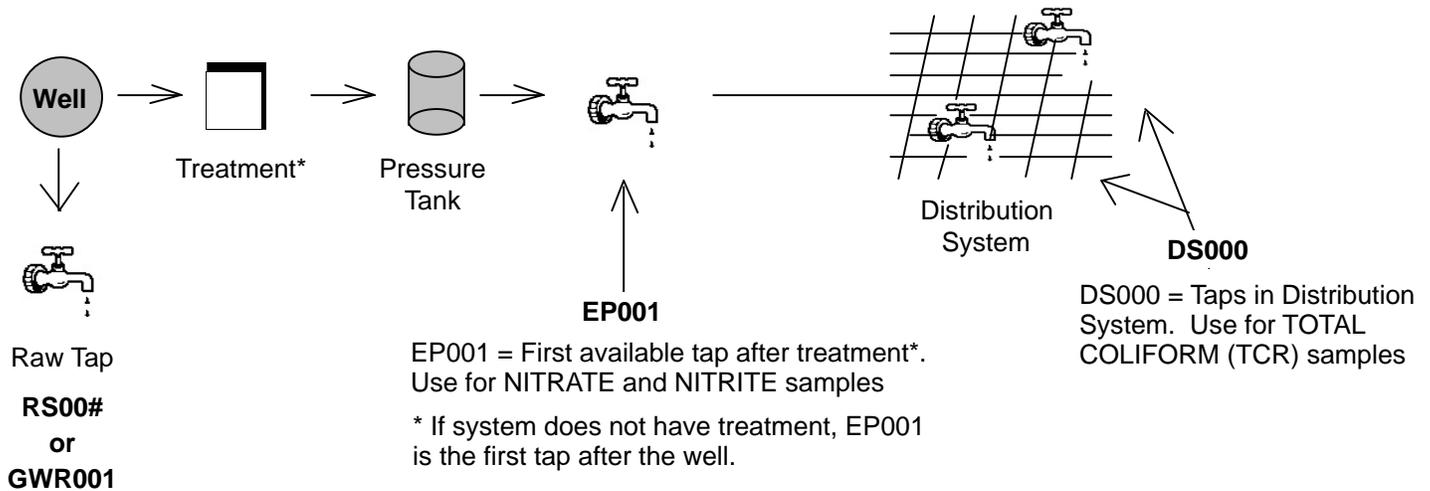

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

**OH1555012 ALLEGHENY WESLEYAN COLLEGE**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>1553524</b>	Facility Name: <b>ALLEGHENY WESLEYAN COLLEGE</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



Effective Date: 01/01/2015

2015 DISTRIBUTION SCHEDULE

**OH1555012 ALLEGHENY WESLEYAN COLLEGE**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **ALLEGHENY WESLEYAN COLLE DISTRIBUTI**  
**Location** SMP ID: **DS000**

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

*Samples should be collected at the same time and place as the Total Coliform samples.*

**OH1555312 MINERVA CHRISTIAN SCHOOL**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> MINERVA CHRISTIAN SCHOOL DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1553526	<b>Facility Name:</b> MINERVA CHRISTIAN SCHOOL
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

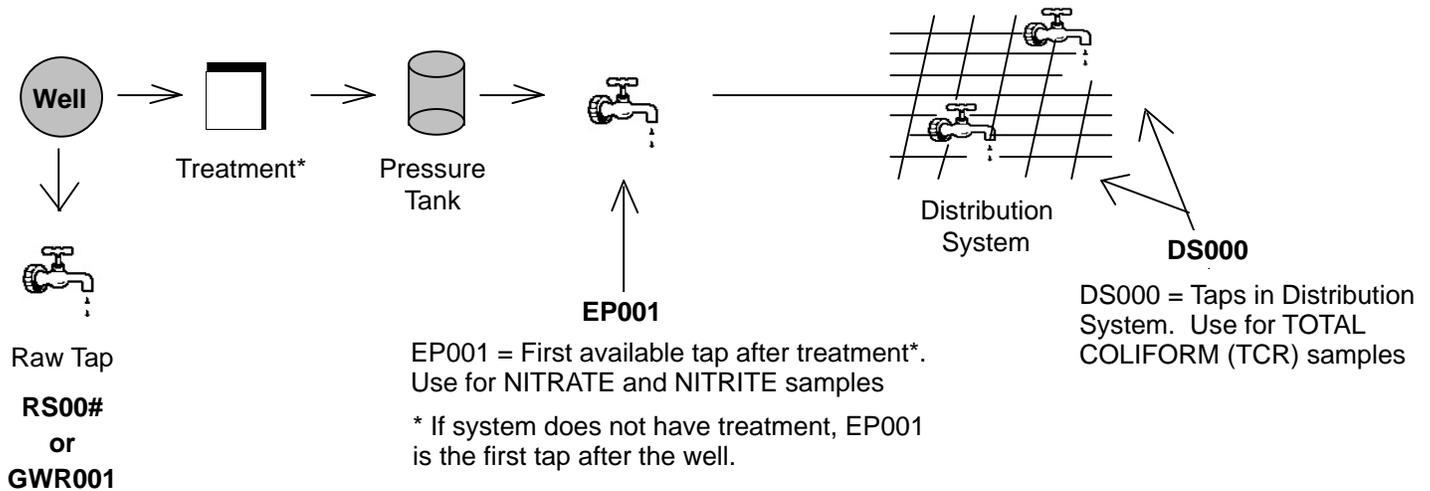

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1555912 SPREAD EAGLE TAVERN**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> SPREAD EAGLE TAVERN DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1553530	<b>Facility Name:</b> SPREAD EAGLE TAVERN
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 3/31/2015

**Where to Collect Samples For a Small Public Water System**

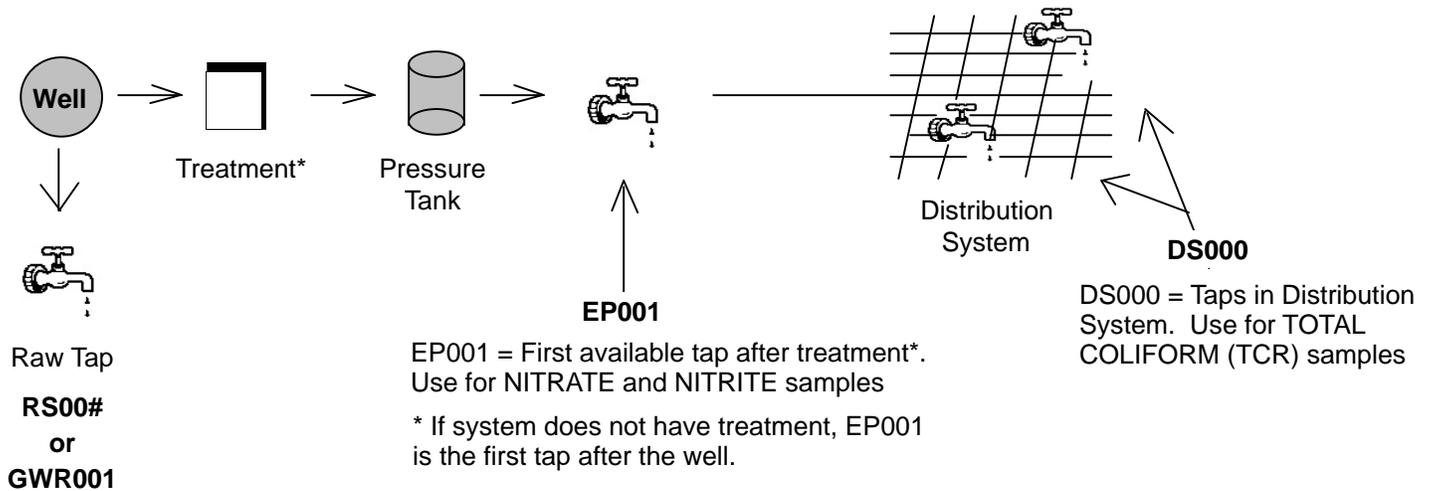

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1556112 PEACE VALLEY ORCHARDS 1 PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **PEACE VALLEY ORCHARDS 1 DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553532** Facility Name: **PEACE VALLEY ORCHARDS WELL NO 1**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 4/1/2015 and 6/30/2015

**Where to Collect Samples For a Small Public Water System**

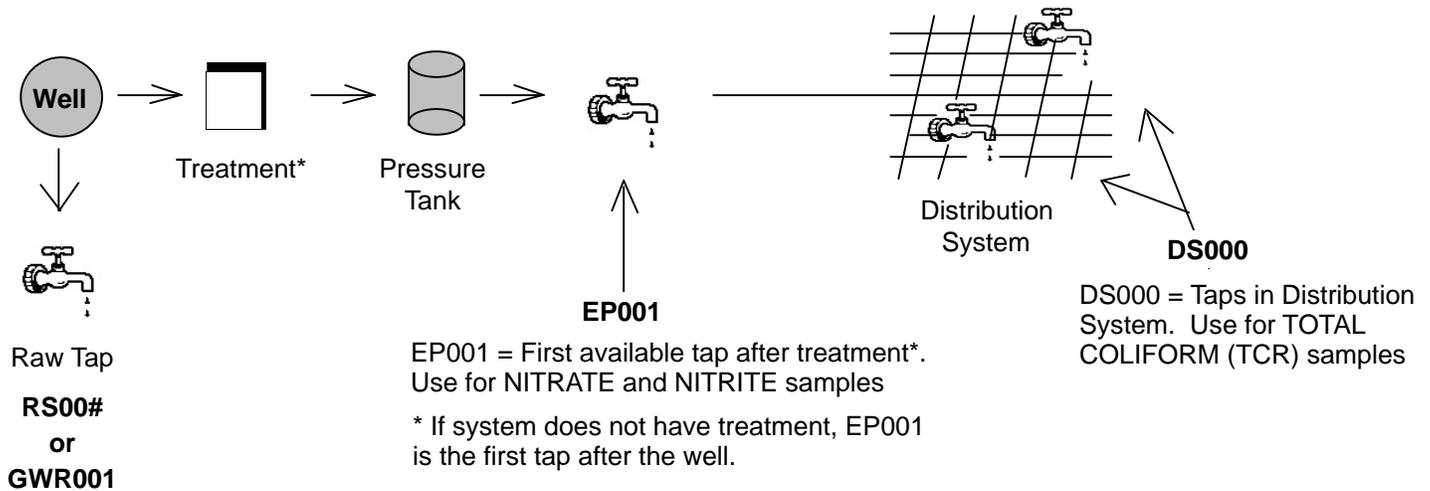

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1556312 BIG ARBS CAMPGROUND PWS**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> BIG ARBS CAMPGROUND DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1553534	<b>Facility Name:</b> BIG ARBS CAMPGROUND
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

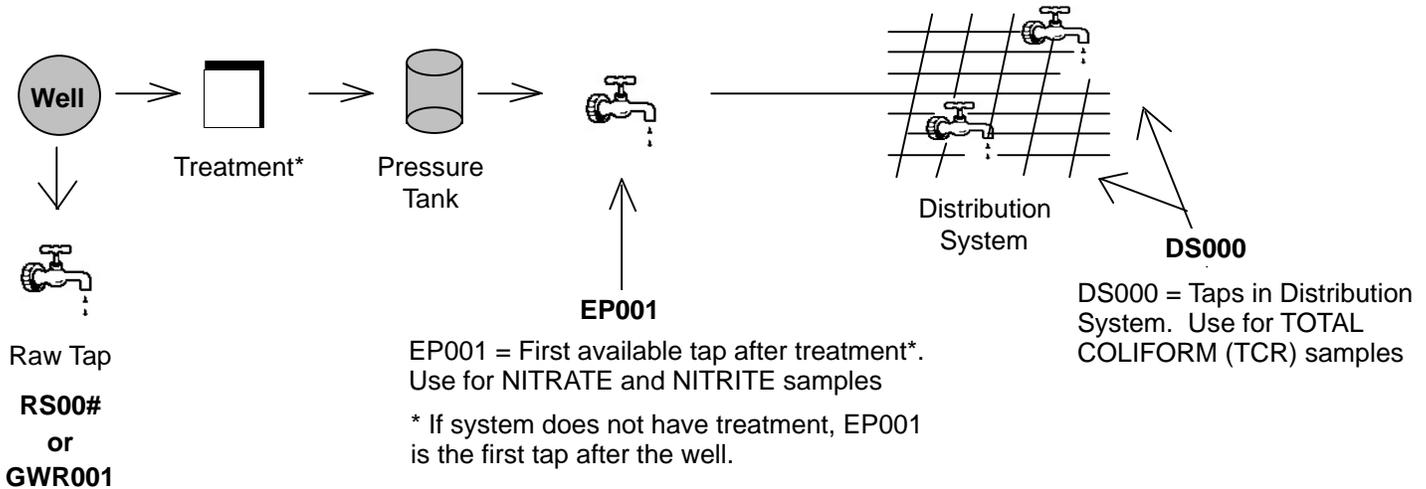

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1556412 CAMP FREDERICK-DINING**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **CAMP FREDERICK-DINING DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553535** Facility Name: **CAMP FREDERICK DINING HALL WEL**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

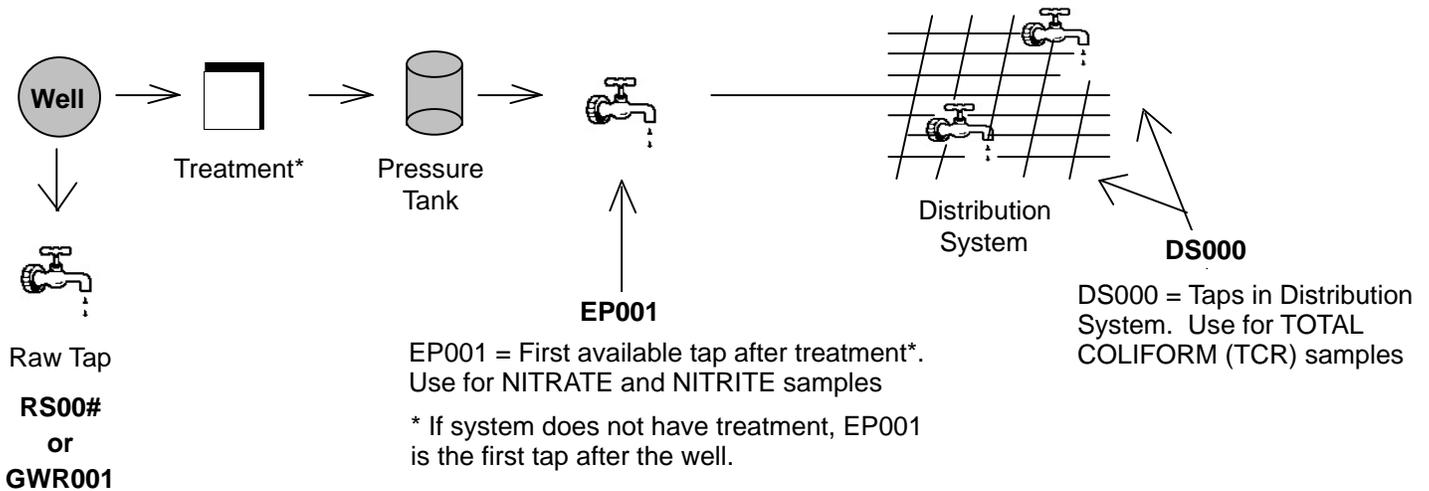

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1556512 CAMP FREDERICK-CAMPGROUND**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **CAMP FREDERICK-CAMPGRND DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553536** Facility Name: **CAMP FREDERICK CAMPGROUND WELL**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

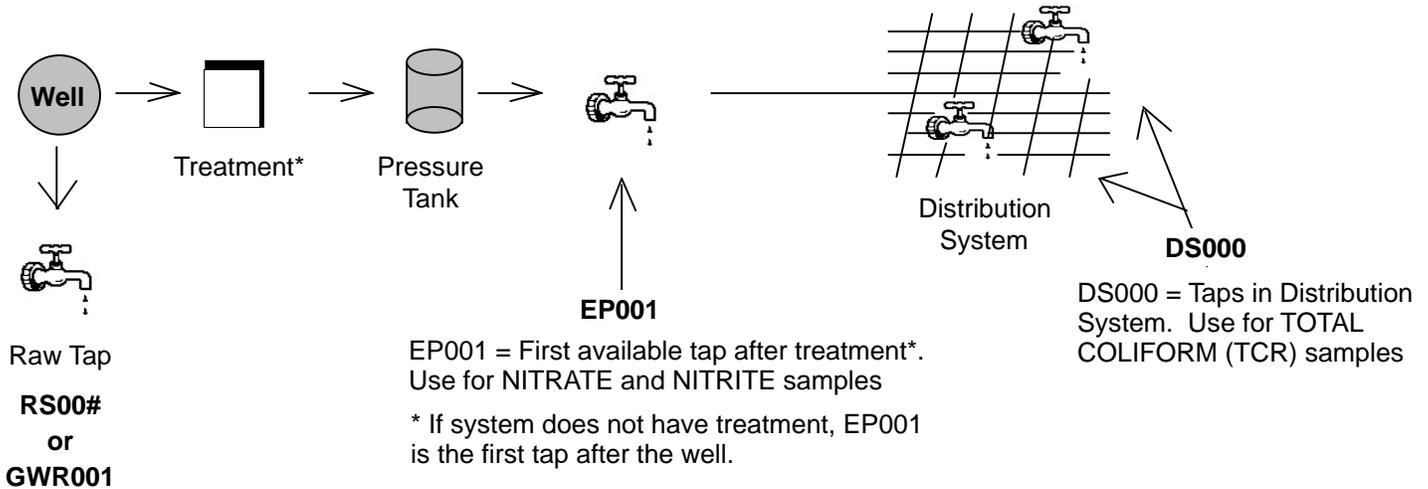

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1556612 CAUSEWAY CAMPGROUND**

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **CAUSEWAY CAMPGROUND DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553537** Facility Name: **CAUSEWAY CAMPGROUND**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**Where to Collect Samples For a Small Public Water System**

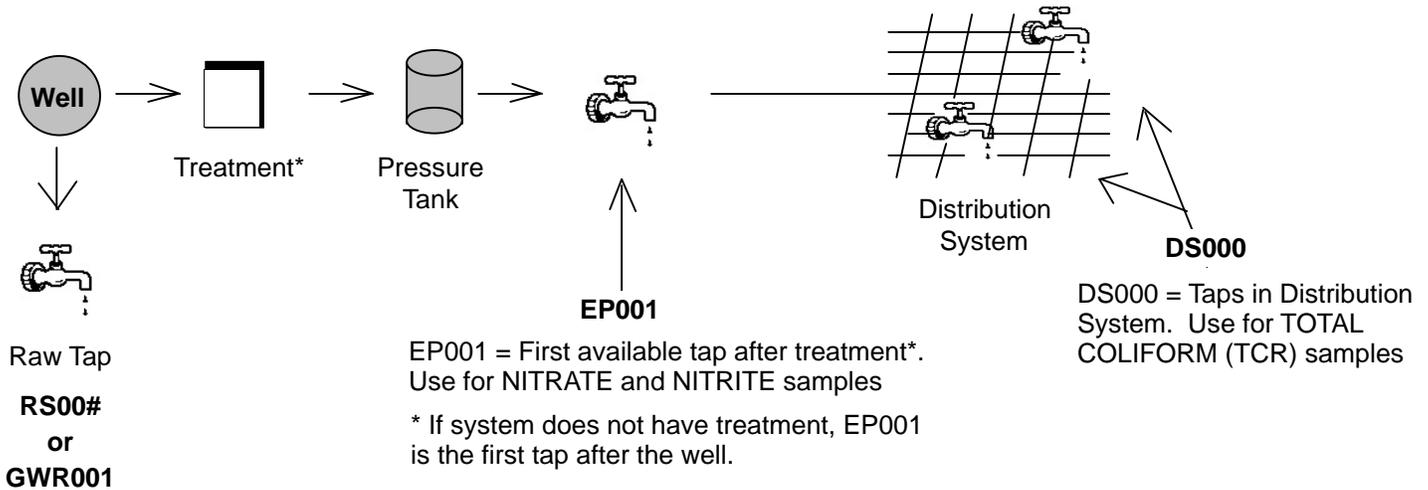

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1556812 FLYING FINN FAMILY CAMPGROUND**

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **FLYING FINN FAMILY CAMPG DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553539** Facility Name: **FLYING FINN FAMILY CAMPGROUND STU 1**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

**Where to Collect Samples For a Small Public Water System**

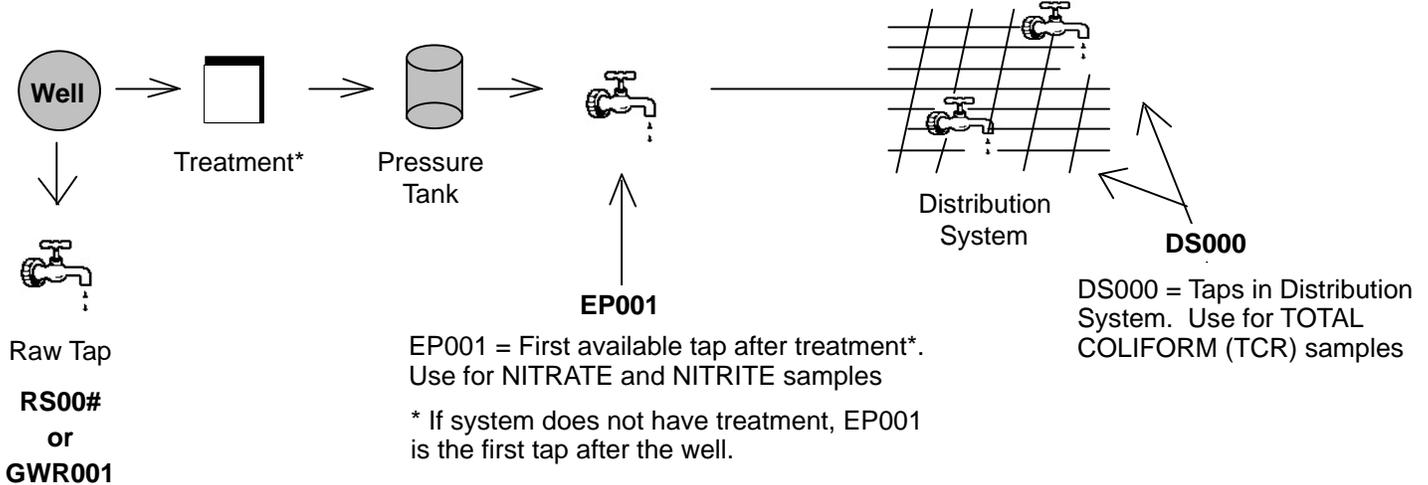

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**  
<http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

**Save a dime. Sample on time!**

**OH1556812 FLYING FINN FAMILY CAMPGROUND**

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **FLYING FINN FAMILY CAMPG DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1560499** Facility Name: **FLYING FINN FAMILY CAMPGROUND STU 2**  
**Location** SMP ID: **EP002** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

**Where to Collect Samples For a Small Public Water System**

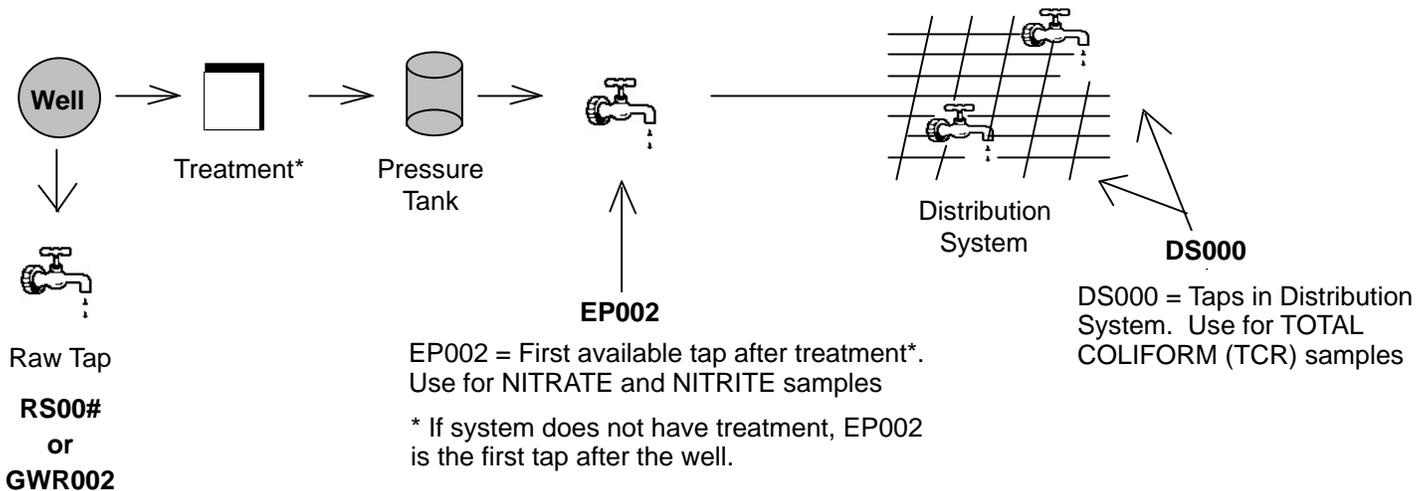

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**  
<http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

**Save a dime. Sample on time!**

**OH1556912 BUCK RUN GOLF COURSE**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **BUCK RUN GOLF COURSE DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553540** Facility Name: **BUCK RUN GOLF COURSE**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

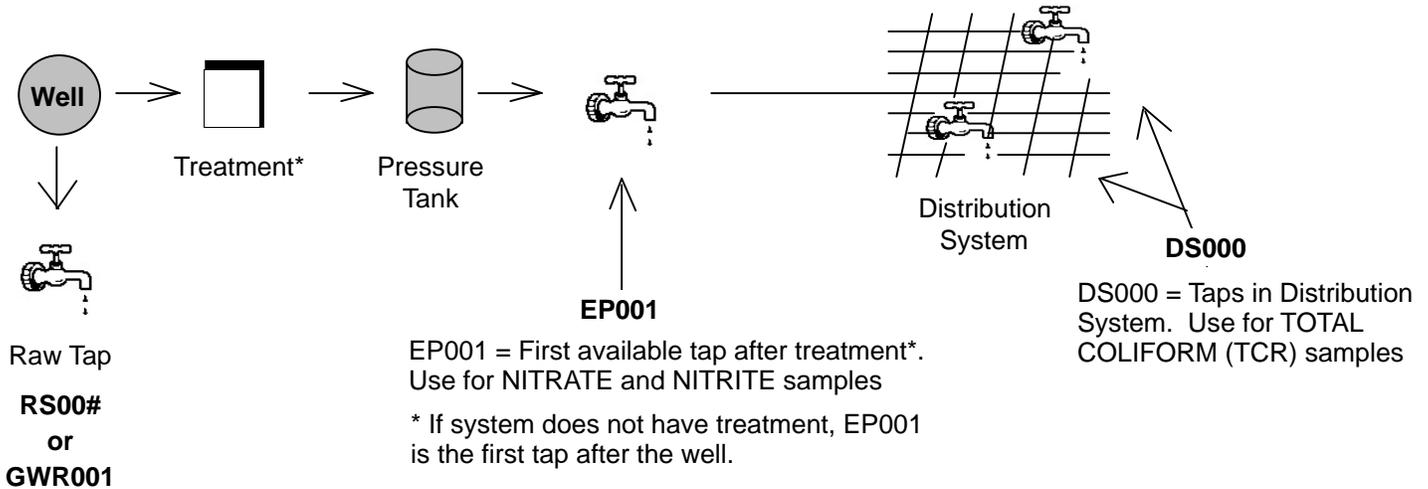

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1557412 PARADISE LAKE PARK - A PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> PARADISE LAKE PARK - A DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1553543	<b>Facility Name:</b> PARADISE LAKE PARK AREA A
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

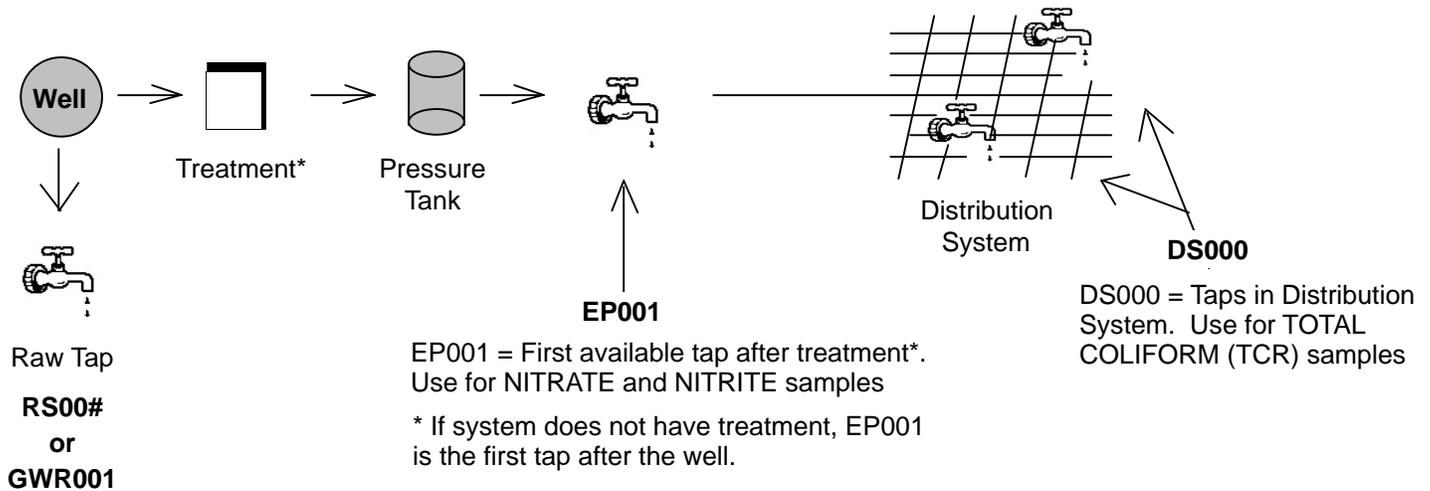

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1557512 PARADISE LAKE PARK-CAMPGROUND PWS**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **PARADISE LAKE PARK-CAMP DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553544** Facility Name: **PARADISE LAKE PARK CAMPGROUND STU 1**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

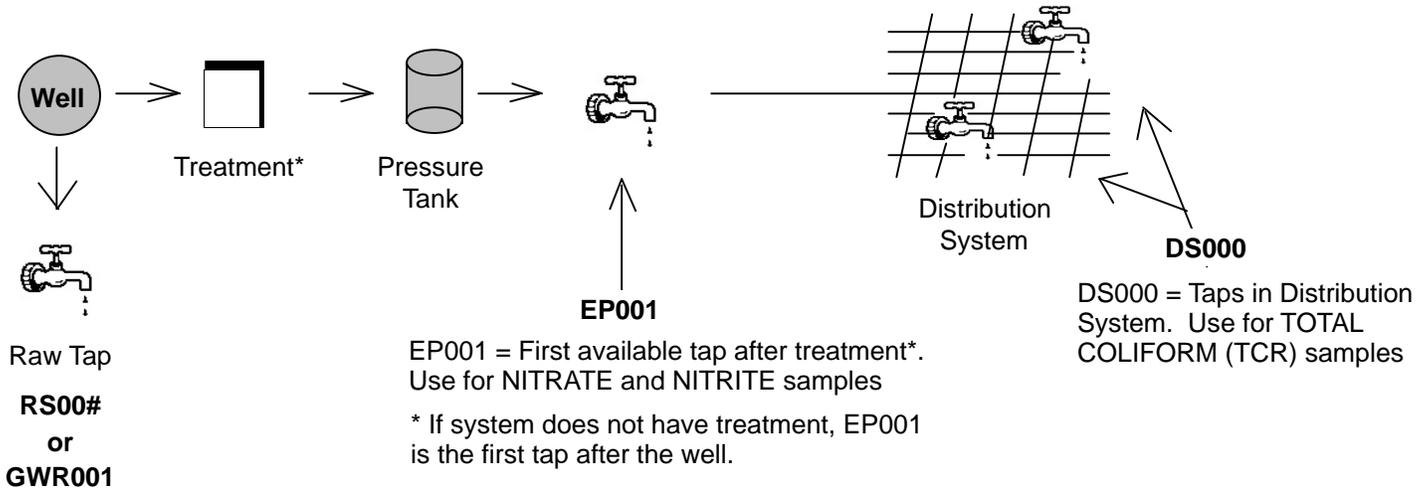

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1557512 PARADISE LAKE PARK-CAMPGROUND PWS**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **PARADISE LAKE PARK-CAMP DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1560500** Facility Name: **PARADISE LAKE PARK CAMPGROUND STU 2**  
**Location** SMP ID: **EP002** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

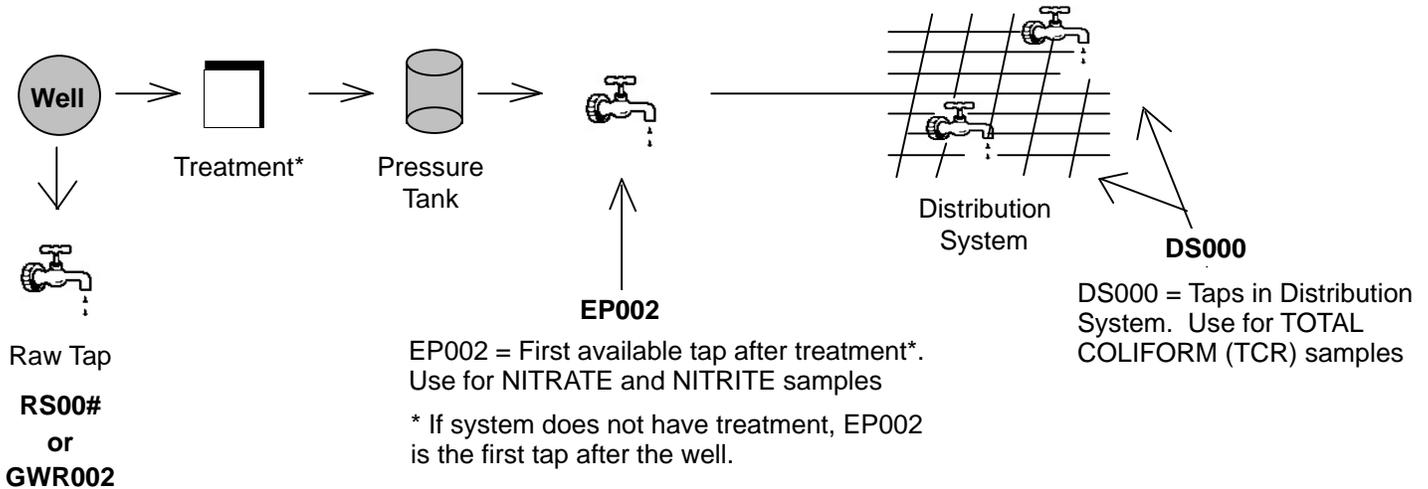

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1557512 PARADISE LAKE PARK-CAMPGROUND PWS**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **PARADISE LAKE PARK-CAMP DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1560501** Facility Name: **PARADISE LAKE PARK CAMPGROUND STU 3**  
**Location** SMP ID: **EP003** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

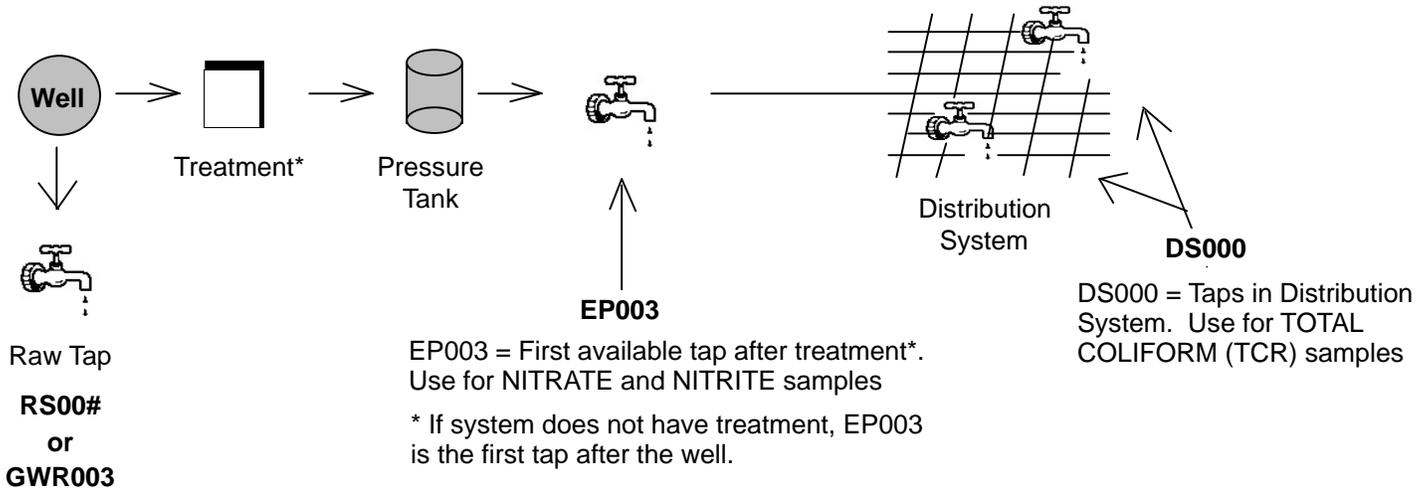

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**  
<http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

**Save a dime. Sample on time!**

**OH1558012 STONERIDGE TERRACE**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> STONERIDGE TERRACE DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1553545	<b>Facility Name:</b> STONERIDGE TERRACE
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

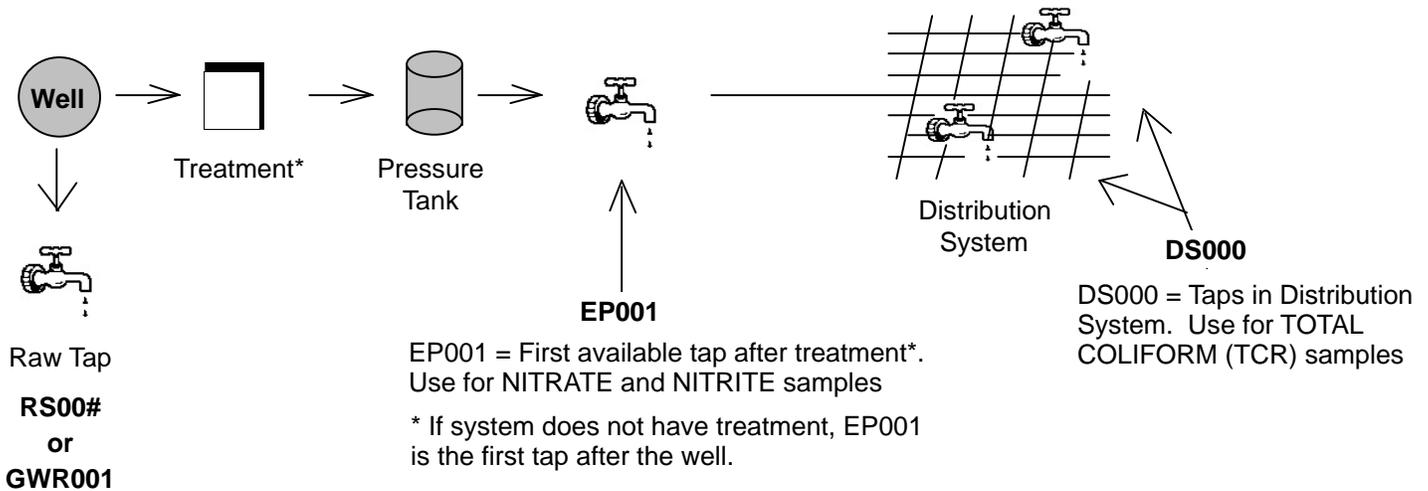

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1558112 TERRACE LAKES CAMPGROUND**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **TERRACE LAKES CAMPGROUND DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553546** Facility Name: **TERRACE LAKES CAMPGROUNDS**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

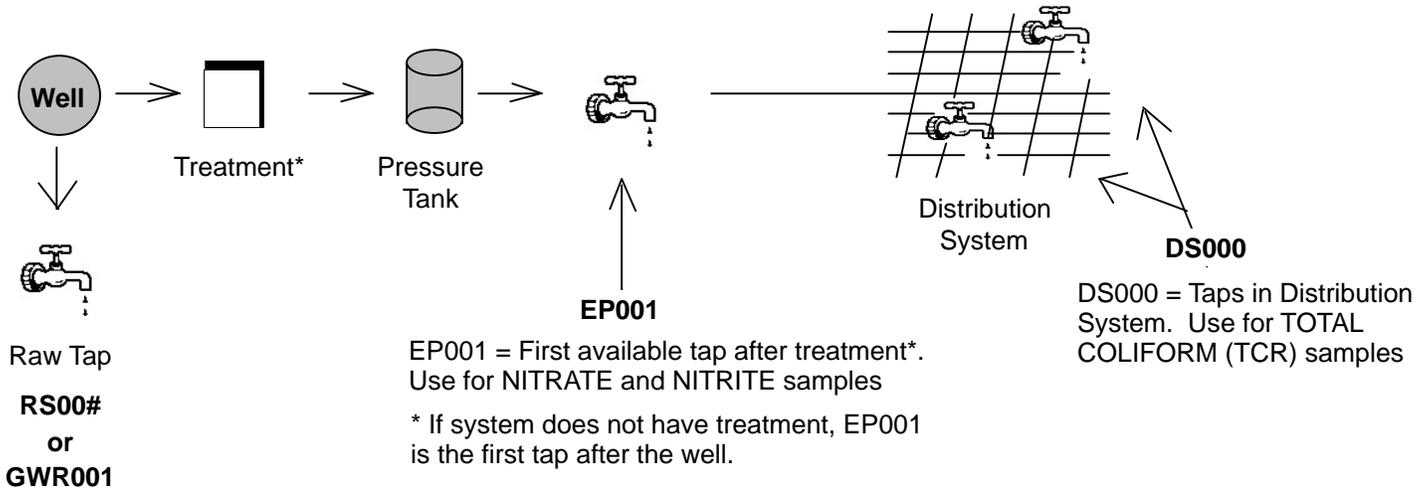

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1558312 MARKS LANDING PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **MARKS LANDING DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553547** Facility Name: **MARKS LANDING**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

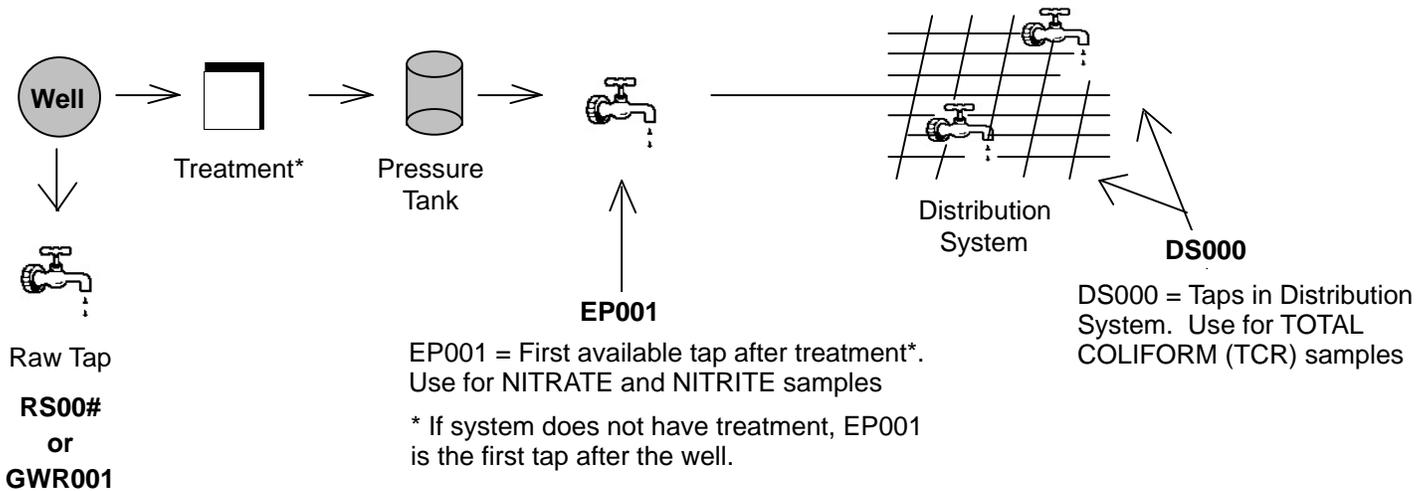

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1558512 MASONS STEAK HOUSE PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **MASONS STEAK HOUSE DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553549** Facility Name: **MASONS STEAK HOUSE**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

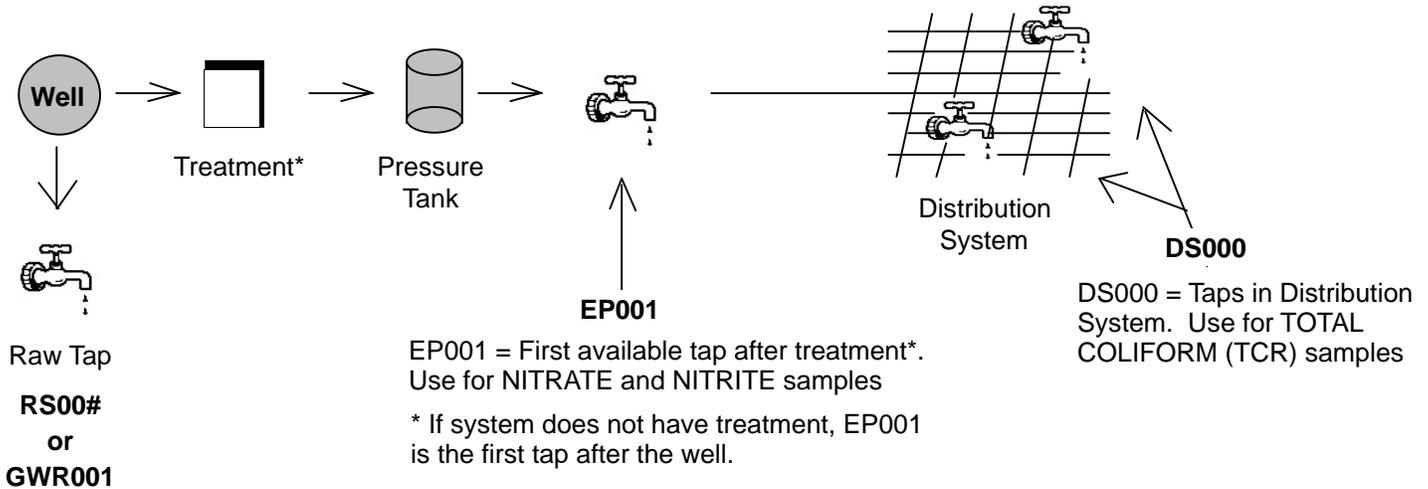

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1558712 BY-THE-WAY CAFE PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **BY-THE-WAY CAFE DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553551** Facility Name: **BY-THE-WAY CAFE**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

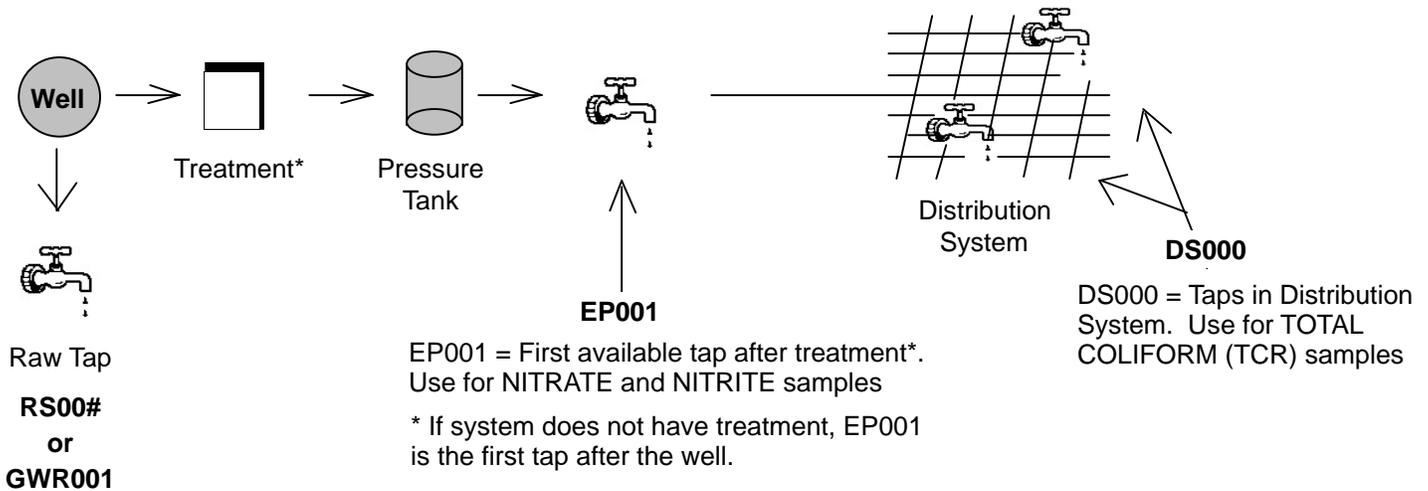

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1558812 BARNETTS MOTEL PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **BARNETTS MOTEL DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553552** Facility Name: **BARNETTS MOTEL**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

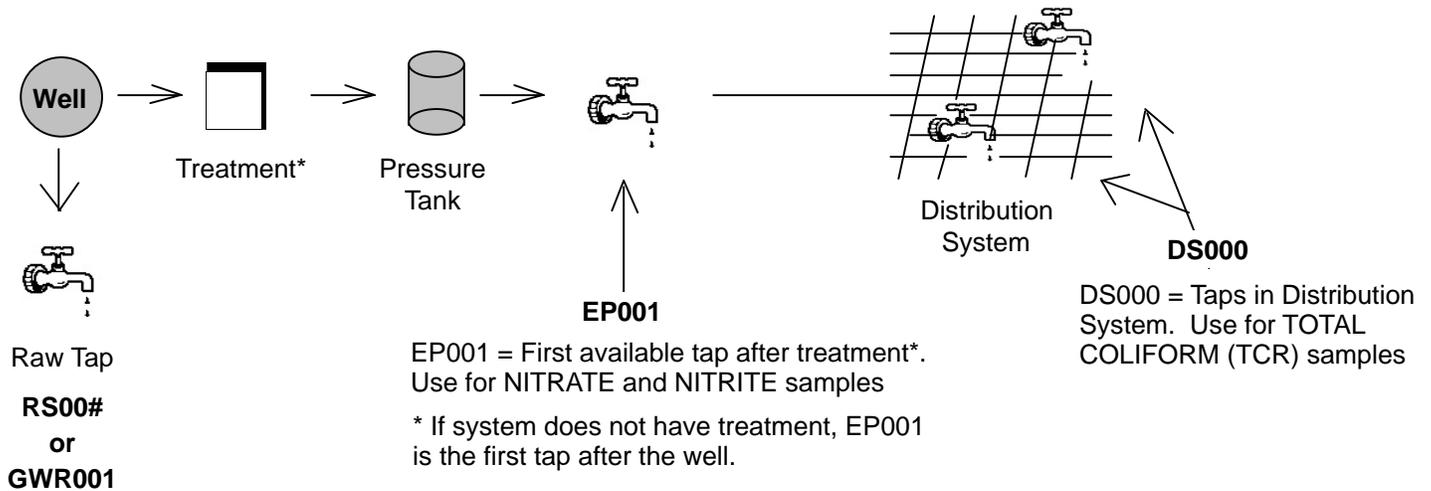

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1558912 DAIRY QUEEN-LISBON**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **DAIRY QUEEN-LISBON DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553553** Facility Name: **DAIRY QUEEN LISBON**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

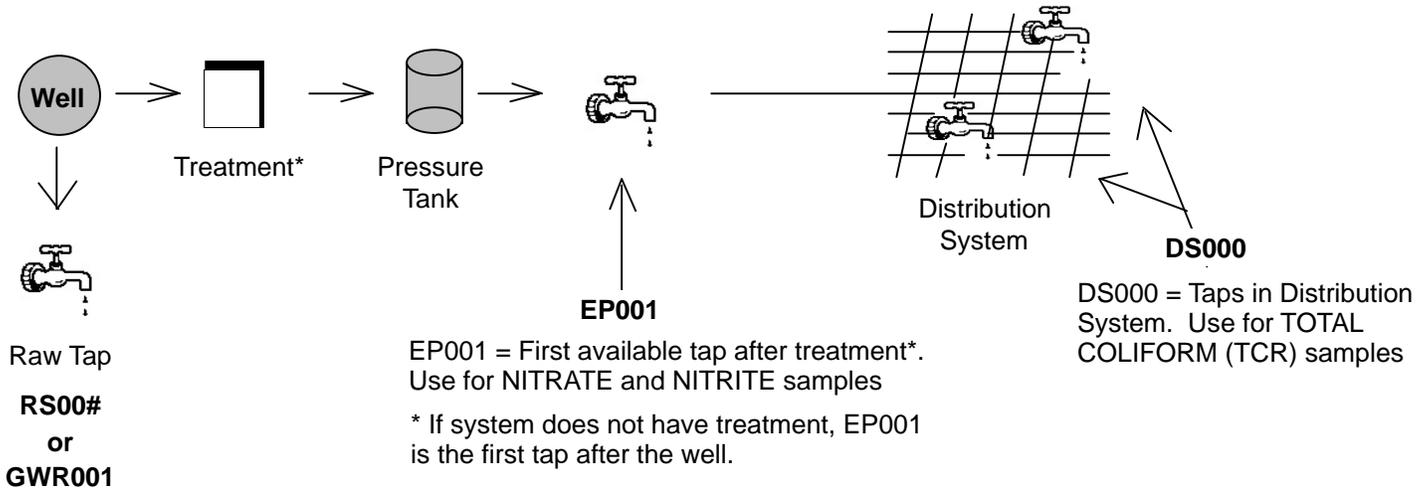

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1559112 VALLEY GOLF CLUB**

System Type: Transient Noncommunity

Operating Period: 3/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **VALLEY GOLF CLUB DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553555** Facility Name: **VALLEY GOLF CLUB**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 4/1/2015 and 6/30/2015

**Where to Collect Samples For a Small Public Water System**

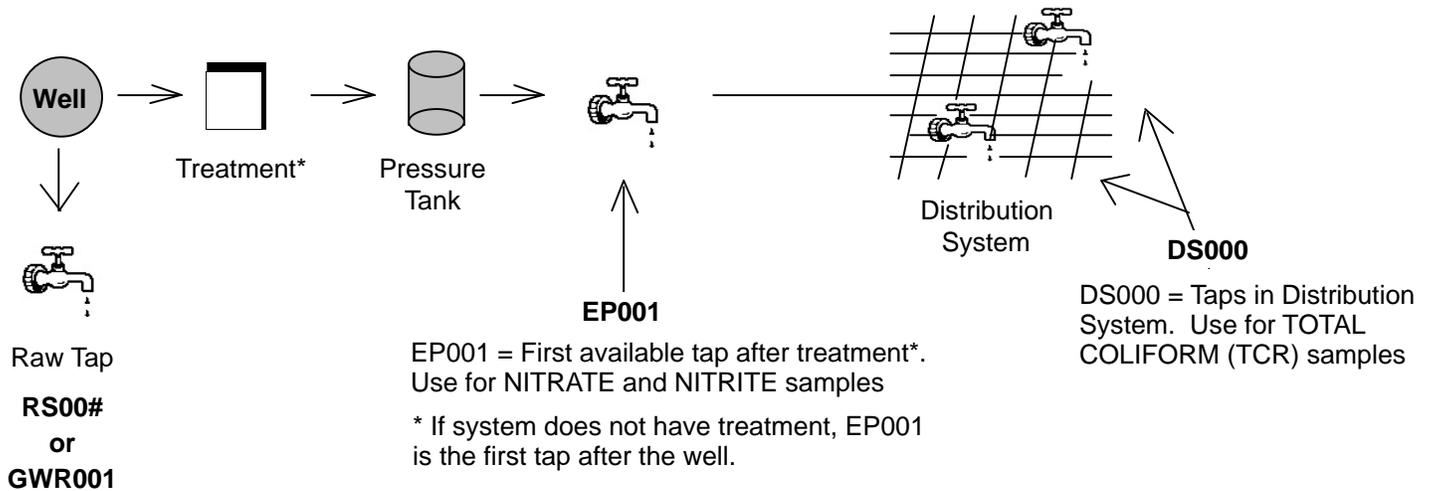

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1559512 GUILFORD LAKE RURITAN CLUB PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **GUILFORD LK RURITAN CLUB DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553557** Facility Name: **GUILFORD LAKE RURITAN CLUB**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

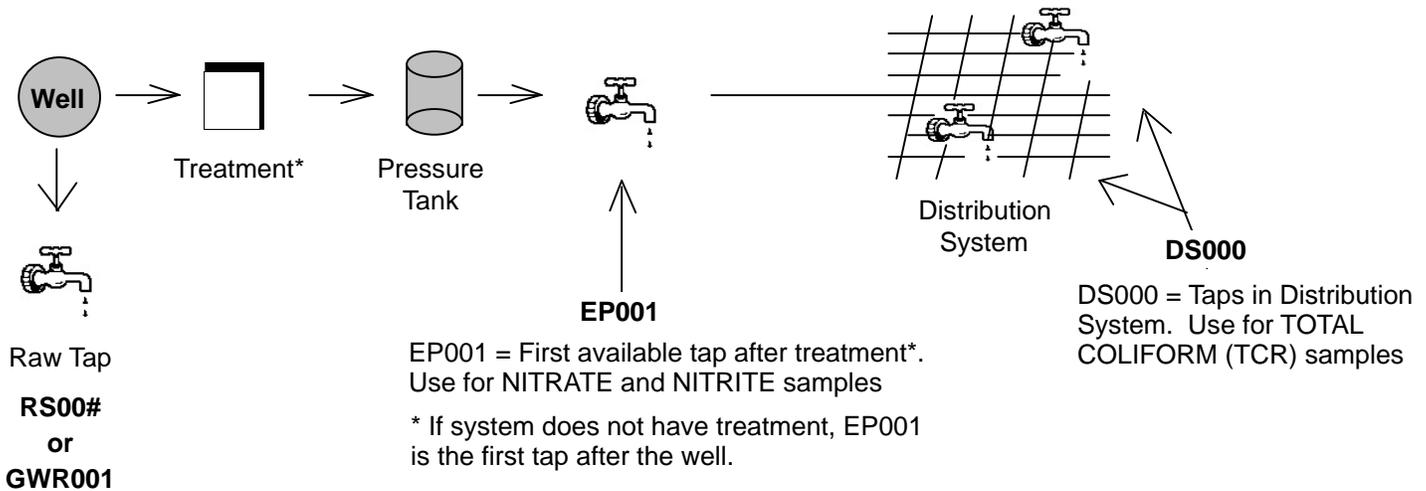

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1559822 BEAVER CREEK MEADOWS FARMHOUSE**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **BEAVER CK MEADOWS FRMHSE DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553560** Facility Name: **BEAVER CREEK MEADOWS FARMHOUSE**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

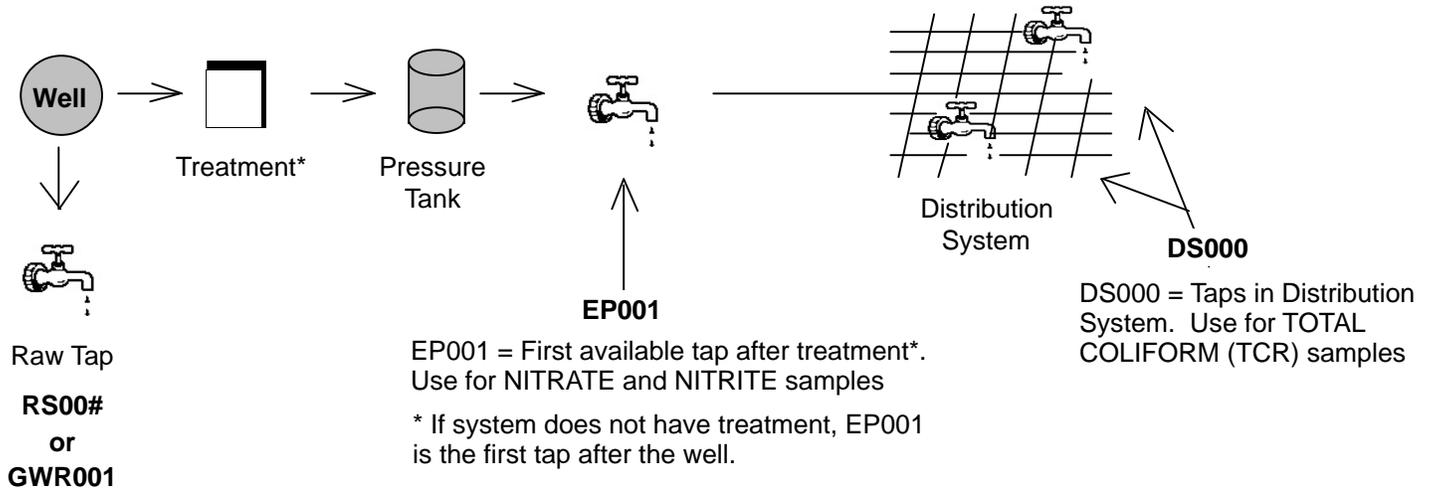

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1559912 AMERICAN LEGION POST 736**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **AMERICAN LEGION POST 736 DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553561** Facility Name: **AMERICAN LEGION POST 736**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

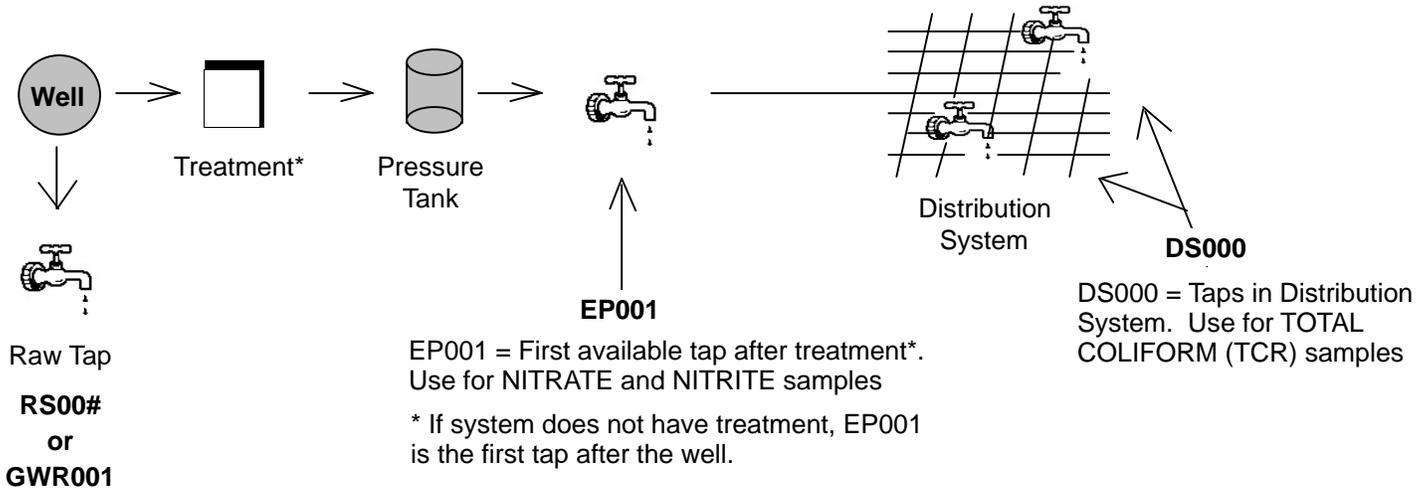

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1560012 VITTLE VILLAGE**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553562** Facility Name: **VITTLE VILLAGE**

**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

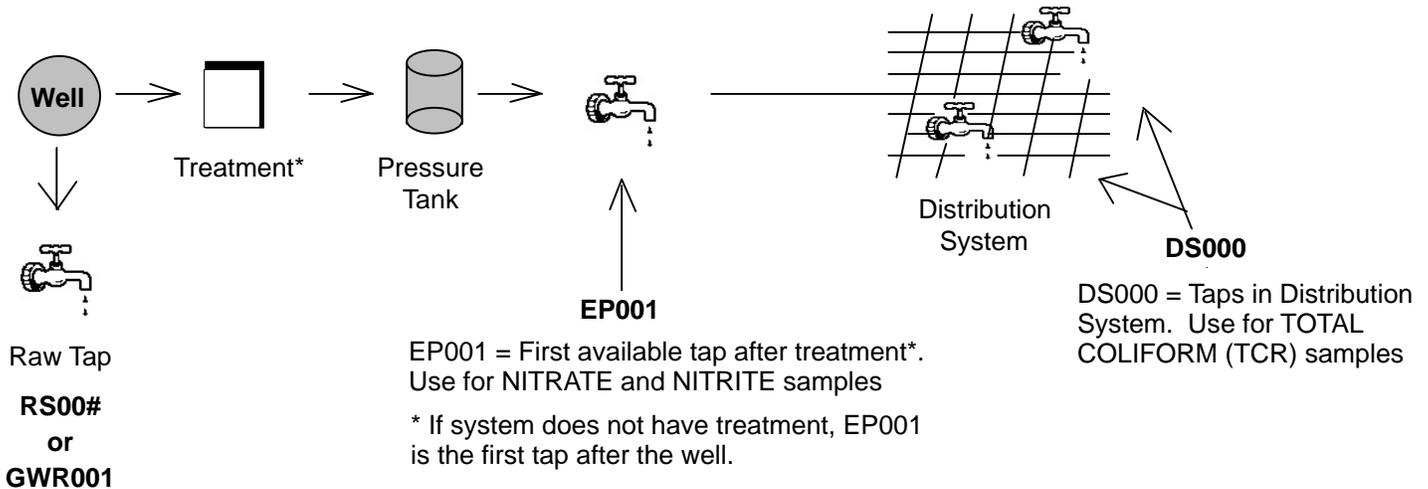

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

**<http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>**

**Save a dime. Sample on time!**

**OH1560312 TWIN SPRINGS GOLF COURSE**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **TWIN SPRINGS GOLF COURSE DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553564** Facility Name: **TWIN SPRINGS GOLF COURSE**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

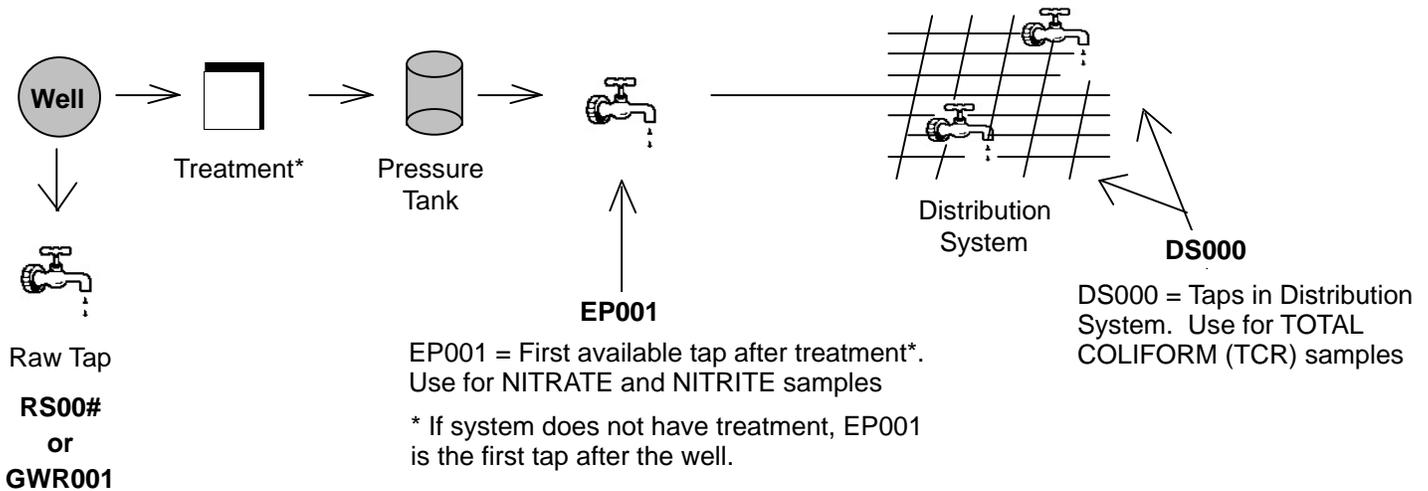

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1560512 VICTORY CHRISTIAN CENTER**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **VICTORY CHRISTIAN CENTER**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553565** Facility Name: **VICTORY CHRISTIAN CENTER**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

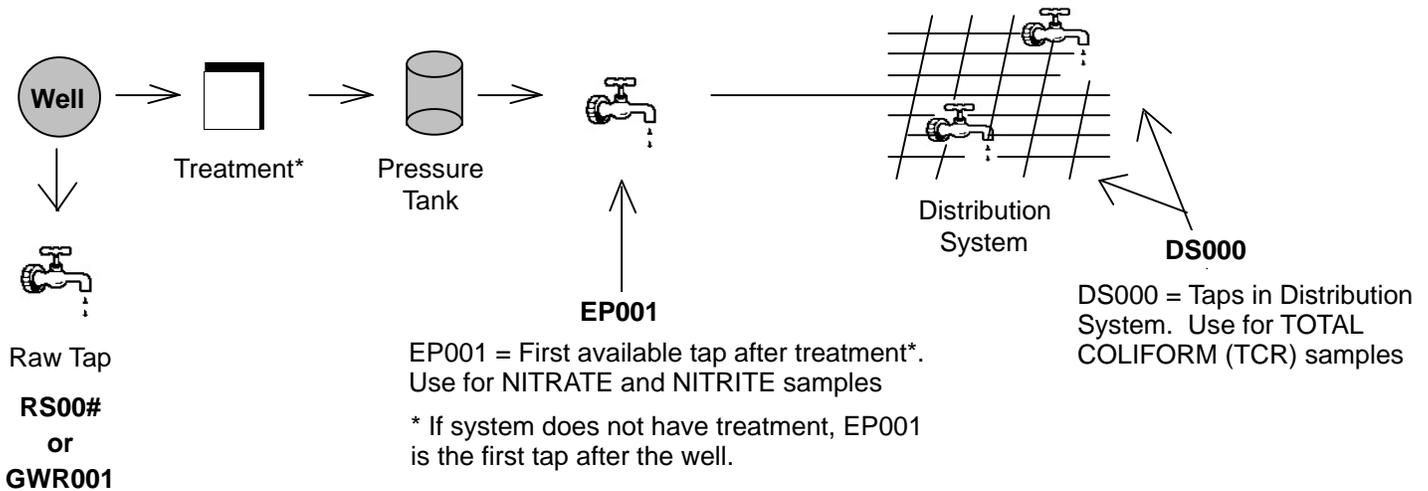

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1560812 SALEM SAXON CLUB**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> SALEM SAXON CLUB DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1553567	<b>Facility Name:</b> SALEM SAXON CLUB
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

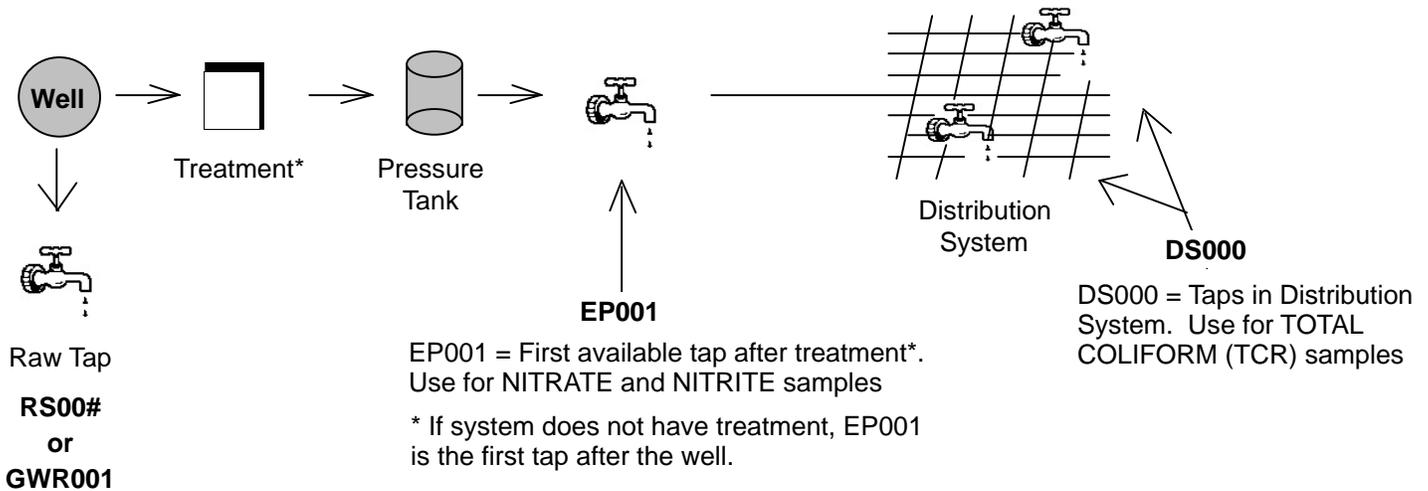

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1560912 CHURCH OF JESUS CHRIST OF LDS - COLUMBIA**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> CH OF JESUS CHRIST OF LD DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1553568	<b>Facility Name:</b> CHURCH OF JESUS CHRIST OF LDS
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

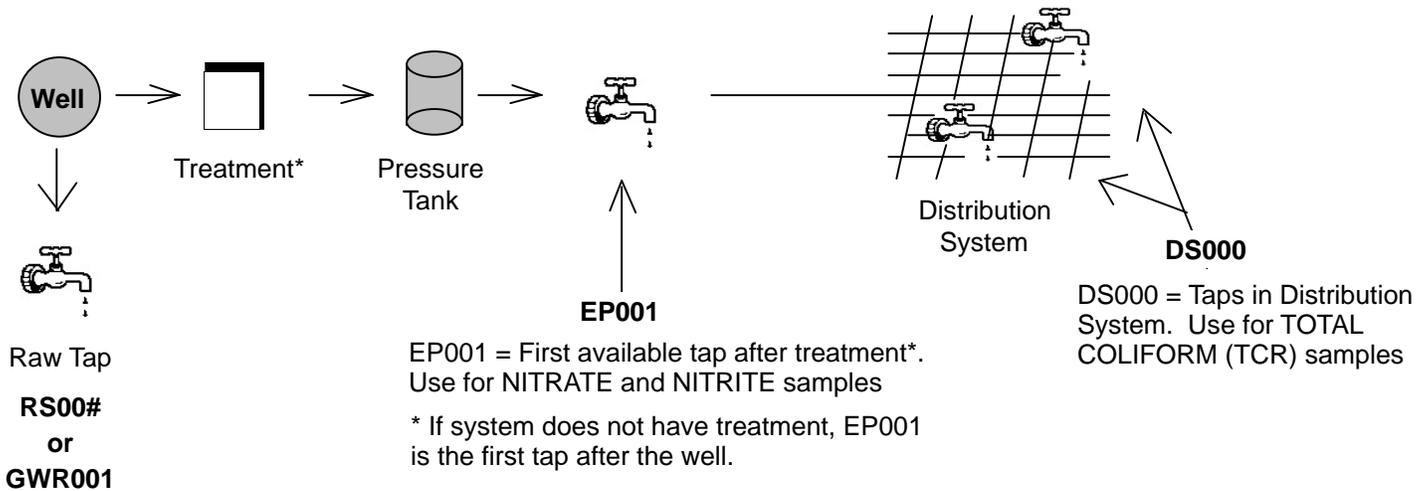

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1561412 CHURCH OF CHRIST - SALEM**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **CHURCH OF CHRIST DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553570** Facility Name: **CHURCH OF CHRIST**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

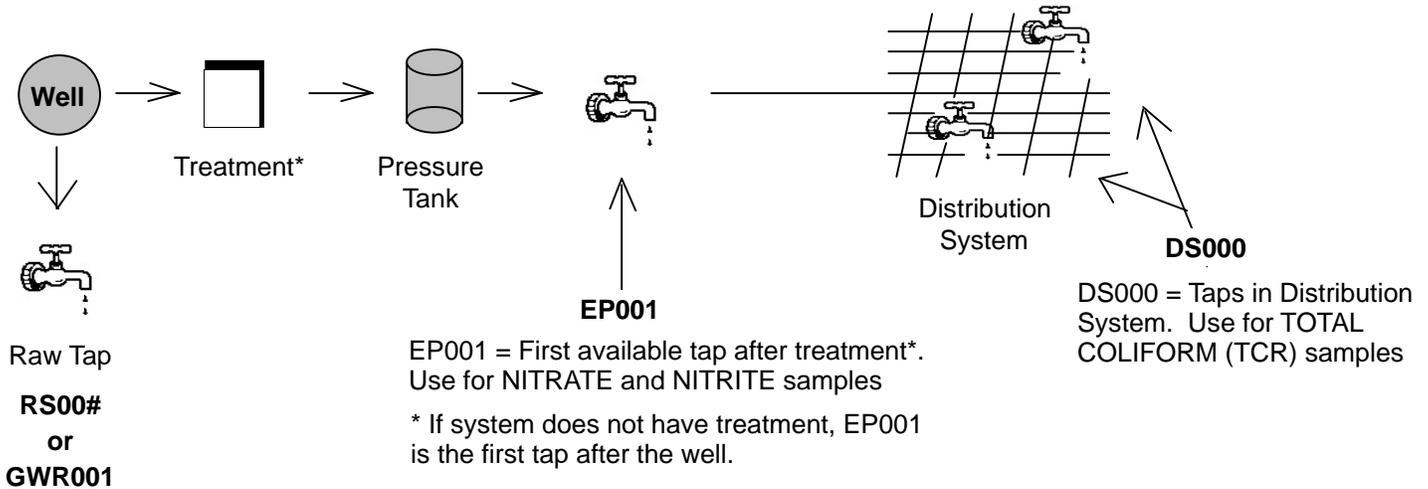

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1561512 KINGDOM HALL OF JEHOVAH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> KINGDOM HALL OF JEHOVAH DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1553571	<b>Facility Name:</b> KINGDOM HALL OF JEHOVAH WITNSS
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 4/1/2015 and 6/30/2015

**Where to Collect Samples For a Small Public Water System**

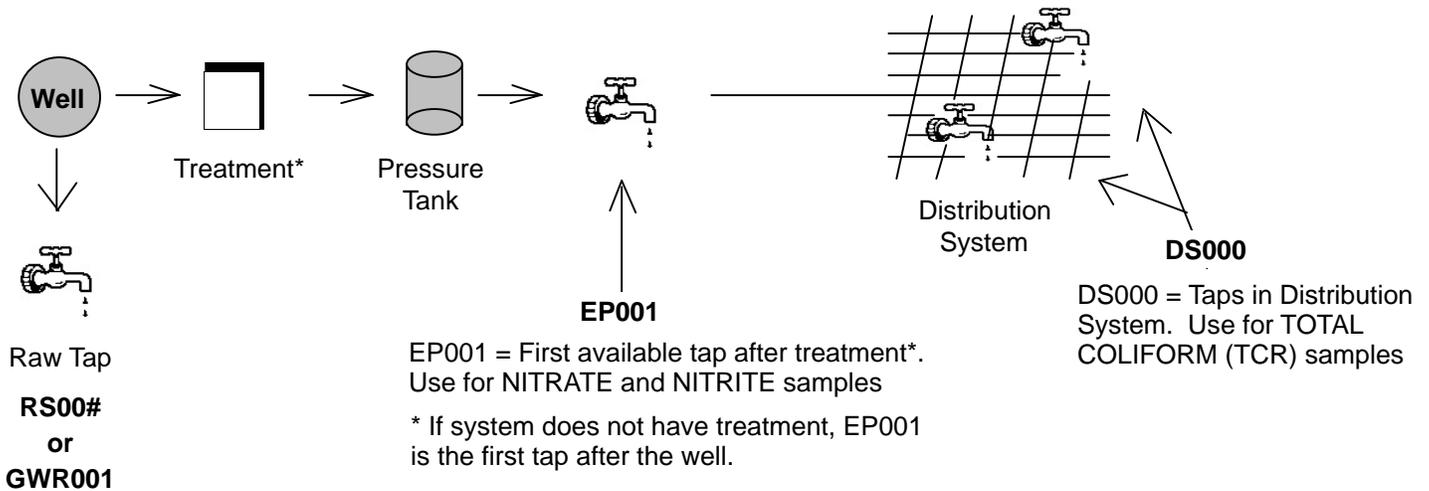

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1561812 LISBON ASSEMBLY OF GOD**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **LISBON ASSEMBLY OF GOD DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553573** Facility Name: **LISBON ASSEMBLY OF GOD CHURCH**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

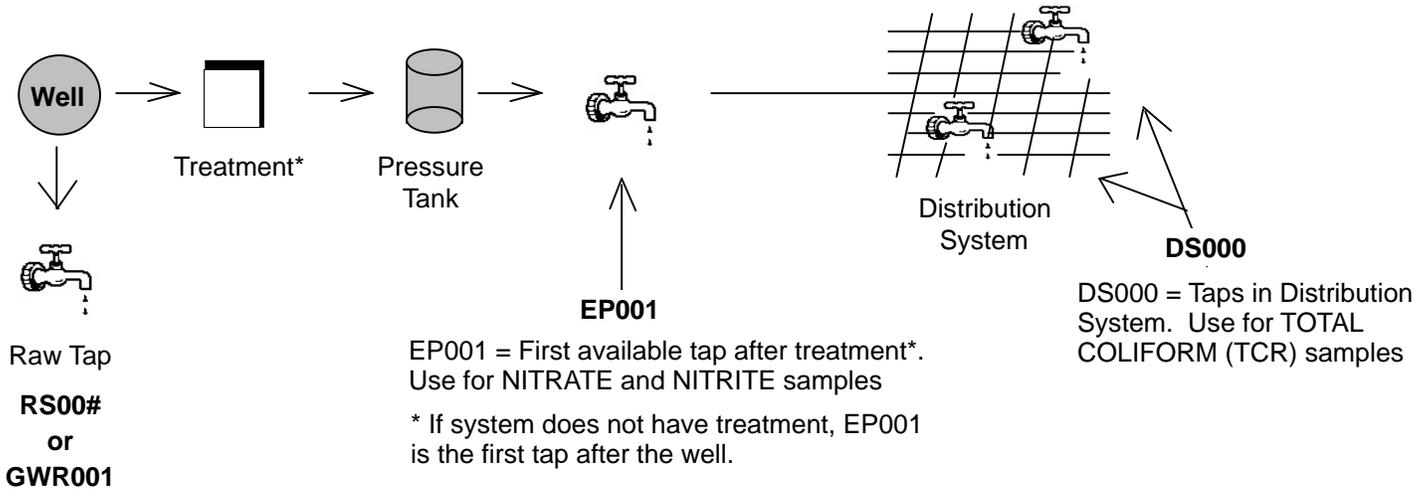

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1562012 ELKTON UNITED METHODIST CHURCH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> ELKTON UN METHODIST CH DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1553575	<b>Facility Name:</b> ELKTON UNITED METHODIST CHURCH
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

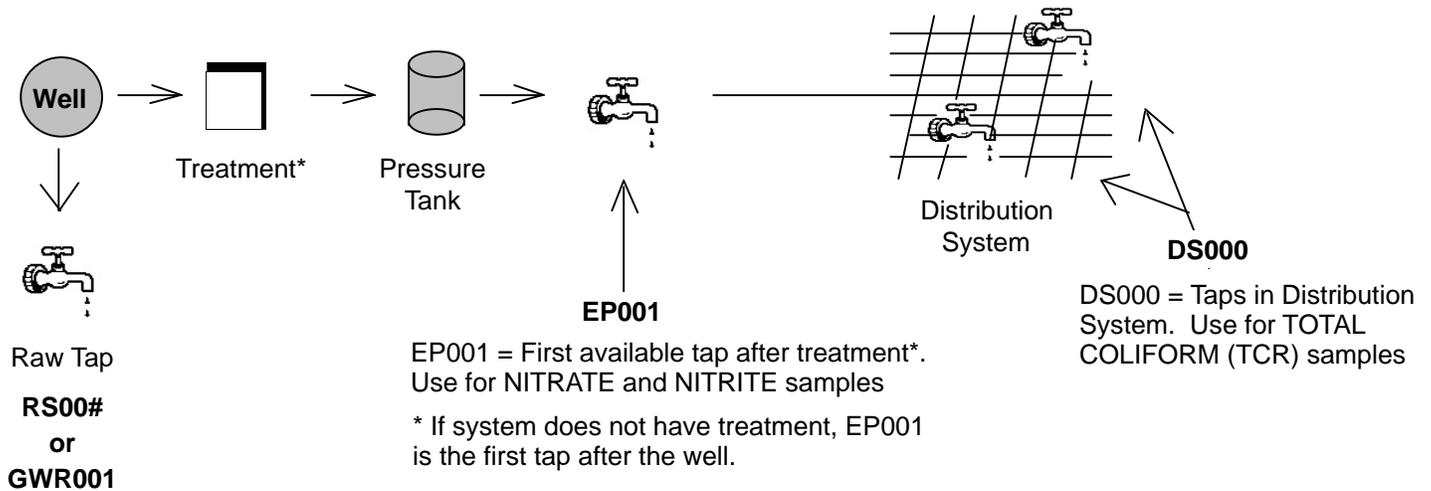

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1562812 CHURCH OF GOD IN CHRIST MENNONITE**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **CH OF GOD IN CHRIST MENN DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553583** Facility Name: **CHURCH OF GOD IN CHRIST MENNONITE**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

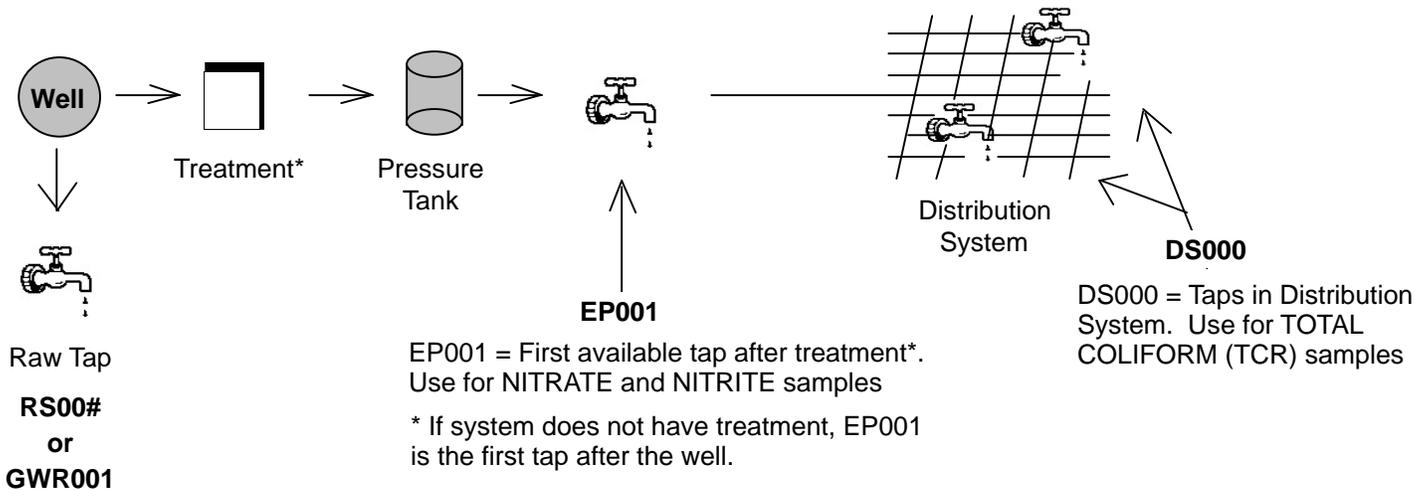

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1563012 1ST CHRISTIAN CHURCH OF KENSINGTON**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> 1ST CHRISTIAN CH OF KENS DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1553585	<b>Facility Name:</b> 1ST CHRISTIAN CHURCH OF KENSINGTON
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

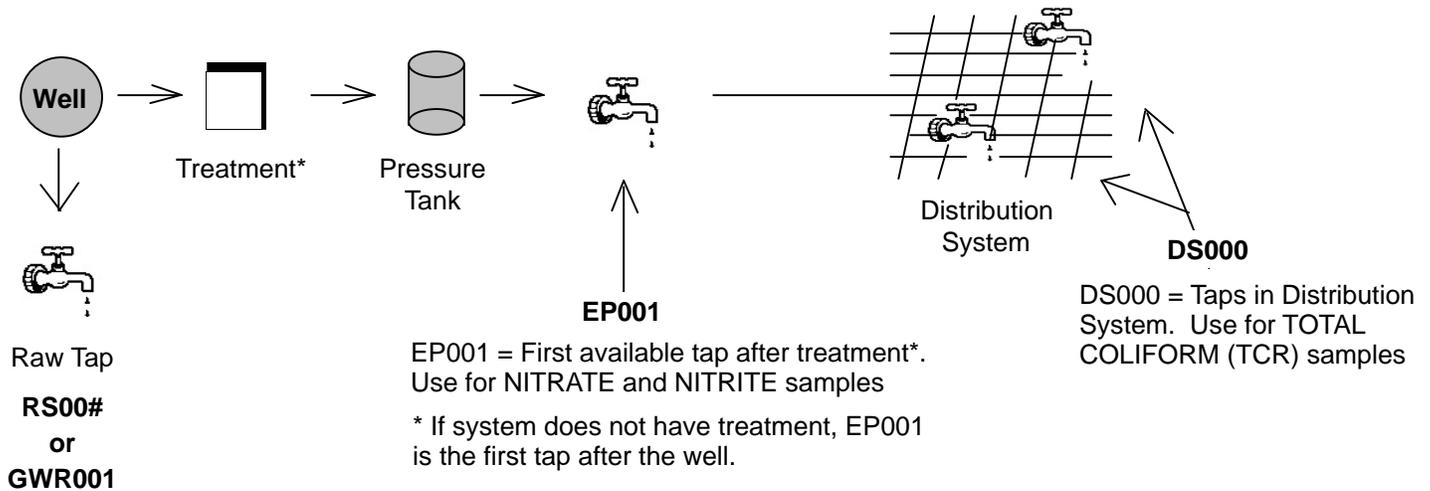

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1563112 J AND K SUBWAY INC #2312**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **J&K SUBWAY INC DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553586** Facility Name: **J & K SUBWAY INC**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

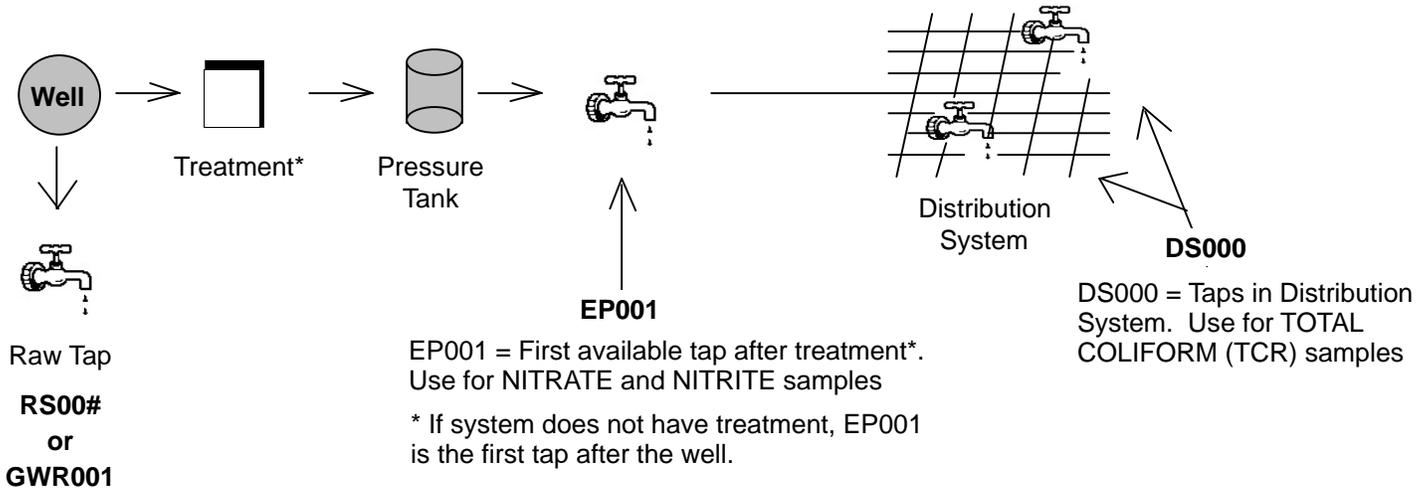

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1563212 MOUNT CALVARY COMMUNITY CHURCH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> MT. CALVARY COM. CHURCH DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1553587	<b>Facility Name:</b> MT CALVARY COMMUNITY CHURCH
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

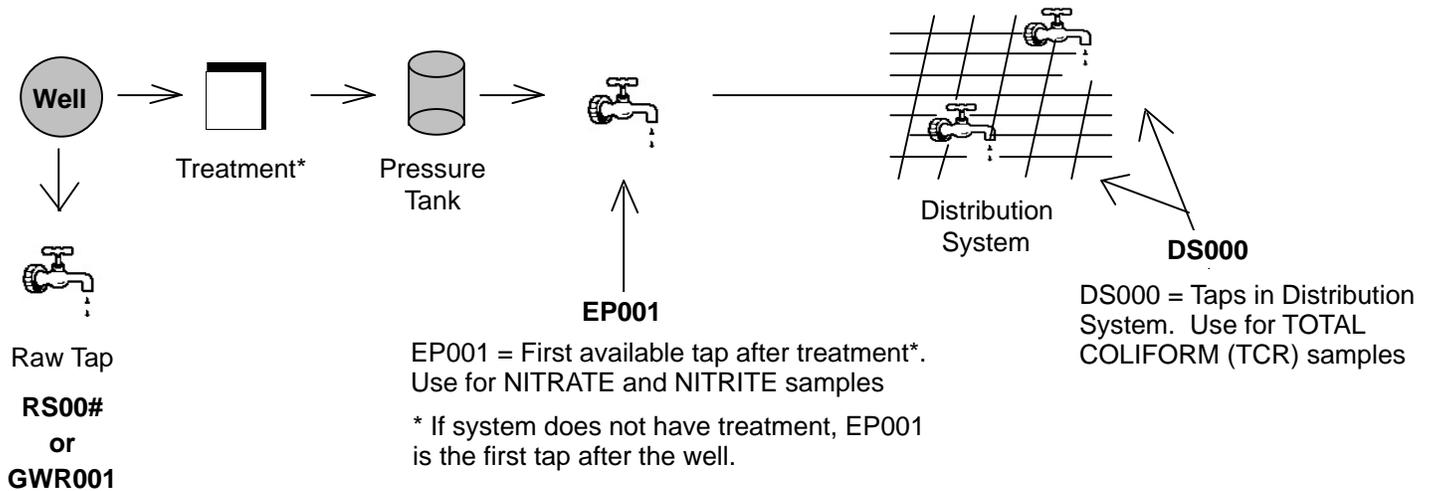

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1563312 MARANATHA CHAPEL**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **MARANATHA CHAPEL DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553588** Facility Name: **MARANATHA CHAPEL**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

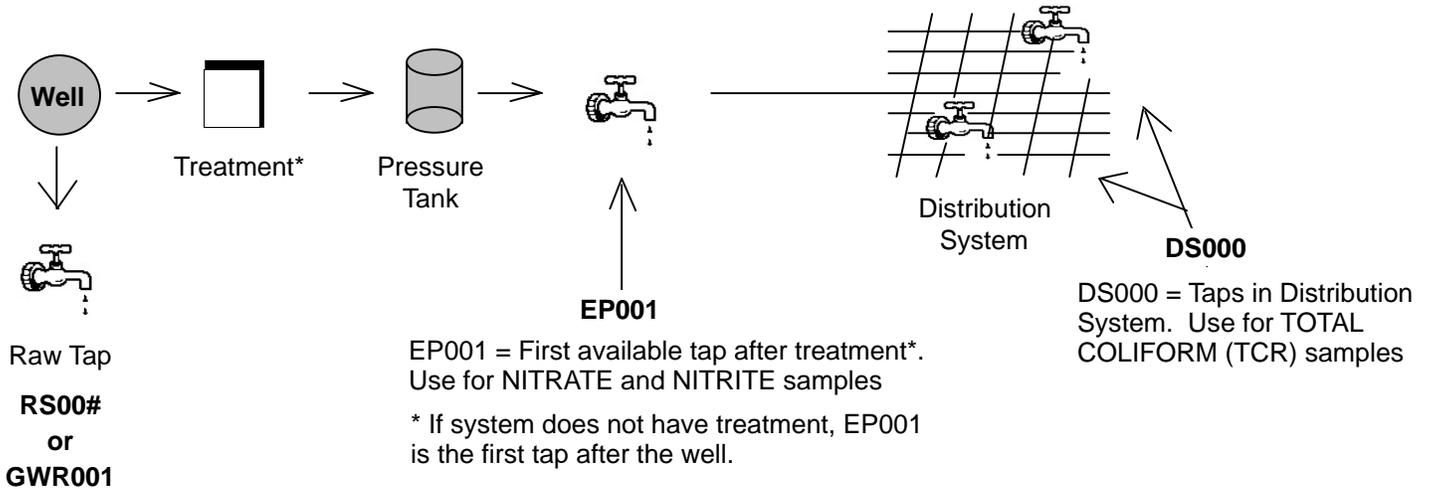

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1563412 BIBLE BAPTIST MINISTRIES**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> BIBLE BAPTIST MINISTRIES DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1553589	<b>Facility Name:</b> BIBLE BAPTIST MINISTRIES
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

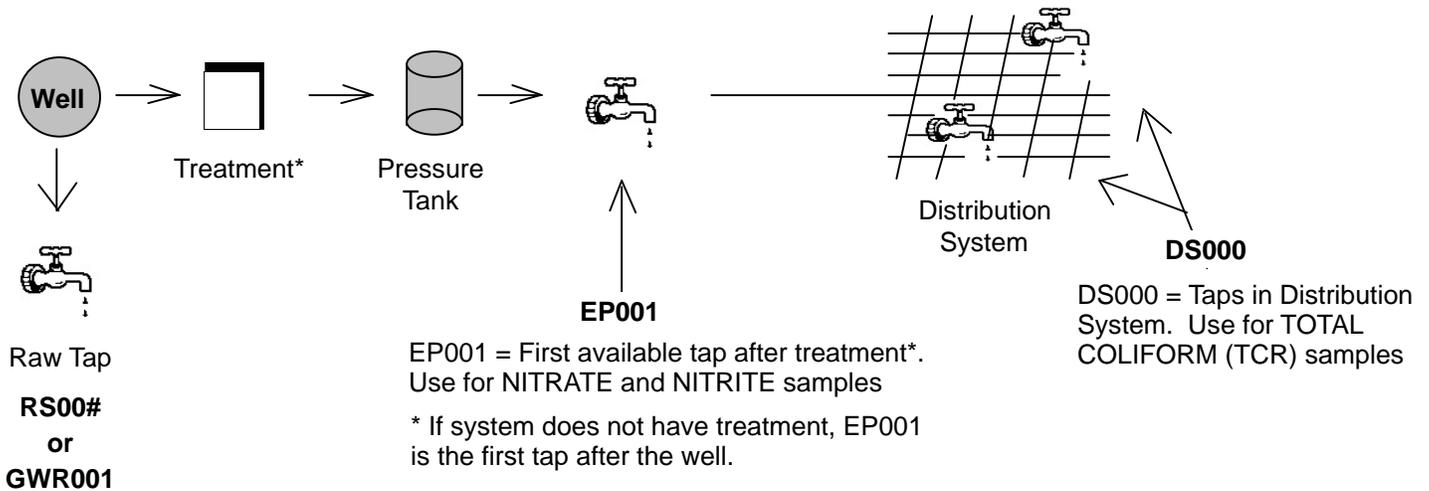

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1563512 W BRANCH ATHLETIC BOOSTER CLUB**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> W BRANCH ATH BOOSTER CLB DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1553590	<b>Facility Name:</b> W BRANCH ATH BOOSTER CLB
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

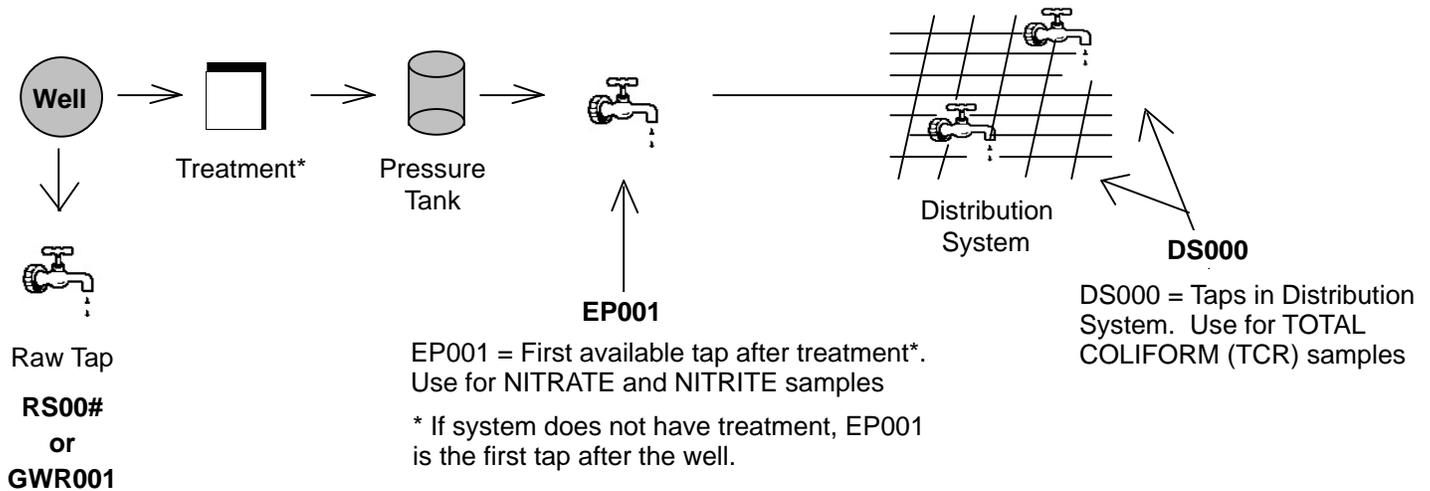

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1563612 EAGLE PASS GOLF COURSE**

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **EAGLE PASS GOLF COURSE DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553591** Facility Name: **EAGLE PASS GOLF COURSE**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

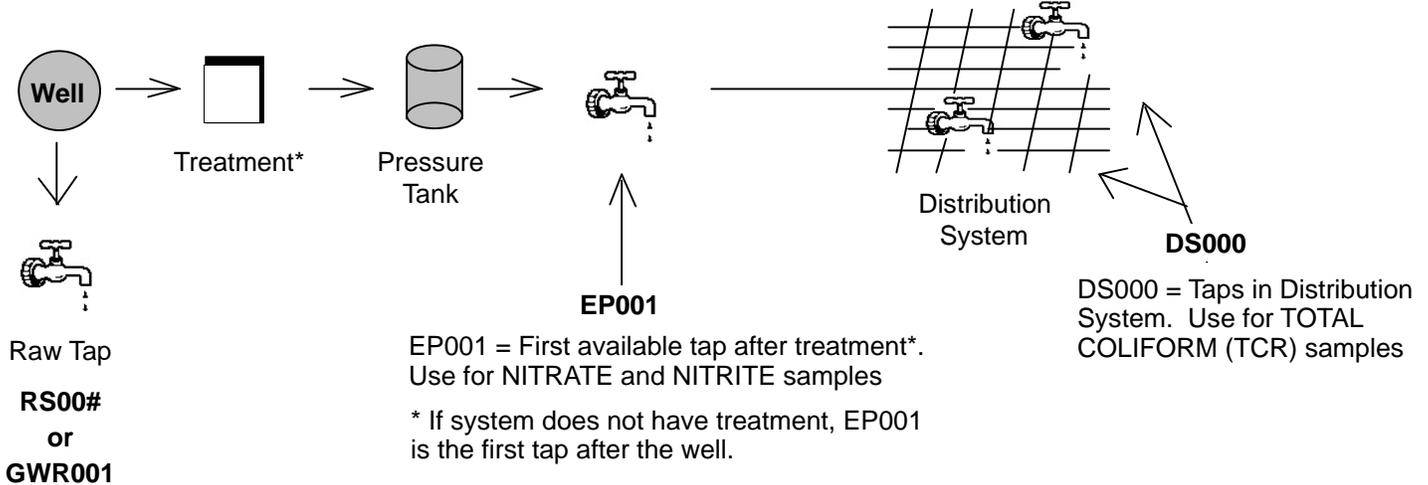

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**  
<http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

**Save a dime. Sample on time!**

**OH1563712 VALLEY GOLF CLUB-HANDPUMP**

System Type: Transient Noncommunity

Operating Period: 3/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> VALLEY GOLF CLUB-HANDPMP DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1553592	<b>Facility Name:</b> VALLEY GOLF CLUB HANDPUMP
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**Where to Collect Samples For a Small Public Water System**

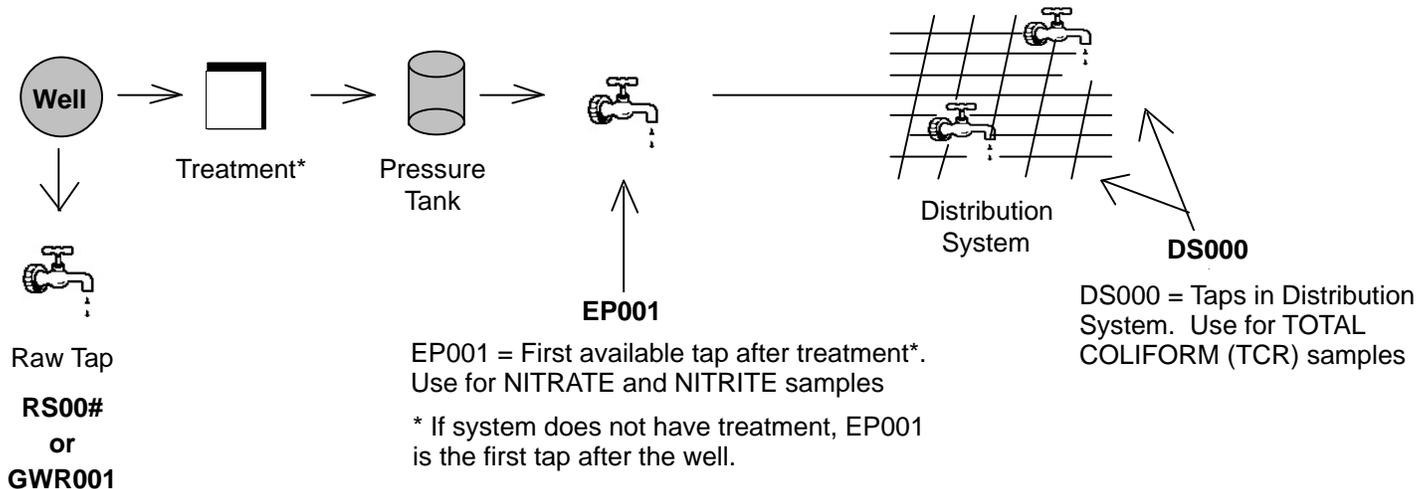

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1563812 SEVAKEEN COUNTRY CLUB**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **SEVAKEEN COUNTRY CLUB DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553593** Facility Name: **SEVAKEEN COUNTRY CLUB**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

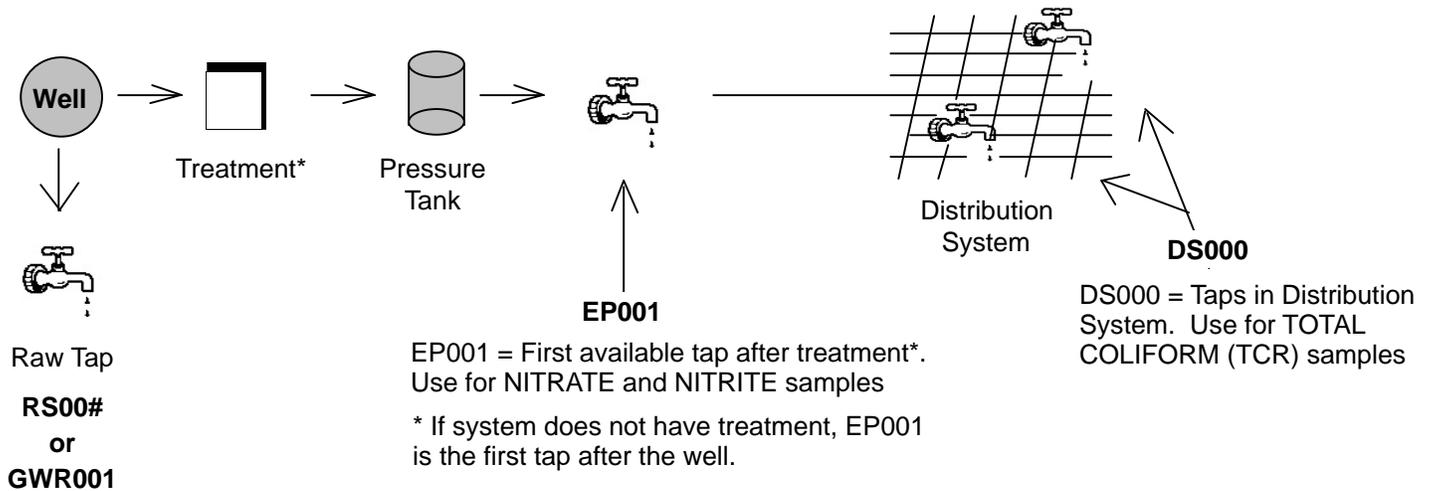

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1564012 STATE LINE TAVERN**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **STATE LINE TAVERN DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553594** Facility Name: **STATE LINE TAVERN**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

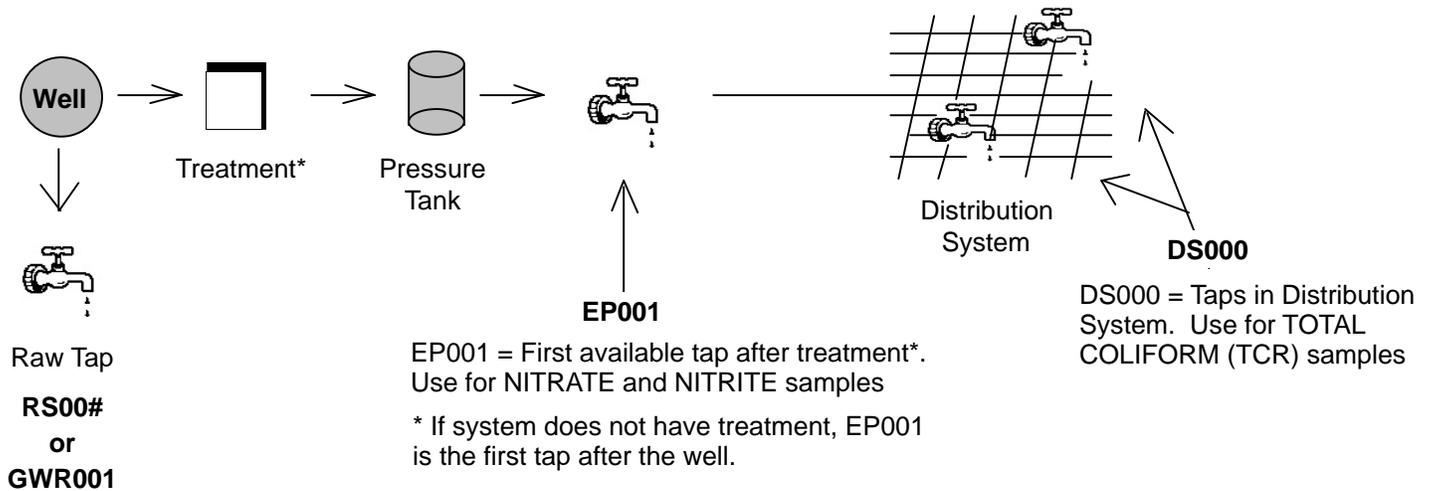

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1564112 PEACE VALLEY ORCHARDS 2 PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **PEACE VALLEY ORCHARDS 2 DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1553595** Facility Name: **PEACE VALLEY ORCHARDS WELL NO 2**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 4/1/2015 and 6/30/2015

**Where to Collect Samples For a Small Public Water System**

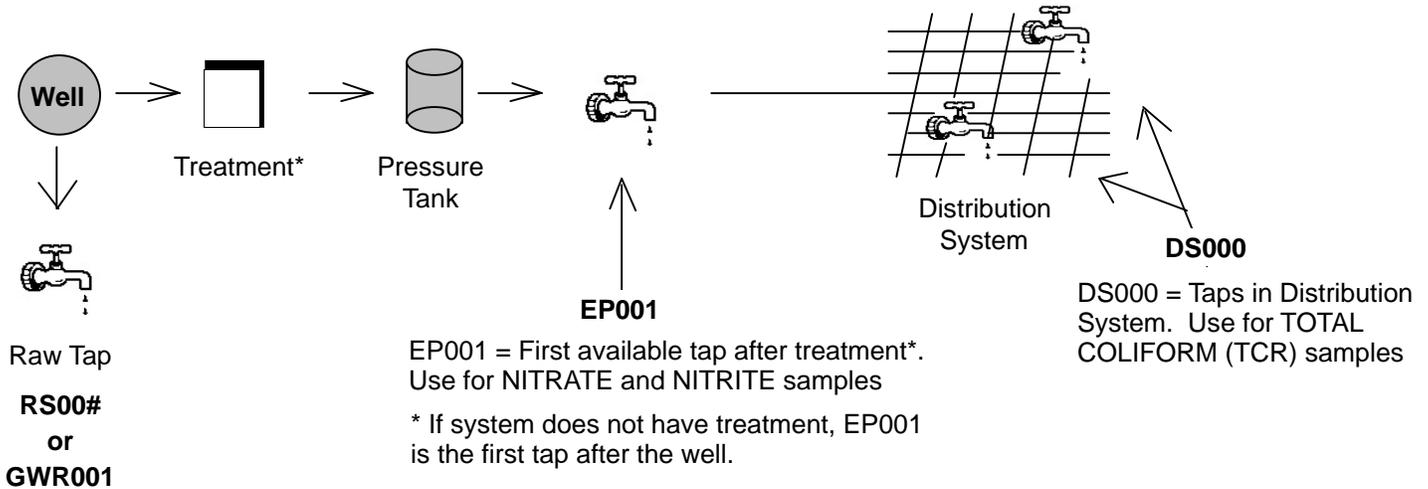

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1564712 SALEM BIBLE CHURCH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **SALEM BIBLE CHURCH DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1560072** Facility Name: **SALEM BIBLE CHURCH**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

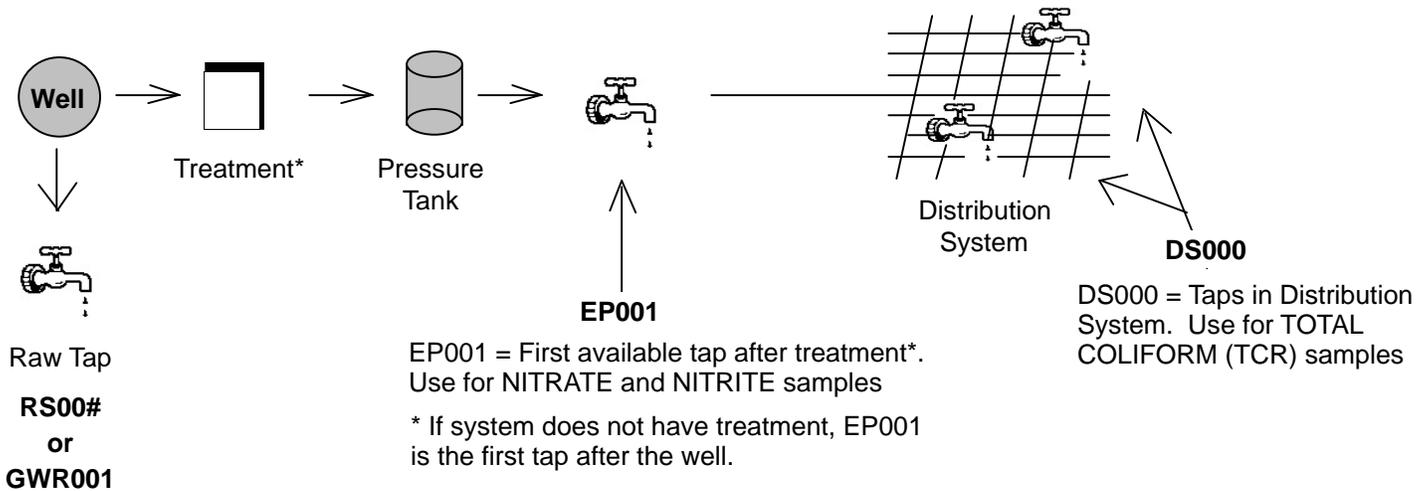

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1564812 EMMANUEL LUTHERAN CHURCH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> EMMANUEL LUTHERAN CHURCH DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1553598	<b>Facility Name:</b> EMMANUEL LUTHERAN CHURCH
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

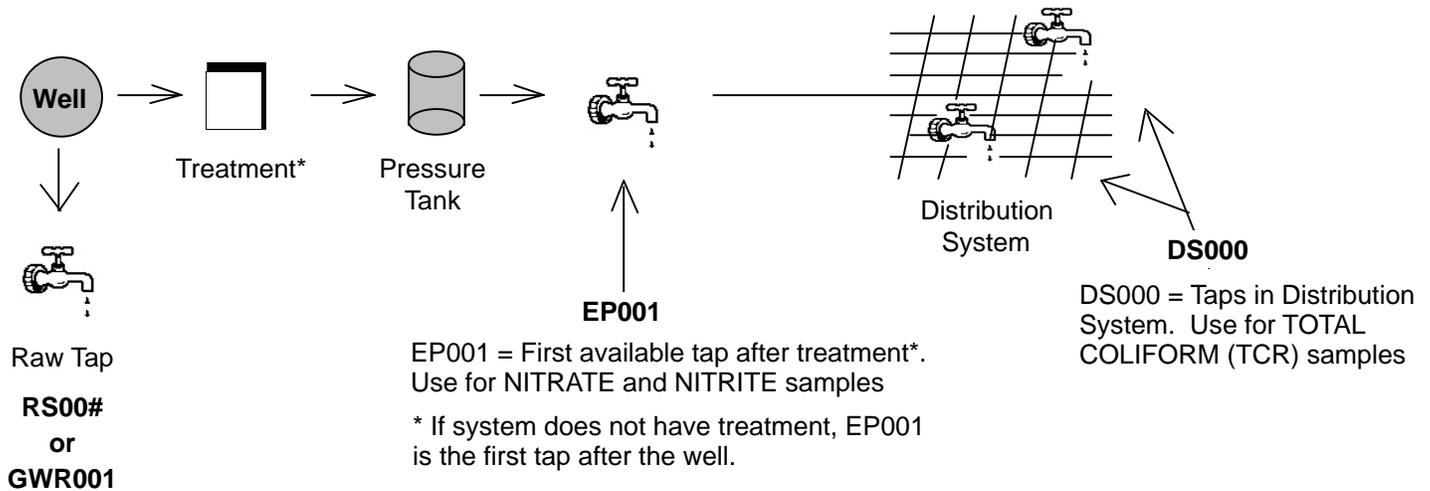

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

**OH1565212 KNOX ELEMENTARY WEST BRANCH PWS**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>1561774</b>	Facility Name: <b>KNOX ELEMENTARY SCHOOL - WEST BRANCH</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>
		Facility Class: <b>CLASS 1</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2015 and 5/31/2015



**OH1565212 KNOX ELEMENTARY WEST BRANCH PWS**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>KNOX ELEMENTARY WEST BRANCH DISTRIE</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2015 and 9/30/2015
-------------------------------	---

*Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>*

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>KNOX ELEMENTARY WEST BRANCH DISTRIE</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

**OH1565512 FELLOWSHIP OF THE BELOVED PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **FELLOWSHIP OF THE BELOVED DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1561922** Facility Name: **FELLOWSHIP OF THE BELOVED**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

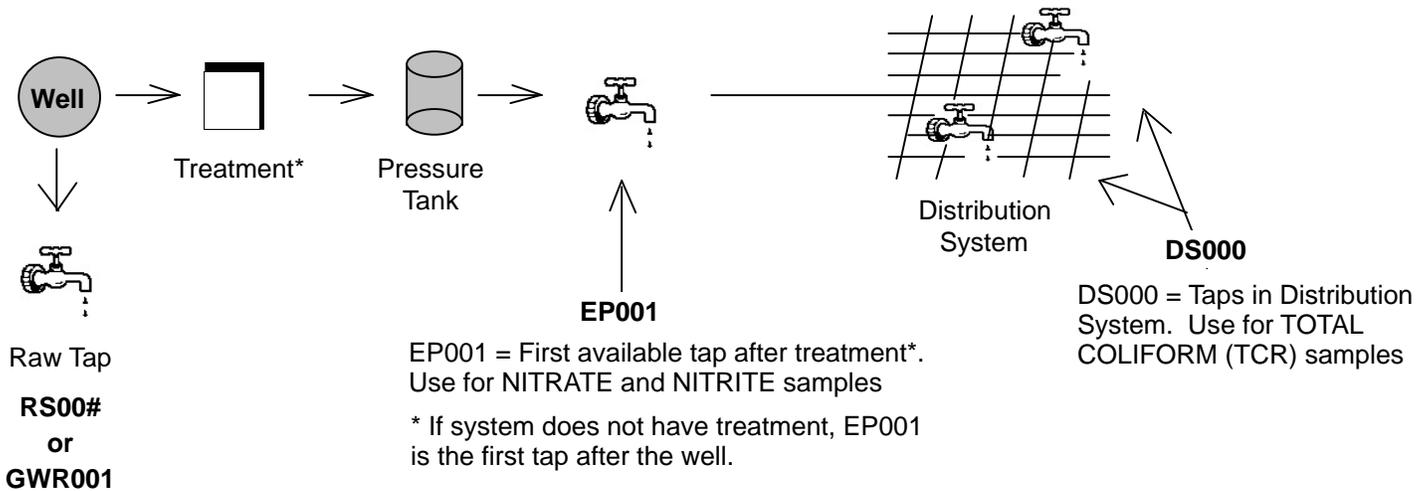

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1565612 TURKANA GOLF PWS**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **TURKANA GOLF DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1562048** Facility Name: **TURKANA GOLF**  
**Location** SMP ID: **EP001** Facility Source:

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

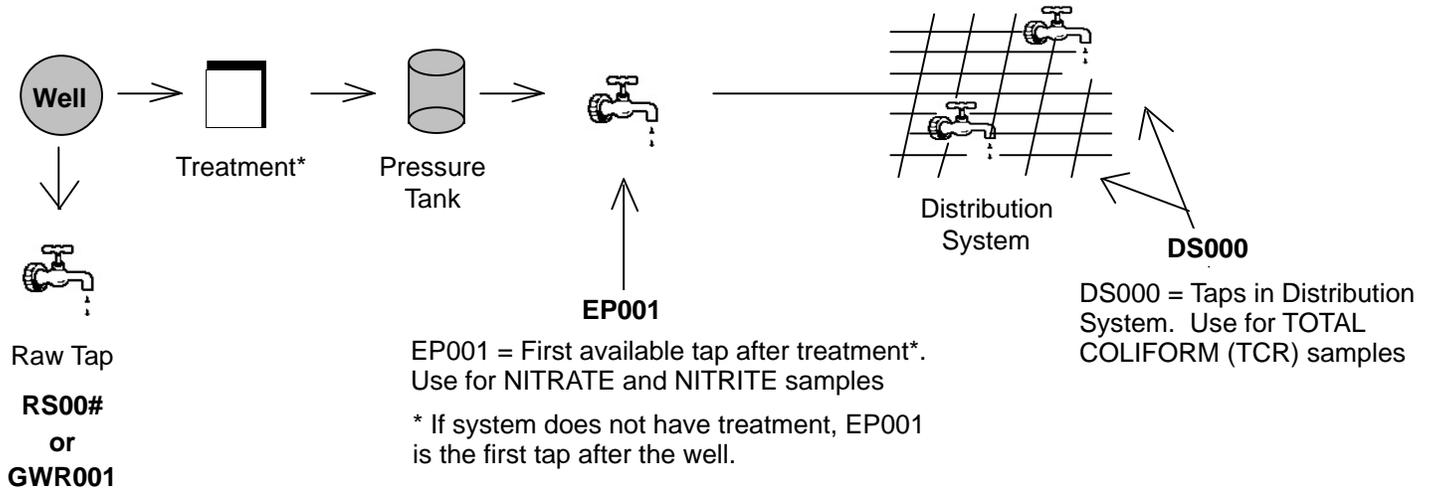

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

**OH1565712 THE WELLSVILLE FOUNDRY INC PWS**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>1562112</b>	Facility Name: <b>THE WELLSVILLE FOUNDRY INC</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>
		Facility Class: <b>CLASS A</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



Effective Date: 01/01/2015

2015 DISTRIBUTION SCHEDULE

**OH1565712 THE WELLSVILLE FOUNDRY INC PWS**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **THE WELLSVILLE FOUNDRY INC DISTRIBUTION**  
**Location** SMP ID: **DS000**

**Chemicals**

**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2015 and 9/30/2015

*Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>*

TOTAL COLIFORM (TCR) - 3100  
1 Sample(s) Required between 1/1/2015 and 3/31/2015  
1 Sample(s) Required between 4/1/2015 and 6/30/2015  
1 Sample(s) Required between 7/1/2015 and 9/30/2015  
1 Sample(s) Required between 10/1/2015 and 12/31/2015

**OH1566012 DOLLAR GENERAL-ROGERS PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **DOLLAR GENERAL STORE DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **1562428** Facility Name: **DOLLAR GENERAL-ROGERS**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

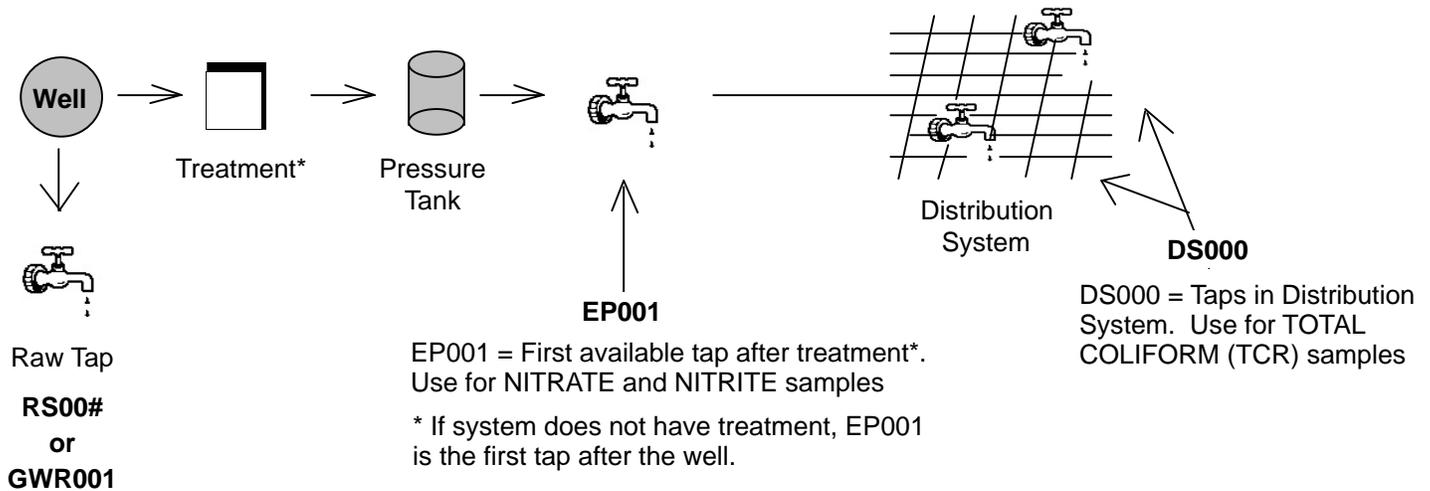

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH1566112 CHURCH OF JESUS CHRIST-NEGLEY PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> CHURCH OF JESUS CHRIST-NEGLEY DISTRIBUTI
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1562450	<b>Facility Name:</b> CHURCH OF JESUS CHRIST-NEGLEY
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

**Where to Collect Samples For a Small Public Water System**

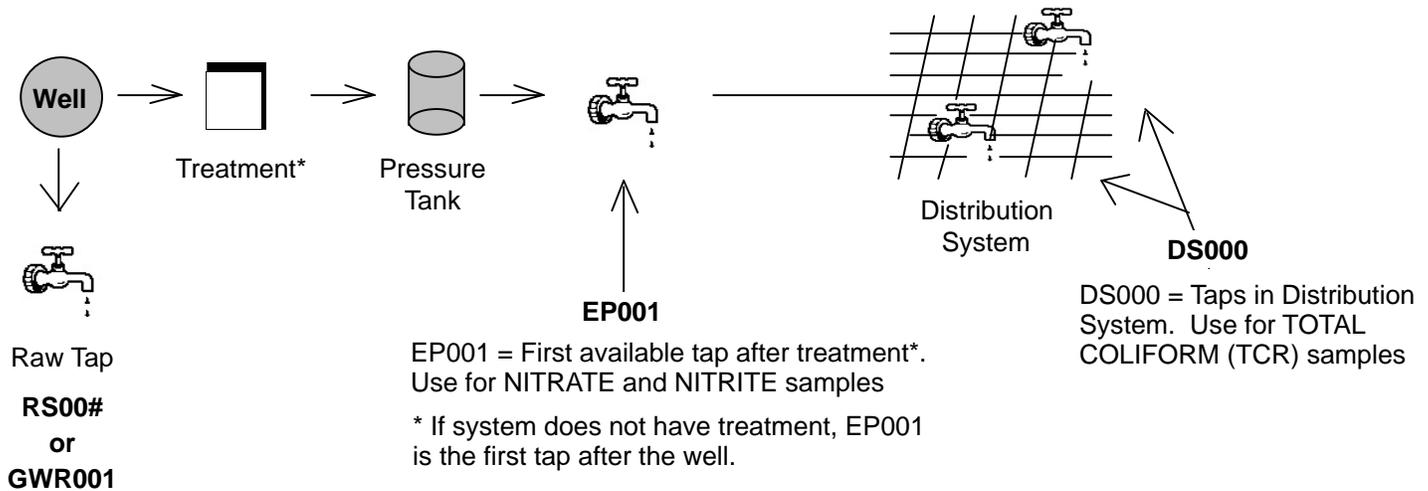

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

OH1566212 BUCKEYE TRANSFER INC

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>1562492</b>	Facility Name: <b>BUCKEYE TRANSFER INC STU 1</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015



**OH1566212 BUCKEYE TRANSFER INC**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>1562493</b>	Facility Name: <b>BUCKEYE TRANSFER INC STU 2</b>
<b>Location</b>	SMP ID: <b>EP002</b>	Facility Source: <b>Ground Water</b>
		Facility Class: <b>CLASS A</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015



**OH1566212 BUCKEYE TRANSFER INC**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>BUCKEYE TRANSFER INC DISTRIBUTION</b>
	SMP ID: <b>DS000</b>	

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2015 and 9/30/2015
-------------------------------	---

*Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>*

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>BUCKEYE TRANSFER INC DISTRIBUTION</b>
	SMP ID: <b>DS201</b>	<b>ADDRESS NOT KNOWN</b>

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH1566312 COLUMBIANA COUNTY-COUNTY HOME RD PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: COLUMBIANA COUNTY-COUNTY HOME RD D Facility Class: CLASS 1
Location SMP ID: DS000

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2015 and 9/30/2015

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: http://epa.ohio.gov/ddagw/reporting.aspx

TOTAL COLIFORM (TCR) - 3100 1 Sample(s) Required between 1/1/2015 and 1/31/2015
1 Sample(s) Required between 2/1/2015 and 2/28/2015
1 Sample(s) Required between 3/1/2015 and 3/31/2015
1 Sample(s) Required between 4/1/2015 and 4/30/2015
1 Sample(s) Required between 5/1/2015 and 5/31/2015
1 Sample(s) Required between 6/1/2015 and 6/30/2015
1 Sample(s) Required between 7/1/2015 and 7/31/2015
1 Sample(s) Required between 8/1/2015 and 8/31/2015
1 Sample(s) Required between 9/1/2015 and 9/30/2015
1 Sample(s) Required between 10/1/2015 and 10/31/2015
1 Sample(s) Required between 11/1/2015 and 11/30/2015
1 Sample(s) Required between 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000 1 Sample(s) Required between 1/1/2015 and 1/31/2015
1 Sample(s) Required between 2/1/2015 and 2/28/2015
1 Sample(s) Required between 3/1/2015 and 3/31/2015
1 Sample(s) Required between 4/1/2015 and 4/30/2015
1 Sample(s) Required between 5/1/2015 and 5/31/2015
1 Sample(s) Required between 6/1/2015 and 6/30/2015
1 Sample(s) Required between 7/1/2015 and 7/31/2015
1 Sample(s) Required between 8/1/2015 and 8/31/2015
1 Sample(s) Required between 9/1/2015 and 9/30/2015
1 Sample(s) Required between 10/1/2015 and 10/31/2015
1 Sample(s) Required between 11/1/2015 and 11/30/2015
1 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Facility ID: DS1 Facility Name: COLUMBIANA COUNTY-COUNTY HOME RD D Facility Class: CLASS 1
Location SMP ID: DS201 8473 COUNTY HOME ROAD

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 2/8/2015 and 2/14/2015 at SMP: DS201
1 Sample(s) Required between 5/8/2015 and 5/14/2015 at SMP: DS201
1 Sample(s) Required between 8/8/2015 and 8/14/2015 at SMP: DS201
1 Sample(s) Required between 11/8/2015 and 11/14/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

**OH1566512 UTICA EAST OHIO MIDSTREAM LLC PWS**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>1562497</b>	Facility Name: <b>UTICA EAST OHIO MIDSTREAM LLC</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>
		Facility Class: <b>CLASS A</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2015 and 5/31/2015



Effective Date: 01/01/2015

2015 DISTRIBUTION SCHEDULE

**OH1566512 UTICA EAST OHIO MIDSTREAM LLC PWS**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>UTICA EAST OHIO MIDSTREAM LLC DISTRIBI</b>
	SMP ID: <b>DS000</b>	

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2015 and 9/30/2015
<i>Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <a href="http://epa.ohio.gov/ddagw/reporting.aspx">http://epa.ohio.gov/ddagw/reporting.aspx</a></i>	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015