



OH0300112 ASHLAND CITY

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 352711	Facility Name: ASHLAND CITY	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS 3

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2016 and 5/31/2016



OH0300112 ASHLAND CITY

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: ASHLAND, CITY OF DISTRIBUTION	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	20 Sample(s) Required between	1/1/2016	and	1/31/2016
	20 Sample(s) Required between	2/1/2016	and	2/29/2016
	20 Sample(s) Required between	3/1/2016	and	3/31/2016
	20 Sample(s) Required between	4/1/2016	and	4/30/2016
	20 Sample(s) Required between	5/1/2016	and	5/31/2016
	20 Sample(s) Required between	6/1/2016	and	6/30/2016
	20 Sample(s) Required between	7/1/2016	and	7/31/2016
	20 Sample(s) Required between	8/1/2016	and	8/31/2016
	20 Sample(s) Required between	9/1/2016	and	9/30/2016
	20 Sample(s) Required between	10/1/2016	and	10/31/2016
	20 Sample(s) Required between	11/1/2016	and	11/30/2016
	20 Sample(s) Required between	12/1/2016	and	12/31/2016

TOTAL CHLORINE - 1000	20 Sample(s) Required between	1/1/2016	and	1/31/2016
	20 Sample(s) Required between	2/1/2016	and	2/29/2016
	20 Sample(s) Required between	3/1/2016	and	3/31/2016
	20 Sample(s) Required between	4/1/2016	and	4/30/2016
	20 Sample(s) Required between	5/1/2016	and	5/31/2016
	20 Sample(s) Required between	6/1/2016	and	6/30/2016
	20 Sample(s) Required between	7/1/2016	and	7/31/2016
	20 Sample(s) Required between	8/1/2016	and	8/31/2016
	20 Sample(s) Required between	9/1/2016	and	9/30/2016
	20 Sample(s) Required between	10/1/2016	and	10/31/2016
	20 Sample(s) Required between	11/1/2016	and	11/30/2016
	20 Sample(s) Required between	12/1/2016	and	12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: ASHLAND, CITY OF DISTRIBUTION 1373 FAULTLESS DRIVE	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between	1/1/2016	and	1/7/2016 at SMP: DS201
	1 Sample(s) Required between	4/1/2016	and	4/7/2016 at SMP: DS201
	1 Sample(s) Required between	7/1/2016	and	7/7/2016 at SMP: DS201



OH0300112 ASHLAND CITY

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: ASHLAND, CITY OF DISTRIBUTION 1373 FAULTLESS DRIVE	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 10/1/2016 and 10/7/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: ASHLAND, CITY OF DISTRIBUTION 2163 CLAREMONT AVENUE	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 1/1/2016 and 1/7/2016 at SMP: DS202

1 Sample(s) Required between 4/1/2016 and 4/7/2016 at SMP: DS202

1 Sample(s) Required between 7/1/2016 and 7/7/2016 at SMP: DS202

1 Sample(s) Required between 10/1/2016 and 10/7/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS203	Facility Name: ASHLAND, CITY OF DISTRIBUTION 1360 SMITH ROAD	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 1/1/2016 and 1/7/2016 at SMP: DS203

1 Sample(s) Required between 4/1/2016 and 4/7/2016 at SMP: DS203

1 Sample(s) Required between 7/1/2016 and 7/7/2016 at SMP: DS203

1 Sample(s) Required between 10/1/2016 and 10/7/2016 at SMP: DS203

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS204	Facility Name: ASHLAND, CITY OF DISTRIBUTION 2115 SOUTH BANEY ROAD	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 1/1/2016 and 1/7/2016 at SMP: DS204

1 Sample(s) Required between 4/1/2016 and 4/7/2016 at SMP: DS204

1 Sample(s) Required between 7/1/2016 and 7/7/2016 at SMP: DS204

1 Sample(s) Required between 10/1/2016 and 10/7/2016 at SMP: DS204

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

OH0300212 ASHLAND COUNTY SERVICE CENTER

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 352712	Facility Name: ASHLAND COUNTY SERVICE CENTER
Location	SMP ID: EP001	Facility Source: Ground Water Facility Class: CLASS A

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2016 and 5/31/2016



OH0300212 ASHLAND COUNTY SERVICE CENTER

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **ASHLAND COUNTY SERVICE CNTR DS**
SMP ID: **DS000**

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2016 and 9/30/2016

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

TOTAL COLIFORM (TCR) - 3100
1 Sample(s) Required between 1/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 12/31/2016

Sampling Location Facility ID: **DS1** Facility Name: **ASHLAND COUNTY SERVICE CNTR DS**
SMP ID: **DS201** ADDRESS NOT KNOWN

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH0300312 BAILEY LAKES VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: BAILEY LAKES, VILLAGE OF DISTRIBUTION Facility Class: CLASS 1
Location SMP ID: DS000

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

TOTAL COLIFORM (TCR) - 3100 1 Sample(s) Required between 1/1/2016 and 1/31/2016
1 Sample(s) Required between 2/1/2016 and 2/29/2016
1 Sample(s) Required between 3/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 4/30/2016
1 Sample(s) Required between 5/1/2016 and 5/31/2016
1 Sample(s) Required between 6/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 7/31/2016
1 Sample(s) Required between 8/1/2016 and 8/31/2016
1 Sample(s) Required between 9/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 10/31/2016
1 Sample(s) Required between 11/1/2016 and 11/30/2016
1 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000 1 Sample(s) Required between 1/1/2016 and 1/31/2016
1 Sample(s) Required between 2/1/2016 and 2/29/2016
1 Sample(s) Required between 3/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 4/30/2016
1 Sample(s) Required between 5/1/2016 and 5/31/2016
1 Sample(s) Required between 6/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 7/31/2016
1 Sample(s) Required between 8/1/2016 and 8/31/2016
1 Sample(s) Required between 9/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 10/31/2016
1 Sample(s) Required between 11/1/2016 and 11/30/2016
1 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Facility ID: DS1 Facility Name: BAILEY LAKES, VILLAGE OF DISTRIBUTION Facility Class: CLASS 1
Location SMP ID: DS201 WWTP LAKE DR.

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

OH0300512 GREEN ACRES MHP

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 352715	Facility Name: GREEN ACRES MHP	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS A

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH0300512 GREEN ACRES MHP

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: GREEN ACRES MHP DISTRIBUTION
Location SMP ID: DS000

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2016 and 9/30/2016

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: http://epa.ohio.gov/ddagw/reporting.aspx

TOTAL COLIFORM (TCR) - 3100 1 Sample(s) Required between 3/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 4/30/2016
1 Sample(s) Required between 5/1/2016 and 5/31/2016
1 Sample(s) Required between 6/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 7/31/2016
1 Sample(s) Required between 8/1/2016 and 8/31/2016
1 Sample(s) Required between 9/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 10/31/2016
1 Sample(s) Required between 11/1/2016 and 11/30/2016
1 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000 1 Sample(s) Required between 3/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 4/30/2016
1 Sample(s) Required between 5/1/2016 and 5/31/2016
1 Sample(s) Required between 6/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 7/31/2016
1 Sample(s) Required between 8/1/2016 and 8/31/2016
1 Sample(s) Required between 9/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 10/31/2016
1 Sample(s) Required between 11/1/2016 and 11/30/2016
1 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Facility ID: DS1 Facility Name: GREEN ACRES MHP DISTRIBUTION
Location SMP ID: DS201 ADDRESS NOT KNOWN

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



OH0300712 HAYESVILLE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 352716	Facility Name: HAYESVILLE VILLAGE	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH0300712 HAYESVILLE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: HAYESVILLE, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 1/31/2016
	1 Sample(s) Required between 2/1/2016 and 2/29/2016
	1 Sample(s) Required between 3/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 4/30/2016
	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 10/31/2016
	1 Sample(s) Required between 11/1/2016 and 11/30/2016
	1 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2016 and 1/31/2016
	1 Sample(s) Required between 2/1/2016 and 2/29/2016
	1 Sample(s) Required between 3/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 4/30/2016
	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 10/31/2016
	1 Sample(s) Required between 11/1/2016 and 11/30/2016
	1 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: HAYESVILLE, VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

OH0300812 HIDDEN ACRES MHP

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 352717	Facility Name: HIDDEN ACRES MHP	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS A

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH0300812 HIDDEN ACRES MHP

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: HIDDEN ACRES MHP DISTRIBUTION
Location SMP ID: DS000

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022

Not Required

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between 1/1/2016 and 1/31/2016
1 Sample(s) Required between 2/1/2016 and 2/29/2016
1 Sample(s) Required between 3/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 4/30/2016
1 Sample(s) Required between 5/1/2016 and 5/31/2016
1 Sample(s) Required between 6/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 7/31/2016
1 Sample(s) Required between 8/1/2016 and 8/31/2016
1 Sample(s) Required between 9/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 10/31/2016
1 Sample(s) Required between 11/1/2016 and 11/30/2016
1 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000

1 Sample(s) Required between 1/1/2016 and 1/31/2016
1 Sample(s) Required between 2/1/2016 and 2/29/2016
1 Sample(s) Required between 3/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 4/30/2016
1 Sample(s) Required between 5/1/2016 and 5/31/2016
1 Sample(s) Required between 6/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 7/31/2016
1 Sample(s) Required between 8/1/2016 and 8/31/2016
1 Sample(s) Required between 9/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 10/31/2016
1 Sample(s) Required between 11/1/2016 and 11/30/2016
1 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Facility ID: DS1 Facility Name: HIDDEN ACRES MHP DISTRIBUTION
Location SMP ID: DS201 ADDRESS NOT KNOWN

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

OH0300912 JEROMESVILLE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 352718	Facility Name: JEROMESVILLE WTP	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH0300912 JEROMESVILLE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **JEROMESVILLE, VILLAGE OF DISTRIBUTION** Facility Class: **CLASS 1**
SMP ID: **DS000**

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

TOTAL COLIFORM (TCR) - 3100
1 Sample(s) Required between 1/1/2016 and 1/31/2016
1 Sample(s) Required between 2/1/2016 and 2/29/2016
1 Sample(s) Required between 3/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 4/30/2016
1 Sample(s) Required between 5/1/2016 and 5/31/2016
1 Sample(s) Required between 6/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 7/31/2016
1 Sample(s) Required between 8/1/2016 and 8/31/2016
1 Sample(s) Required between 9/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 10/31/2016
1 Sample(s) Required between 11/1/2016 and 11/30/2016
1 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000
1 Sample(s) Required between 1/1/2016 and 1/31/2016
1 Sample(s) Required between 2/1/2016 and 2/29/2016
1 Sample(s) Required between 3/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 4/30/2016
1 Sample(s) Required between 5/1/2016 and 5/31/2016
1 Sample(s) Required between 6/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 7/31/2016
1 Sample(s) Required between 8/1/2016 and 8/31/2016
1 Sample(s) Required between 9/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 10/31/2016
1 Sample(s) Required between 11/1/2016 and 11/30/2016
1 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: **DS1** Facility Name: **JEROMESVILLE, VILLAGE OF DISTRIBUTION** Facility Class: **CLASS 1**
SMP ID: **DS201** ADDRESS NOT KNOWN

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

OH0300912 JEROMESVILLE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: JEROMESVILLE, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
	SMP ID: DS202	ADDRESS NOT KNOWN	

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH0301012 LOUDONVILLE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 352719	Facility Name: LOUDONVILLE WTP	Facility Class: CLASS 2
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.
 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
 Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
ARSENIC - 1005	1 Sample(s) Required between 1/1/2016 and 3/31/2016 1 Sample(s) Required between 4/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 9/30/2016 1 Sample(s) Required between 10/1/2016 and 12/31/2016
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH0301012 LOUDONVILLE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: LOUDONVILLE, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

TOTAL COLIFORM (TCR) - 3100	3 Sample(s) Required between 1/1/2016 and 1/31/2016
	3 Sample(s) Required between 2/1/2016 and 2/29/2016
	3 Sample(s) Required between 3/1/2016 and 3/31/2016
	3 Sample(s) Required between 4/1/2016 and 4/30/2016
	3 Sample(s) Required between 5/1/2016 and 5/31/2016
	3 Sample(s) Required between 6/1/2016 and 6/30/2016
	3 Sample(s) Required between 7/1/2016 and 7/31/2016
	3 Sample(s) Required between 8/1/2016 and 8/31/2016
	3 Sample(s) Required between 9/1/2016 and 9/30/2016
	3 Sample(s) Required between 10/1/2016 and 10/31/2016
	3 Sample(s) Required between 11/1/2016 and 11/30/2016
	3 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000	3 Sample(s) Required between 1/1/2016 and 1/31/2016
	3 Sample(s) Required between 2/1/2016 and 2/29/2016
	3 Sample(s) Required between 3/1/2016 and 3/31/2016
	3 Sample(s) Required between 4/1/2016 and 4/30/2016
	3 Sample(s) Required between 5/1/2016 and 5/31/2016
	3 Sample(s) Required between 6/1/2016 and 6/30/2016
	3 Sample(s) Required between 7/1/2016 and 7/31/2016
	3 Sample(s) Required between 8/1/2016 and 8/31/2016
	3 Sample(s) Required between 9/1/2016 and 9/30/2016
	3 Sample(s) Required between 10/1/2016 and 10/31/2016
	3 Sample(s) Required between 11/1/2016 and 11/30/2016
	3 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: LOUDONVILLE, VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

OH0301012 LOUDONVILLE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: LOUDONVILLE, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
	SMP ID: DS202	ADDRESS NOT KNOWN	

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

OH0301112 TRI-STATE YOUTH ACADEMY

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 352720 SMP ID: EP001	Facility Name: ODYS MOHICAN JUVENILE CORRECTIONAL Facility Source: Ground Water	Facility Class: CLASS 1
--------------------------	--	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH0301112 TRI-STATE YOUTH ACADEMY

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: ODYS-MOHICAN JUVENILE CORRECTIONAL Facility Class: CLASS 1
Location SMP ID: DS000

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2016 and 9/30/2016

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: http://epa.ohio.gov/ddagw/reporting.aspx

TOTAL COLIFORM (TCR) - 3100 1 Sample(s) Required between 1/1/2016 and 1/31/2016
1 Sample(s) Required between 2/1/2016 and 2/29/2016
1 Sample(s) Required between 3/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 4/30/2016
1 Sample(s) Required between 5/1/2016 and 5/31/2016
1 Sample(s) Required between 6/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 7/31/2016
1 Sample(s) Required between 8/1/2016 and 8/31/2016
1 Sample(s) Required between 9/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 10/31/2016
1 Sample(s) Required between 11/1/2016 and 11/30/2016
1 Sample(s) Required between 12/1/2016 and 12/31/2016

Sampling Facility ID: DS1 Facility Name: ODYS-MOHICAN JUVENILE CORRECTIONAL Facility Class: CLASS 1
Location SMP ID: DS201 ODYS-MOHICAN JUVENILE CORRE(

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

OH0301212 PERRYSVILLE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 352721	Facility Name: PERRYSVILLE TP	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH0301212 PERRYVILLE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: PERRYVILLE, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 1/31/2016
	1 Sample(s) Required between 2/1/2016 and 2/29/2016
	1 Sample(s) Required between 3/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 4/30/2016
	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 10/31/2016
	1 Sample(s) Required between 11/1/2016 and 11/30/2016
	1 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2016 and 1/31/2016
	1 Sample(s) Required between 2/1/2016 and 2/29/2016
	1 Sample(s) Required between 3/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 4/30/2016
	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 10/31/2016
	1 Sample(s) Required between 11/1/2016 and 11/30/2016
	1 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: PERRYVILLE, VILLAGE OF DISTRIBUTION 164 WEST 2ND ST.	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

OH0301212 PERRYSVILLE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: PERRYSVILLE, VILLAGE OF DISTRIBUTION 123 WELTMEN CIRCLE	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

OH0301312 MOHICAN RIVER ESTATES

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 352722	Facility Name: MOHICAN RIVER ESTATES WWTP
Location	SMP ID: EP001	Facility Source: Ground Water Facility Class: CLASS A

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH0301312 MOHICAN RIVER ESTATES

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: MOHICAN RIVER ESTATES DISTRIBUTION
	SMP ID: DS000	

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 1/31/2016
	1 Sample(s) Required between 2/1/2016 and 2/29/2016
	1 Sample(s) Required between 3/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 4/30/2016
	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 10/31/2016
	1 Sample(s) Required between 11/1/2016 and 11/30/2016
	1 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2016 and 1/31/2016
	1 Sample(s) Required between 2/1/2016 and 2/29/2016
	1 Sample(s) Required between 3/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 4/30/2016
	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 10/31/2016
	1 Sample(s) Required between 11/1/2016 and 11/30/2016
	1 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: MOHICAN RIVER ESTATES DISTRIBUTION
	SMP ID: DS201	3055 COUNTY ROAD 3175

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH0301512 SOUTHWOOD ESTATES

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 361160	Facility Name: SOUTHWOODS ESTATES SUBDIV
Location	SMP ID: EP001	Facility Source: Ground Water
		Facility Class: CLASS A

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2016 and 5/31/2016



OH0301512 SOUTHWOOD ESTATES

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: SOUTHWOOD ESTATESDISTRIBUTION
Location SMP ID: DS000

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2016 and 9/30/2016

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: http://epa.ohio.gov/ddagw/reporting.aspx

TOTAL COLIFORM (TCR) - 3100 1 Sample(s) Required between 1/1/2016 and 1/31/2016
1 Sample(s) Required between 2/1/2016 and 2/29/2016
1 Sample(s) Required between 3/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 4/30/2016
1 Sample(s) Required between 5/1/2016 and 5/31/2016
1 Sample(s) Required between 6/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 7/31/2016
1 Sample(s) Required between 8/1/2016 and 8/31/2016
1 Sample(s) Required between 9/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 10/31/2016
1 Sample(s) Required between 11/1/2016 and 11/30/2016
1 Sample(s) Required between 12/1/2016 and 12/31/2016

Sampling Facility ID: DS1 Facility Name: SOUTHWOOD ESTATESDISTRIBUTION
Location SMP ID: DS201 ADDRESS NOT KNOWN

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950

OH0330112 HIDDEN ACRES CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: HIDDEN ACRES CAMPGROUNDS DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

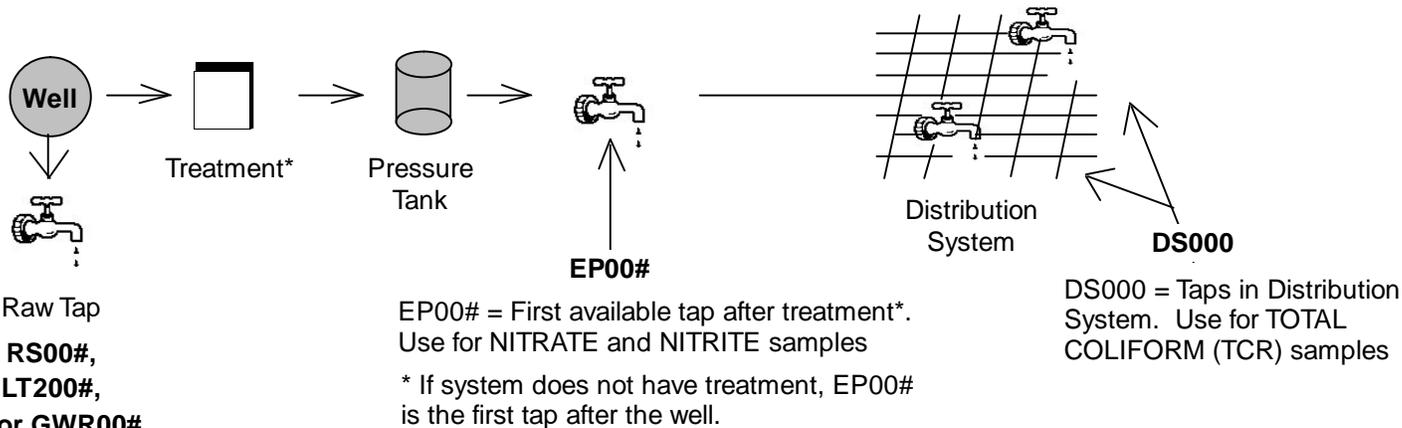

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0330112 HIDDEN ACRES CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 352724

Facility Name: **HIDDEN ACRES CAMPGROUNDS INC**

Location SMP ID: EP001

Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

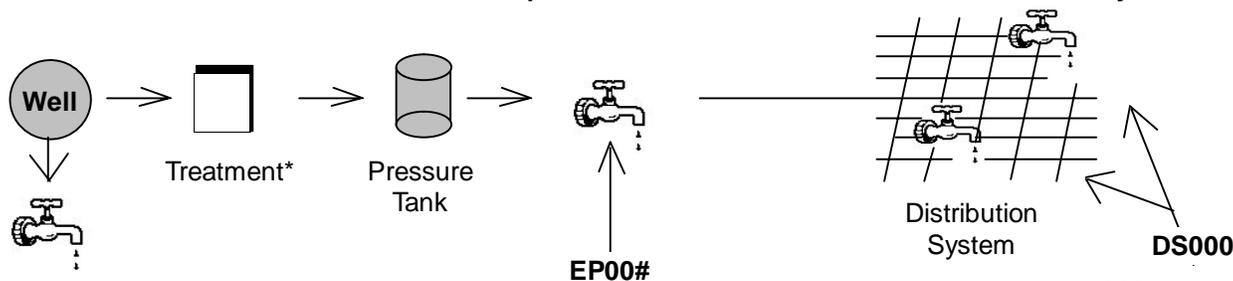

Raw Tap
RS00#,
LT200#,
 or **GWR00#**

EP00# = First available tap after treatment*.
 Use for NITRATE and NITRITE samples
 * If system does not have treatment, EP00#
 is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0330912 ASHLAND-WOOSTER DRIVE-IN

System Type: Transient Noncommunity

Operating Period: 2/1 to 11/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ASHLAND-WOOSTER DRIVE-IN DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

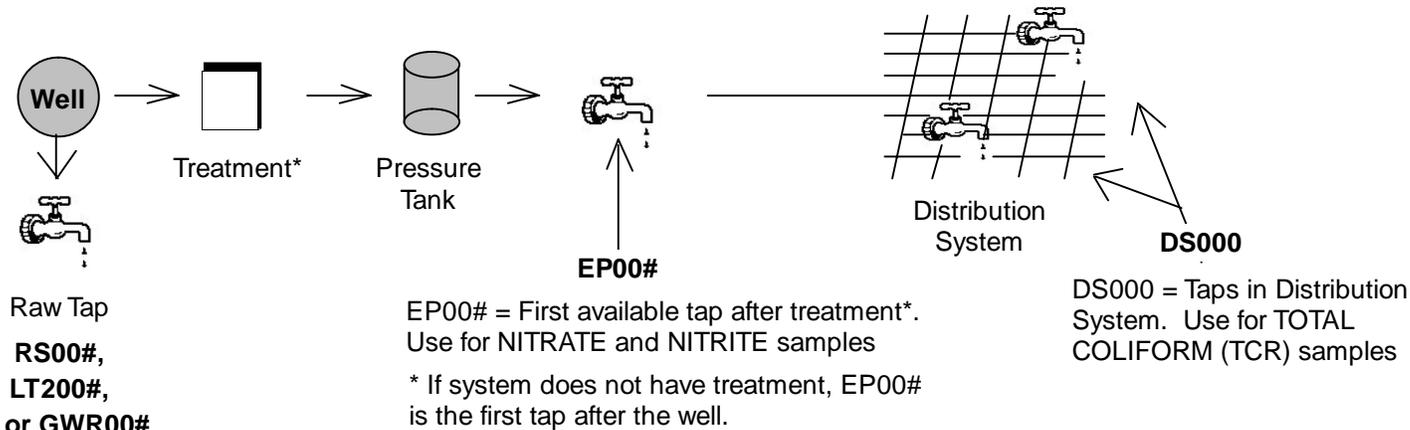

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0330912 ASHLAND-WOOSTER DRIVE-IN

System Type: Transient Noncommunity

Operating Period: 2/1 to 11/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 352726	Facility Name: ASHLAND-WOOSTER DRIVE-IN
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

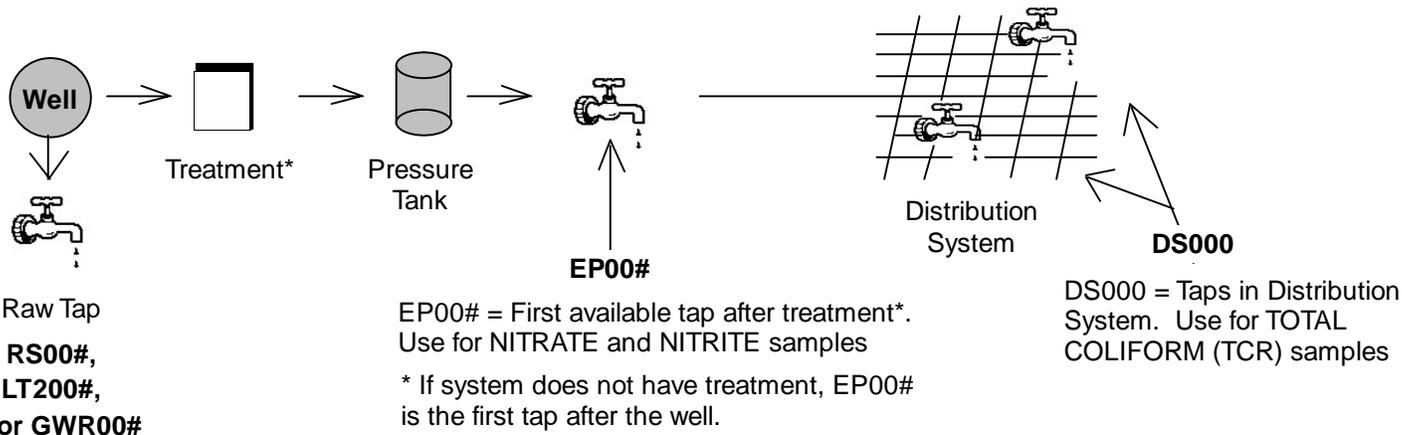

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0331912 MAPLE GROVE CHURCH OF THE BRETHREN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: MAPLE GROVE CHURCH OF BR DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

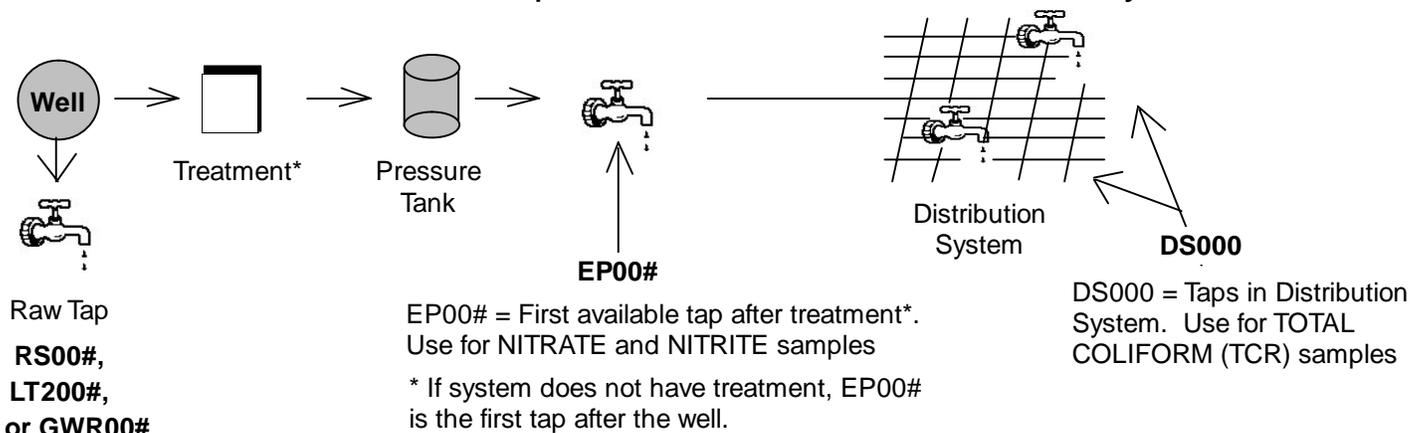

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0331912 MAPLE GROVE CHURCH OF THE BRETHREN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **352730** Facility Name: **MAPLE GROVE CHURCH**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

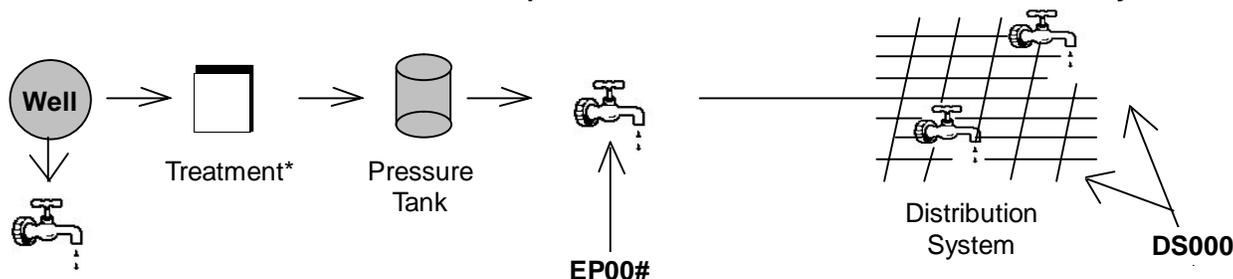

Raw Tap
RS00#,
LT200#,
or **GWR00#**

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples
* If system does not have treatment, EP00#
is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0332612 PERKINS RESTAURANT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: PERKINS FAMILY RESTAURAN DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

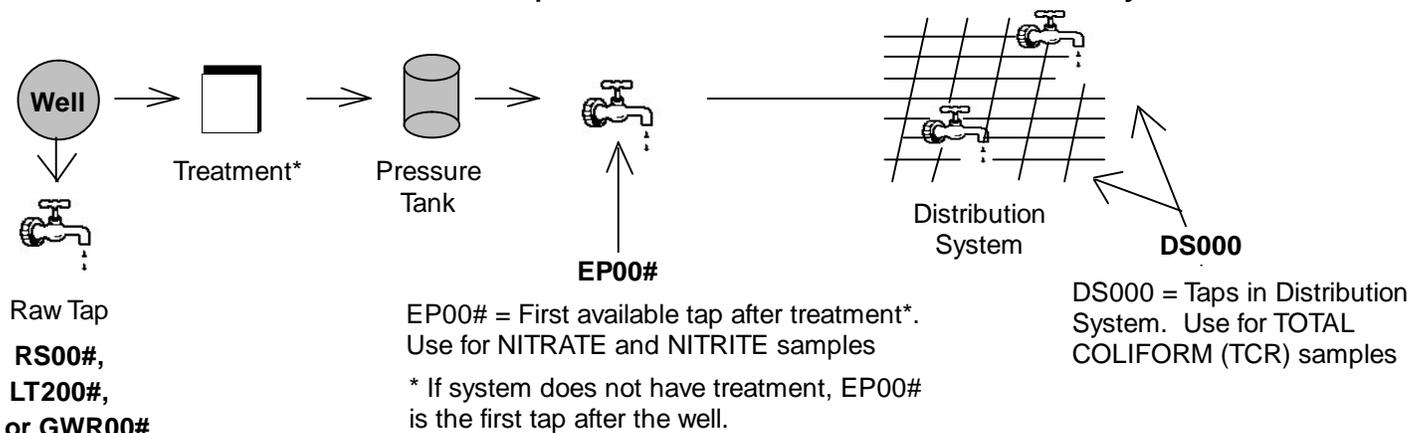

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0332612 PERKINS RESTAURANT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 352733	Facility Name: PERKINS RESTAURANT
Location SMP ID: EP001	Facility Source: Ground Water
Facility Class: CLASS A	

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

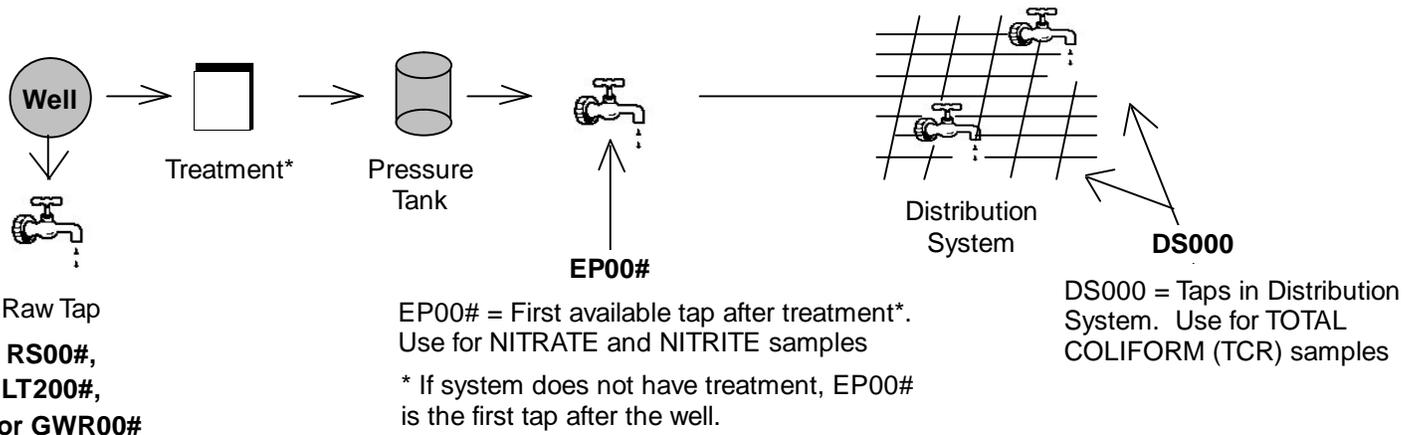

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH0333112 AMERICAN AUGERS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 352734	Facility Name: AMERICAN AUGERS	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.
 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
 Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
ARSENIC - 1005	1 Sample(s) Required between 1/1/2016 and 3/31/2016 1 Sample(s) Required between 4/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 9/30/2016 1 Sample(s) Required between 10/1/2016 and 12/31/2016
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH0333112 AMERICAN AUGERS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **AMERICAN AUGERS DISTRIBUTION**
SMP ID: **DS000**

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2016 and 9/30/2016

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

TOTAL COLIFORM (TCR) - 3100
1 Sample(s) Required between 1/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 12/31/2016



OH0334612 ASHLAND CO WEST HOLMES CAREER CENTER

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 352741	Facility Name: ASHLAND CO WEST HOLMES	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.
 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
 Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	1 Sample(s) Required between 1/1/2016 and 5/31/2016
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH0334612 ASHLAND CO WEST HOLMES CAREER CENTER

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **ASH CO-WEST HOLMES CAREE DISTRIBUTI** Facility Class: **CLASS 1**
SMP ID: **DS000**

Chemicals **Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 Not Required

TOTAL COLIFORM (TCR) - 3100
1 Sample(s) Required between 1/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000
1 Sample(s) Required between 1/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: **DS1** Facility Name: **ASH CO-WEST HOLMES CAREE DISTRIBUTI** Facility Class: **CLASS 1**
SMP ID: **DS201** ADDRESS NOT KNOWN

Chemicals **Monitoring Requirements**

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH0335012 MWCD-CM PARK-CM5

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: MWCD-CM PARK-CM5 DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

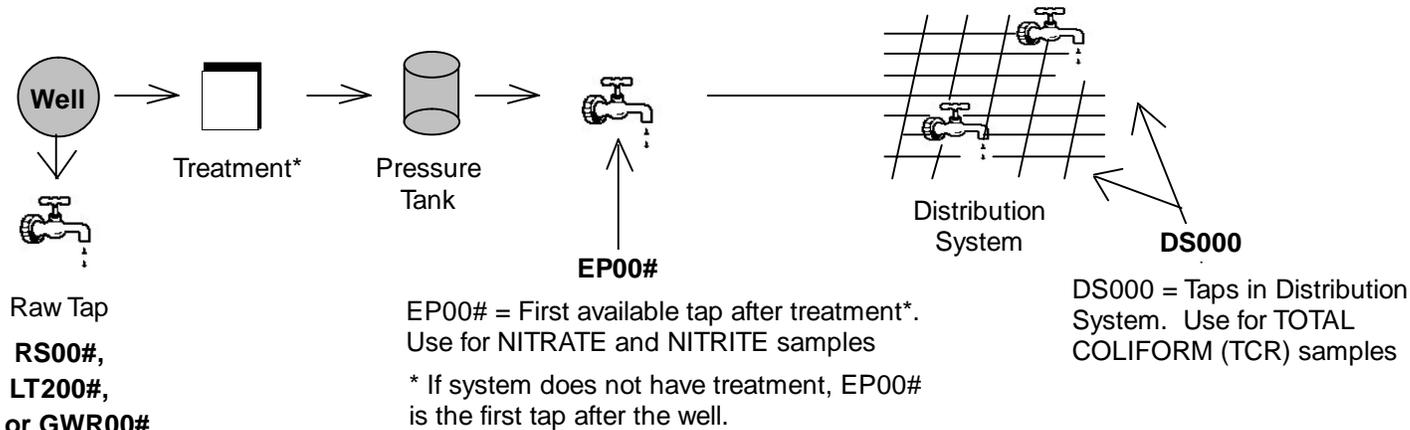

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0335012 MWCD-CM PARK-CM5

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 352745	Facility Name: MWCD CM PARK CM5
Location SMP ID: EP001	Facility Source: Ground Water
	Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

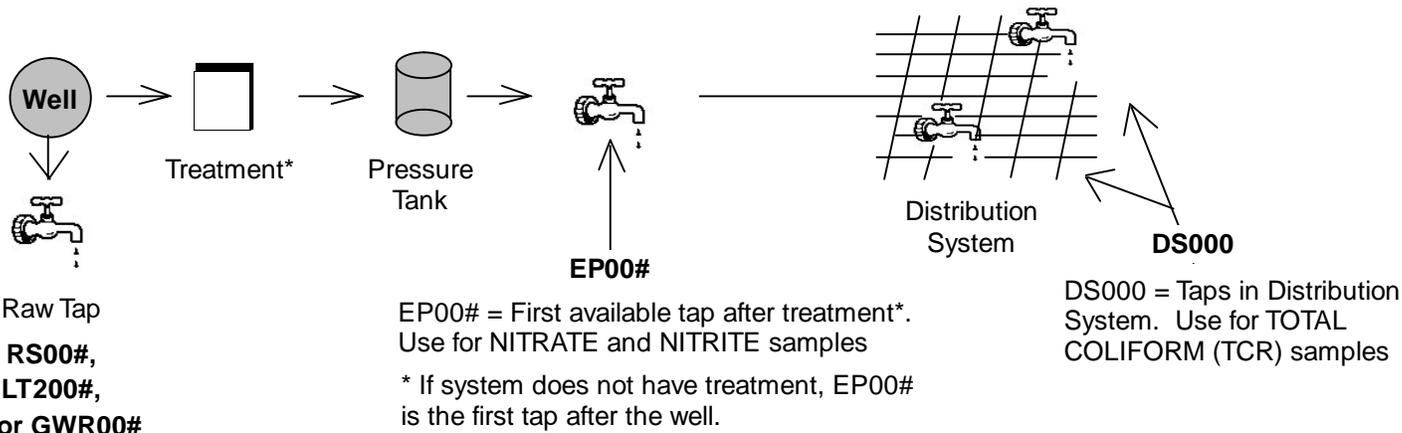

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0335712 ODNR-DIV OF FORESTRY/SHRINE AREA

System Type: Transient Noncommunity

Operating Period: 3/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ODNR-MEM SHR/MOHICAN FOR DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

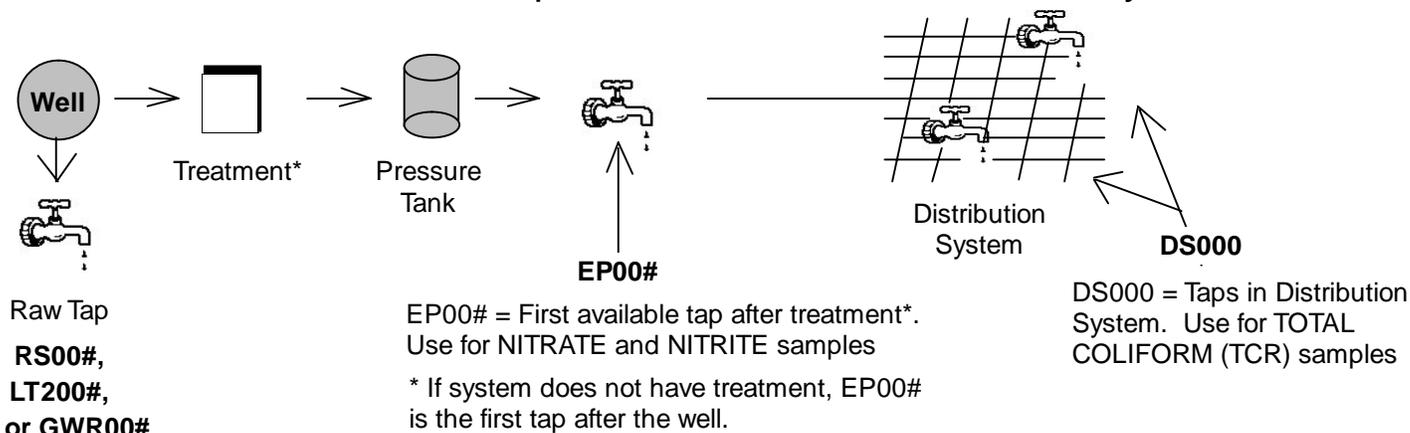

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0335712 ODNR-DIV OF FORESTRY/SHRINE AREA

System Type: Transient Noncommunity

Operating Period: 3/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 352750 Facility Name: ODNR MEM SHR MOHICAN FOREST

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

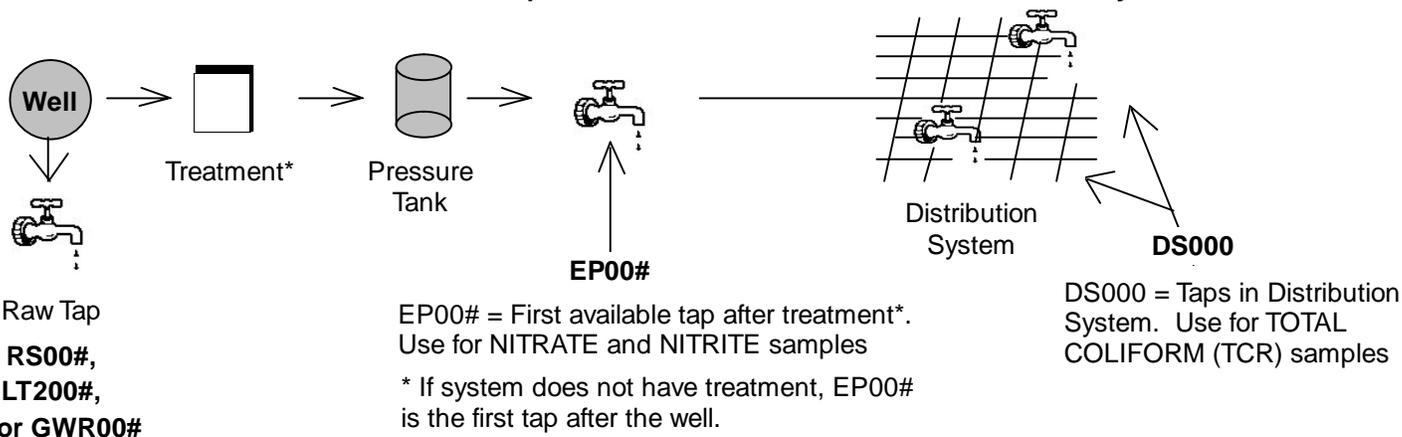

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0335912 ODNR-MOHICAN ST PK-HEMLOCK GROVE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ODNR-MOHICAN ST PK-HEMLO DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

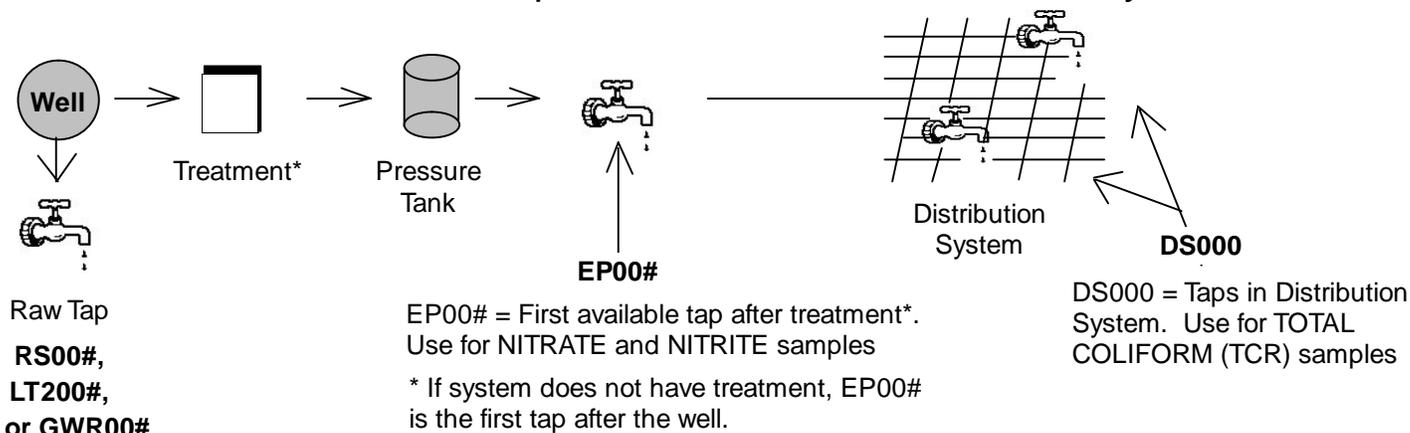

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0335912 ODNR-MOHICAN ST PK-HEMLOCK GROVE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 352752	Facility Name: ODNR MOHICAN ST PK HEMLOCK GRO
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

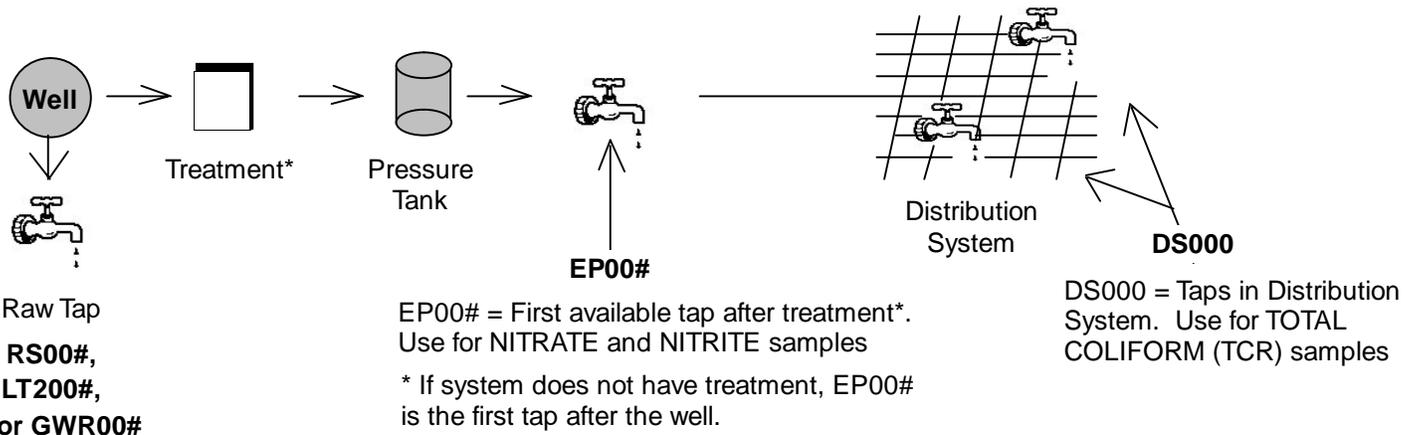

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0336012 ODNR-MOHICAN STATE FOREST/GROUP CAMP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ODNR-MOHICAN FOREST/PK GRP CAMP DISTRIBU
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

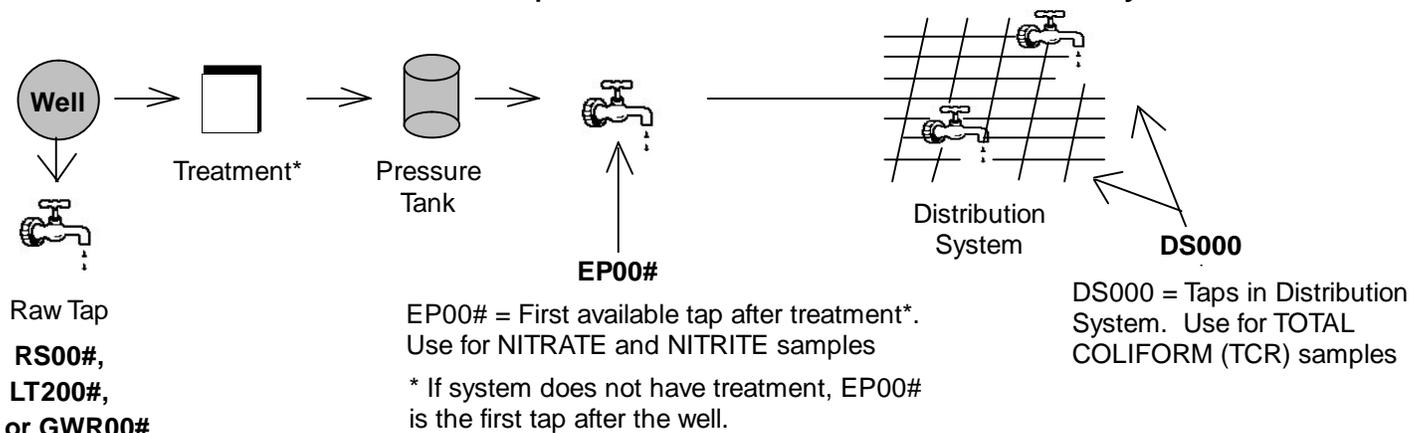

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0336012 ODNR-MOHICAN STATE FOREST/GROUP CAMP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 352753	Facility Name: ODNR MOHICAN STATE PARK GROUP CAMP
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

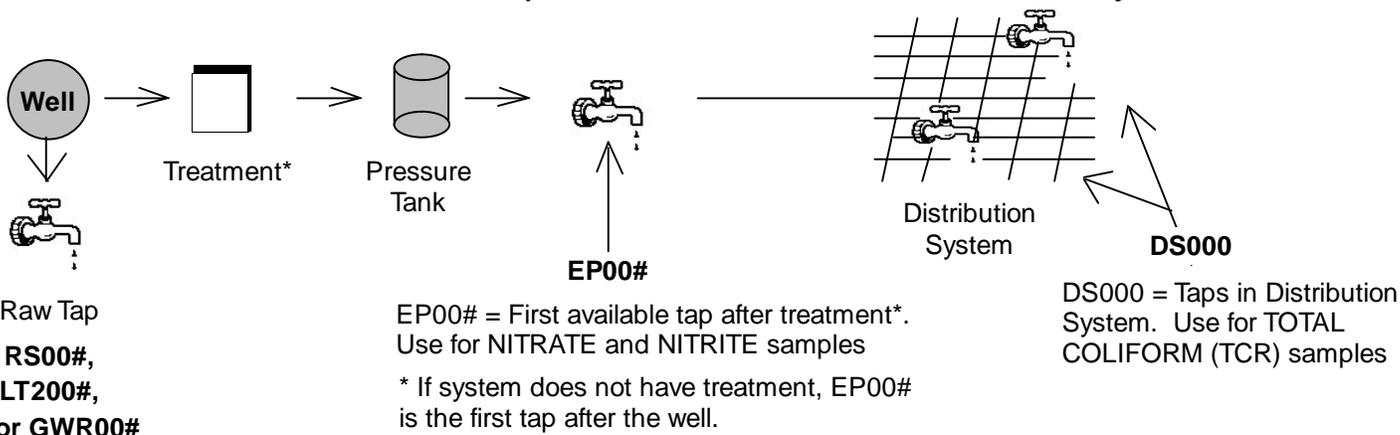

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0336612 RIVER RUN FAMILY CAMPGROUND 1 PWS

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: RIVER RUN FMLY CMPGRD 1 DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 9/30/2016

Where to Collect Samples For a Small Public Water System

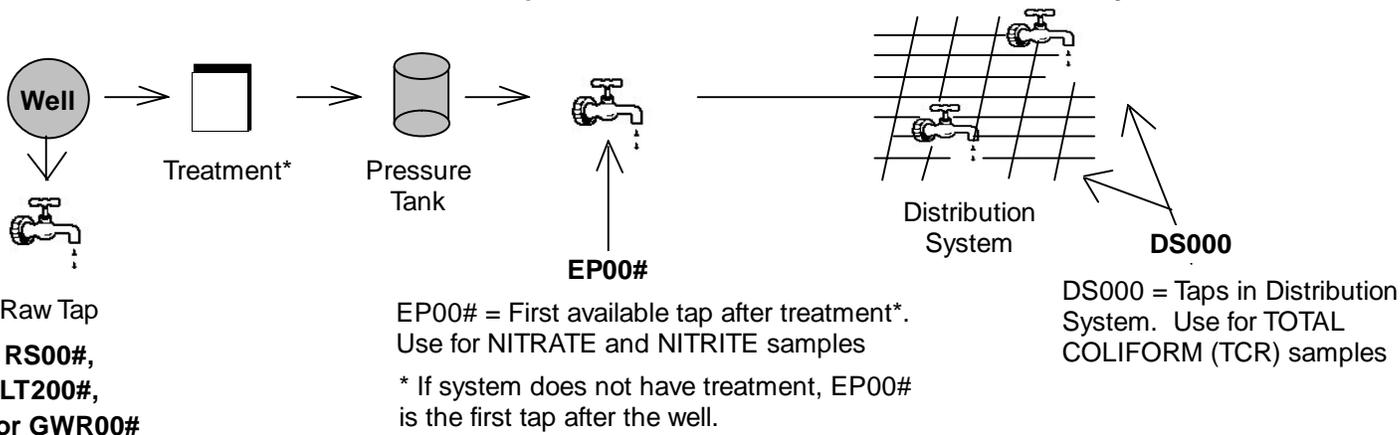

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0336612 RIVER RUN FAMILY CAMPGROUND 1 PWS

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 352759	Facility Name: RIVER RUN CAMPGROUND WELL 1
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

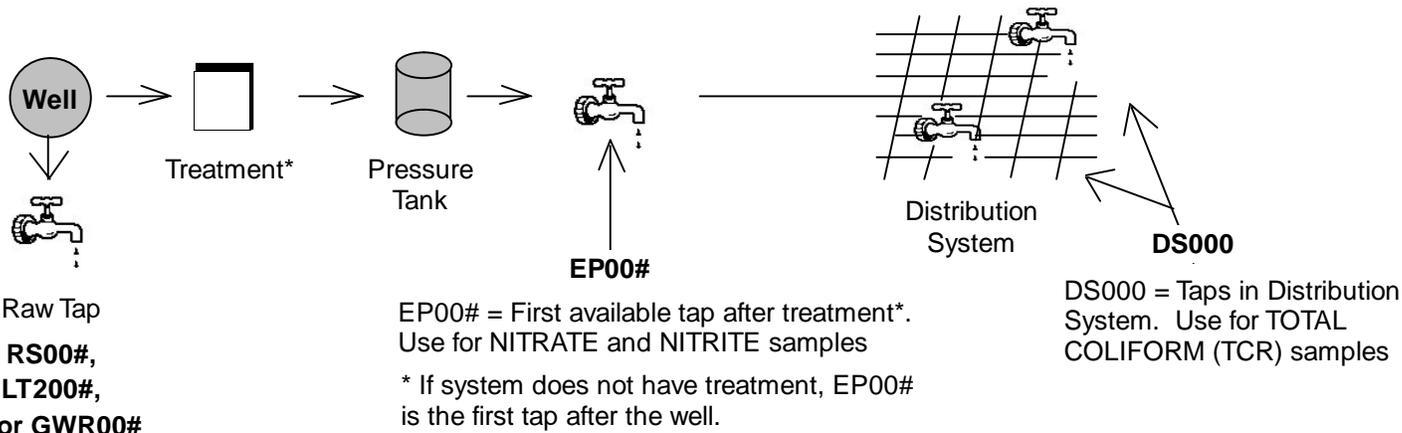

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0336912 HICKORY LAKE CAMPGROUND D-AREA

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: HICKORY LAKE - D AREA DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 4/30/2016
	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016

Where to Collect Samples For a Small Public Water System

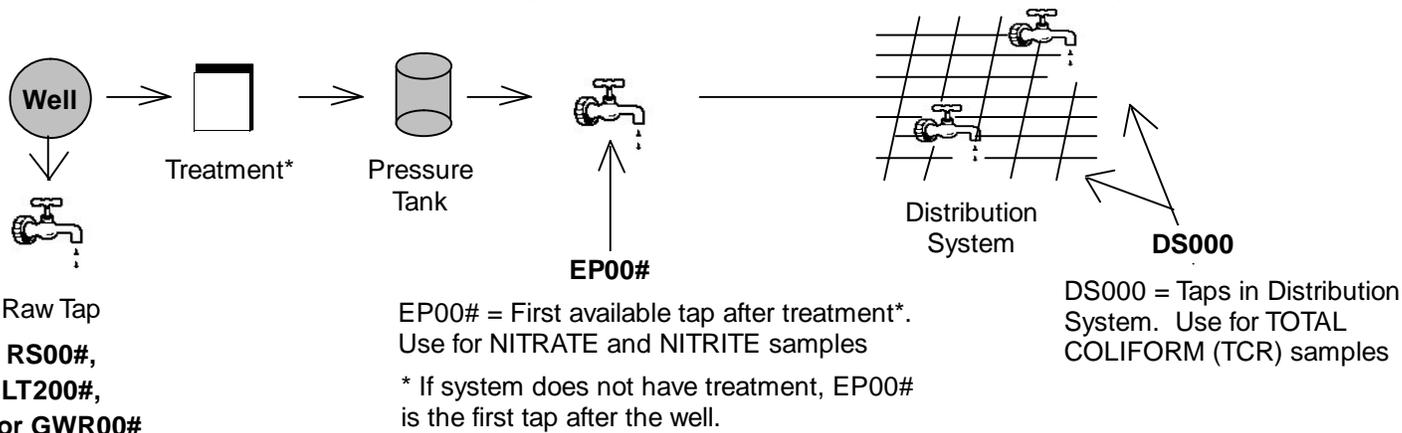

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0336912 HICKORY LAKE CAMPGROUND D-AREA

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **352760** Facility Name: **HICKORY LAKE D AREA**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

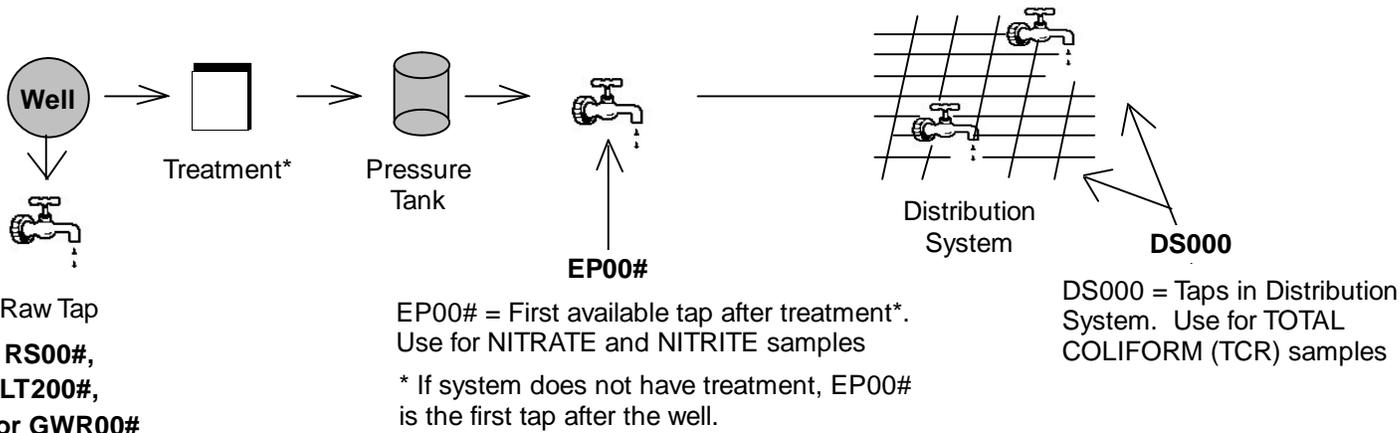

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0337012 HICKORY LAKE CAMPGROUND B-AREA

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: HICKORY LAKE - B AREA DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 4/30/2016
	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016

Where to Collect Samples For a Small Public Water System

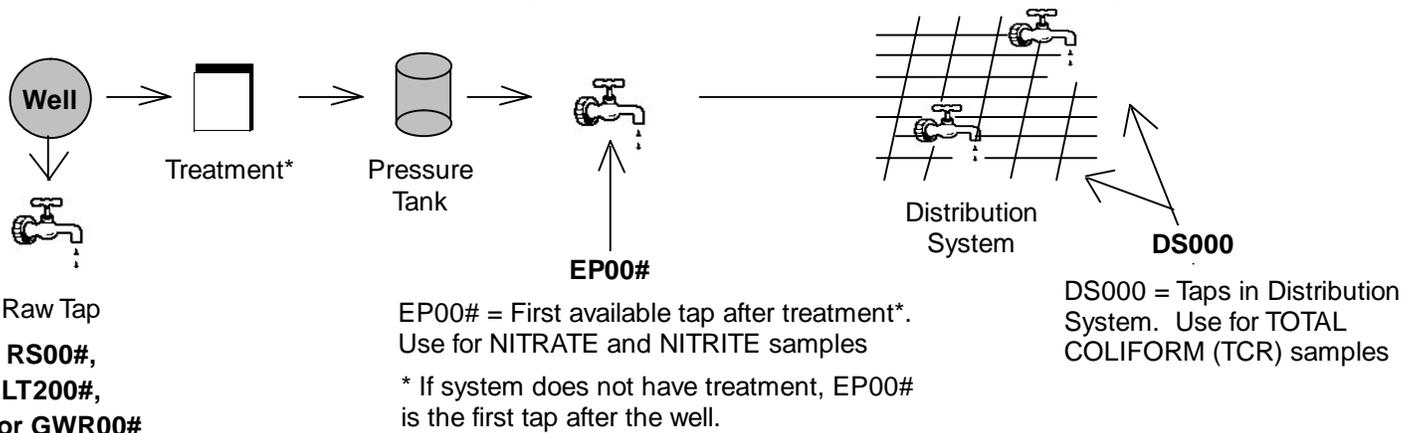

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0337012 HICKORY LAKE CAMPGROUND B-AREA

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **352761** Facility Name: **HICKORY LAKE B AREA**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

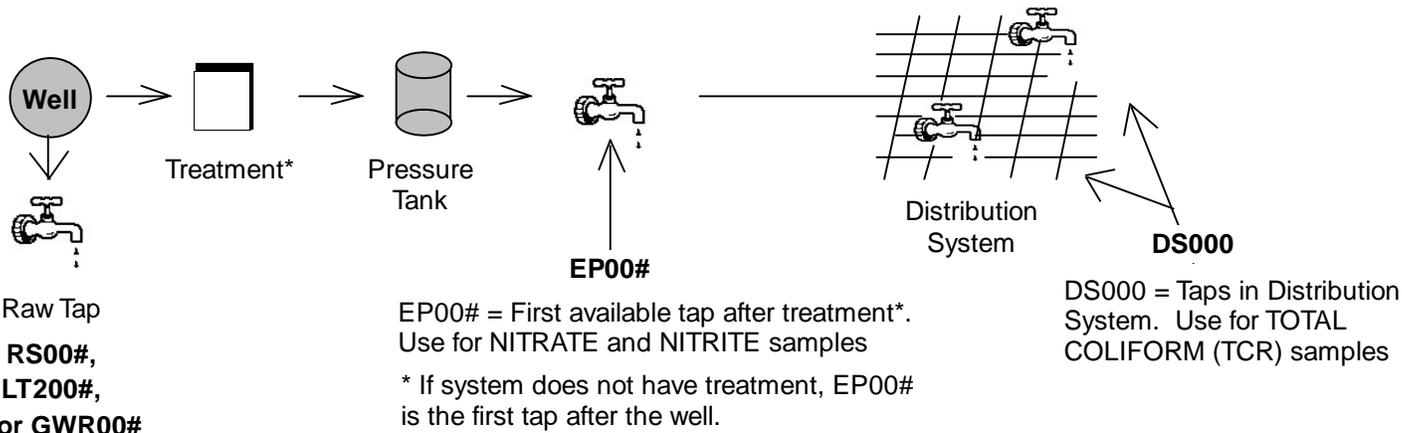

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0337312 ASHLAND DICKEY CHURCH OF THE BRETHREN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ASHLAND DICKEY CH BRETHN DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

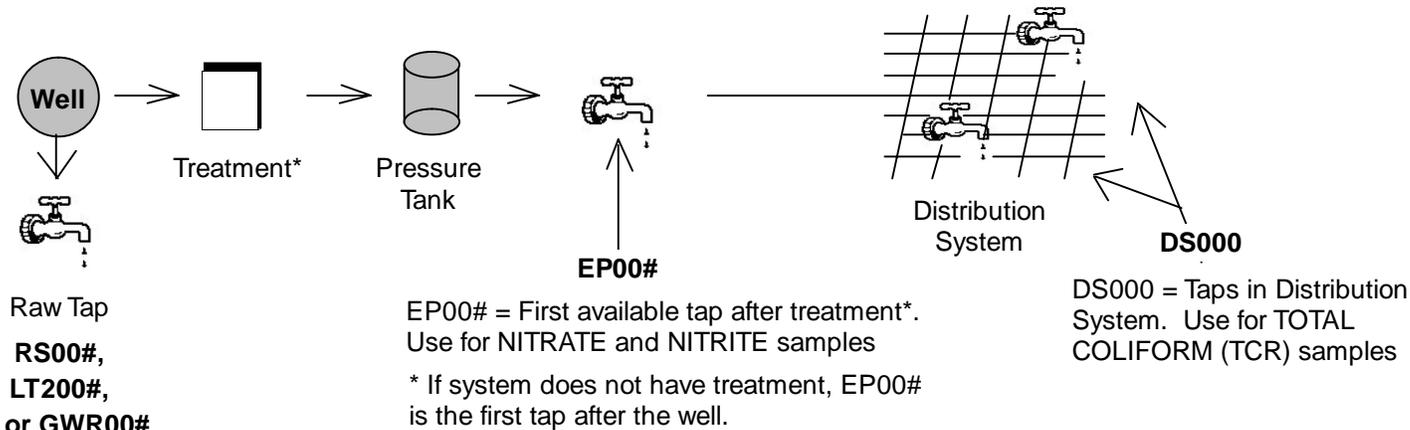

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0337312 ASHLAND DICKEY CHURCH OF THE BRETHREN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 352763	Facility Name: ASHLAND DICKEY CH BRETHN
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

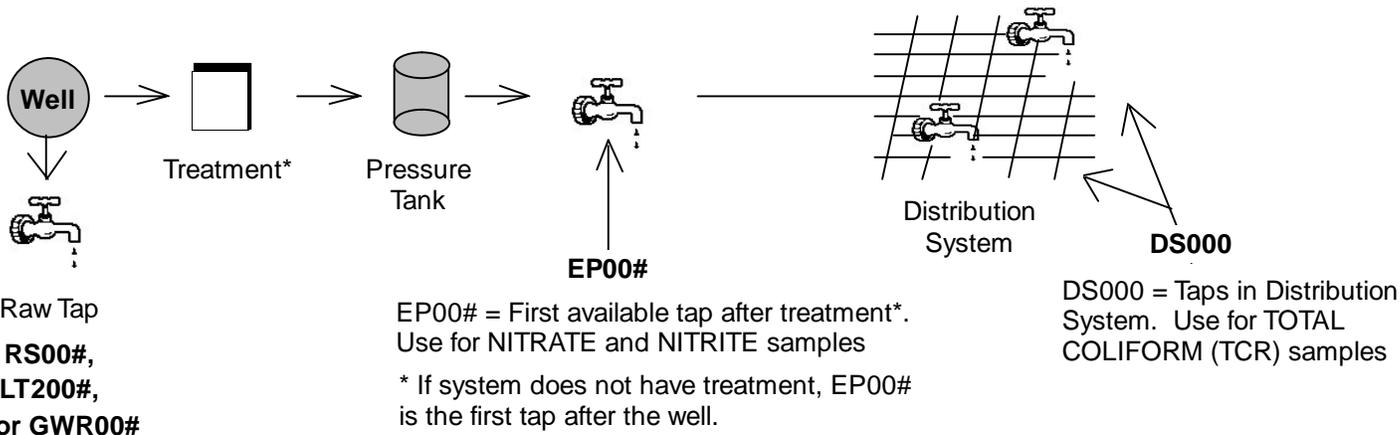

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0338212 ASHLAND CHURCH OF THE NAZARENE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ASHLND CH OF NAZARENE,IN DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

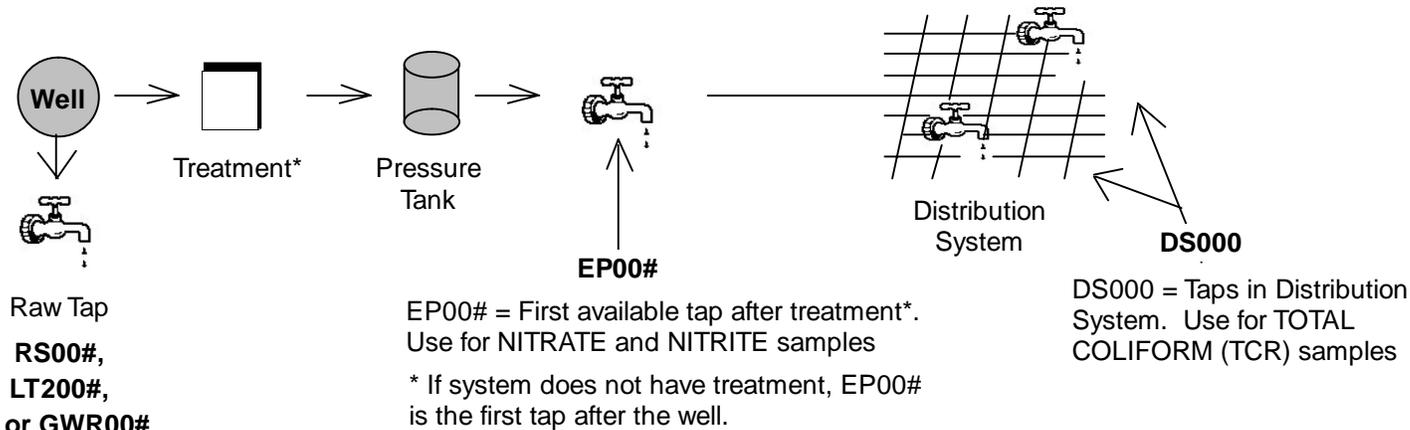

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0338212 ASHLAND CHURCH OF THE NAZARENE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 352767	Facility Name: ASHLAND CHURCH OF THE NAZARENE
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

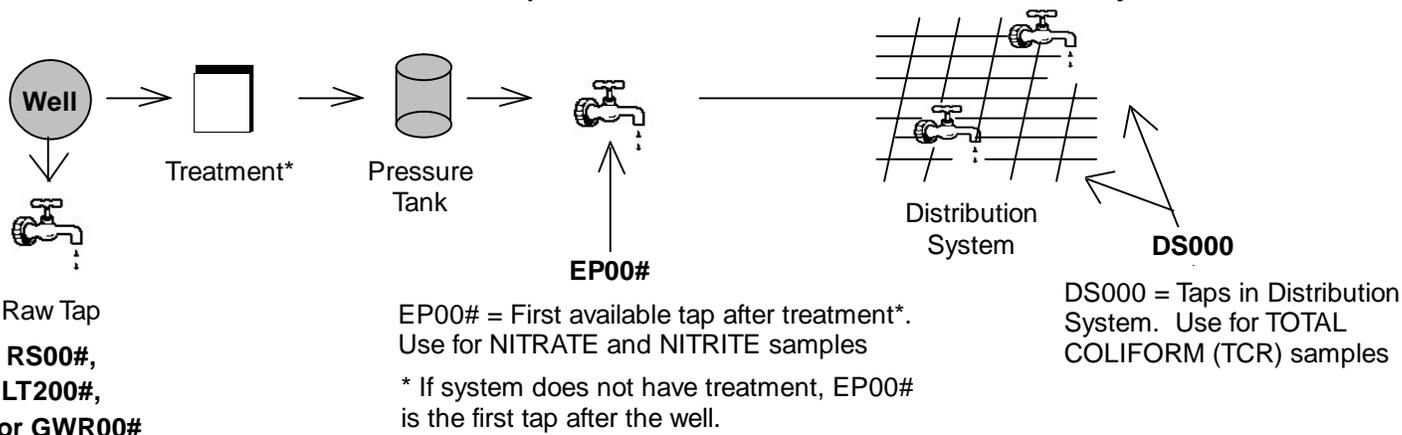

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH0338412 COBURN

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 352768	Facility Name: COBURN INC	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS A

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

OH0338412 COBURN

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: COBURN INC DISTRIBUTION
	SMP ID: DS000	

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022

Not Required

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between	1/1/2016	and	3/31/2016
1 Sample(s) Required between	4/1/2016	and	6/30/2016
1 Sample(s) Required between	7/1/2016	and	9/30/2016
1 Sample(s) Required between	10/1/2016	and	12/31/2016

OH0338512 EVERGREEN TAVERN AND DRIVE-THRU

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: EVERGREEN TAVERN & DRIVE DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

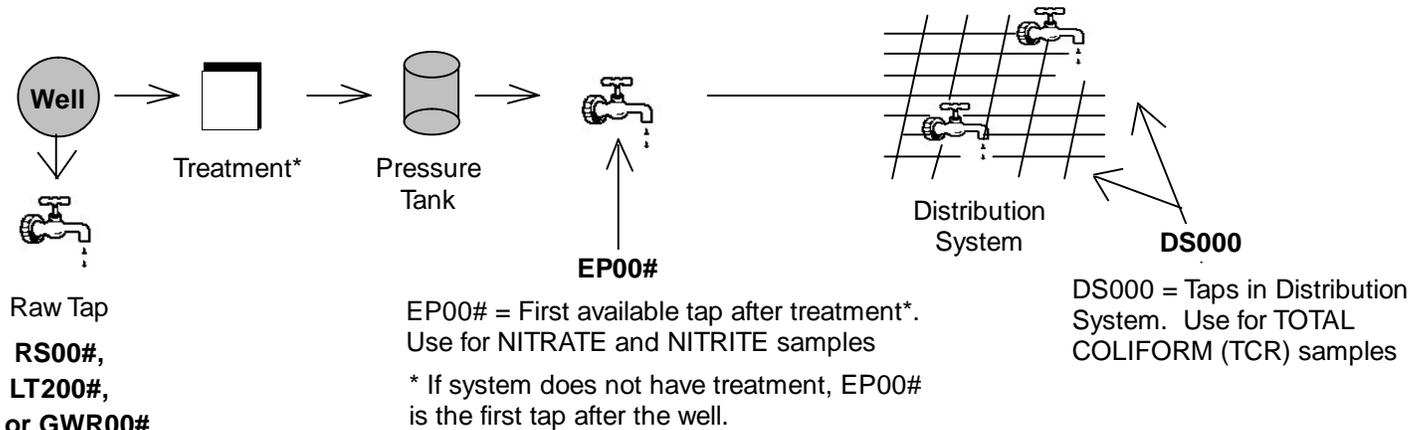

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0338512 EVERGREEN TAVERN AND DRIVE-THRU

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 352769	Facility Name: EVERGREEN TAVERN & DRIVE-THRU
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

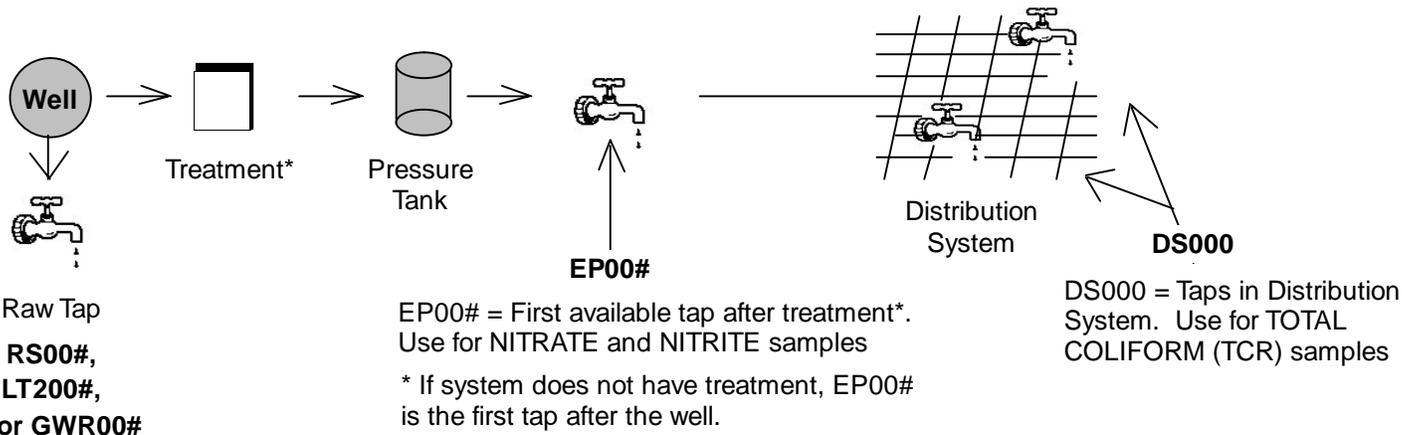

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0338612 FIRST BAPTIST CHURCH OF ASHLAND

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: FIRST BAPTIST CH OF ASHL DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

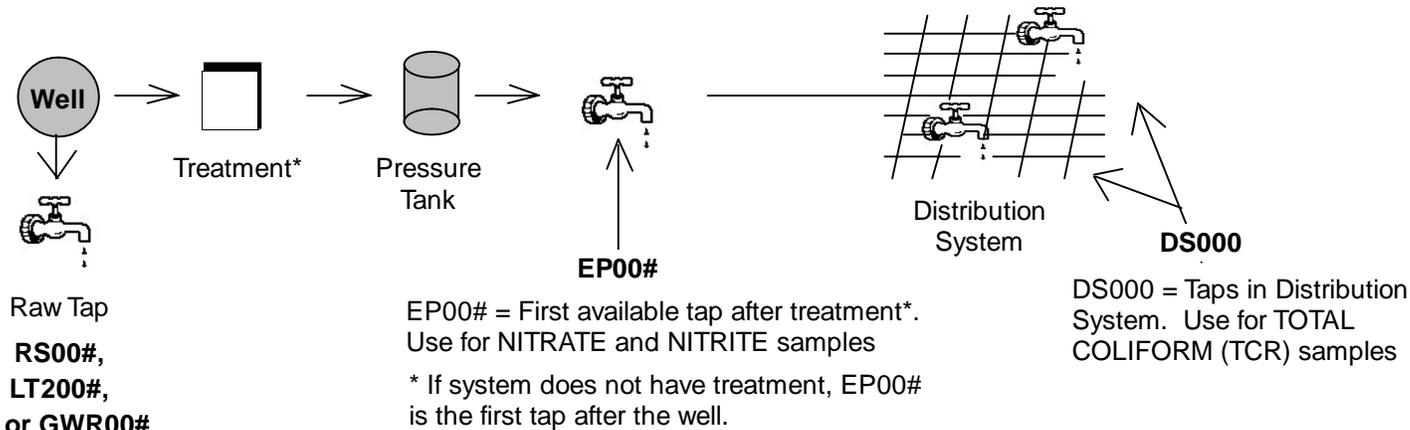

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0338612 FIRST BAPTIST CHURCH OF ASHLAND

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 352770	Facility Name: FIRST BAPTIST CHURCH OF ASHLAND INC
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

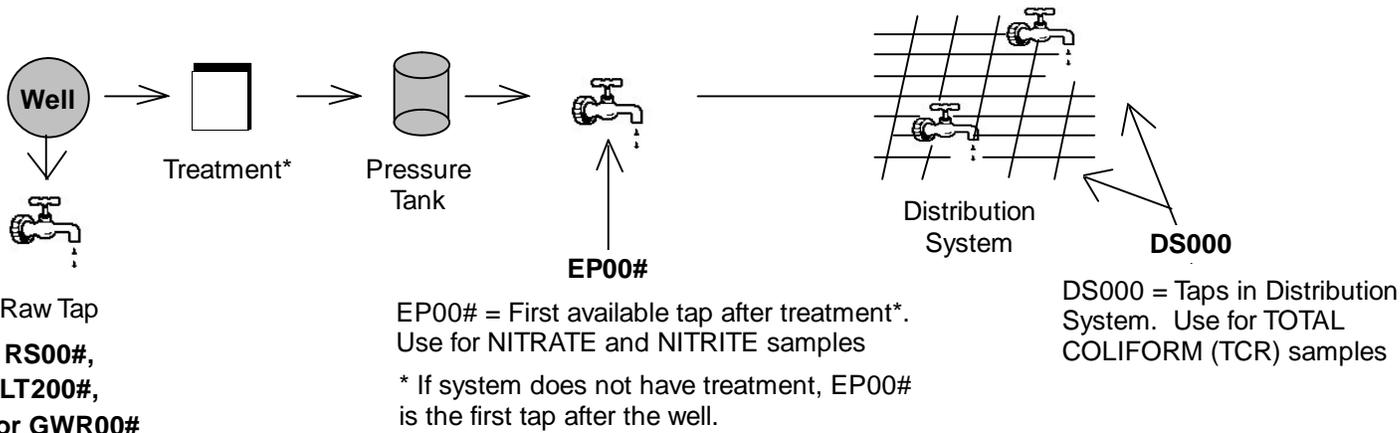

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

OH0339012 HILLSDALE HIGH SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 352772	Facility Name: HILLSDALE HIGH SCHOOL	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required

OH0339512 MIFFLIN INN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: MIFFLIN INN DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

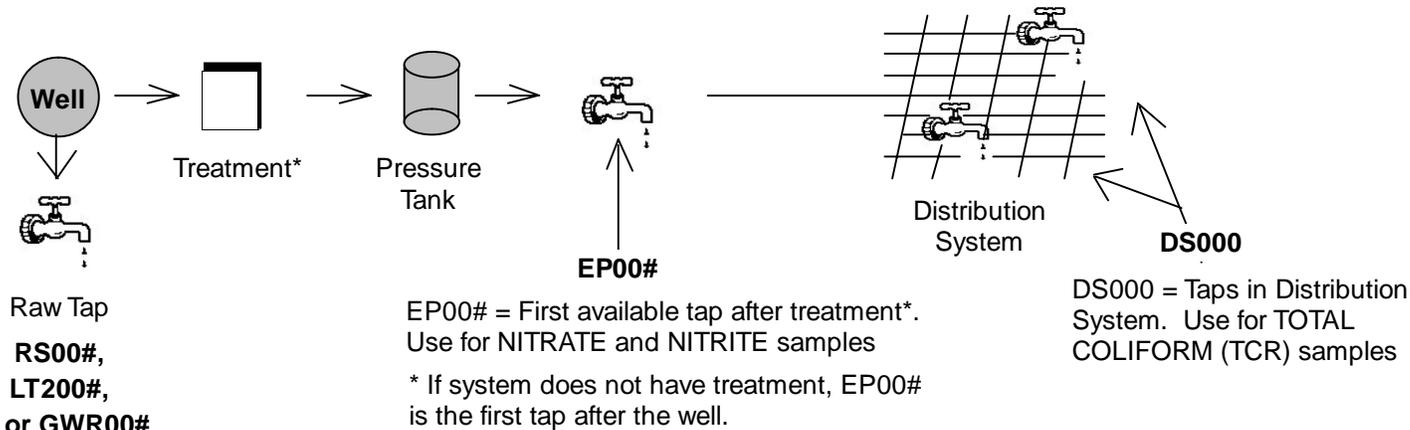

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0339512 MIFFLIN INN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 352773 Facility Name: MIFFLIN INN

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

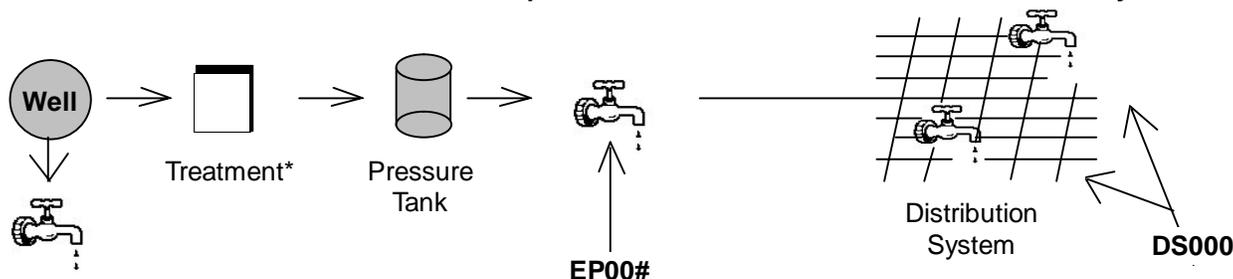

Raw Tap
RS00#,
LT200#,
or **GWR00#**

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00#
is the first tap after the well.

DS000 = Taps in Distribution
System. Use for TOTAL
COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0339712 MOHICAN HILLS GOLF CLUB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: MOHICAN HILLS GOLF CLUB DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

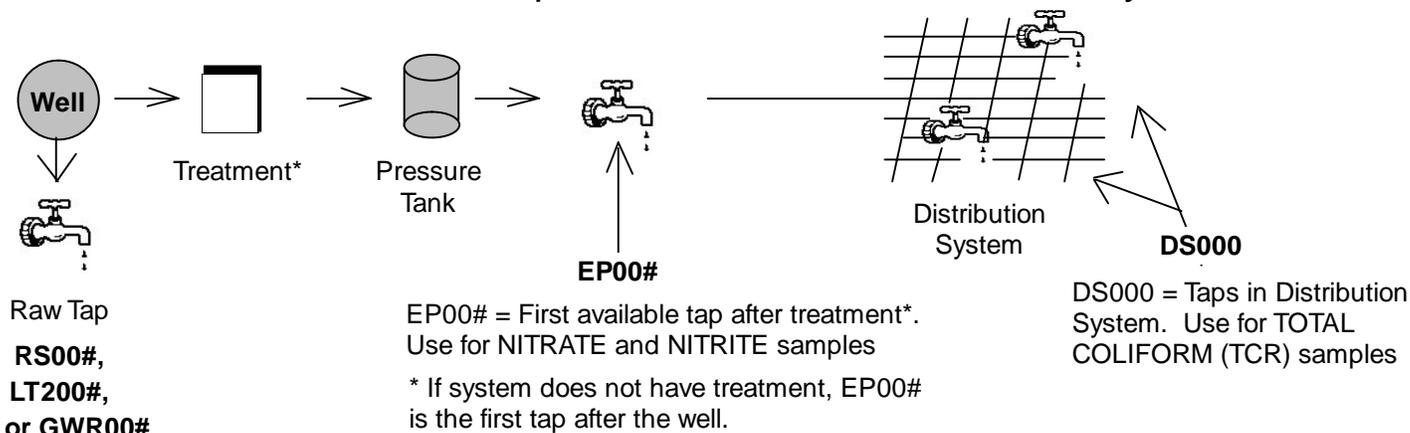

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0339712 MOHICAN HILLS GOLF CLUB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 352774 Facility Name: MOHICAN HILLS GOLF CLUB INC

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

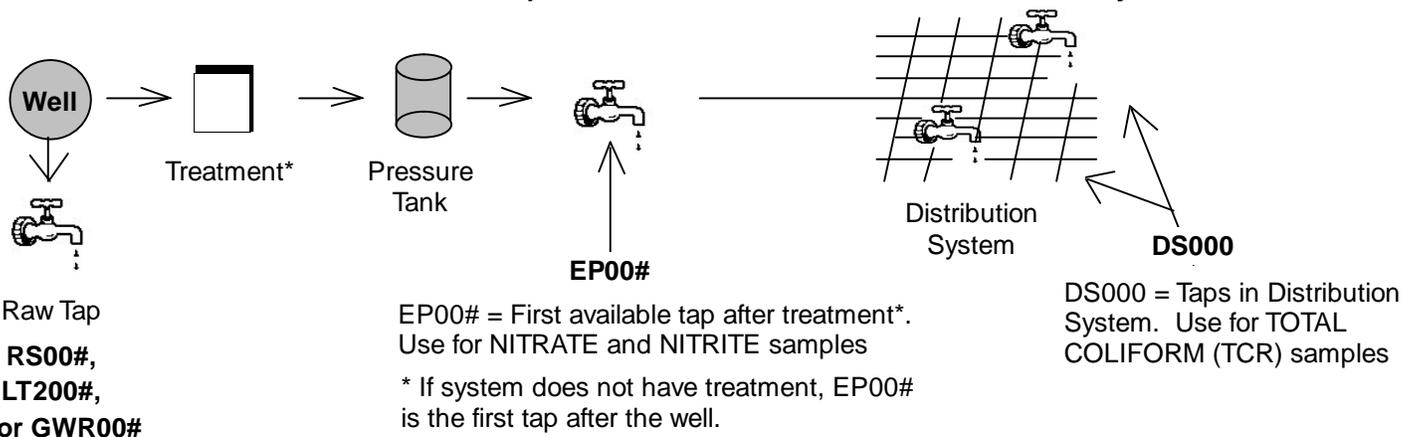

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0340312 PARADISE HILLS GOLF COURSE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: PARADISE HILLS GOLF CSE DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 1/31/2016
	1 Sample(s) Required between 2/1/2016 and 2/29/2016
	1 Sample(s) Required between 3/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 4/30/2016
	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 10/31/2016
	1 Sample(s) Required between 11/1/2016 and 11/30/2016
	1 Sample(s) Required between 12/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

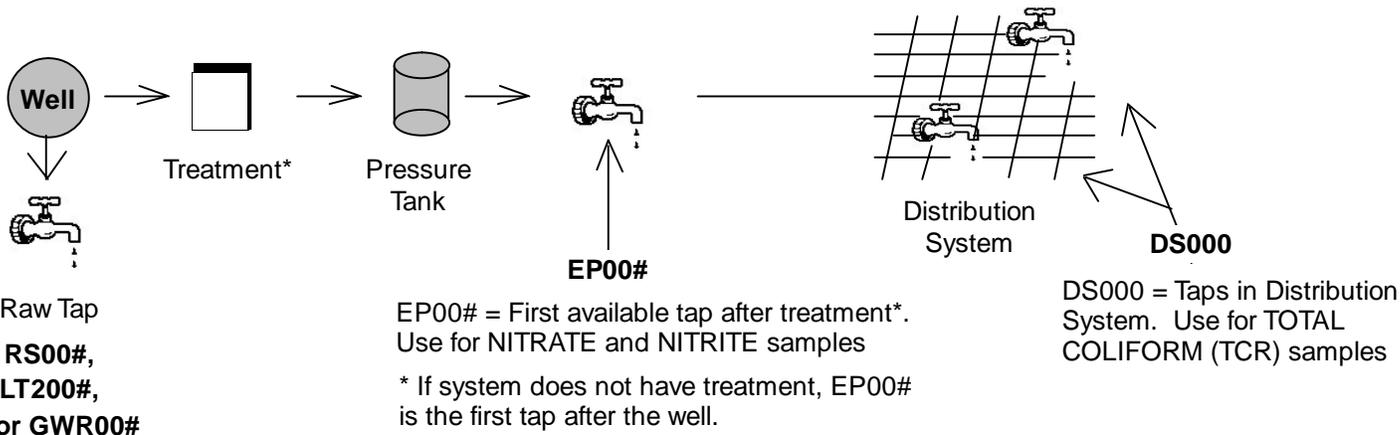

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0340312 PARADISE HILLS GOLF COURSE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 352776 Facility Name: PARADISE HILLS GOLF CSE

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

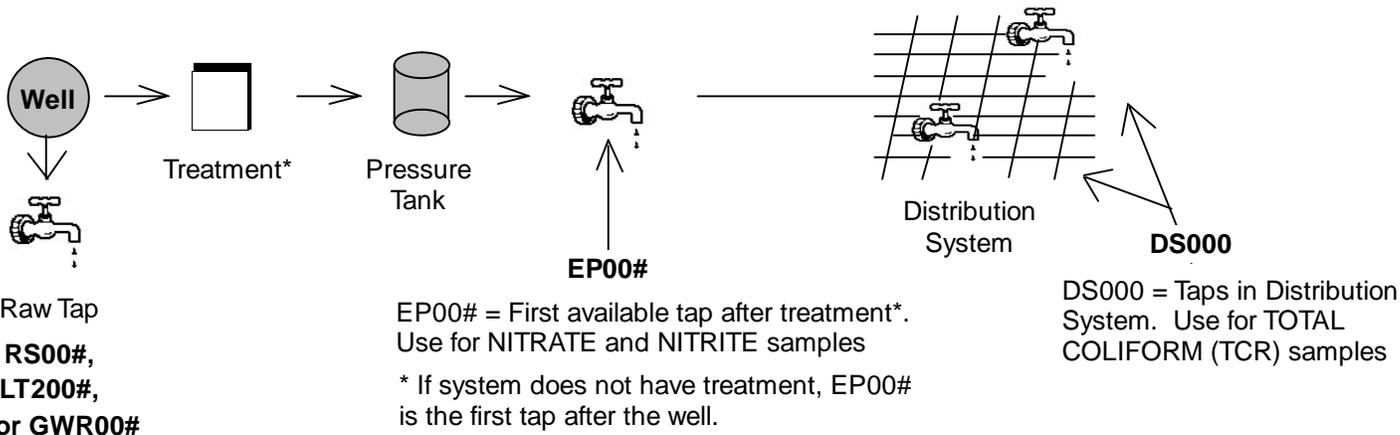

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0340512 PARADISE HILL UNITED METHODIST CHURCH PW

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: PARADISE HILLS UM CHURCH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

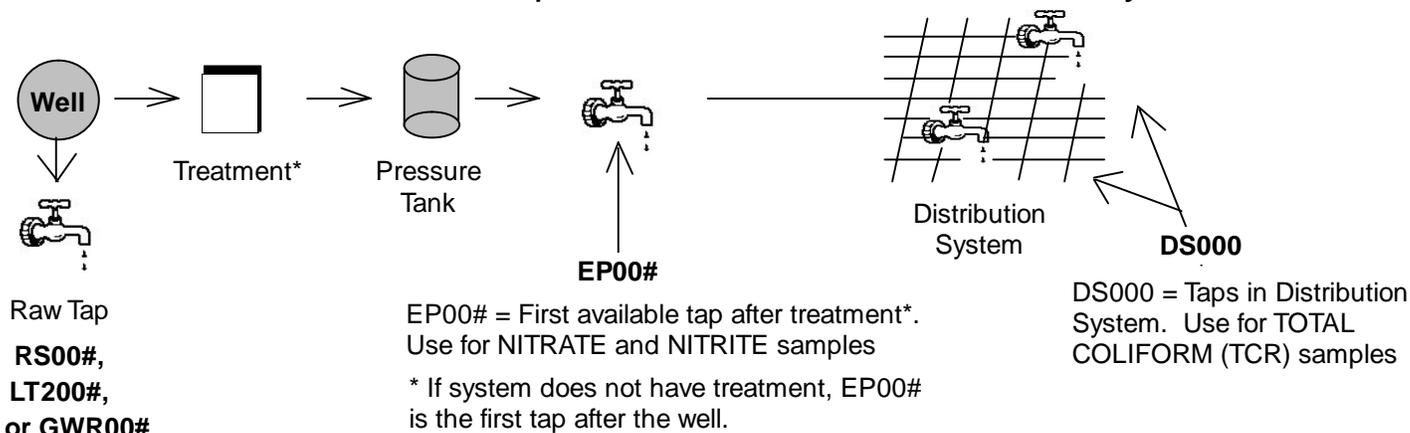

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0340512 PARADISE HILL UNITED METHODIST CHURCH PW

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 352777 Facility Name: PARADISE HILLS UN METH CH

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

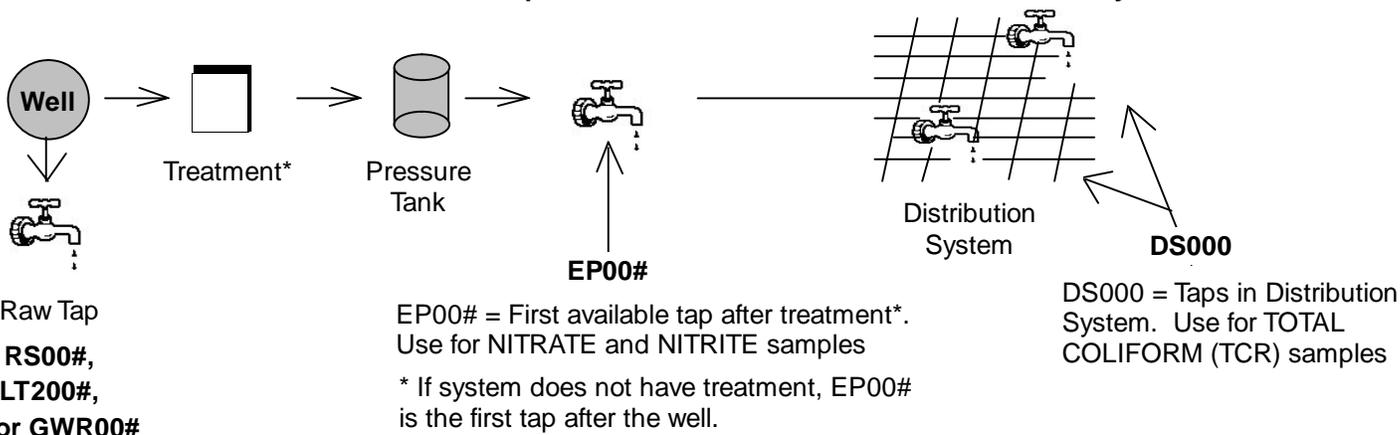

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0340912 ROUND LAKE CHRISTIAN ASSEMBLY-LODGE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ROUND LK CHRIST AMBY-LOD DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

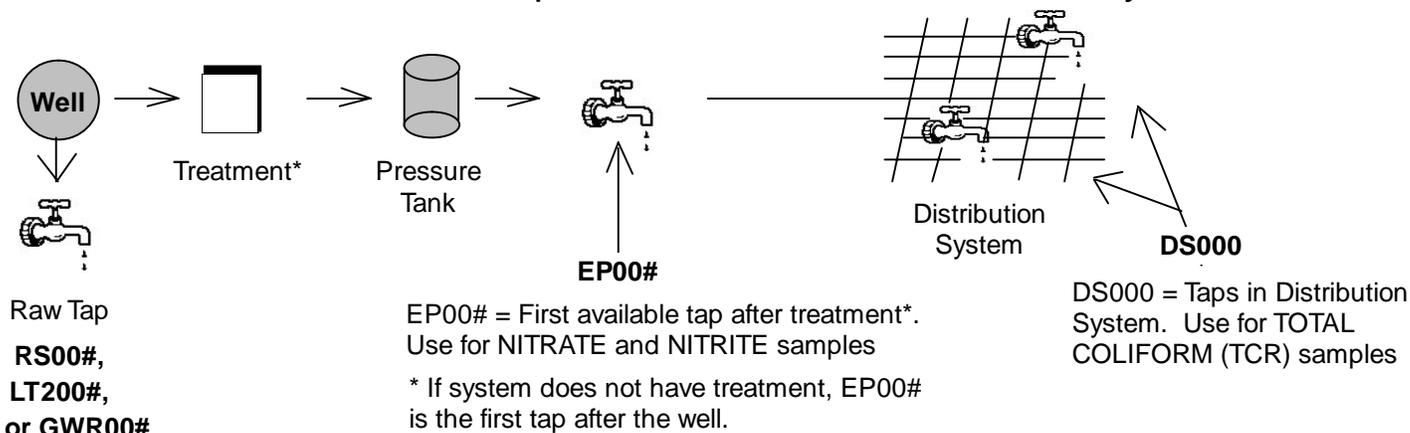

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0340912 ROUND LAKE CHRISTIAN ASSEMBLY-LODGE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 352780	Facility Name: ROUND LAKE CHRISTIAN ASSEMBLY LODGE
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

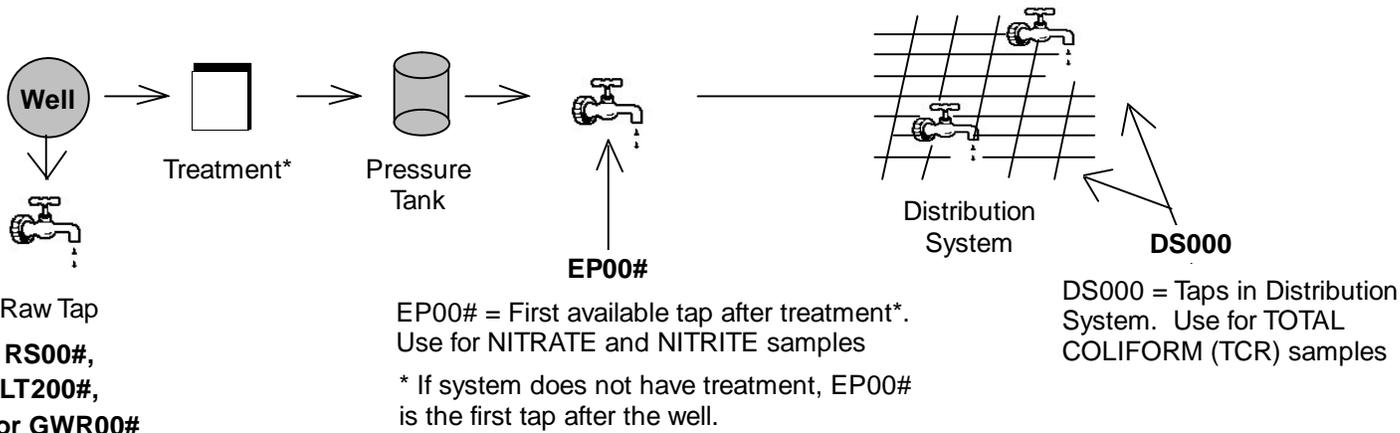

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0341012 ROUND LAKE CHRISTIAN ASSEMBLY-SR 3

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ROUND LK CHRIST AMBY-SR3 DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 10/31/2016

Where to Collect Samples For a Small Public Water System

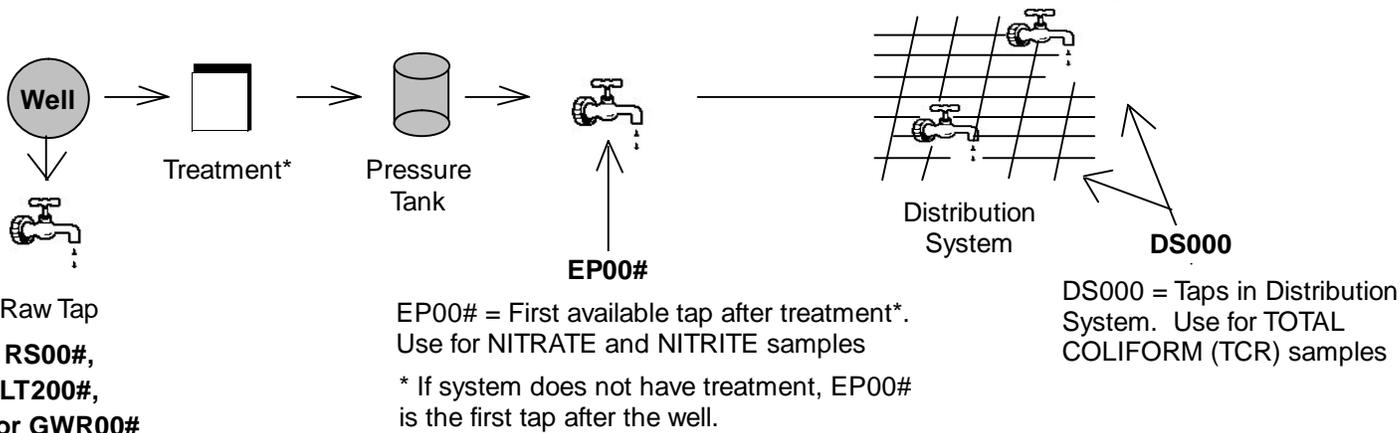

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0341012 ROUND LAKE CHRISTIAN ASSEMBLY-SR 3

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **352781** Facility Name: **ROUND LK CHR ASSEM SR3**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

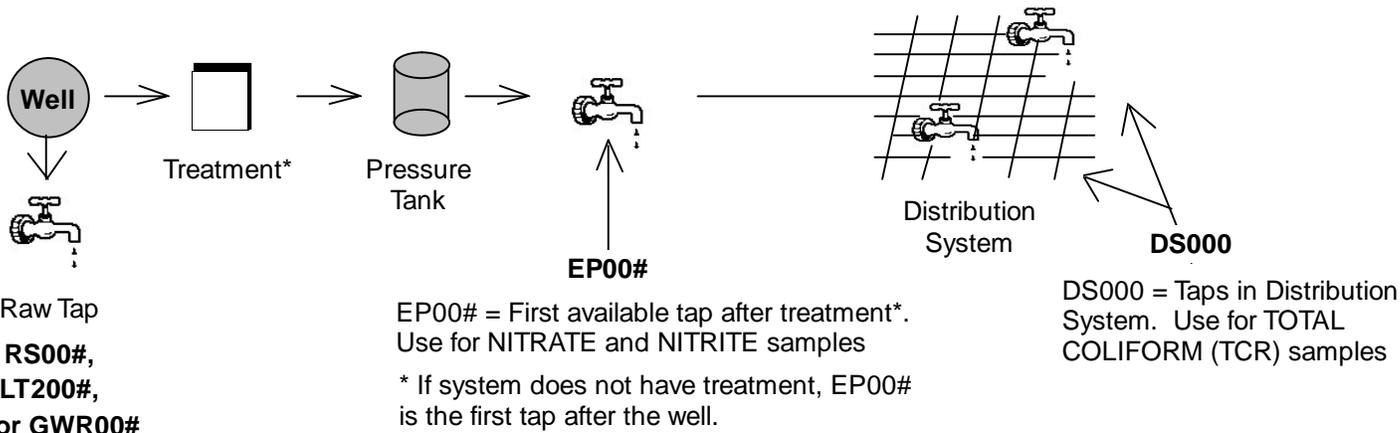

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0341112 ROUND LAKE CHRISTIAN ASSEMBLY B/G DORMS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ROUND LK CHRIST AMBY-B/G DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 10/31/2016

Where to Collect Samples For a Small Public Water System

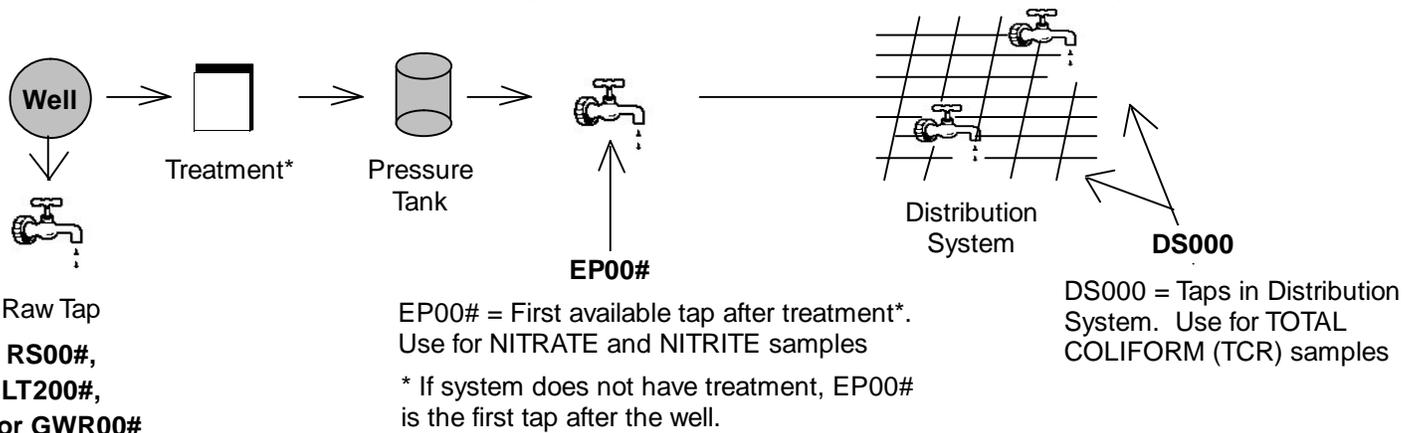

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0341112 ROUND LAKE CHRISTIAN ASSEMBLY B/G DORMS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 352782	Facility Name: ROUND LK CHR ASSEM B & G DORMS
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

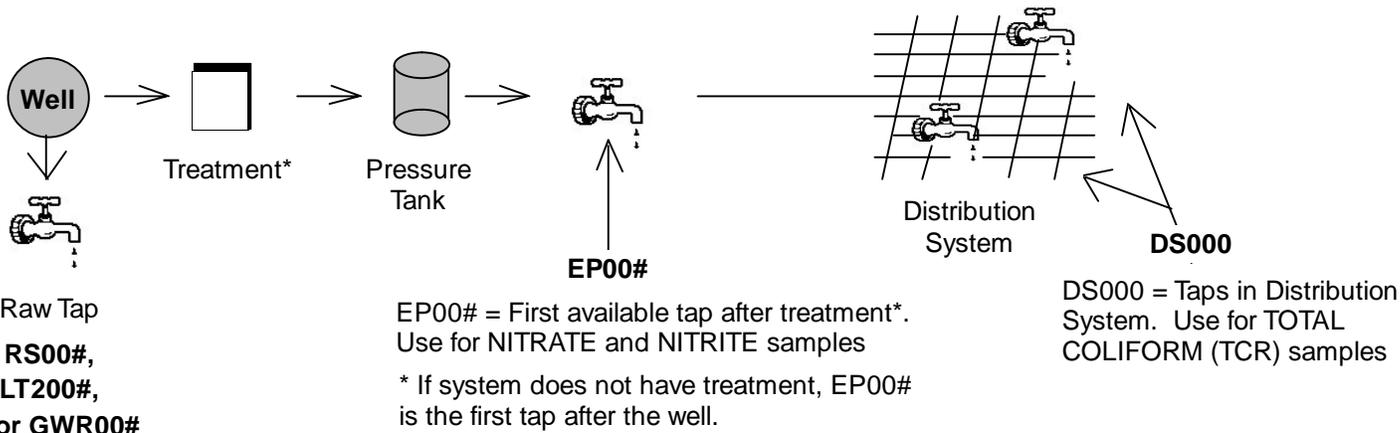

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0341212 ROUND LAKE GOLF COURSE

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ROUND LAKE GOLF COURSE DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 4/30/2016
	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 10/31/2016

Where to Collect Samples For a Small Public Water System

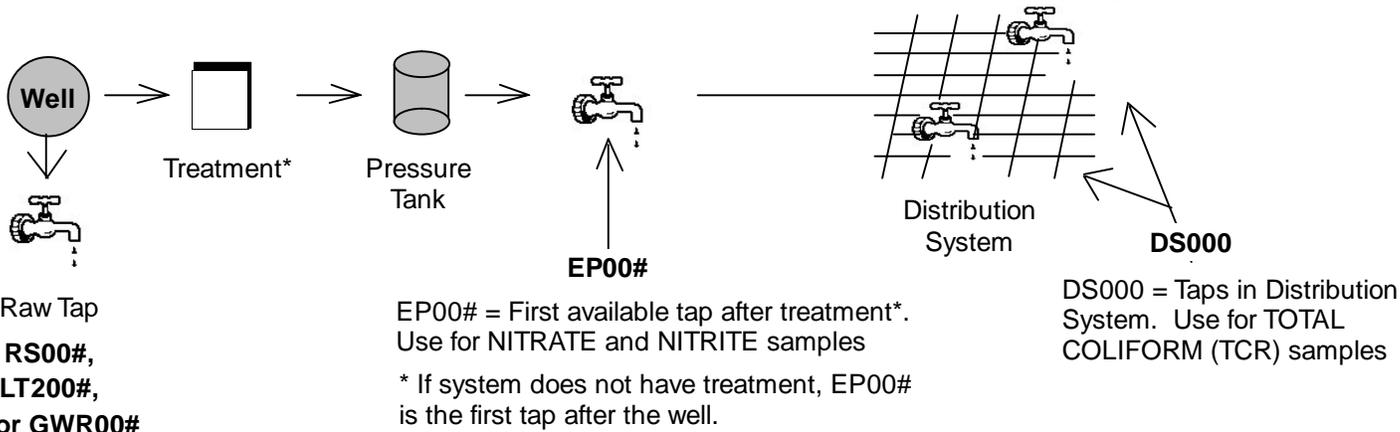

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0341212 ROUND LAKE GOLF COURSE

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **352783** Facility Name: **ROUND LAKE GOLF COURSE**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

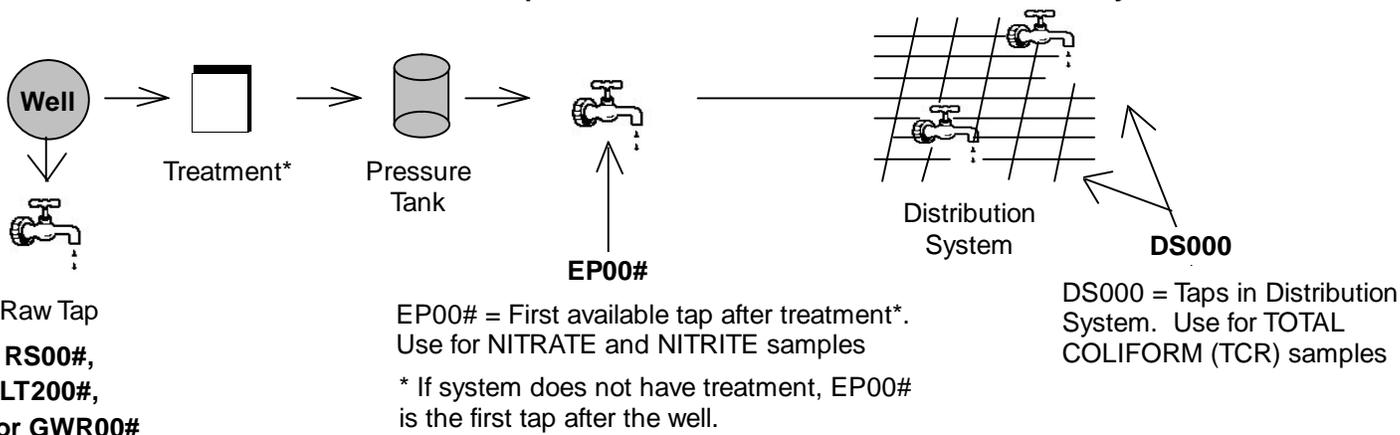

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0341812 VFW POST 8586-ROBERT L FRANK

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: VFW POST 8586-RBT L FRANK DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

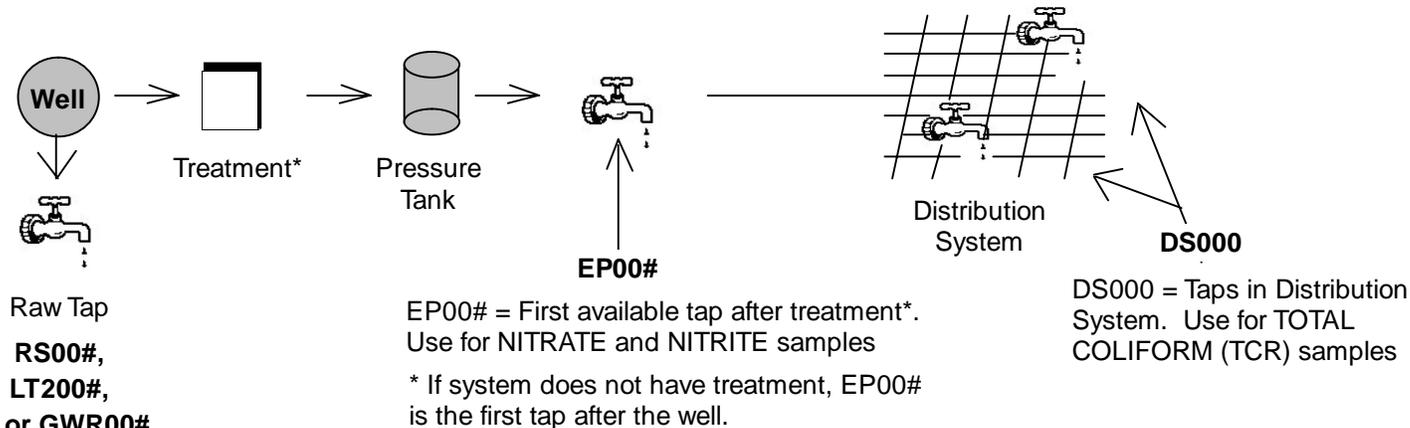

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0341812 VFW POST 8586-ROBERT L FRANK

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **352786** Facility Name: **VFW POST 8586**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

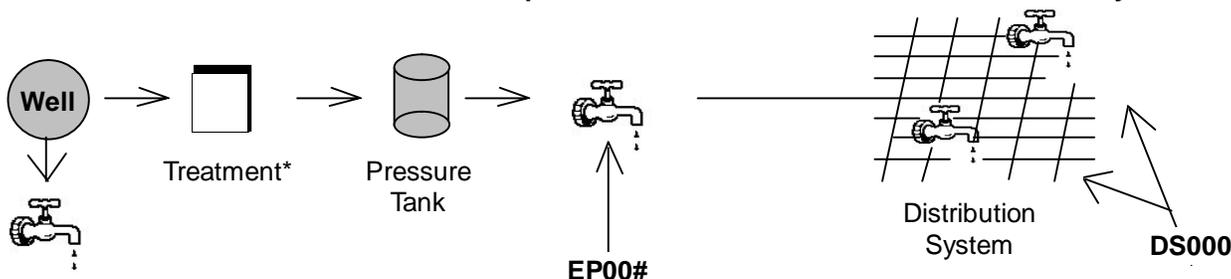

Raw Tap
RS00#,
LT200#,
or **GWR00#**

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00#
is the first tap after the well.

DS000 = Taps in Distribution
System. Use for TOTAL
COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0342012 WAYSIDE INN-LUCAS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: WAYSIDE INN DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

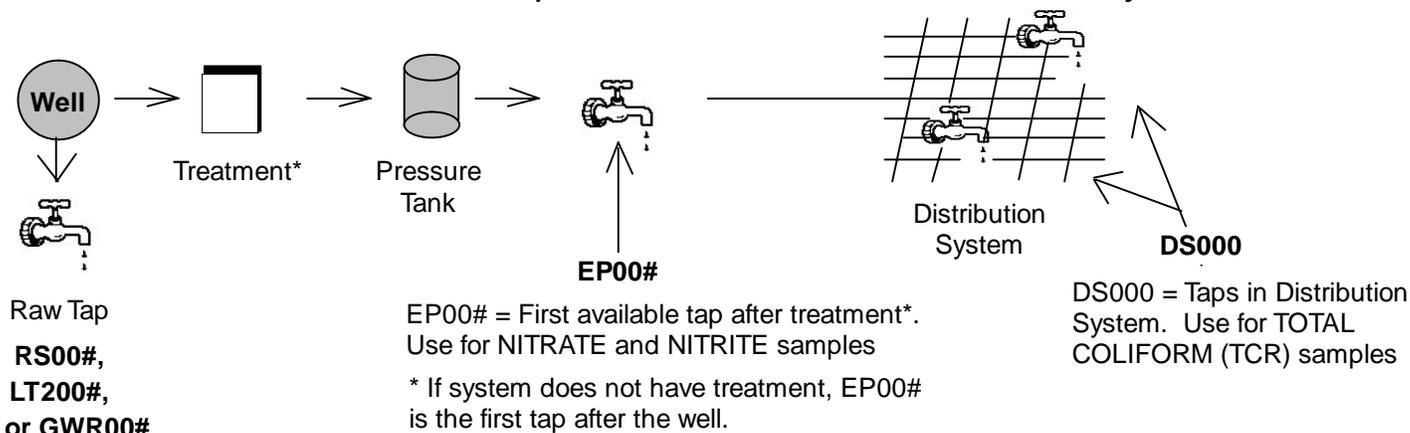

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0342012 WAYSIDE INN-LUCAS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **352787** Facility Name: **WAYSIDE INN**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

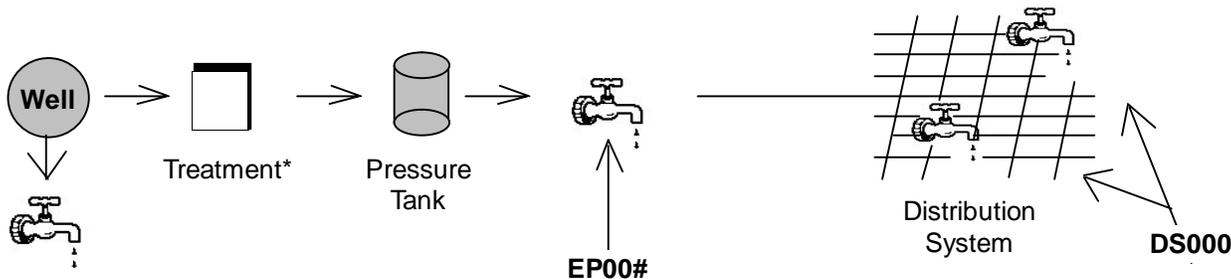

Raw Tap
RS00#,
LT200#,
or **GWR00#**

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples
* If system does not have treatment, EP00#
is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0342812 LITTLE FLOCK FELLOWSHIP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: LITTLE FLOCK FELLOWSHIP DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

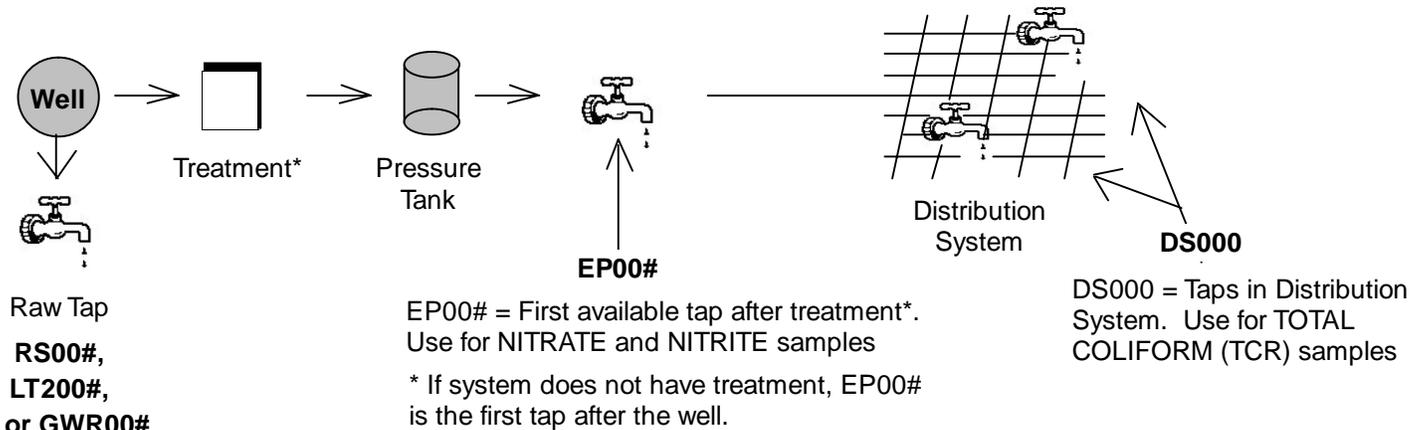

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0342812 LITTLE FLOCK FELLOWSHIP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 352791	Facility Name: LITTLE FLOCK FELLOWSHIP CHURCH
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

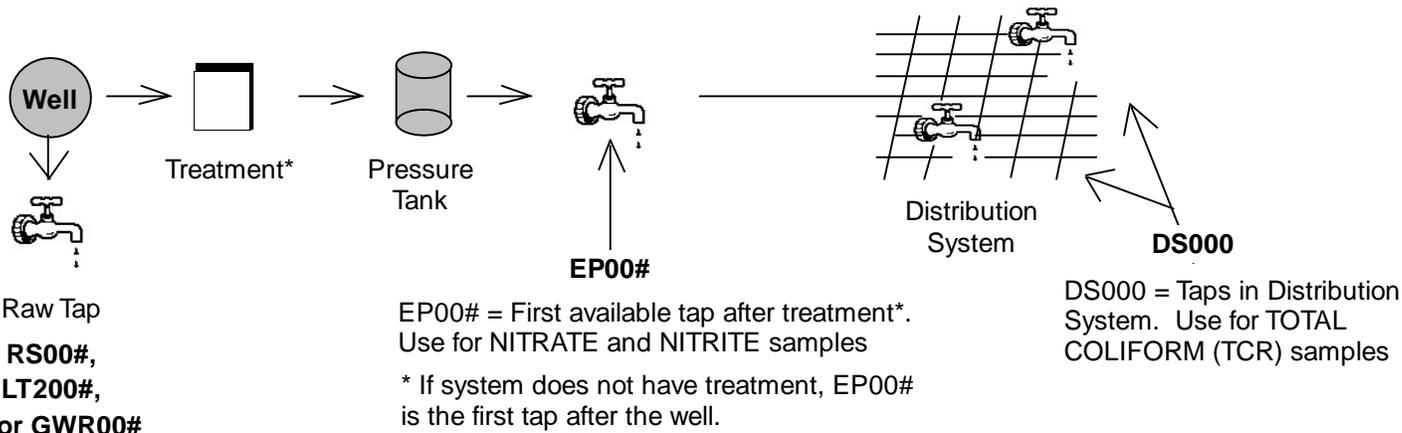

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0343112 LDS CHURCH ASHLAND

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: LDS CHURCH ASHLAND DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

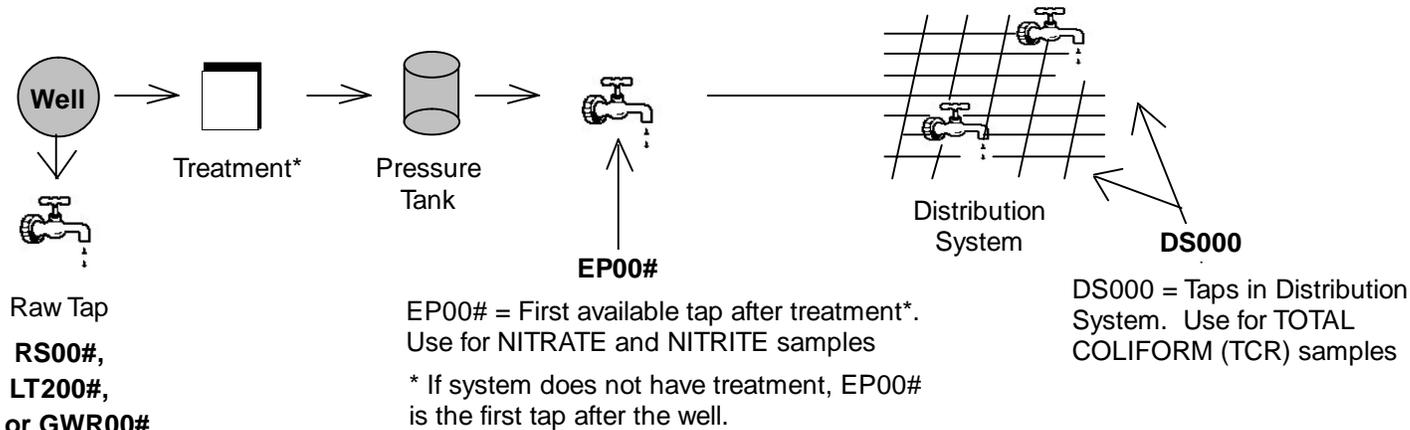

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0343112 LDS CHURCH ASHLAND

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **352793** Facility Name: **LDS CHURCH ASHLAND**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

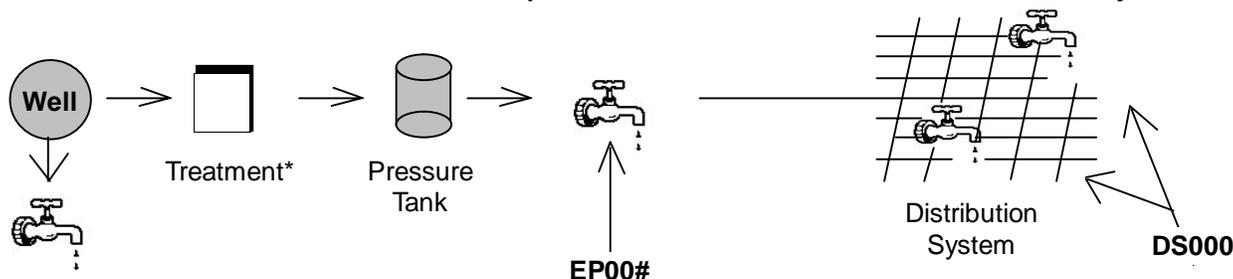

Raw Tap
RS00#,
LT200#,
or **GWR00#**

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00#
is the first tap after the well.

DS000 = Taps in Distribution
System. Use for TOTAL
COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH0343512 ODNR-MOHICAN LODGE/PLEASANT HILL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 352797	Facility Name: ODNR-MOHICAN LODGE PLEASANT HI
Location	SMP ID: EP001	Facility Source: Ground Water Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH0343512 ODNR-MOHICAN LODGE/PLEASANT HILL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: DS1 SMP ID: DS000 Facility Name: ODNR-MOHICAN LODGE/PLEAS DISTRIBUTIC Facility Class: CLASS 1

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2016 and 9/30/2016

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: http://epa.ohio.gov/ddagw/reporting.aspx

TOTAL COLIFORM (TCR) - 3100 2 Sample(s) Required between 4/1/2016 and 4/30/2016 2 Sample(s) Required between 5/1/2016 and 5/31/2016 2 Sample(s) Required between 6/1/2016 and 6/30/2016 2 Sample(s) Required between 7/1/2016 and 7/31/2016 2 Sample(s) Required between 8/1/2016 and 8/31/2016 2 Sample(s) Required between 9/1/2016 and 9/30/2016 2 Sample(s) Required between 10/1/2016 and 10/31/2016 1 Sample(s) Required between 10/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000 2 Sample(s) Required between 4/1/2016 and 4/30/2016 2 Sample(s) Required between 5/1/2016 and 5/31/2016 2 Sample(s) Required between 6/1/2016 and 6/30/2016 2 Sample(s) Required between 7/1/2016 and 7/31/2016 2 Sample(s) Required between 8/1/2016 and 8/31/2016 2 Sample(s) Required between 9/1/2016 and 9/30/2016 2 Sample(s) Required between 10/1/2016 and 10/31/2016 1 Sample(s) Required between 10/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: DS1 SMP ID: DS201 Facility Name: ODNR-MOHICAN LODGE/PLEAS DISTRIBUTIC Facility Class: CLASS 1 ADDRESS NOT KNOWN

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950

OH0343612 MWCD-EAGLE POINT-CM9

System Type: Transient Noncommunity

Operating Period: 3/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: MWCD-EAGLE PT.-CM9 DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

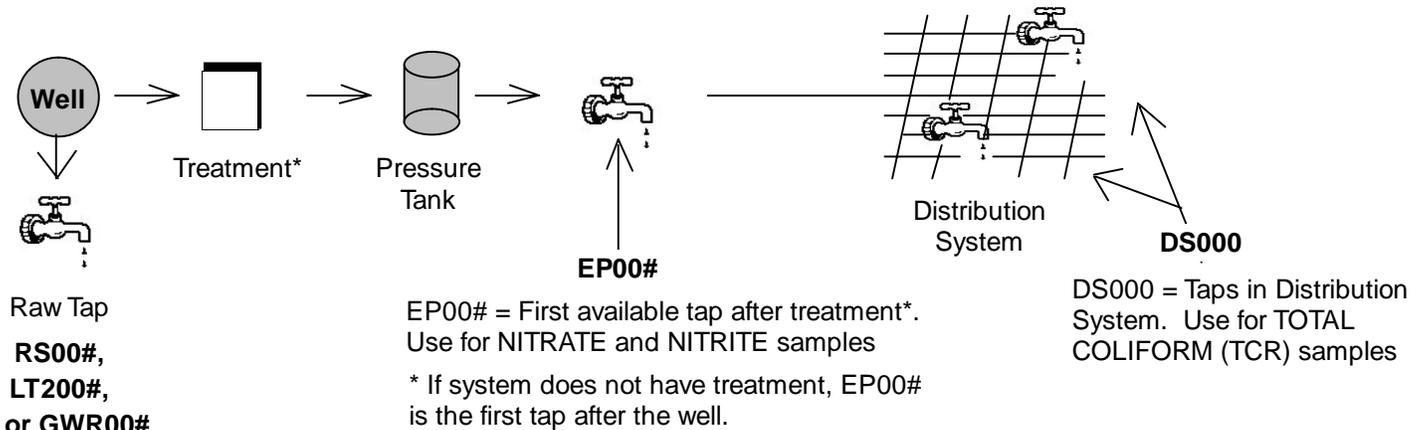

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0343612 MWCD-EAGLE POINT-CM9

System Type: Transient Noncommunity

Operating Period: 3/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 352798	Facility Name: MWCD EAGLE POINT CM9
Location SMP ID: EP001	Facility Source: Ground Water
Facility Class: CLASS A	

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

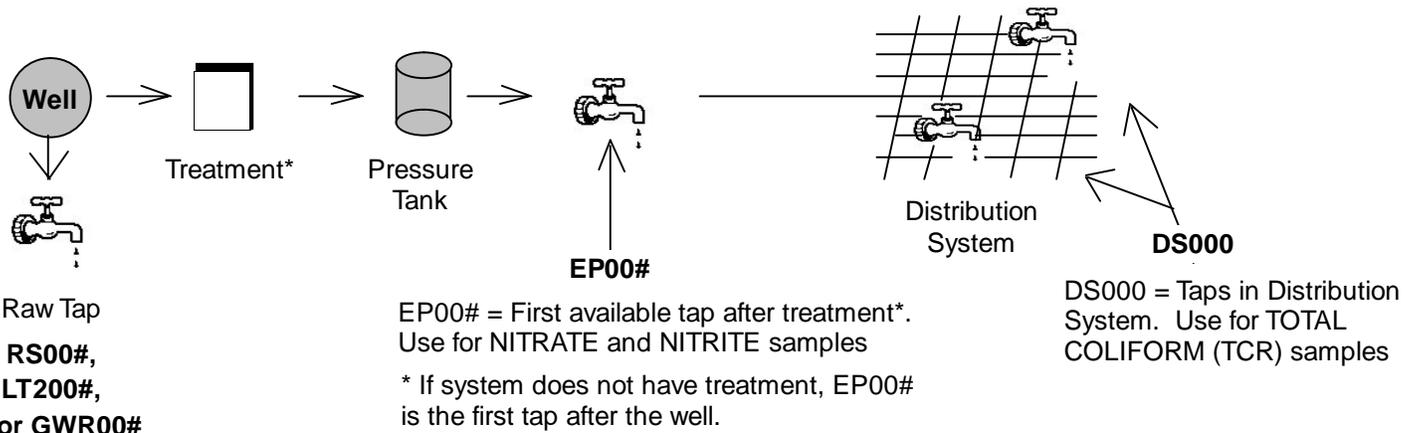

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0343912 VALLEY TRANSPORTATION INC

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: VALLEY TRANSPORTATION IN DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

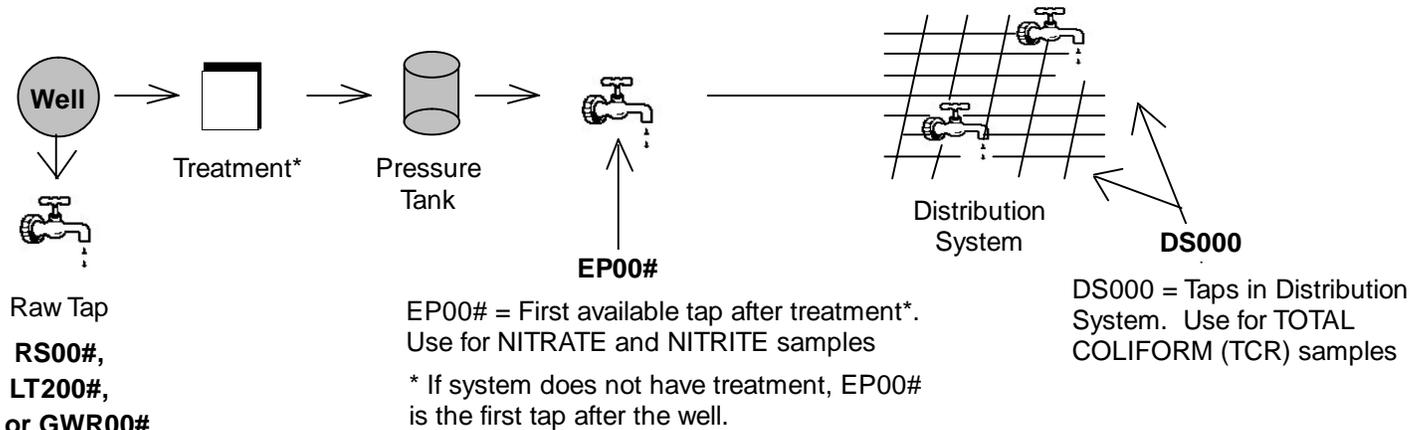

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0343912 VALLEY TRANSPORTATION INC

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **352800** Facility Name: **VALLEY TRANSPORTATION**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

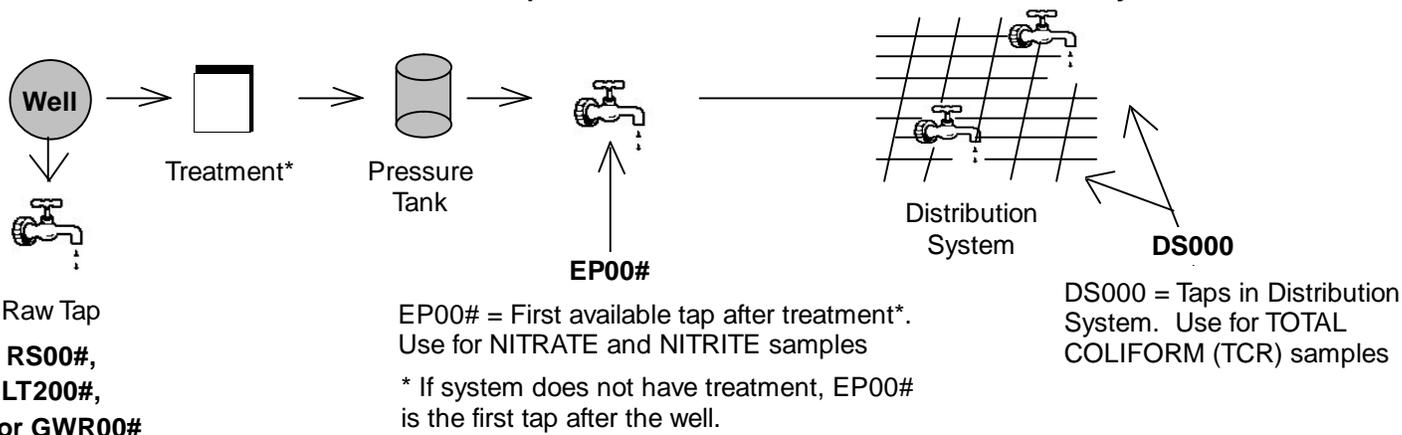

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0344312 THE CABIN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: THE CABIN DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

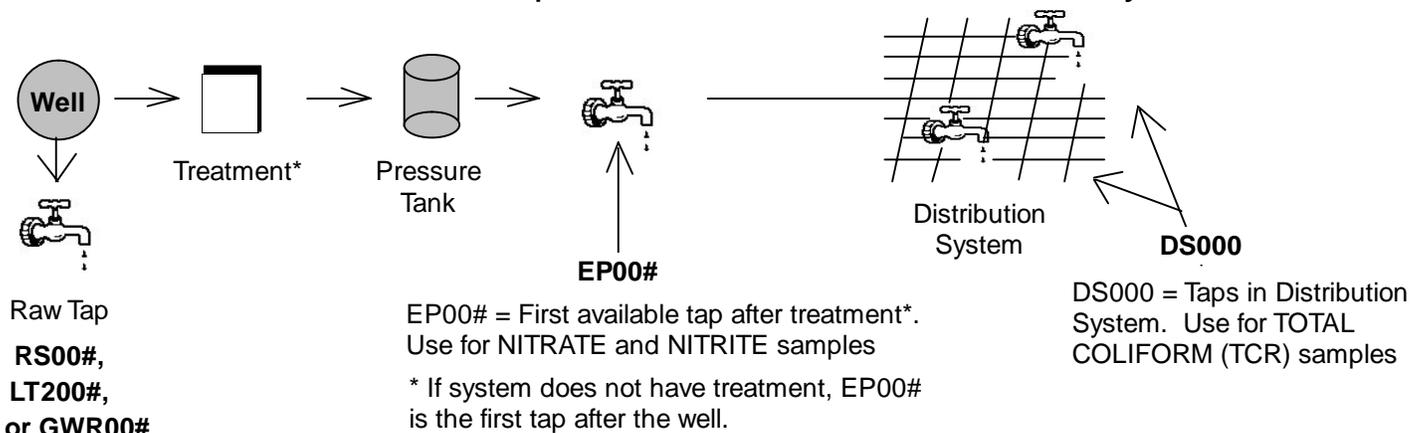

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0344312 THE CABIN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **352802** Facility Name: **CABIN RESTAURANT**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

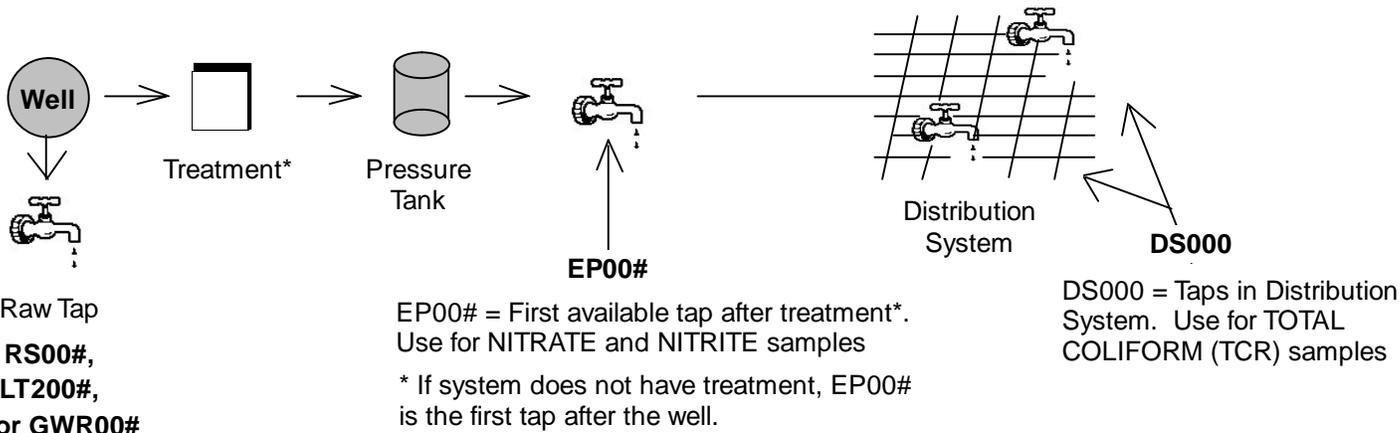

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0344612 RIVER RUN FAMILY CAMPGROUND 2 PWS

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: RIVER RUN FMLY CMPGRD 2 DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 9/30/2016

Where to Collect Samples For a Small Public Water System

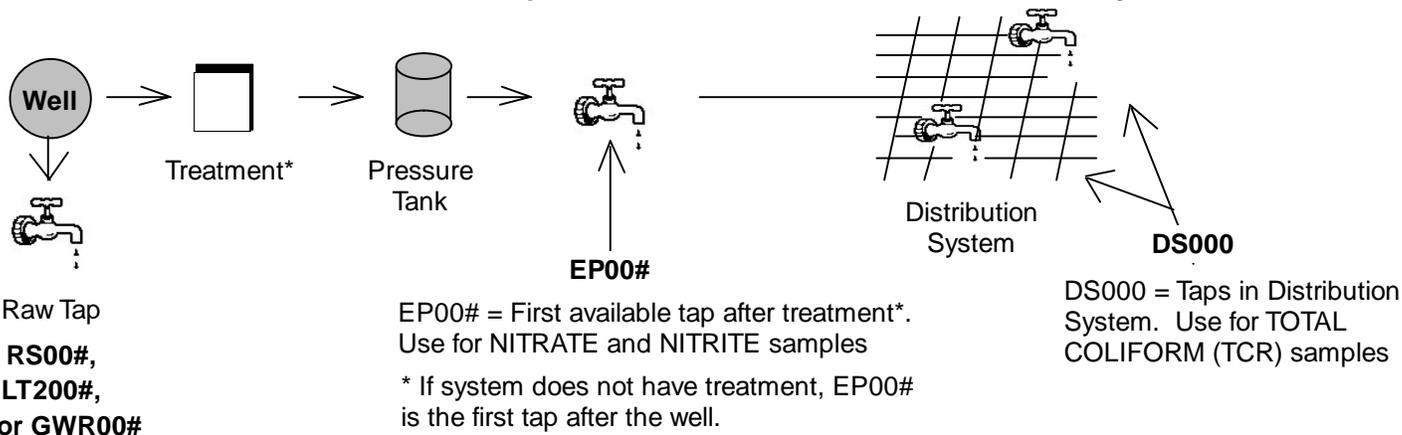

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0344612 RIVER RUN FAMILY CAMPGROUND 2 PWS

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 352804	Facility Name: RIVER RUN CAMPGROUND WELL 2
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

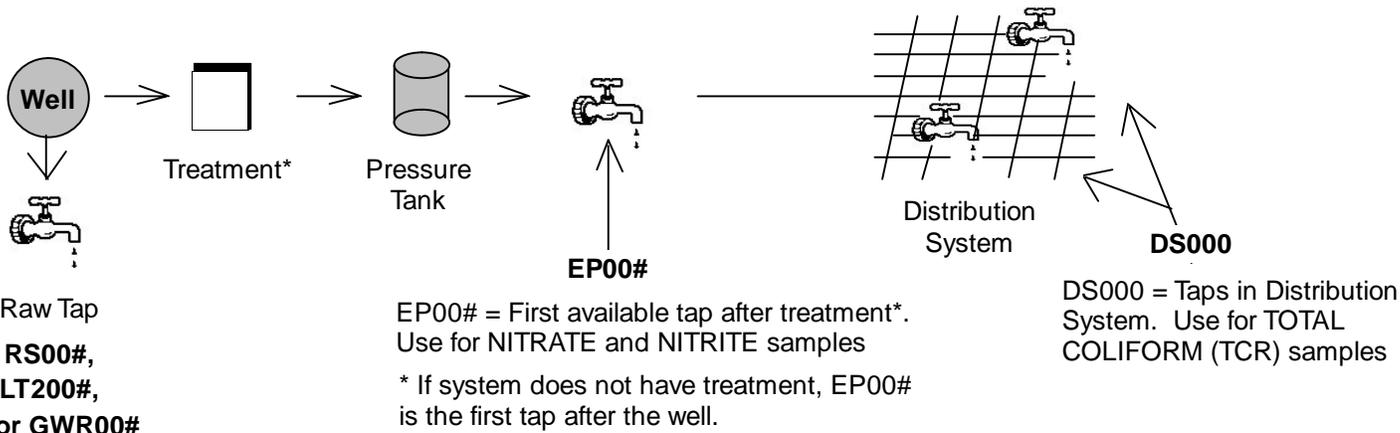

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0345012 TRINITY UNITED METHODIST CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: TRINITY UNITED METHODIST CHURCH DISTRIBU
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

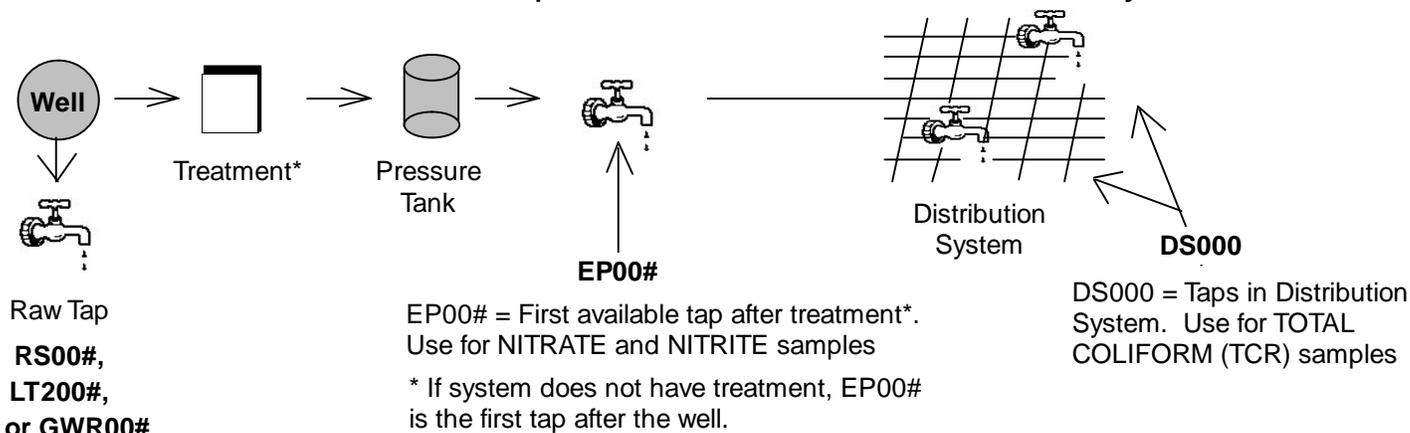

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0345012 TRINITY UNITED METHODIST CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 361394	Facility Name: TRINITY UNITED METHODIST CHURCH
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

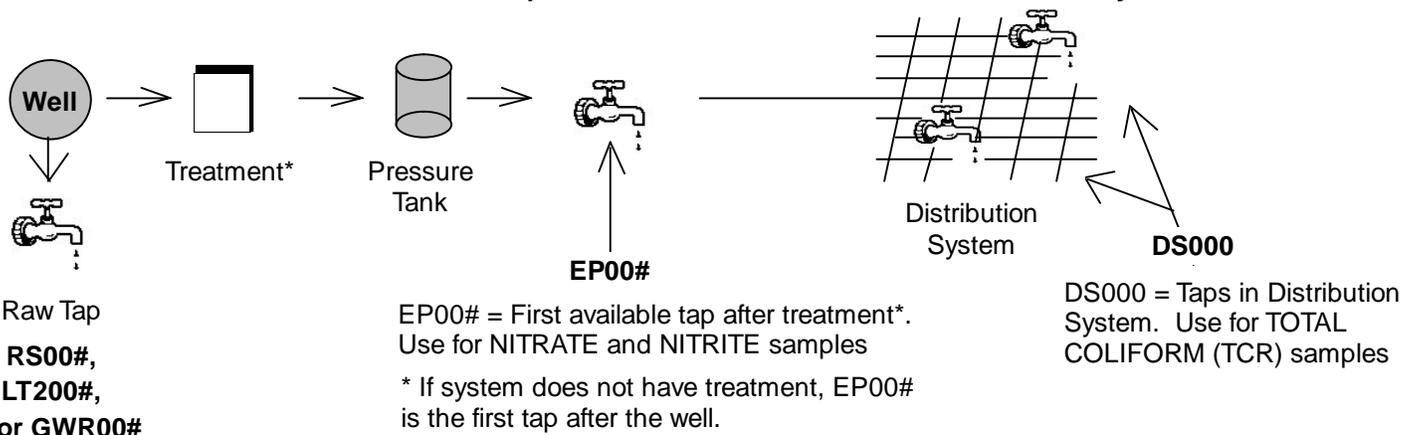

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0345112 CAMP NUHOP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CAMP NUHOP DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

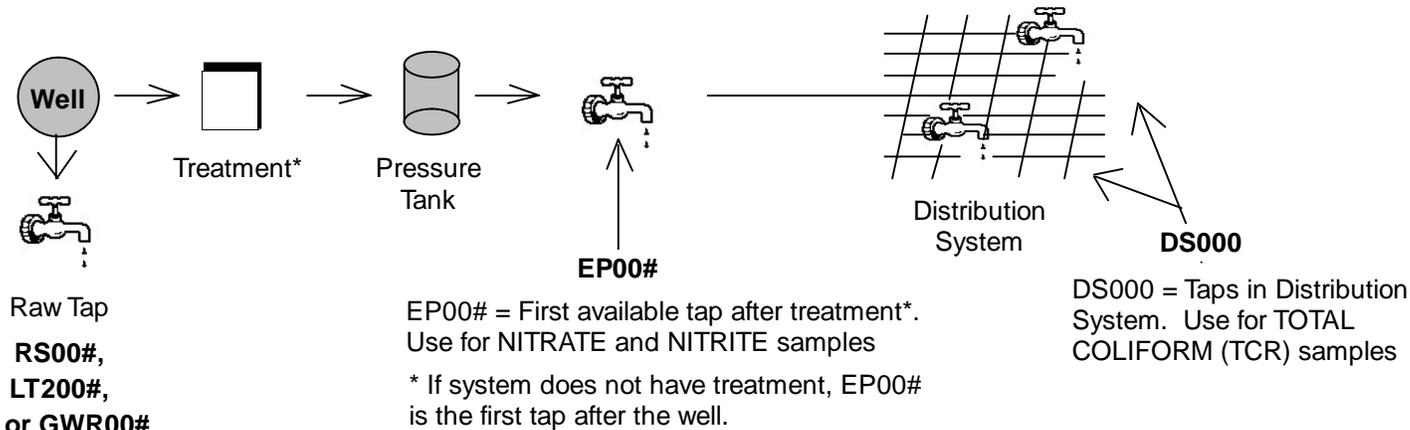

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0345112 CAMP NUHOP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **352808** Facility Name: **CAMP NUHOP**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

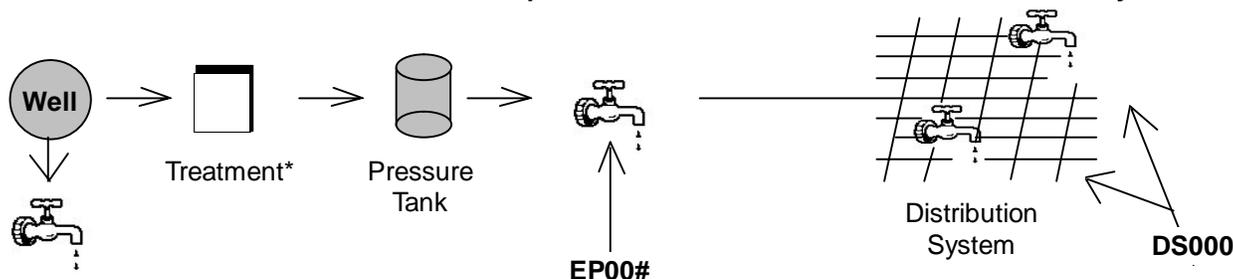

Raw Tap
RS00#,
LT200#,
or **GWR00#**

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00#
is the first tap after the well.

DS000 = Taps in Distribution
System. Use for TOTAL
COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0345212 COWEN TRUCK LINES

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: COWEN TRUCK LINES DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

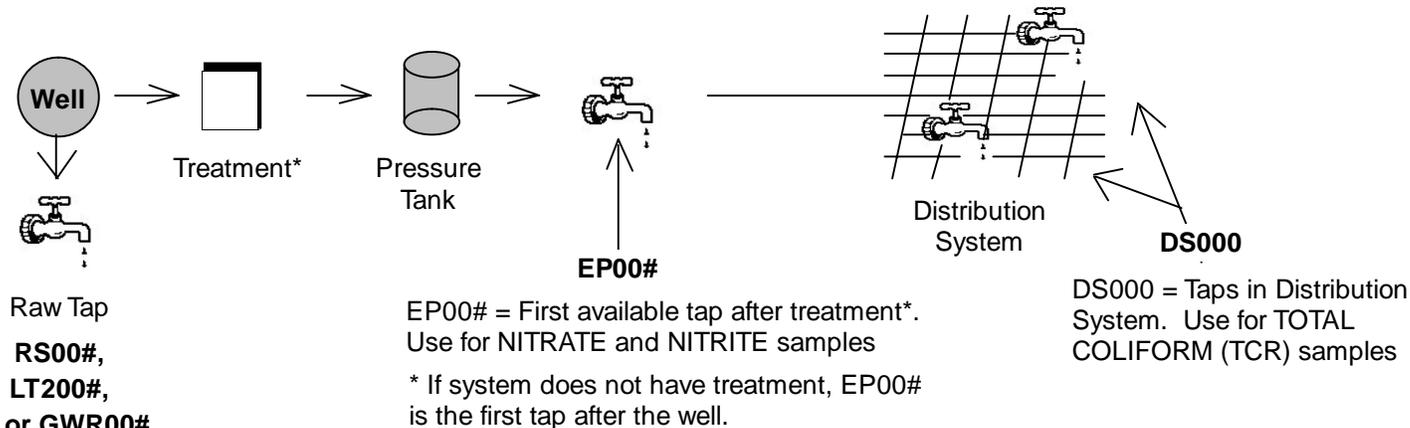

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0345212 COWEN TRUCK LINES

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **352809** Facility Name: **COWEN TRUCK LINES**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

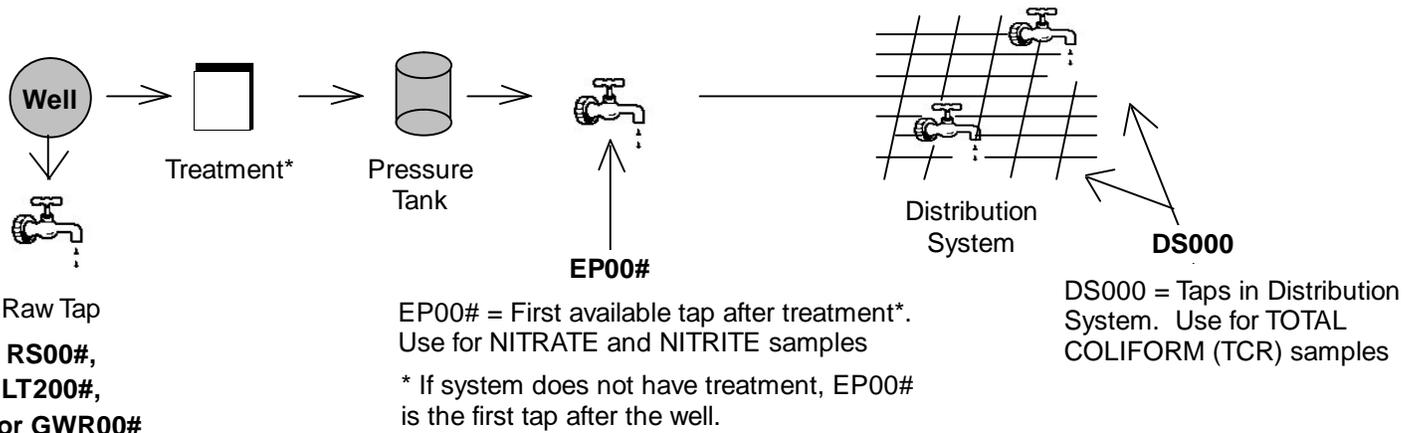

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0345312 RIVER RUN FAMILY CAMPGROUND 3 PWS

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: RIVER RUN FMLY CMPGRD 3 DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 9/30/2016

Where to Collect Samples For a Small Public Water System

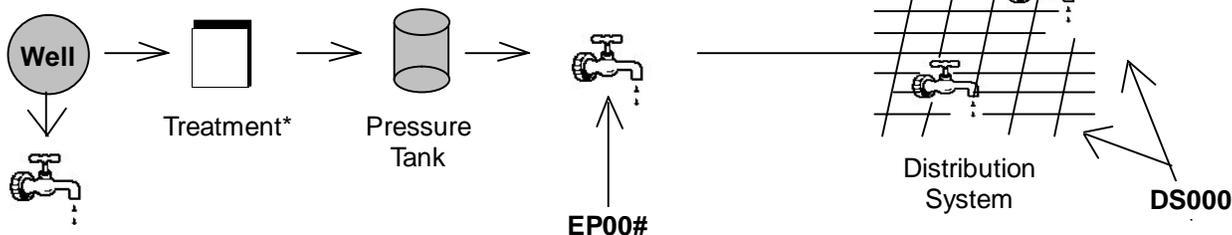

Raw Tap
RS00#,
LT200#,
or **GWR00#**

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples
* If system does not have treatment, EP00# is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0345312 RIVER RUN FAMILY CAMPGROUND 3 PWS

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **361154** Facility Name: **RIVER RUN CAMPGROUND 3**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

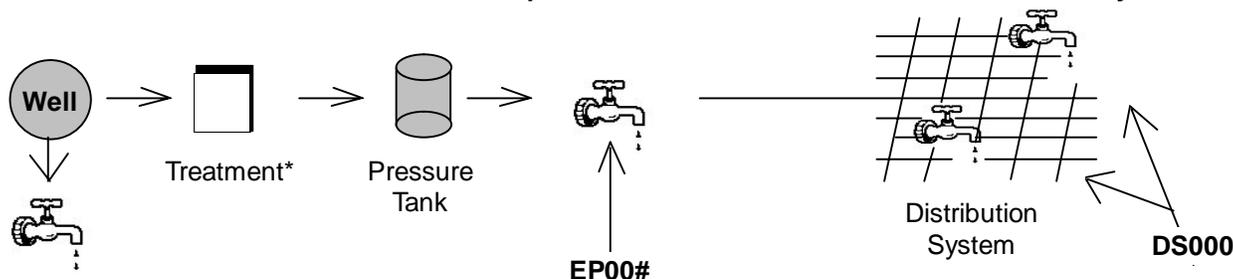

Raw Tap
RS00#,
LT200#,
or **GWR00#**

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00#
is the first tap after the well.

DS000 = Taps in Distribution
System. Use for TOTAL
COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH0345412 FIN-FEATHER-FUR OUTFITTERS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 360727	Facility Name: FIN FEATHER FUR OUTFITTERS
Location	SMP ID: EP001	Facility Source: Ground Water
		Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
ARSENIC - 1005	1 Sample(s) Required between 1/1/2016 and 3/31/2016 1 Sample(s) Required between 4/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 9/30/2016 1 Sample(s) Required between 10/1/2016 and 12/31/2016
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH0345412 FIN-FEATHER-FUR OUTFITTERS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: FIN FEATHER FUR OUTFITTERS DS	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2016 and 9/30/2016

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

TOTAL COLIFORM (TCR) - 3100

2 Sample(s) Required between 1/1/2016 and 1/31/2016

2 Sample(s) Required between 2/1/2016 and 2/29/2016

2 Sample(s) Required between 3/1/2016 and 3/31/2016

2 Sample(s) Required between 4/1/2016 and 4/30/2016

2 Sample(s) Required between 5/1/2016 and 5/31/2016

2 Sample(s) Required between 6/1/2016 and 6/30/2016

2 Sample(s) Required between 7/1/2016 and 7/31/2016

2 Sample(s) Required between 8/1/2016 and 8/31/2016

2 Sample(s) Required between 9/1/2016 and 9/30/2016

2 Sample(s) Required between 10/1/2016 and 10/31/2016

2 Sample(s) Required between 11/1/2016 and 11/30/2016

2 Sample(s) Required between 12/1/2016 and 12/31/2016

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: FIN FEATHER FUR OUTFITTERS DS ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH0345512 MOHICAN CASTLE RESORT PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: MOHICAN CASTLE RESORT DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

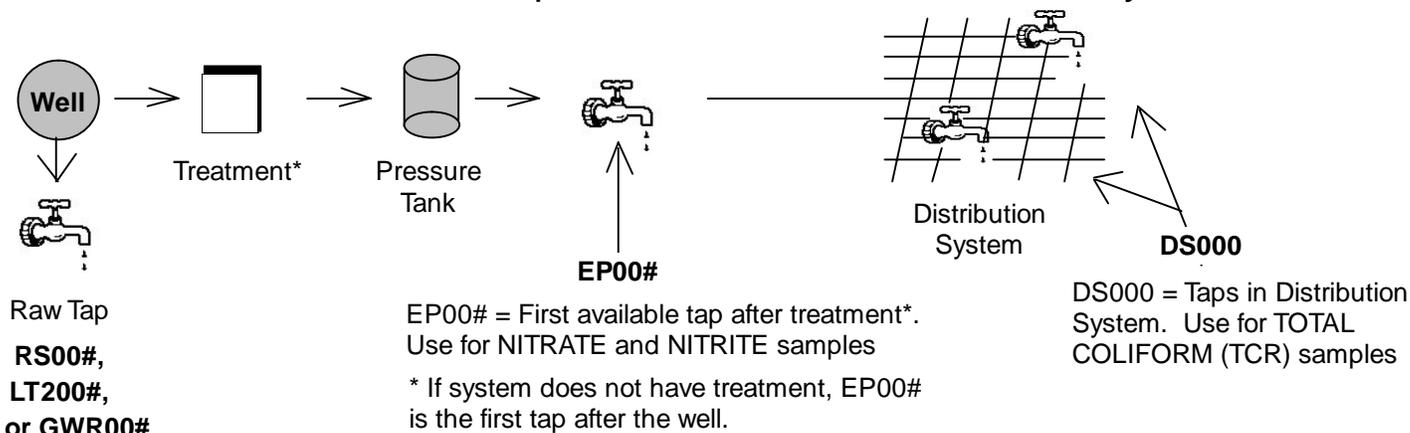

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0345512 MOHICAN CASTLE RESORT PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 361100	Facility Name: WILDERNESS LANDOLLS MOHICAN CASTLE RESOR
Location SMP ID: EP001	Facility Source: Ground Water
	Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

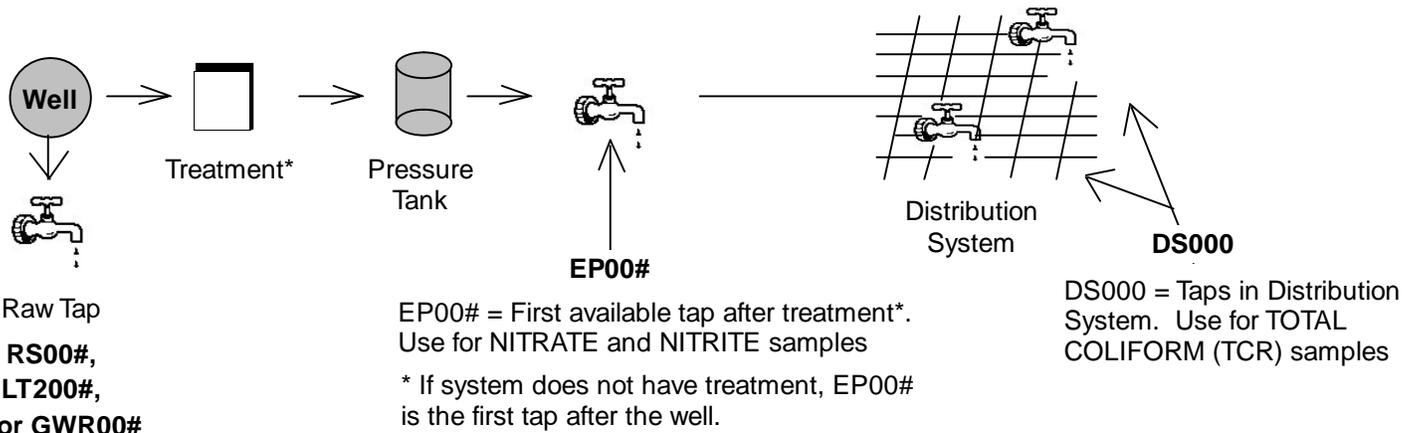

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0345912 CHURCH OF CHRIST - ASHLAND

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CHURCH OF CHRIST - ASHLAND DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

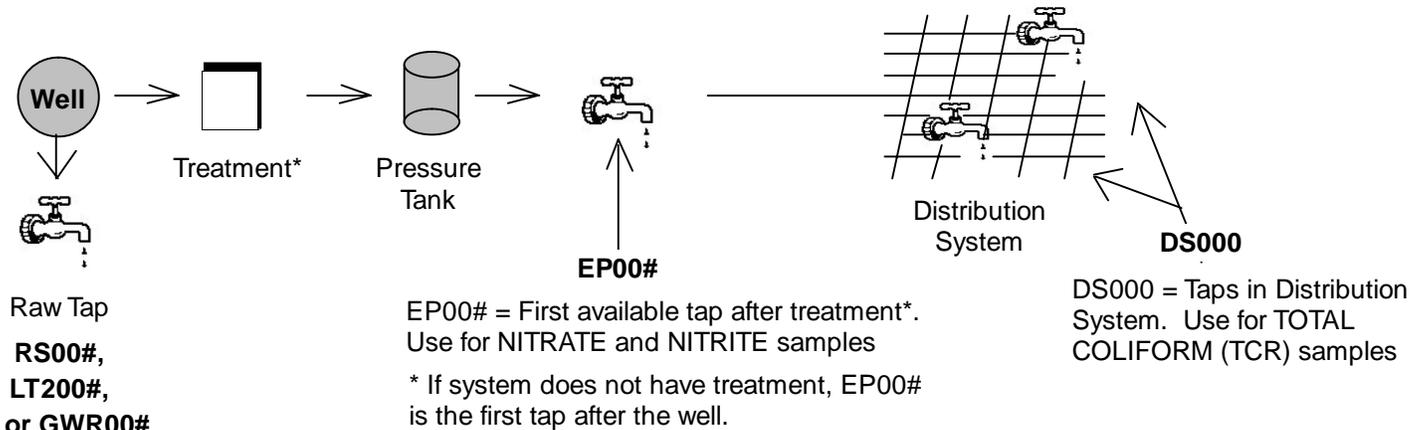

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0345912 CHURCH OF CHRIST - ASHLAND

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 361752	Facility Name: CHURCH OF CHRIST - ASHLAND
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

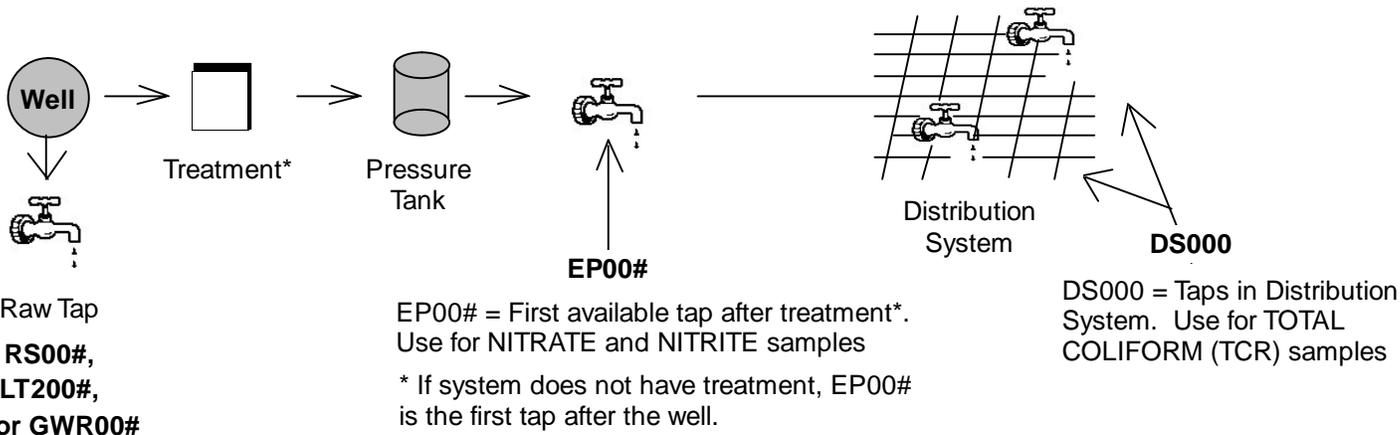

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0346112 FIRST BAPTIST CHURCH OF ASHLAND 2 PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: FIRST BAPTIST CHURCH ASHLAND DISTRIBUTIO
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

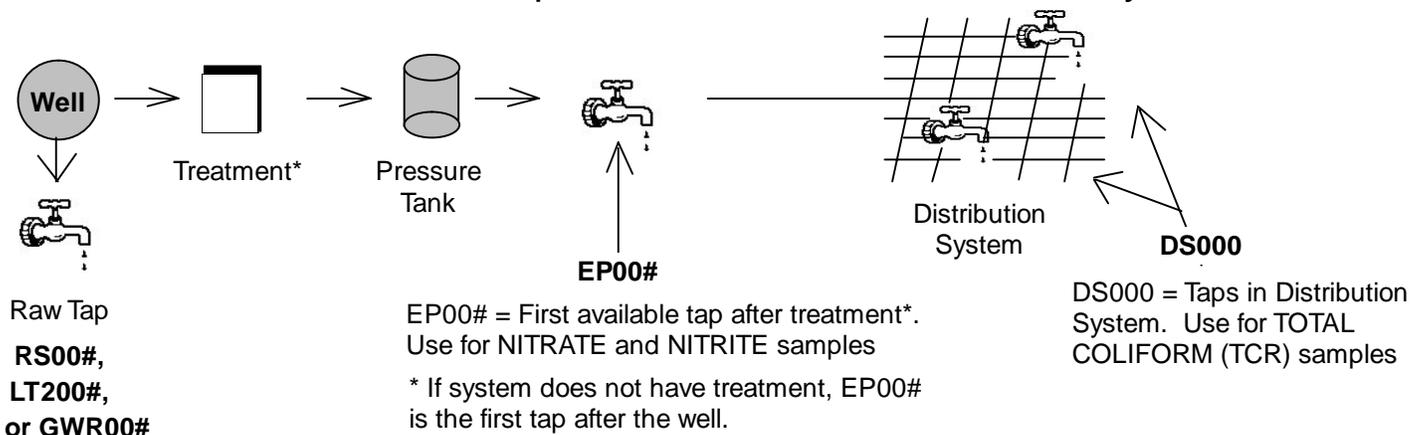

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH0346112 FIRST BAPTIST CHURCH OF ASHLAND 2 PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **362478** Facility Name: **FIRST BAPTIST CHURCH**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

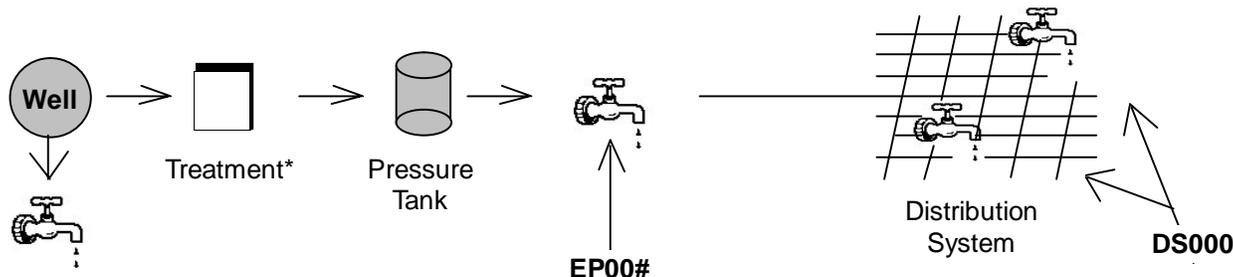

Raw Tap
RS00#,
LT200#,
or **GWR00#**

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00#
is the first tap after the well.

DS000 = Taps in Distribution
System. Use for TOTAL
COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 11/18/2016

2016 ENTRY POINT SCHEDULE

OH0346114 SCENIC RIDGE CHURCH AND CHRISTIAN SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 362480	Facility Name: SCENIC RIDGE CHURCH AND CHRISTIAN SCHOOL	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS A

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

NITRATE - 1040

1 Sample(s) Required between 10/1/2016 and 12/31/2016



Effective Date: 11/18/2016

2016 DISTRIBUTION SCHEDULE

OH0346114 SCENIC RIDGE CHURCH AND CHRISTIAN SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: DISTRIBUTION
	SMP ID: DS000	

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between 10/1/2016 and 12/31/2016