



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

OH1600012 COSHOCTON PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1653599	Facility Name: COSHOCTON WTP	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS 3

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH1600012 COSHOCTON PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: COSHOCTON DISTRIBUTION	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

TOTAL COLIFORM (TCR) - 3100	10 Sample(s) Required between	1/1/2016	and	1/31/2016
	10 Sample(s) Required between	2/1/2016	and	2/29/2016
	10 Sample(s) Required between	3/1/2016	and	3/31/2016
	10 Sample(s) Required between	4/1/2016	and	4/30/2016
	10 Sample(s) Required between	5/1/2016	and	5/31/2016
	10 Sample(s) Required between	6/1/2016	and	6/30/2016
	10 Sample(s) Required between	7/1/2016	and	7/31/2016
	10 Sample(s) Required between	8/1/2016	and	8/31/2016
	10 Sample(s) Required between	9/1/2016	and	9/30/2016
	10 Sample(s) Required between	10/1/2016	and	10/31/2016
	10 Sample(s) Required between	11/1/2016	and	11/30/2016
	10 Sample(s) Required between	12/1/2016	and	12/31/2016

TOTAL CHLORINE - 1000	10 Sample(s) Required between	1/1/2016	and	1/31/2016
	10 Sample(s) Required between	2/1/2016	and	2/29/2016
	10 Sample(s) Required between	3/1/2016	and	3/31/2016
	10 Sample(s) Required between	4/1/2016	and	4/30/2016
	10 Sample(s) Required between	5/1/2016	and	5/31/2016
	10 Sample(s) Required between	6/1/2016	and	6/30/2016
	10 Sample(s) Required between	7/1/2016	and	7/31/2016
	10 Sample(s) Required between	8/1/2016	and	8/31/2016
	10 Sample(s) Required between	9/1/2016	and	9/30/2016
	10 Sample(s) Required between	10/1/2016	and	10/31/2016
	10 Sample(s) Required between	11/1/2016	and	11/30/2016
	10 Sample(s) Required between	12/1/2016	and	12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: COSHOCTON DISTRIBUTION 2742 CR 271	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

OH1600012 COSHOCTON PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: COSHOCTON DISTRIBUTION 1991 OTSEGO AVE.	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS202
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

OH1600212 EDGEWOOD TERRACE MHP PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1653600	Facility Name: EDGEWOOD TERRACE MHP	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS A

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH1600212 EDGEWOOD TERRACE MHP PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: EDGEWOOD TERRACE MHP DISTRIBUTION
	SMP ID: DS000	

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 1/31/2016
	1 Sample(s) Required between 2/1/2016 and 2/29/2016
	1 Sample(s) Required between 3/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 4/30/2016
	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 10/31/2016
	1 Sample(s) Required between 11/1/2016 and 11/30/2016
	1 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2016 and 1/31/2016
	1 Sample(s) Required between 2/1/2016 and 2/29/2016
	1 Sample(s) Required between 3/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 4/30/2016
	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 10/31/2016
	1 Sample(s) Required between 11/1/2016 and 11/30/2016
	1 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: EDGEWOOD TERRACE MHP DISTRIBUTION
	SMP ID: DS201	ADDRESS NOT KNOWN

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

OH1600412 HOUSE OF JACOB

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1653602	Facility Name: HOUSE OF JACOB WTP	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 3/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH1600412 HOUSE OF JACOB

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: HOUSE OF JACOB DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2016 and 9/30/2016

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between 1/1/2016 and 1/31/2016

1 Sample(s) Required between 2/1/2016 and 2/29/2016

1 Sample(s) Required between 3/1/2016 and 3/31/2016

1 Sample(s) Required between 4/1/2016 and 4/30/2016

1 Sample(s) Required between 5/1/2016 and 5/31/2016

1 Sample(s) Required between 6/1/2016 and 6/30/2016

1 Sample(s) Required between 7/1/2016 and 7/31/2016

1 Sample(s) Required between 8/1/2016 and 8/31/2016

1 Sample(s) Required between 9/1/2016 and 9/30/2016

1 Sample(s) Required between 10/1/2016 and 10/31/2016

1 Sample(s) Required between 11/1/2016 and 11/30/2016

1 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000

1 Sample(s) Required between 1/1/2016 and 1/31/2016

1 Sample(s) Required between 2/1/2016 and 2/29/2016

1 Sample(s) Required between 3/1/2016 and 3/31/2016

1 Sample(s) Required between 4/1/2016 and 4/30/2016

1 Sample(s) Required between 5/1/2016 and 5/31/2016

1 Sample(s) Required between 6/1/2016 and 6/30/2016

1 Sample(s) Required between 7/1/2016 and 7/31/2016

1 Sample(s) Required between 8/1/2016 and 8/31/2016

1 Sample(s) Required between 9/1/2016 and 9/30/2016

1 Sample(s) Required between 10/1/2016 and 10/31/2016

1 Sample(s) Required between 11/1/2016 and 11/30/2016

1 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: HOUSE OF JACOB DISTRIBUTION 25520 TOWNSHIP ROAD 39	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH1600612 WARSAW PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1653603	Facility Name: WARSAW	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH1600612 WARSAW PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: WARSAW DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2016 and 9/30/2016

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between 1/1/2016 and 1/31/2016

1 Sample(s) Required between 2/1/2016 and 2/29/2016

1 Sample(s) Required between 3/1/2016 and 3/31/2016

1 Sample(s) Required between 4/1/2016 and 4/30/2016

1 Sample(s) Required between 5/1/2016 and 5/31/2016

1 Sample(s) Required between 6/1/2016 and 6/30/2016

1 Sample(s) Required between 7/1/2016 and 7/31/2016

1 Sample(s) Required between 8/1/2016 and 8/31/2016

1 Sample(s) Required between 9/1/2016 and 9/30/2016

1 Sample(s) Required between 10/1/2016 and 10/31/2016

1 Sample(s) Required between 11/1/2016 and 11/30/2016

1 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000

1 Sample(s) Required between 1/1/2016 and 1/31/2016

1 Sample(s) Required between 2/1/2016 and 2/29/2016

1 Sample(s) Required between 3/1/2016 and 3/31/2016

1 Sample(s) Required between 4/1/2016 and 4/30/2016

1 Sample(s) Required between 5/1/2016 and 5/31/2016

1 Sample(s) Required between 6/1/2016 and 6/30/2016

1 Sample(s) Required between 7/1/2016 and 7/31/2016

1 Sample(s) Required between 8/1/2016 and 8/31/2016

1 Sample(s) Required between 9/1/2016 and 9/30/2016

1 Sample(s) Required between 10/1/2016 and 10/31/2016

1 Sample(s) Required between 11/1/2016 and 11/30/2016

1 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: WARSAW DISTRIBUTION 714 BEECH STREET	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

OH1600612 WARSAW PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: WARSAW DISTRIBUTION 197 SPRING MOUNTAIN ROAD	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

OH1600712 WEST LAFAYETTE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1653604	Facility Name: WEST LAFAYETTE WTP	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS 2

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2016 and 10/31/2016



OH1600712 WEST LAFAYETTE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: WEST LAFAYETTE DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

TOTAL COLIFORM (TCR) - 3100	3 Sample(s) Required between	1/1/2016	and	1/31/2016
	3 Sample(s) Required between	2/1/2016	and	2/29/2016
	3 Sample(s) Required between	3/1/2016	and	3/31/2016
	3 Sample(s) Required between	4/1/2016	and	4/30/2016
	3 Sample(s) Required between	5/1/2016	and	5/31/2016
	3 Sample(s) Required between	6/1/2016	and	6/30/2016
	3 Sample(s) Required between	7/1/2016	and	7/31/2016
	3 Sample(s) Required between	8/1/2016	and	8/31/2016
	3 Sample(s) Required between	9/1/2016	and	9/30/2016
	3 Sample(s) Required between	10/1/2016	and	10/31/2016
	3 Sample(s) Required between	11/1/2016	and	11/30/2016
	3 Sample(s) Required between	12/1/2016	and	12/31/2016

TOTAL CHLORINE - 1000	3 Sample(s) Required between	1/1/2016	and	1/31/2016
	3 Sample(s) Required between	2/1/2016	and	2/29/2016
	3 Sample(s) Required between	3/1/2016	and	3/31/2016
	3 Sample(s) Required between	4/1/2016	and	4/30/2016
	3 Sample(s) Required between	5/1/2016	and	5/31/2016
	3 Sample(s) Required between	6/1/2016	and	6/30/2016
	3 Sample(s) Required between	7/1/2016	and	7/31/2016
	3 Sample(s) Required between	8/1/2016	and	8/31/2016
	3 Sample(s) Required between	9/1/2016	and	9/30/2016
	3 Sample(s) Required between	10/1/2016	and	10/31/2016
	3 Sample(s) Required between	11/1/2016	and	11/30/2016
	3 Sample(s) Required between	12/1/2016	and	12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: WEST LAFAYETTE DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

OH1600712 WEST LAFAYETTE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: WEST LAFAYETTE DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS202
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH1600811 ECHOING HILLS VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1653605	Facility Name: ECHOING HILLS VILLAGE INC	Facility Class: CLASS 2
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.
 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
 Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 1/1/2016 and 5/31/2016
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 1/31/2016 1 Sample(s) Required between 2/1/2016 and 2/29/2016 1 Sample(s) Required between 3/1/2016 and 3/31/2016 1 Sample(s) Required between 4/1/2016 and 4/30/2016 1 Sample(s) Required between 5/1/2016 and 5/31/2016 1 Sample(s) Required between 6/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 7/31/2016 1 Sample(s) Required between 8/1/2016 and 8/31/2016 1 Sample(s) Required between 9/1/2016 and 9/30/2016 1 Sample(s) Required between 10/1/2016 and 10/31/2016 1 Sample(s) Required between 11/1/2016 and 11/30/2016 1 Sample(s) Required between 12/1/2016 and 12/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2016 and 6/30/2016
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2016 and 3/31/2016



Effective Date: 05/13/2016

2016 ENTRY POINT SCHEDULE

OH1600811 ECHOING HILLS VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1653605	Facility Name: ECHOING HILLS VILLAGE INC	Facility Class: CLASS 2
	SMP ID: EP001/LT2001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
TOTAL MICROCYSTINS	1 Sample Set Required WEEKLY starting June 5

Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. Both are required every week from January 1 to December 31 (reduced monitoring available from November to April). A week is defined as Sunday through Saturday. Samples must be analyzed at a lab accepted by Ohio EPA for microcystins analysis.



OH1600811 ECHOING HILLS VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1653605 SMP ID: LT2001	Facility Name: ECHOING HILLS VILLAGE INC Facility Source: Surface Water	Facility Class: CLASS 2
--------------------------	--	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016

Chemicals	Monitoring Requirements
CYANOBACTERIA SCREENING	1 Sample(s) Required between 6/12/2016 and 6/18/2016
	1 Sample(s) Required between 6/26/2016 and 7/2/2016
	1 Sample(s) Required between 7/10/2016 and 7/16/2016
	1 Sample(s) Required between 7/24/2016 and 7/30/2016
	1 Sample(s) Required between 8/7/2016 and 8/13/2016
	1 Sample(s) Required between 8/21/2016 and 8/27/2016
	1 Sample(s) Required between 9/4/2016 and 9/10/2016
	1 Sample(s) Required between 9/18/2016 and 9/24/2016
	1 Sample(s) Required between 10/2/2016 and 10/8/2016
	1 Sample(s) Required between 10/16/2016 and 10/22/2016
	1 Sample(s) Required between 10/30/2016 and 11/5/2016
	1 Sample(s) Required between 11/13/2016 and 11/19/2016
	1 Sample(s) Required between 11/27/2016 and 12/3/2016
	1 Sample(s) Required between 12/11/2016 and 12/17/2016
	1 Sample(s) Required between 12/25/2016 and 12/31/2016

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 and must be collected at the same time as the raw total microcystins sample. SAMPLES MUST BE SHIPPED OVERNIGHT ON ICE ON THE DAY OF COLLECTION AND ARRIVE AT OHIO EPA DIVISION OF ENVIRONMENTAL SERVICES BY NOON MONDAY THROUGH THURSDAY ONLY!



OH1600811 ECHOING HILLS VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: ECHOING HILLS VILLAGE DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2016 and 9/30/2016

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: http://epa.ohio.gov/ddagw/reporting.aspx

TOTAL COLIFORM (TCR) - 3100

4 Sample(s) Required between 1/1/2016 and 1/31/2016

4 Sample(s) Required between 2/1/2016 and 2/29/2016

4 Sample(s) Required between 3/1/2016 and 3/31/2016

4 Sample(s) Required between 4/1/2016 and 4/30/2016

4 Sample(s) Required between 5/1/2016 and 5/31/2016

4 Sample(s) Required between 6/1/2016 and 6/30/2016

4 Sample(s) Required between 7/1/2016 and 7/31/2016

4 Sample(s) Required between 8/1/2016 and 8/31/2016

4 Sample(s) Required between 9/1/2016 and 9/30/2016

4 Sample(s) Required between 10/1/2016 and 10/31/2016

4 Sample(s) Required between 11/1/2016 and 11/30/2016

4 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000

4 Sample(s) Required between 1/1/2016 and 1/31/2016

4 Sample(s) Required between 2/1/2016 and 2/29/2016

4 Sample(s) Required between 3/1/2016 and 3/31/2016

4 Sample(s) Required between 4/1/2016 and 4/30/2016

4 Sample(s) Required between 5/1/2016 and 5/31/2016

4 Sample(s) Required between 6/1/2016 and 6/30/2016

4 Sample(s) Required between 7/1/2016 and 7/31/2016

4 Sample(s) Required between 8/1/2016 and 8/31/2016

4 Sample(s) Required between 9/1/2016 and 9/30/2016

4 Sample(s) Required between 10/1/2016 and 10/31/2016

4 Sample(s) Required between 11/1/2016 and 11/30/2016

4 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: ECHOING HILLS VILLAGE DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

OH1601012 MILLERS ACRES HOME OWNER ASSOCIATION

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1653606	Facility Name: MILLERS ACRES HOME OWNER ASSN
Location	SMP ID: EP001	Facility Source: Ground Water
		Facility Class: CLASS A

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2016 and 10/31/2016



OH1601012 MILLERS ACRES HOME OWNER ASSOCIATION

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: MILLERS ACRES HOME OWNER DISTRIBUTI
	SMP ID: DS000	

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 1/31/2016
	1 Sample(s) Required between 2/1/2016 and 2/29/2016
	1 Sample(s) Required between 3/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 4/30/2016
	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 10/31/2016
	1 Sample(s) Required between 11/1/2016 and 11/30/2016
	1 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2016 and 1/31/2016
	1 Sample(s) Required between 2/1/2016 and 2/29/2016
	1 Sample(s) Required between 3/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 4/30/2016
	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 10/31/2016
	1 Sample(s) Required between 11/1/2016 and 11/30/2016
	1 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: MILLERS ACRES HOME OWNER DISTRIBUTI
	SMP ID: DS201	ADDRESS NOT KNOWN

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

OH1601312 BOMAC MOBILE HOME PARK

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1653609	Facility Name: BOMAC	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS A

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH1601312 BOMAC MOBILE HOME PARK

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **BOMAC DISTRIBUTION**
SMP ID: **DS000**

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022

Not Required

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between	1/1/2016	and	1/31/2016
1 Sample(s) Required between	2/1/2016	and	2/29/2016
1 Sample(s) Required between	3/1/2016	and	3/31/2016
1 Sample(s) Required between	4/1/2016	and	4/30/2016
1 Sample(s) Required between	5/1/2016	and	5/31/2016
1 Sample(s) Required between	6/1/2016	and	6/30/2016
1 Sample(s) Required between	7/1/2016	and	7/31/2016
1 Sample(s) Required between	8/1/2016	and	8/31/2016
1 Sample(s) Required between	9/1/2016	and	9/30/2016
1 Sample(s) Required between	10/1/2016	and	10/31/2016
1 Sample(s) Required between	11/1/2016	and	11/30/2016
1 Sample(s) Required between	12/1/2016	and	12/31/2016

TOTAL CHLORINE - 1000

1 Sample(s) Required between	1/1/2016	and	1/31/2016
1 Sample(s) Required between	2/1/2016	and	2/29/2016
1 Sample(s) Required between	3/1/2016	and	3/31/2016
1 Sample(s) Required between	4/1/2016	and	4/30/2016
1 Sample(s) Required between	5/1/2016	and	5/31/2016
1 Sample(s) Required between	6/1/2016	and	6/30/2016
1 Sample(s) Required between	7/1/2016	and	7/31/2016
1 Sample(s) Required between	8/1/2016	and	8/31/2016
1 Sample(s) Required between	9/1/2016	and	9/30/2016
1 Sample(s) Required between	10/1/2016	and	10/31/2016
1 Sample(s) Required between	11/1/2016	and	11/30/2016
1 Sample(s) Required between	12/1/2016	and	12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: **DS1** Facility Name: **BOMAC DISTRIBUTION**
SMP ID: **DS201** ADDRESS NOT KNOWN

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH1630112 WALHONDING HILLS CAMP

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: WALHONDING HILLS CAMP DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

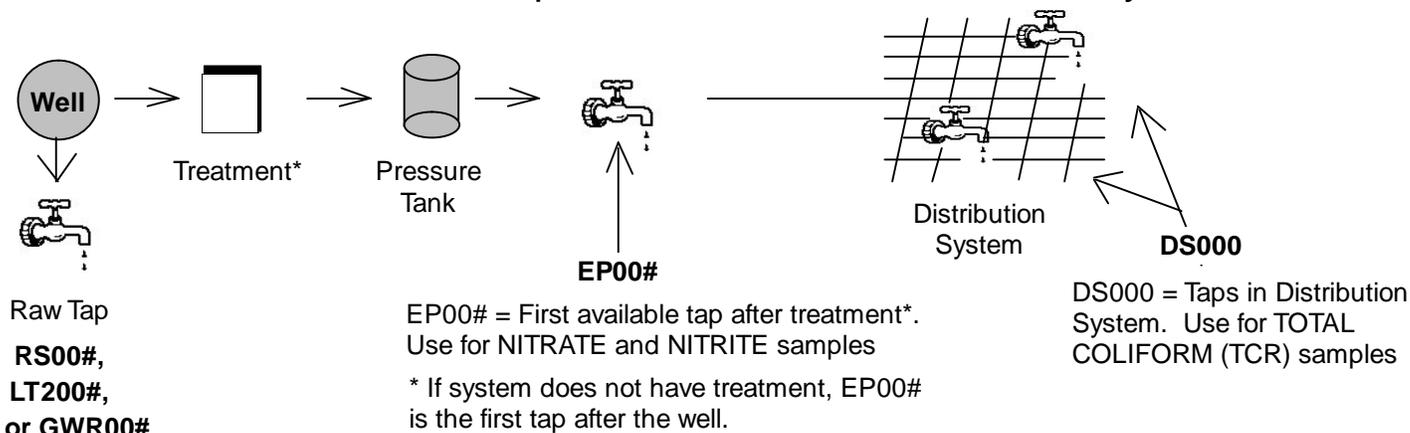

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1630112 WALHONDING HILLS CAMP

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **1653610** Facility Name: **WALHONDING HILLS CAMP INC**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

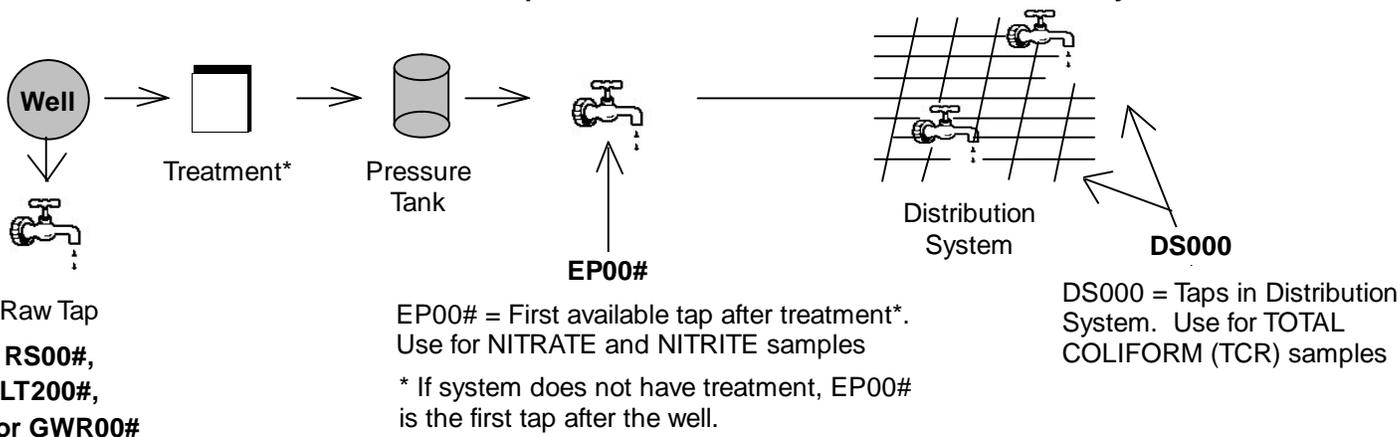

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH1630511 CONESVILLE GENERATING STATION

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1653612	Facility Name: CONESVILLE GENERATING STATION
Location	SMP ID: EP001	Facility Source: Ground Water Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2016 and 10/31/2016



OH1630511 CONESVILLE GENERATING STATION

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **CONESVILLE GENERATING ST DISTRIBUTIO** Facility Class: **CLASS 1**
SMP ID: **DS000**

Chemicals **Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 Not Required

TOTAL COLIFORM (TCR) - 3100
1 Sample(s) Required between 1/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000
1 Sample(s) Required between 1/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: **DS1** Facility Name: **CONESVILLE GENERATING ST DISTRIBUTIO** Facility Class: **CLASS 1**
SMP ID: **DS201** ADDRESS NOT KNOWN

Chemicals **Monitoring Requirements**

DISINFECTION BYPRODUCTS
1 Sample(s) Required between 2/1/2016 and 2/7/2016 at SMP: DS201
1 Sample(s) Required between 5/1/2016 and 5/7/2016 at SMP: DS201
1 Sample(s) Required between 8/1/2016 and 8/7/2016 at SMP: DS201
1 Sample(s) Required between 11/1/2016 and 11/7/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH1630712 CONESVILLE ELEMENTARY SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1653614	Facility Name: CONESVILLE ELEMENTARY SCHOOL
Location	SMP ID: EP001	Facility Source: Ground Water Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
DIOXIN - 2063	1 Sample(s) Required between 4/1/2016 and 6/30/2016
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 7/1/2016 and 9/30/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH1630712 CONESVILLE ELEMENTARY SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **CONESVILLE ELEMENTARY SC DISTRIBUTIC** Facility Class: **CLASS 1**
SMP ID: **DS000**

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2016 and 9/30/2016

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

TOTAL COLIFORM (TCR) - 3100
1 Sample(s) Required between 1/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000
1 Sample(s) Required between 1/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: **DS1** Facility Name: **CONESVILLE ELEMENTARY SC DISTRIBUTIC** Facility Class: **CLASS 1**
SMP ID: **DS201** ADDRESS NOT KNOWN

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH1631112 FOREST HILL LAKE, INC.-CAMP PWS

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: FOREST HILL LAKE, INC.-C DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 9/30/2016

Where to Collect Samples For a Small Public Water System

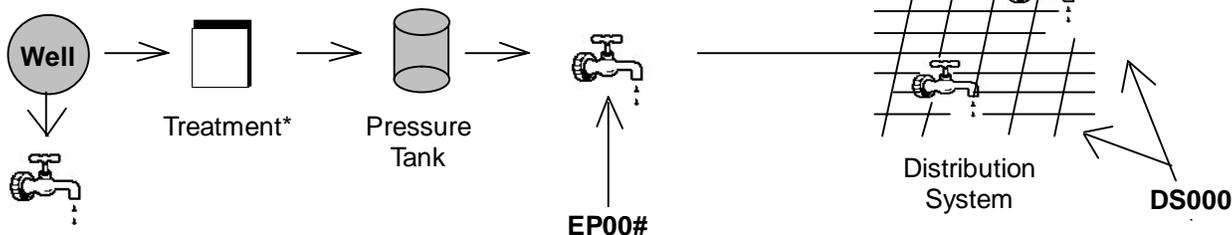

Raw Tap
RS00#,
LT200#,
or **GWR00#**

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples
* If system does not have treatment, EP00# is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1631112 FOREST HILL LAKE, INC.-CAMP PWS

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **1653616** Facility Name: **FOREST HILL LAKE INC CAMP**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

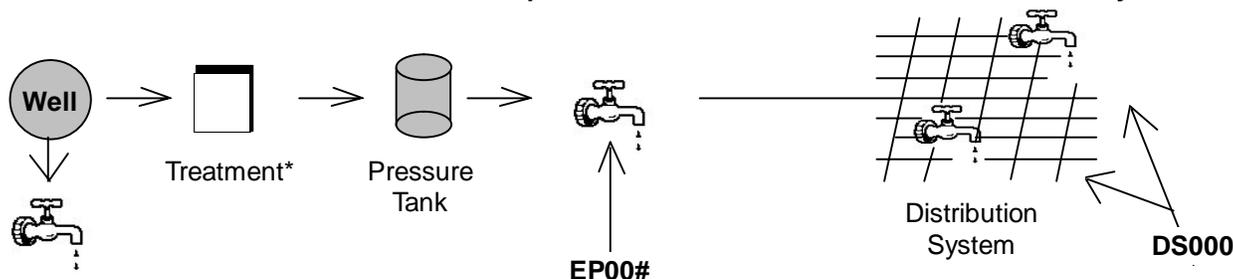

Raw Tap
RS00#,
LT200#,
or **GWR00#**

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples
* If system does not have treatment, EP00#
is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1631212 FOREST HILL LAKE, INC.-FSO PWS

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: FOREST HILL LAKE, INC.-F DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 9/30/2016

Where to Collect Samples For a Small Public Water System

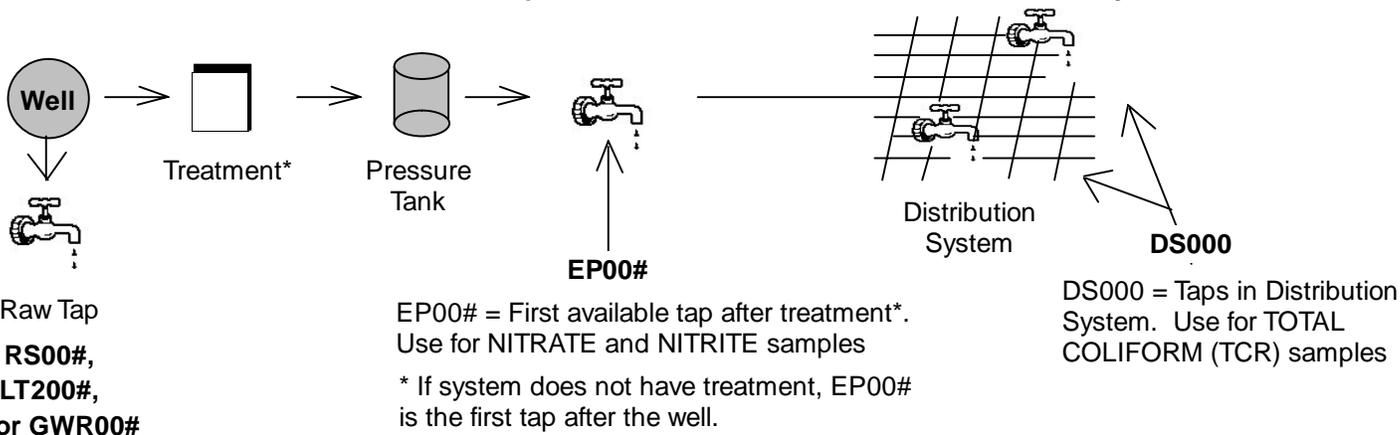

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1631212 FOREST HILL LAKE, INC.-FSO PWS

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **1653617** Facility Name: **FOREST HILL LAKE INC FSO**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

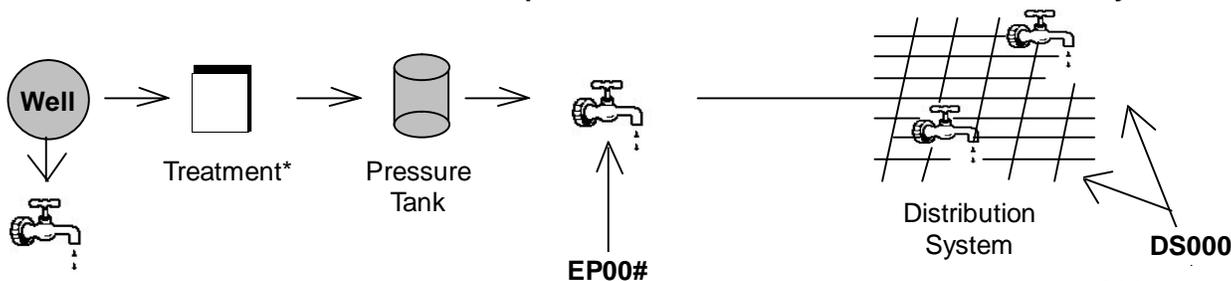

Raw Tap
RS00#,
LT200#,
 or **GWR00#**

EP00# = First available tap after treatment*.
 Use for NITRATE and NITRITE samples
 * If system does not have treatment, EP00#
 is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1631612 HICKORY FLAT GOLF COURSE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: HICKORY FLAT GOLF COURSE DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

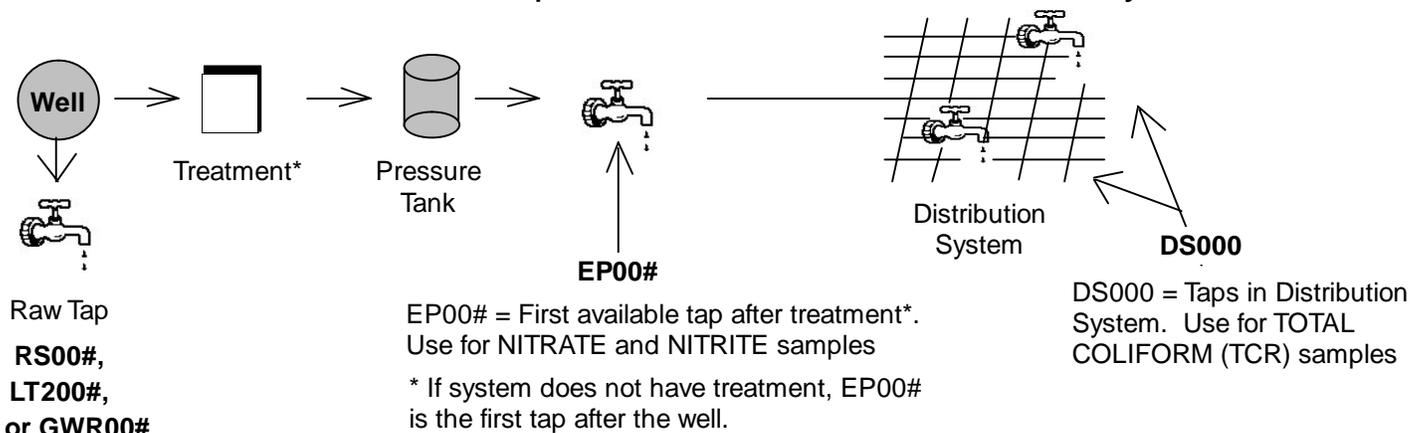

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1631612 HICKORY FLAT GOLF COURSE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **1653619** Facility Name: **HICKORY FLAT GOLF COURSE**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

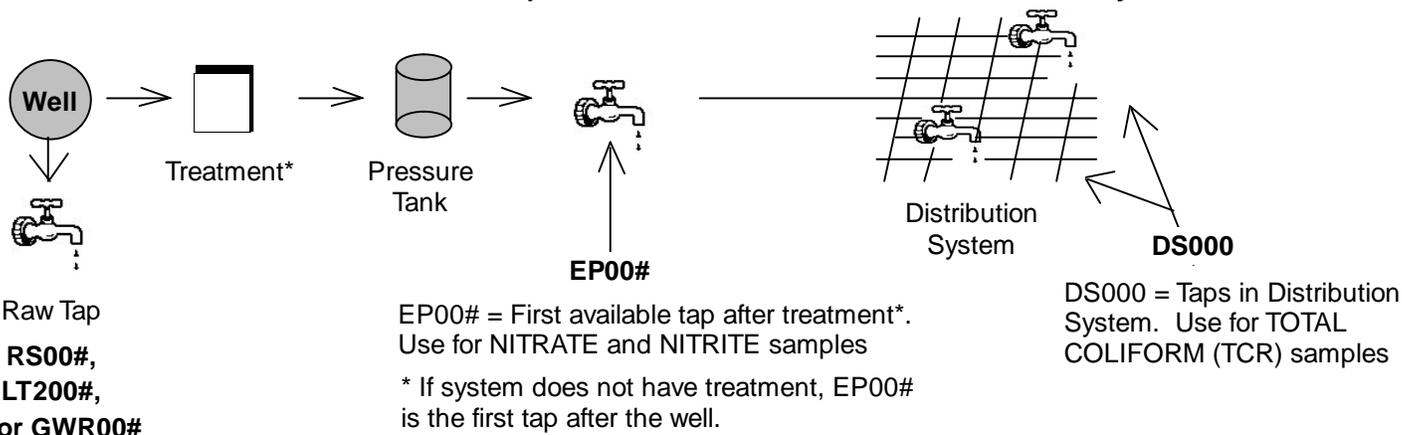

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

OH1632012 KEENE ELEMENTARY SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1653621	Facility Name: KEENE ELEMENTARY SCHOOL	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH1632012 KEENE ELEMENTARY SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **KEENE ELEMENTARY SCHOOL DISTRIBUTIO** Facility Class: **CLASS 1**
SMP ID: **DS000**

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2016 and 9/30/2016

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

TOTAL COLIFORM (TCR) - 3100
1 Sample(s) Required between 1/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000
1 Sample(s) Required between 1/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: **DS1** Facility Name: **KEENE ELEMENTARY SCHOOL DISTRIBUTIO** Facility Class: **CLASS 1**
SMP ID: **DS201** ADDRESS NOT KNOWN

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH1632112 LAKE LILA (BACK WELL)

System Type: Transient Noncommunity

Operating Period: 4/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: LAKE LILA (BACK-WELL) DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

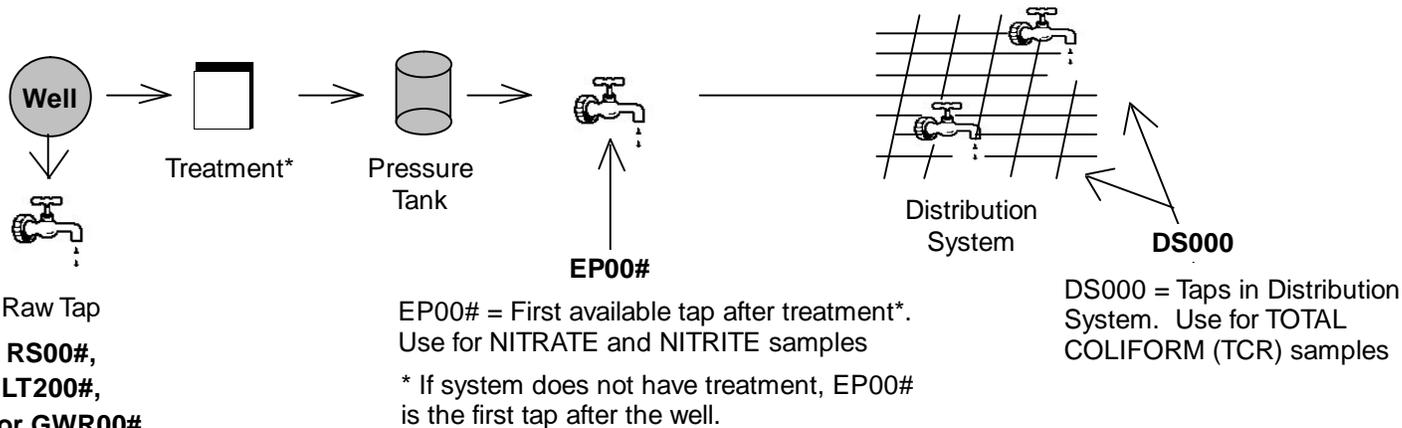

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1632112 LAKE LILA (BACK WELL)

System Type: Transient Noncommunity

Operating Period: 4/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **1653622** Facility Name: **LAKE LILA BACK WELL**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

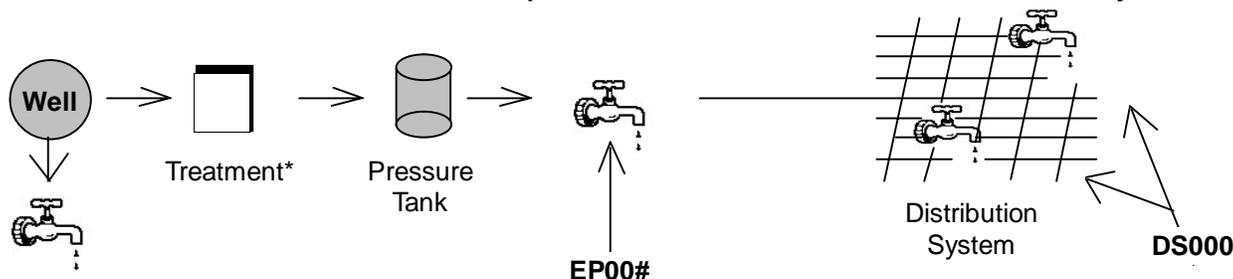

Raw Tap
RS00#,
LT200#,
or **GWR00#**

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples
* If system does not have treatment, EP00#
is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1632212 LAKE LILA (FRONT-WELL)

System Type: Transient Noncommunity

Operating Period: 4/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: LAKE LILA (FRONT-WELL) DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

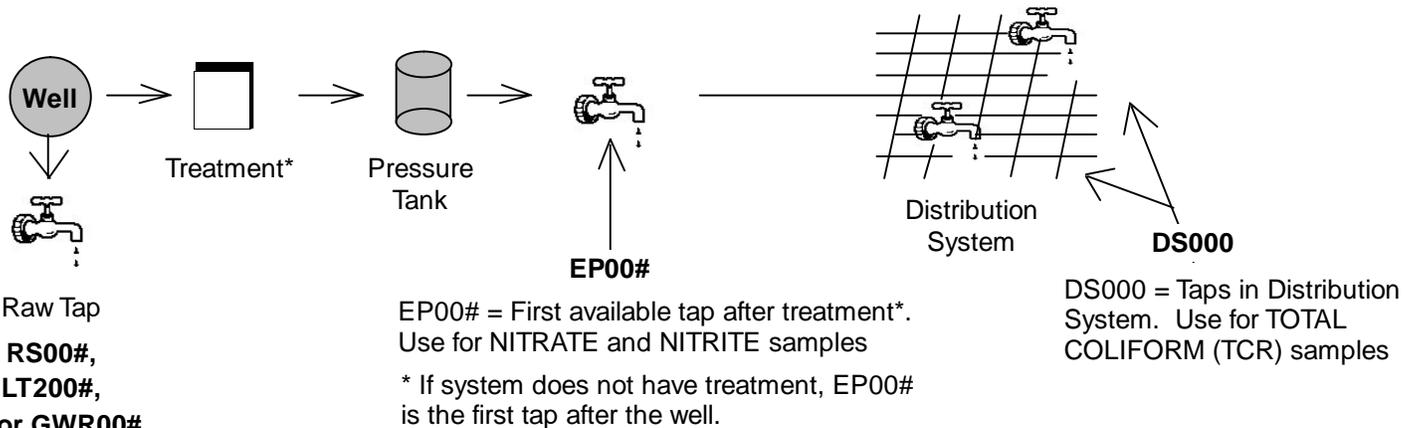

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1632212 LAKE LILA (FRONT-WELL)

System Type: Transient Noncommunity

Operating Period: 4/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **1653623** Facility Name: **LAKE LILA FRONT WELL**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

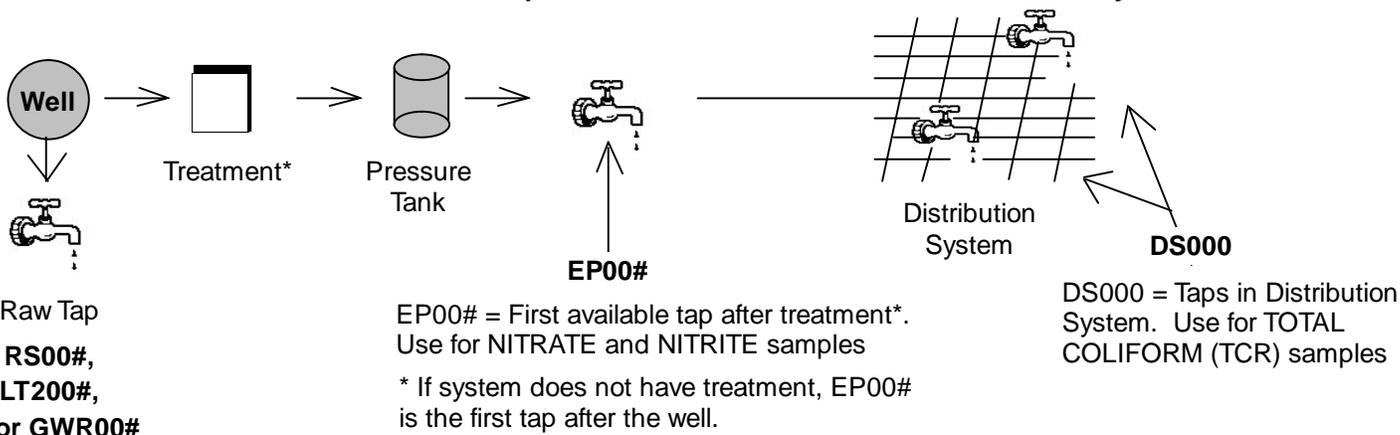

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1632312 PEGGY SUES STEAK AND RIBS PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: PEGGY SUES STEAK & RIBS DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

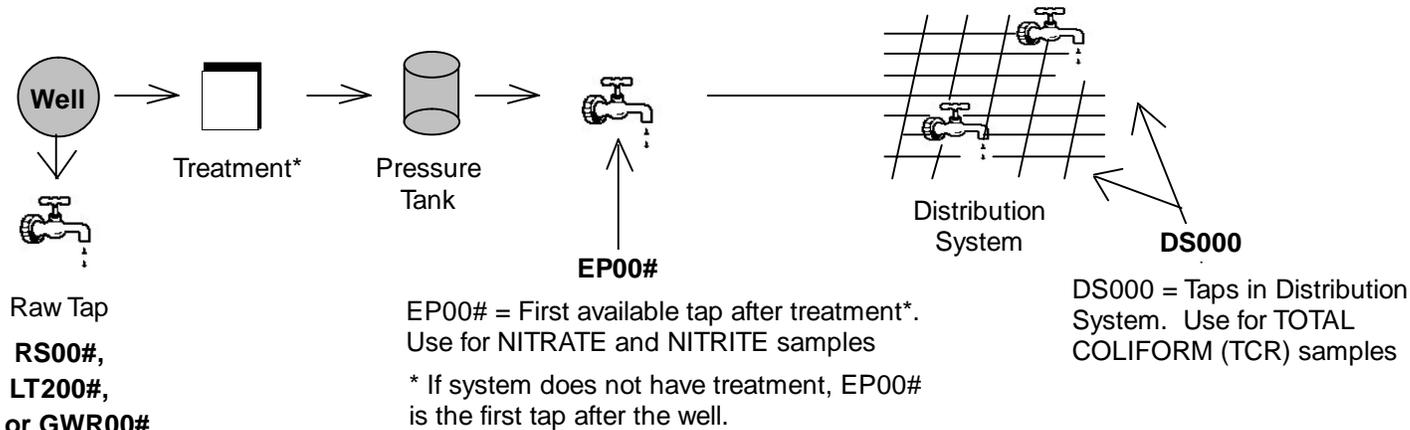

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1632312 PEGGY SUES STEAK AND RIBS PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **1653624** Facility Name: **PEGGY SUES STEAK & RIBS**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

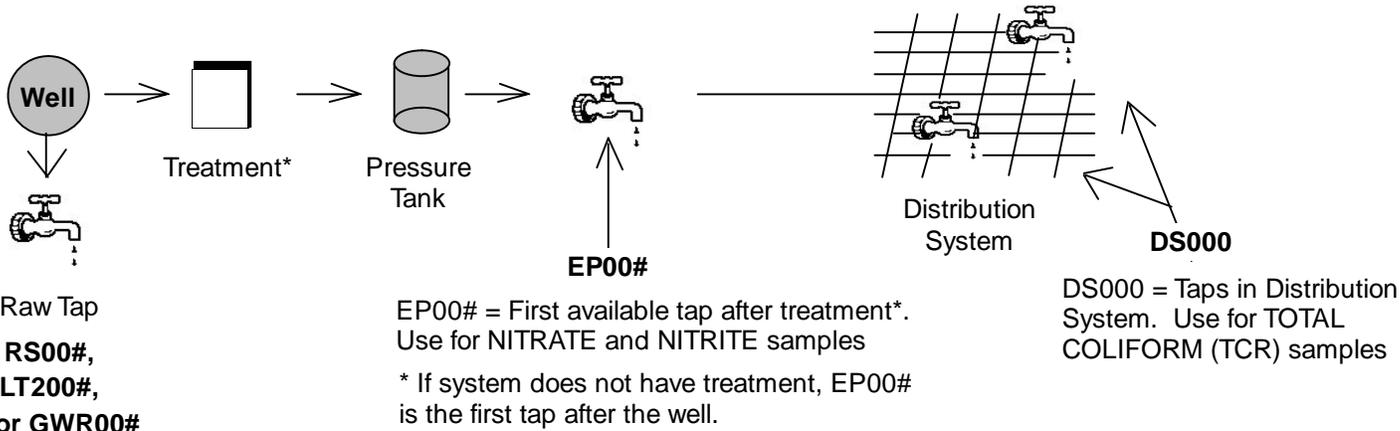

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1632512 MUSKINGUM VALLEY SCOUT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: MUSKINGUM VALLEY SCOUT DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

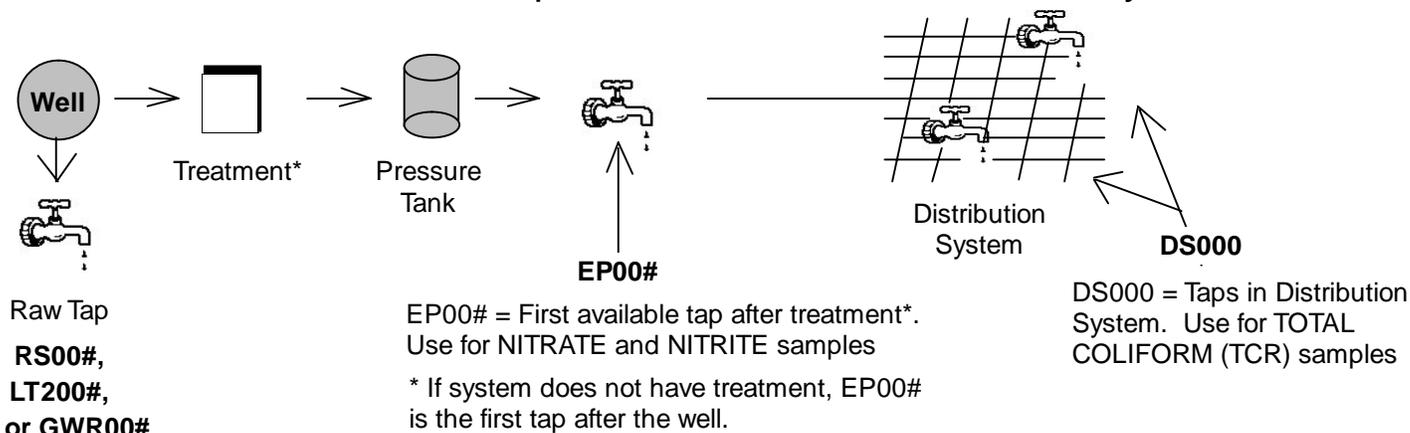

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1632512 MUSKINGUM VALLEY SCOUT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653625	Facility Name: MUSKINGUM VALLEY SCOUT RESERVATION
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

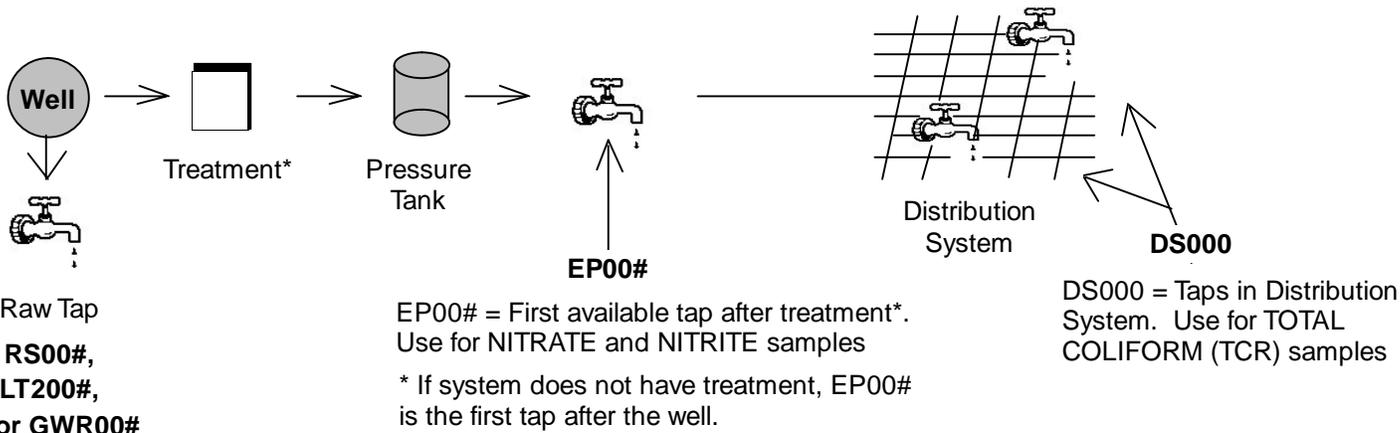

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1632712 WHISPERING FALLS, INC.

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: WHISPERING FALLS, INC. DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

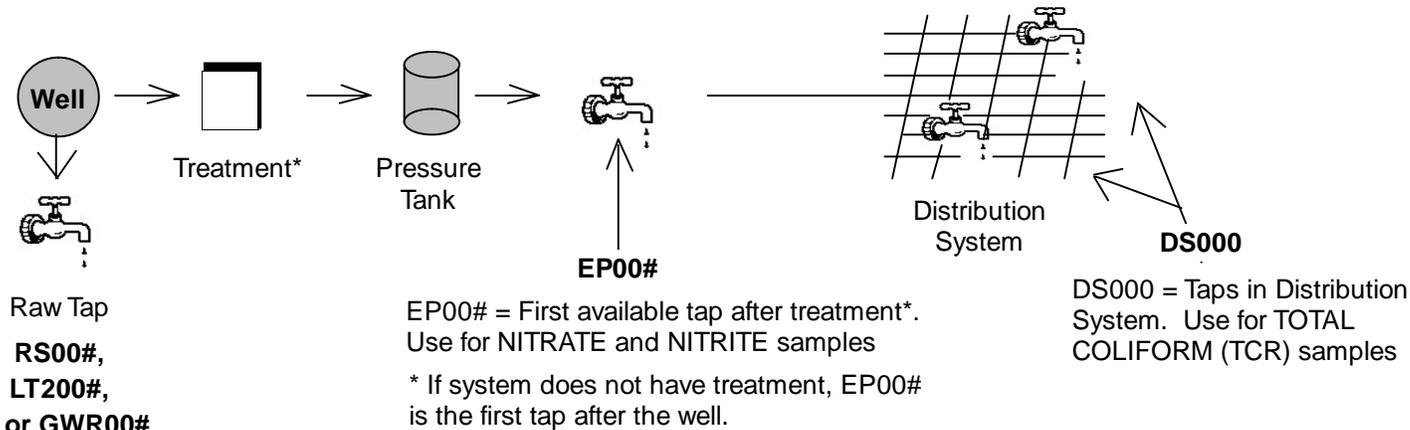

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1632712 WHISPERING FALLS, INC.

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **1653627** Facility Name: **WHISPERING FALLS INC**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

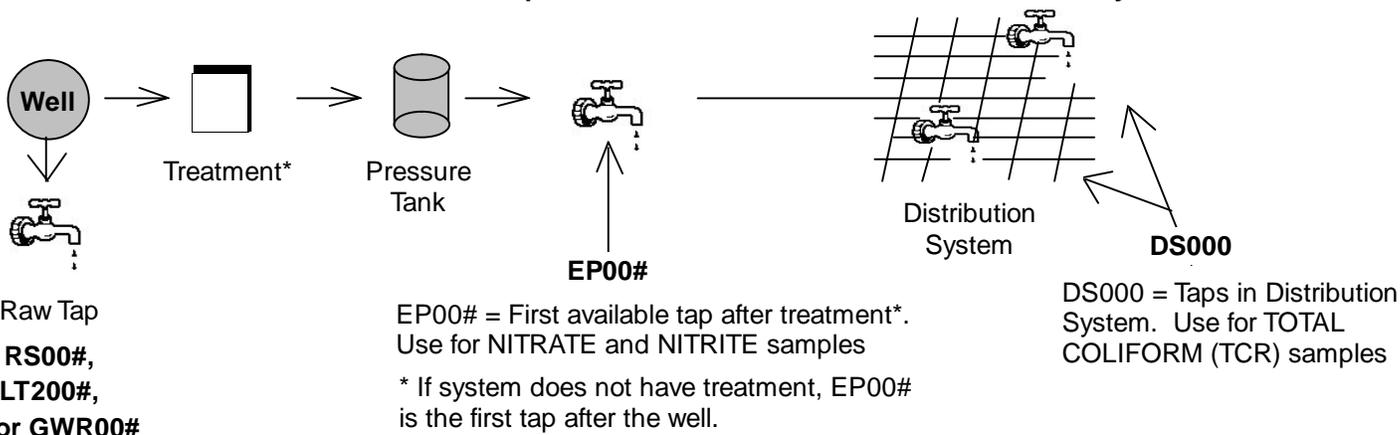

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1632812 PLAINFIELD COMMUNITY CENTER

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: PLAINFIELD COMMUNITY CNTR DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

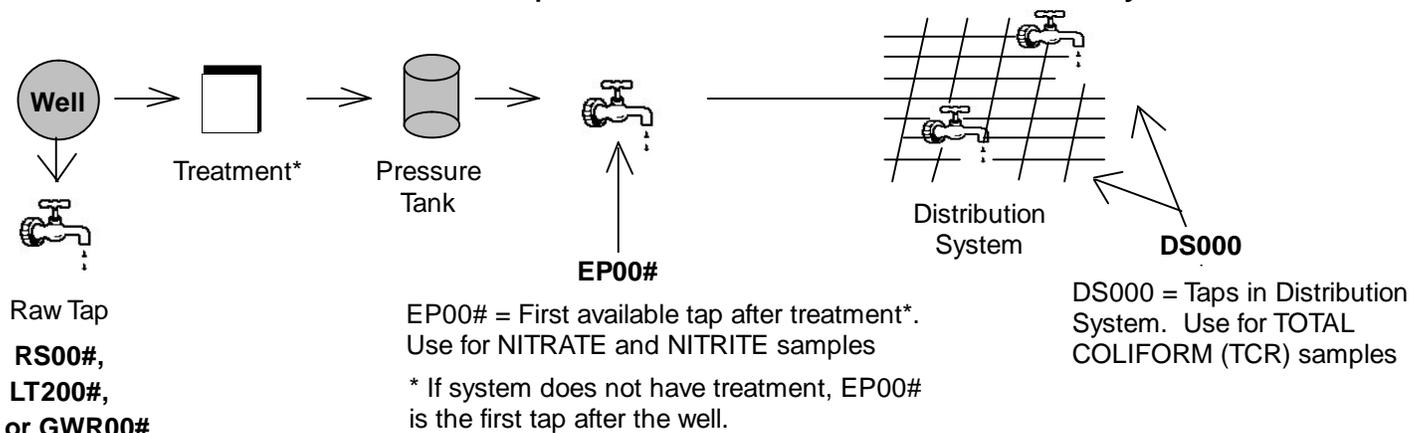

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1632812 PLAINFIELD COMMUNITY CENTER

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **1653628** Facility Name: **PLAINFIELD COMMUNITY CENTER**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2016 and 10/31/2016

Where to Collect Samples For a Small Public Water System

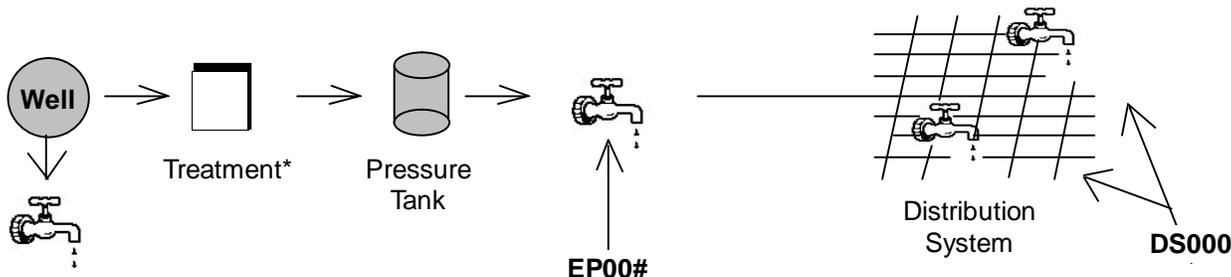

Raw Tap
RS00#,
LT200#,
or **GWR00#**

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples
* If system does not have treatment, EP00#
is the first tap after the well.

DS000 = Taps in Distribution
System. Use for TOTAL
COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1632912 RIVERGREEN GOLF PRO SHOP PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: RIVERGREEN GOLF CLUB DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

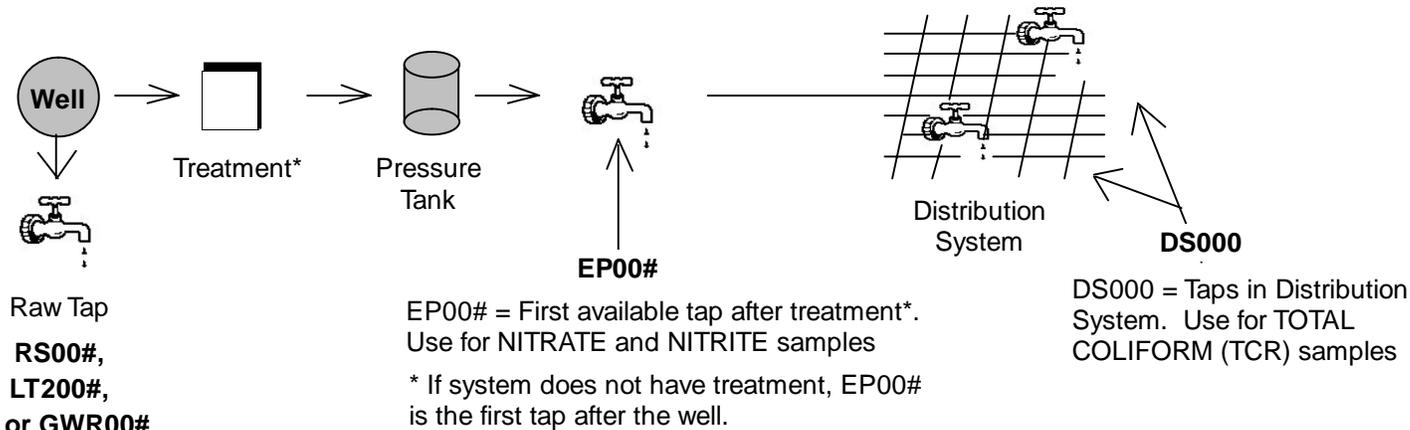

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1632912 RIVERGREEN GOLF PRO SHOP PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **1653629** Facility Name: **RIVERGREEN GOLF CLUB**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

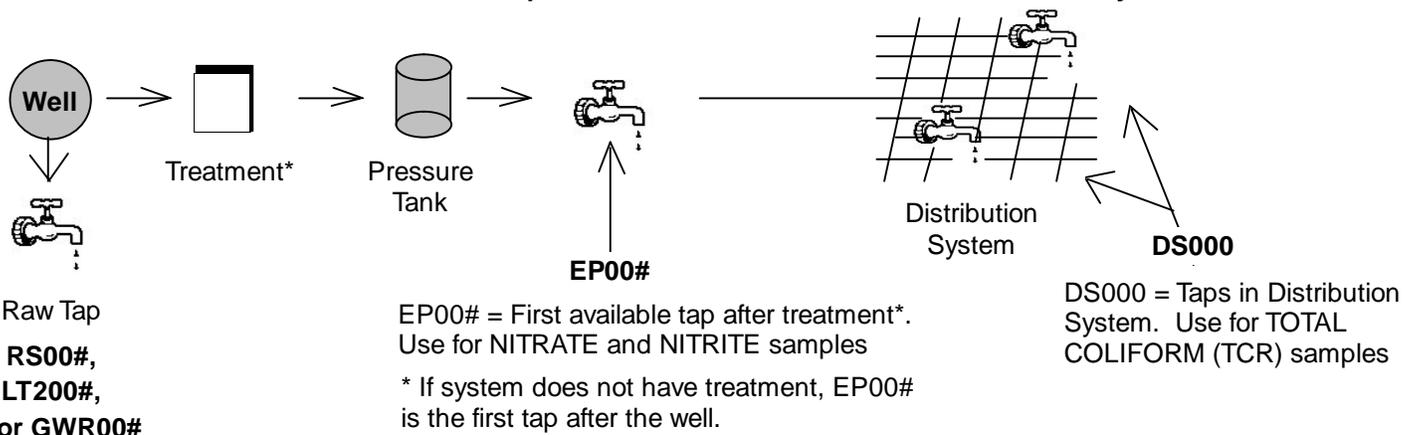

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1633012 RIVERGREEN GOLF COURSE CLUB HOUSE PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: RIVERGREEN GOLF COURSE DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

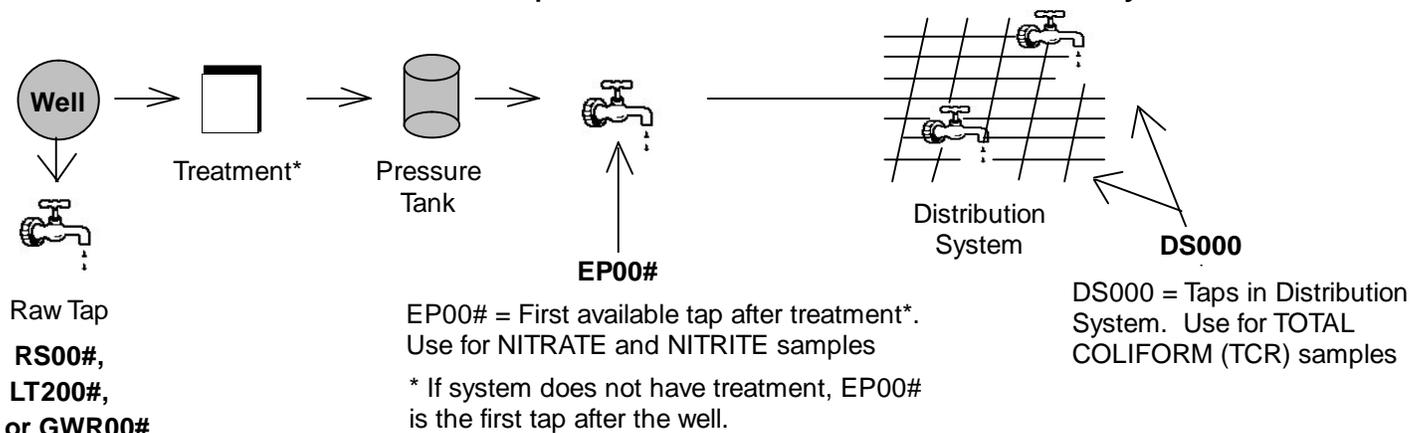

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1633012 RIVERGREEN GOLF COURSE CLUB HOUSE PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **1653630** Facility Name: **RIVERGREEN GOLF COURSE**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

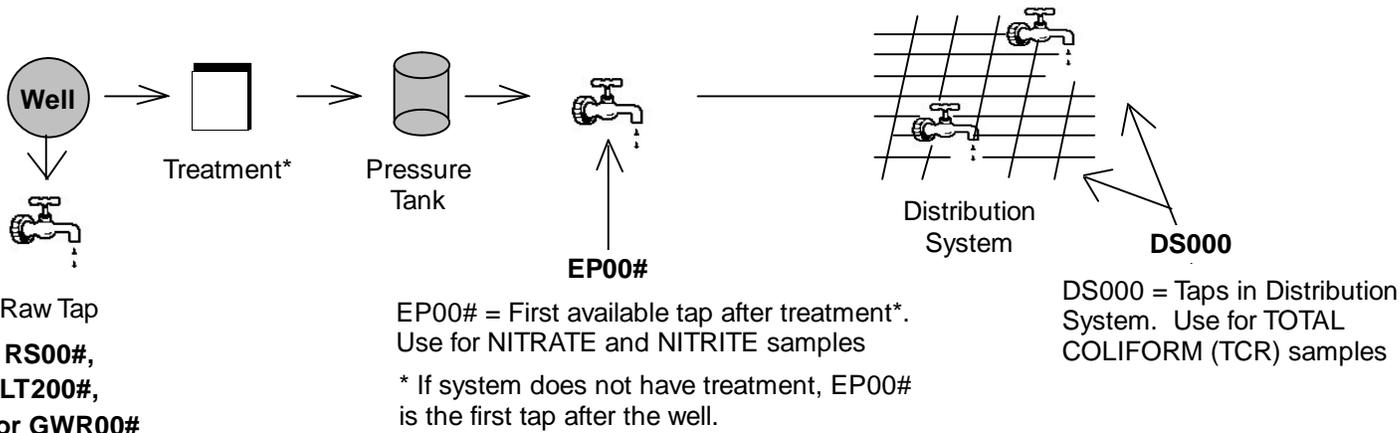

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH1633112 RIVERVIEW HIGH SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1653631	Facility Name: RIVERVIEW LOCAL SCH DIST
Location	SMP ID: EP001	Facility Source: Ground Water
		Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH1633112 RIVERVIEW HIGH SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: RIVERVIEW HIGH SCHOOL DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between	1/1/2016	and	1/31/2016
	2 Sample(s) Required between	2/1/2016	and	2/29/2016
	2 Sample(s) Required between	3/1/2016	and	3/31/2016
	2 Sample(s) Required between	4/1/2016	and	4/30/2016
	2 Sample(s) Required between	5/1/2016	and	5/31/2016
	2 Sample(s) Required between	6/1/2016	and	6/30/2016
	2 Sample(s) Required between	7/1/2016	and	7/31/2016
	2 Sample(s) Required between	8/1/2016	and	8/31/2016
	2 Sample(s) Required between	9/1/2016	and	9/30/2016
	2 Sample(s) Required between	10/1/2016	and	10/31/2016
	2 Sample(s) Required between	11/1/2016	and	11/30/2016
	2 Sample(s) Required between	12/1/2016	and	12/31/2016

TOTAL CHLORINE - 1000	2 Sample(s) Required between	1/1/2016	and	1/31/2016
	2 Sample(s) Required between	2/1/2016	and	2/29/2016
	2 Sample(s) Required between	3/1/2016	and	3/31/2016
	2 Sample(s) Required between	4/1/2016	and	4/30/2016
	2 Sample(s) Required between	5/1/2016	and	5/31/2016
	2 Sample(s) Required between	6/1/2016	and	6/30/2016
	2 Sample(s) Required between	7/1/2016	and	7/31/2016
	2 Sample(s) Required between	8/1/2016	and	8/31/2016
	2 Sample(s) Required between	9/1/2016	and	9/30/2016
	2 Sample(s) Required between	10/1/2016	and	10/31/2016
	2 Sample(s) Required between	11/1/2016	and	11/30/2016
	2 Sample(s) Required between	12/1/2016	and	12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: RIVERVIEW HIGH SCHOOL DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

OH1633112 RIVERVIEW HIGH SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: RIVERVIEW HIGH SCHOOL DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) **TOTAL HALOACETIC ACIDS (HAA5) – 2456**
- 2) **TTHM - 2950**



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

OH1633812 UNION ELEMENTARY SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1653632	Facility Name: UNION ELEMENTARY SCHOOL	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH1633812 UNION ELEMENTARY SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: UNION ELEMENTARY SCHOOL DISTRIBUTIOI
--------------------------	---	--

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2016 and 9/30/2016
-------------------------------	---

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: UNION ELEMENTARY SCHOOL DISTRIBUTIOI ADDRESS NOT KNOWN
--------------------------	---	--

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

OH1633912 AK STEEL COSHOCTON WORKS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1653633	Facility Name: AK STEEL CORP	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH1633912 AK STEEL COSHOCTON WORKS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: AK STEEL DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016 1 Sample(s) Required between 4/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 9/30/2016 1 Sample(s) Required between 10/1/2016 and 12/31/2016
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2016 and 3/31/2016 1 Sample(s) Required between 4/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 9/30/2016 1 Sample(s) Required between 10/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: AK STEEL DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH1634012 UNUSUAL SHOPPE AND JUNCTION

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: UNUSUAL SHOPPE & JUNCTIO DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

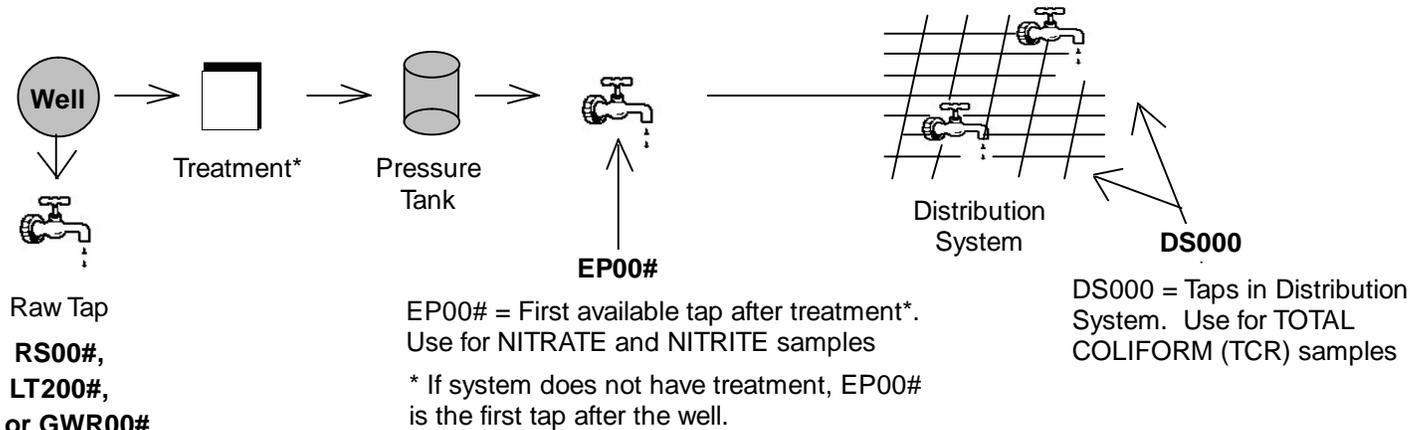

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1634012 UNUSUAL SHOPPE AND JUNCTION

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **1653634** Facility Name: **UNUSUAL SHOPPE & JUNCTION**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 3/31/2016

Where to Collect Samples For a Small Public Water System

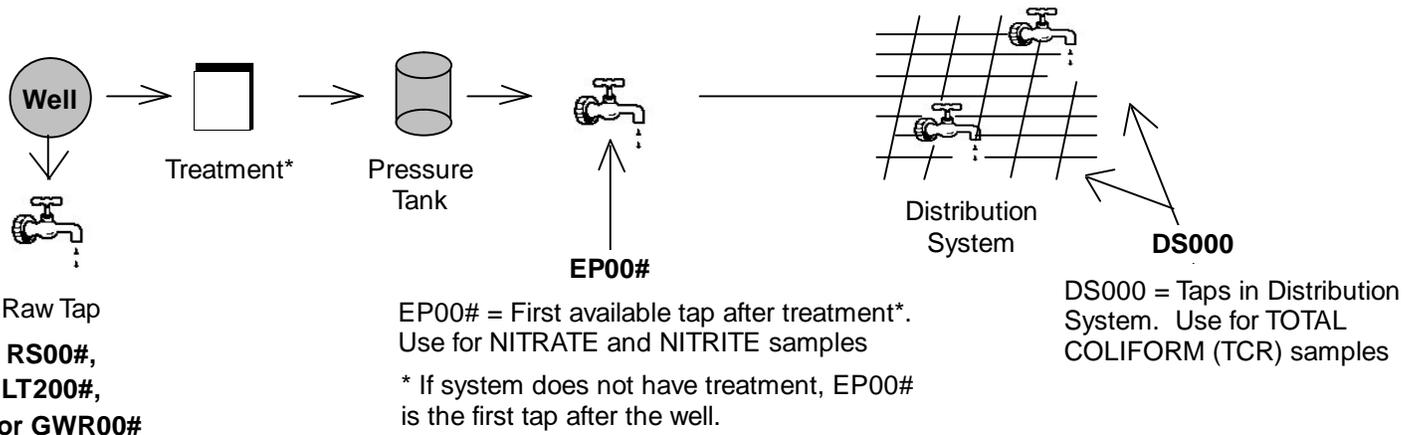

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1634612 FRESNO BIBLE CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: FRESNO BIBLE CHURCH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

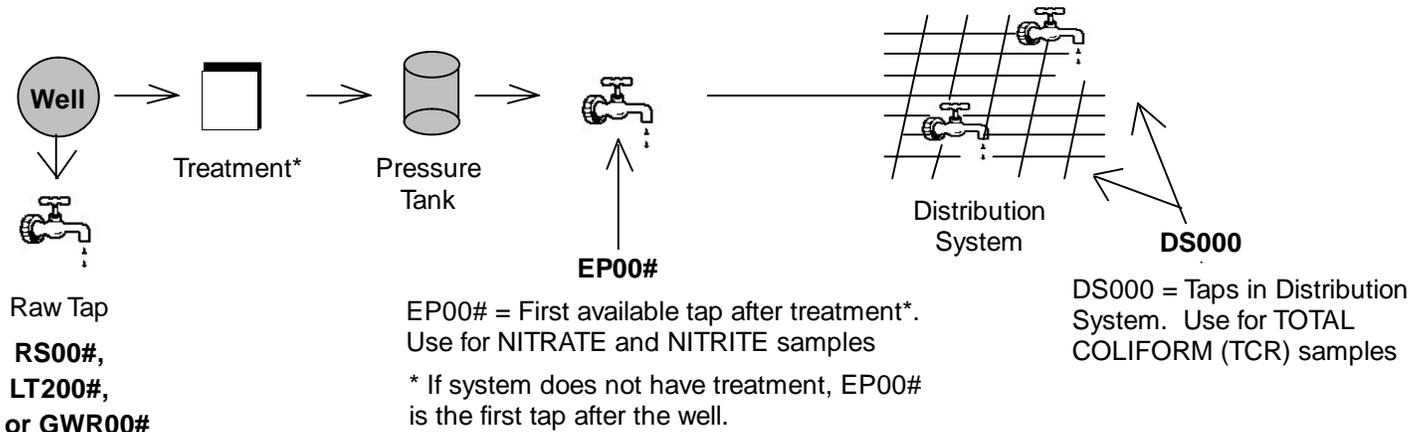

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1634612 FRESNO BIBLE CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **1653637** Facility Name: **FRESNO BIBLE CHURCH**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

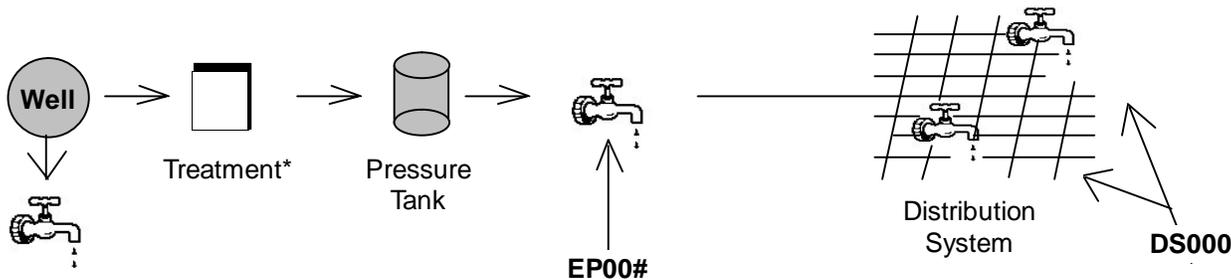

Raw Tap
RS00#,
LT200#,
 or **GWR00#**

EP00# = First available tap after treatment*.
 Use for NITRATE and NITRITE samples
 * If system does not have treatment, EP00#
 is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1635412 PILGRIM HILLS CONFERENCE CENTER PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: PILGRIM HILLS CONFERENCE CENTER DISTRIBU
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

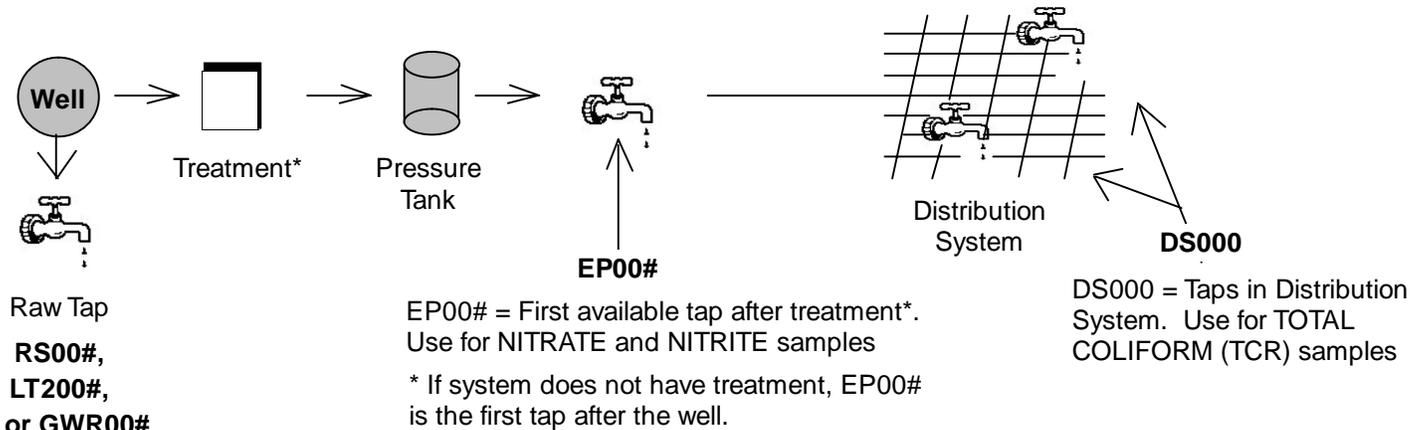

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1635412 PILGRIM HILLS CONFERENCE CENTER PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **1653639** Facility Name: **PILGRIM HILLS CONFERENCE CENTER**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

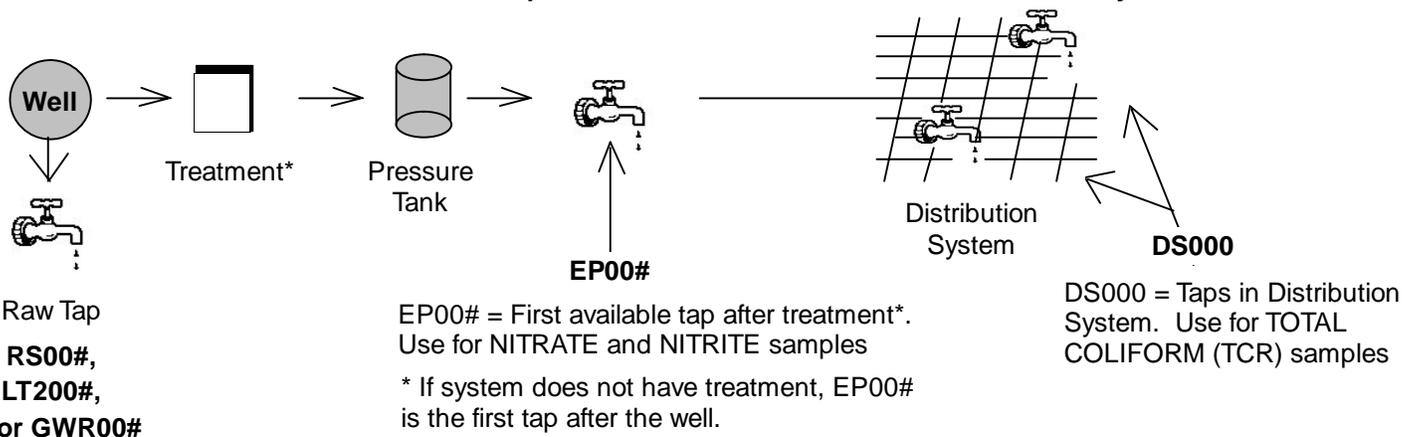

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1636512 KINGDOM HALL OF JEHOVAHS WITNESS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: KINGDOM HALL OF JEHOVAHS DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

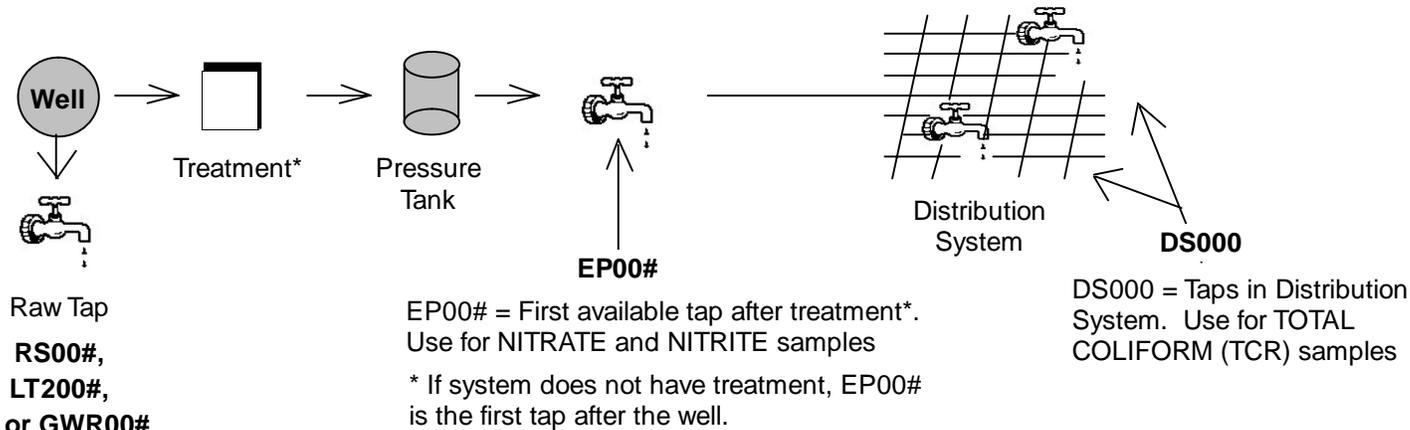

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1636512 KINGDOM HALL OF JEHOVAHS WITNESS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653648	Facility Name: KINGDOM HALL OF JEHOVAHS WITNE
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

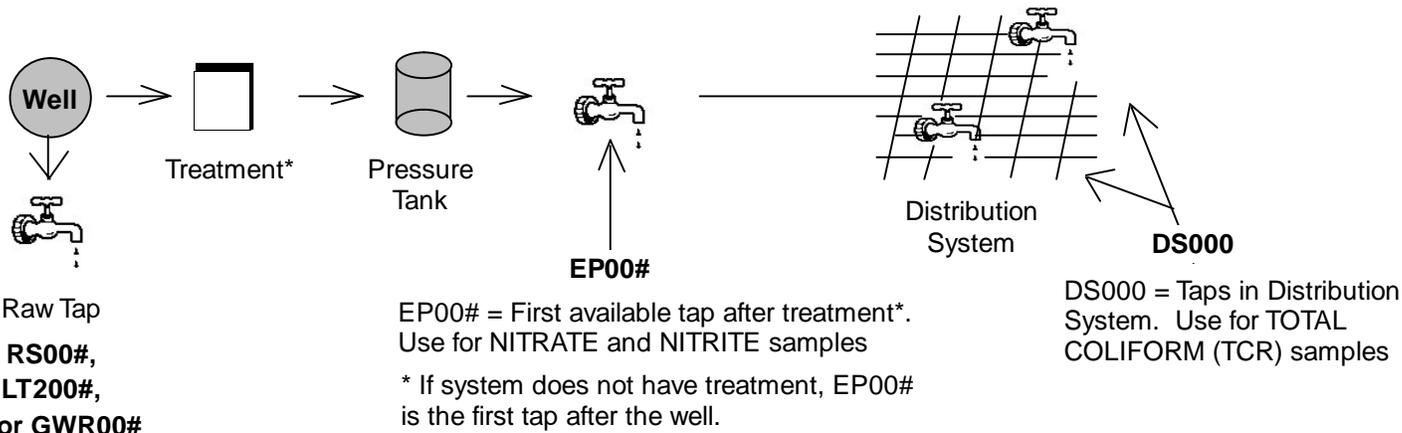

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1637012 RIVER GREENS GOLFCOURSE SHELTER PWS

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: RIVER GREEN GOLFCOURSE S DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

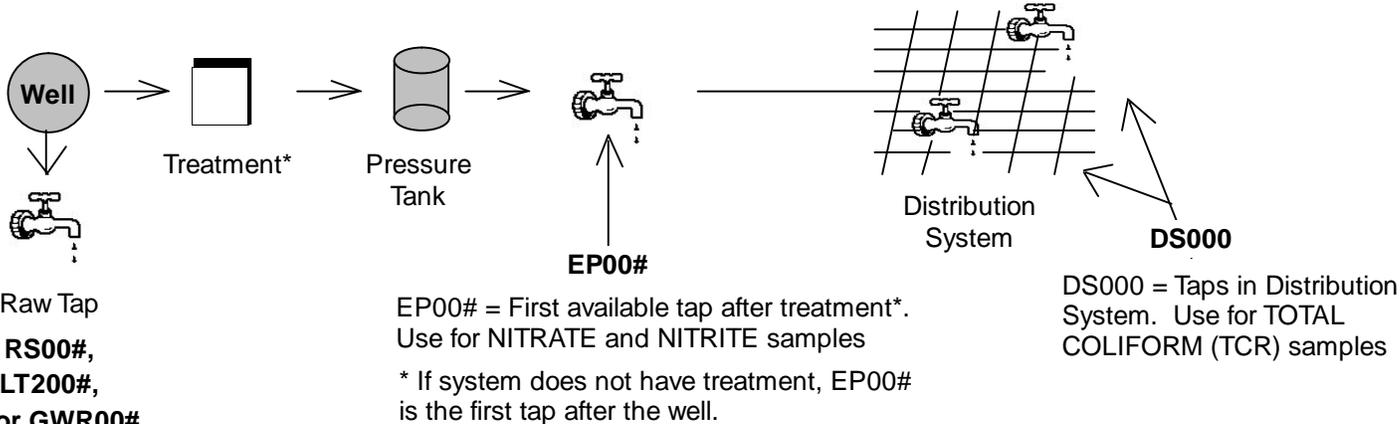

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1637012 RIVER GREENS GOLFCOURSE SHELTER PWS

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653652	Facility Name: RIVERGREENS GOLF COURSE SHELTER
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

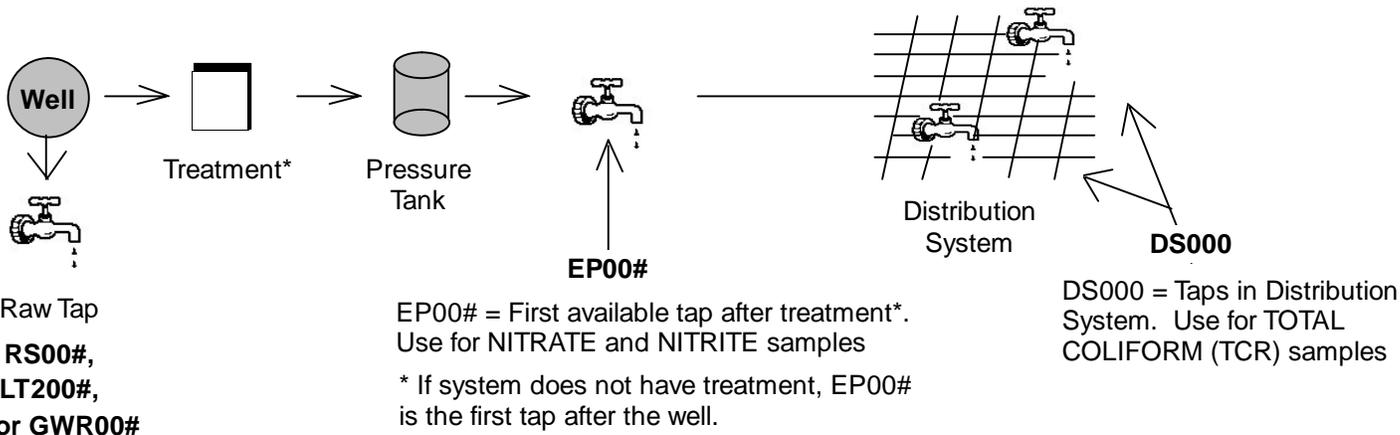

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1637212 GOSPEL HILL MINISTRY

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: GOSPEL HILL MINISTRY DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

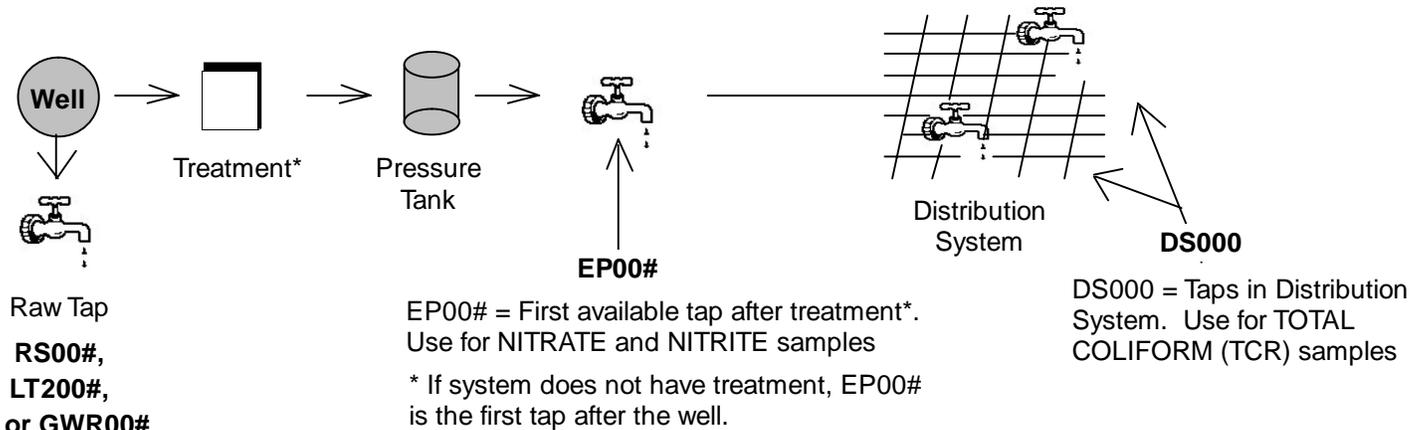

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1637212 GOSPEL HILL MINISTRY

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653654	Facility Name: GOSPEL HILL MINISTRY
Location SMP ID: EP001	Facility Source: Ground Water
	Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

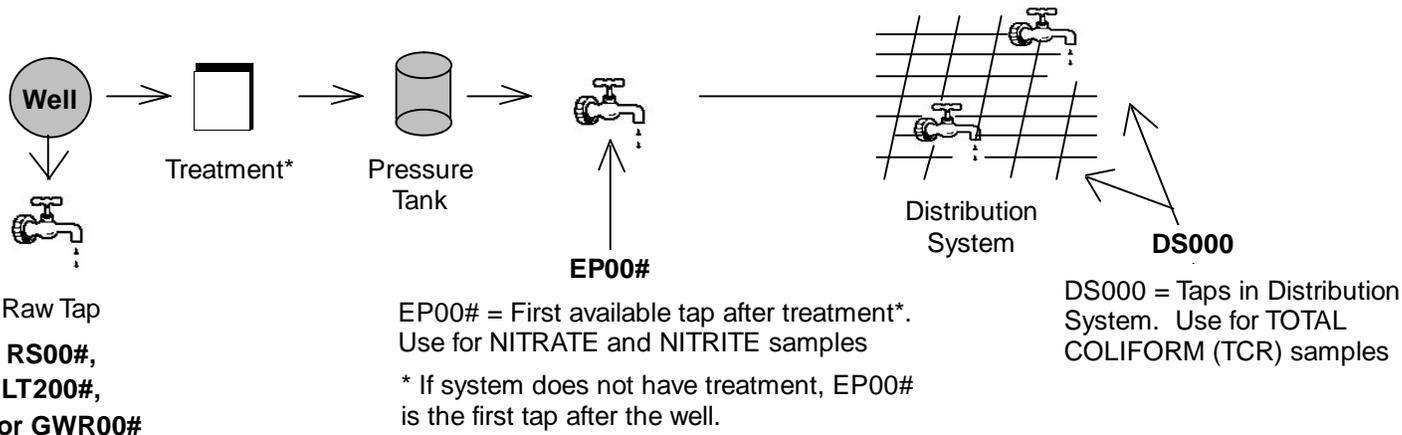

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1637412 SALEM AMISH FELLOWSHIP CHURCH SCHOOL PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: SALEM AMISH FELLOWSHIP CHURCH DISTRIBUTI
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

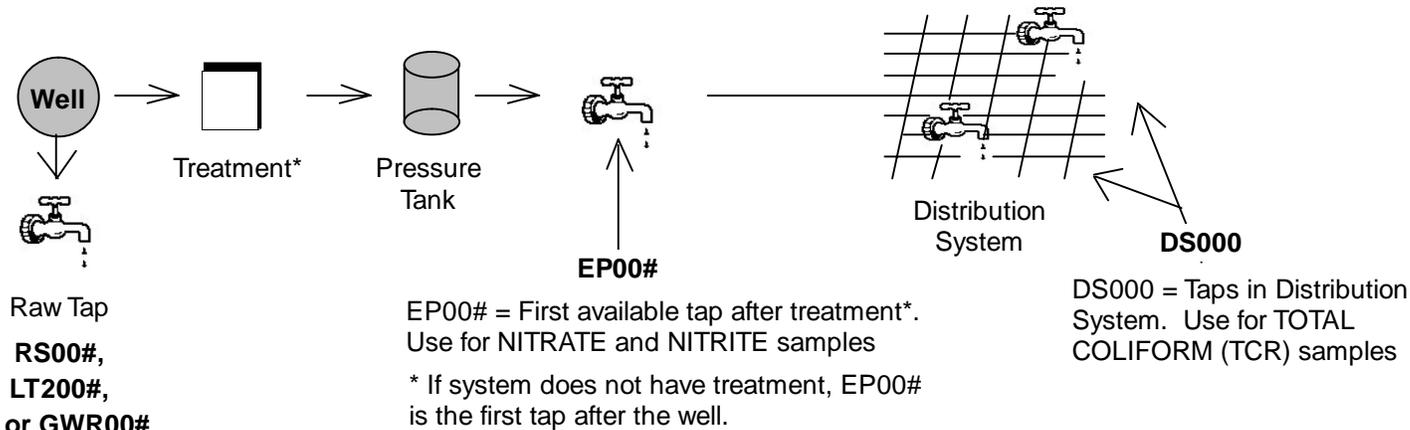

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1637412 SALEM AMISH FELLOWSHIP CHURCH SCHOOL PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1660815	Facility Name: SALEM AMISH FELLOWSHIP CHURCH
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

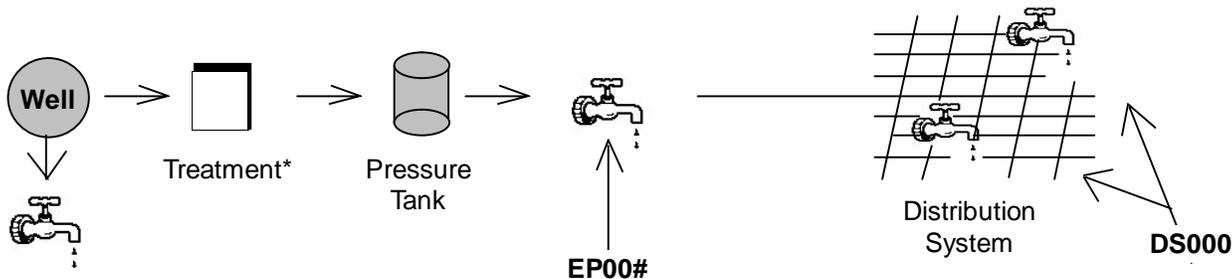

Raw Tap
RS00#,
LT200#,
 or **GWR00#**

EP00# = First available tap after treatment*.
 Use for NITRATE and NITRITE samples
 * If system does not have treatment, EP00# is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1637712 KEENE UNITED METHODIST CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: KEENE UNITED METHODIST CHURCH DISTRIBUTI
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

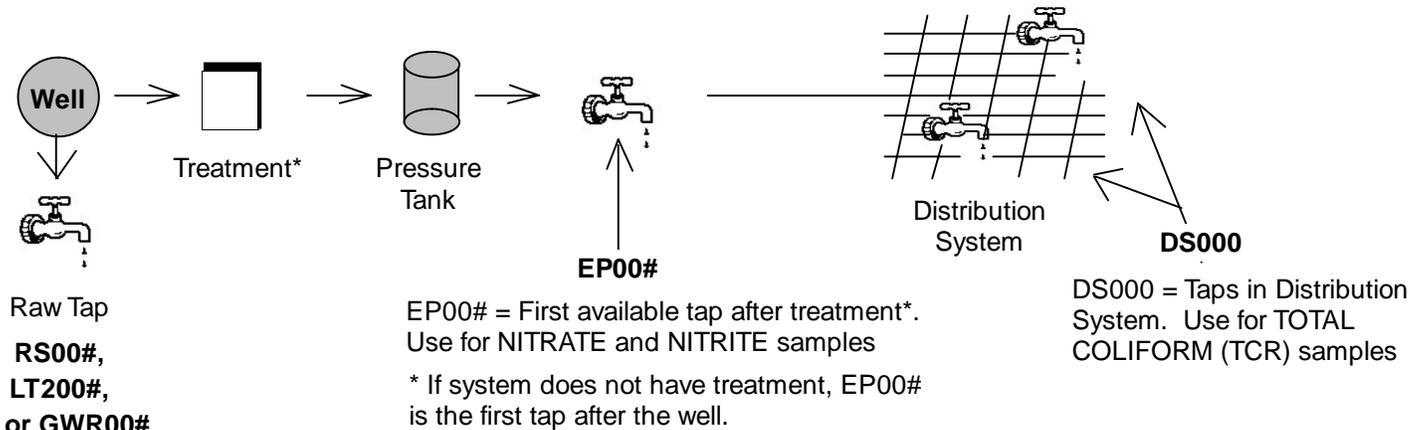

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1637712 KEENE UNITED METHODIST CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **1660945** Facility Name: **KEENE UNITED METHODIST CHURCH**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

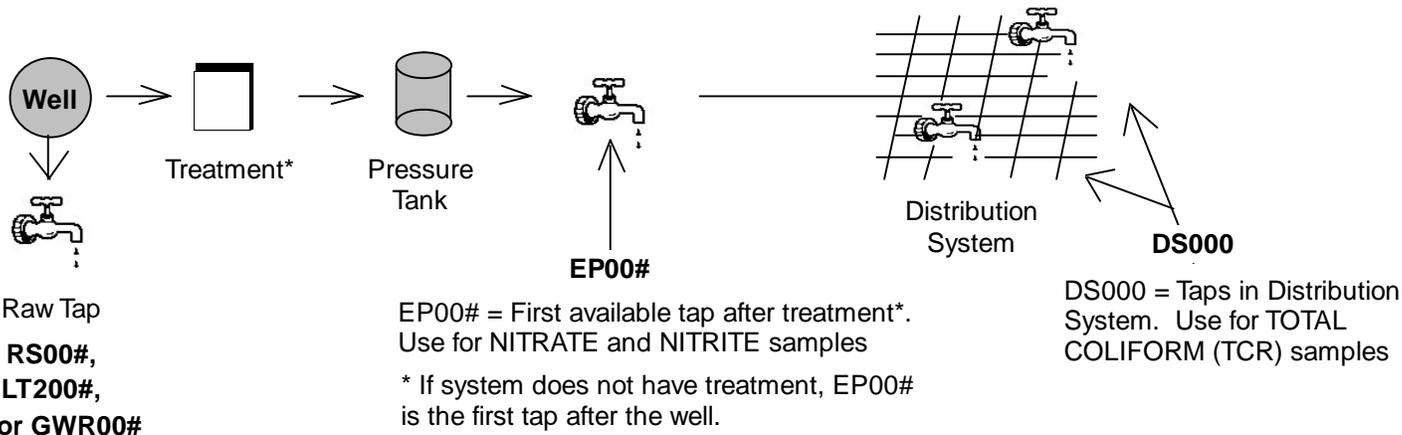

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1637912 CONESVILLE UNITED METHODIST CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CONESVILLE UNITED METHODIST CHURCH DISTR
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

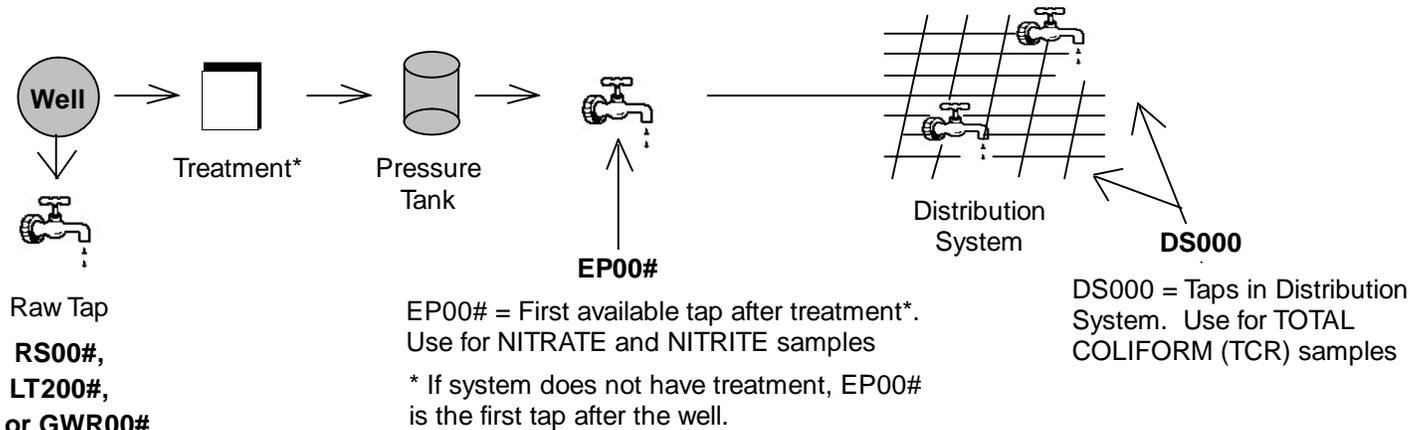

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1637912 CONESVILLE UNITED METHODIST CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1661401	Facility Name: CONESVILLE UNITED METHODIST CHURCH
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

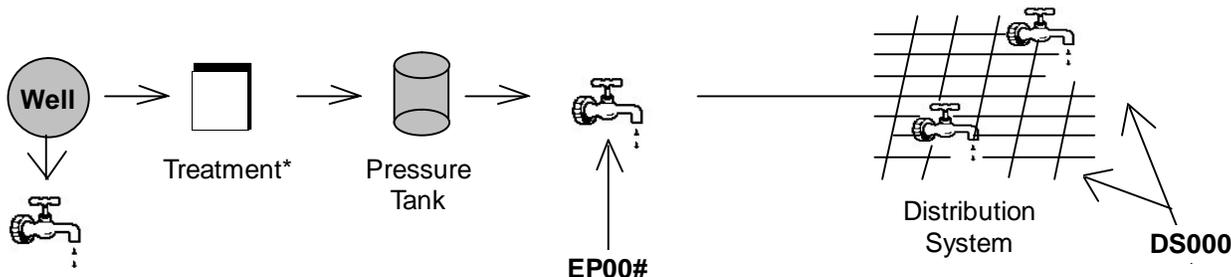

Raw Tap
RS00#,
LT200#,
 or **GWR00#**

EP00# = First available tap after treatment*.
 Use for NITRATE and NITRITE samples
 * If system does not have treatment, EP00#
 is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1638012 PERRY CHAPEL BAPTIST CHURCH-OLD CHURCH P

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: PERRY CHAPEL BAPTIST CHURCH - OLD CHURCH
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

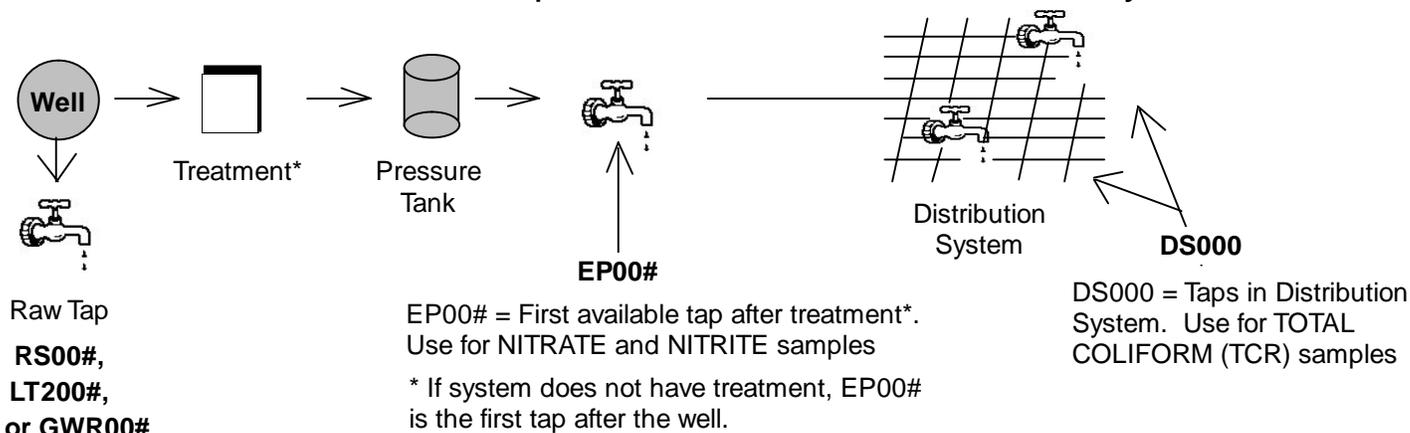

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1638012 PERRY CHAPEL BAPTIST CHURCH-OLD CHURCH P

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1661548	Facility Name: PERRY CHAPEL BAPTIST CHURCH-OLD CHURCH
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

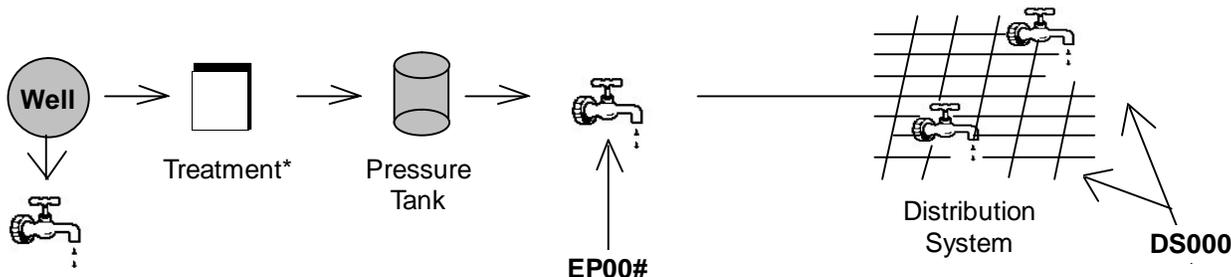

Raw Tap
RS00#,
LT200#,
 or **GWR00#**

EP00# = First available tap after treatment*.
 Use for NITRATE and NITRITE samples
 * If system does not have treatment, EP00#
 is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1638112 PERRY CHAPEL BAPTIST CHURCH-NEW CHURCH P

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: PERRY CHAPEL BAPTIST CHURCH - NEW CHURCH
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

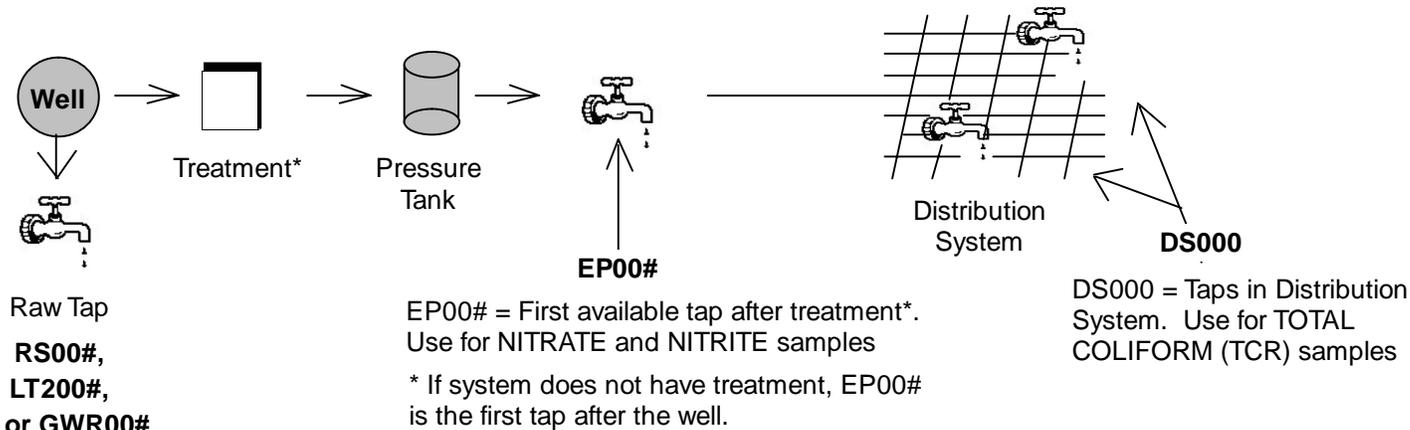

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1638112 PERRY CHAPEL BAPTIST CHURCH-NEW CHURCH P

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1661549	Facility Name: PERRY CHAPEL BAPTIST CHURCH-NEW CHURCH
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

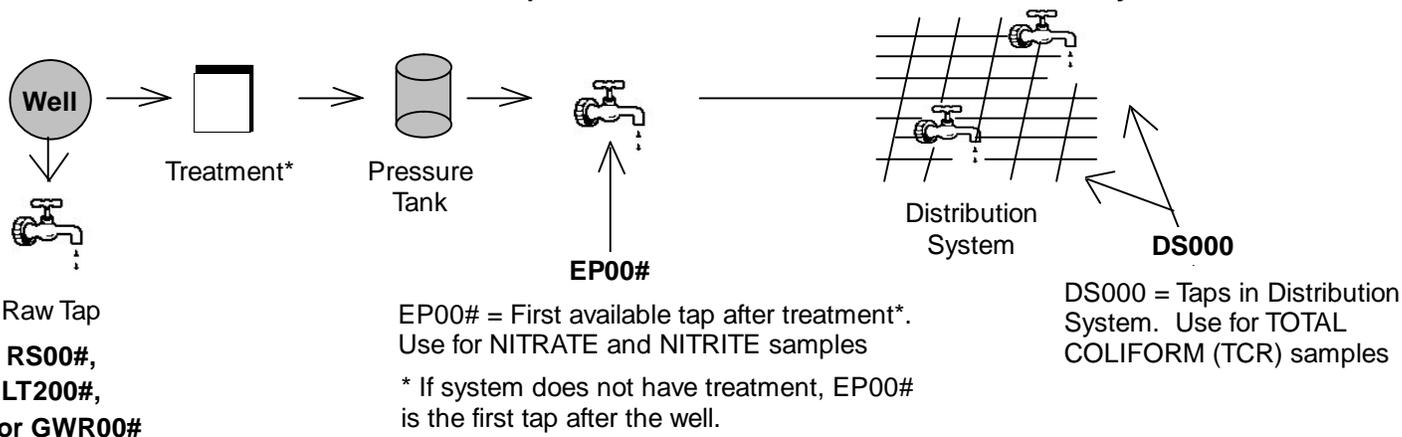

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1638212 RAVENS GLENN WINERY PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: RAVENS GLENN WINERY DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

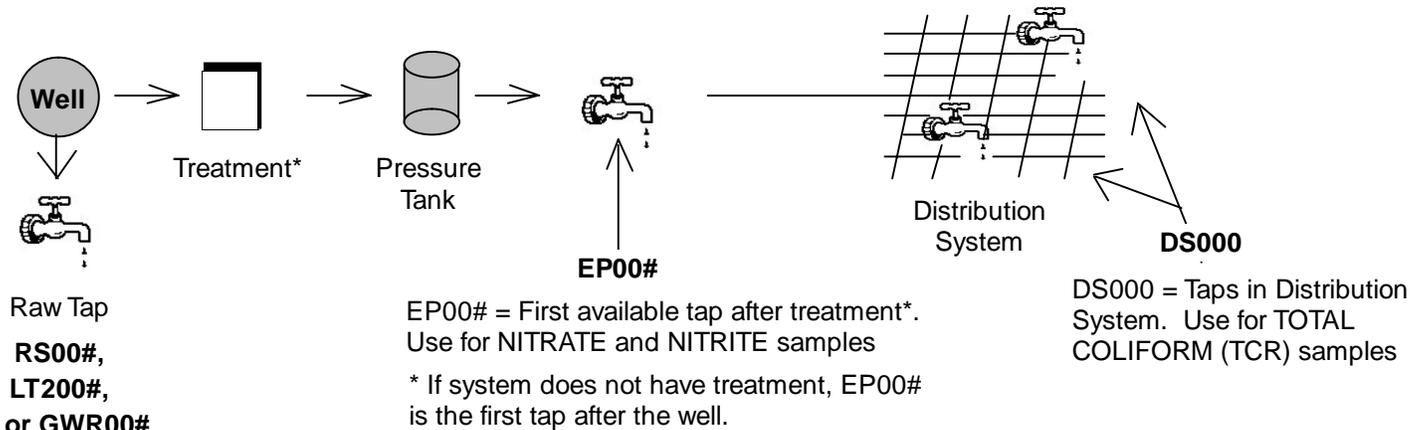

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1638212 RAVENS GLENN WINERY PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **1661607** Facility Name: **RAVENS GLENN WINERY**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

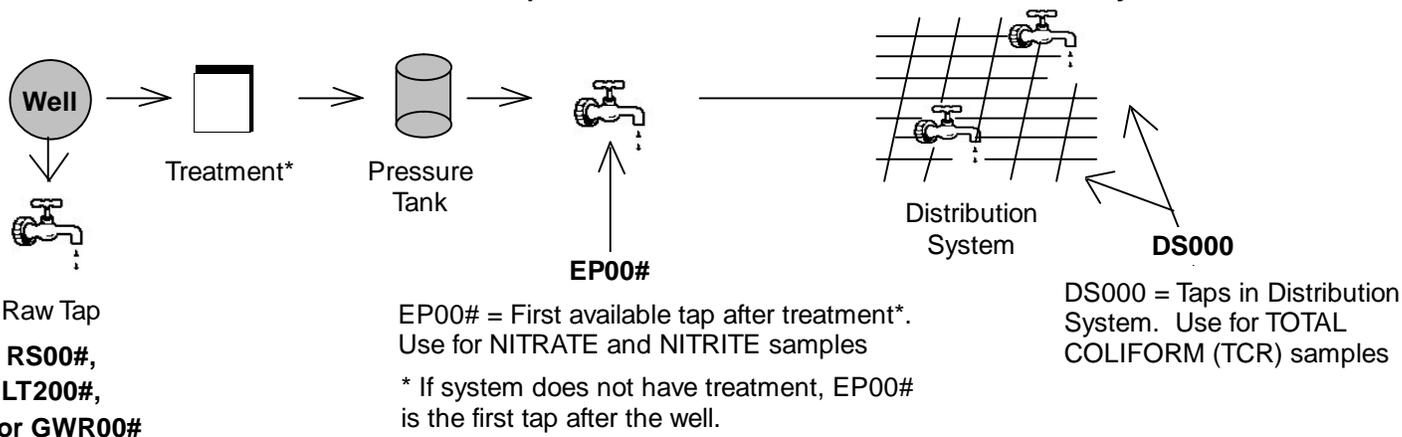

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1638312 PRAIRIE CHAPEL UNITED METHODIST CHURCH P

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: PRAIRIE CHAPEL UMC DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

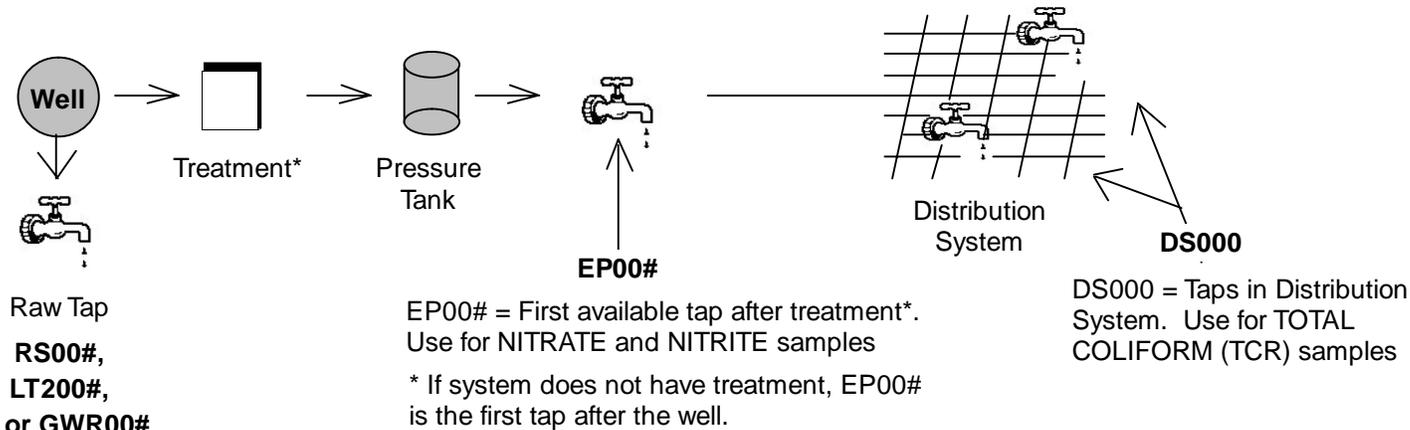

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1638312 PRAIRIE CHAPEL UNITED METHODIST CHURCH P

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **1661796** Facility Name: **PRAIRIE CHAPEL UNITED METHODIST CHURCH**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 1/31/2016 1 Sample(s) Required between 2/1/2016 and 2/29/2016 1 Sample(s) Required between 3/1/2016 and 3/31/2016 1 Sample(s) Required between 4/1/2016 and 4/30/2016 1 Sample(s) Required between 5/1/2016 and 5/31/2016 1 Sample(s) Required between 6/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 7/31/2016 1 Sample(s) Required between 8/1/2016 and 8/31/2016 1 Sample(s) Required between 9/1/2016 and 9/30/2016 1 Sample(s) Required between 10/1/2016 and 10/31/2016 1 Sample(s) Required between 11/1/2016 and 11/30/2016 1 Sample(s) Required between 12/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

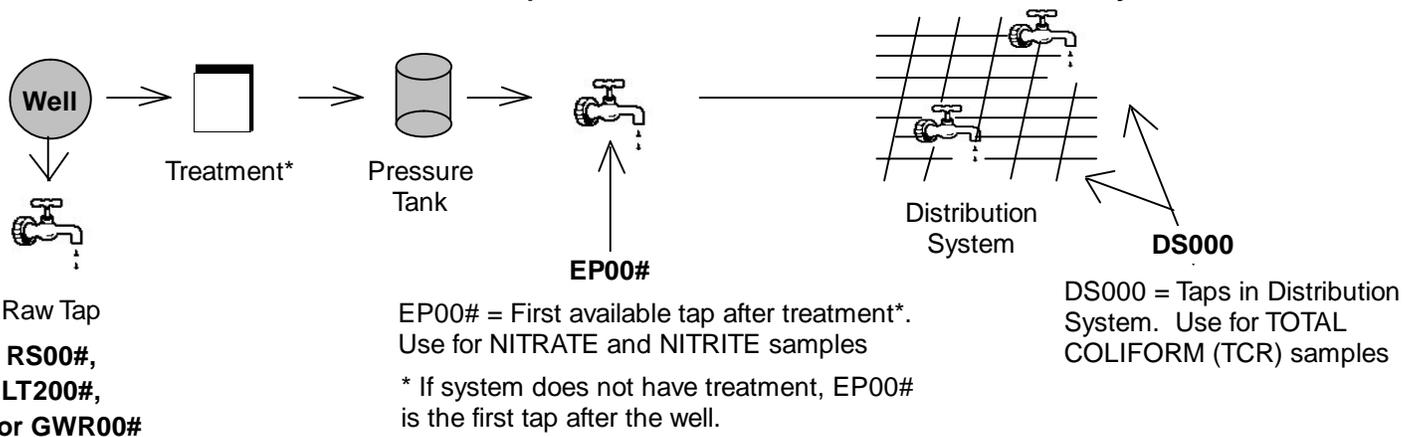

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

OH1638412 THREE RIVERS ENERGY LLC PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1662073	Facility Name: COSHOCTON ETHANOL LLC	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS A

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2016 and 10/31/2016



OH1638412 THREE RIVERS ENERGY LLC PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: COSHOCTON ETHANOL LLC DISTRIBUTION
--------------------------	---	--

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2016 and 9/30/2016
-------------------------------	---

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: COSHOCTON ETHANOL LLC DISTRIBUTION ADDRESS NOT KNOWN
--------------------------	---	--

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH1638512 CHILI CROSSROADS CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CHILI CROSSROADS CHURCH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

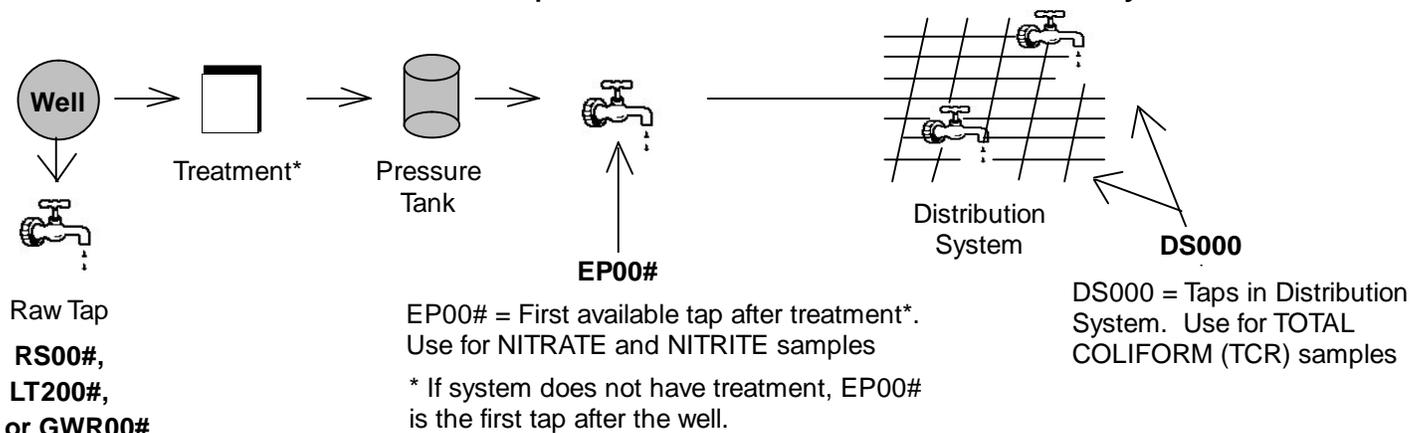

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1638512 CHILI CROSSROADS CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **1662102** Facility Name: **CHILI CROSSROADS CHURCH**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

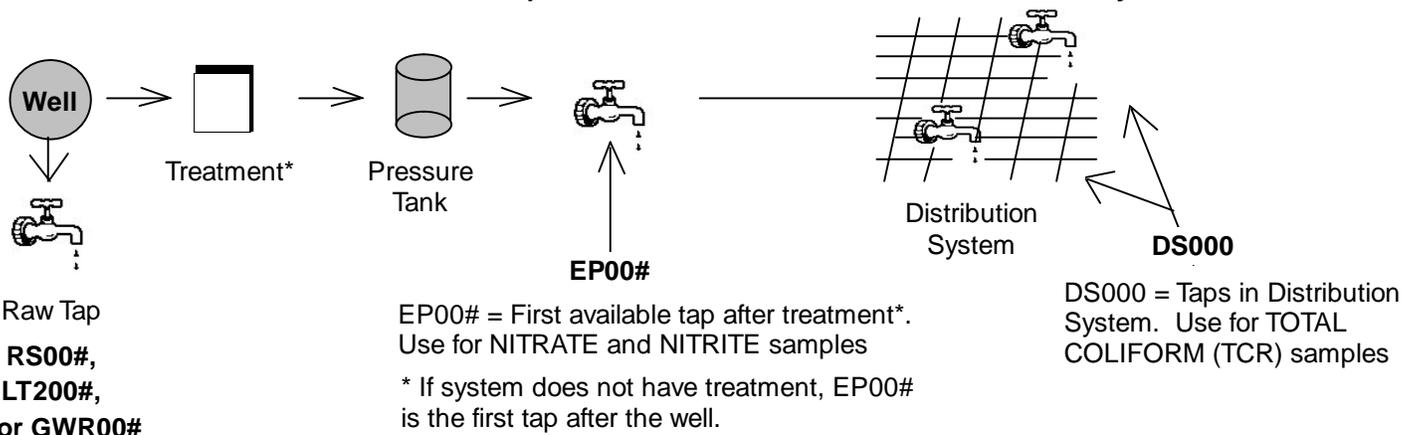

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH1638612 SCHLABACH WOOD DESIGN PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1662186	Facility Name: SCHLABACH WOOD DESIGN	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS A

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2016 and 5/31/2016



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

OH1638612 SCHLABACH WOOD DESIGN PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: SCHLABACH WOOD DESIGN DISTRIBUTION
Location SMP ID: DS000

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022

Not Required

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between 1/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 12/31/2016

OH1638912 RAINBOW HILLS VINEYARDS PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: RAINBOW HILL VINEYARDS DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

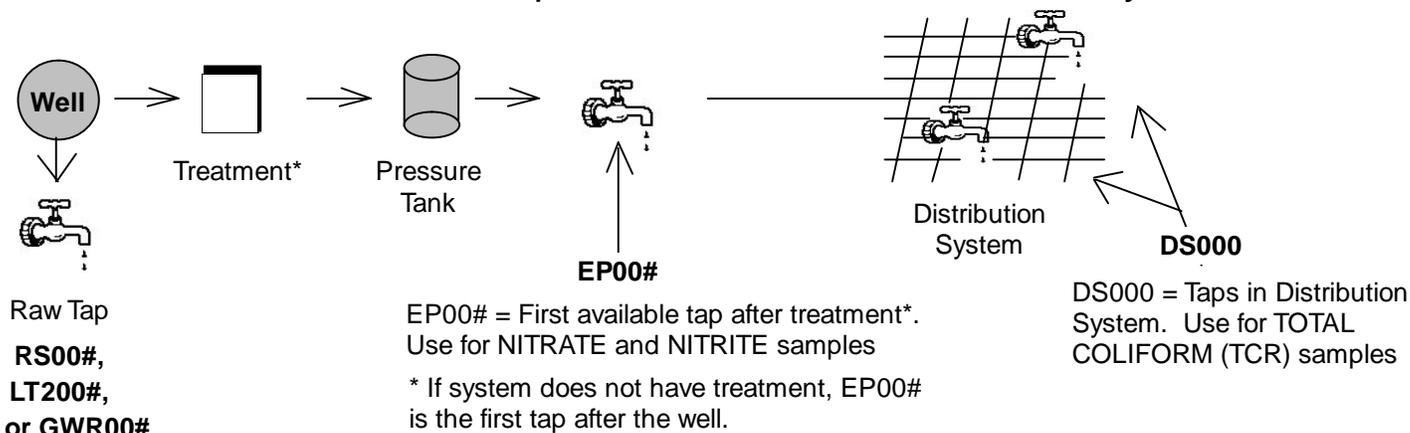

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1638912 RAINBOW HILLS VINEYARDS PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **1662406** Facility Name: **RAINBOW HILL VINEYARDS**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

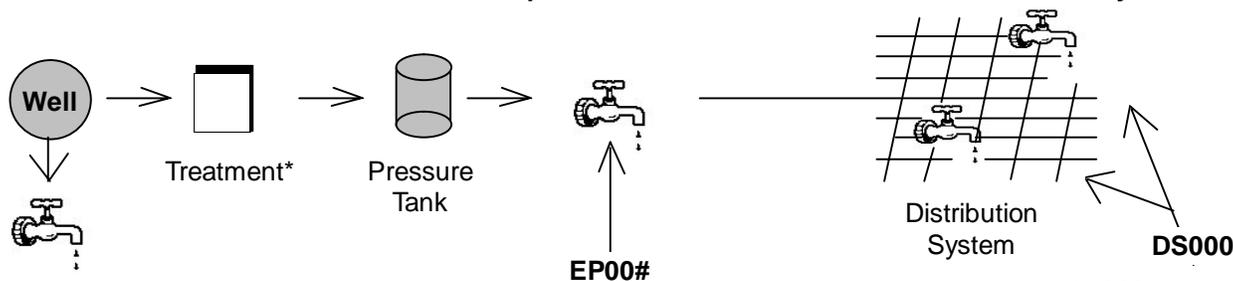

Raw Tap
RS00#,
LT200#,
or **GWR00#**

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00#
is the first tap after the well.

DS000 = Taps in Distribution
System. Use for TOTAL
COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!