



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

OH3200012 ARLINGTON VILLAGE WATER

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 3254796	Facility Name: ARLINGTON WTP	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.
 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
 Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH3200012 ARLINGTON VILLAGE WATER

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: ARLINGTON, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

TOTAL COLIFORM (TCR) - 3100

2 Sample(s) Required between	1/1/2016	and	1/31/2016
2 Sample(s) Required between	2/1/2016	and	2/29/2016
2 Sample(s) Required between	3/1/2016	and	3/31/2016
2 Sample(s) Required between	4/1/2016	and	4/30/2016
2 Sample(s) Required between	5/1/2016	and	5/31/2016
2 Sample(s) Required between	6/1/2016	and	6/30/2016
2 Sample(s) Required between	7/1/2016	and	7/31/2016
2 Sample(s) Required between	8/1/2016	and	8/31/2016
2 Sample(s) Required between	9/1/2016	and	9/30/2016
2 Sample(s) Required between	10/1/2016	and	10/31/2016
2 Sample(s) Required between	11/1/2016	and	11/30/2016
2 Sample(s) Required between	12/1/2016	and	12/31/2016

TOTAL CHLORINE - 1000

2 Sample(s) Required between	1/1/2016	and	1/31/2016
2 Sample(s) Required between	2/1/2016	and	2/29/2016
2 Sample(s) Required between	3/1/2016	and	3/31/2016
2 Sample(s) Required between	4/1/2016	and	4/30/2016
2 Sample(s) Required between	5/1/2016	and	5/31/2016
2 Sample(s) Required between	6/1/2016	and	6/30/2016
2 Sample(s) Required between	7/1/2016	and	7/31/2016
2 Sample(s) Required between	8/1/2016	and	8/31/2016
2 Sample(s) Required between	9/1/2016	and	9/30/2016
2 Sample(s) Required between	10/1/2016	and	10/31/2016
2 Sample(s) Required between	11/1/2016	and	11/30/2016
2 Sample(s) Required between	12/1/2016	and	12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: ARLINGTON, VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

OH3200012 ARLINGTON VILLAGE WATER

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: ARLINGTON, VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH3200111 FINDLAY CITY

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3254797	Facility Name: FINDLAY CITY	Facility Class: CLASS 4
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
------------------	--------------------------------

INORGANICS	1 Sample(s) Required between 1/1/2016 and 5/31/2016
------------	---

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020
 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 1/31/2016
	1 Sample(s) Required between 2/1/2016 and 2/29/2016
	1 Sample(s) Required between 3/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 4/30/2016
	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 10/31/2016
	1 Sample(s) Required between 11/1/2016 and 11/30/2016
	1 Sample(s) Required between 12/1/2016 and 12/31/2016

RADIOLOGICALS	Not Required
---------------	--------------

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2016 and 6/30/2016
---	---

VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2016 and 5/31/2016
----------------------------------	---

TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 1/1/2016 and 1/31/2016
	1 Paired Sample Set Required between 2/1/2016 and 2/29/2016
	1 Paired Sample Set Required between 3/1/2016 and 3/31/2016
	1 Paired Sample Set Required between 4/1/2016 and 4/30/2016
	1 Paired Sample Set Required between 5/1/2016 and 5/31/2016
	1 Paired Sample Set Required between 6/1/2016 and 6/30/2016
	1 Paired Sample Set Required between 7/1/2016 and 7/31/2016
	1 Paired Sample Set Required between 8/1/2016 and 8/31/2016
	1 Paired Sample Set Required between 9/1/2016 and 9/30/2016
	1 Paired Sample Set Required between 10/1/2016 and 10/31/2016
	1 Paired Sample Set Required between 11/1/2016 and 11/30/2016
	1 Paired Sample Set Required between 12/1/2016 and 12/31/2016

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



Effective Date: 10/14/2016

2016 ENTRY POINT SCHEDULE

OH3200111 FINDLAY CITY

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3254797	Facility Name: FINDLAY CITY	Facility Class: CLASS 4
	SMP ID: EP001/LT2001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals

Monitoring Requirements

TOTAL MICROCYSTINS

1 Sample Set Required WEEKLY
starting June 5

Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. Both are required every week from January 1 to December 31 (reduced monitoring available from November to April). A week is defined as Sunday through Saturday. Samples must be analyzed at a lab accepted by Ohio EPA for microcystins analysis.



OH3200111 FINDLAY CITY

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3254797 SMP ID: LT2001	Facility Name: FINDLAY CITY Facility Source: Surface Water	Facility Class: CLASS 4
--------------------------	--	---	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
------------------	--------------------------------

CYANOBACTERIA SCREENING	1 Sample(s) Required between 6/5/2016 and 6/11/2016
	1 Sample(s) Required between 6/19/2016 and 6/25/2016
	1 Sample(s) Required between 7/3/2016 and 7/9/2016
	1 Sample(s) Required between 7/17/2016 and 7/23/2016
	1 Sample(s) Required between 7/31/2016 and 8/6/2016
	1 Sample(s) Required between 8/14/2016 and 8/20/2016
	1 Sample(s) Required between 8/28/2016 and 9/3/2016
	1 Sample(s) Required between 9/11/2016 and 9/17/2016
	1 Sample(s) Required between 9/25/2016 and 10/1/2016
	1 Sample(s) Required between 10/9/2016 and 10/15/2016
	1 Sample(s) Required between 10/23/2016 and 10/29/2016
	1 Sample(s) Required between 11/6/2016 and 11/12/2016
	1 Sample(s) Required between 11/20/2016 and 11/26/2016
	1 Sample(s) Required between 12/4/2016 and 12/10/2016
	1 Sample(s) Required between 12/18/2016 and 12/24/2016

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 and must be collected at the same time as the raw total microcystins sample. SAMPLES MUST BE SHIPPED OVERNIGHT ON ICE ON THE DAY OF COLLECTION AND ARRIVE AT OHIO EPA DIVISION OF ENVIRONMENTAL SERVICES BY NOON MONDAY THROUGH THURSDAY ONLY!

LT2 MONITORING	1 Sample(s) Required between 10/23/2016 and 10/27/2016
	1 Sample(s) Required between 11/20/2016 and 11/24/2016
	1 Sample(s) Required between 12/25/2016 and 12/29/2016

Monitor for: Cryptosporidium - 2078, E-coli count - 3014, Turbidity - 0100

LT2 MATRIX SPIKE SAMPLE	1 Sample(s) Required between 10/23/2016 and 10/27/2016
-------------------------	--



OH3200111 FINDLAY CITY

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: FINDLAY CITY DISTRIBUTION SYSTEM	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 30 Sample(s) Required between 6/1/2016 and 9/30/2016

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100

50 Sample(s) Required between 1/1/2016 and 1/31/2016

50 Sample(s) Required between 2/1/2016 and 2/29/2016

50 Sample(s) Required between 3/1/2016 and 3/31/2016

50 Sample(s) Required between 4/1/2016 and 4/30/2016

50 Sample(s) Required between 5/1/2016 and 5/31/2016

50 Sample(s) Required between 6/1/2016 and 6/30/2016

50 Sample(s) Required between 7/1/2016 and 7/31/2016

50 Sample(s) Required between 8/1/2016 and 8/31/2016

50 Sample(s) Required between 9/1/2016 and 9/30/2016

50 Sample(s) Required between 10/1/2016 and 10/31/2016

50 Sample(s) Required between 11/1/2016 and 11/30/2016

50 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000

50 Sample(s) Required between 1/1/2016 and 1/31/2016

50 Sample(s) Required between 2/1/2016 and 2/29/2016

50 Sample(s) Required between 3/1/2016 and 3/31/2016

50 Sample(s) Required between 4/1/2016 and 4/30/2016

50 Sample(s) Required between 5/1/2016 and 5/31/2016

50 Sample(s) Required between 6/1/2016 and 6/30/2016

50 Sample(s) Required between 7/1/2016 and 7/31/2016

50 Sample(s) Required between 8/1/2016 and 8/31/2016

50 Sample(s) Required between 9/1/2016 and 9/30/2016

50 Sample(s) Required between 10/1/2016 and 10/31/2016

50 Sample(s) Required between 11/1/2016 and 11/30/2016

50 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: FINDLAY CITY DISTRIBUTION SYSTEM 301 E. MARKET ST. VAN BUREN	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 3/8/2016 and 3/14/2016 at SMP: DS201

1 Sample(s) Required between 6/8/2016 and 6/14/2016 at SMP: DS201

1 Sample(s) Required between 9/8/2016 and 9/14/2016 at SMP: DS201



OH3200111 FINDLAY CITY

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: FINDLAY CITY DISTRIBUTION SYSTEM 301 E. MARKET ST. VAN BUREN	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 12/8/2016 and 12/14/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: FINDLAY CITY DISTRIBUTION SYSTEM 9500 ST. RT. 12 W.	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 3/8/2016 and 3/14/2016 at SMP: DS202

1 Sample(s) Required between 6/8/2016 and 6/14/2016 at SMP: DS202

1 Sample(s) Required between 9/8/2016 and 9/14/2016 at SMP: DS202

1 Sample(s) Required between 12/8/2016 and 12/14/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS203	Facility Name: FINDLAY CITY DISTRIBUTION SYSTEM 401 OLIVE ST.	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 3/8/2016 and 3/14/2016 at SMP: DS203

1 Sample(s) Required between 6/8/2016 and 6/14/2016 at SMP: DS203

1 Sample(s) Required between 9/8/2016 and 9/14/2016 at SMP: DS203

1 Sample(s) Required between 12/8/2016 and 12/14/2016 at SMP: DS203

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS204	Facility Name: FINDLAY CITY DISTRIBUTION SYSTEM TWP. RD. 201 AT DEER TRAIL CT.	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 3/8/2016 and 3/14/2016 at SMP: DS204

1 Sample(s) Required between 6/8/2016 and 6/14/2016 at SMP: DS204

1 Sample(s) Required between 9/8/2016 and 9/14/2016 at SMP: DS204

1 Sample(s) Required between 12/8/2016 and 12/14/2016 at SMP: DS204

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH3200411 MCCOMB VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3254799	Facility Name: MCCOMB VILLAGE	Facility Class: CLASS 3
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
------------------	--------------------------------

INORGANICS	1 Sample(s) Required between 1/1/2016 and 5/31/2016
------------	---

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020
 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 1/31/2016
	1 Sample(s) Required between 2/1/2016 and 2/29/2016
	1 Sample(s) Required between 3/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 4/30/2016
	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 10/31/2016
	1 Sample(s) Required between 11/1/2016 and 11/30/2016
	1 Sample(s) Required between 12/1/2016 and 12/31/2016

RADIOLOGICALS	Not Required
---------------	--------------

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2016 and 6/30/2016
---	---

VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2016 and 5/31/2016
----------------------------------	---



Effective Date: 05/13/2016

2016 ENTRY POINT SCHEDULE

OH3200411 MCCOMB VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3254799	Facility Name: MCCOMB VILLAGE	Facility Class: CLASS 3
	SMP ID: EP001/LT2001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
TOTAL MICROCYSTINS	1 Sample Set Required WEEKLY starting June 5

Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. Both are required every week from January 1 to December 31 (reduced monitoring available from November to April). A week is defined as Sunday through Saturday. Samples must be analyzed at a lab accepted by Ohio EPA for microcystins analysis.



OH3200411 MCCOMB VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3254799 SMP ID: LT2001	Facility Name: MCCOMB VILLAGE Facility Source: Surface Water	Facility Class: CLASS 3
--------------------------	--	---	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016

Chemicals	Monitoring Requirements
CYANOBACTERIA SCREENING	1 Sample(s) Required between 6/5/2016 and 6/11/2016
	1 Sample(s) Required between 6/19/2016 and 6/25/2016
	1 Sample(s) Required between 7/3/2016 and 7/9/2016
	1 Sample(s) Required between 7/17/2016 and 7/23/2016
	1 Sample(s) Required between 7/31/2016 and 8/6/2016
	1 Sample(s) Required between 8/14/2016 and 8/20/2016
	1 Sample(s) Required between 8/28/2016 and 9/3/2016
	1 Sample(s) Required between 9/11/2016 and 9/17/2016
	1 Sample(s) Required between 9/25/2016 and 10/1/2016
	1 Sample(s) Required between 10/9/2016 and 10/15/2016
	1 Sample(s) Required between 10/23/2016 and 10/29/2016
	1 Sample(s) Required between 11/6/2016 and 11/12/2016
	1 Sample(s) Required between 11/20/2016 and 11/26/2016
	1 Sample(s) Required between 12/4/2016 and 12/10/2016
	1 Sample(s) Required between 12/18/2016 and 12/24/2016

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 and must be collected at the same time as the raw total microcystins sample. SAMPLES MUST BE SHIPPED OVERNIGHT ON ICE ON THE DAY OF COLLECTION AND ARRIVE AT OHIO EPA DIVISION OF ENVIRONMENTAL SERVICES BY NOON MONDAY THROUGH THURSDAY ONLY!



OH3200411 MCCOMB VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: MCCOMB VILLAGE DISTRIBUTION SYSTEM	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

TOTAL COLIFORM (TCR) - 3100	4 Sample(s) Required between 1/1/2016 and 1/31/2016
	4 Sample(s) Required between 2/1/2016 and 2/29/2016
	4 Sample(s) Required between 3/1/2016 and 3/31/2016
	4 Sample(s) Required between 4/1/2016 and 4/30/2016
	4 Sample(s) Required between 5/1/2016 and 5/31/2016
	4 Sample(s) Required between 6/1/2016 and 6/30/2016
	4 Sample(s) Required between 7/1/2016 and 7/31/2016
	4 Sample(s) Required between 8/1/2016 and 8/31/2016
	4 Sample(s) Required between 9/1/2016 and 9/30/2016
	4 Sample(s) Required between 10/1/2016 and 10/31/2016
	4 Sample(s) Required between 11/1/2016 and 11/30/2016
	4 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000	4 Sample(s) Required between 1/1/2016 and 1/31/2016
	4 Sample(s) Required between 2/1/2016 and 2/29/2016
	4 Sample(s) Required between 3/1/2016 and 3/31/2016
	4 Sample(s) Required between 4/1/2016 and 4/30/2016
	4 Sample(s) Required between 5/1/2016 and 5/31/2016
	4 Sample(s) Required between 6/1/2016 and 6/30/2016
	4 Sample(s) Required between 7/1/2016 and 7/31/2016
	4 Sample(s) Required between 8/1/2016 and 8/31/2016
	4 Sample(s) Required between 9/1/2016 and 9/30/2016
	4 Sample(s) Required between 10/1/2016 and 10/31/2016
	4 Sample(s) Required between 11/1/2016 and 11/30/2016
	4 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: MCCOMB VILLAGE DISTRIBUTION SYSTEM 444 MAPLE ST	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/8/2016 and 2/14/2016 at SMP: DS201
	1 Sample(s) Required between 5/8/2016 and 5/14/2016 at SMP: DS201
	1 Sample(s) Required between 8/8/2016 and 8/14/2016 at SMP: DS201
	1 Sample(s) Required between 11/8/2016 and 11/14/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH3200411 MCCOMB VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: MCCOMB VILLAGE DISTRIBUTION SYSTEM 328 SOUTH TODD ST	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/8/2016 and 2/14/2016 at SMP: DS202
	1 Sample(s) Required between 5/8/2016 and 5/14/2016 at SMP: DS202
	1 Sample(s) Required between 8/8/2016 and 8/14/2016 at SMP: DS202
	1 Sample(s) Required between 11/8/2016 and 11/14/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH3200512 MT BLANCHARD VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 3254800	Facility Name: MT BLANCHARD STU 1	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
THALLIUM, TOTAL - 1085	1 Sample(s) Required between 1/1/2016 and 3/31/2016 1 Sample(s) Required between 4/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 9/30/2016 1 Sample(s) Required between 10/1/2016 and 12/31/2016
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

OH3200512 MT BLANCHARD VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3260378 SMP ID: EP002	Facility Name: MT BLANCHARD STU 2 Facility Source: Ground Water	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

OH3200512 MT BLANCHARD VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: MT BLANCHARD DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2016	and	1/31/2016
	1 Sample(s) Required between	2/1/2016	and	2/29/2016
	1 Sample(s) Required between	3/1/2016	and	3/31/2016
	1 Sample(s) Required between	4/1/2016	and	4/30/2016
	1 Sample(s) Required between	5/1/2016	and	5/31/2016
	1 Sample(s) Required between	6/1/2016	and	6/30/2016
	1 Sample(s) Required between	7/1/2016	and	7/31/2016
	1 Sample(s) Required between	8/1/2016	and	8/31/2016
	1 Sample(s) Required between	9/1/2016	and	9/30/2016
	1 Sample(s) Required between	10/1/2016	and	10/31/2016
	1 Sample(s) Required between	11/1/2016	and	11/30/2016
	1 Sample(s) Required between	12/1/2016	and	12/31/2016

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2016	and	1/31/2016
	1 Sample(s) Required between	2/1/2016	and	2/29/2016
	1 Sample(s) Required between	3/1/2016	and	3/31/2016
	1 Sample(s) Required between	4/1/2016	and	4/30/2016
	1 Sample(s) Required between	5/1/2016	and	5/31/2016
	1 Sample(s) Required between	6/1/2016	and	6/30/2016
	1 Sample(s) Required between	7/1/2016	and	7/31/2016
	1 Sample(s) Required between	8/1/2016	and	8/31/2016
	1 Sample(s) Required between	9/1/2016	and	9/30/2016
	1 Sample(s) Required between	10/1/2016	and	10/31/2016
	1 Sample(s) Required between	11/1/2016	and	11/30/2016
	1 Sample(s) Required between	12/1/2016	and	12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: MT BLANCHARD DISTRIBUTION 16988 ST RT 103	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

OH3200612 RAWSON VILLAGE WATER

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 3254801	Facility Name: RAWSON VILLAGE	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



Effective Date: 07/15/2016

2016 DISTRIBUTION SCHEDULE

OH3200612 RAWSON VILLAGE WATER

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: RAWSON, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 1/31/2016
	1 Sample(s) Required between 2/1/2016 and 2/29/2016
	1 Sample(s) Required between 3/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 4/30/2016
	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 10/31/2016
	1 Sample(s) Required between 11/1/2016 and 11/30/2016
	1 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2016 and 1/31/2016
	1 Sample(s) Required between 2/1/2016 and 2/29/2016
	1 Sample(s) Required between 3/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 4/30/2016
	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 10/31/2016
	1 Sample(s) Required between 11/1/2016 and 11/30/2016
	1 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: RAWSON, VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 07/15/2016

2016 DISTRIBUTION SCHEDULE

OH3200612 RAWSON VILLAGE WATER

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: RAWSON, VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS202
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

OH3200812 GREEN MEADOW MHP-HANCOCK CO

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 3254803	Facility Name: GREEN MEADOW MHP	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS A

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH3200812 GREEN MEADOW MHP-HANCOCK CO

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: GREEN MEADOW MOBILE HOME DISTRIBUT
	SMP ID: DS000	

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 1/31/2016
	1 Sample(s) Required between 2/1/2016 and 2/29/2016
	1 Sample(s) Required between 3/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 4/30/2016
	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 10/31/2016
	1 Sample(s) Required between 11/1/2016 and 11/30/2016
	1 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2016 and 1/31/2016
	1 Sample(s) Required between 2/1/2016 and 2/29/2016
	1 Sample(s) Required between 3/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 4/30/2016
	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 10/31/2016
	1 Sample(s) Required between 11/1/2016 and 11/30/2016
	1 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: GREEN MEADOW MOBILE HOME DISTRIBUT
	SMP ID: DS201	ADDRESS NOT KNOWN

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH3200903 ARCADIA VILLAGE WATER

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: ARCADIA, VLG OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 1/31/2016
	1 Sample(s) Required between 2/1/2016 and 2/29/2016
	1 Sample(s) Required between 3/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 4/30/2016
	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 10/31/2016
	1 Sample(s) Required between 11/1/2016 and 11/30/2016
	1 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2016 and 1/31/2016
	1 Sample(s) Required between 2/1/2016 and 2/29/2016
	1 Sample(s) Required between 3/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 4/30/2016
	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 10/31/2016
	1 Sample(s) Required between 11/1/2016 and 11/30/2016
	1 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: ARCADIA, VLG OF DISTRIBUTION NOBLE HAWK CT AND RIDGE RUN I	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 3/1/2016 and 3/7/2016 at SMP: DS201
	1 Sample(s) Required between 6/1/2016 and 6/7/2016 at SMP: DS201
	1 Sample(s) Required between 9/1/2016 and 9/7/2016 at SMP: DS201
	1 Sample(s) Required between 12/1/2016 and 12/7/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH3200903 ARCADIA VILLAGE WATER

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: ARCADIA, VLG OF DISTRIBUTION TEST TAP @ OLYMPIC DR	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements			
DISINFECTION BYPRODUCTS	1 Sample(s) Required between	3/1/2016	and	3/7/2016 at SMP: DS202
	1 Sample(s) Required between	6/1/2016	and	6/7/2016 at SMP: DS202
	1 Sample(s) Required between	9/1/2016	and	9/7/2016 at SMP: DS202
	1 Sample(s) Required between	12/1/2016	and	12/7/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH3230412 BETHEL CHURCH OF CHRIST

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: BETHEL CHURCH OF CHRIST DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

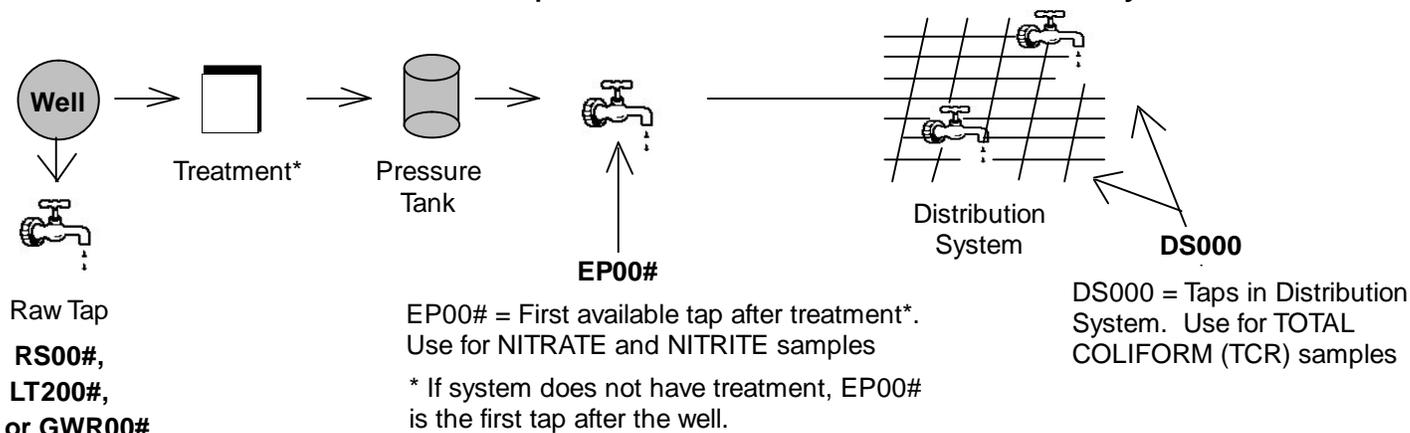

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3230412 BETHEL CHURCH OF CHRIST

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3254807	Facility Name: BETHEL CHURCH OF CHRIST
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

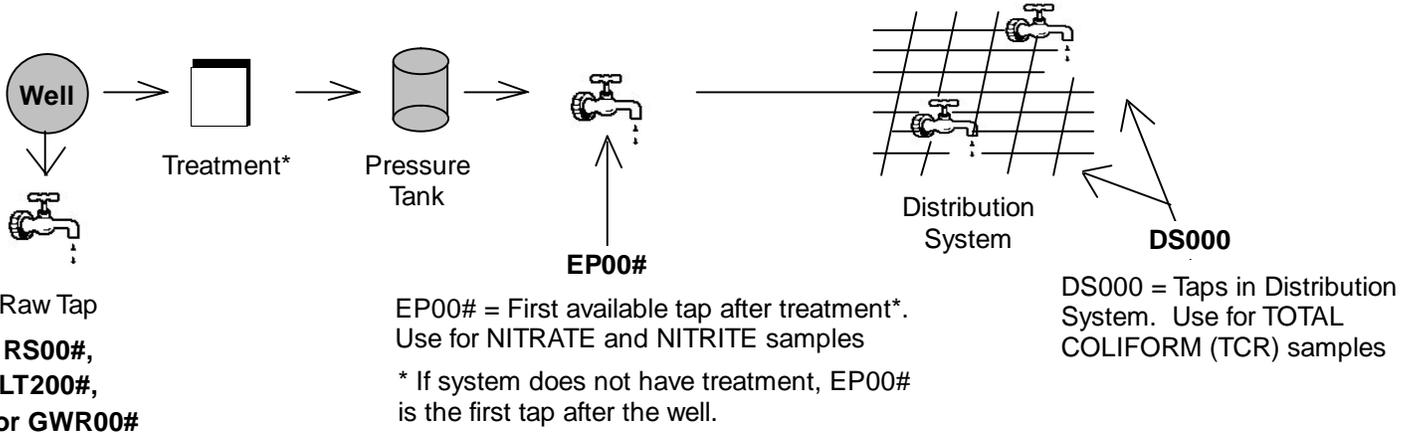

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3231112 CALVARY UM CHURCH OF BENTON RIDGE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CALVARY CHURCH-BENTON RIDGE-DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

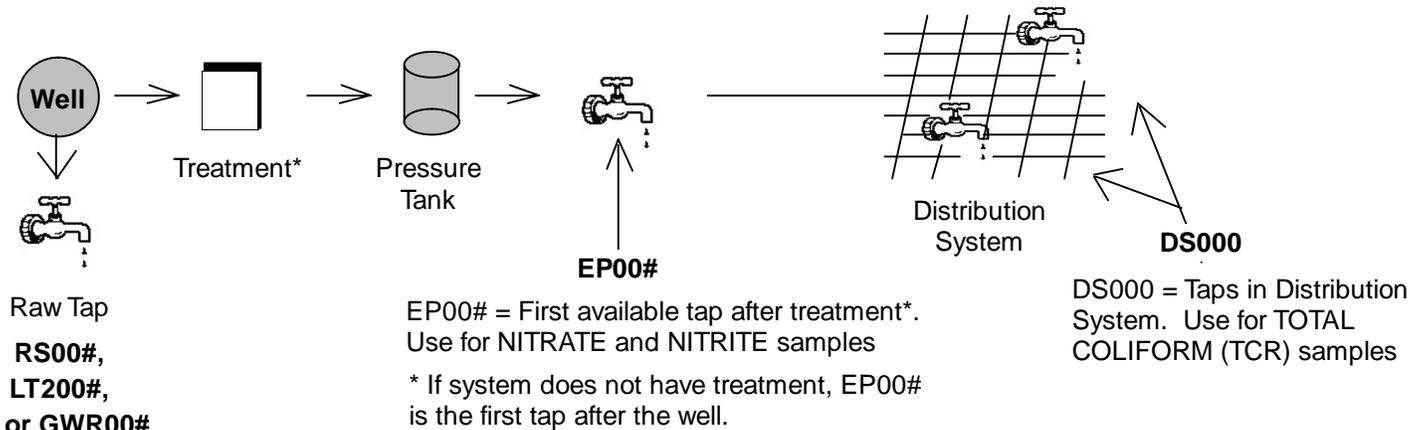

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3231112 CALVARY UM CHURCH OF BENTON RIDGE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3254809** Facility Name: **CALVARY CHURCH OF BENTON RIDGE**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

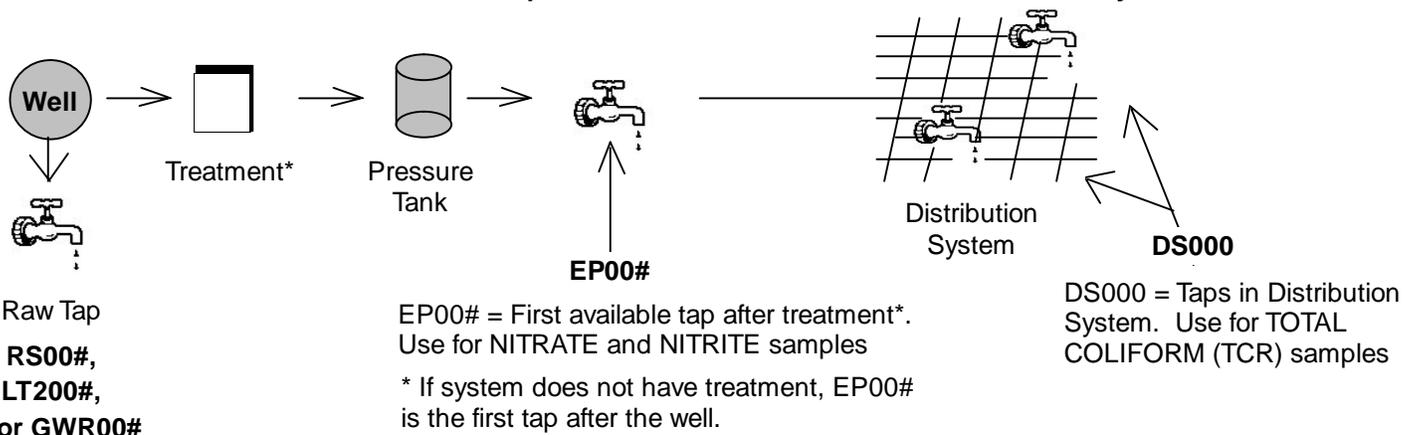

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3231212 CAMP BERRY [BSA]-WEST CAMP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CAMP BERRY-WEST CAMP DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

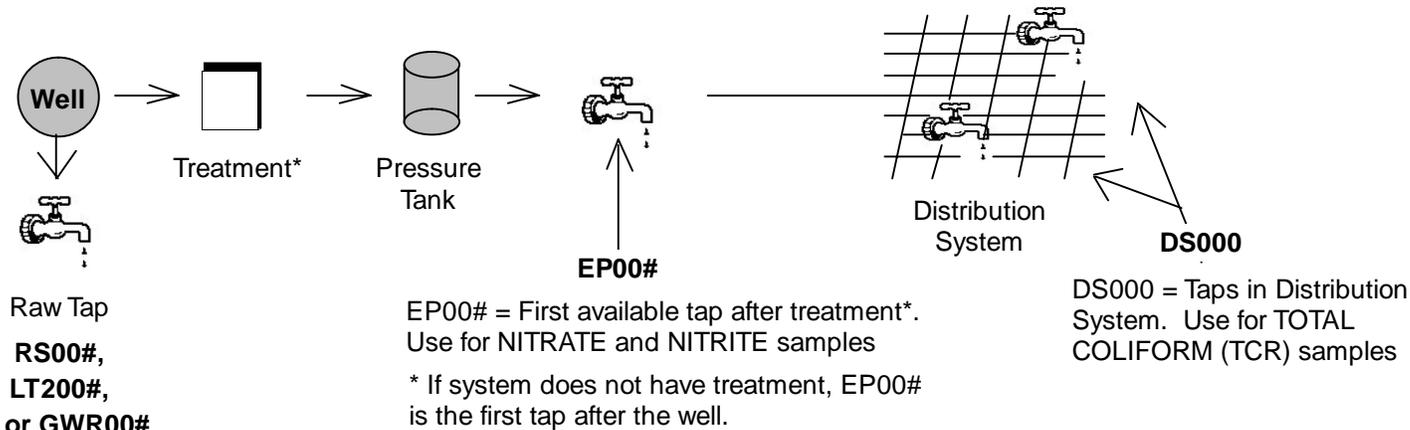

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3231212 CAMP BERRY [BSA]-WEST CAMP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3254810** Facility Name: **CAMP BERRY WEST CAMP**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

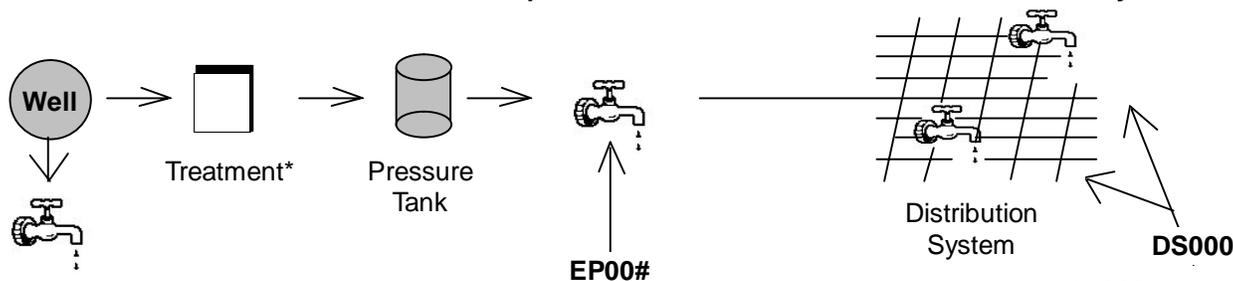

Raw Tap
RS00#,
LT200#,
 or **GWR00#**

EP00# = First available tap after treatment*.
 Use for NITRATE and NITRITE samples
 * If system does not have treatment, EP00#
 is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3231312 CAMP BERRY [BSA]-EAST CAMP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CAMP BERRY-EAST CAMP DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

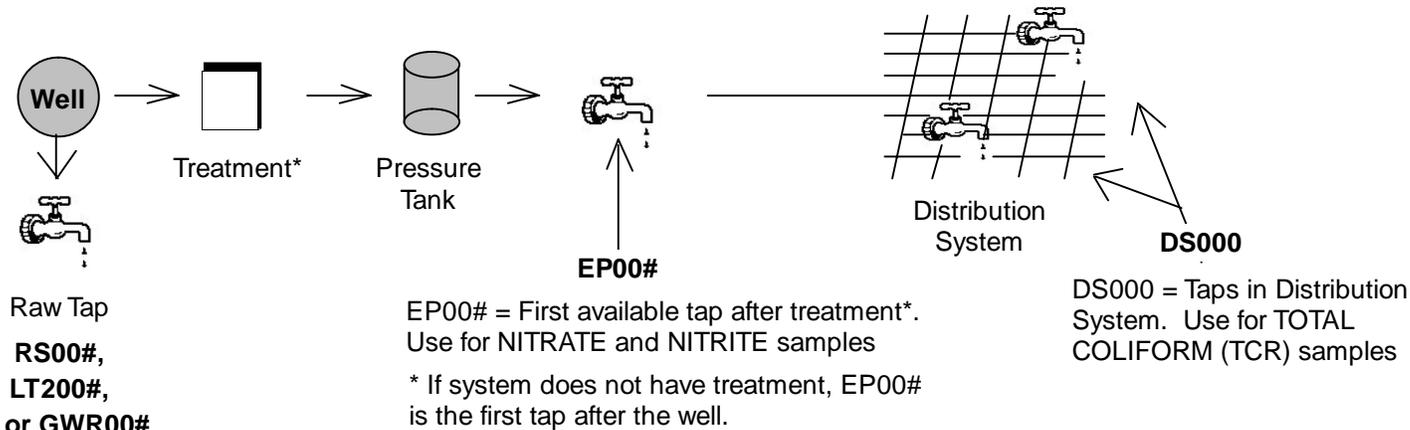

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3231312 CAMP BERRY [BSA]-EAST CAMP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3254811** Facility Name: **CAMP BERRY EAST CAMP**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

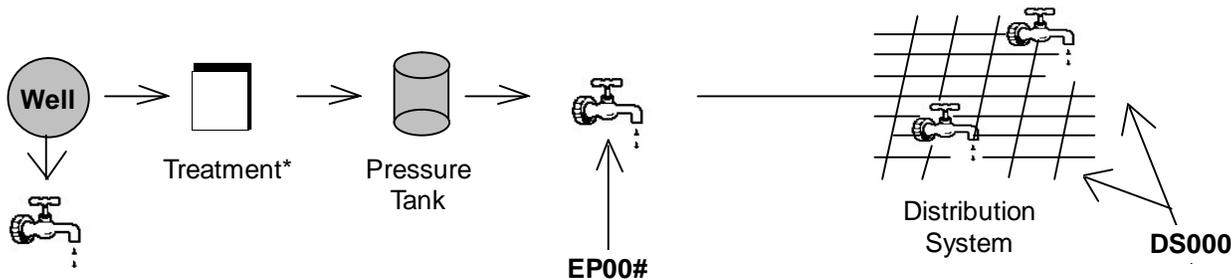

Raw Tap
RS00#,
LT200#,
or **GWR00#**

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00#
is the first tap after the well.

DS000 = Taps in Distribution
System. Use for TOTAL
COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3231412 CAMP BERRY [BSA]-CENTRAL AREA

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CAMP BERRY-CENTRAL AREA DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

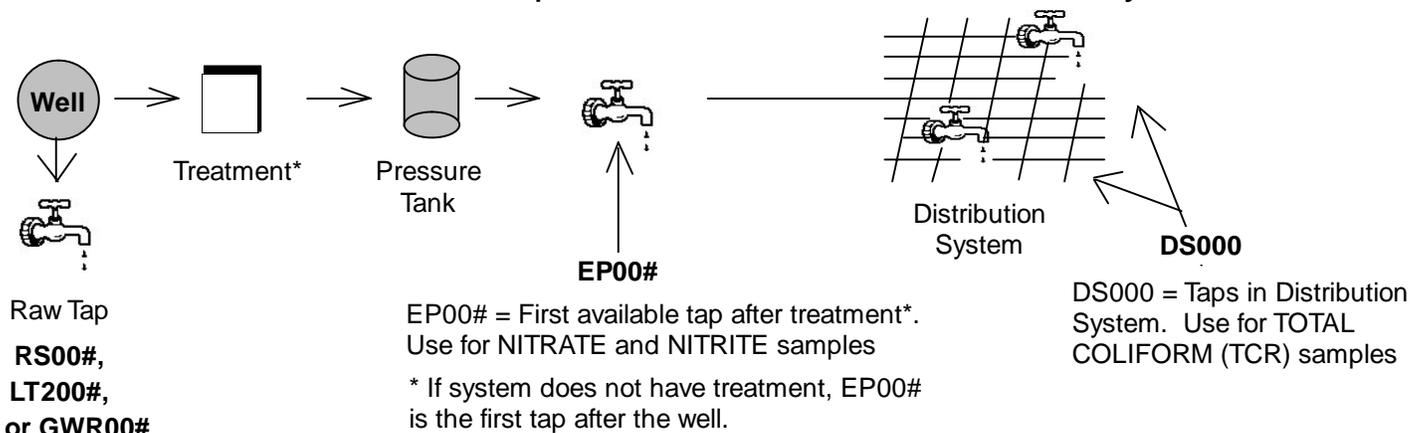

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3231412 CAMP BERRY [BSA]-CENTRAL AREA

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3254812** Facility Name: **CAMP BERRY CENTRAL AREA**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

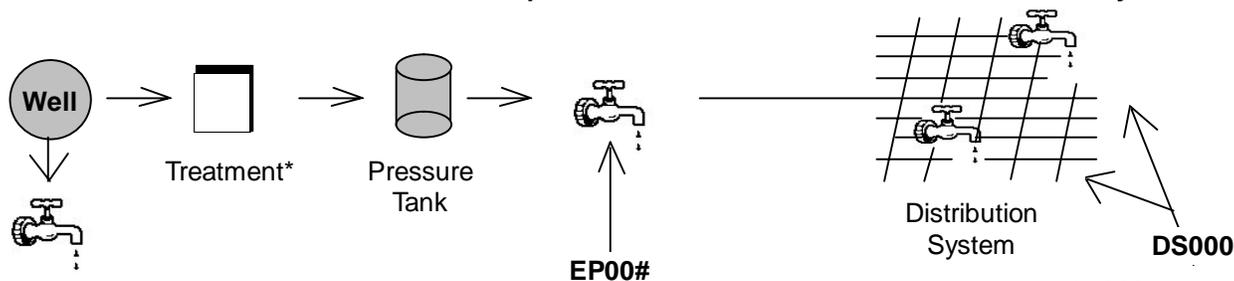

Raw Tap
RS00#,
LT200#,
or **GWR00#**

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples
* If system does not have treatment, EP00#
is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

OH3232112 CORY RAWSON SCHOOLS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 3254815	Facility Name: CORY RAWSON SCHOOL	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH3232112 CORY RAWSON SCHOOLS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **CORY RAWSON SCHOOL DISTRIBUTION SYS** Facility Class: **CLASS 1**
SMP ID: **DS000**

Chemicals **Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 Not Required

TOTAL COLIFORM (TCR) - 3100
1 Sample(s) Required between 1/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000
1 Sample(s) Required between 1/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: **DS1** Facility Name: **CORY RAWSON SCHOOL DISTRIBUTION SYS** Facility Class: **CLASS 1**
SMP ID: **DS201** ADDRESS NOT KNOWN

Chemicals **Monitoring Requirements**

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location Facility ID: **DS1** Facility Name: **CORY RAWSON SCHOOL DISTRIBUTION SYS** Facility Class: **CLASS 1**
SMP ID: **DS202** ADDRESS NOT KNOWN

Chemicals **Monitoring Requirements**

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH3233412 GOOD SHEPHERD U M CH -BENTON RIDGE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: GOOD SHEPHERD U M CHURCH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

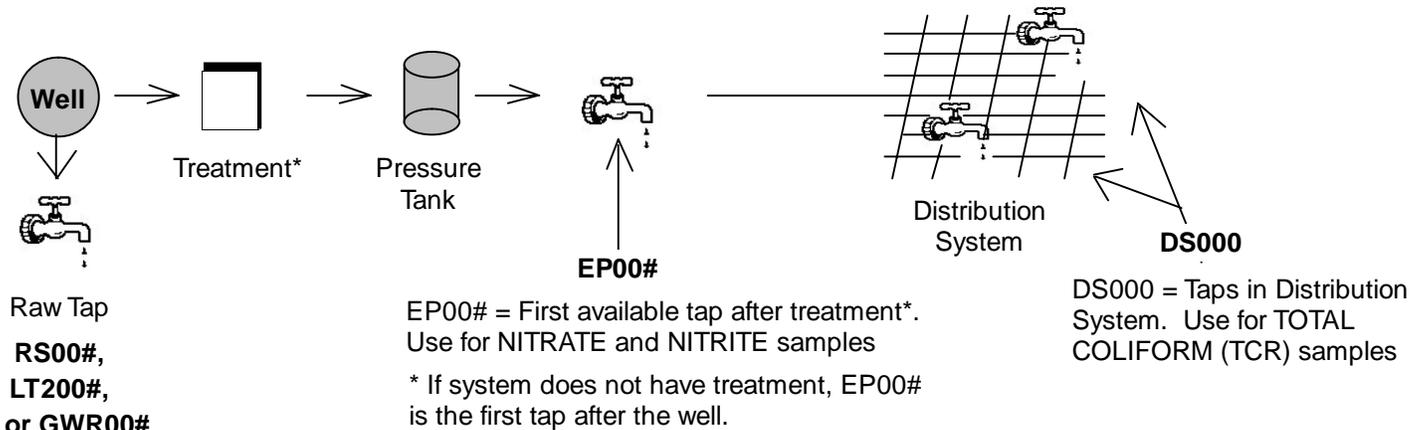

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3233412 GOOD SHEPHERD U M CH -BENTON RIDGE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3254820** Facility Name: **GOOD SHEPHERD U M CHURCH**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

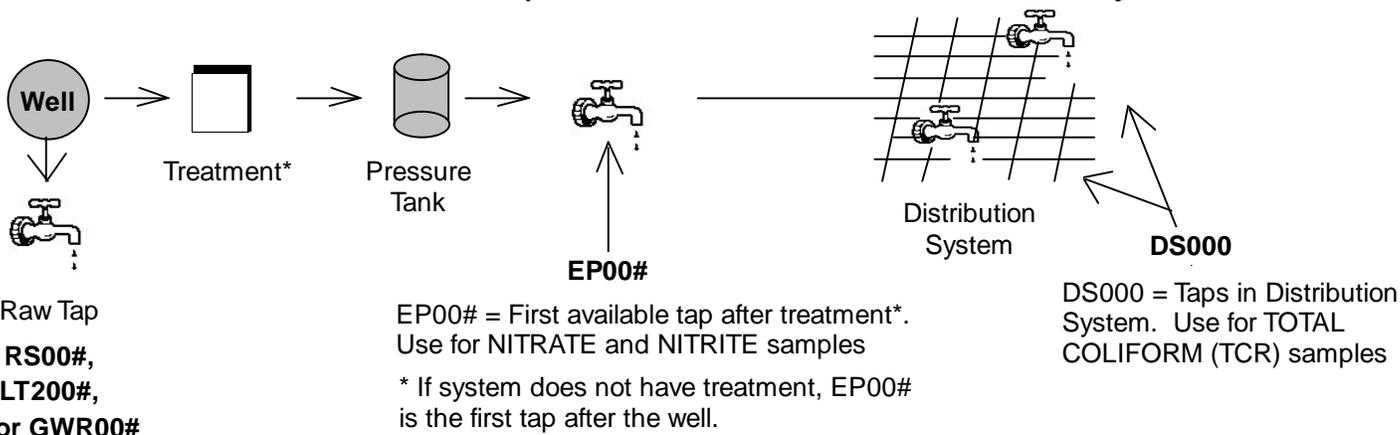

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3235212 JENERA COMMUNITY BUILDING

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: JENERA COMMUNITY PARK DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 1/31/2016
	1 Sample(s) Required between 2/1/2016 and 2/29/2016
	1 Sample(s) Required between 3/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 4/30/2016
	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 10/31/2016
	1 Sample(s) Required between 11/1/2016 and 11/30/2016
	1 Sample(s) Required between 12/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

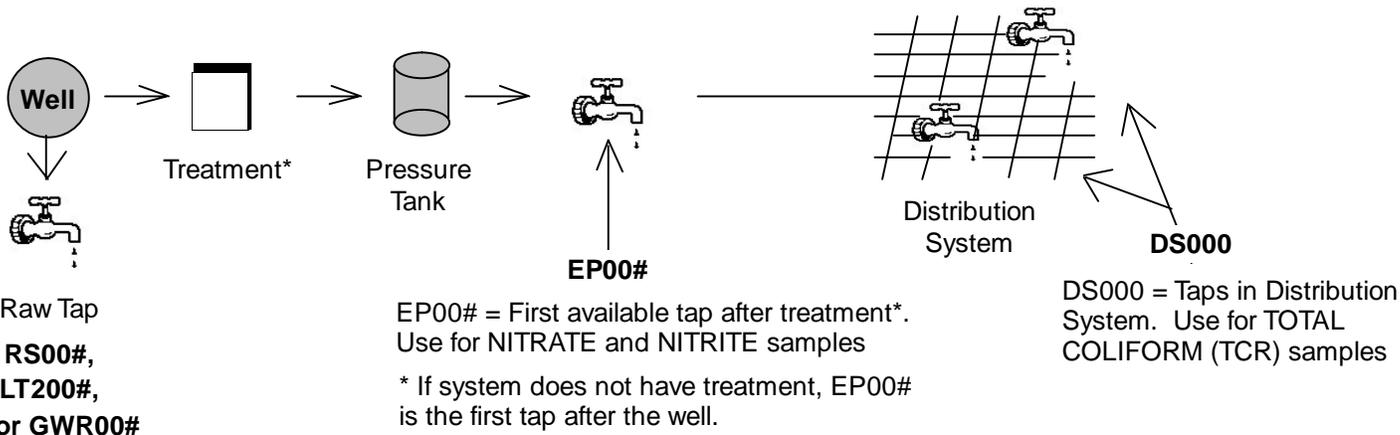

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3235212 JENERA COMMUNITY BUILDING

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3254824** Facility Name: **JENERA COMMUNITY PARK**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

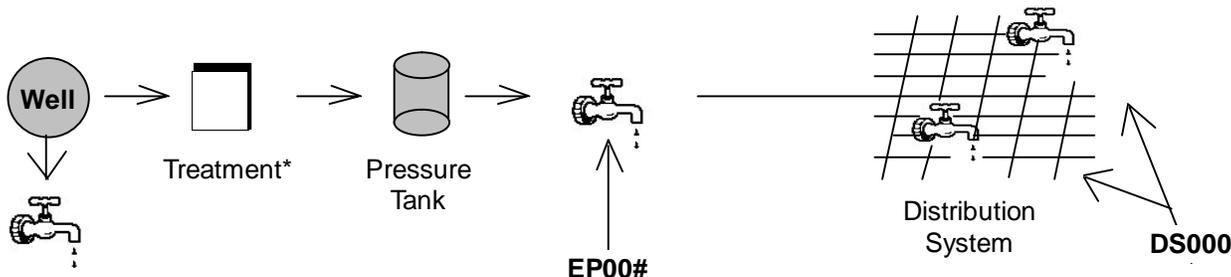

Raw Tap
RS00#,
LT200#,
 or **GWR00#**

EP00# = First available tap after treatment*.
 Use for NITRATE and NITRITE samples
 * If system does not have treatment, EP00#
 is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3236212 HERITAGE SPRINGS CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: HERITAGE SPRINGS CMPGRD DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

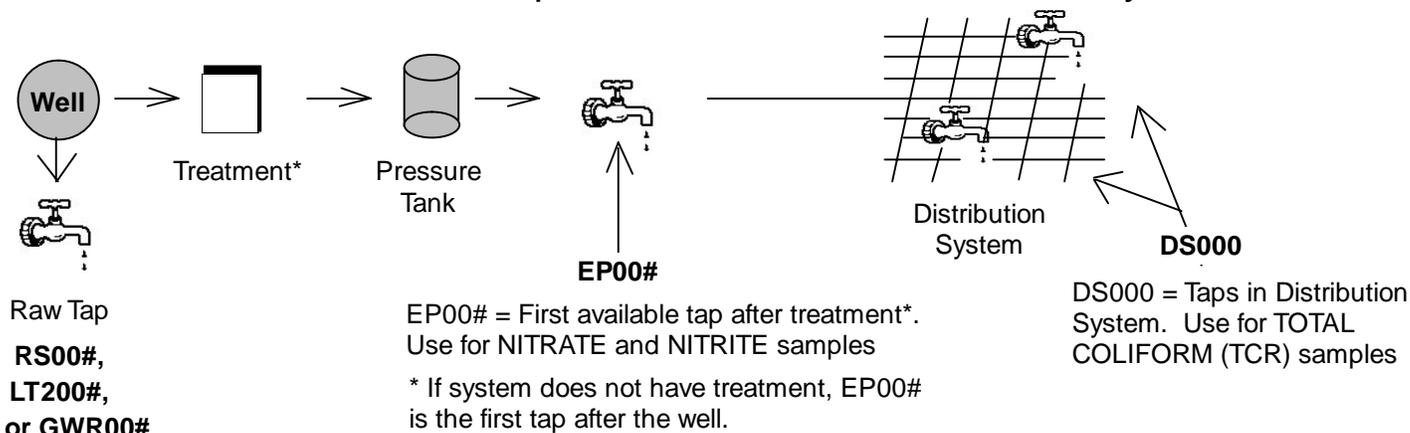

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3236212 HERITAGE SPRINGS CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3254826** Facility Name: **HERITAGE SPRINGS CAMPGROUND**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

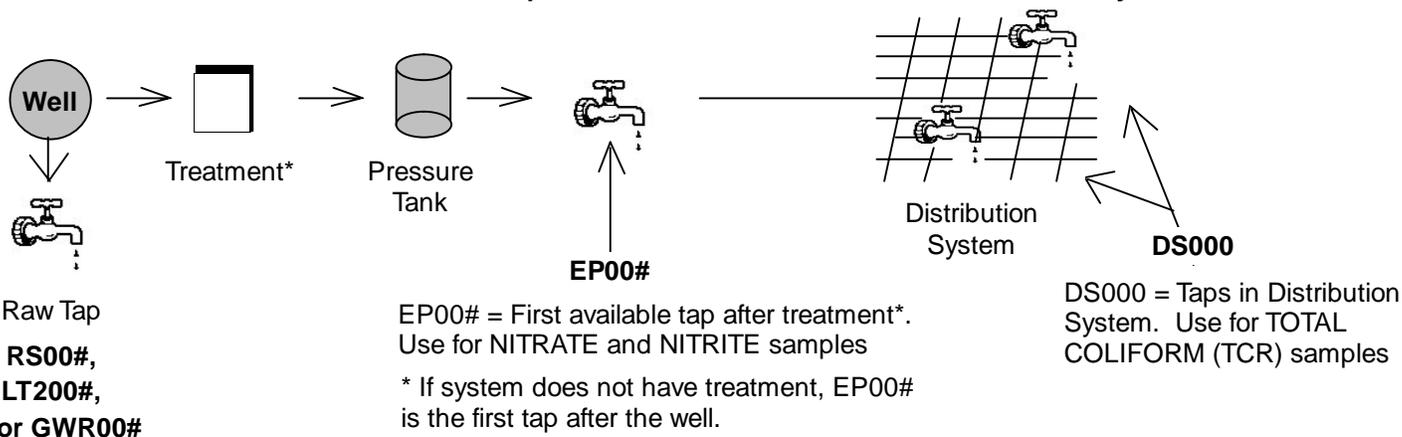

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3236412 LAKELAND GOLF COURSE FOSTORIA

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: LAKELAND GOLF COURSE DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

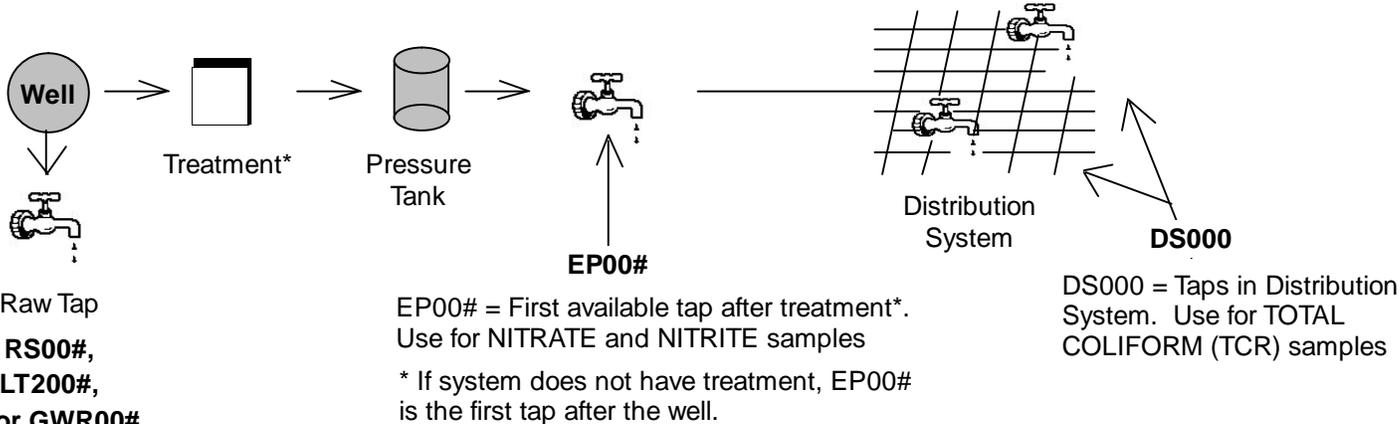

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3236412 LAKELAND GOLF COURSE FOSTORIA

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3254828** Facility Name: **LAKELAND GOLF COURSE FOSTORIA**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

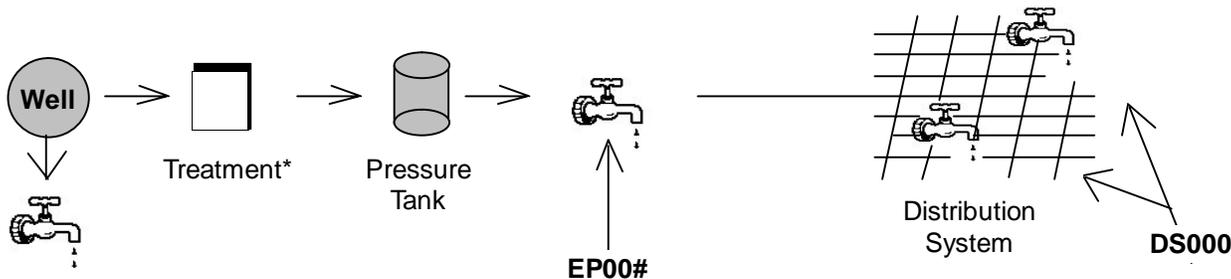

Raw Tap
RS00#,
LT200#,
 or **GWR00#**

EP00# = First available tap after treatment*.
 Use for NITRATE and NITRITE samples
 * If system does not have treatment, EP00#
 is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3238812 PLEASANT VIEW METHODIST CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: PLEASANT VIEW METH CH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

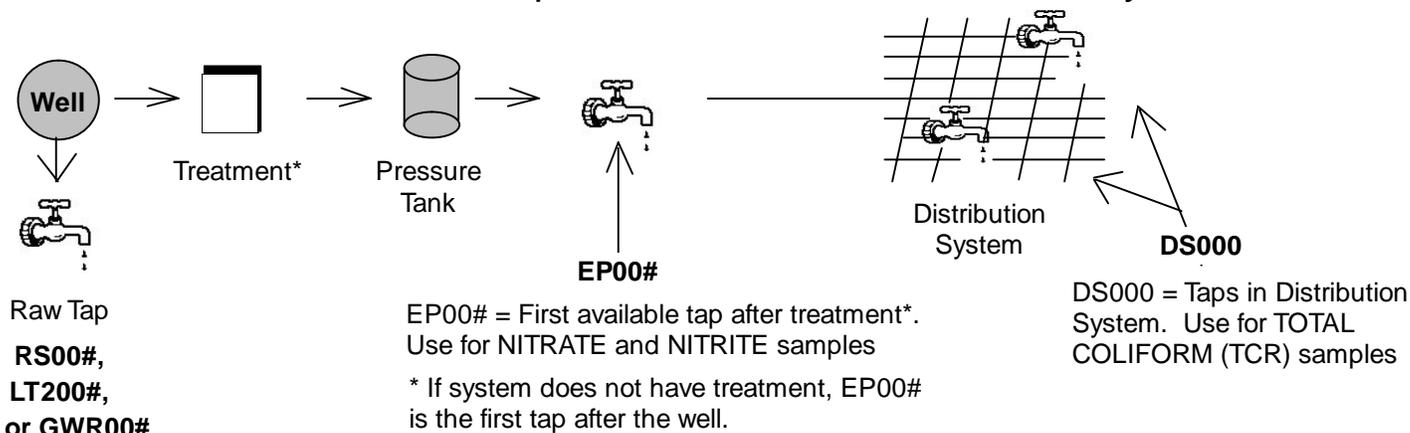

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3238812 PLEASANT VIEW METHODIST CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3254832 Facility Name: PLEASANT VIEW METH CHURCH

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

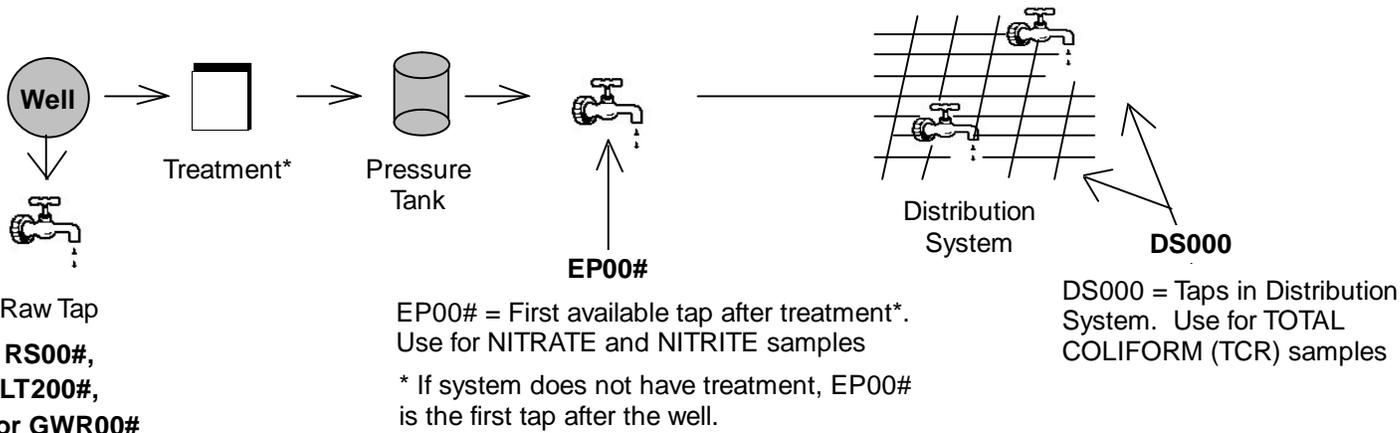

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3238912 PLEASANT VIEW RESORT- EAST

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: PLEASANT VIEW RECREATION EAST DISTRIBUTI
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

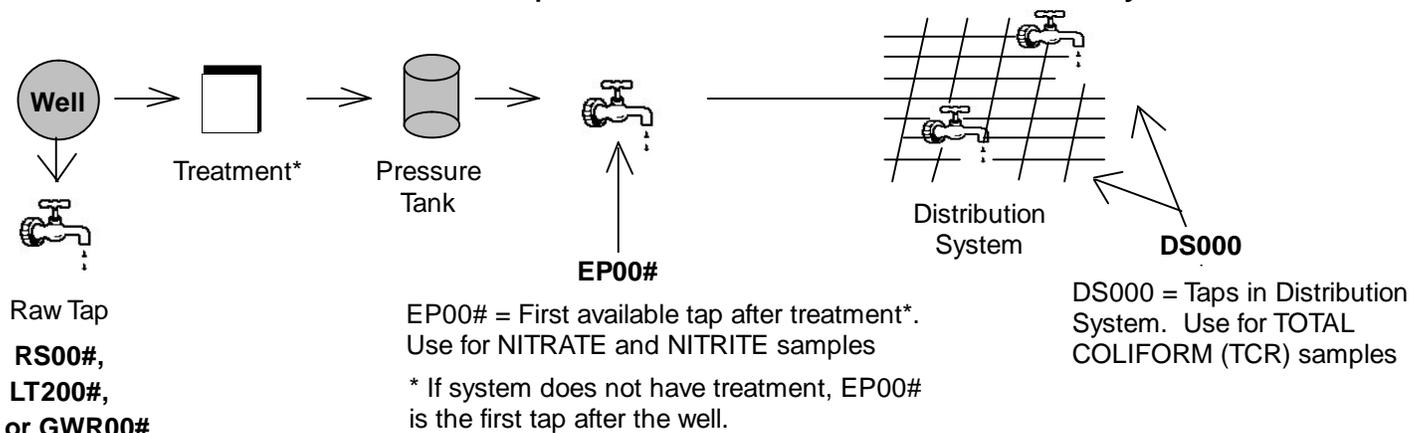

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3238912 PLEASANT VIEW RESORT- EAST

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3254833 Facility Name: PLEASANT VIEW RV RESORT EAST

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

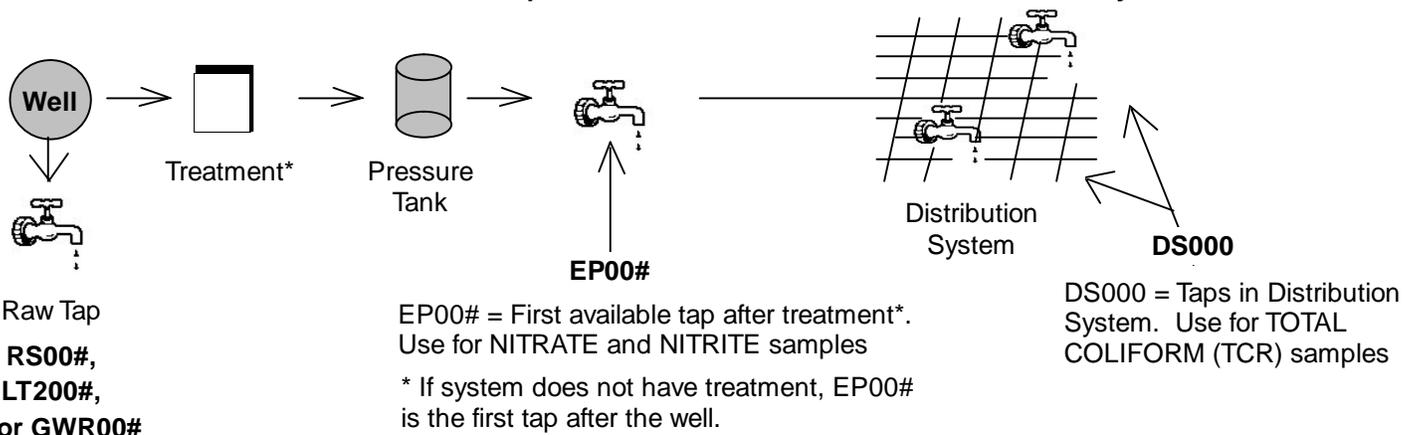

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH3239812 RIVERDALE LOCAL SCHOOLS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 3261718	Facility Name: RIVERDALE LOCAL SCHOOLS TP
Location	SMP ID: EP002	Facility Source: Ground Water Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH3239812 RIVERDALE LOCAL SCHOOLS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **RIVERDALE LOCAL SCHOOLS DISTRIBUTION** Facility Class: **CLASS 1**
SMP ID: **DS000**

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

TOTAL COLIFORM (TCR) - 3100
2 Sample(s) Required between 1/1/2016 and 1/31/2016
2 Sample(s) Required between 2/1/2016 and 2/29/2016
2 Sample(s) Required between 3/1/2016 and 3/31/2016
2 Sample(s) Required between 4/1/2016 and 4/30/2016
2 Sample(s) Required between 5/1/2016 and 5/31/2016
2 Sample(s) Required between 6/1/2016 and 6/30/2016
2 Sample(s) Required between 7/1/2016 and 7/31/2016
2 Sample(s) Required between 8/1/2016 and 8/31/2016
2 Sample(s) Required between 9/1/2016 and 9/30/2016
2 Sample(s) Required between 10/1/2016 and 10/31/2016
2 Sample(s) Required between 11/1/2016 and 11/30/2016
2 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000
2 Sample(s) Required between 1/1/2016 and 1/31/2016
2 Sample(s) Required between 2/1/2016 and 2/29/2016
2 Sample(s) Required between 3/1/2016 and 3/31/2016
2 Sample(s) Required between 4/1/2016 and 4/30/2016
2 Sample(s) Required between 5/1/2016 and 5/31/2016
2 Sample(s) Required between 6/1/2016 and 6/30/2016
2 Sample(s) Required between 7/1/2016 and 7/31/2016
2 Sample(s) Required between 8/1/2016 and 8/31/2016
2 Sample(s) Required between 9/1/2016 and 9/30/2016
2 Sample(s) Required between 10/1/2016 and 10/31/2016
2 Sample(s) Required between 11/1/2016 and 11/30/2016
2 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: **DS1** Facility Name: **RIVERDALE LOCAL SCHOOLS DISTRIBUTION** Facility Class: **CLASS 1**
SMP ID: **DS201** ADDRESS NOT KNOWN

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

OH3239812 RIVERDALE LOCAL SCHOOLS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: RIVERDALE LOCAL SCHOOLS DISTRIBUTION	Facility Class: CLASS 1
	SMP ID: DS202	ADDRESS NOT KNOWN	

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH3240112 SHADYLAKE CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: SHADYLAKE CAMPGROUND DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

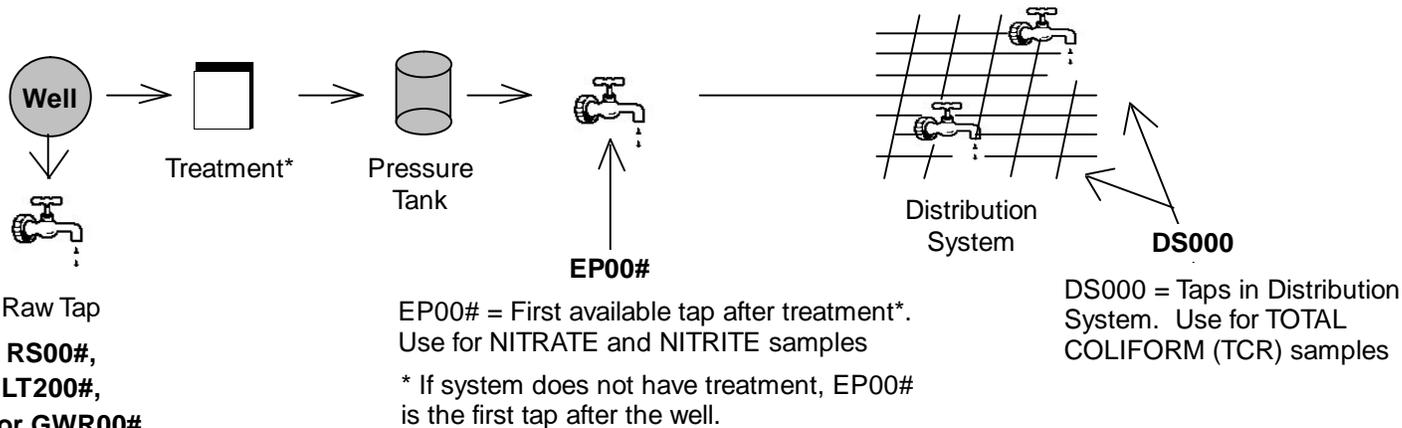

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3240112 SHADYLAKE CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3254838** Facility Name: **SHADYLAKE CAMPGROUND**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

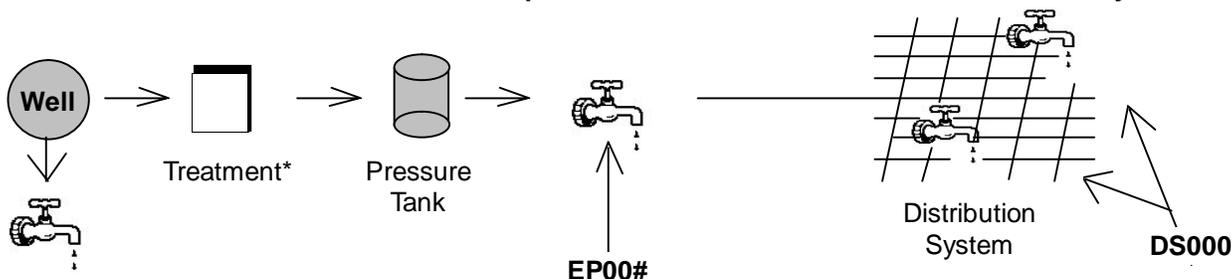

Raw Tap
RS00#,
LT200#,
or **GWR00#**

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples
* If system does not have treatment, EP00#
is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3240912 ST PAUL EVANGELICAL LUTHERAN CH-JENERA

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ST PAUL EV LUTHERAN CH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

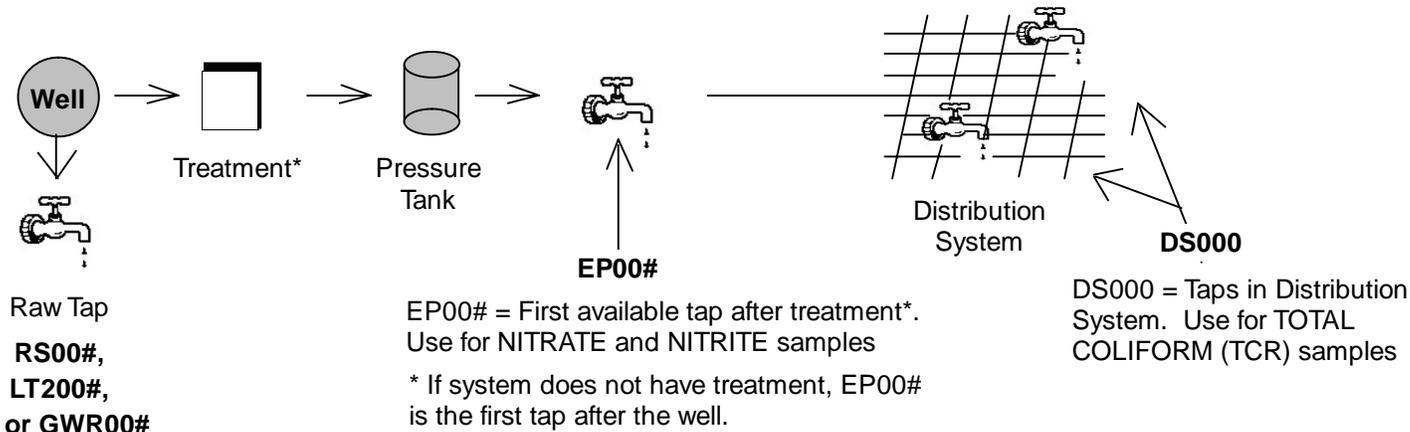

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3240912 ST PAUL EVANGELICAL LUTHERAN CH-JENERA

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3254839** Facility Name: **ST PAUL EV LUTHERAN CHURCH**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

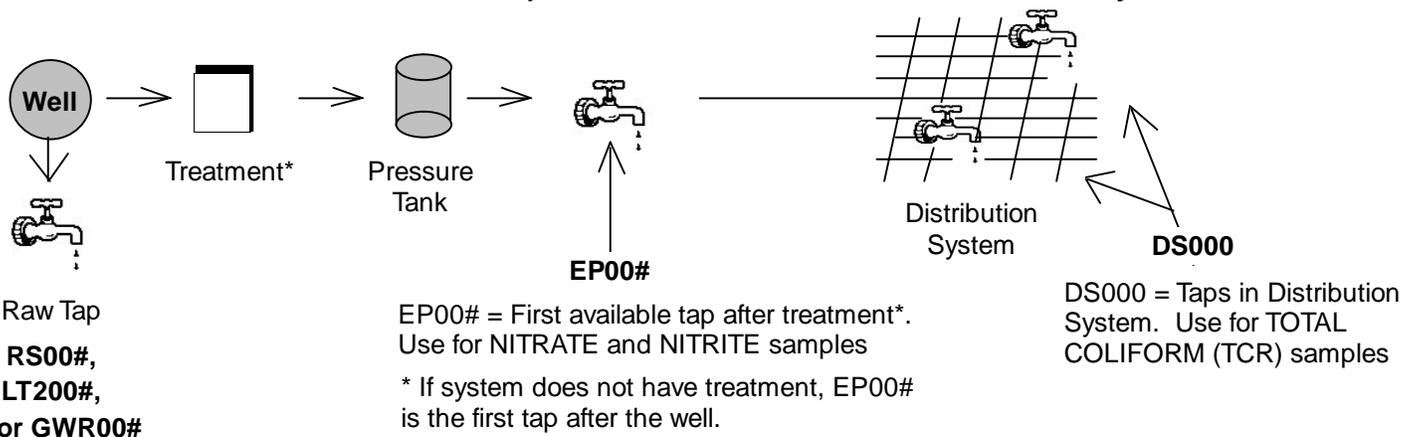

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3241312 SYCAMORE SPRINGS GOLF COURSE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: SYCAMORE SPR GOLF COURSE DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

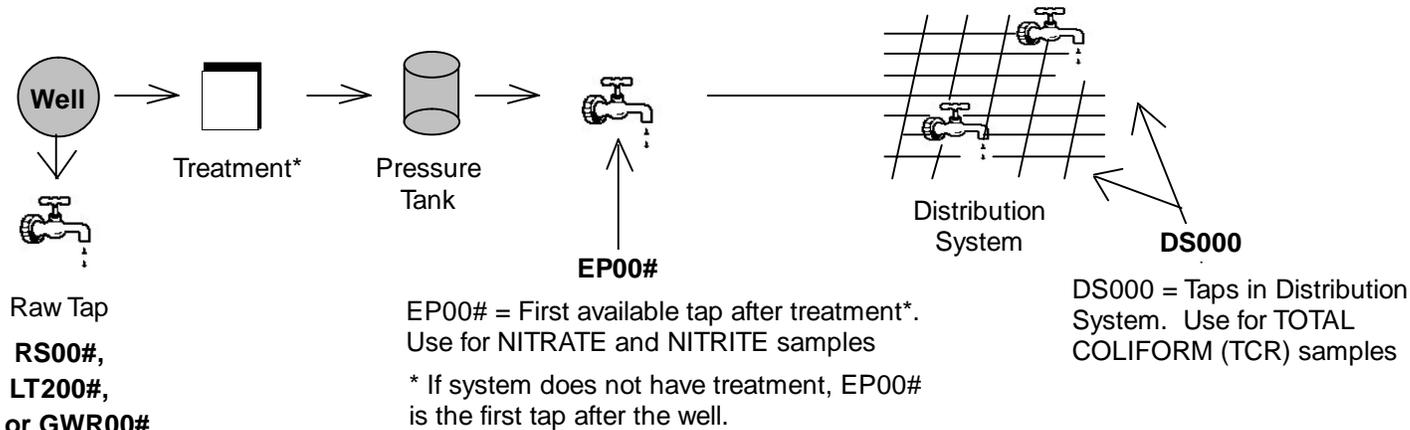

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3241312 SYCAMORE SPRINGS GOLF COURSE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3254841	Facility Name: SYCAMORE SPRINGS GOLF COURSE STU 1
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

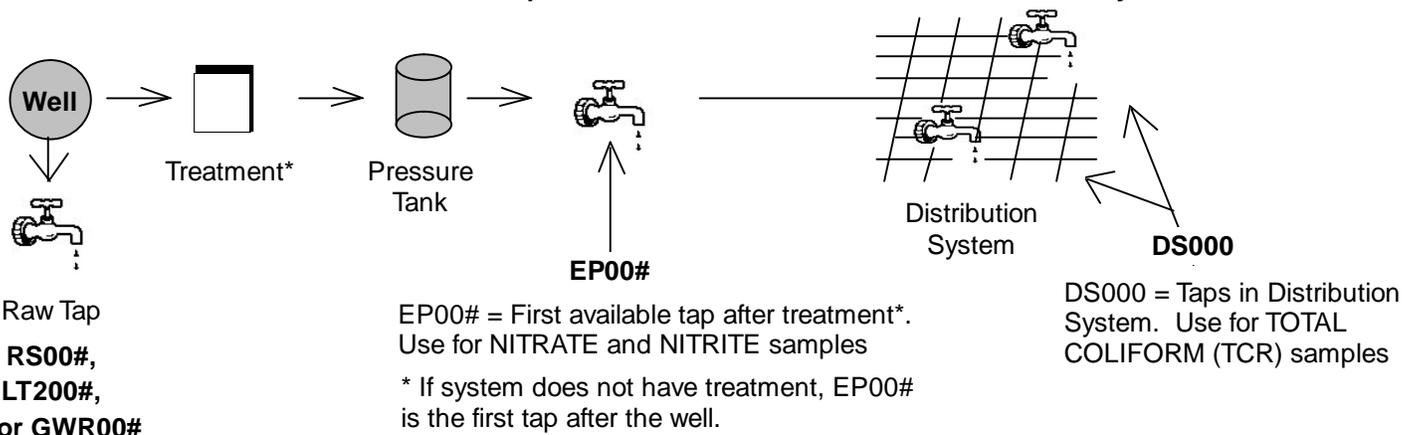

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3241812 BLUFFTON/FINDLAY SW KOA

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: BLUFFTON/FINDLAY SW KOA DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

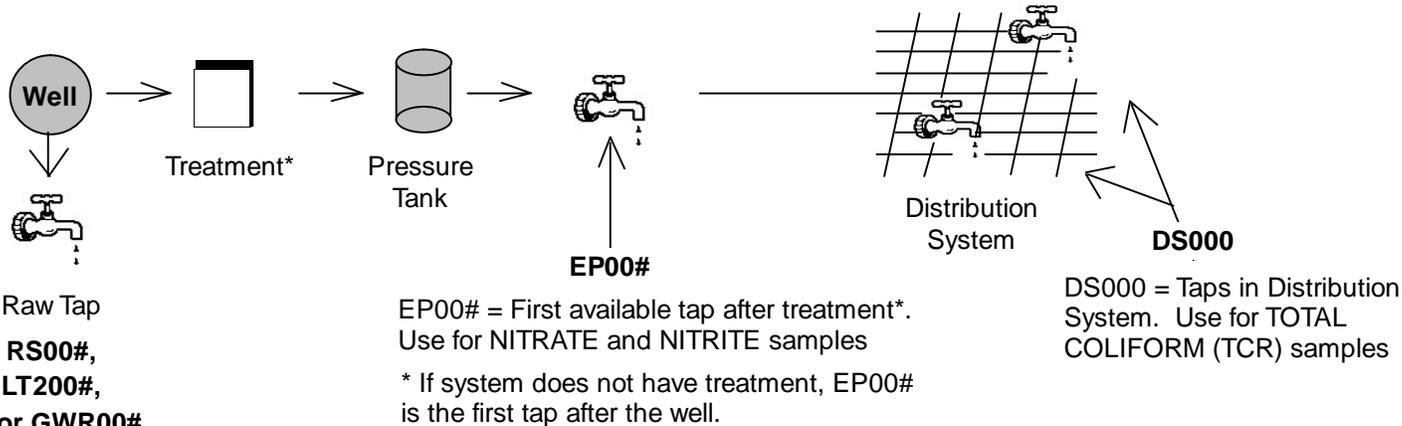

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3241812 BLUFFTON/FINDLAY SW KOA

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3254846	Facility Name: BLUFFTON/FINDLAY SW KOA-BATHHOUSE
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

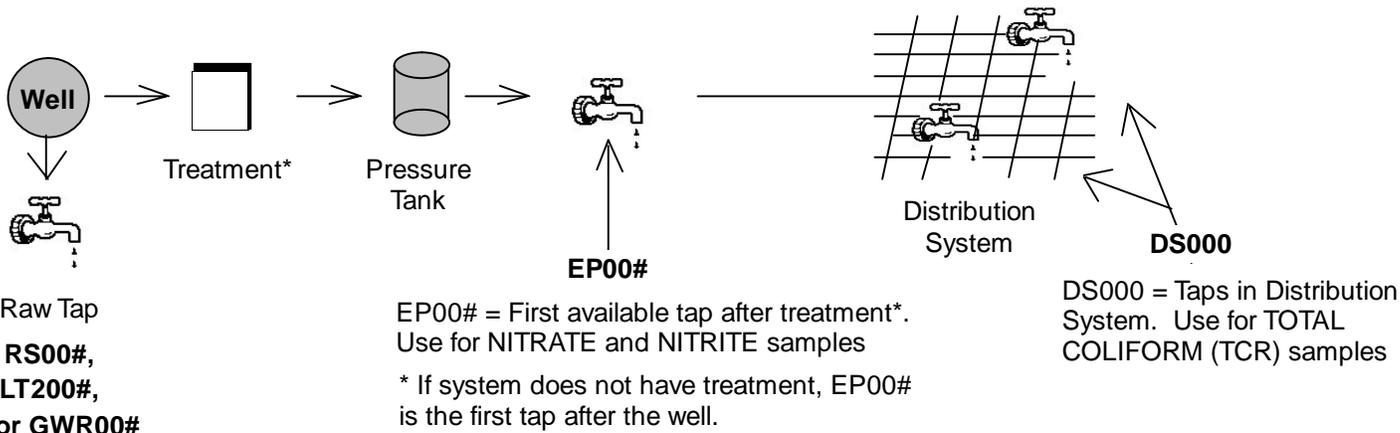

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3241812 BLUFFTON/FINDLAY SW KOA

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: BLUFFTON/FINDLAY SW KOA DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

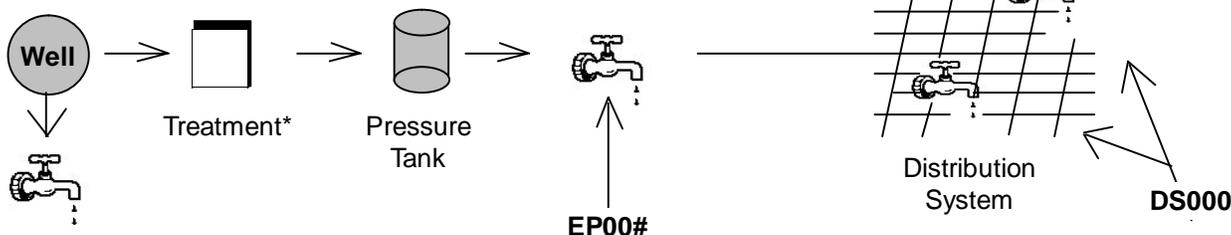

Raw Tap
RS00#,
LT200#,
or GWR00#

EP00# = First available tap after treatment*.
 Use for NITRATE and NITRITE samples
 * If system does not have treatment, EP00# is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3241812 BLUFFTON/FINDLAY SW KOA

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3260521** Facility Name: **BLUFFTON/FINDLAY SW KOA-STORE**

Location SMP ID: **EP002** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

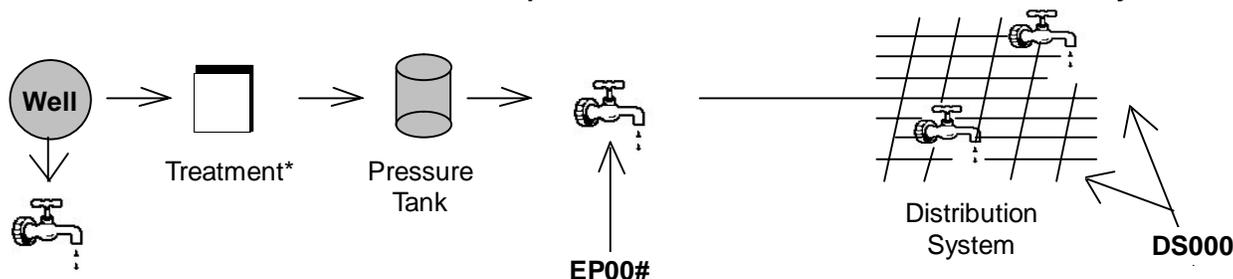

Raw Tap
RS00#,
LT200#,
or **GWR00#**

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples
* If system does not have treatment, EP00#
is the first tap after the well.

DS000 = Taps in Distribution
System. Use for TOTAL
COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3242012 UNITED CONSERVATION AND OUTDOOR ASSN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: UN CONSV & OUTDOOR ASSN DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

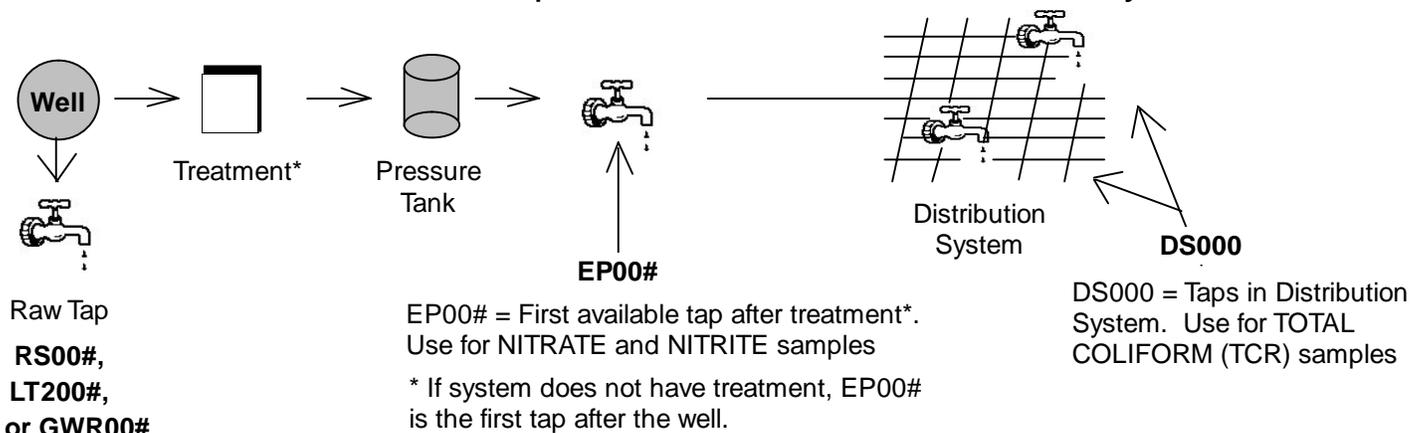

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3242012 UNITED CONSERVATION AND OUTDOOR ASSN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3254847** Facility Name: **UN CONSV & OUTDOOR ASSN**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

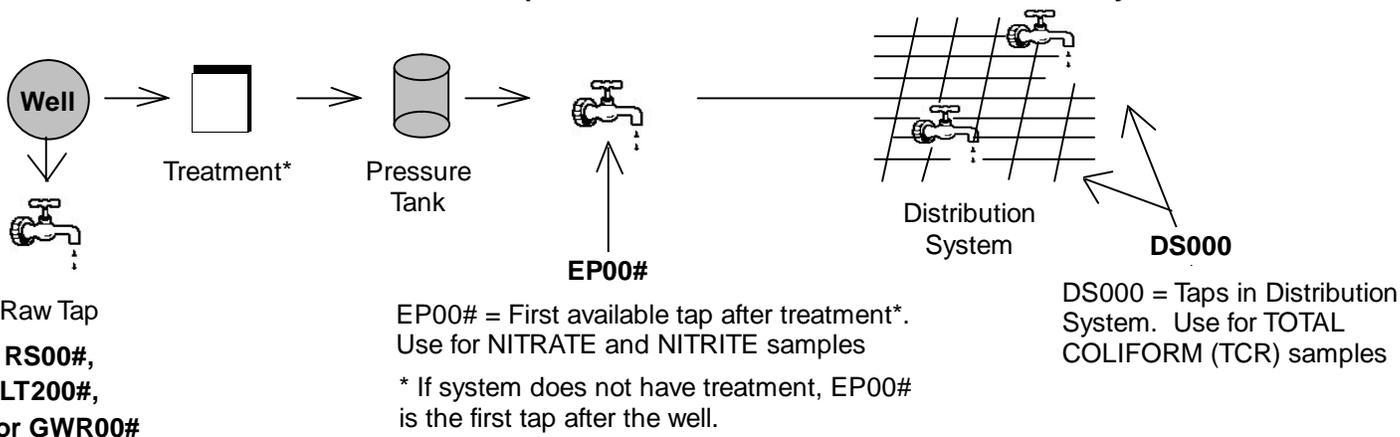

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3243112 WEST INDEPENDENCE UM CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

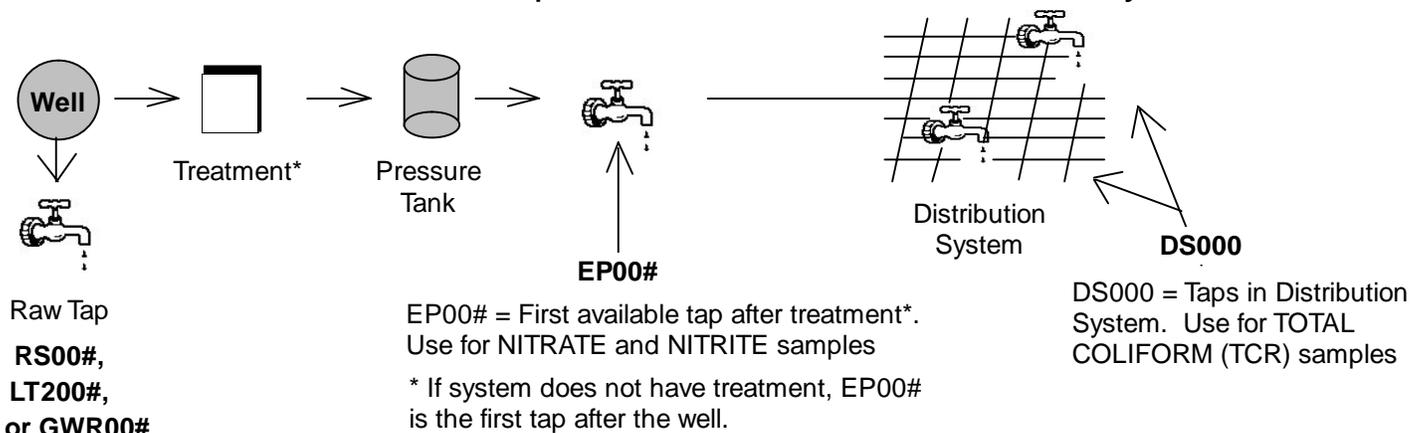

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3243112 WEST INDEPENDENCE UM CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3254852** Facility Name: **WEST INDEPENDENCE UM CHURCH**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

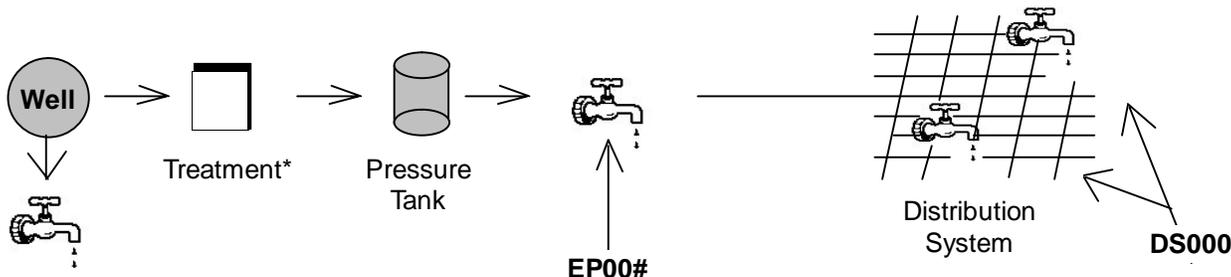

Raw Tap
RS00#,
LT200#,
 or **GWR00#**

EP00# = First available tap after treatment*.
 Use for NITRATE and NITRITE samples
 * If system does not have treatment, EP00#
 is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3243812 ODOT REST AREA 1-25 NB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ODOT RA 1-25 NB DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2016 and 1/31/2016
	2 Sample(s) Required between 2/1/2016 and 2/29/2016
	2 Sample(s) Required between 3/1/2016 and 3/31/2016
	2 Sample(s) Required between 4/1/2016 and 4/30/2016
	2 Sample(s) Required between 5/1/2016 and 5/31/2016
	2 Sample(s) Required between 6/1/2016 and 6/30/2016
	2 Sample(s) Required between 7/1/2016 and 7/31/2016
	2 Sample(s) Required between 8/1/2016 and 8/31/2016
	2 Sample(s) Required between 9/1/2016 and 9/30/2016
	2 Sample(s) Required between 10/1/2016 and 10/31/2016
	2 Sample(s) Required between 11/1/2016 and 11/30/2016
	2 Sample(s) Required between 12/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

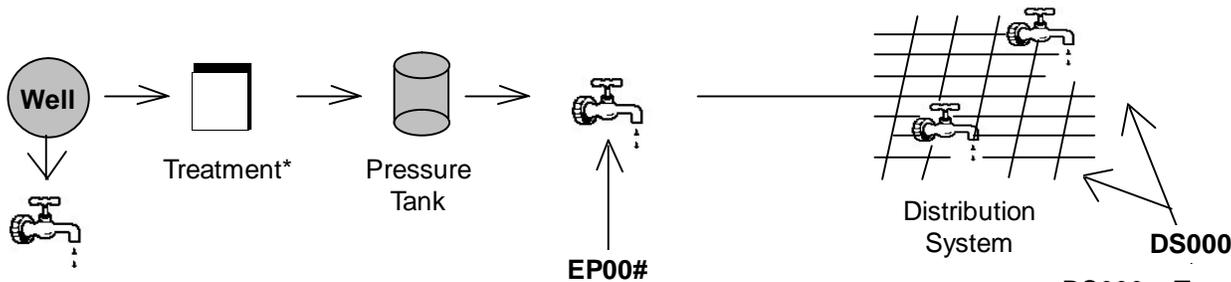

Raw Tap
RS00#,
LT200#,
 or **GWR00#**

EP00# = First available tap after treatment*.
 Use for NITRATE and NITRITE samples
 * If system does not have treatment, EP00#
 is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3243812 ODOT REST AREA 1-25 NB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3254855	Facility Name: ODOT RA 1-25 NB
Location SMP ID: EP001	Facility Source: Ground Water
Facility Class: CLASS A	

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

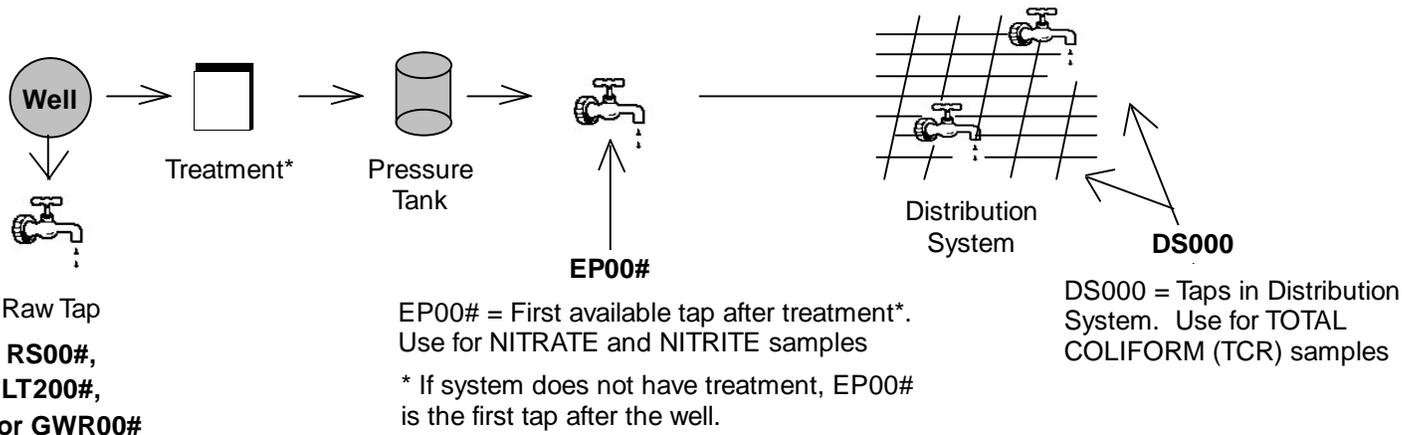

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3244012 ODOT REST AREA 1-26 SB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ODOT RA 1-26 SB DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2016 and 1/31/2016
	2 Sample(s) Required between 2/1/2016 and 2/29/2016
	2 Sample(s) Required between 3/1/2016 and 3/31/2016
	2 Sample(s) Required between 4/1/2016 and 4/30/2016
	2 Sample(s) Required between 5/1/2016 and 5/31/2016
	2 Sample(s) Required between 6/1/2016 and 6/30/2016
	2 Sample(s) Required between 7/1/2016 and 7/31/2016
	2 Sample(s) Required between 8/1/2016 and 8/31/2016
	2 Sample(s) Required between 9/1/2016 and 9/30/2016
	2 Sample(s) Required between 10/1/2016 and 10/31/2016
	2 Sample(s) Required between 11/1/2016 and 11/30/2016
	2 Sample(s) Required between 12/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

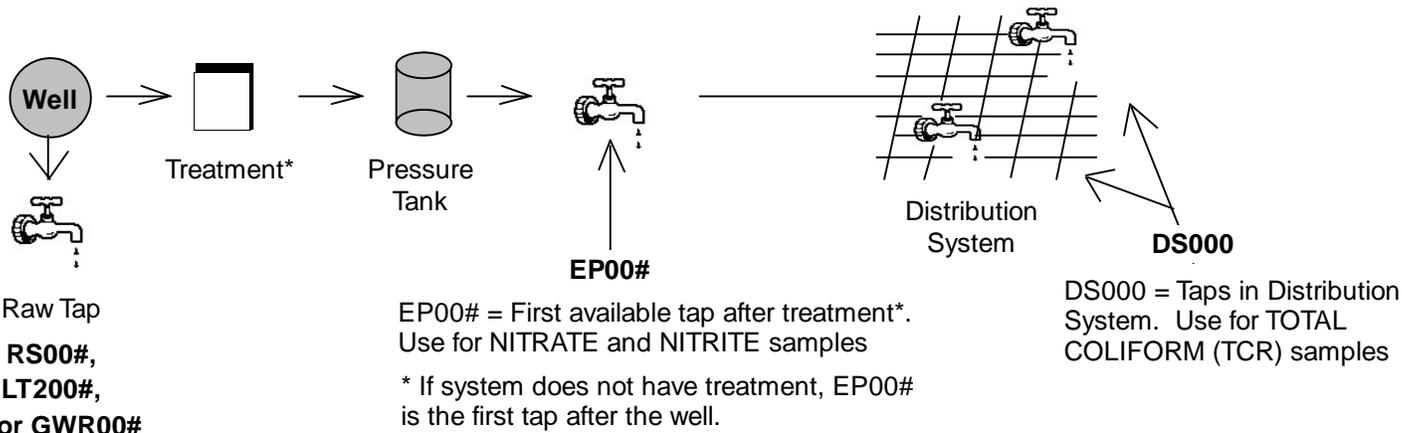

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3244012 ODOT REST AREA 1-26 SB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3254856	Facility Name: ODOT RA 1-26 SB TP
Location SMP ID: EP001	Facility Source: Ground Water
Facility Class: CLASS A	

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

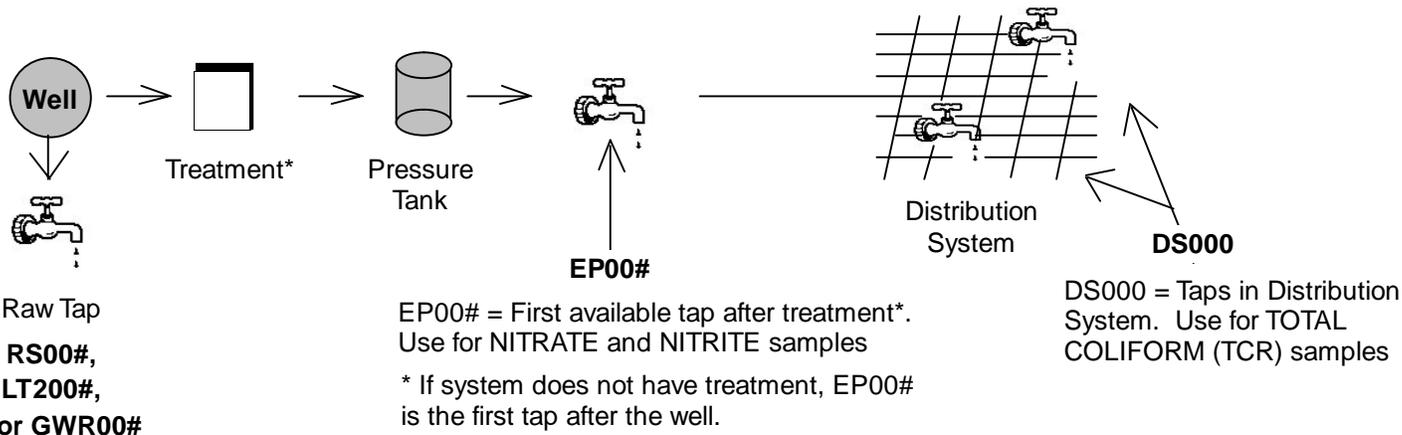

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

OH3244912 UNIVERSITY OF FINDLAY-SOUTH CAMPUS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3254863	Facility Name: UNIVERSITY OF FINDLAY-S	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

OH3244912 UNIVERSITY OF FINDLAY-SOUTH CAMPUS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **UNIV OF FINDLAY-S DIST**
SMP ID: **DS000**

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016 1 Sample(s) Required between 4/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 9/30/2016 1 Sample(s) Required between 10/1/2016 and 12/31/2016



OH3245612 GARNER TRANSPORTATION GROUP

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 3254870	Facility Name: GARNER TRANSPORTATION GROUP
Location	SMP ID: EP001	Facility Source: Ground Water Facility Class: CLASS A

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2016 and 5/31/2016



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

OH3245612 GARNER TRANSPORTATION GROUP

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **GARNER TRANSPORTATION GROUP DISTRIE**
SMP ID: **DS000**

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2016 and 9/30/2016

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

TOTAL COLIFORM (TCR) - 3100
1 Sample(s) Required between 1/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 12/31/2016

OH3245812 HANCOCK PRK DIS-RIVERBEND MEADOWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: RIVERBEND PK MEADOWS PAV DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

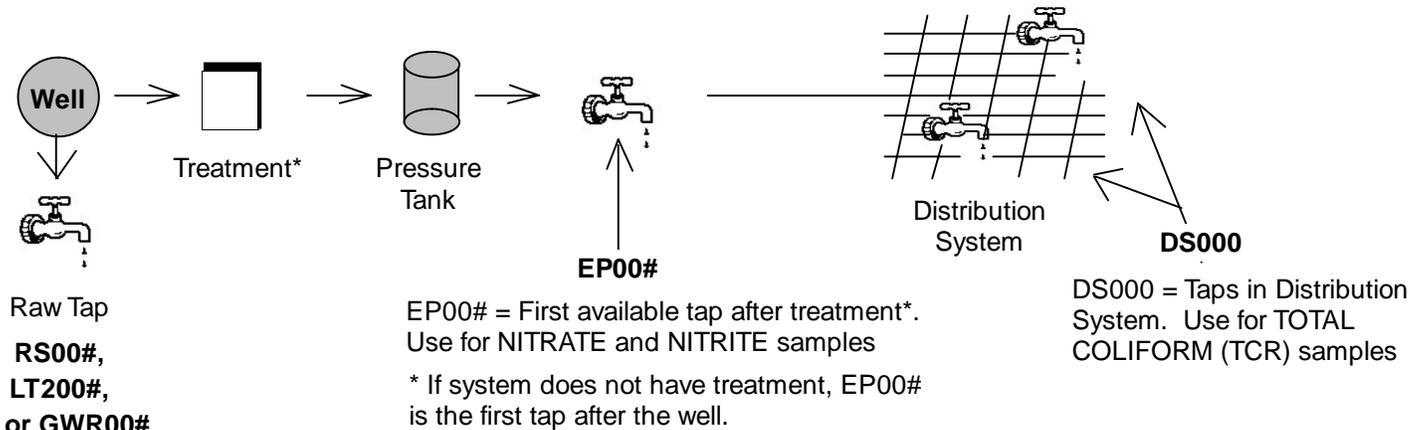

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3245812 HANCOCK PRK DIS-RIVERBEND MEADOWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3254872** Facility Name: **RIVERBEND MEADOWS**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

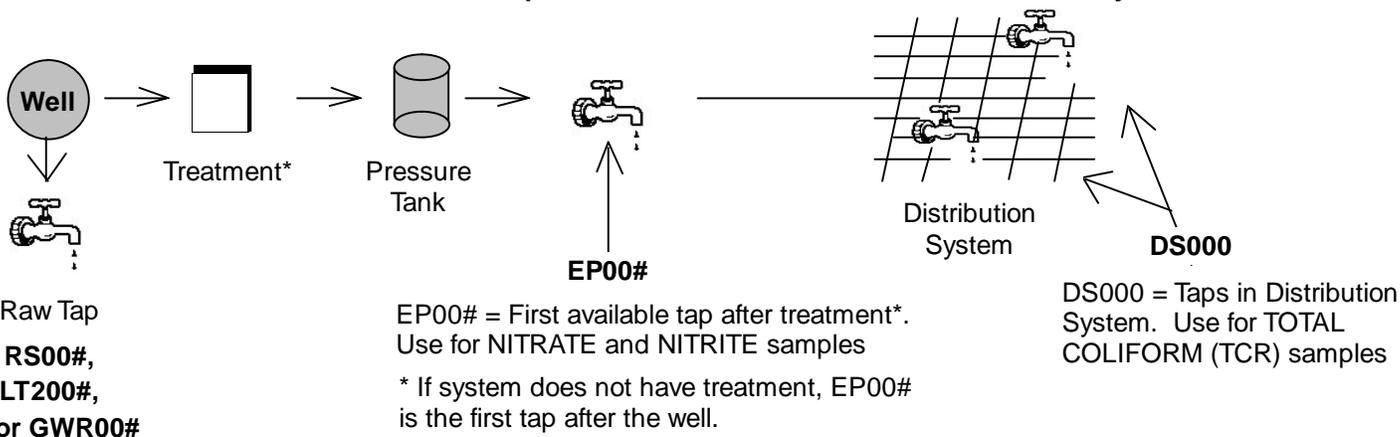

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH3245912 TRINITY LUTHERAN SCHOOL-JENERA

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 3254873	Facility Name: TRINITY EVANGELICAL LUTHERAN SCHOOL
Location	SMP ID: EP001	Facility Source: Ground Water Facility Class: CLASS A

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.
 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
 Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
ARSENIC - 1005	1 Sample(s) Required between 1/1/2016 and 3/31/2016 1 Sample(s) Required between 4/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 9/30/2016 1 Sample(s) Required between 10/1/2016 and 12/31/2016
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2016 and 3/31/2016



Effective Date: 02/12/2016

2016 DISTRIBUTION SCHEDULE

OH3245912 TRINITY LUTHERAN SCHOOL-JENERA

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **DISTRIBUTION**
SMP ID: **DS000**

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022
5 Sample(s) Required between 1/1/2016 and 6/30/2016
5 Sample(s) Required between 7/1/2016 and 12/31/2016

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

TOTAL COLIFORM (TCR) - 3100
1 Sample(s) Required between 1/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 12/31/2016

OH3246112 JEFFREYS ANTIQUE GALLERY

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: JEFFREYS ANTIQUE GALLERY DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

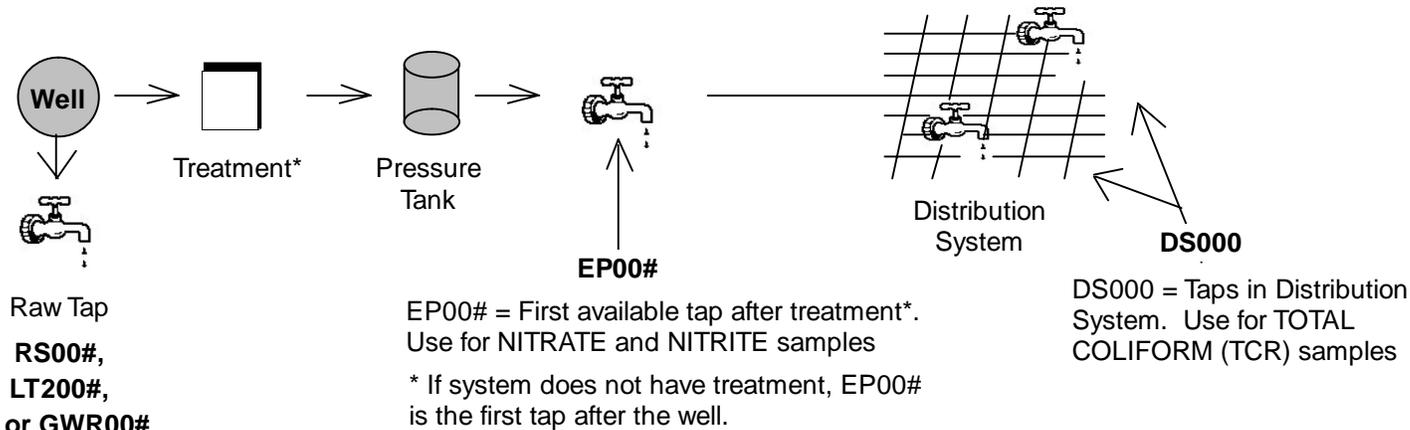

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3246112 JEFFREYS ANTIQUE GALLERY

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3254875	Facility Name: JEFFERYS ANTIQUE GALLERY
Location SMP ID: EP001	Facility Source: Ground Water Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

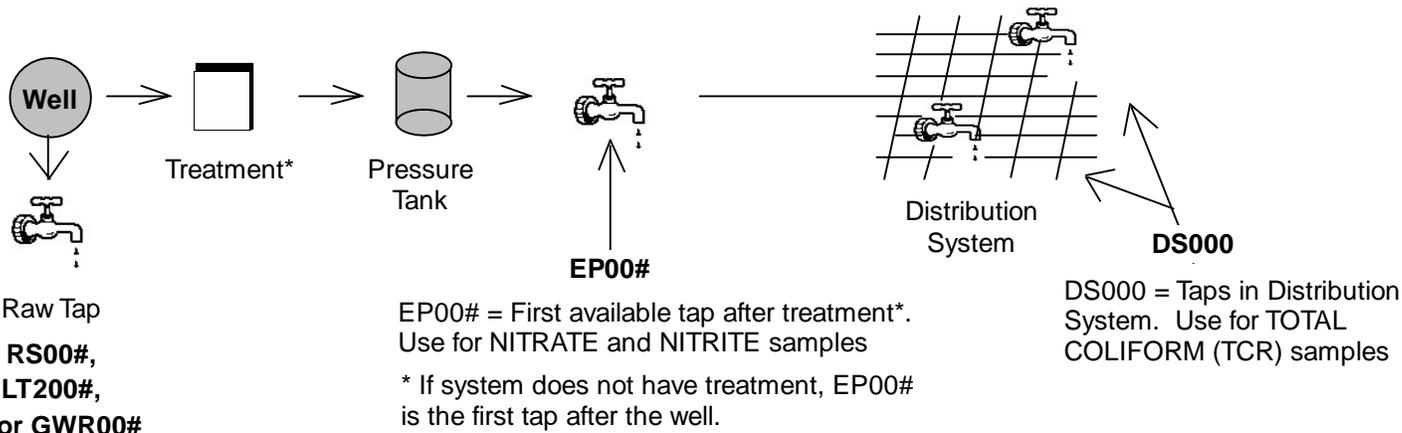

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3246512 PLEASANT VIEW RESORT- WEST

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: PLEASANT VIEW RECREATION WEST DISTRIBUTI
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

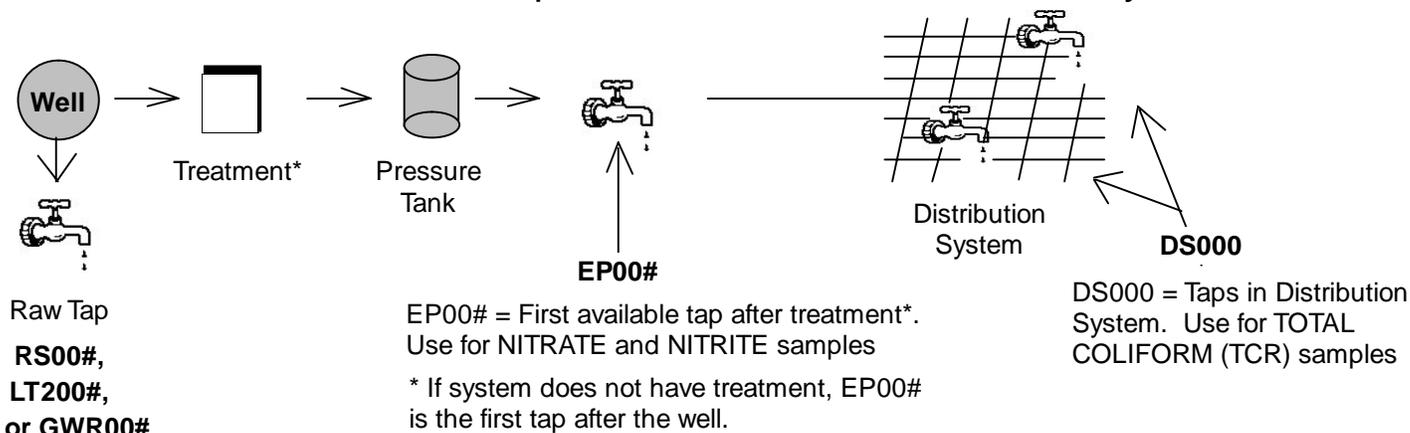

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3246512 PLEASANT VIEW RESORT- WEST

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3254879** Facility Name: **PLEASANT VIEW RV RESORT WEST**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

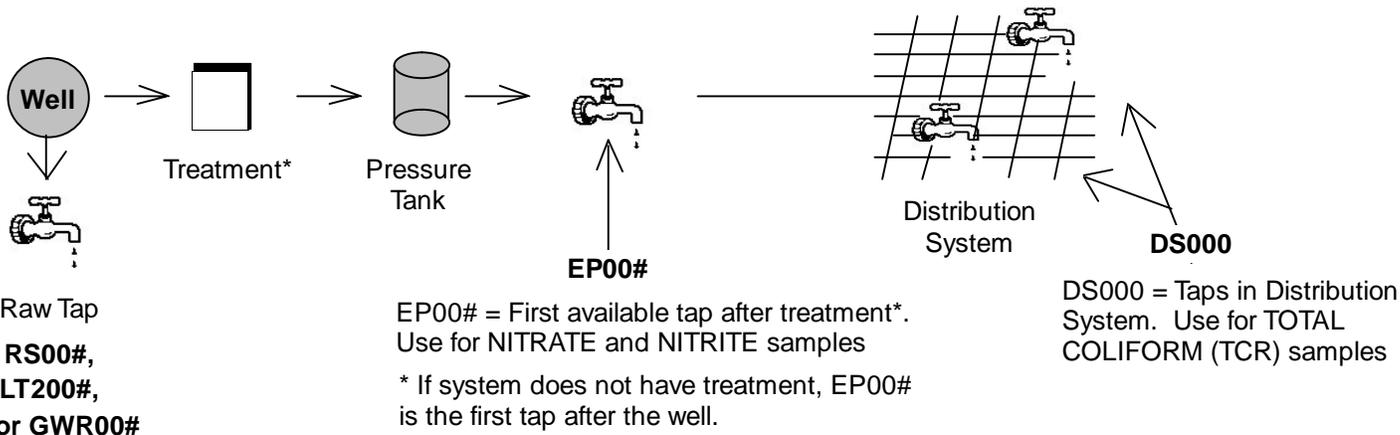

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3247112 HANCOCK PRK DIS-LITZENBERG MEMORIAL PARK

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: LITZENBERG MEMORIAL WOOD DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

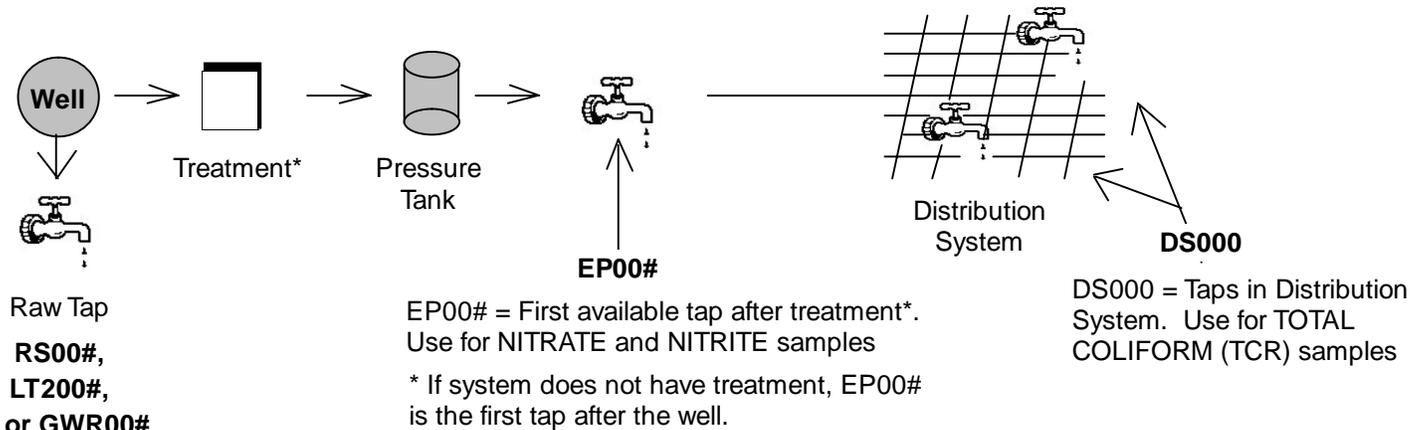

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3247112 HANCOCK PRK DIS-LITZENBERG MEMORIAL PARK

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3254882** Facility Name: **LITZENBERG MEMORIAL WOODS**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

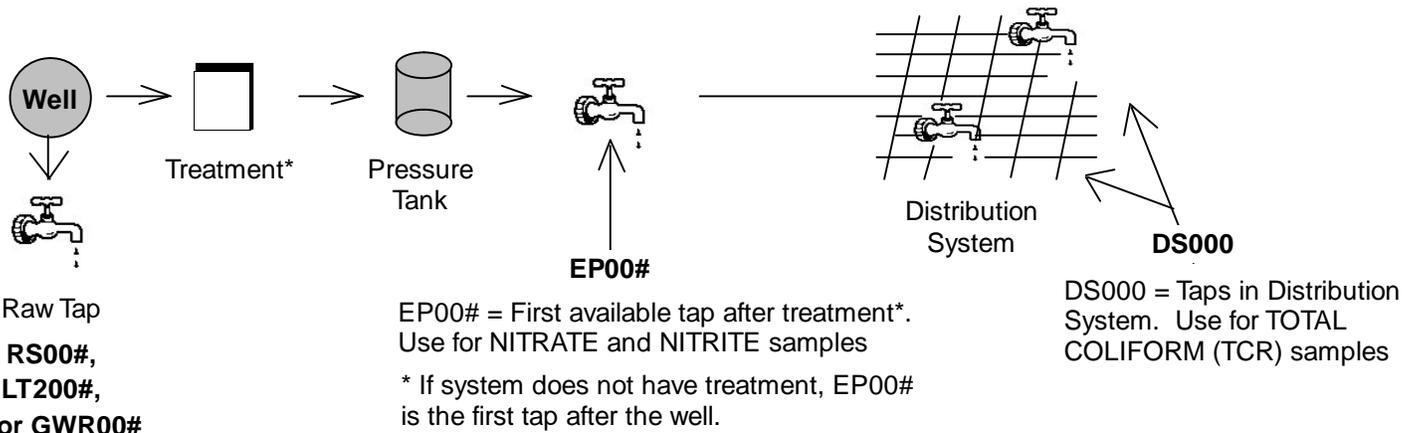

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3247412 SULPHUR LAKE CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 3/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

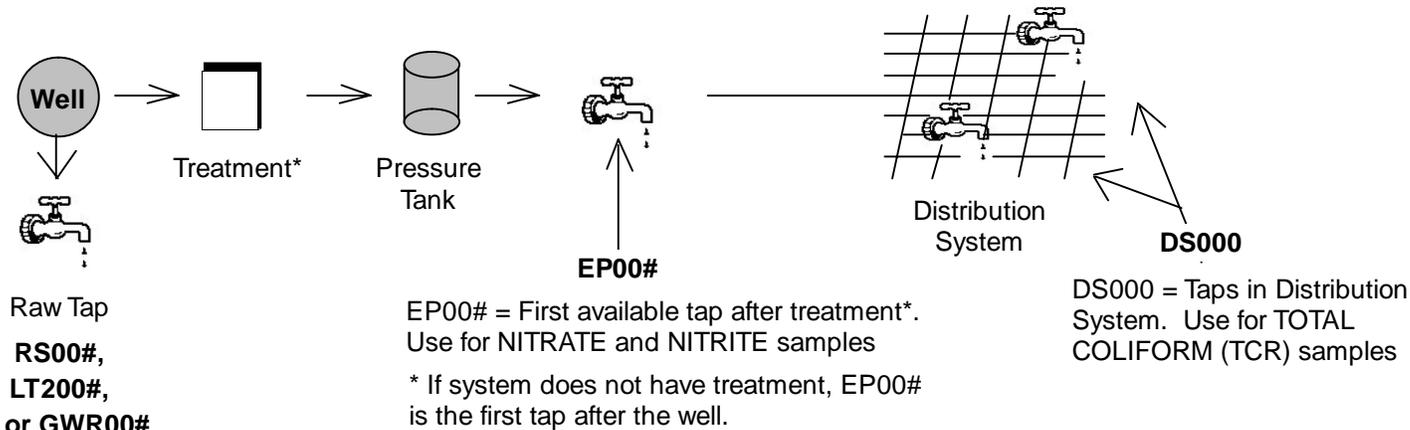

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3247412 SULPHUR LAKE CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 3/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3260783** Facility Name: **TREATMENT PLANT**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

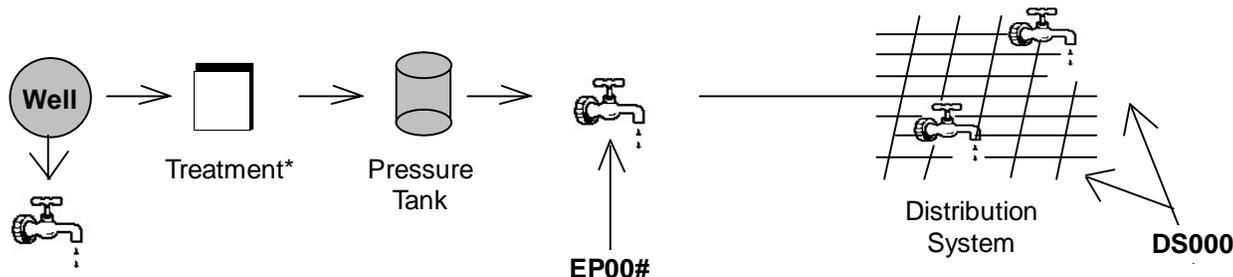

Raw Tap
RS00#,
LT200#,
or **GWR00#**

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00#
is the first tap after the well.

DS000 = Taps in Distribution
System. Use for TOTAL
COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3248212 SPARKS COMMERCIAL TIRE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: SPARKS COMMERCIAL TIRE DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

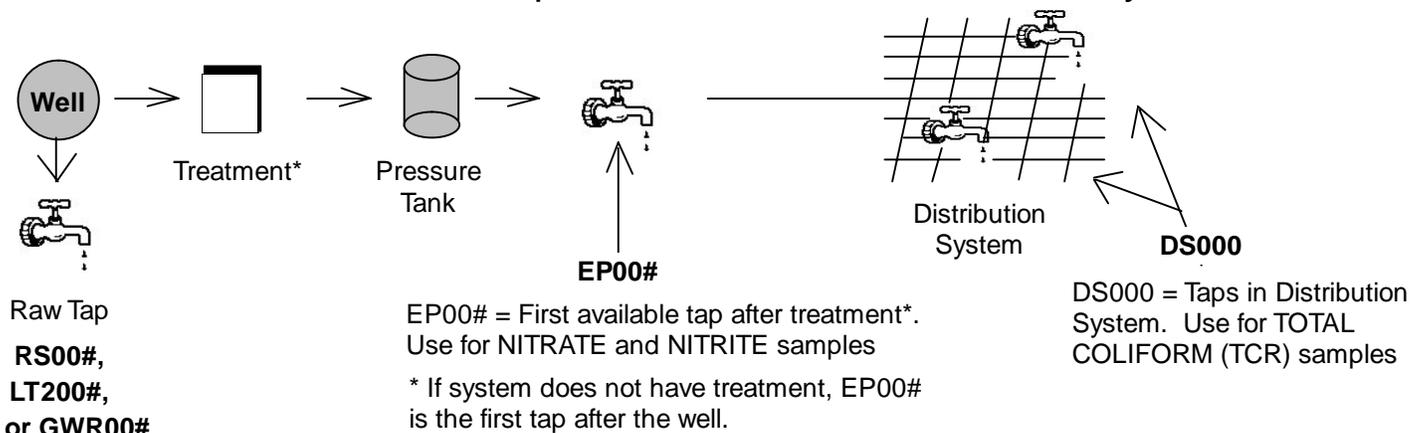

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3248212 SPARKS COMMERCIAL TIRE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3261908** Facility Name: **SPARKS COMMERCIAL TIRE INC**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

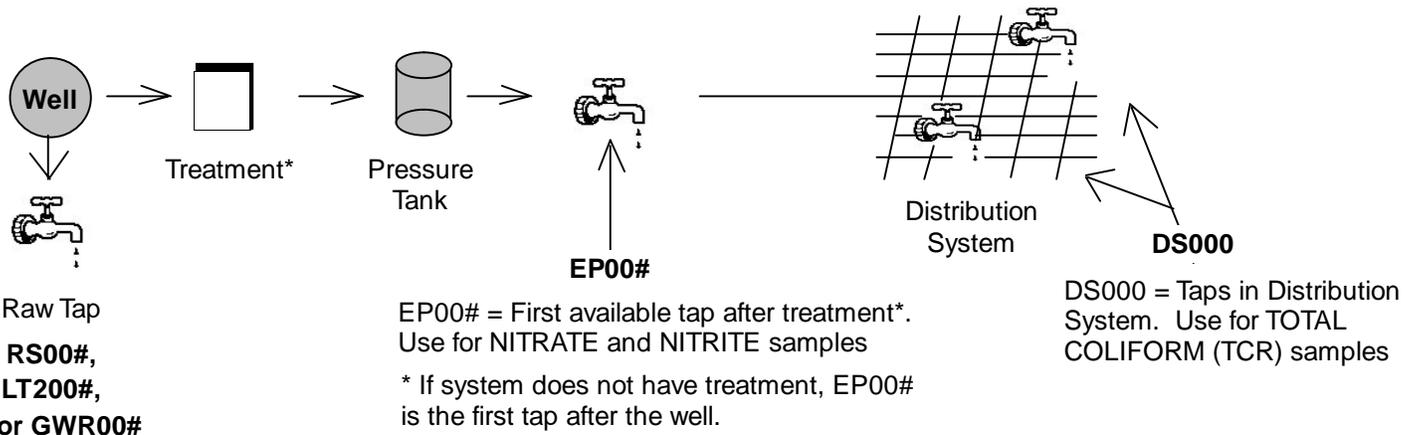

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

OH3248312 VANLUE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 3261964	Facility Name: VANLUE VILLAGE	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2016 and 5/31/2016



OH3248312 VANLUE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: VANLUE VILLAGE DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2016 and 9/30/2016

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between 1/1/2016 and 1/31/2016

1 Sample(s) Required between 2/1/2016 and 2/29/2016

1 Sample(s) Required between 3/1/2016 and 3/31/2016

1 Sample(s) Required between 4/1/2016 and 4/30/2016

1 Sample(s) Required between 5/1/2016 and 5/31/2016

1 Sample(s) Required between 6/1/2016 and 6/30/2016

1 Sample(s) Required between 7/1/2016 and 7/31/2016

1 Sample(s) Required between 8/1/2016 and 8/31/2016

1 Sample(s) Required between 9/1/2016 and 9/30/2016

1 Sample(s) Required between 10/1/2016 and 10/31/2016

1 Sample(s) Required between 11/1/2016 and 11/30/2016

1 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000

1 Sample(s) Required between 1/1/2016 and 1/31/2016

1 Sample(s) Required between 2/1/2016 and 2/29/2016

1 Sample(s) Required between 3/1/2016 and 3/31/2016

1 Sample(s) Required between 4/1/2016 and 4/30/2016

1 Sample(s) Required between 5/1/2016 and 5/31/2016

1 Sample(s) Required between 6/1/2016 and 6/30/2016

1 Sample(s) Required between 7/1/2016 and 7/31/2016

1 Sample(s) Required between 8/1/2016 and 8/31/2016

1 Sample(s) Required between 9/1/2016 and 9/30/2016

1 Sample(s) Required between 10/1/2016 and 10/31/2016

1 Sample(s) Required between 11/1/2016 and 11/30/2016

1 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: VANLUE VILLAGE DISTRIBUTION 401 EAST ST	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH3248512 MARANATHA BIBLE CHURCH-VAN BUREN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: MARANATHA BIBLE CHURCH-VAN BUREN DISTRIB
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

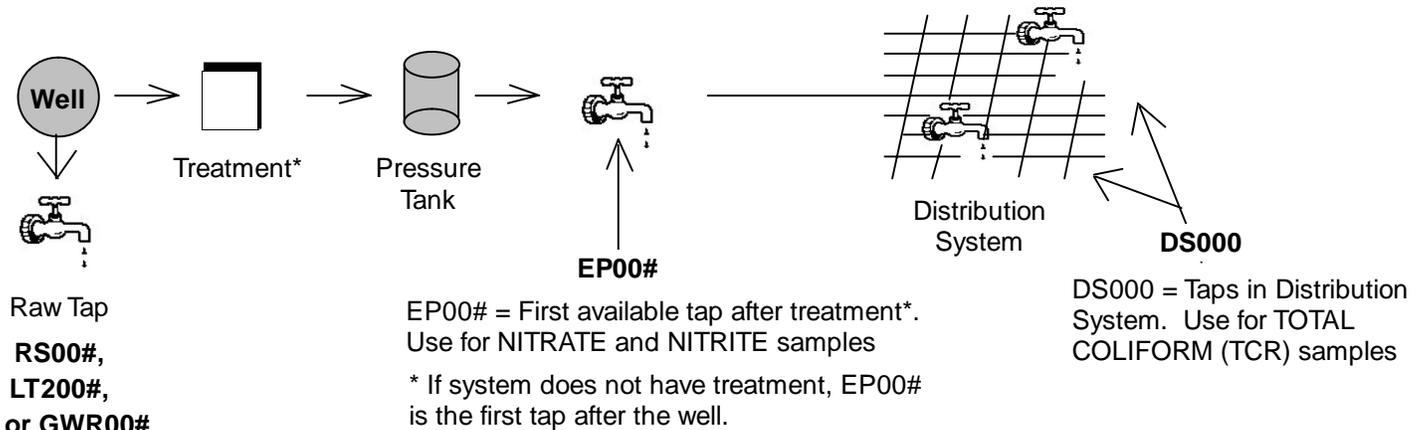

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3248512 MARANATHA BIBLE CHURCH-VAN BUREN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3262234	Facility Name: MARANATHA BIBLE CHURCH-VAN BUREN
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

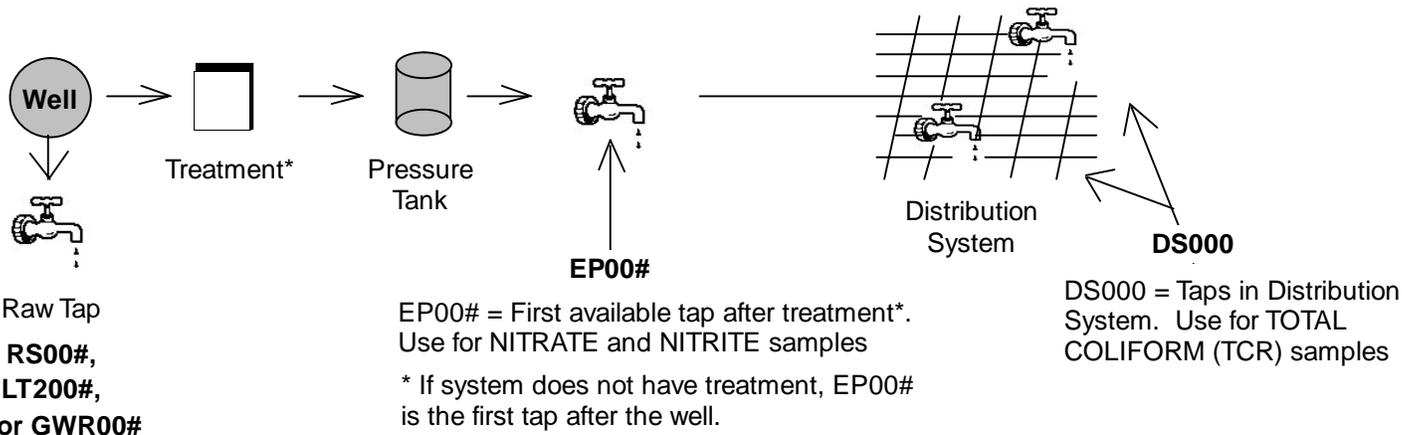

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!