



**OH3600312 GREENFIELD CITY PWS**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>3655021</b>	Facility Name: <b>GREENFIELD WATER DEPARTMENT</b>
<b>Location</b>	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b> Facility Class: <b>CLASS 1</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**  
 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
 Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 7/1/2016 and 9/30/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 2	1 Sample(s) Required between 4/1/2016 and 6/30/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 3	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 4	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



**OH3600312 GREENFIELD CITY PWS**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>GREENFIELD,CITY OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 Not Required

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100

6 Sample(s) Required between	1/1/2016	and	1/31/2016
6 Sample(s) Required between	2/1/2016	and	2/29/2016
6 Sample(s) Required between	3/1/2016	and	3/31/2016
6 Sample(s) Required between	4/1/2016	and	4/30/2016
6 Sample(s) Required between	5/1/2016	and	5/31/2016
6 Sample(s) Required between	6/1/2016	and	6/30/2016
6 Sample(s) Required between	7/1/2016	and	7/31/2016
6 Sample(s) Required between	8/1/2016	and	8/31/2016
6 Sample(s) Required between	9/1/2016	and	9/30/2016
6 Sample(s) Required between	10/1/2016	and	10/31/2016
6 Sample(s) Required between	11/1/2016	and	11/30/2016
6 Sample(s) Required between	12/1/2016	and	12/31/2016

TOTAL CHLORINE - 1000

6 Sample(s) Required between	1/1/2016	and	1/31/2016
6 Sample(s) Required between	2/1/2016	and	2/29/2016
6 Sample(s) Required between	3/1/2016	and	3/31/2016
6 Sample(s) Required between	4/1/2016	and	4/30/2016
6 Sample(s) Required between	5/1/2016	and	5/31/2016
6 Sample(s) Required between	6/1/2016	and	6/30/2016
6 Sample(s) Required between	7/1/2016	and	7/31/2016
6 Sample(s) Required between	8/1/2016	and	8/31/2016
6 Sample(s) Required between	9/1/2016	and	9/30/2016
6 Sample(s) Required between	10/1/2016	and	10/31/2016
6 Sample(s) Required between	11/1/2016	and	11/30/2016
6 Sample(s) Required between	12/1/2016	and	12/31/2016

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>GREENFIELD,CITY OF DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

**OH3600312 GREENFIELD CITY PWS**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>GREENFIELD,CITY OF DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

**OH3600514 HIGHLAND COUNTY WATER COMPANY, INC.**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>3655022</b>	Facility Name: <b>HIGHLAND COUNTY WATER CO INC</b>
<b>Location</b>	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b> Facility Class: <b>CLASS 2</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

**OH3600514 HIGHLAND COUNTY WATER COMPANY, INC.**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Location** Facility ID: **DS1** Facility Name: **HIGHLAND COUNTY WATER CO DISTRIBUTIC** Facility Class: **CLASS 2**  
SMP ID: **DS000**

**Chemicals Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 Not Required

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100  
30 Sample(s) Required between 1/1/2016 and 1/31/2016  
30 Sample(s) Required between 2/1/2016 and 2/29/2016  
30 Sample(s) Required between 3/1/2016 and 3/31/2016  
30 Sample(s) Required between 4/1/2016 and 4/30/2016  
30 Sample(s) Required between 5/1/2016 and 5/31/2016  
30 Sample(s) Required between 6/1/2016 and 6/30/2016  
30 Sample(s) Required between 7/1/2016 and 7/31/2016  
30 Sample(s) Required between 8/1/2016 and 8/31/2016  
30 Sample(s) Required between 9/1/2016 and 9/30/2016  
30 Sample(s) Required between 10/1/2016 and 10/31/2016  
30 Sample(s) Required between 11/1/2016 and 11/30/2016  
30 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000  
30 Sample(s) Required between 1/1/2016 and 1/31/2016  
30 Sample(s) Required between 2/1/2016 and 2/29/2016  
30 Sample(s) Required between 3/1/2016 and 3/31/2016  
30 Sample(s) Required between 4/1/2016 and 4/30/2016  
30 Sample(s) Required between 5/1/2016 and 5/31/2016  
30 Sample(s) Required between 6/1/2016 and 6/30/2016  
30 Sample(s) Required between 7/1/2016 and 7/31/2016  
30 Sample(s) Required between 8/1/2016 and 8/31/2016  
30 Sample(s) Required between 9/1/2016 and 9/30/2016  
30 Sample(s) Required between 10/1/2016 and 10/31/2016  
30 Sample(s) Required between 11/1/2016 and 11/30/2016  
30 Sample(s) Required between 12/1/2016 and 12/31/2016

*Samples should be collected at the same time and place as the Total Coliform samples.*

**Sampling Location** Facility ID: **DS1** Facility Name: **HIGHLAND COUNTY WATER CO DISTRIBUTIC** Facility Class: **CLASS 2**  
SMP ID: **DS201** ADDRESS NOT KNOWN

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

**OH3600514 HIGHLAND COUNTY WATER COMPANY, INC.**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>HIGHLAND COUNTY WATER CO DISTRIBUTIC</b>	Facility Class: <b>CLASS 2</b>
	SMP ID: <b>DS202</b>	<b>ADDRESS NOT KNOWN</b>	

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH3600614 HILLSBORO CITY**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>3655023</b>	Facility Name: <b>HILLSBORO WTP</b>	Facility Class: <b>CLASS 3</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Surface Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**Chemicals**

**Monitoring Requirements**

INORGANICS	1 Sample(s) Required between 1/1/2016 and 5/31/2016
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 1/31/2016 1 Sample(s) Required between 2/1/2016 and 2/29/2016 1 Sample(s) Required between 3/1/2016 and 3/31/2016 1 Sample(s) Required between 4/1/2016 and 4/30/2016 1 Sample(s) Required between 5/1/2016 and 5/31/2016 1 Sample(s) Required between 6/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 7/31/2016 1 Sample(s) Required between 8/1/2016 and 8/31/2016 1 Sample(s) Required between 9/1/2016 and 9/30/2016 1 Sample(s) Required between 10/1/2016 and 10/31/2016 1 Sample(s) Required between 11/1/2016 and 11/30/2016 1 Sample(s) Required between 12/1/2016 and 12/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2016 and 6/30/2016
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2016 and 5/31/2016
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 1/1/2016 and 1/31/2016 1 Paired Sample Set Required between 2/1/2016 and 2/29/2016 1 Paired Sample Set Required between 3/1/2016 and 3/31/2016 1 Paired Sample Set Required between 4/1/2016 and 4/30/2016 1 Paired Sample Set Required between 5/1/2016 and 5/31/2016 1 Paired Sample Set Required between 6/1/2016 and 6/30/2016 1 Paired Sample Set Required between 7/1/2016 and 7/31/2016 1 Paired Sample Set Required between 8/1/2016 and 8/31/2016 1 Paired Sample Set Required between 9/1/2016 and 9/30/2016 1 Paired Sample Set Required between 10/1/2016 and 10/31/2016 1 Paired Sample Set Required between 11/1/2016 and 11/30/2016 1 Paired Sample Set Required between 12/1/2016 and 12/31/2016

**A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.**



**OH3600614 HILLSBORO CITY**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>3655023</b>	Facility Name: <b>HILLSBORO WTP</b>	Facility Class: <b>CLASS 3</b>
	SMP ID: <b>EP001/LT2001</b>	Facility Source: <b>Surface Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
TOTAL MICROCYSTINS	1 Sample Set Required WEEKLY starting June 5

*Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. Both are required every week from January 1 to December 31 (reduced monitoring available from November to April). A week is defined as Sunday through Saturday. Samples must be analyzed at a lab accepted by Ohio EPA for microcystins analysis.*



**OH3600614 HILLSBORO CITY**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>3655023</b> SMP ID: <b>LT2001</b>	Facility Name: <b>HILLSBORO WTP</b> Facility Source: <b>Surface Water</b>	Facility Class: <b>CLASS 3</b>
--------------------------	--	--	--------------------------------

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
<b>CYANOBACTERIA SCREENING</b>	1 Sample(s) Required between 6/5/2016 and 6/11/2016
	1 Sample(s) Required between 6/19/2016 and 6/25/2016
	1 Sample(s) Required between 7/3/2016 and 7/9/2016
	1 Sample(s) Required between 7/17/2016 and 7/23/2016
	1 Sample(s) Required between 7/31/2016 and 8/6/2016
	1 Sample(s) Required between 8/14/2016 and 8/20/2016
	1 Sample(s) Required between 8/28/2016 and 9/3/2016
	1 Sample(s) Required between 9/11/2016 and 9/17/2016
	1 Sample(s) Required between 9/25/2016 and 10/1/2016
	1 Sample(s) Required between 10/9/2016 and 10/15/2016
	1 Sample(s) Required between 10/23/2016 and 10/29/2016
	1 Sample(s) Required between 11/6/2016 and 11/12/2016
	1 Sample(s) Required between 11/20/2016 and 11/26/2016
	1 Sample(s) Required between 12/4/2016 and 12/10/2016
	1 Sample(s) Required between 12/18/2016 and 12/24/2016

**Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 and must be collected at the same time as the raw total microcystins sample. SAMPLES MUST BE SHIPPED OVERNIGHT ON ICE ON THE DAY OF COLLECTION AND ARRIVE AT OHIO EPA DIVISION OF ENVIRONMENTAL SERVICES BY NOON MONDAY THROUGH THURSDAY ONLY!**



**OH3600614 HILLSBORO CITY**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>HILLSBORO, CITY OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 20 Sample(s) Required between 6/1/2016 and 9/30/2016

*Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>*

TOTAL COLIFORM (TCR) - 3100

8 Sample(s) Required between 1/1/2016 and 1/31/2016

8 Sample(s) Required between 2/1/2016 and 2/29/2016

8 Sample(s) Required between 3/1/2016 and 3/31/2016

8 Sample(s) Required between 4/1/2016 and 4/30/2016

8 Sample(s) Required between 5/1/2016 and 5/31/2016

8 Sample(s) Required between 6/1/2016 and 6/30/2016

8 Sample(s) Required between 7/1/2016 and 7/31/2016

8 Sample(s) Required between 8/1/2016 and 8/31/2016

8 Sample(s) Required between 9/1/2016 and 9/30/2016

8 Sample(s) Required between 10/1/2016 and 10/31/2016

8 Sample(s) Required between 11/1/2016 and 11/30/2016

8 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000

8 Sample(s) Required between 1/1/2016 and 1/31/2016

8 Sample(s) Required between 2/1/2016 and 2/29/2016

8 Sample(s) Required between 3/1/2016 and 3/31/2016

8 Sample(s) Required between 4/1/2016 and 4/30/2016

8 Sample(s) Required between 5/1/2016 and 5/31/2016

8 Sample(s) Required between 6/1/2016 and 6/30/2016

8 Sample(s) Required between 7/1/2016 and 7/31/2016

8 Sample(s) Required between 8/1/2016 and 8/31/2016

8 Sample(s) Required between 9/1/2016 and 9/30/2016

8 Sample(s) Required between 10/1/2016 and 10/31/2016

8 Sample(s) Required between 11/1/2016 and 11/30/2016

8 Sample(s) Required between 12/1/2016 and 12/31/2016

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>HILLSBORO, CITY OF DISTRIBUTION</b> <b>959 WEST MAIN STREET</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 1/1/2016 and 1/7/2016 at SMP: DS201

1 Sample(s) Required between 4/1/2016 and 4/7/2016 at SMP: DS201

1 Sample(s) Required between 7/1/2016 and 7/7/2016 at SMP: DS201



**OH3600614 HILLSBORO CITY**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>HILLSBORO, CITY OF DISTRIBUTION</b> <b>959 WEST MAIN STREET</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 10/1/2016 and 10/7/2016 at SMP: DS201
-------------------------	--

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>HILLSBORO, CITY OF DISTRIBUTION</b> <b>298 WOODLANDER</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/1/2016 and 1/7/2016 at SMP: DS202
	1 Sample(s) Required between 4/1/2016 and 4/7/2016 at SMP: DS202
	1 Sample(s) Required between 7/1/2016 and 7/7/2016 at SMP: DS202
	1 Sample(s) Required between 10/1/2016 and 10/7/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH3600712 LEESBURG VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>3655024</b>	Facility Name: <b>LEESBURG WTP</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
ARSENIC - 1005	1 Sample(s) Required between 1/1/2016 and 3/31/2016 1 Sample(s) Required between 4/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 9/30/2016 1 Sample(s) Required between 10/1/2016 and 12/31/2016
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



**OH3600712 LEESBURG VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>LEESBURG,VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**Chemicals Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2016 and 9/30/2016

*Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>*

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100

2 Sample(s) Required between 1/1/2016 and 1/31/2016

2 Sample(s) Required between 2/1/2016 and 2/29/2016

2 Sample(s) Required between 3/1/2016 and 3/31/2016

2 Sample(s) Required between 4/1/2016 and 4/30/2016

2 Sample(s) Required between 5/1/2016 and 5/31/2016

2 Sample(s) Required between 6/1/2016 and 6/30/2016

2 Sample(s) Required between 7/1/2016 and 7/31/2016

2 Sample(s) Required between 8/1/2016 and 8/31/2016

2 Sample(s) Required between 9/1/2016 and 9/30/2016

2 Sample(s) Required between 10/1/2016 and 10/31/2016

2 Sample(s) Required between 11/1/2016 and 11/30/2016

2 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000

2 Sample(s) Required between 1/1/2016 and 1/31/2016

2 Sample(s) Required between 2/1/2016 and 2/29/2016

2 Sample(s) Required between 3/1/2016 and 3/31/2016

2 Sample(s) Required between 4/1/2016 and 4/30/2016

2 Sample(s) Required between 5/1/2016 and 5/31/2016

2 Sample(s) Required between 6/1/2016 and 6/30/2016

2 Sample(s) Required between 7/1/2016 and 7/31/2016

2 Sample(s) Required between 8/1/2016 and 8/31/2016

2 Sample(s) Required between 9/1/2016 and 9/30/2016

2 Sample(s) Required between 10/1/2016 and 10/31/2016

2 Sample(s) Required between 11/1/2016 and 11/30/2016

2 Sample(s) Required between 12/1/2016 and 12/31/2016

**Samples should be collected at the same time and place as the Total Coliform samples.**



**OH3600712 LEESBURG VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>LEESBURG,VILLAGE OF DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>LEESBURG,VILLAGE OF DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

**OH3600915 LYNCHBURG VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>3655025</b>	Facility Name: <b>LYNCHBURG WATER DEPARTMENT</b>
<b>Location</b>	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b> Facility Class: <b>CLASS 1</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



**OH3600915 LYNCHBURG VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>LYNCHBURG,VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 Not Required

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100

2 Sample(s) Required between	1/1/2016	and	1/31/2016
2 Sample(s) Required between	2/1/2016	and	2/29/2016
2 Sample(s) Required between	3/1/2016	and	3/31/2016
2 Sample(s) Required between	4/1/2016	and	4/30/2016
2 Sample(s) Required between	5/1/2016	and	5/31/2016
2 Sample(s) Required between	6/1/2016	and	6/30/2016
2 Sample(s) Required between	7/1/2016	and	7/31/2016
2 Sample(s) Required between	8/1/2016	and	8/31/2016
2 Sample(s) Required between	9/1/2016	and	9/30/2016
2 Sample(s) Required between	10/1/2016	and	10/31/2016
2 Sample(s) Required between	11/1/2016	and	11/30/2016
2 Sample(s) Required between	12/1/2016	and	12/31/2016

TOTAL CHLORINE - 1000

2 Sample(s) Required between	1/1/2016	and	1/31/2016
2 Sample(s) Required between	2/1/2016	and	2/29/2016
2 Sample(s) Required between	3/1/2016	and	3/31/2016
2 Sample(s) Required between	4/1/2016	and	4/30/2016
2 Sample(s) Required between	5/1/2016	and	5/31/2016
2 Sample(s) Required between	6/1/2016	and	6/30/2016
2 Sample(s) Required between	7/1/2016	and	7/31/2016
2 Sample(s) Required between	8/1/2016	and	8/31/2016
2 Sample(s) Required between	9/1/2016	and	9/30/2016
2 Sample(s) Required between	10/1/2016	and	10/31/2016
2 Sample(s) Required between	11/1/2016	and	11/30/2016
2 Sample(s) Required between	12/1/2016	and	12/31/2016

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>LYNCHBURG,VILLAGE OF DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

**OH3600915 LYNCHBURG VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>LYNCHBURG, VILLAGE OF DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

**OH3632312 NORTH BAY COTTAGES AND BAIT SHOP**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: NORTH BAY COTTAGES &amp; BAI DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

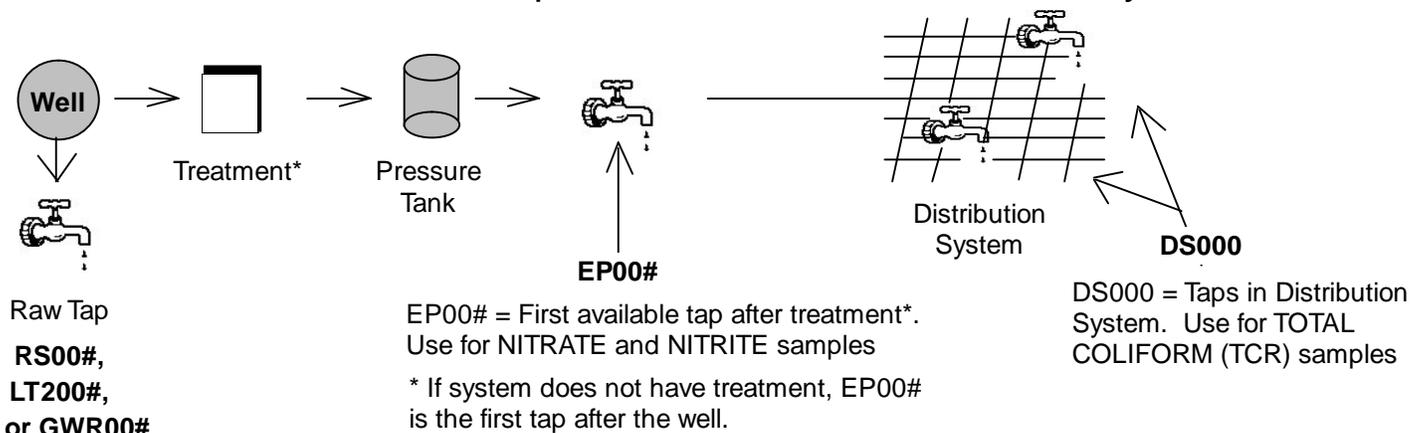

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3632312 NORTH BAY COTTAGES AND BAIT SHOP**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 3655034 Facility Name: NORTH BAY COTTAGES & BAIT SHOP**

**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

**Where to Collect Samples For a Small Public Water System**

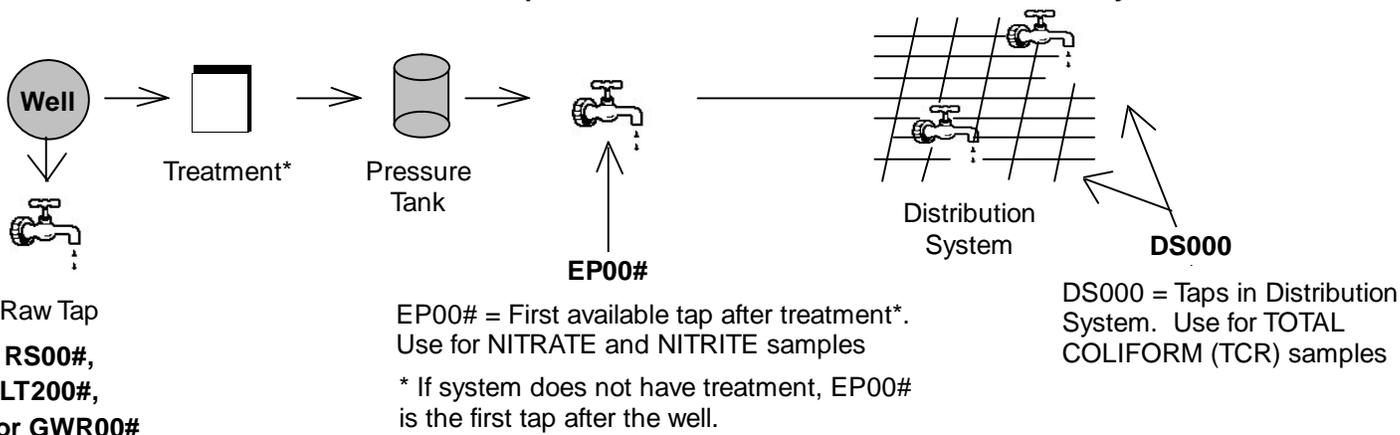

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3632512 SHADY TRAILS CAMPGROUND**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> SHADY TRAILS CAMPGROUND DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

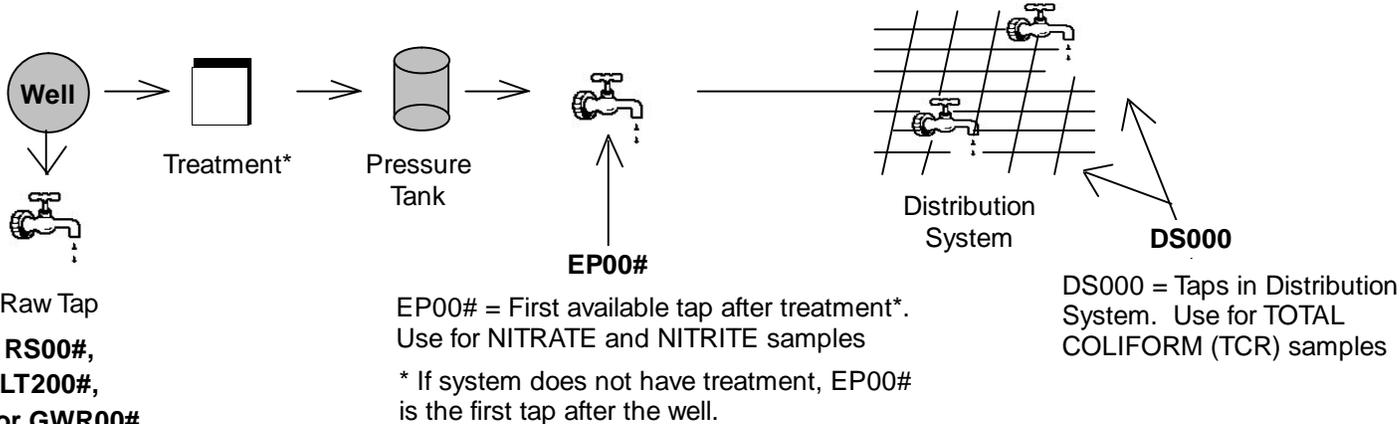

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3632512 SHADY TRAILS CAMPGROUND**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **3655035** Facility Name: **SHADY TRAILS CAMPGROUND**

**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

**Where to Collect Samples For a Small Public Water System**

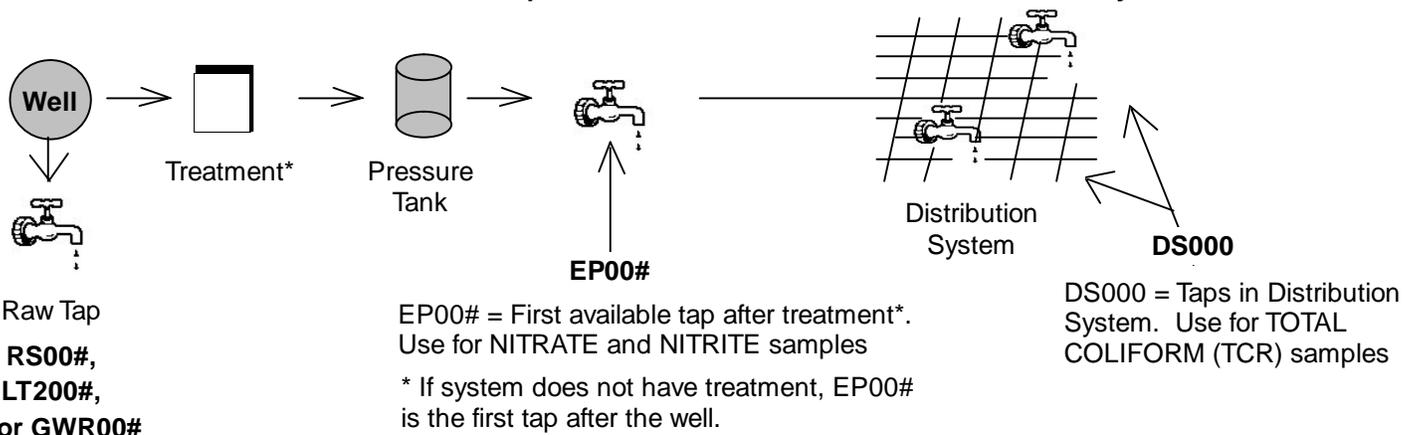

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3634412 COUNTRY CORNER MARKET PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: COUNTRY CORNER MARKET DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

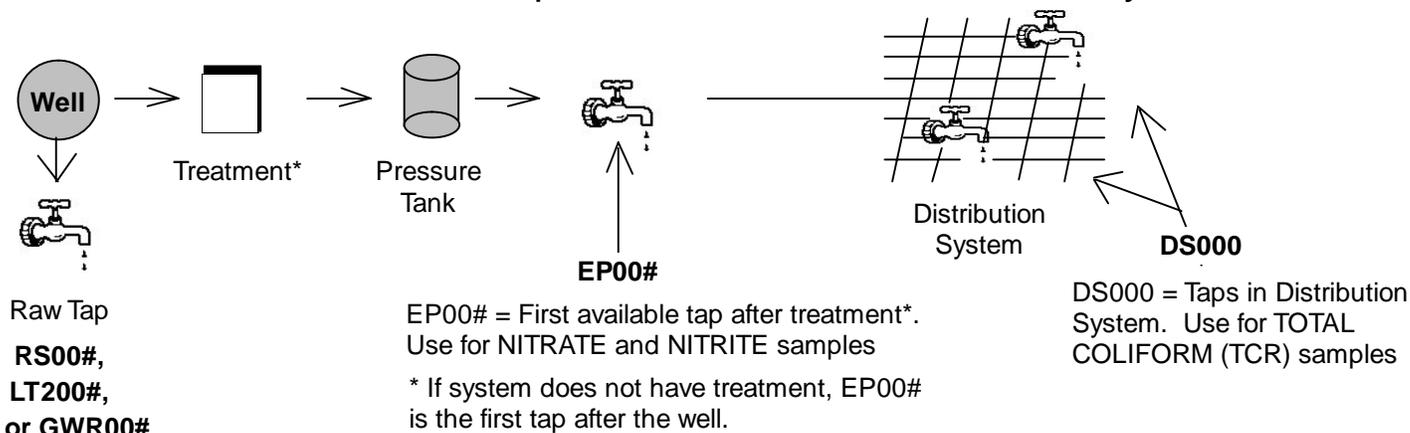

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3634412 COUNTRY CORNER MARKET PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **3660933** Facility Name: **COUNTRY CORNER MARKET**

**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

**Where to Collect Samples For a Small Public Water System**

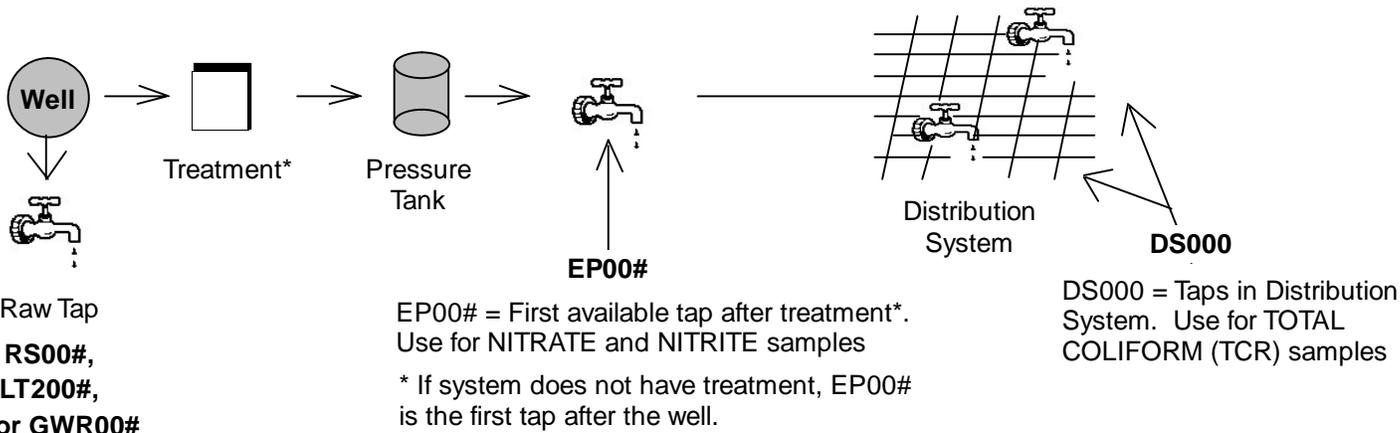

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3636812 GOOD SHEPHERD U B CHURCH PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: GOOD SHEPHERD U B CHURCH DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

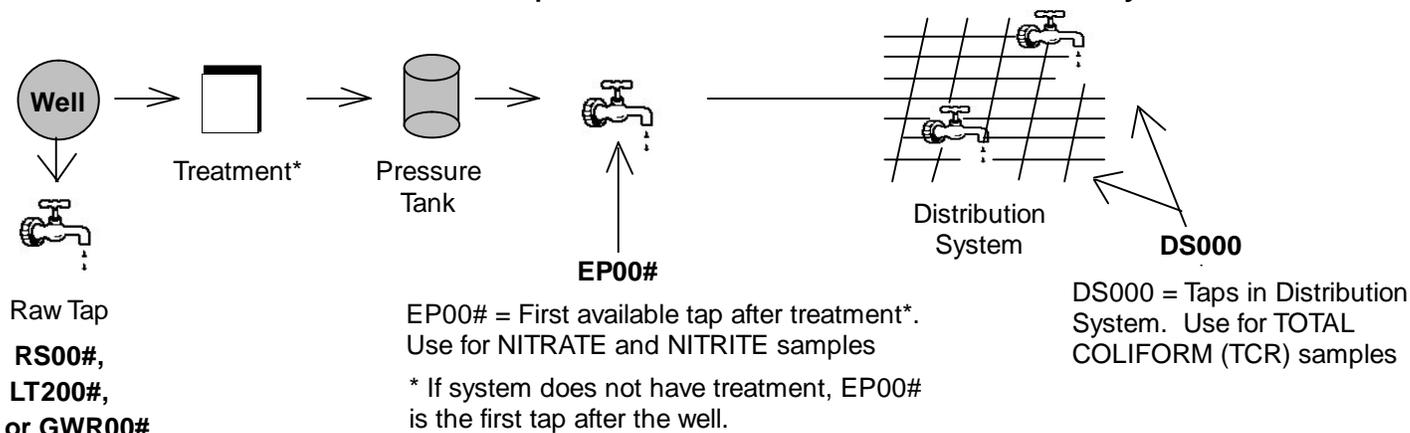

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3636812 GOOD SHEPHERD U B CHURCH PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 3655042 Facility Name: UNITED BRETHREN CHURCH**

**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

**Where to Collect Samples For a Small Public Water System**

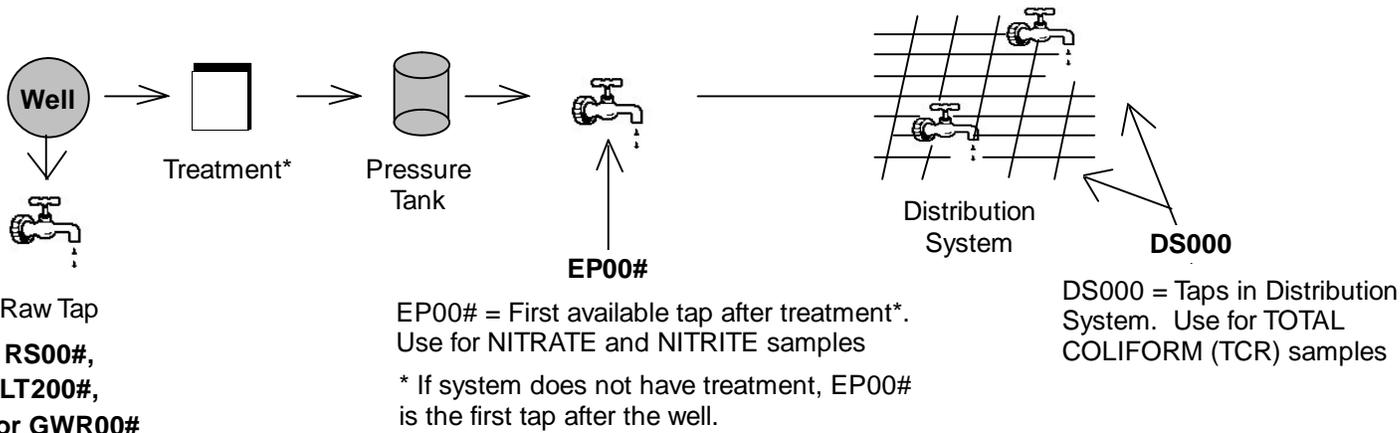

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3636912 FAITH AND LIGHT MENNONITE CHURCH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: FAITH AND LIGHT MENNONITE DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

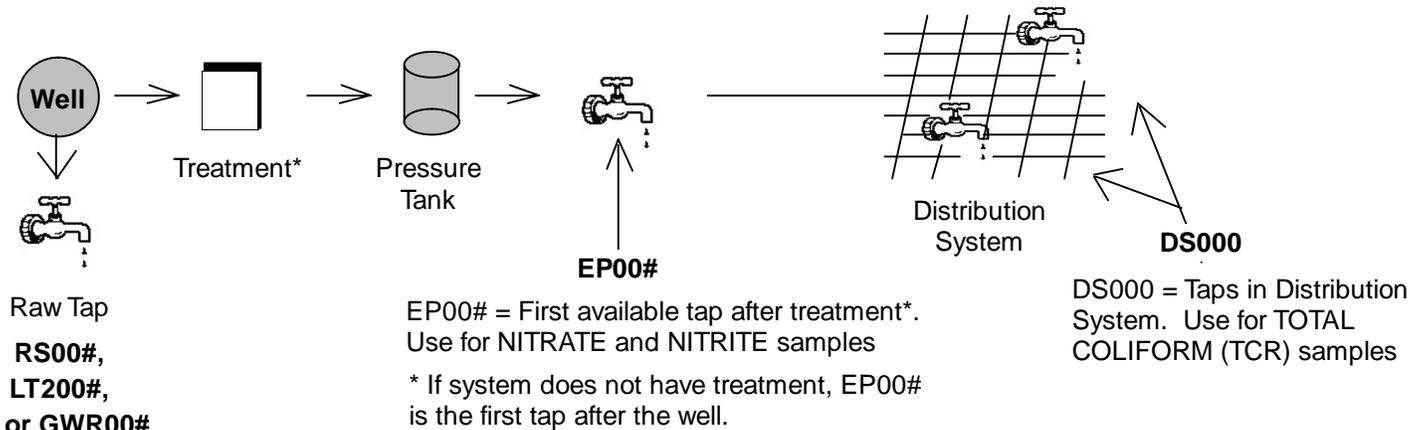

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3636912 FAITH AND LIGHT MENNONITE CHURCH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID: 3655043</b>	<b>Facility Name: FAITH AND LIGHT MENNONITE CHURCH</b>
<b>Location SMP ID: EP001</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

**Where to Collect Samples For a Small Public Water System**

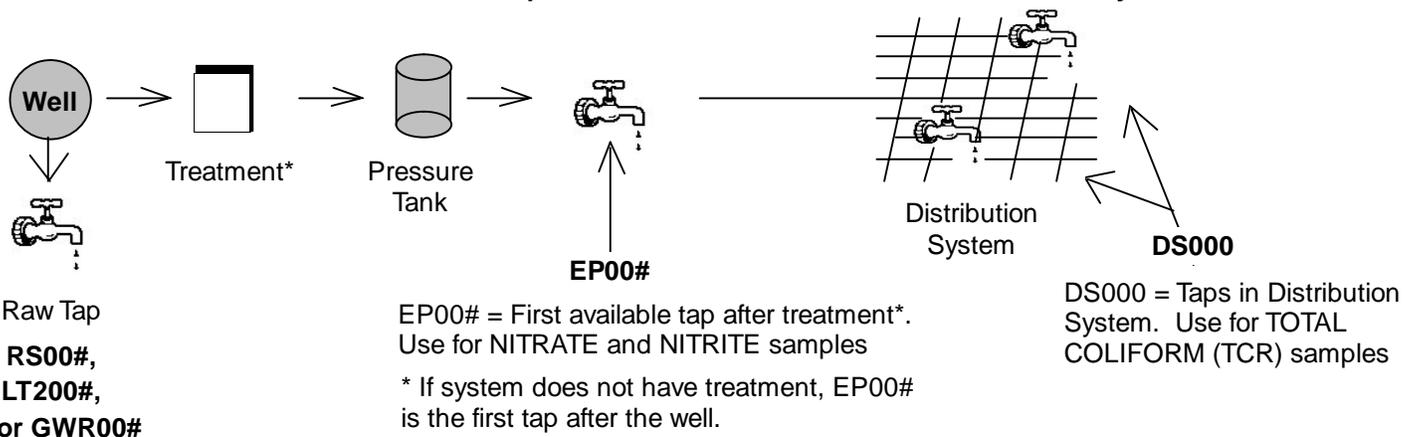

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3637012 CEDAR HILL CAMPGROUND**

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: CEDAR HILL CAMPGROUND DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 9/30/2016

**Where to Collect Samples For a Small Public Water System**

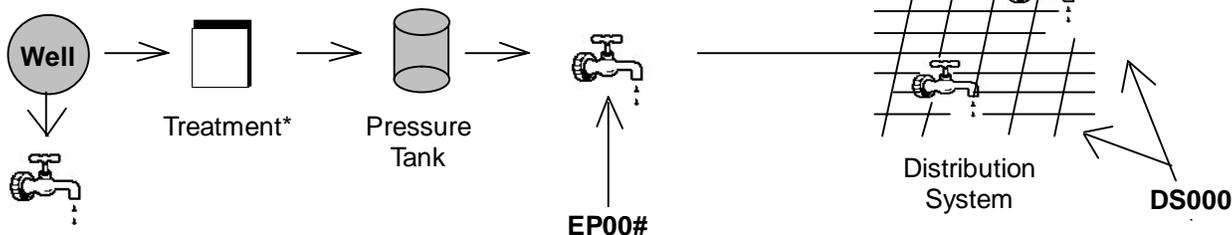

Raw Tap  
**RS00#,**  
**LT200#,**  
or **GWR00#**

EP00# = First available tap after treatment\*.  
Use for NITRATE and NITRITE samples  
\* If system does not have treatment, EP00# is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3637012 CEDAR HILL CAMPGROUND**

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **3655044** Facility Name: **CEDAR HILL CAMPGROUND**

**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

**Where to Collect Samples For a Small Public Water System**

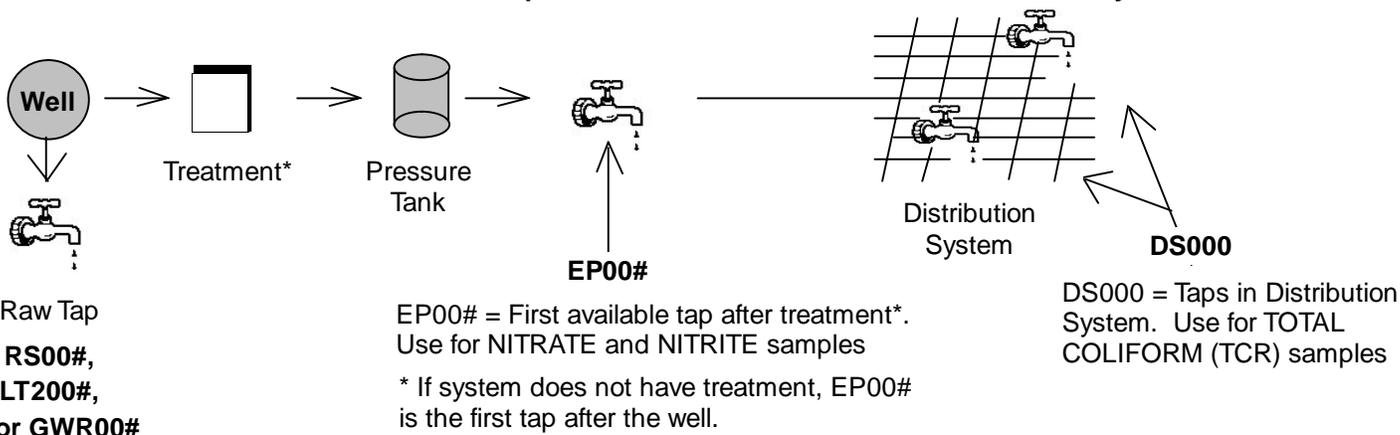

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**