



OH4300411 FAIRPORT HARBOR VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4355441	Facility Name: FAIRPORT HARBOR WTP	Facility Class: CLASS 3
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016

Chemicals	Monitoring Requirements
-----------	-------------------------

INORGANICS	1 Sample(s) Required between 1/1/2016 and 5/31/2016
------------	---

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020
 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 1/31/2016
	1 Sample(s) Required between 2/1/2016 and 2/29/2016
	1 Sample(s) Required between 3/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 4/30/2016
	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 10/31/2016
	1 Sample(s) Required between 11/1/2016 and 11/30/2016
	1 Sample(s) Required between 12/1/2016 and 12/31/2016

RADIOLOGICALS	Not Required
---------------	--------------

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2016 and 6/30/2016
---	---

VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2016 and 3/31/2016
----------------------------------	---

TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 1/1/2016 and 1/31/2016
	1 Paired Sample Set Required between 2/1/2016 and 2/29/2016
	1 Paired Sample Set Required between 3/1/2016 and 3/31/2016
	1 Paired Sample Set Required between 4/1/2016 and 4/30/2016
	1 Paired Sample Set Required between 5/1/2016 and 5/31/2016
	1 Paired Sample Set Required between 6/1/2016 and 6/30/2016
	1 Paired Sample Set Required between 7/1/2016 and 7/31/2016
	1 Paired Sample Set Required between 8/1/2016 and 8/31/2016
	1 Paired Sample Set Required between 9/1/2016 and 9/30/2016
	1 Paired Sample Set Required between 10/1/2016 and 10/31/2016
	1 Paired Sample Set Required between 11/1/2016 and 11/30/2016
	1 Paired Sample Set Required between 12/1/2016 and 12/31/2016

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



Effective Date: 05/13/2016

2016 ENTRY POINT SCHEDULE

OH4300411 FAIRPORT HARBOR VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4355441	Facility Name: FAIRPORT HARBOR WTP	Facility Class: CLASS 3
	SMP ID: EP001/LT2001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
TOTAL MICROCYSTINS	1 Sample Set Required WEEKLY starting June 5

Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. Both are required every week from January 1 to December 31 (reduced monitoring available from November to April). A week is defined as Sunday through Saturday. Samples must be analyzed at a lab accepted by Ohio EPA for microcystins analysis.



OH4300411 FAIRPORT HARBOR VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4355441 SMP ID: LT2001	Facility Name: FAIRPORT HARBOR WTP Facility Source: Surface Water	Facility Class: CLASS 3
--------------------------	--	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
CYANOBACTERIA SCREENING	1 Sample(s) Required between 6/12/2016 and 6/18/2016
	1 Sample(s) Required between 6/26/2016 and 7/2/2016
	1 Sample(s) Required between 7/10/2016 and 7/16/2016
	1 Sample(s) Required between 7/24/2016 and 7/30/2016
	1 Sample(s) Required between 8/7/2016 and 8/13/2016
	1 Sample(s) Required between 8/21/2016 and 8/27/2016
	1 Sample(s) Required between 9/4/2016 and 9/10/2016
	1 Sample(s) Required between 9/18/2016 and 9/24/2016
	1 Sample(s) Required between 10/2/2016 and 10/8/2016
	1 Sample(s) Required between 10/16/2016 and 10/22/2016
	1 Sample(s) Required between 10/30/2016 and 11/5/2016
	1 Sample(s) Required between 11/13/2016 and 11/19/2016
	1 Sample(s) Required between 11/27/2016 and 12/3/2016
	1 Sample(s) Required between 12/11/2016 and 12/17/2016
	1 Sample(s) Required between 12/25/2016 and 12/31/2016

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 and must be collected at the same time as the raw total microcystins sample. SAMPLES MUST BE SHIPPED OVERNIGHT ON ICE ON THE DAY OF COLLECTION AND ARRIVE AT OHIO EPA DIVISION OF ENVIRONMENTAL SERVICES BY NOON MONDAY THROUGH THURSDAY ONLY!



OH4300411 FAIRPORT HARBOR VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: FAIRPORT HARBOR, VLG. OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

TOTAL COLIFORM (TCR) - 3100	3 Sample(s) Required between 1/1/2016 and 1/31/2016
	3 Sample(s) Required between 2/1/2016 and 2/29/2016
	3 Sample(s) Required between 3/1/2016 and 3/31/2016
	3 Sample(s) Required between 4/1/2016 and 4/30/2016
	3 Sample(s) Required between 5/1/2016 and 5/31/2016
	3 Sample(s) Required between 6/1/2016 and 6/30/2016
	3 Sample(s) Required between 7/1/2016 and 7/31/2016
	3 Sample(s) Required between 8/1/2016 and 8/31/2016
	3 Sample(s) Required between 9/1/2016 and 9/30/2016
	3 Sample(s) Required between 10/1/2016 and 10/31/2016
	3 Sample(s) Required between 11/1/2016 and 11/30/2016
	3 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000	3 Sample(s) Required between 1/1/2016 and 1/31/2016
	3 Sample(s) Required between 2/1/2016 and 2/29/2016
	3 Sample(s) Required between 3/1/2016 and 3/31/2016
	3 Sample(s) Required between 4/1/2016 and 4/30/2016
	3 Sample(s) Required between 5/1/2016 and 5/31/2016
	3 Sample(s) Required between 6/1/2016 and 6/30/2016
	3 Sample(s) Required between 7/1/2016 and 7/31/2016
	3 Sample(s) Required between 8/1/2016 and 8/31/2016
	3 Sample(s) Required between 9/1/2016 and 9/30/2016
	3 Sample(s) Required between 10/1/2016 and 10/31/2016
	3 Sample(s) Required between 11/1/2016 and 11/30/2016
	3 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: FAIRPORT HARBOR, VLG. OF DISTRIBUTION 400 SEVENTH STREET	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 3/1/2016 and 3/7/2016 at SMP: DS201
	1 Sample(s) Required between 6/1/2016 and 6/7/2016 at SMP: DS201
	1 Sample(s) Required between 9/1/2016 and 9/7/2016 at SMP: DS201
	1 Sample(s) Required between 12/1/2016 and 12/7/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

OH4300411 FAIRPORT HARBOR VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: FAIRPORT HARBOR, VLG. OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS	1 Sample(s) Required between	3/1/2016	and	3/7/2016	at SMP: DS202
	1 Sample(s) Required between	6/1/2016	and	6/7/2016	at SMP: DS202
	1 Sample(s) Required between	9/1/2016	and	9/7/2016	at SMP: DS202
	1 Sample(s) Required between	12/1/2016	and	12/7/2016	at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH4300903 MADISON VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: MADISON, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2016 and 9/30/2016
-------------------------------	--

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	3 Sample(s) Required between 1/1/2016 and 1/31/2016
	3 Sample(s) Required between 2/1/2016 and 2/29/2016
	3 Sample(s) Required between 3/1/2016 and 3/31/2016
	3 Sample(s) Required between 4/1/2016 and 4/30/2016
	3 Sample(s) Required between 5/1/2016 and 5/31/2016
	3 Sample(s) Required between 6/1/2016 and 6/30/2016
	3 Sample(s) Required between 7/1/2016 and 7/31/2016
	3 Sample(s) Required between 8/1/2016 and 8/31/2016
	3 Sample(s) Required between 9/1/2016 and 9/30/2016
	3 Sample(s) Required between 10/1/2016 and 10/31/2016
	3 Sample(s) Required between 11/1/2016 and 11/30/2016
	3 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000	3 Sample(s) Required between 1/1/2016 and 1/31/2016
	3 Sample(s) Required between 2/1/2016 and 2/29/2016
	3 Sample(s) Required between 3/1/2016 and 3/31/2016
	3 Sample(s) Required between 4/1/2016 and 4/30/2016
	3 Sample(s) Required between 5/1/2016 and 5/31/2016
	3 Sample(s) Required between 6/1/2016 and 6/30/2016
	3 Sample(s) Required between 7/1/2016 and 7/31/2016
	3 Sample(s) Required between 8/1/2016 and 8/31/2016
	3 Sample(s) Required between 9/1/2016 and 9/30/2016
	3 Sample(s) Required between 10/1/2016 and 10/31/2016
	3 Sample(s) Required between 11/1/2016 and 11/30/2016
	3 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: MADISON, VILLAGE OF DISTRIBUTION MARATHON STATION AT 4390 MADI	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/1/2016 and 2/7/2016 at SMP: DS201
	1 Sample(s) Required between 5/1/2016 and 5/7/2016 at SMP: DS201
	1 Sample(s) Required between 8/1/2016 and 8/7/2016 at SMP: DS201



OH4300903 MADISON VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: MADISON, VILLAGE OF DISTRIBUTION MARATHON STATION AT 4390 MADI	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 11/1/2016 and 11/7/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: MADISON, VILLAGE OF DISTRIBUTION 300 KIM DRIVE SENIOR HOME	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 2/1/2016 and 2/7/2016 at SMP: DS202

1 Sample(s) Required between 5/1/2016 and 5/7/2016 at SMP: DS202

1 Sample(s) Required between 8/1/2016 and 8/7/2016 at SMP: DS202

1 Sample(s) Required between 11/1/2016 and 11/7/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

OH4301012 MENTOR RIDGE FARMS ASSOCIATION PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4355444	Facility Name: MENTOR RIDGE FARMS ASSOCIATION
Location	SMP ID: EP001	Facility Source: Ground Water Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2016 and 5/31/2016



OH4301012 MENTOR RIDGE FARMS ASSOCIATION PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: MENTOR RIDGE FARMS ASSN. DISTRIBUTIO
	SMP ID: DS000	

Chemicals	Monitoring Requirements
-----------	-------------------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 1/31/2016
	1 Sample(s) Required between 2/1/2016 and 2/29/2016
	1 Sample(s) Required between 3/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 4/30/2016
	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 10/31/2016
	1 Sample(s) Required between 11/1/2016 and 11/30/2016
	1 Sample(s) Required between 12/1/2016 and 12/31/2016
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2016 and 1/31/2016
	1 Sample(s) Required between 2/1/2016 and 2/29/2016
	1 Sample(s) Required between 3/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 4/30/2016
	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 10/31/2016
	1 Sample(s) Required between 11/1/2016 and 11/30/2016
	1 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: MENTOR RIDGE FARMS ASSN. DISTRIBUTIO
	SMP ID: DS201	ADDRESS NOT KNOWN

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH4301511 AQUA OHIO - MENTOR

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4355445	Facility Name: AQUA OHIO INC - MENTOR	Facility Class: CLASS 4
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 1/1/2016 and 5/31/2016

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2016 and 1/31/2016

1 Sample(s) Required between 2/1/2016 and 2/29/2016

1 Sample(s) Required between 3/1/2016 and 3/31/2016

1 Sample(s) Required between 4/1/2016 and 4/30/2016

1 Sample(s) Required between 5/1/2016 and 5/31/2016

1 Sample(s) Required between 6/1/2016 and 6/30/2016

1 Sample(s) Required between 7/1/2016 and 7/31/2016

1 Sample(s) Required between 8/1/2016 and 8/31/2016

1 Sample(s) Required between 9/1/2016 and 9/30/2016

1 Sample(s) Required between 10/1/2016 and 10/31/2016

1 Sample(s) Required between 11/1/2016 and 11/30/2016

1 Sample(s) Required between 12/1/2016 and 12/31/2016

RADIOLOGICALS Not Required

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 4/1/2016 and 6/30/2016

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 1/1/2016 and 5/31/2016

TOTAL ORGANIC CARBON (TOC)

1 Paired Sample Set Required between 1/1/2016 and 1/31/2016

1 Paired Sample Set Required between 2/1/2016 and 2/29/2016

1 Paired Sample Set Required between 3/1/2016 and 3/31/2016

1 Paired Sample Set Required between 4/1/2016 and 4/30/2016

1 Paired Sample Set Required between 5/1/2016 and 5/31/2016

1 Paired Sample Set Required between 6/1/2016 and 6/30/2016

1 Paired Sample Set Required between 7/1/2016 and 7/31/2016

1 Paired Sample Set Required between 8/1/2016 and 8/31/2016

1 Paired Sample Set Required between 9/1/2016 and 9/30/2016

1 Paired Sample Set Required between 10/1/2016 and 10/31/2016

1 Paired Sample Set Required between 11/1/2016 and 11/30/2016

1 Paired Sample Set Required between 12/1/2016 and 12/31/2016

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



Effective Date: 05/13/2016

2016 ENTRY POINT SCHEDULE

OH4301511 AQUA OHIO - MENTOR

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4355445	Facility Name: AQUA OHIO INC - MENTOR	Facility Class: CLASS 4
	SMP ID: EP001/LT2001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
TOTAL MICROCYSTINS	1 Sample Set Required WEEKLY starting June 5

Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. Both are required every week from January 1 to December 31 (reduced monitoring available from November to April). A week is defined as Sunday through Saturday. Samples must be analyzed at a lab accepted by Ohio EPA for microcystins analysis.



OH4301511 AQUA OHIO - MENTOR

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4355445 SMP ID: LT2001	Facility Name: AQUA OHIO INC - MENTOR Facility Source: Surface Water	Facility Class: CLASS 4
--------------------------	--	---	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016

Chemicals	Monitoring Requirements
CYANOBACTERIA SCREENING	1 Sample(s) Required between 6/12/2016 and 6/18/2016
	1 Sample(s) Required between 6/26/2016 and 7/2/2016
	1 Sample(s) Required between 7/10/2016 and 7/16/2016
	1 Sample(s) Required between 7/24/2016 and 7/30/2016
	1 Sample(s) Required between 8/7/2016 and 8/13/2016
	1 Sample(s) Required between 8/21/2016 and 8/27/2016
	1 Sample(s) Required between 9/4/2016 and 9/10/2016
	1 Sample(s) Required between 9/18/2016 and 9/24/2016
	1 Sample(s) Required between 10/2/2016 and 10/8/2016
	1 Sample(s) Required between 10/16/2016 and 10/22/2016
	1 Sample(s) Required between 10/30/2016 and 11/5/2016
	1 Sample(s) Required between 11/13/2016 and 11/19/2016
	1 Sample(s) Required between 11/27/2016 and 12/3/2016
	1 Sample(s) Required between 12/11/2016 and 12/17/2016
	1 Sample(s) Required between 12/25/2016 and 12/31/2016

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 and must be collected at the same time as the raw total microcystins sample. SAMPLES MUST BE SHIPPED OVERNIGHT ON ICE ON THE DAY OF COLLECTION AND ARRIVE AT OHIO EPA DIVISION OF ENVIRONMENTAL SERVICES BY NOON MONDAY THROUGH THURSDAY ONLY!

LT2 MONITORING	1 Sample(s) Required between 1/17/2016 and 1/21/2016
	1 Sample(s) Required between 2/14/2016 and 2/18/2016
	1 Sample(s) Required between 3/20/2016 and 3/24/2016
	1 Sample(s) Required between 4/17/2016 and 4/21/2016
	1 Sample(s) Required between 5/15/2016 and 5/19/2016
	1 Sample(s) Required between 6/19/2016 and 6/23/2016
	1 Sample(s) Required between 7/17/2016 and 7/21/2016
	1 Sample(s) Required between 8/14/2016 and 8/18/2016
	1 Sample(s) Required between 9/18/2016 and 9/22/2016
	1 Sample(s) Required between 10/16/2016 and 10/20/2016
	1 Sample(s) Required between 11/13/2016 and 11/17/2016
	1 Sample(s) Required between 12/18/2016 and 12/22/2016

Monitor for: Cryptosporidium - 2078, E-coli count - 3014, Turbidity - 0100



OH4301511 AQUA OHIO - MENTOR

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: AQUA OHIO INC - MENTOR DISTRIBUTION	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	80 Sample(s) Required between	1/1/2016	and	1/31/2016
	80 Sample(s) Required between	2/1/2016	and	2/29/2016
	80 Sample(s) Required between	3/1/2016	and	3/31/2016
	80 Sample(s) Required between	4/1/2016	and	4/30/2016
	80 Sample(s) Required between	5/1/2016	and	5/31/2016
	80 Sample(s) Required between	6/1/2016	and	6/30/2016
	80 Sample(s) Required between	7/1/2016	and	7/31/2016
	80 Sample(s) Required between	8/1/2016	and	8/31/2016
	80 Sample(s) Required between	9/1/2016	and	9/30/2016
	80 Sample(s) Required between	10/1/2016	and	10/31/2016
	80 Sample(s) Required between	11/1/2016	and	11/30/2016
	80 Sample(s) Required between	12/1/2016	and	12/31/2016

TOTAL CHLORINE - 1000	80 Sample(s) Required between	1/1/2016	and	1/31/2016
	80 Sample(s) Required between	2/1/2016	and	2/29/2016
	80 Sample(s) Required between	3/1/2016	and	3/31/2016
	80 Sample(s) Required between	4/1/2016	and	4/30/2016
	80 Sample(s) Required between	5/1/2016	and	5/31/2016
	80 Sample(s) Required between	6/1/2016	and	6/30/2016
	80 Sample(s) Required between	7/1/2016	and	7/31/2016
	80 Sample(s) Required between	8/1/2016	and	8/31/2016
	80 Sample(s) Required between	9/1/2016	and	9/30/2016
	80 Sample(s) Required between	10/1/2016	and	10/31/2016
	80 Sample(s) Required between	11/1/2016	and	11/30/2016
	80 Sample(s) Required between	12/1/2016	and	12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: AQUA OHIO INC - MENTOR DISTRIBUTION KIRTLAND CITY HALL	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between	1/8/2016	and	1/14/2016 at SMP: DS201
	1 Sample(s) Required between	4/8/2016	and	4/14/2016 at SMP: DS201
	1 Sample(s) Required between	7/8/2016	and	7/14/2016 at SMP: DS201



OH4301511 AQUA OHIO - MENTOR

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: AQUA OHIO INC - MENTOR DISTRIBUTION KIRTLAND CITY HALL	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 10/8/2016 and 10/14/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: AQUA OHIO INC - MENTOR DISTRIBUTION KIRTLAND LIBRARY	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 1/8/2016 and 1/14/2016 at SMP: DS202

1 Sample(s) Required between 4/8/2016 and 4/14/2016 at SMP: DS202

1 Sample(s) Required between 7/8/2016 and 7/14/2016 at SMP: DS202

1 Sample(s) Required between 10/8/2016 and 10/14/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS203	Facility Name: AQUA OHIO INC - MENTOR DISTRIBUTION BAXTER BOOSTER	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 1/8/2016 and 1/14/2016 at SMP: DS203

1 Sample(s) Required between 4/8/2016 and 4/14/2016 at SMP: DS203

1 Sample(s) Required between 7/8/2016 and 7/14/2016 at SMP: DS203

1 Sample(s) Required between 10/8/2016 and 10/14/2016 at SMP: DS203

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS204	Facility Name: AQUA OHIO INC - MENTOR DISTRIBUTION METRO COOSTER STATION	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 1/8/2016 and 1/14/2016 at SMP: DS204

1 Sample(s) Required between 4/8/2016 and 4/14/2016 at SMP: DS204

1 Sample(s) Required between 7/8/2016 and 7/14/2016 at SMP: DS204

1 Sample(s) Required between 10/8/2016 and 10/14/2016 at SMP: DS204

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH4301511 AQUA OHIO - MENTOR

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS205	Facility Name: AQUA OHIO INC - MENTOR DISTRIBUTION BILLINGS BOOSTER	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/8/2016 and 1/14/2016 at SMP: DS205
	1 Sample(s) Required between 4/8/2016 and 4/14/2016 at SMP: DS205
	1 Sample(s) Required between 7/8/2016 and 7/14/2016 at SMP: DS205
	1 Sample(s) Required between 10/8/2016 and 10/14/2016 at SMP: DS205

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS206	Facility Name: AQUA OHIO INC - MENTOR DISTRIBUTION WAITE HILL SERVICE	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/8/2016 and 1/14/2016 at SMP: DS206
	1 Sample(s) Required between 4/8/2016 and 4/14/2016 at SMP: DS206
	1 Sample(s) Required between 7/8/2016 and 7/14/2016 at SMP: DS206
	1 Sample(s) Required between 10/8/2016 and 10/14/2016 at SMP: DS206

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS207	Facility Name: AQUA OHIO INC - MENTOR DISTRIBUTION KIRTLAND BOOSTER	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/8/2016 and 1/14/2016 at SMP: DS207
	1 Sample(s) Required between 4/8/2016 and 4/14/2016 at SMP: DS207
	1 Sample(s) Required between 7/8/2016 and 7/14/2016 at SMP: DS207
	1 Sample(s) Required between 10/8/2016 and 10/14/2016 at SMP: DS207

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS208	Facility Name: AQUA OHIO INC - MENTOR DISTRIBUTION CARRIGE HILLS	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/8/2016 and 1/14/2016 at SMP: DS208
	1 Sample(s) Required between 4/8/2016 and 4/14/2016 at SMP: DS208
	1 Sample(s) Required between 7/8/2016 and 7/14/2016 at SMP: DS208



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

OH4301511 AQUA OHIO - MENTOR

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS208	Facility Name: AQUA OHIO INC - MENTOR DISTRIBUTION CARRIGE HILLS	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 10/8/2016 and 10/14/2016 at SMP: DS208

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH4301611 PAINESVILLE CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4355446	Facility Name: PAINESVILLE CITY	Facility Class: CLASS 4
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 1/1/2016 and 5/31/2016

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040
1 Sample(s) Required between 1/1/2016 and 1/31/2016
1 Sample(s) Required between 2/1/2016 and 2/29/2016
1 Sample(s) Required between 3/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 4/30/2016
1 Sample(s) Required between 5/1/2016 and 5/31/2016
1 Sample(s) Required between 6/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 7/31/2016
1 Sample(s) Required between 8/1/2016 and 8/31/2016
1 Sample(s) Required between 9/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 10/31/2016
1 Sample(s) Required between 11/1/2016 and 11/30/2016
1 Sample(s) Required between 12/1/2016 and 12/31/2016

RADIOLOGICALS Not Required

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 4/1/2016 and 6/30/2016

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 1/1/2016 and 5/31/2016

TOTAL ORGANIC CARBON (TOC)
1 Paired Sample Set Required between 1/1/2016 and 1/31/2016
1 Paired Sample Set Required between 2/1/2016 and 2/29/2016
1 Paired Sample Set Required between 3/1/2016 and 3/31/2016
1 Paired Sample Set Required between 4/1/2016 and 4/30/2016
1 Paired Sample Set Required between 5/1/2016 and 5/31/2016
1 Paired Sample Set Required between 6/1/2016 and 6/30/2016
1 Paired Sample Set Required between 7/1/2016 and 7/31/2016
1 Paired Sample Set Required between 8/1/2016 and 8/31/2016
1 Paired Sample Set Required between 9/1/2016 and 9/30/2016
1 Paired Sample Set Required between 10/1/2016 and 10/31/2016
1 Paired Sample Set Required between 11/1/2016 and 11/30/2016
1 Paired Sample Set Required between 12/1/2016 and 12/31/2016

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



Effective Date: 10/14/2016

2016 ENTRY POINT SCHEDULE

OH4301611 PAINESVILLE CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4355446	Facility Name: PAINESVILLE CITY	Facility Class: CLASS 4
	SMP ID: EP001/LT2001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
TOTAL MICROCYSTINS	1 Sample Set Required WEEKLY starting June 5

Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. Both are required every week from January 1 to December 31 (reduced monitoring available from November to April). A week is defined as Sunday through Saturday. Samples must be analyzed at a lab accepted by Ohio EPA for microcystins analysis.



OH4301611 PAINESVILLE CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4355446 SMP ID: LT2001	Facility Name: PAINESVILLE CITY Facility Source: Surface Water	Facility Class: CLASS 4
--------------------------	--	---	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016

Chemicals	Monitoring Requirements
-----------	-------------------------

CYANOBACTERIA SCREENING	1 Sample(s) Required between 6/12/2016 and 6/18/2016
	1 Sample(s) Required between 6/26/2016 and 7/2/2016
	1 Sample(s) Required between 7/10/2016 and 7/16/2016
	1 Sample(s) Required between 7/24/2016 and 7/30/2016
	1 Sample(s) Required between 8/7/2016 and 8/13/2016
	1 Sample(s) Required between 8/21/2016 and 8/27/2016
	1 Sample(s) Required between 9/4/2016 and 9/10/2016
	1 Sample(s) Required between 9/18/2016 and 9/24/2016
	1 Sample(s) Required between 10/2/2016 and 10/8/2016
	1 Sample(s) Required between 10/16/2016 and 10/22/2016
	1 Sample(s) Required between 10/30/2016 and 11/5/2016
	1 Sample(s) Required between 11/13/2016 and 11/19/2016
	1 Sample(s) Required between 11/27/2016 and 12/3/2016
	1 Sample(s) Required between 12/11/2016 and 12/17/2016
	1 Sample(s) Required between 12/25/2016 and 12/31/2016

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 and must be collected at the same time as the raw total microcystins sample. SAMPLES MUST BE SHIPPED OVERNIGHT ON ICE ON THE DAY OF COLLECTION AND ARRIVE AT OHIO EPA DIVISION OF ENVIRONMENTAL SERVICES BY NOON MONDAY THROUGH THURSDAY ONLY!

LT2 MONITORING	1 Sample(s) Required between 10/3/2016 and 10/7/2016
	1 Sample(s) Required between 10/31/2016 and 11/4/2016
	1 Sample(s) Required between 12/5/2016 and 12/9/2016

Monitor for: Cryptosporidium - 2078, E-coli count - 3014, Turbidity - 0100

LT2 MATRIX SPIKE SAMPLE	1 Sample(s) Required between 10/3/2016 and 10/7/2016
-------------------------	--



OH4301611 PAINESVILLE CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: PAINESVILLE, CITY OF DISTRIBUTION	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100

25 Sample(s) Required between	1/1/2016	and	1/31/2016
25 Sample(s) Required between	2/1/2016	and	2/29/2016
25 Sample(s) Required between	3/1/2016	and	3/31/2016
25 Sample(s) Required between	4/1/2016	and	4/30/2016
25 Sample(s) Required between	5/1/2016	and	5/31/2016
25 Sample(s) Required between	6/1/2016	and	6/30/2016
25 Sample(s) Required between	7/1/2016	and	7/31/2016
25 Sample(s) Required between	8/1/2016	and	8/31/2016
25 Sample(s) Required between	9/1/2016	and	9/30/2016
25 Sample(s) Required between	10/1/2016	and	10/31/2016
25 Sample(s) Required between	11/1/2016	and	11/30/2016
25 Sample(s) Required between	12/1/2016	and	12/31/2016

TOTAL CHLORINE - 1000

25 Sample(s) Required between	1/1/2016	and	1/31/2016
25 Sample(s) Required between	2/1/2016	and	2/29/2016
25 Sample(s) Required between	3/1/2016	and	3/31/2016
25 Sample(s) Required between	4/1/2016	and	4/30/2016
25 Sample(s) Required between	5/1/2016	and	5/31/2016
25 Sample(s) Required between	6/1/2016	and	6/30/2016
25 Sample(s) Required between	7/1/2016	and	7/31/2016
25 Sample(s) Required between	8/1/2016	and	8/31/2016
25 Sample(s) Required between	9/1/2016	and	9/30/2016
25 Sample(s) Required between	10/1/2016	and	10/31/2016
25 Sample(s) Required between	11/1/2016	and	11/30/2016
25 Sample(s) Required between	12/1/2016	and	12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: PAINESVILLE, CITY OF DISTRIBUTION 11376 SADDLEWOOD	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between	1/1/2016	and	1/7/2016	at SMP: DS201
1 Sample(s) Required between	4/1/2016	and	4/7/2016	at SMP: DS201
1 Sample(s) Required between	7/1/2016	and	7/7/2016	at SMP: DS201



OH4301611 PAINESVILLE CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: PAINESVILLE, CITY OF DISTRIBUTION 11376 SADDLEWOOD	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 10/1/2016 and 10/7/2016 at SMP: DS201
-------------------------	--

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: PAINESVILLE, CITY OF DISTRIBUTION 8209 RAVENNA RD.	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/1/2016 and 1/7/2016 at SMP: DS202
	1 Sample(s) Required between 4/1/2016 and 4/7/2016 at SMP: DS202
	1 Sample(s) Required between 7/1/2016 and 7/7/2016 at SMP: DS202
	1 Sample(s) Required between 10/1/2016 and 10/7/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS203	Facility Name: PAINESVILLE, CITY OF DISTRIBUTION 7229 RAVENNA RD.	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/1/2016 and 1/7/2016 at SMP: DS203
	1 Sample(s) Required between 4/1/2016 and 4/7/2016 at SMP: DS203
	1 Sample(s) Required between 7/1/2016 and 7/7/2016 at SMP: DS203
	1 Sample(s) Required between 10/1/2016 and 10/7/2016 at SMP: DS203

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS204	Facility Name: PAINESVILLE, CITY OF DISTRIBUTION RT. 86 TANK 880 SOUTH STATE ST.	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/1/2016 and 1/7/2016 at SMP: DS204
	1 Sample(s) Required between 4/1/2016 and 4/7/2016 at SMP: DS204
	1 Sample(s) Required between 7/1/2016 and 7/7/2016 at SMP: DS204
	1 Sample(s) Required between 10/1/2016 and 10/7/2016 at SMP: DS204

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

OH4302212 STEWART LODGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4355448	Facility Name: STEWART LODGE	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS A

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH4302212 STEWART LODGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **STEWART LODGE DISTRIBUTION**
SMP ID: **DS000**

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022

Not Required

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between	1/1/2016	and	1/31/2016
1 Sample(s) Required between	2/1/2016	and	2/29/2016
1 Sample(s) Required between	3/1/2016	and	3/31/2016
1 Sample(s) Required between	4/1/2016	and	4/30/2016
1 Sample(s) Required between	5/1/2016	and	5/31/2016
1 Sample(s) Required between	6/1/2016	and	6/30/2016
1 Sample(s) Required between	7/1/2016	and	7/31/2016
1 Sample(s) Required between	8/1/2016	and	8/31/2016
1 Sample(s) Required between	9/1/2016	and	9/30/2016
1 Sample(s) Required between	10/1/2016	and	10/31/2016
1 Sample(s) Required between	11/1/2016	and	11/30/2016
1 Sample(s) Required between	12/1/2016	and	12/31/2016

TOTAL CHLORINE - 1000

1 Sample(s) Required between	1/1/2016	and	1/31/2016
1 Sample(s) Required between	2/1/2016	and	2/29/2016
1 Sample(s) Required between	3/1/2016	and	3/31/2016
1 Sample(s) Required between	4/1/2016	and	4/30/2016
1 Sample(s) Required between	5/1/2016	and	5/31/2016
1 Sample(s) Required between	6/1/2016	and	6/30/2016
1 Sample(s) Required between	7/1/2016	and	7/31/2016
1 Sample(s) Required between	8/1/2016	and	8/31/2016
1 Sample(s) Required between	9/1/2016	and	9/30/2016
1 Sample(s) Required between	10/1/2016	and	10/31/2016
1 Sample(s) Required between	11/1/2016	and	11/30/2016
1 Sample(s) Required between	12/1/2016	and	12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: **DS1** Facility Name: **STEWART LODGE DISTRIBUTION**
SMP ID: **DS201** ADDRESS NOT KNOWN

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH4302411 LAKE COUNTY WEST WATER SUBDISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4355449	Facility Name: LAKE CO WEST SUBDIST WTP	Facility Class: CLASS 4
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 1/1/2016 and 5/31/2016
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020	
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 1/31/2016 1 Sample(s) Required between 2/1/2016 and 2/29/2016 1 Sample(s) Required between 3/1/2016 and 3/31/2016 1 Sample(s) Required between 4/1/2016 and 4/30/2016 1 Sample(s) Required between 5/1/2016 and 5/31/2016 1 Sample(s) Required between 6/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 7/31/2016 1 Sample(s) Required between 8/1/2016 and 8/31/2016 1 Sample(s) Required between 9/1/2016 and 9/30/2016 1 Sample(s) Required between 10/1/2016 and 10/31/2016 1 Sample(s) Required between 11/1/2016 and 11/30/2016 1 Sample(s) Required between 12/1/2016 and 12/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2016 and 6/30/2016
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2016 and 5/31/2016
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 1/1/2016 and 1/31/2016 1 Paired Sample Set Required between 2/1/2016 and 2/29/2016 1 Paired Sample Set Required between 3/1/2016 and 3/31/2016 1 Paired Sample Set Required between 4/1/2016 and 4/30/2016 1 Paired Sample Set Required between 5/1/2016 and 5/31/2016 1 Paired Sample Set Required between 6/1/2016 and 6/30/2016 1 Paired Sample Set Required between 7/1/2016 and 7/31/2016 1 Paired Sample Set Required between 8/1/2016 and 8/31/2016 1 Paired Sample Set Required between 9/1/2016 and 9/30/2016 1 Paired Sample Set Required between 10/1/2016 and 10/31/2016 1 Paired Sample Set Required between 11/1/2016 and 11/30/2016 1 Paired Sample Set Required between 12/1/2016 and 12/31/2016

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



Effective Date: 05/13/2016

2016 ENTRY POINT SCHEDULE

OH4302411 LAKE COUNTY WEST WATER SUBDISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4355449	Facility Name: LAKE CO WEST SUBDIST WTP	Facility Class: CLASS 4
	SMP ID: EP001/LT2001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals

Monitoring Requirements

TOTAL MICROCYSTINS	1 Sample Set Required WEEKLY starting June 5
--------------------	---

Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. Both are required every week from January 1 to December 31 (reduced monitoring available from November to April). A week is defined as Sunday through Saturday. Samples must be analyzed at a lab accepted by Ohio EPA for microcystins analysis.



OH4302411 LAKE COUNTY WEST WATER SUBDISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4355449 SMP ID: LT2001	Facility Name: LAKE CO WEST SUBDIST WTP Facility Source: Surface Water	Facility Class: CLASS 4
--------------------------	--	---	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016

Chemicals	Monitoring Requirements
CYANOBACTERIA SCREENING	1 Sample(s) Required between 6/12/2016 and 6/18/2016
	1 Sample(s) Required between 6/26/2016 and 7/2/2016
	1 Sample(s) Required between 7/10/2016 and 7/16/2016
	1 Sample(s) Required between 7/24/2016 and 7/30/2016
	1 Sample(s) Required between 8/7/2016 and 8/13/2016
	1 Sample(s) Required between 8/21/2016 and 8/27/2016
	1 Sample(s) Required between 9/4/2016 and 9/10/2016
	1 Sample(s) Required between 9/18/2016 and 9/24/2016
	1 Sample(s) Required between 10/2/2016 and 10/8/2016
	1 Sample(s) Required between 10/16/2016 and 10/22/2016
	1 Sample(s) Required between 10/30/2016 and 11/5/2016
	1 Sample(s) Required between 11/13/2016 and 11/19/2016
	1 Sample(s) Required between 11/27/2016 and 12/3/2016
	1 Sample(s) Required between 12/11/2016 and 12/17/2016
	1 Sample(s) Required between 12/25/2016 and 12/31/2016

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 and must be collected at the same time as the raw total microcystins sample. SAMPLES MUST BE SHIPPED OVERNIGHT ON ICE ON THE DAY OF COLLECTION AND ARRIVE AT OHIO EPA DIVISION OF ENVIRONMENTAL SERVICES BY NOON MONDAY THROUGH THURSDAY ONLY!



OH4302411 LAKE COUNTY WEST WATER SUBDISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: LAKE CO WEST SUBDIST DISTRIBUTION	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	80 Sample(s) Required between	1/1/2016	and	1/31/2016
	80 Sample(s) Required between	2/1/2016	and	2/29/2016
	80 Sample(s) Required between	3/1/2016	and	3/31/2016
	80 Sample(s) Required between	4/1/2016	and	4/30/2016
	80 Sample(s) Required between	5/1/2016	and	5/31/2016
	80 Sample(s) Required between	6/1/2016	and	6/30/2016
	80 Sample(s) Required between	7/1/2016	and	7/31/2016
	80 Sample(s) Required between	8/1/2016	and	8/31/2016
	80 Sample(s) Required between	9/1/2016	and	9/30/2016
	80 Sample(s) Required between	10/1/2016	and	10/31/2016
	80 Sample(s) Required between	11/1/2016	and	11/30/2016
	80 Sample(s) Required between	12/1/2016	and	12/31/2016

TOTAL CHLORINE - 1000	80 Sample(s) Required between	1/1/2016	and	1/31/2016
	80 Sample(s) Required between	2/1/2016	and	2/29/2016
	80 Sample(s) Required between	3/1/2016	and	3/31/2016
	80 Sample(s) Required between	4/1/2016	and	4/30/2016
	80 Sample(s) Required between	5/1/2016	and	5/31/2016
	80 Sample(s) Required between	6/1/2016	and	6/30/2016
	80 Sample(s) Required between	7/1/2016	and	7/31/2016
	80 Sample(s) Required between	8/1/2016	and	8/31/2016
	80 Sample(s) Required between	9/1/2016	and	9/30/2016
	80 Sample(s) Required between	10/1/2016	and	10/31/2016
	80 Sample(s) Required between	11/1/2016	and	11/30/2016
	80 Sample(s) Required between	12/1/2016	and	12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: LAKE CO WEST SUBDIST DISTRIBUTION RIVER RD. BY I-90	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between	2/8/2016	and	2/14/2016 at SMP: DS201
	1 Sample(s) Required between	5/8/2016	and	5/14/2016 at SMP: DS201
	1 Sample(s) Required between	8/8/2016	and	8/14/2016 at SMP: DS201



OH4302411 LAKE COUNTY WEST WATER SUBDISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: LAKE CO WEST SUBDIST DISTRIBUTION RIVER RD. BY I-90	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 11/8/2016 and 11/14/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: LAKE CO WEST SUBDIST DISTRIBUTION WHITE RD. TANK	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 2/8/2016 and 2/14/2016 at SMP: DS202

1 Sample(s) Required between 5/8/2016 and 5/14/2016 at SMP: DS202

1 Sample(s) Required between 8/8/2016 and 8/14/2016 at SMP: DS202

1 Sample(s) Required between 11/8/2016 and 11/14/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS203	Facility Name: LAKE CO WEST SUBDIST DISTRIBUTION RODGERS RD.	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 2/8/2016 and 2/14/2016 at SMP: DS203

1 Sample(s) Required between 5/8/2016 and 5/14/2016 at SMP: DS203

1 Sample(s) Required between 8/8/2016 and 8/14/2016 at SMP: DS203

1 Sample(s) Required between 11/8/2016 and 11/14/2016 at SMP: DS203

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS204	Facility Name: LAKE CO WEST SUBDIST DISTRIBUTION BRYN MAWR	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 2/8/2016 and 2/14/2016 at SMP: DS204

1 Sample(s) Required between 5/8/2016 and 5/14/2016 at SMP: DS204

1 Sample(s) Required between 8/8/2016 and 8/14/2016 at SMP: DS204

1 Sample(s) Required between 11/8/2016 and 11/14/2016 at SMP: DS204

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH4302411 LAKE COUNTY WEST WATER SUBDISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS205	Facility Name: LAKE CO WEST SUBDIST DISTRIBUTION 27400 CHARDON RD.	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/8/2016 and 2/14/2016 at SMP: DS205
	1 Sample(s) Required between 5/8/2016 and 5/14/2016 at SMP: DS205
	1 Sample(s) Required between 8/8/2016 and 8/14/2016 at SMP: DS205
	1 Sample(s) Required between 11/8/2016 and 11/14/2016 at SMP: DS205

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS206	Facility Name: LAKE CO WEST SUBDIST DISTRIBUTION 28601 CHARDON RD.	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/8/2016 and 2/14/2016 at SMP: DS206
	1 Sample(s) Required between 5/8/2016 and 5/14/2016 at SMP: DS206
	1 Sample(s) Required between 8/8/2016 and 8/14/2016 at SMP: DS206
	1 Sample(s) Required between 11/8/2016 and 11/14/2016 at SMP: DS206

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS207	Facility Name: LAKE CO WEST SUBDIST DISTRIBUTION RT. 306 AND 90 (BURGER KING)	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/8/2016 and 2/14/2016 at SMP: DS207
	1 Sample(s) Required between 5/8/2016 and 5/14/2016 at SMP: DS207
	1 Sample(s) Required between 8/8/2016 and 8/14/2016 at SMP: DS207
	1 Sample(s) Required between 11/8/2016 and 11/14/2016 at SMP: DS207

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS208	Facility Name: LAKE CO WEST SUBDIST DISTRIBUTION TRAILARD	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/8/2016 and 2/14/2016 at SMP: DS208
	1 Sample(s) Required between 5/8/2016 and 5/14/2016 at SMP: DS208
	1 Sample(s) Required between 8/8/2016 and 8/14/2016 at SMP: DS208



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

OH4302411 LAKE COUNTY WEST WATER SUBDISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS208	Facility Name: LAKE CO WEST SUBDIST DISTRIBUTION TRAILARD	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 11/8/2016 and 11/14/2016 at SMP: DS208

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH4302911 LAKE COUNTY EAST WATER SUBDISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4355450	Facility Name: LAKE CO EAST WTR SUBDISTRICT	Facility Class: CLASS 4
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 1/1/2016 and 5/31/2016

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2016 and 1/31/2016

1 Sample(s) Required between 2/1/2016 and 2/29/2016

1 Sample(s) Required between 3/1/2016 and 3/31/2016

1 Sample(s) Required between 4/1/2016 and 4/30/2016

1 Sample(s) Required between 5/1/2016 and 5/31/2016

1 Sample(s) Required between 6/1/2016 and 6/30/2016

1 Sample(s) Required between 7/1/2016 and 7/31/2016

1 Sample(s) Required between 8/1/2016 and 8/31/2016

1 Sample(s) Required between 9/1/2016 and 9/30/2016

1 Sample(s) Required between 10/1/2016 and 10/31/2016

1 Sample(s) Required between 11/1/2016 and 11/30/2016

1 Sample(s) Required between 12/1/2016 and 12/31/2016

RADIOLOGICALS Not Required

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 4/1/2016 and 6/30/2016

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 1/1/2016 and 5/31/2016

TOTAL ORGANIC CARBON (TOC)

1 Paired Sample Set Required between 1/1/2016 and 1/31/2016

1 Paired Sample Set Required between 2/1/2016 and 2/29/2016

1 Paired Sample Set Required between 3/1/2016 and 3/31/2016

1 Paired Sample Set Required between 4/1/2016 and 4/30/2016

1 Paired Sample Set Required between 5/1/2016 and 5/31/2016

1 Paired Sample Set Required between 6/1/2016 and 6/30/2016

1 Paired Sample Set Required between 7/1/2016 and 7/31/2016

1 Paired Sample Set Required between 8/1/2016 and 8/31/2016

1 Paired Sample Set Required between 9/1/2016 and 9/30/2016

1 Paired Sample Set Required between 10/1/2016 and 10/31/2016

1 Paired Sample Set Required between 11/1/2016 and 11/30/2016

1 Paired Sample Set Required between 12/1/2016 and 12/31/2016

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



Effective Date: 05/13/2016

2016 ENTRY POINT SCHEDULE

OH4302911 LAKE COUNTY EAST WATER SUBDISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4355450	Facility Name: LAKE CO EAST WTR SUBDISTRICT	Facility Class: CLASS 4
	SMP ID: EP001/LT2001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals

Monitoring Requirements

TOTAL MICROCYSTINS	1 Sample Set Required WEEKLY starting June 5
--------------------	---

Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. Both are required every week from January 1 to December 31 (reduced monitoring available from November to April). A week is defined as Sunday through Saturday. Samples must be analyzed at a lab accepted by Ohio EPA for microcystins analysis.



OH4302911 LAKE COUNTY EAST WATER SUBDISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4355450 SMP ID: LT2001	Facility Name: LAKE CO EAST WTR SUBDISTRICT Facility Source: Surface Water	Facility Class: CLASS 4
--------------------------	--	---	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016

Chemicals	Monitoring Requirements
-----------	-------------------------

CYANOBACTERIA SCREENING	1 Sample(s) Required between 6/12/2016 and 6/18/2016
	1 Sample(s) Required between 6/26/2016 and 7/2/2016
	1 Sample(s) Required between 7/10/2016 and 7/16/2016
	1 Sample(s) Required between 7/24/2016 and 7/30/2016
	1 Sample(s) Required between 8/7/2016 and 8/13/2016
	1 Sample(s) Required between 8/21/2016 and 8/27/2016
	1 Sample(s) Required between 9/4/2016 and 9/10/2016
	1 Sample(s) Required between 9/18/2016 and 9/24/2016
	1 Sample(s) Required between 10/2/2016 and 10/8/2016
	1 Sample(s) Required between 10/16/2016 and 10/22/2016
	1 Sample(s) Required between 10/30/2016 and 11/5/2016
	1 Sample(s) Required between 11/13/2016 and 11/19/2016
	1 Sample(s) Required between 11/27/2016 and 12/3/2016
	1 Sample(s) Required between 12/11/2016 and 12/17/2016
	1 Sample(s) Required between 12/25/2016 and 12/31/2016

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 and must be collected at the same time as the raw total microcystins sample. SAMPLES MUST BE SHIPPED OVERNIGHT ON ICE ON THE DAY OF COLLECTION AND ARRIVE AT OHIO EPA DIVISION OF ENVIRONMENTAL SERVICES BY NOON MONDAY THROUGH THURSDAY ONLY!

LT2 MONITORING	1 Sample(s) Required between 1/11/2016 and 1/15/2016
	1 Sample(s) Required between 2/15/2016 and 2/19/2016
	1 Sample(s) Required between 3/14/2016 and 3/18/2016
	1 Sample(s) Required between 4/11/2016 and 4/15/2016
	1 Sample(s) Required between 5/9/2016 and 5/13/2016
	1 Sample(s) Required between 6/13/2016 and 6/17/2016
	1 Sample(s) Required between 7/11/2016 and 7/15/2016
	1 Sample(s) Required between 8/15/2016 and 8/19/2016
	1 Sample(s) Required between 9/12/2016 and 9/16/2016
	1 Sample(s) Required between 10/10/2016 and 10/14/2016
	1 Sample(s) Required between 11/14/2016 and 11/18/2016
	1 Sample(s) Required between 12/5/2016 and 12/9/2016

Monitor for: Cryptosporidium - 2078, E-coli count - 3014, Turbidity - 0100



OH4302911 LAKE COUNTY EAST WATER SUBDISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: DS1 SMP ID: DS000 Facility Name: LAKE CO EAST WTR SUBDIST DISTRIBUTION Facility Class: CLASS 2

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100 40 Sample(s) Required between 1/1/2016 and 1/31/2016 ... 40 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000 40 Sample(s) Required between 1/1/2016 and 1/31/2016 ... 40 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: DS1 SMP ID: DS201 Facility Name: LAKE CO EAST WTR SUBDIST DISTRIBUTION Facility Class: CLASS 2

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 2/8/2016 and 2/14/2016 at SMP: DS201 ... 1 Sample(s) Required between 8/8/2016 and 8/14/2016 at SMP: DS201



OH4302911 LAKE COUNTY EAST WATER SUBDISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: LAKE CO EAST WTR SUBDIST DISTRIBUTION Facility Class: CLASS 2
Location SMP ID: DS201 6782 RIVER ROAD

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 11/8/2016 and 11/14/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950

Sampling Facility ID: DS1 Facility Name: LAKE CO EAST WTR SUBDIST DISTRIBUTION Facility Class: CLASS 2
Location SMP ID: DS202 5212 RIVER ROAD

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 2/8/2016 and 2/14/2016 at SMP: DS202
1 Sample(s) Required between 5/8/2016 and 5/14/2016 at SMP: DS202
1 Sample(s) Required between 8/8/2016 and 8/14/2016 at SMP: DS202
1 Sample(s) Required between 11/8/2016 and 11/14/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950

Sampling Facility ID: DS1 Facility Name: LAKE CO EAST WTR SUBDIST DISTRIBUTION Facility Class: CLASS 2
Location SMP ID: DS203 4830 DAVIS ROAD

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 2/8/2016 and 2/14/2016 at SMP: DS203
1 Sample(s) Required between 5/8/2016 and 5/14/2016 at SMP: DS203
1 Sample(s) Required between 8/8/2016 and 8/14/2016 at SMP: DS203
1 Sample(s) Required between 11/8/2016 and 11/14/2016 at SMP: DS203

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950

Sampling Facility ID: DS1 Facility Name: LAKE CO EAST WTR SUBDIST DISTRIBUTION Facility Class: CLASS 2
Location SMP ID: DS204 4610 WEBB RD.

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 2/8/2016 and 2/14/2016 at SMP: DS204
1 Sample(s) Required between 5/8/2016 and 5/14/2016 at SMP: DS204
1 Sample(s) Required between 8/8/2016 and 8/14/2016 at SMP: DS204
1 Sample(s) Required between 11/8/2016 and 11/14/2016 at SMP: DS204

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



OH4303103 LAKE COUNTY PINECREST SUBDISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: PINECREST SUBDIVISION DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 1/31/2016
	1 Sample(s) Required between 2/1/2016 and 2/29/2016
	1 Sample(s) Required between 3/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 4/30/2016
	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 10/31/2016
	1 Sample(s) Required between 11/1/2016 and 11/30/2016
	1 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2016 and 1/31/2016
	1 Sample(s) Required between 2/1/2016 and 2/29/2016
	1 Sample(s) Required between 3/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 4/30/2016
	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 10/31/2016
	1 Sample(s) Required between 11/1/2016 and 11/30/2016
	1 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: PINECREST SUBDIVISION DISTRIBUTION 8242 WHITNEY LANE	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/8/2016 and 2/14/2016 at SMP: DS201
	1 Sample(s) Required between 5/8/2016 and 5/14/2016 at SMP: DS201
	1 Sample(s) Required between 8/8/2016 and 8/14/2016 at SMP: DS201
	1 Sample(s) Required between 11/8/2016 and 11/14/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH4330217 BUNKYS PUB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: BUNKYS PUB DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

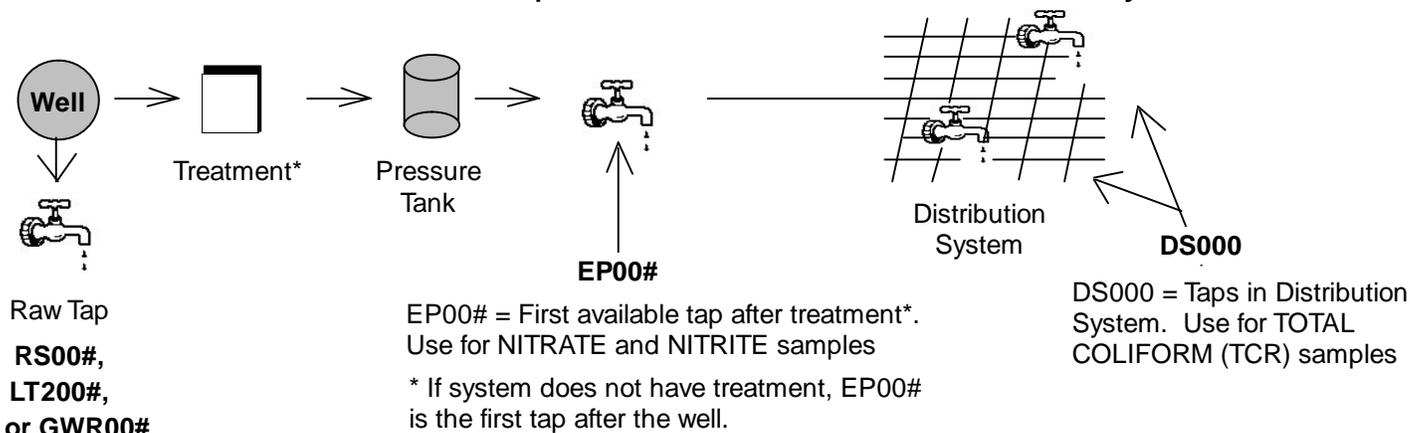

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4330217 BUNKYS PUB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **4355453** Facility Name: **BUNKYS PUB**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

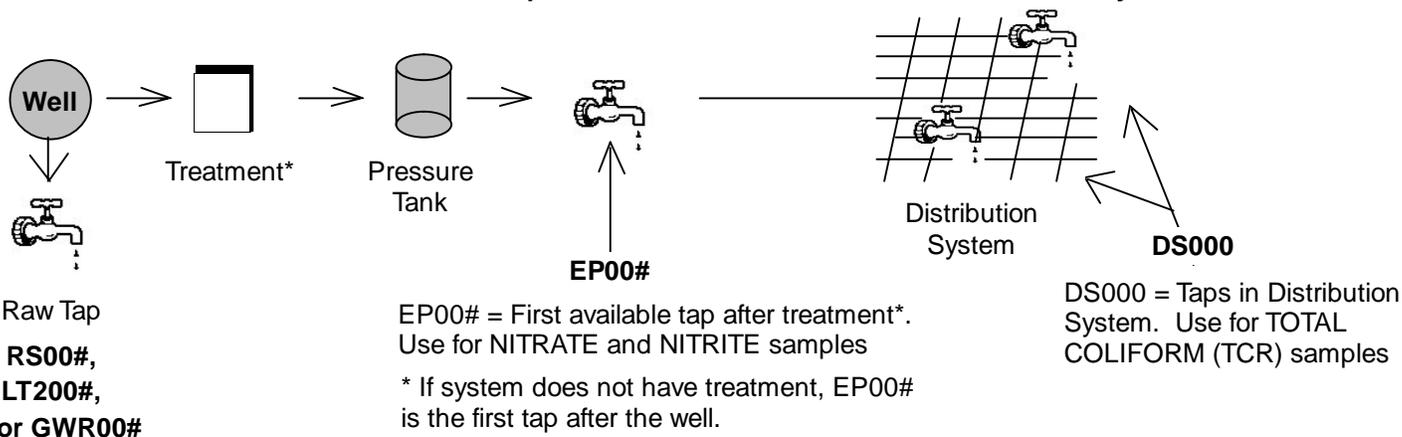

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH4331612 LEROY ELEMENTARY SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4355459	Facility Name: LEROY ELEM SCH	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH4331612 LEROY ELEMENTARY SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **LEROY ELEMENTARY SCHOOL DISTRIBUTIO** Facility Class: **CLASS 1**
SMP ID: **DS000**

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2016 and 9/30/2016

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

TOTAL COLIFORM (TCR) - 3100
1 Sample(s) Required between 1/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000
1 Sample(s) Required between 1/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: **DS1** Facility Name: **LEROY ELEMENTARY SCHOOL DISTRIBUTIO** Facility Class: **CLASS 1**
SMP ID: **DS201** ADDRESS NOT KNOWN

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH4333617 CEDARJJJ

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CEDAR HILLS CONFERENCE C DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

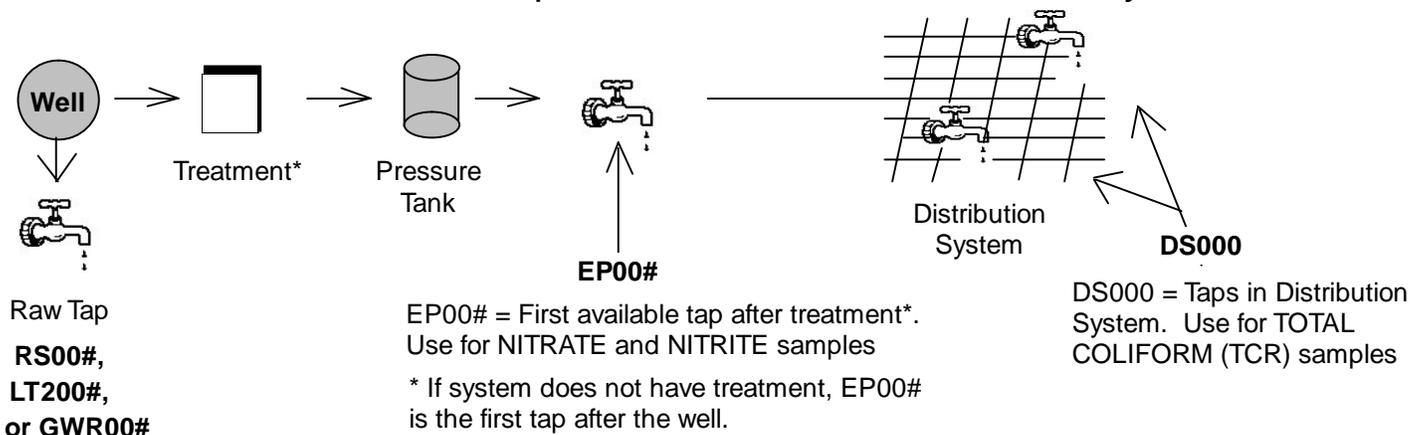

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4334612 CAPPS TAVERN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CAPPS TAVERN DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

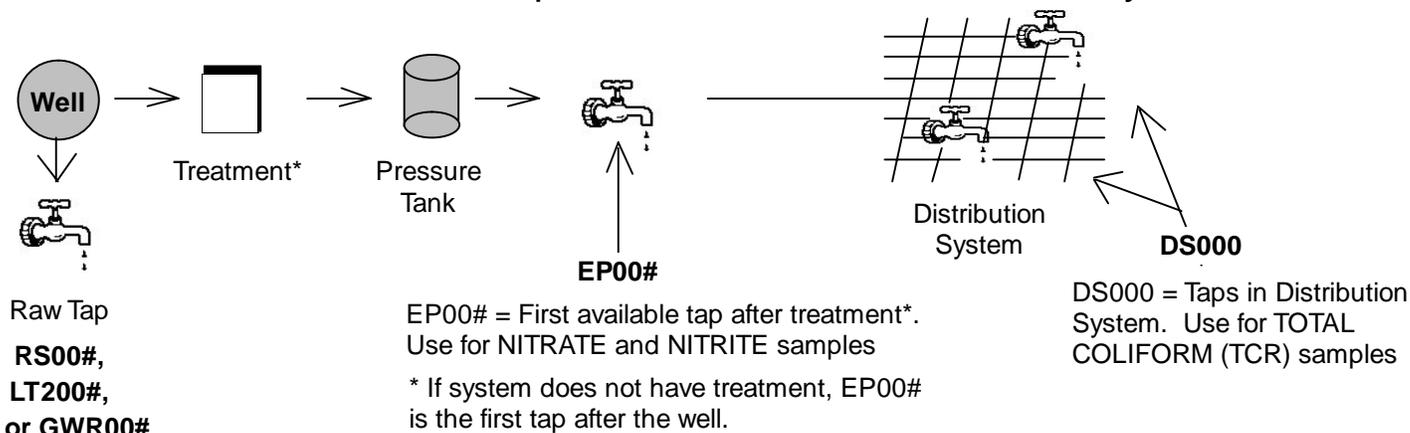

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4334612 CAPPS TAVERN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **4355467** Facility Name: **CAPPS TAVERN**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

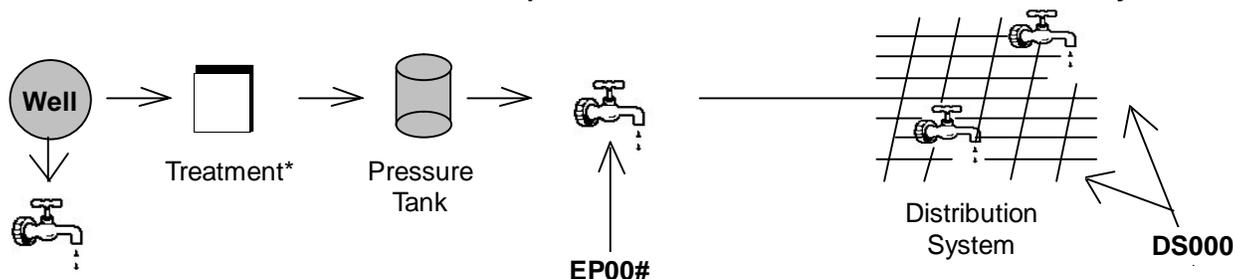

Raw Tap
RS00#,
LT200#,
or **GWR00#**

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00#
is the first tap after the well.

DS000 = Taps in Distribution
System. Use for TOTAL
COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

OH4337419 HOLDEN ARBORETUM

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4355476	Facility Name: HOLDEN ARBORETUM	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS A

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH4337419 HOLDEN ARBORETUM

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **HOLDEN ARBORETUM DISTRIBUTION**
SMP ID: **DS000**

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 7/1/2016 and 12/31/2016

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

TOTAL COLIFORM (TCR) - 3100
1 Sample(s) Required between 1/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000
1 Sample(s) Required between 1/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: **DS1** Facility Name: **HOLDEN ARBORETUM DISTRIBUTION**
SMP ID: **DS201** ADDRESS NOT KNOWN

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH4338112 KIRTLAND CITY TAVERN PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: PJS PUB DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

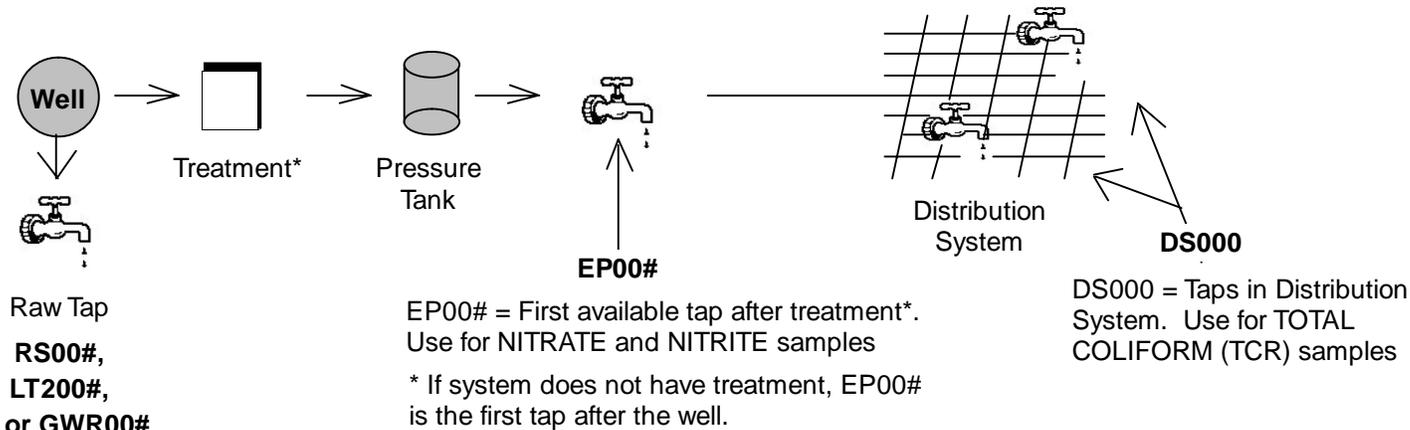

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4338112 KIRTLAND CITY TAVERN PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **4355479** Facility Name: **KIRTLAND CITY TAVERN**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

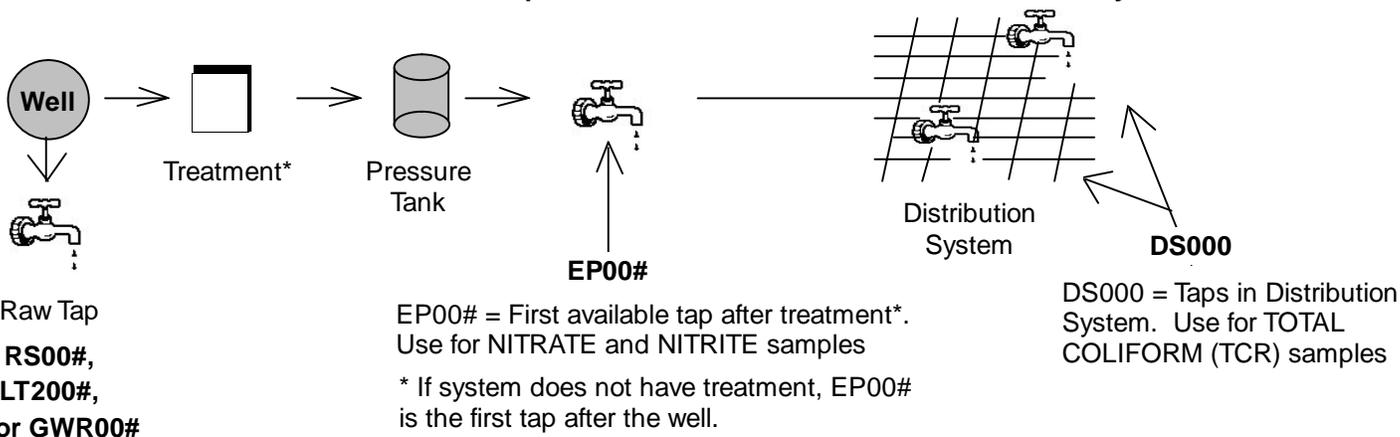

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4338312 STONY GLEN CAMP-CENTER CAMP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: STONY GLEN CAMP-CENTER CAMP DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

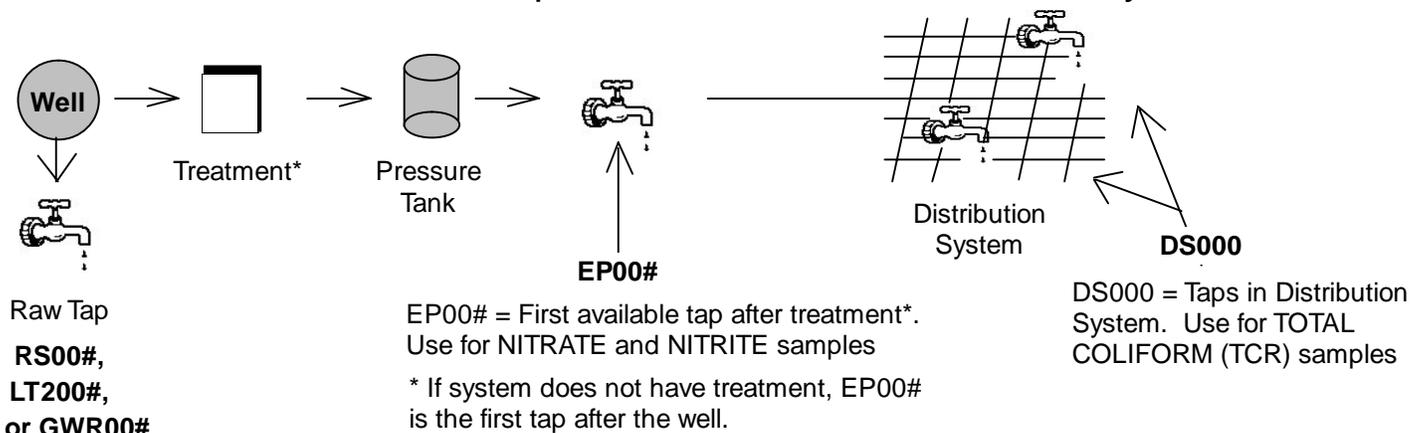

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4338312 STONY GLEN CAMP-CENTER CAMP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **4355480** Facility Name: **STONY GLEN CAMP-CENTER CAMP**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

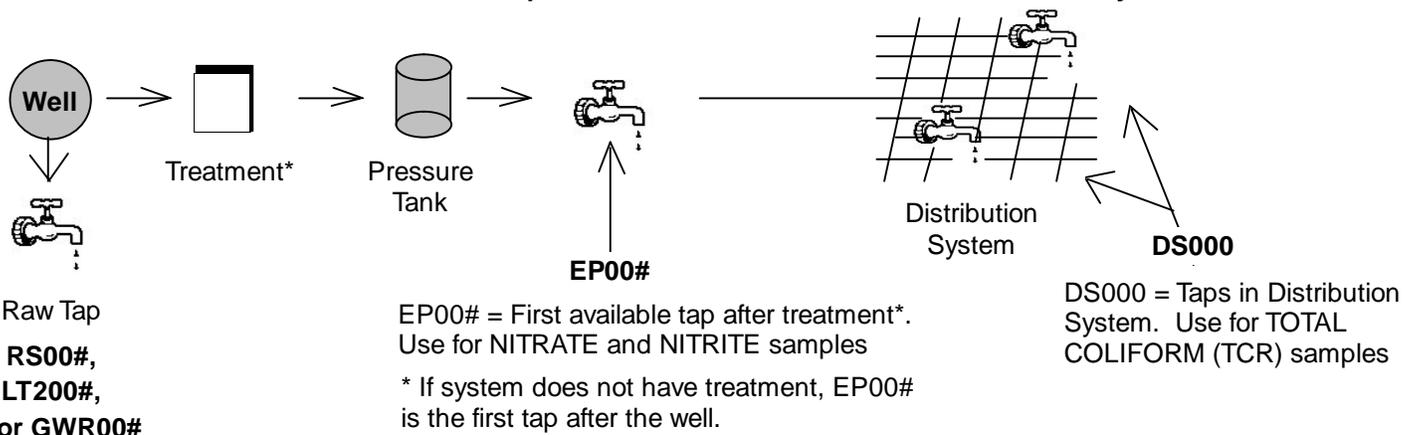

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

OH4339112 LITTLE LEARNER'S DAYCARE

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4355482	Facility Name: LITTLE LEARNER'S DAYCARE	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS A

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

OH4339112 LITTLE LEARNER'S DAYCARE

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: LITTLE LEARNER'S DAYCARE DISTRIBUTION
	SMP ID: DS000	

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022

Not Required

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between	1/1/2016	and	3/31/2016
1 Sample(s) Required between	4/1/2016	and	6/30/2016
1 Sample(s) Required between	7/1/2016	and	9/30/2016
1 Sample(s) Required between	10/1/2016	and	12/31/2016

OH4339612 MADISON CONG. OF JEHOVAHS WITNESS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: MADISON CONG. OF JEH.WIT DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

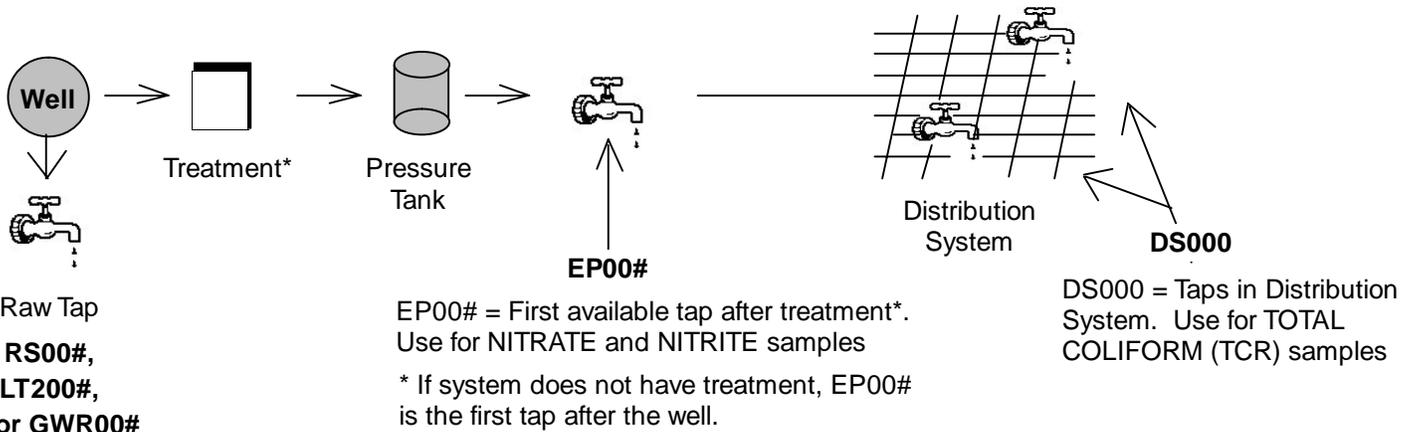

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4339612 MADISON CONG. OF JEHOVAHS WITNESS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **4355484** Facility Name: **MADISON CONG OF JEH WITNESS**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

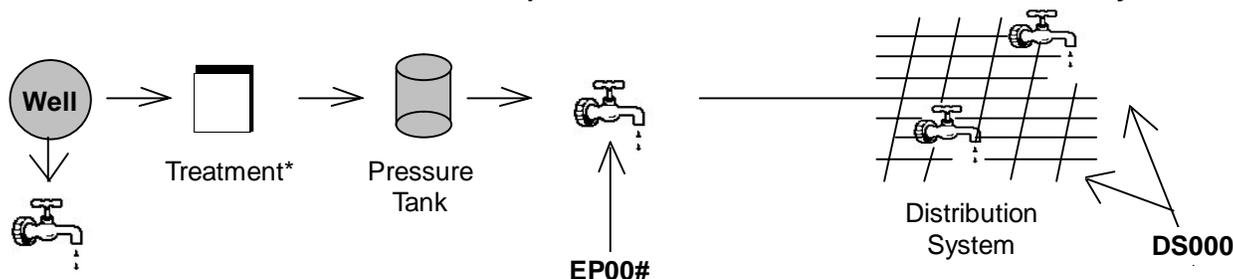

Raw Tap
RS00#,
LT200#,
or **GWR00#**

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00#
is the first tap after the well.

DS000 = Taps in Distribution
System. Use for TOTAL
COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4339812 LAKE CO.-RED SCHOOL HOUSE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: LAKE CO.-RED SCHOOL HOUS DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

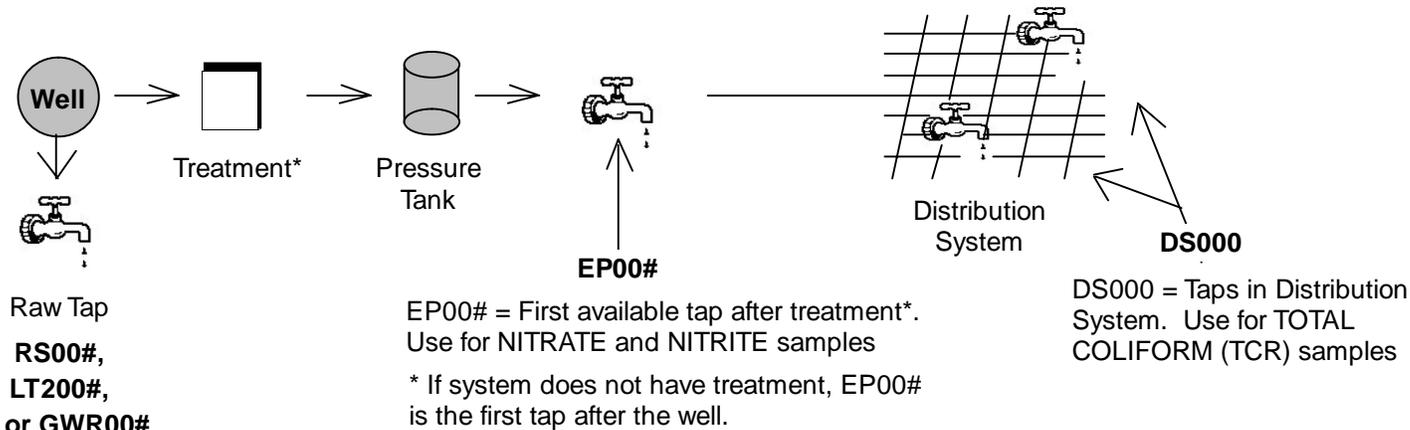

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4339812 LAKE CO.-RED SCHOOL HOUSE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **4355486** Facility Name: **LAKE CO RED SCHOOL HOUSE NTR**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

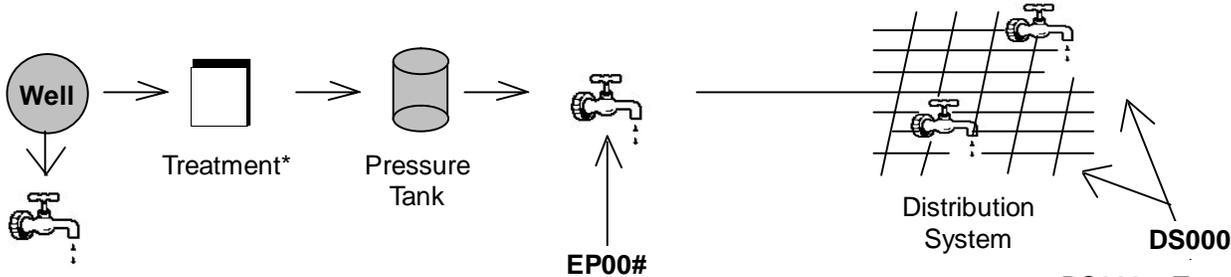

Raw Tap
RS00#,
LT200#,
or **GWR00#**

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00#
is the first tap after the well.

DS000 = Taps in Distribution
System. Use for TOTAL
COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4340111 CAMP STIGWANDISH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **4355489** Facility Name: **CAMP STIGWANDISH**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 4/1/2016 and 6/30/2016

Where to Collect Samples For a Small Public Water System

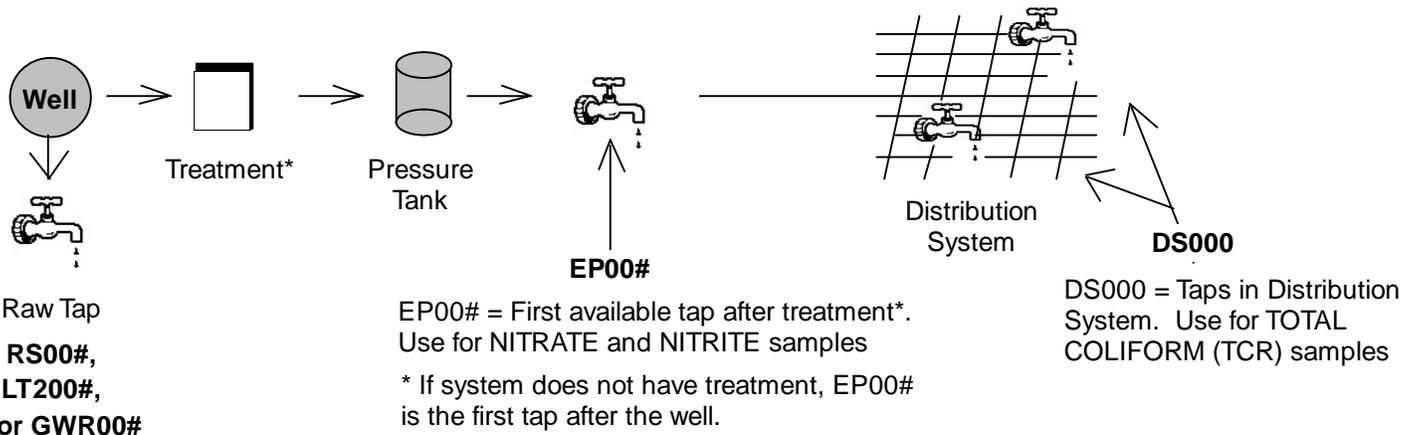

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4340812 LEROY COUNTRY STORE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: LEROY COUNTRY STORE DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

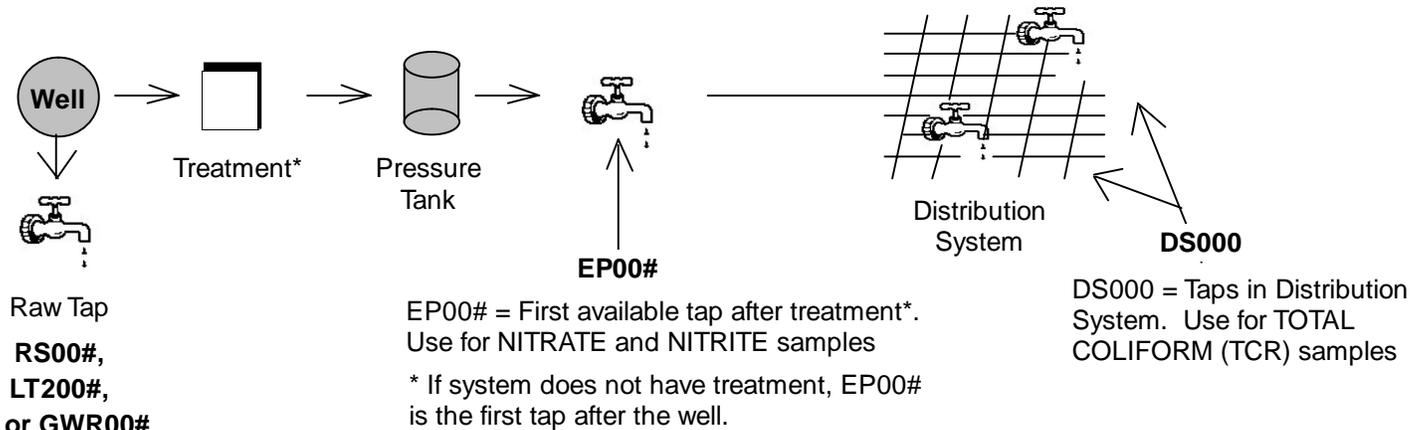

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4340812 LEROY COUNTRY STORE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **4355493** Facility Name: **LEROY COUNTRY STORE**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

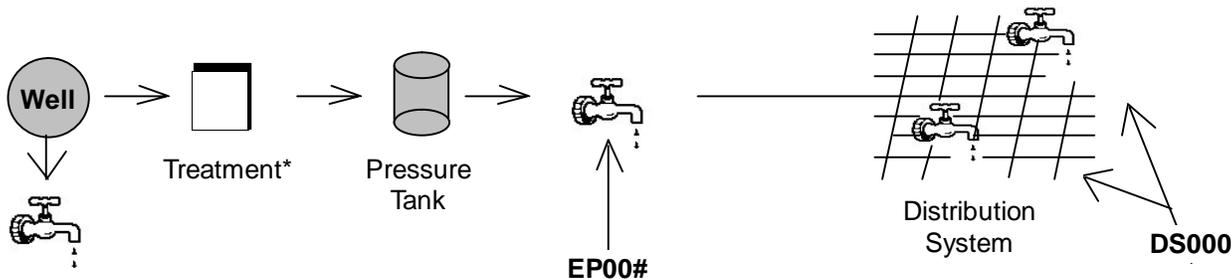

Raw Tap
RS00#,
LT200#,
 or **GWR00#**

EP00# = First available tap after treatment*.
 Use for NITRATE and NITRITE samples
 * If system does not have treatment, EP00#
 is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4341112 STONY GLEN CAMP-A-FRAME

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: STONY GLEN CAMP-A-FRAME DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

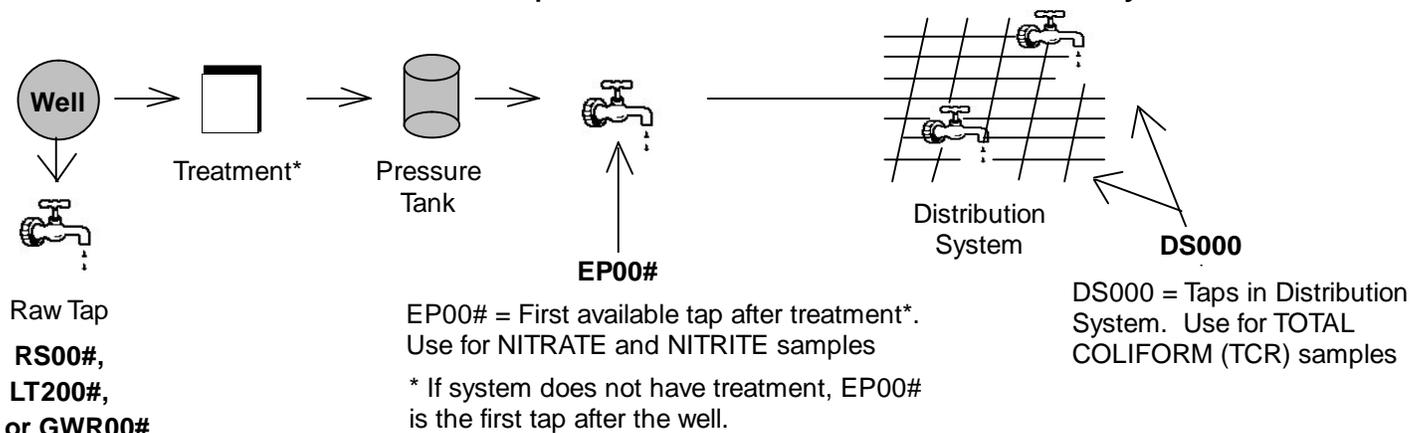

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4341112 STONY GLEN CAMP-A-FRAME

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **4355495** Facility Name: **STONY GLEN CAMP-A-FRAME**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

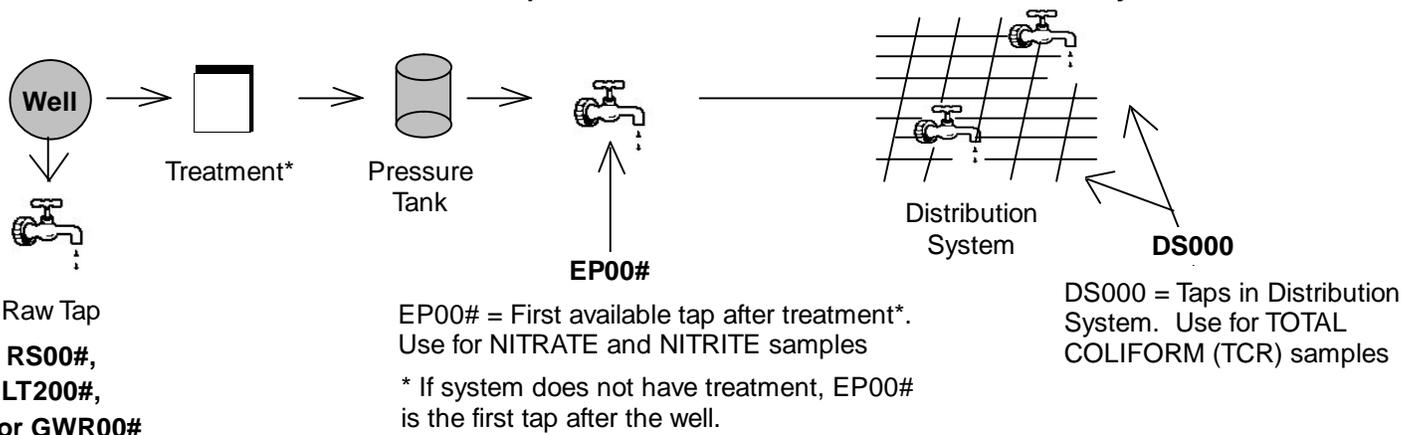

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4341211 CHALET DEBONNE VINEYARD

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CHALET DEBONNE VINEYARD DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

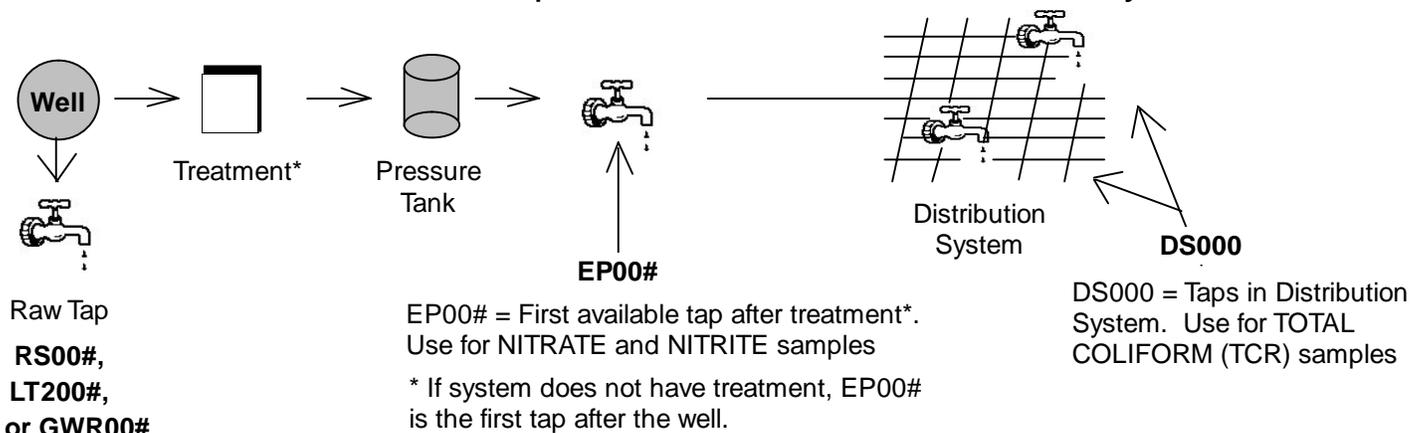

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4341211 CHALET DEBONNE VINEYARD

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **4355496** Facility Name: **CHALET DEBONNE VINEYARD**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

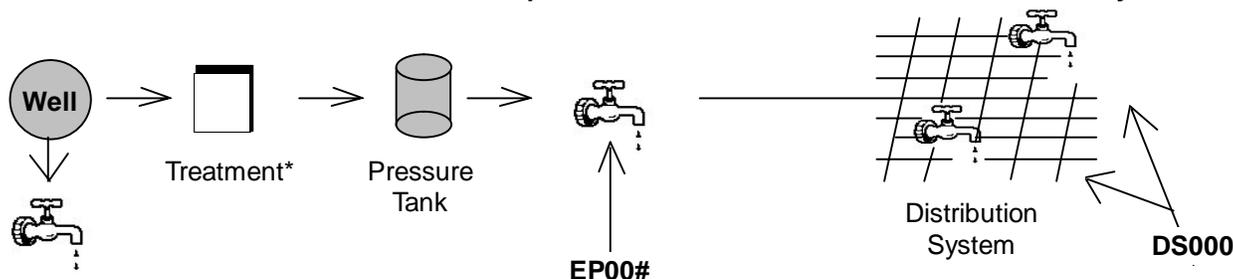

Raw Tap
RS00#,
LT200#,
or **GWR00#**

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples
* If system does not have treatment, EP00#
is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4341612 LEROY COMMUNITY CHAPEL CORNERSTONE PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: LEROY COMMUNITY CHAPEL CORNERSTONE DISTR
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

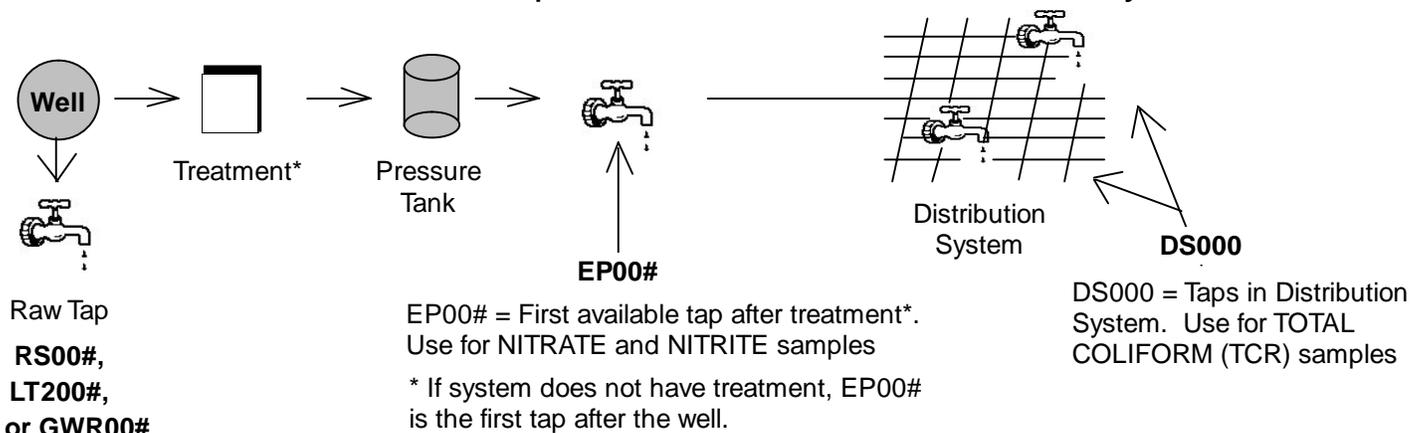

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4341612 LEROY COMMUNITY CHAPEL CORNERSTONE PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **4361545** Facility Name: **LEROY COMMUNITY CHAPEL CORNERSTONE BLDG**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 5/31/2016

Where to Collect Samples For a Small Public Water System

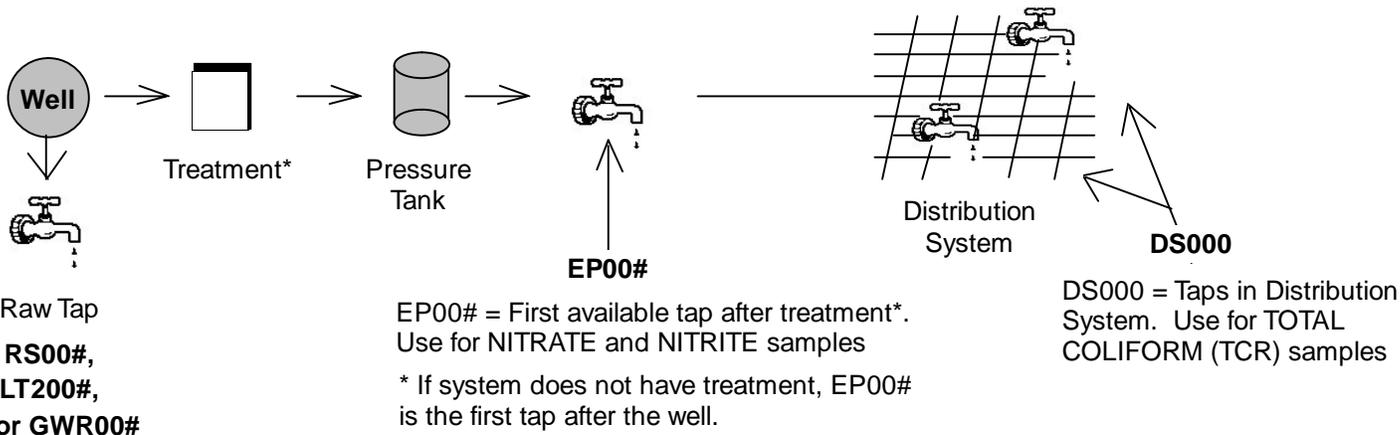

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!