



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

**OH5900112 CARDINGTON VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>5956758</b>	Facility Name: <b>CARDINGTON WTP</b>	
<b>Location</b>	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	Facility Class: <b>CLASS 1</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



**OH5900112 CARDINGTON VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>CARDINGTON DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 Not Required

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100

2 Sample(s) Required between	1/1/2016	and	1/31/2016
2 Sample(s) Required between	2/1/2016	and	2/29/2016
2 Sample(s) Required between	3/1/2016	and	3/31/2016
2 Sample(s) Required between	4/1/2016	and	4/30/2016
2 Sample(s) Required between	5/1/2016	and	5/31/2016
2 Sample(s) Required between	6/1/2016	and	6/30/2016
2 Sample(s) Required between	7/1/2016	and	7/31/2016
2 Sample(s) Required between	8/1/2016	and	8/31/2016
2 Sample(s) Required between	9/1/2016	and	9/30/2016
2 Sample(s) Required between	10/1/2016	and	10/31/2016
2 Sample(s) Required between	11/1/2016	and	11/30/2016
2 Sample(s) Required between	12/1/2016	and	12/31/2016

TOTAL CHLORINE - 1000

2 Sample(s) Required between	1/1/2016	and	1/31/2016
2 Sample(s) Required between	2/1/2016	and	2/29/2016
2 Sample(s) Required between	3/1/2016	and	3/31/2016
2 Sample(s) Required between	4/1/2016	and	4/30/2016
2 Sample(s) Required between	5/1/2016	and	5/31/2016
2 Sample(s) Required between	6/1/2016	and	6/30/2016
2 Sample(s) Required between	7/1/2016	and	7/31/2016
2 Sample(s) Required between	8/1/2016	and	8/31/2016
2 Sample(s) Required between	9/1/2016	and	9/30/2016
2 Sample(s) Required between	10/1/2016	and	10/31/2016
2 Sample(s) Required between	11/1/2016	and	11/30/2016
2 Sample(s) Required between	12/1/2016	and	12/31/2016

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>CARDINGTON DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

**OH5900112 CARDINGTON VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>CARDINGTON DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH5900412 HICKORY GROVE MOBILE HOME COMMUNITY**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>5956761</b>	Facility Name: <b>HICKORY GROVE MOBILE HOME COMMUNITY</b>
<b>Location</b>	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b> Facility Class: <b>CLASS A</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**  
 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
 Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



**OH5900412 HICKORY GROVE MOBILE HOME COMMUNITY**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>HICKORY GROVE MOBILE HOME COMMUNIT</b>
	SMP ID: <b>DS000</b>	

<b>Chemicals</b>	<b>Monitoring Requirements</b>
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2016 and 9/30/2016
-------------------------------	---

*Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>*

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 1/31/2016
	1 Sample(s) Required between 2/1/2016 and 2/29/2016
	1 Sample(s) Required between 3/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 4/30/2016
	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 10/31/2016
	1 Sample(s) Required between 11/1/2016 and 11/30/2016
	1 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2016 and 1/31/2016
	1 Sample(s) Required between 2/1/2016 and 2/29/2016
	1 Sample(s) Required between 3/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 4/30/2016
	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 10/31/2016
	1 Sample(s) Required between 11/1/2016 and 11/30/2016
	1 Sample(s) Required between 12/1/2016 and 12/31/2016

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>HICKORY GROVE MOBILE HOME COMMUNIT</b>
	SMP ID: <b>DS201</b>	<b>7117 COUNTY ROAD 59</b>

<b>Chemicals</b>	<b>Monitoring Requirements</b>
------------------	--------------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

**OH5900512 LAKEVIEW ESTATES MHC**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>5956762</b>	Facility Name: <b>LAKEVIEW ESTATES MHC</b>	
<b>Location</b>	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	Facility Class: <b>CLASS A</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



**OH5900512 LAKEVIEW ESTATES MHC**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Location** Facility ID: **DS1** Facility Name: **LAKEVIEW ESTATES MHC DIST**  
SMP ID: **DS000**

**Chemicals**

**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022

Not Required

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between	1/1/2016	and	1/31/2016
1 Sample(s) Required between	2/1/2016	and	2/29/2016
1 Sample(s) Required between	3/1/2016	and	3/31/2016
1 Sample(s) Required between	4/1/2016	and	4/30/2016
1 Sample(s) Required between	5/1/2016	and	5/31/2016
1 Sample(s) Required between	6/1/2016	and	6/30/2016
1 Sample(s) Required between	7/1/2016	and	7/31/2016
1 Sample(s) Required between	8/1/2016	and	8/31/2016
1 Sample(s) Required between	9/1/2016	and	9/30/2016
1 Sample(s) Required between	10/1/2016	and	10/31/2016
1 Sample(s) Required between	11/1/2016	and	11/30/2016
1 Sample(s) Required between	12/1/2016	and	12/31/2016

TOTAL CHLORINE - 1000

1 Sample(s) Required between	1/1/2016	and	1/31/2016
1 Sample(s) Required between	2/1/2016	and	2/29/2016
1 Sample(s) Required between	3/1/2016	and	3/31/2016
1 Sample(s) Required between	4/1/2016	and	4/30/2016
1 Sample(s) Required between	5/1/2016	and	5/31/2016
1 Sample(s) Required between	6/1/2016	and	6/30/2016
1 Sample(s) Required between	7/1/2016	and	7/31/2016
1 Sample(s) Required between	8/1/2016	and	8/31/2016
1 Sample(s) Required between	9/1/2016	and	9/30/2016
1 Sample(s) Required between	10/1/2016	and	10/31/2016
1 Sample(s) Required between	11/1/2016	and	11/30/2016
1 Sample(s) Required between	12/1/2016	and	12/31/2016

*Samples should be collected at the same time and place as the Total Coliform samples.*

**Sampling Location** Facility ID: **DS1** Facility Name: **LAKEVIEW ESTATES MHC DIST**  
SMP ID: **DS201** ADDRESS NOT KNOWN

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

*Sample for all the analytes listed below:*

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH5900712 MT GILEAD VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>5956763</b>	Facility Name: <b>MT GILEAD WTP</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**  
 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
 Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
ARSENIC - 1005	1 Sample(s) Required between 1/1/2016 and 3/31/2016 1 Sample(s) Required between 4/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 9/30/2016 1 Sample(s) Required between 10/1/2016 and 12/31/2016
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



**OH5900712 MT GILEAD VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>MT GILEAD DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**Chemicals Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 20 Sample(s) Required between 6/1/2016 and 9/30/2016

*Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>*

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100

4 Sample(s) Required between 1/1/2016 and 1/31/2016

4 Sample(s) Required between 2/1/2016 and 2/29/2016

4 Sample(s) Required between 3/1/2016 and 3/31/2016

4 Sample(s) Required between 4/1/2016 and 4/30/2016

4 Sample(s) Required between 5/1/2016 and 5/31/2016

4 Sample(s) Required between 6/1/2016 and 6/30/2016

4 Sample(s) Required between 7/1/2016 and 7/31/2016

4 Sample(s) Required between 8/1/2016 and 8/31/2016

4 Sample(s) Required between 9/1/2016 and 9/30/2016

4 Sample(s) Required between 10/1/2016 and 10/31/2016

4 Sample(s) Required between 11/1/2016 and 11/30/2016

4 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000

4 Sample(s) Required between 1/1/2016 and 1/31/2016

4 Sample(s) Required between 2/1/2016 and 2/29/2016

4 Sample(s) Required between 3/1/2016 and 3/31/2016

4 Sample(s) Required between 4/1/2016 and 4/30/2016

4 Sample(s) Required between 5/1/2016 and 5/31/2016

4 Sample(s) Required between 6/1/2016 and 6/30/2016

4 Sample(s) Required between 7/1/2016 and 7/31/2016

4 Sample(s) Required between 8/1/2016 and 8/31/2016

4 Sample(s) Required between 9/1/2016 and 9/30/2016

4 Sample(s) Required between 10/1/2016 and 10/31/2016

4 Sample(s) Required between 11/1/2016 and 11/30/2016

4 Sample(s) Required between 12/1/2016 and 12/31/2016

**Samples should be collected at the same time and place as the Total Coliform samples.**



**OH5900712 MT GILEAD VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>MT GILEAD DISTRIBUTION</b> <b>900 ORCHARD DRIVE</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

<b>Chemicals</b>	<b>Monitoring Requirements</b>
------------------	--------------------------------

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>MT GILEAD DISTRIBUTION</b> <b>165 FAIRWAY LANE</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

<b>Chemicals</b>	<b>Monitoring Requirements</b>
------------------	--------------------------------

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH5901012 CANDLEWOOD LAKE ASSOCIATION INC**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>5956765</b>	Facility Name: <b>CANDLEWOOD LAKE WTP</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**  
 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
 Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
ARSENIC - 1005	1 Sample(s) Required between 1/1/2016 and 3/31/2016 1 Sample(s) Required between 4/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 9/30/2016 1 Sample(s) Required between 10/1/2016 and 12/31/2016
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH5901012 CANDLEWOOD LAKE ASSOCIATION INC

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: DS1 SMP ID: DS000 Facility Name: CANDLEWOOD LAKE ASSN INC DISTRIBUTI Facility Class: CLASS 1

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2016 and 9/30/2016

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: http://epa.ohio.gov/ddagw/reporting.aspx

TOTAL COLIFORM (TCR) - 3100 2 Sample(s) Required between 1/1/2016 and 1/31/2016 2 Sample(s) Required between 2/1/2016 and 2/29/2016 2 Sample(s) Required between 3/1/2016 and 3/31/2016 2 Sample(s) Required between 4/1/2016 and 4/30/2016 2 Sample(s) Required between 5/1/2016 and 5/31/2016 2 Sample(s) Required between 6/1/2016 and 6/30/2016 2 Sample(s) Required between 7/1/2016 and 7/31/2016 2 Sample(s) Required between 8/1/2016 and 8/31/2016 2 Sample(s) Required between 9/1/2016 and 9/30/2016 2 Sample(s) Required between 10/1/2016 and 10/31/2016 2 Sample(s) Required between 11/1/2016 and 11/30/2016 2 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000 2 Sample(s) Required between 1/1/2016 and 1/31/2016 2 Sample(s) Required between 2/1/2016 and 2/29/2016 2 Sample(s) Required between 3/1/2016 and 3/31/2016 2 Sample(s) Required between 4/1/2016 and 4/30/2016 2 Sample(s) Required between 5/1/2016 and 5/31/2016 2 Sample(s) Required between 6/1/2016 and 6/30/2016 2 Sample(s) Required between 7/1/2016 and 7/31/2016 2 Sample(s) Required between 8/1/2016 and 8/31/2016 2 Sample(s) Required between 9/1/2016 and 9/30/2016 2 Sample(s) Required between 10/1/2016 and 10/31/2016 2 Sample(s) Required between 11/1/2016 and 11/30/2016 2 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: DS1 SMP ID: DS201 Facility Name: CANDLEWOOD LAKE ASSN INC DISTRIBUTI Facility Class: CLASS 1 ADDRESS NOT KNOWN

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

**OH5901012 CANDLEWOOD LAKE ASSOCIATION INC**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Location** Facility ID: **DS1** Facility Name: **CANDLEWOOD LAKE ASSN INC DISTRIBUTIC** Facility Class: **CLASS 1**  
SMP ID: **DS202** ADDRESS NOT KNOWN

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

**OH5931712 CLEARFORK MARINA**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: CLEARFORK MARINA DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

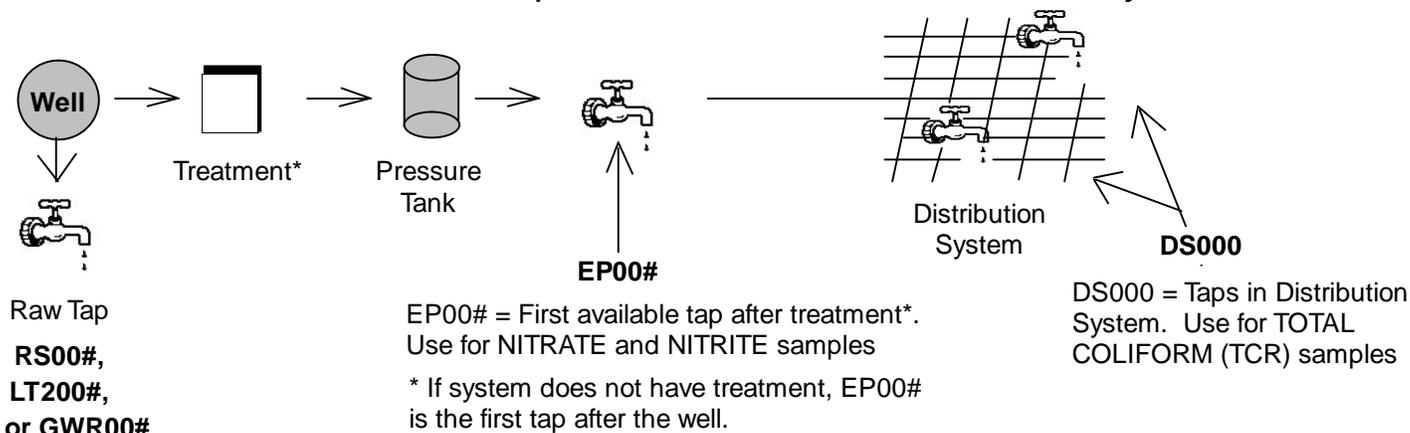

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5931712 CLEARFORK MARINA**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **5956768** Facility Name: **CLEARFORK MARINA**

**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

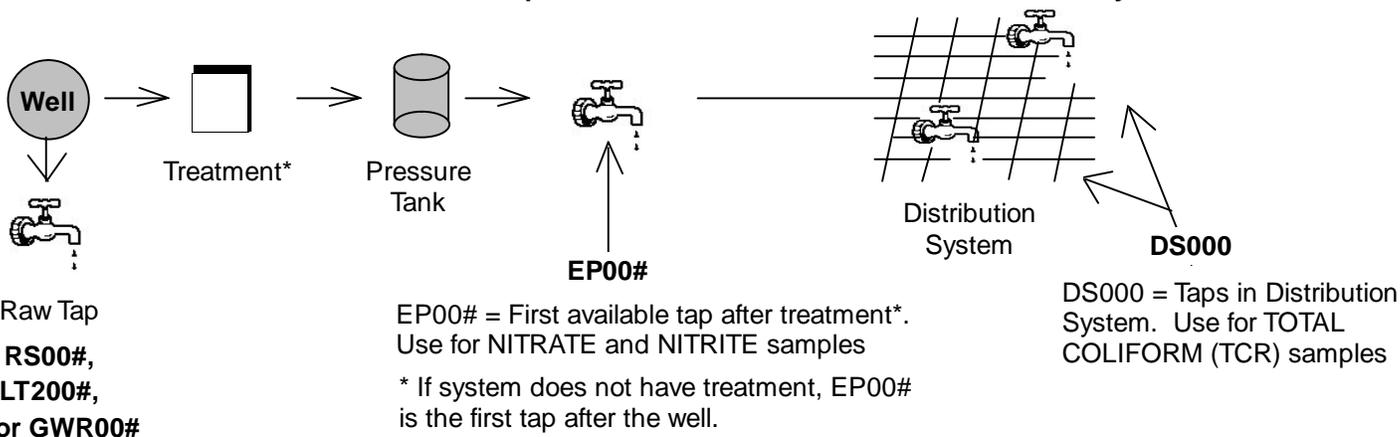

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5931812 CLEARFORK CAMPGROUND**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: CLEARFORK CAMPGROUND DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

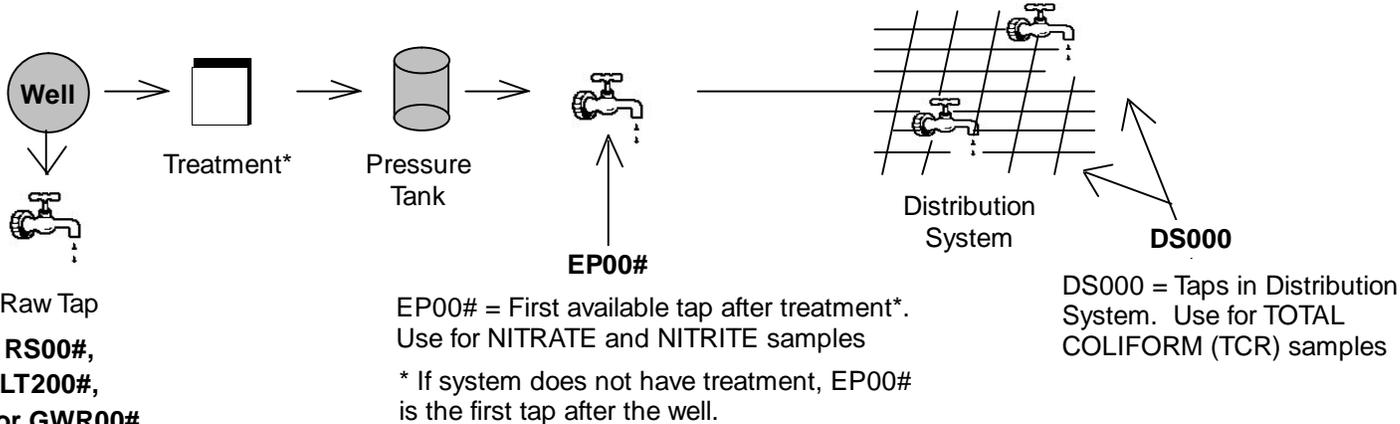

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5931812 CLEARFORK CAMPGROUND**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **5956769** Facility Name: **CLEARFORK CAMPGROUND**

**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

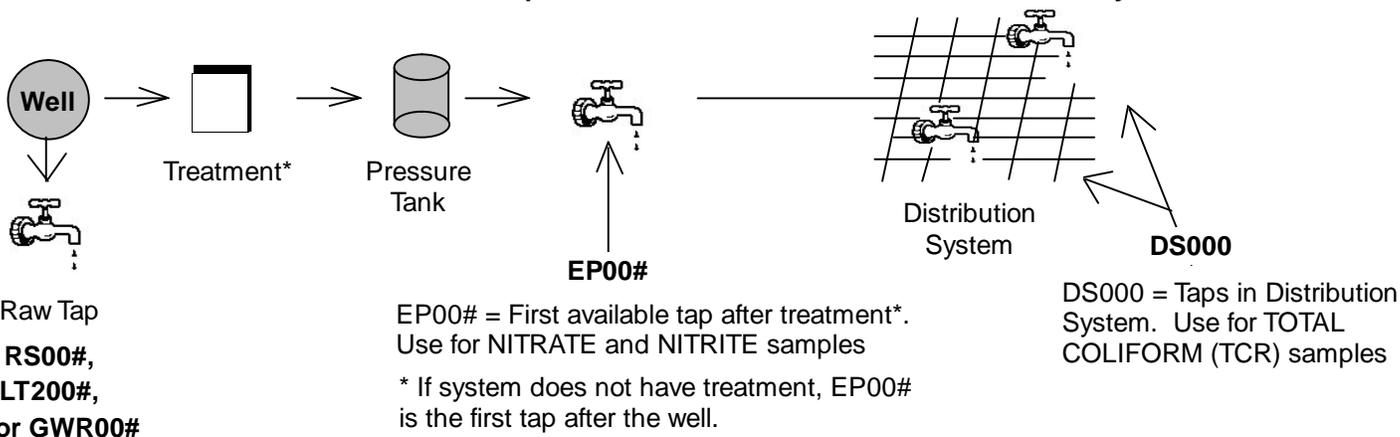

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5935712 MID-OHIO SPORTS MAINTENANCE**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: MID-OHIO SPORTS MAINTENA DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

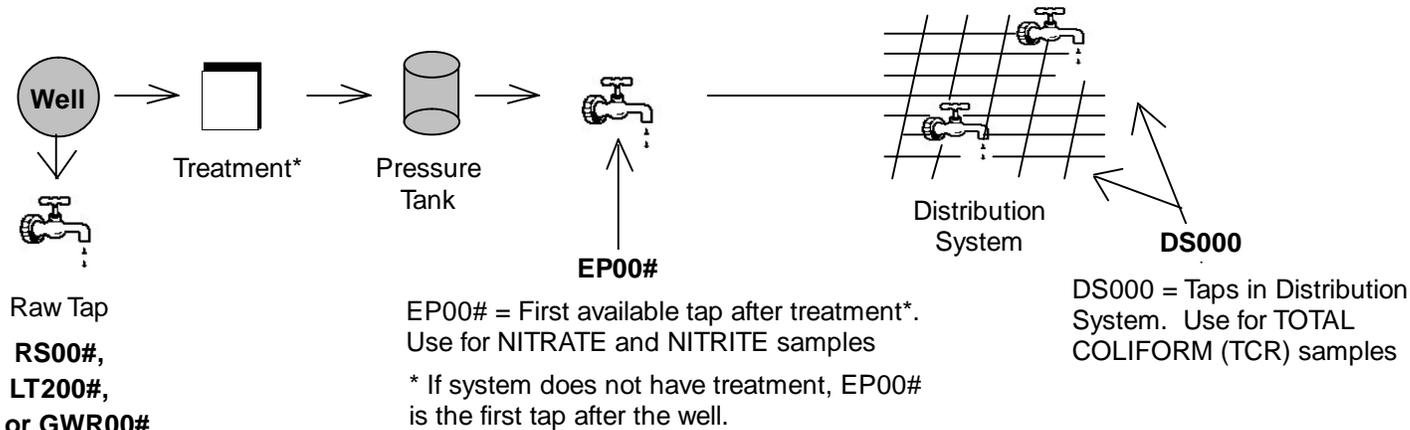

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5935712 MID-OHIO SPORTS MAINTENANCE**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **5956779** Facility Name: **MID-OHIO SPORTS MAINTENANCE**

**Location** SMP ID: **EP001** Facility Source: **Ground Water**

**Chemicals**

**Monitoring Requirements**


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

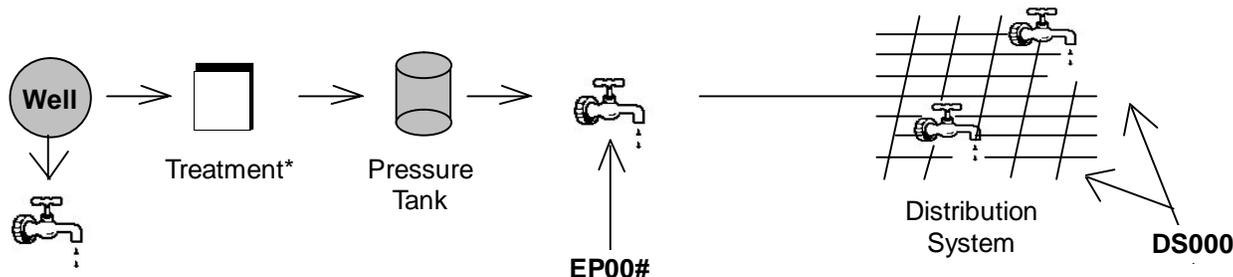

Raw Tap  
**RS00#,**  
**LT200#,**  
or **GWR00#**

EP00# = First available tap after treatment\*.  
Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00#  
is the first tap after the well.

DS000 = Taps in Distribution  
System. Use for TOTAL  
COLIFORM (TCR) samples

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5935812 MID-OHIO SPORTS TOWER**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: MID-OHIO SPORTS/TOWER DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

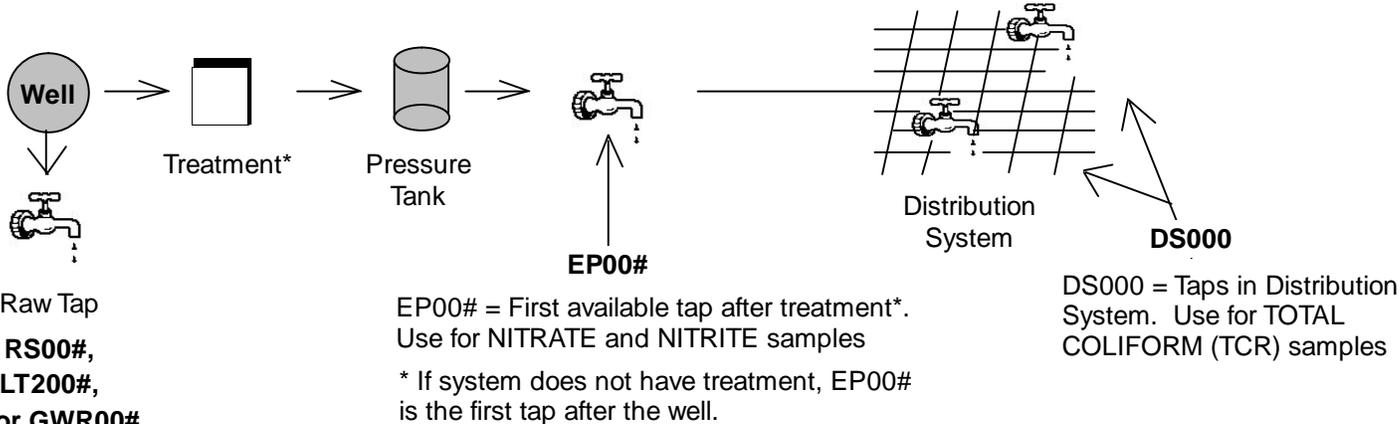

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5935812 MID-OHIO SPORTS TOWER**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **5956780** Facility Name: **MID-OHIO SPORTS/TOWER**

**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

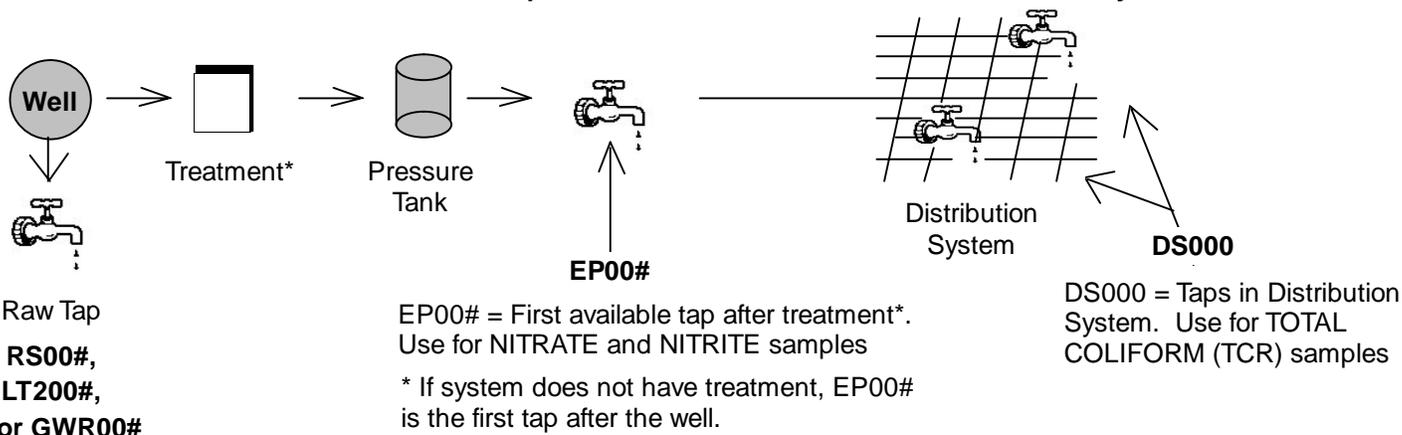

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



Effective Date: 01/01/2016

2016 ENTRY POINT SCHEDULE

**OH5936212 NORTHMOR ADMINISTRATIVE OFFICE**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>5956783</b>	Facility Name: <b>NORTHMOR ADMINISTRATIVE OFFICE</b>
<b>Location</b>	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b> Facility Class: <b>CLASS A</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

**OH5936212 NORTHMOR ADMINISTRATIVE OFFICE**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Location** Facility ID: **DS1** Facility Name: **NORTHMOR ADMIN. OFFICE DISTRIBUTUTIO**  
SMP ID: **DS000**

**Chemicals**

**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022

Not Required

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between 1/1/2016 and 3/31/2016  
1 Sample(s) Required between 4/1/2016 and 6/30/2016  
1 Sample(s) Required between 7/1/2016 and 9/30/2016  
1 Sample(s) Required between 10/1/2016 and 12/31/2016

**OH5936412 OHIO RETREAT CENTER**

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **5956785** Facility Name: **OHIO RETREAT CENTER**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

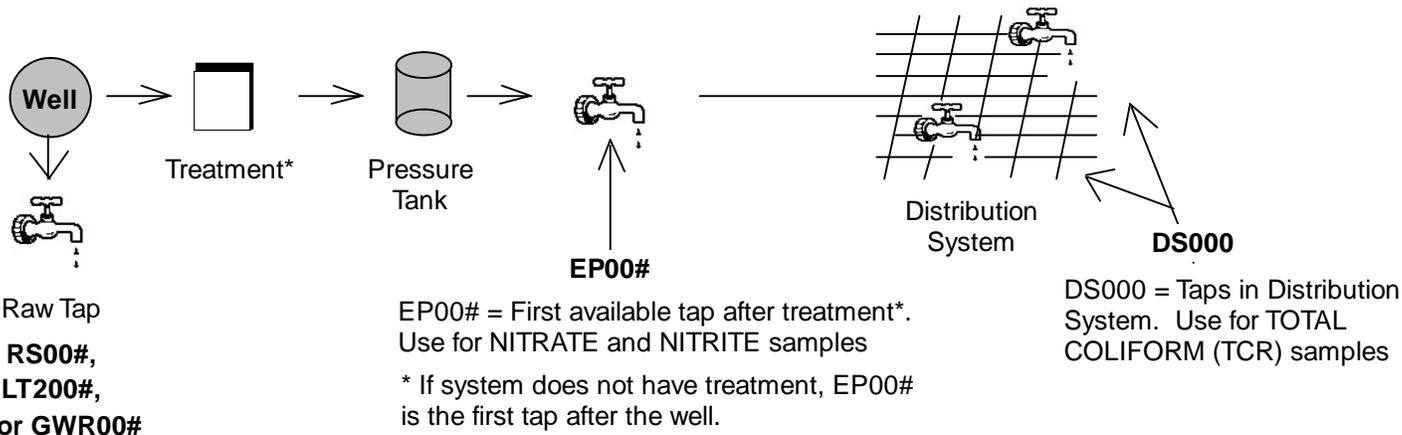

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5936712 PLEASANT GROVE CHURCH OF CHRIST**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: PLEASANT GROVE CHURCH OF DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

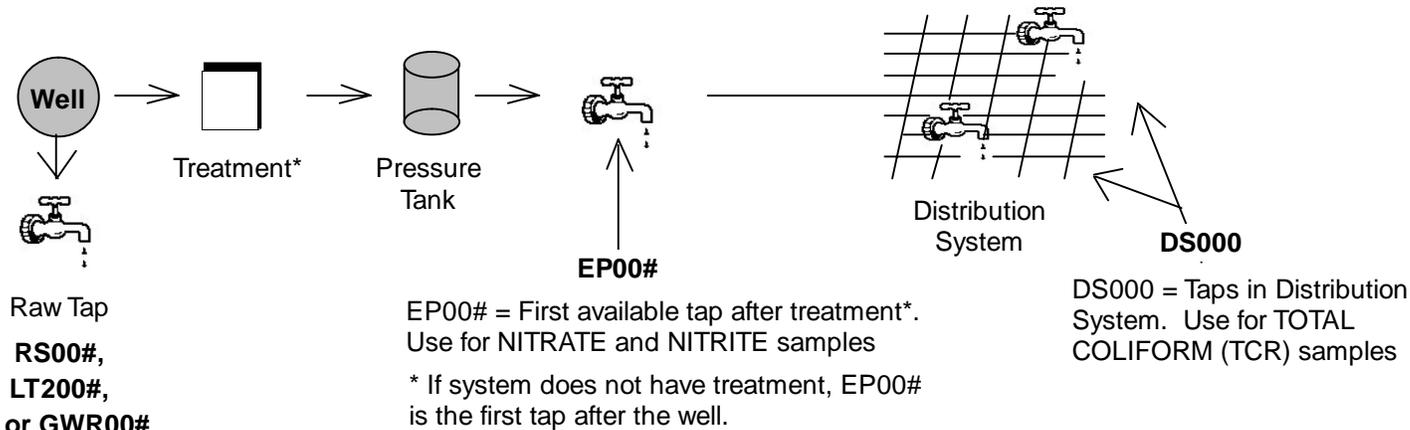

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5936712 PLEASANT GROVE CHURCH OF CHRIST**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID: 5956788</b>	<b>Facility Name: PLEASANT GROVE CHURCH OF CHRST</b>
<b>Location SMP ID: EP001</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

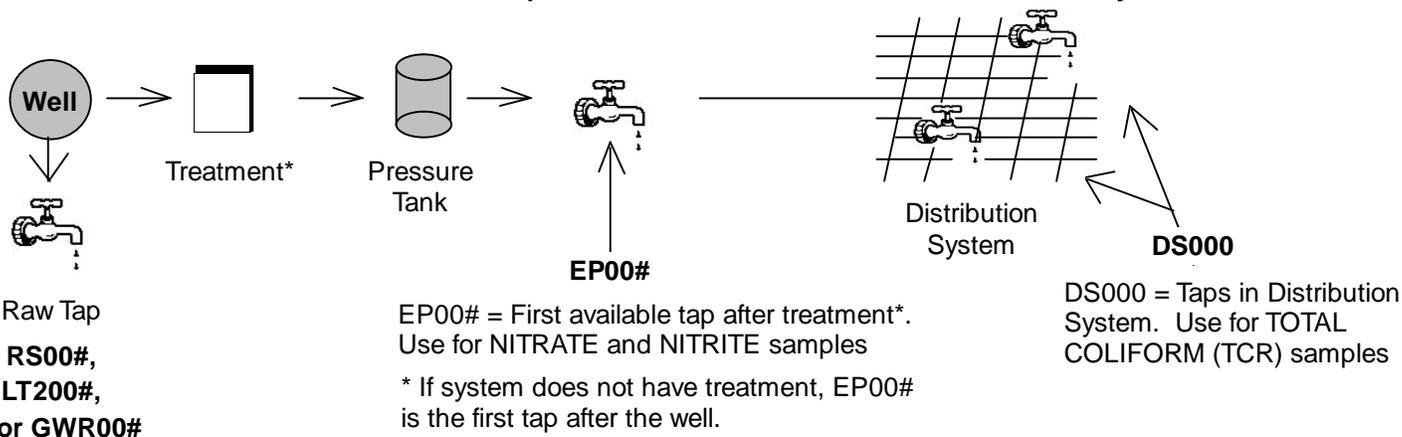

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5941112 SYCAMORE CREEK GOLF COURSE POOL PWS**

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID: 5956804</b>	<b>Facility Name: SYCAMORE CREEK GOLF COURSE POOL</b>
<b>Location SMP ID: EP001</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

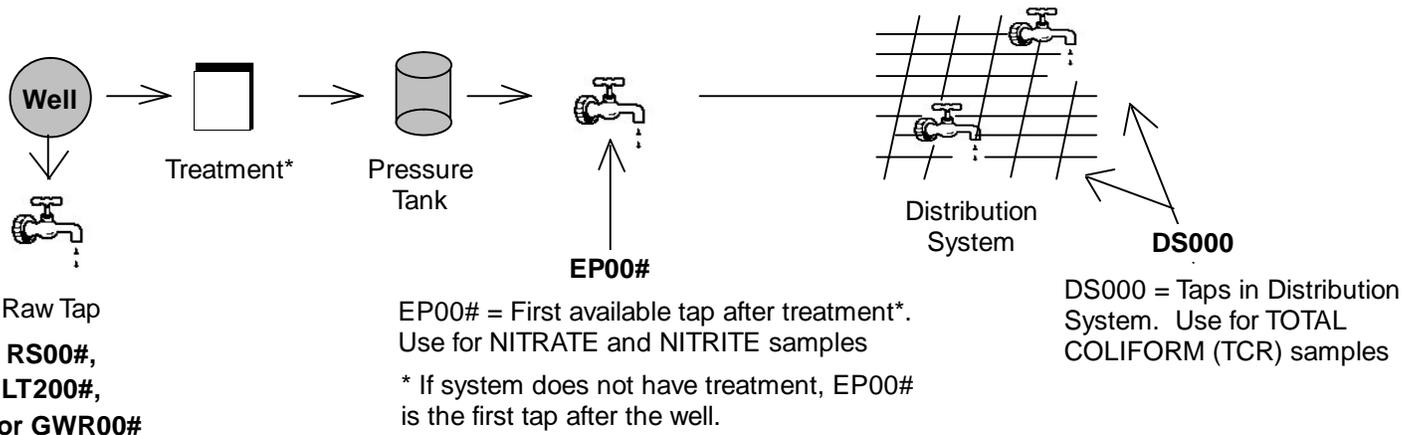

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5941222 SYCAMORE CREEK GOLF COURSE LODGE PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: SYCAMORE CREEK GOLF COURSE LODG DIST</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

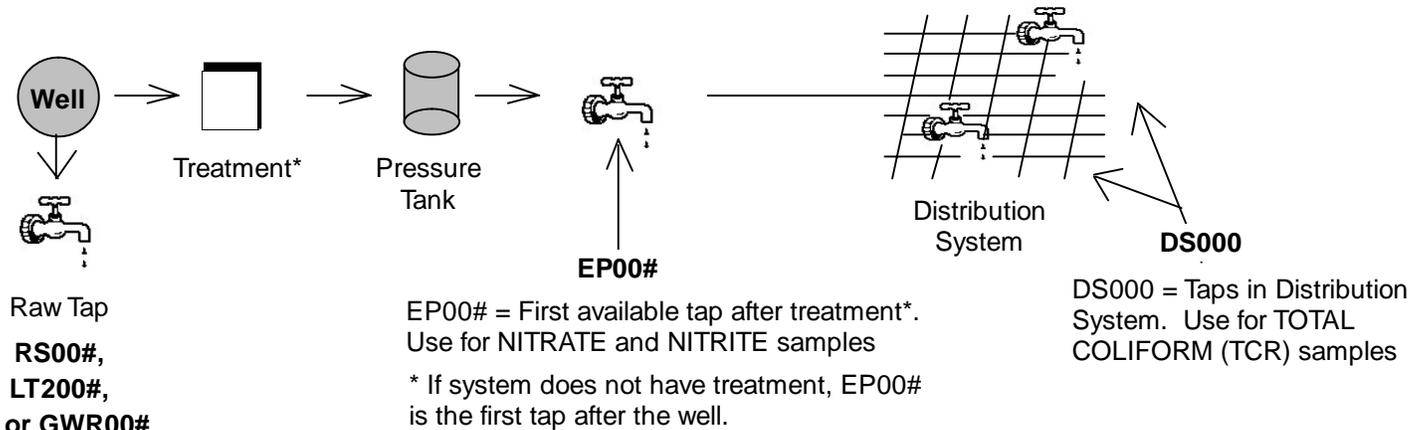

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5941222 SYCAMORE CREEK GOLF COURSE LODGE PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID: 5956805</b>	<b>Facility Name: SYCAMORE CREEK GOLF COURSE LODGE</b>
<b>Location SMP ID: EP001</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

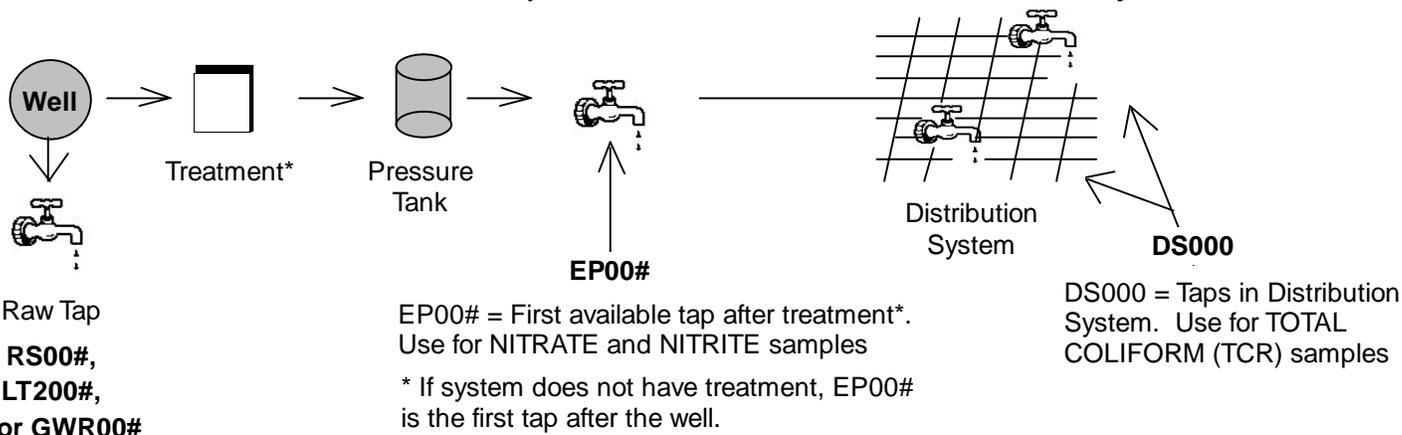

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5941912 GRANT GALBRAITH MD, INC. PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: GRANT GALBRAITH MD, INC. DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

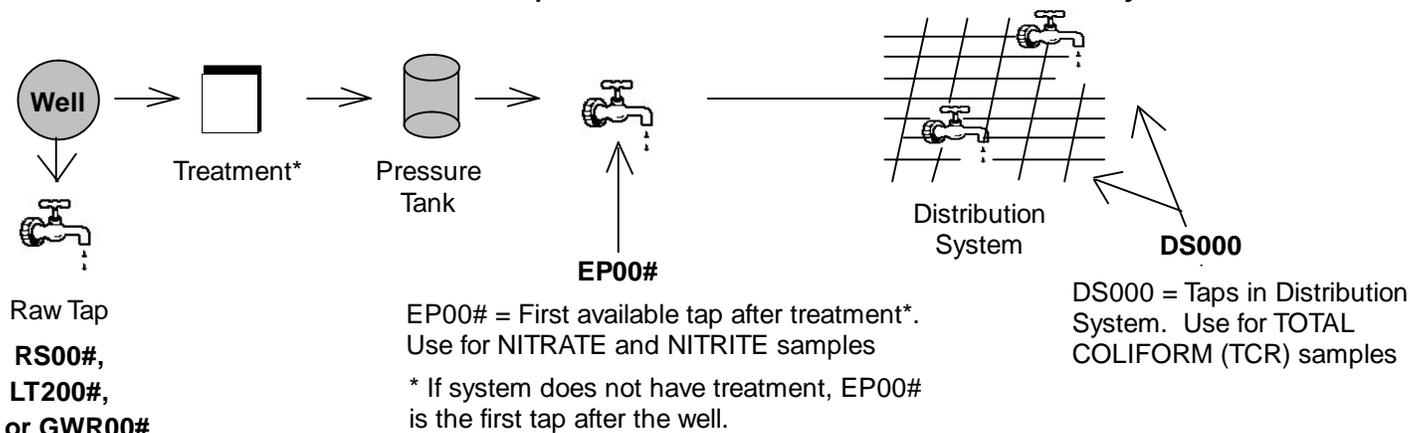

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5941912 GRANT GALBRAITH MD, INC. PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **5961626** Facility Name: **GRANT GALBRAITH MD, INC.**

**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

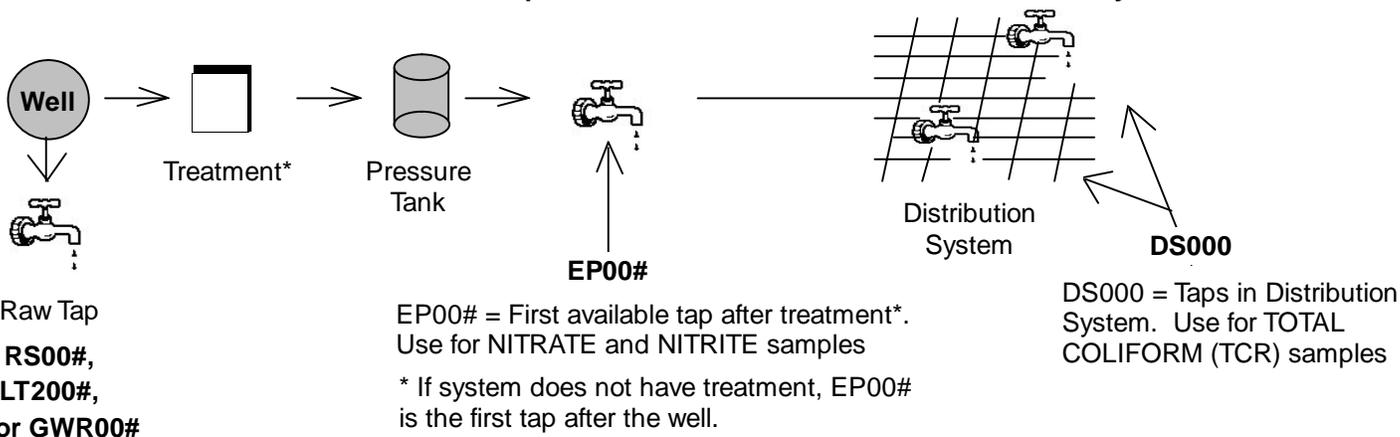

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5942012 NORTHFIELD MEDICAL BLDG PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: NORTHFIELD MEDICAL BLDG DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

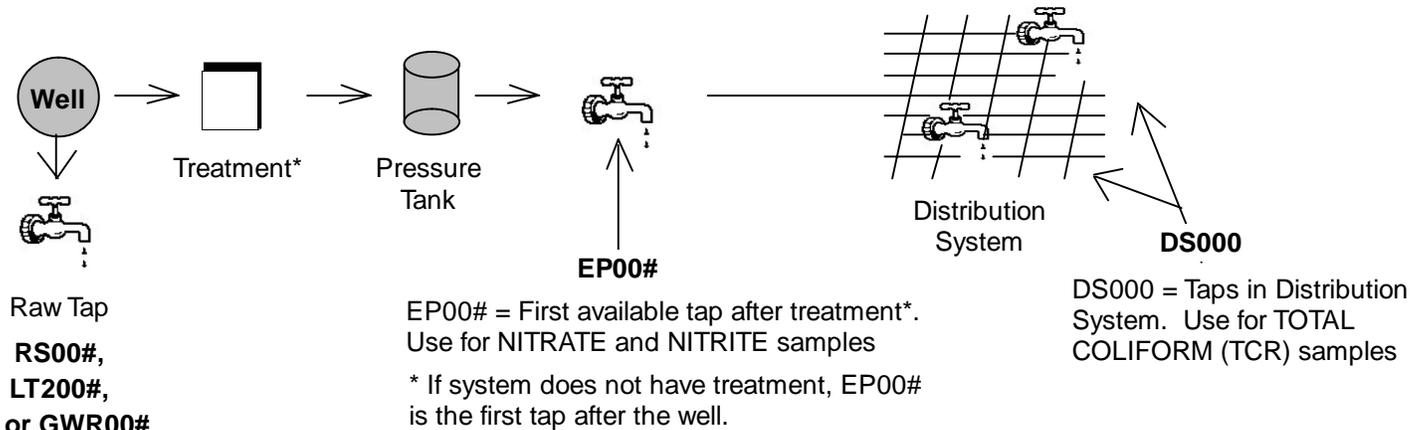

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5942012 NORTHFIELD MEDICAL BLDG PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **5961627** Facility Name: **NORTHFIELD MEDICAL BLDG**

**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

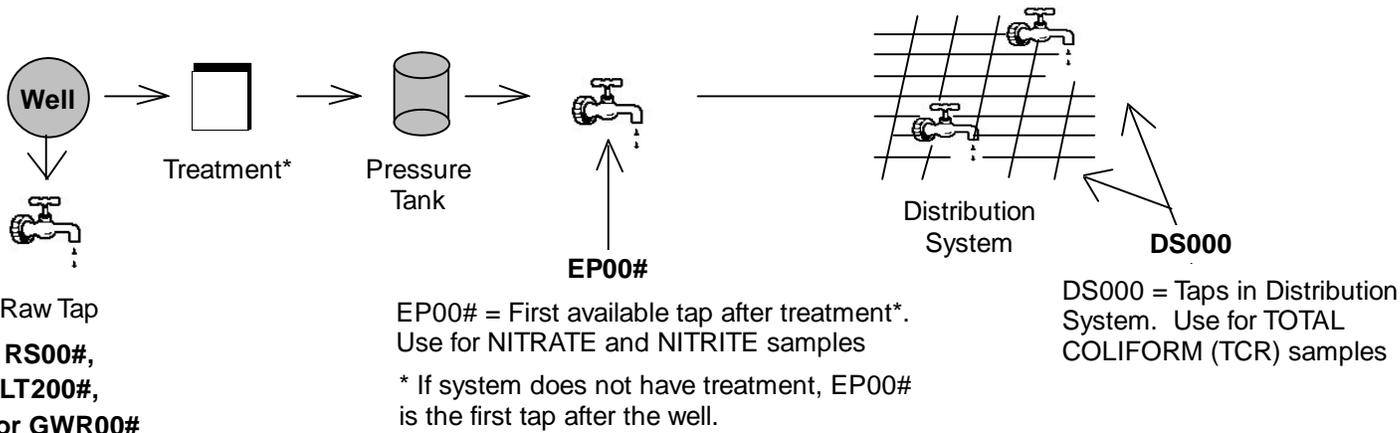

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5942212 FRESH FAITH COMMUNITY CHURCH PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: FRESH FAITH COMM CHURCH DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

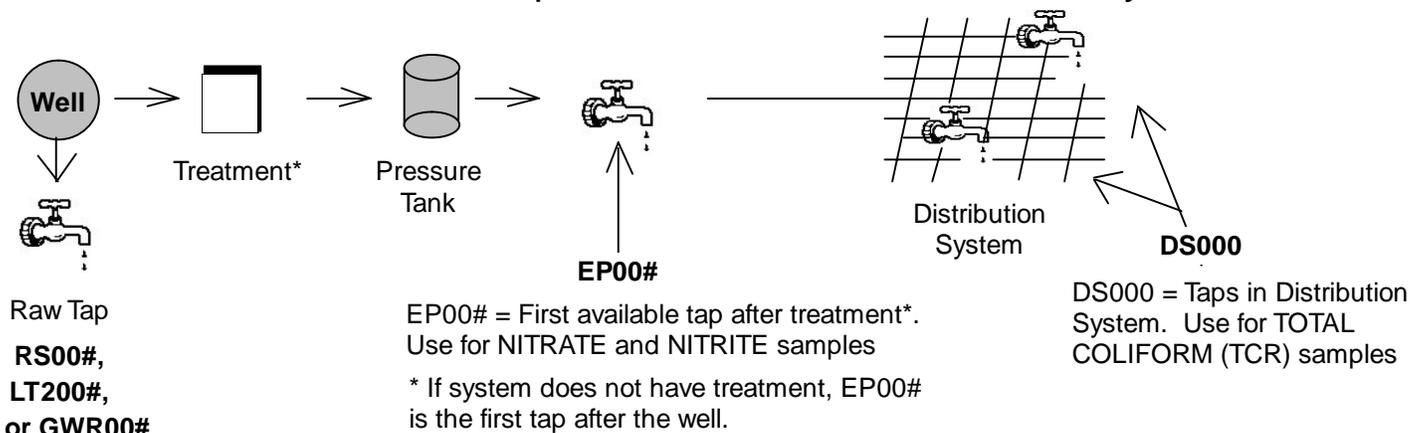

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5942212 FRESH FAITH COMMUNITY CHURCH PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b> Facility ID: <b>5962148</b>	Facility Name: <b>FRESH FAITH COMMUNITY CHURCH</b>
<b>Location</b> SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

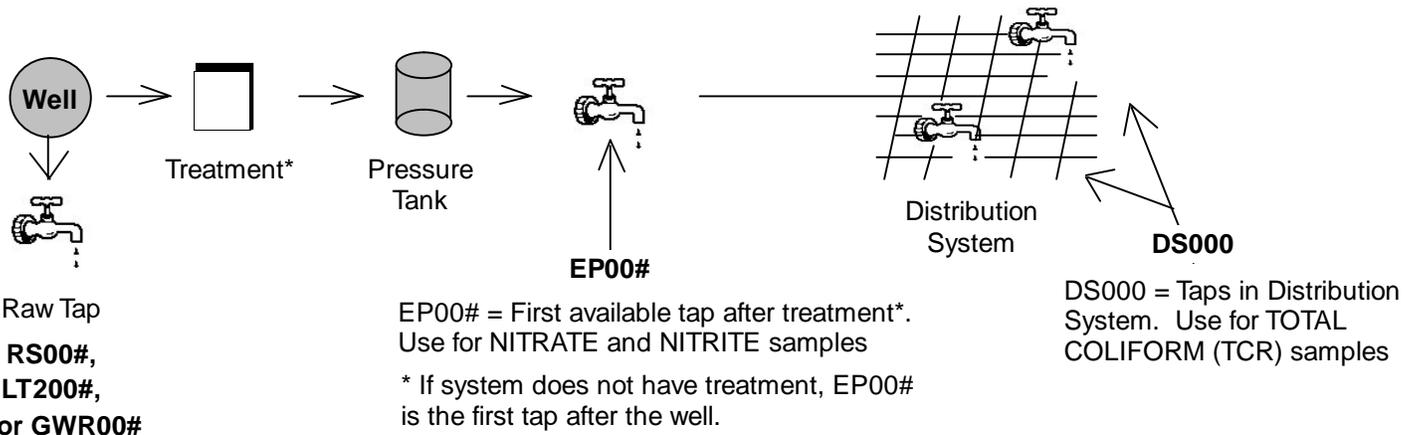

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5942312 YODERS COUNTRY DINER**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> YODERS COUNTRY DINER DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

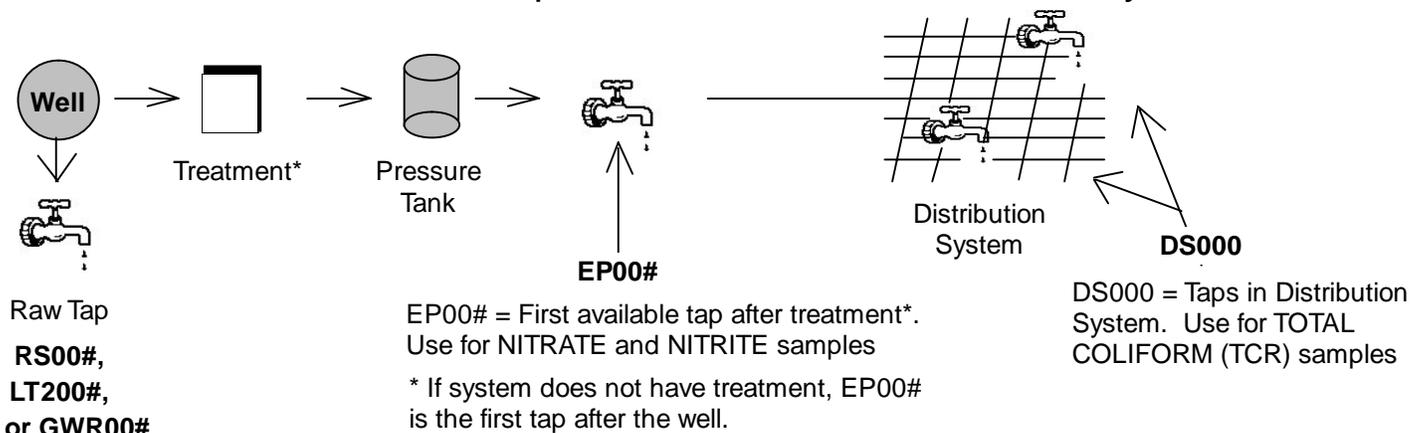

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5942312 YODERS COUNTRY DINER**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **5962248** Facility Name: **YODERS COUNTRY DINER**

**Location** SMP ID: **EP001** Facility Source: **Ground Water**

**Chemicals**

**Monitoring Requirements**


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

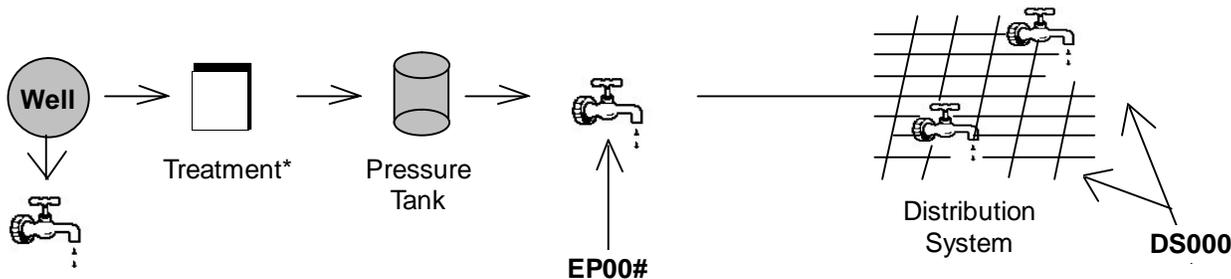

Raw Tap  
**RS00#,**  
**LT200#,**  
 or **GWR00#**

EP00# = First available tap after treatment\*.  
 Use for NITRATE and NITRITE samples  
 \* If system does not have treatment, EP00#  
 is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5942512 PENIEL BIBLE CAMP PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> PENIEL BIBLE CAMP DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

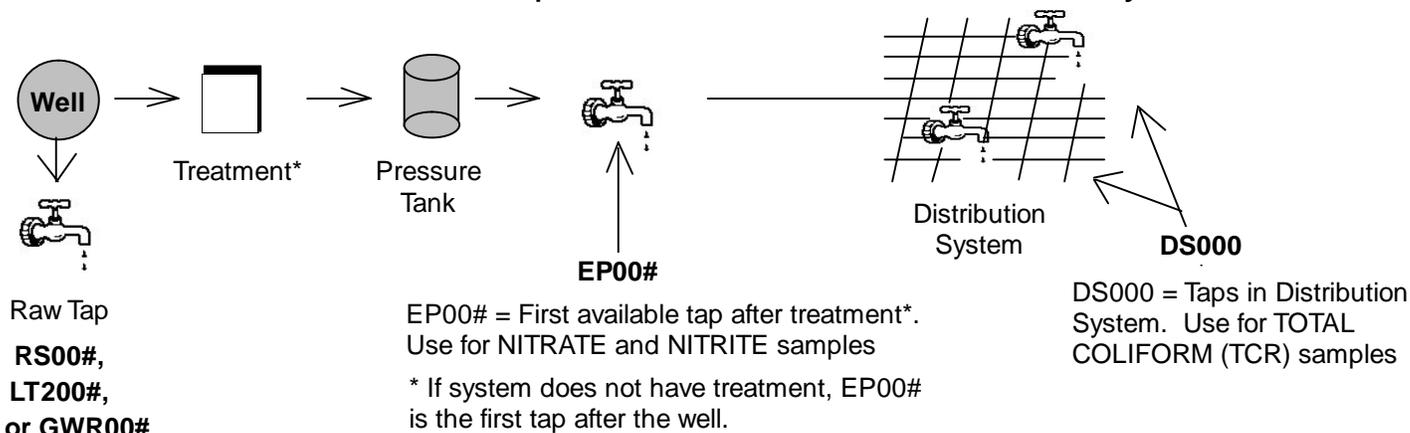

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5942512 PENIEL BIBLE CAMP PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **5962264** Facility Name: **PENIEL BIBLE CAMP**

**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

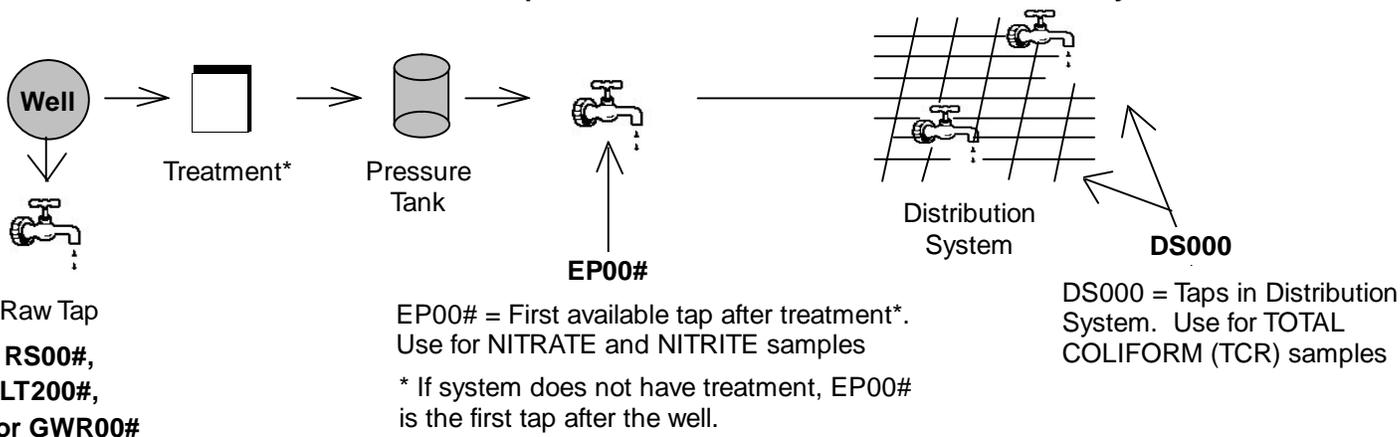

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5942612 HIGHLAND PIZZA AND ICE CREAM PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: HIGHLAND PIZZA AND ICE CREAM DISTRIBUTIO</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

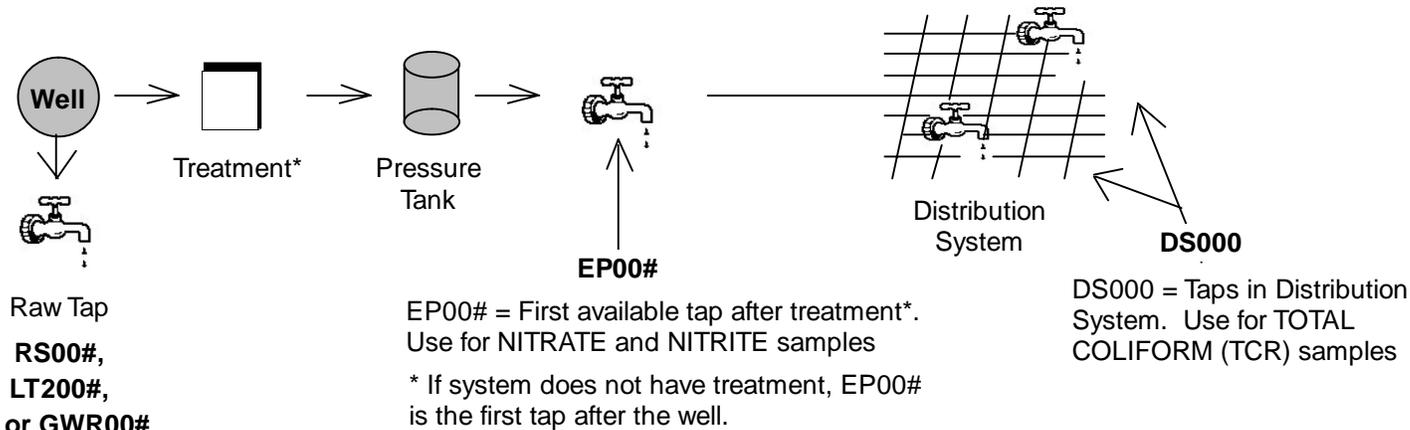

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5942612 HIGHLAND PIZZA AND ICE CREAM PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **5962265** Facility Name: **HIGHLAND PIZZA AND ICE CREAM**

**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

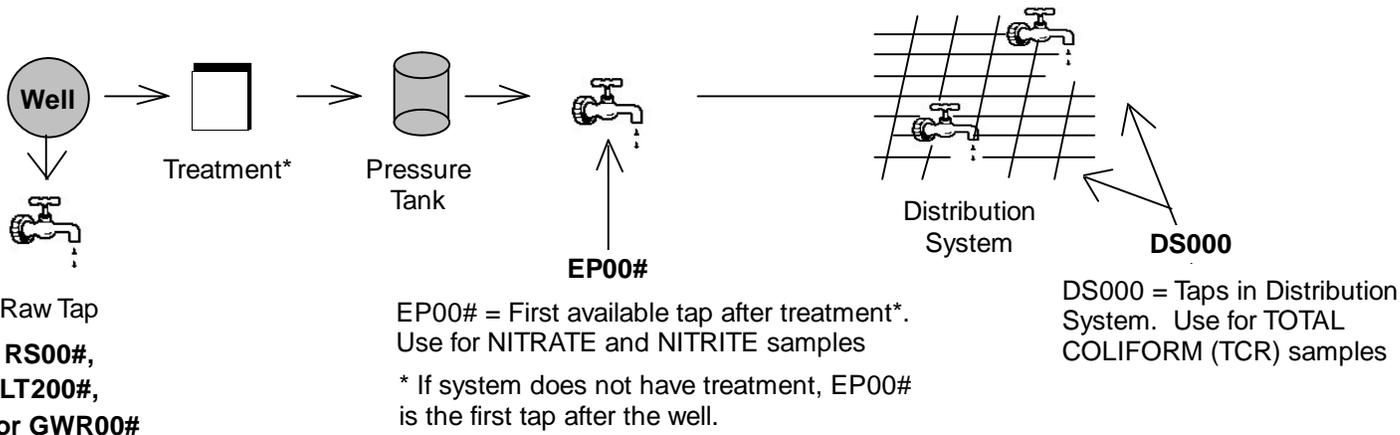

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH5942712 NORTHMOR SCHOOL PWS**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>5962375</b>	Facility Name: <b>NORTHMOR SCHOOL</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**  
 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
 Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
ARSENIC - 1005	1 Sample(s) Required between 1/1/2016 and 3/31/2016 1 Sample(s) Required between 4/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 9/30/2016 1 Sample(s) Required between 10/1/2016 and 12/31/2016
INORGANICS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTA CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2016 and 10/31/2016



**OH5942712 NORTHMOR SCHOOL PWS**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>NORTHMOR SCHOOL DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**Chemicals Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2016 and 9/30/2016

*Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>*

TOTAL COLIFORM (TCR) - 3100

2 Sample(s) Required between 1/1/2016 and 1/31/2016

2 Sample(s) Required between 2/1/2016 and 2/29/2016

2 Sample(s) Required between 3/1/2016 and 3/31/2016

2 Sample(s) Required between 4/1/2016 and 4/30/2016

2 Sample(s) Required between 5/1/2016 and 5/31/2016

2 Sample(s) Required between 6/1/2016 and 6/30/2016

2 Sample(s) Required between 7/1/2016 and 7/31/2016

2 Sample(s) Required between 8/1/2016 and 8/31/2016

2 Sample(s) Required between 9/1/2016 and 9/30/2016

2 Sample(s) Required between 10/1/2016 and 10/31/2016

2 Sample(s) Required between 11/1/2016 and 11/30/2016

2 Sample(s) Required between 12/1/2016 and 12/31/2016

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>NORTHMOR SCHOOL DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/8/2016 and 7/14/2016 at SMP: DS201  
1 Sample(s) Required between 10/8/2016 and 10/14/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>NORTHMOR SCHOOL DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/8/2016 and 7/14/2016 at SMP: DS202  
1 Sample(s) Required between 10/8/2016 and 10/14/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH5942713 CARDINGTON LINCOLN HIGH SCHOOL**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2016 and 9/30/2016
-------------------------------	--

*Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>*

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS202
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

**OH5942714 MID-OHIO SPORTS INFIELD PWS**

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1 Facility Name: DISTRIBUTION**  
**Location SMP ID: DS000 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 9/30/2016

**Where to Collect Samples For a Small Public Water System**

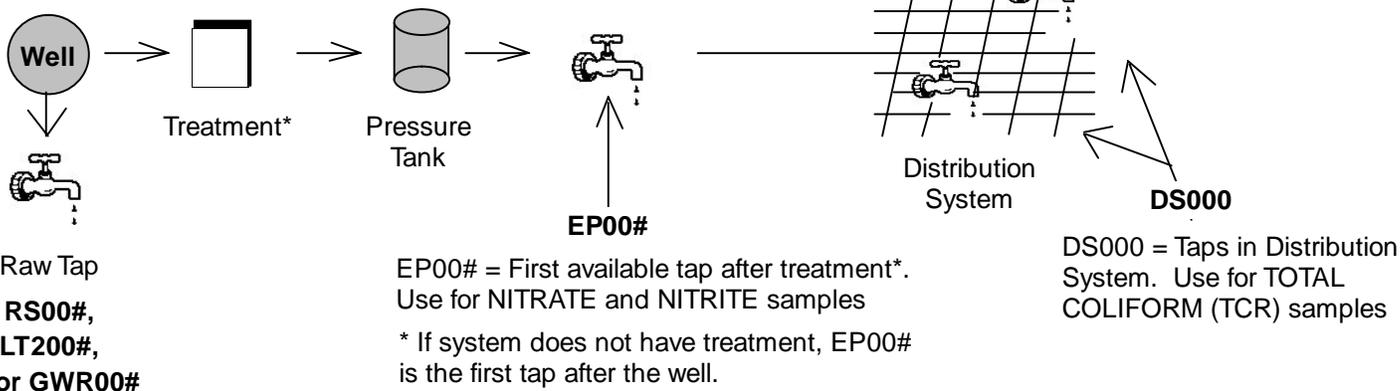

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5942714 MID-OHIO SPORTS INFIELD PWS**

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: 5962377 Facility Name: MID-OHIO SPORTS INFIELD

**Location** SMP ID: EP001 Facility Source: Ground Water

**Chemicals**

**Monitoring Requirements**


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

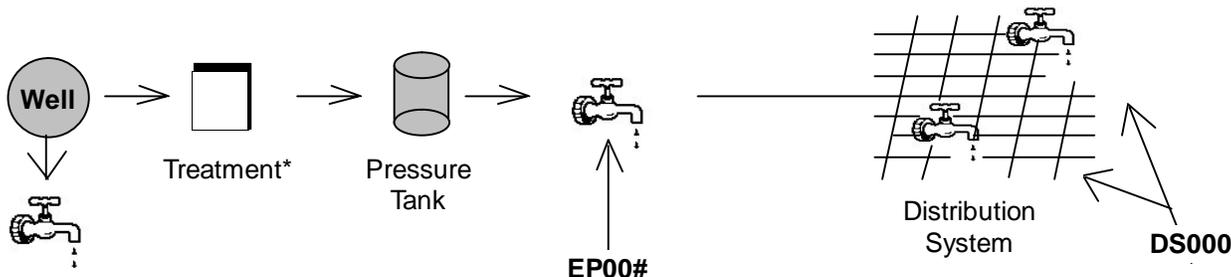

Raw Tap  
**RS00#,**  
**LT200#,**  
or **GWR00#**

EP00# = First available tap after treatment\*.  
Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00#  
is the first tap after the well.

DS000 = Taps in Distribution  
System. Use for TOTAL  
COLIFORM (TCR) samples

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**