



OH8100112 CONVOY VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 8159421	Facility Name: CONVOY VILLAGE STU 1	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.
 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
 Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2016 and 10/31/2016



OH8100112 CONVOY VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 8160620 SMP ID: EP002	Facility Name: CONVOY VILLAGE STU 2 Facility Source: Ground Water	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.
 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
 Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
<i>Sample for all the analytes listed below:</i>	
<i>ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085</i>	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
RADIOLOGICALS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2016 and 10/31/2016



OH8100112 CONVOY VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 8162394 SMP ID: EP003	Facility Name: CONVOY VILLAGE STU 3 Facility Source: Ground Water	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2016 and 10/31/2016



OH8100112 CONVOY VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: CONVOY, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2016 and 9/30/2016

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100

2 Sample(s) Required between 1/1/2016 and 1/31/2016

2 Sample(s) Required between 2/1/2016 and 2/29/2016

2 Sample(s) Required between 3/1/2016 and 3/31/2016

2 Sample(s) Required between 4/1/2016 and 4/30/2016

2 Sample(s) Required between 5/1/2016 and 5/31/2016

2 Sample(s) Required between 6/1/2016 and 6/30/2016

2 Sample(s) Required between 7/1/2016 and 7/31/2016

2 Sample(s) Required between 8/1/2016 and 8/31/2016

2 Sample(s) Required between 9/1/2016 and 9/30/2016

2 Sample(s) Required between 10/1/2016 and 10/31/2016

2 Sample(s) Required between 11/1/2016 and 11/30/2016

2 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000

2 Sample(s) Required between 1/1/2016 and 1/31/2016

2 Sample(s) Required between 2/1/2016 and 2/29/2016

2 Sample(s) Required between 3/1/2016 and 3/31/2016

2 Sample(s) Required between 4/1/2016 and 4/30/2016

2 Sample(s) Required between 5/1/2016 and 5/31/2016

2 Sample(s) Required between 6/1/2016 and 6/30/2016

2 Sample(s) Required between 7/1/2016 and 7/31/2016

2 Sample(s) Required between 8/1/2016 and 8/31/2016

2 Sample(s) Required between 9/1/2016 and 9/30/2016

2 Sample(s) Required between 10/1/2016 and 10/31/2016

2 Sample(s) Required between 11/1/2016 and 11/30/2016

2 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: CONVOY, VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 9/1/2016 and 9/7/2016 at SMP: DS201



OH8100112 CONVOY VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: CONVOY, VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 12/1/2016 and 12/7/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: CONVOY, VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 9/1/2016 and 9/7/2016 at SMP: DS202
1 Sample(s) Required between 12/1/2016 and 12/7/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH8100312 MIDDLE POINT VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 8162463	Facility Name: MIDDLE POINT NEW WTP 2	Facility Class: CLASS 1
	SMP ID: EP002	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
RADIOLOGICALS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 10/1/2016 and 12/31/2016



OH8100312 MIDDLE POINT VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **MIDDLE POINT, VILLAGE OF DISTRIBUTION** Facility Class: **CLASS 1**
SMP ID: **DS000**

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

TOTAL COLIFORM (TCR) - 3100
1 Sample(s) Required between 1/1/2016 and 1/31/2016
1 Sample(s) Required between 2/1/2016 and 2/29/2016
1 Sample(s) Required between 3/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 4/30/2016
1 Sample(s) Required between 5/1/2016 and 5/31/2016
1 Sample(s) Required between 6/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 7/31/2016
1 Sample(s) Required between 8/1/2016 and 8/31/2016
1 Sample(s) Required between 9/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 10/31/2016
1 Sample(s) Required between 11/1/2016 and 11/30/2016
1 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000
1 Sample(s) Required between 1/1/2016 and 1/31/2016
1 Sample(s) Required between 2/1/2016 and 2/29/2016
1 Sample(s) Required between 3/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 4/30/2016
1 Sample(s) Required between 5/1/2016 and 5/31/2016
1 Sample(s) Required between 6/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 7/31/2016
1 Sample(s) Required between 8/1/2016 and 8/31/2016
1 Sample(s) Required between 9/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 10/31/2016
1 Sample(s) Required between 11/1/2016 and 11/30/2016
1 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: **DS1** Facility Name: **MIDDLE POINT, VILLAGE OF DISTRIBUTION** Facility Class: **CLASS 1**
SMP ID: **DS201** **507 EASTVIEW ST**

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS
1 Sample(s) Required between 3/1/2016 and 3/7/2016 at SMP: DS201
1 Sample(s) Required between 6/1/2016 and 6/7/2016 at SMP: DS201
1 Sample(s) Required between 9/1/2016 and 9/7/2016 at SMP: DS201
1 Sample(s) Required between 12/1/2016 and 12/7/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

OH8100312 MIDDLE POINT VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: MIDDLE POINT, VILLAGE OF DISTRIBUTION 103 N ADAMS ST	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 3/1/2016 and 3/7/2016 at SMP: DS202
	1 Sample(s) Required between 6/1/2016 and 6/7/2016 at SMP: DS202
	1 Sample(s) Required between 9/1/2016 and 9/7/2016 at SMP: DS202
	1 Sample(s) Required between 12/1/2016 and 12/7/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH8100412 OHIO CITY VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 8161766	Facility Name: OHIO CITY WTP -NEW PLANT	Facility Class: CLASS 1
	SMP ID: EP003	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
RADIOLOGICALS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2016 and 10/31/2016



OH8100412 OHIO CITY VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: OHIO CITY, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2016 and 9/30/2016

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between 1/1/2016 and 1/31/2016

1 Sample(s) Required between 2/1/2016 and 2/29/2016

1 Sample(s) Required between 3/1/2016 and 3/31/2016

1 Sample(s) Required between 4/1/2016 and 4/30/2016

1 Sample(s) Required between 5/1/2016 and 5/31/2016

1 Sample(s) Required between 6/1/2016 and 6/30/2016

1 Sample(s) Required between 7/1/2016 and 7/31/2016

1 Sample(s) Required between 8/1/2016 and 8/31/2016

1 Sample(s) Required between 9/1/2016 and 9/30/2016

1 Sample(s) Required between 10/1/2016 and 10/31/2016

1 Sample(s) Required between 11/1/2016 and 11/30/2016

1 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000

1 Sample(s) Required between 1/1/2016 and 1/31/2016

1 Sample(s) Required between 2/1/2016 and 2/29/2016

1 Sample(s) Required between 3/1/2016 and 3/31/2016

1 Sample(s) Required between 4/1/2016 and 4/30/2016

1 Sample(s) Required between 5/1/2016 and 5/31/2016

1 Sample(s) Required between 6/1/2016 and 6/30/2016

1 Sample(s) Required between 7/1/2016 and 7/31/2016

1 Sample(s) Required between 8/1/2016 and 8/31/2016

1 Sample(s) Required between 9/1/2016 and 9/30/2016

1 Sample(s) Required between 10/1/2016 and 10/31/2016

1 Sample(s) Required between 11/1/2016 and 11/30/2016

1 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: OHIO CITY, VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

OH8100412 OHIO CITY VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: OHIO CITY, VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH8100611 VAN WERT CITY

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 8159424	Facility Name: VAN WERT CITY	Facility Class: CLASS 3
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020	
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 1/31/2016 1 Sample(s) Required between 2/1/2016 and 2/29/2016 1 Sample(s) Required between 3/1/2016 and 3/31/2016 1 Sample(s) Required between 4/1/2016 and 4/30/2016 1 Sample(s) Required between 5/1/2016 and 5/31/2016 1 Sample(s) Required between 6/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 7/31/2016 1 Sample(s) Required between 8/1/2016 and 8/31/2016 1 Sample(s) Required between 9/1/2016 and 9/30/2016 1 Sample(s) Required between 10/1/2016 and 10/31/2016 1 Sample(s) Required between 11/1/2016 and 11/30/2016 1 Sample(s) Required between 12/1/2016 and 12/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2016 and 4/30/2016 1 Sample(s) Required between 5/1/2016 and 5/31/2016 1 Sample(s) Required between 6/1/2016 and 6/30/2016
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2016 and 10/31/2016
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 1/1/2016 and 1/31/2016 1 Paired Sample Set Required between 2/1/2016 and 2/29/2016 1 Paired Sample Set Required between 3/1/2016 and 3/31/2016 1 Paired Sample Set Required between 4/1/2016 and 4/30/2016 1 Paired Sample Set Required between 5/1/2016 and 5/31/2016 1 Paired Sample Set Required between 6/1/2016 and 6/30/2016 1 Paired Sample Set Required between 7/1/2016 and 7/31/2016 1 Paired Sample Set Required between 8/1/2016 and 8/31/2016 1 Paired Sample Set Required between 9/1/2016 and 9/30/2016 1 Paired Sample Set Required between 10/1/2016 and 10/31/2016 1 Paired Sample Set Required between 11/1/2016 and 11/30/2016 1 Paired Sample Set Required between 12/1/2016 and 12/31/2016

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



Effective Date: 10/14/2016

2016 ENTRY POINT SCHEDULE

OH8100611 VAN WERT CITY

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 8159424	Facility Name: VAN WERT CITY	Facility Class: CLASS 3
	SMP ID: EP001/LT2001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
TOTAL MICROCYSTINS	1 Sample Set Required WEEKLY starting June 5

Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. Both are required every week from January 1 to December 31 (reduced monitoring available from November to April). A week is defined as Sunday through Saturday. Samples must be analyzed at a lab accepted by Ohio EPA for microcystins analysis.



OH8100611 VAN WERT CITY

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 8159424 SMP ID: LT2001	Facility Name: VAN WERT CITY Facility Source: Surface Water	Facility Class: CLASS 3
--------------------------	--	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
CYANOBACTERIA SCREENING	1 Sample(s) Required between 6/5/2016 and 6/11/2016
	1 Sample(s) Required between 6/19/2016 and 6/25/2016
	1 Sample(s) Required between 7/3/2016 and 7/9/2016
	1 Sample(s) Required between 7/17/2016 and 7/23/2016
	1 Sample(s) Required between 7/31/2016 and 8/6/2016
	1 Sample(s) Required between 8/14/2016 and 8/20/2016
	1 Sample(s) Required between 8/28/2016 and 9/3/2016
	1 Sample(s) Required between 9/11/2016 and 9/17/2016
	1 Sample(s) Required between 9/25/2016 and 10/1/2016
	1 Sample(s) Required between 10/9/2016 and 10/15/2016
	1 Sample(s) Required between 10/23/2016 and 10/29/2016
	1 Sample(s) Required between 11/6/2016 and 11/12/2016
	1 Sample(s) Required between 11/20/2016 and 11/26/2016
	1 Sample(s) Required between 12/4/2016 and 12/10/2016
	1 Sample(s) Required between 12/18/2016 and 12/24/2016

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 and must be collected at the same time as the raw total microcystins sample. SAMPLES MUST BE SHIPPED OVERNIGHT ON ICE ON THE DAY OF COLLECTION AND ARRIVE AT OHIO EPA DIVISION OF ENVIRONMENTAL SERVICES BY NOON MONDAY THROUGH THURSDAY ONLY!

LT2 MONITORING	1 Sample(s) Required between 10/3/2016 and 10/7/2016
	1 Sample(s) Required between 10/17/2016 and 10/21/2016
	1 Sample(s) Required between 10/31/2016 and 11/4/2016
	1 Sample(s) Required between 11/14/2016 and 11/18/2016
	1 Sample(s) Required between 12/5/2016 and 12/9/2016
	1 Sample(s) Required between 12/19/2016 and 12/23/2016

Monitor for: Cryptosporidium - 2078, E-coli count - 3014, Turbidity - 0100

LT2 MATRIX SPIKE SAMPLE	1 Sample(s) Required between 10/3/2016 and 10/7/2016
-------------------------	--



OH8100611 VAN WERT CITY

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: VAN WERT CITY DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 30 Sample(s) Required between 6/1/2016 and 9/30/2016

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

TOTAL COLIFORM (TCR) - 3100

10 Sample(s) Required between 1/1/2016 and 1/31/2016

10 Sample(s) Required between 2/1/2016 and 2/29/2016

10 Sample(s) Required between 3/1/2016 and 3/31/2016

10 Sample(s) Required between 4/1/2016 and 4/30/2016

10 Sample(s) Required between 5/1/2016 and 5/31/2016

10 Sample(s) Required between 6/1/2016 and 6/30/2016

10 Sample(s) Required between 7/1/2016 and 7/31/2016

10 Sample(s) Required between 8/1/2016 and 8/31/2016

10 Sample(s) Required between 9/1/2016 and 9/30/2016

10 Sample(s) Required between 10/1/2016 and 10/31/2016

10 Sample(s) Required between 11/1/2016 and 11/30/2016

10 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000

10 Sample(s) Required between 1/1/2016 and 1/31/2016

10 Sample(s) Required between 2/1/2016 and 2/29/2016

10 Sample(s) Required between 3/1/2016 and 3/31/2016

10 Sample(s) Required between 4/1/2016 and 4/30/2016

10 Sample(s) Required between 5/1/2016 and 5/31/2016

10 Sample(s) Required between 6/1/2016 and 6/30/2016

10 Sample(s) Required between 7/1/2016 and 7/31/2016

10 Sample(s) Required between 8/1/2016 and 8/31/2016

10 Sample(s) Required between 9/1/2016 and 9/30/2016

10 Sample(s) Required between 10/1/2016 and 10/31/2016

10 Sample(s) Required between 11/1/2016 and 11/30/2016

10 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: VAN WERT CITY DISTRIBUTION WASTEWATER PLANT GATE HYDRA	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 2/8/2016 and 2/14/2016 at SMP: DS201

1 Sample(s) Required between 5/8/2016 and 5/14/2016 at SMP: DS201

1 Sample(s) Required between 8/8/2016 and 8/14/2016 at SMP: DS201



OH8100611 VAN WERT CITY

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: VAN WERT CITY DISTRIBUTION WASTEWATER PLANT GATE HYDRA	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 11/8/2016 and 11/14/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: VAN WERT CITY DISTRIBUTION SOUTH WATER TOWER DRAIN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 2/8/2016 and 2/14/2016 at SMP: DS202

1 Sample(s) Required between 5/8/2016 and 5/14/2016 at SMP: DS202

1 Sample(s) Required between 8/8/2016 and 8/14/2016 at SMP: DS202

1 Sample(s) Required between 11/8/2016 and 11/14/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS203	Facility Name: VAN WERT CITY DISTRIBUTION 800 N. WASHINGTON ST.	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 2/8/2016 and 2/14/2016 at SMP: DS203

1 Sample(s) Required between 5/8/2016 and 5/14/2016 at SMP: DS203

1 Sample(s) Required between 8/8/2016 and 8/14/2016 at SMP: DS203

1 Sample(s) Required between 11/8/2016 and 11/14/2016 at SMP: DS203

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS204	Facility Name: VAN WERT CITY DISTRIBUTION BURT/CABLE HYDRANT 2089	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 2/8/2016 and 2/14/2016 at SMP: DS204

1 Sample(s) Required between 5/8/2016 and 5/14/2016 at SMP: DS204

1 Sample(s) Required between 8/8/2016 and 8/14/2016 at SMP: DS204

1 Sample(s) Required between 11/8/2016 and 11/14/2016 at SMP: DS204

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH8100712 RIDGEVIEW BEHAVIORAL HOSPITAL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 8159425	Facility Name: RIDGEVIEW BEHAVIORAL HOSPITAL	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.
 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
 Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2016 and 10/31/2016



OH8100712 RIDGEVIEW BEHAVIORAL HOSPITAL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **RIDGEVIEW HOSPITAL DISTRIBUTION**
SMP ID: **DS000**

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2016 and 9/30/2016

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

TOTAL COLIFORM (TCR) - 3100 1 Sample(s) Required between 1/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 12/31/2016

Sampling Location Facility ID: **DS1** Facility Name: **RIDGEVIEW HOSPITAL DISTRIBUTION**
SMP ID: **DS201** ADDRESS NOT KNOWN

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH8100911 WILLSHIRE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 8159426	Facility Name: WILLSHIRE WTP	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
<i>Sample for all the analytes listed below:</i>	
<i>ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020</i>	
<i>CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085</i>	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
RADIOLOGICALS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2016 and 10/31/2016



OH8100911 WILLSHIRE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: WILLSHIRE, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2016 and 9/30/2016

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between 1/1/2016 and 1/31/2016

1 Sample(s) Required between 2/1/2016 and 2/29/2016

1 Sample(s) Required between 3/1/2016 and 3/31/2016

1 Sample(s) Required between 4/1/2016 and 4/30/2016

1 Sample(s) Required between 5/1/2016 and 5/31/2016

1 Sample(s) Required between 6/1/2016 and 6/30/2016

1 Sample(s) Required between 7/1/2016 and 7/31/2016

1 Sample(s) Required between 8/1/2016 and 8/31/2016

1 Sample(s) Required between 9/1/2016 and 9/30/2016

1 Sample(s) Required between 10/1/2016 and 10/31/2016

1 Sample(s) Required between 11/1/2016 and 11/30/2016

1 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000

1 Sample(s) Required between 1/1/2016 and 1/31/2016

1 Sample(s) Required between 2/1/2016 and 2/29/2016

1 Sample(s) Required between 3/1/2016 and 3/31/2016

1 Sample(s) Required between 4/1/2016 and 4/30/2016

1 Sample(s) Required between 5/1/2016 and 5/31/2016

1 Sample(s) Required between 6/1/2016 and 6/30/2016

1 Sample(s) Required between 7/1/2016 and 7/31/2016

1 Sample(s) Required between 8/1/2016 and 8/31/2016

1 Sample(s) Required between 9/1/2016 and 9/30/2016

1 Sample(s) Required between 10/1/2016 and 10/31/2016

1 Sample(s) Required between 11/1/2016 and 11/30/2016

1 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: WILLSHIRE, VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

OH8100911 WILLSHIRE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2016**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: WILLSHIRE, VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH8130612 BROOKSIDE DAIRY

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: BROOKSIDE DAIRY DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

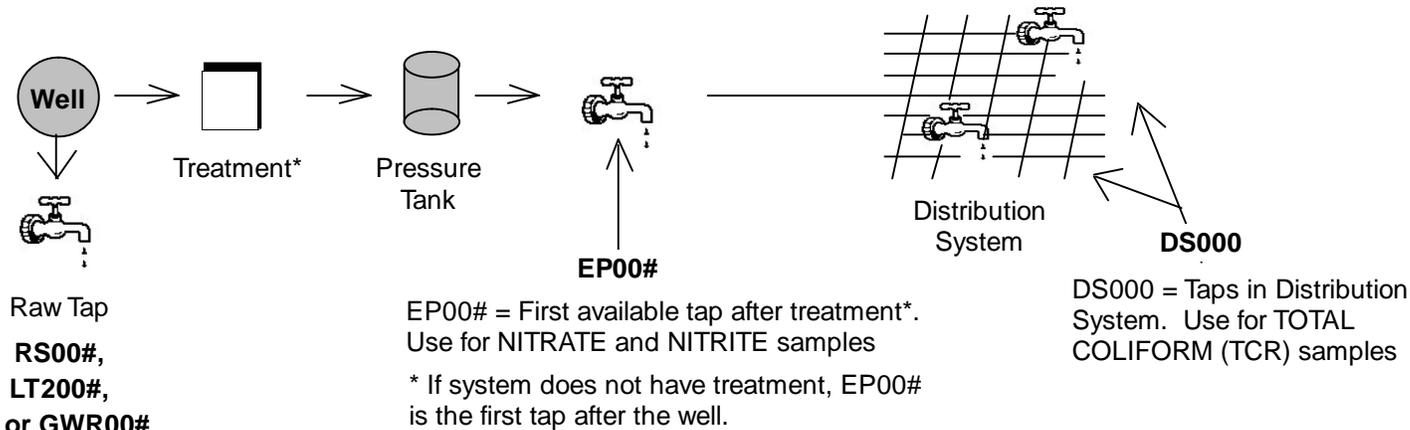

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8130612 BROOKSIDE DAIRY

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 8159428	Facility Name: BROOKSIDE DAIRY
Location SMP ID: EP001	Facility Source: Ground Water
Facility Class: CLASS A	

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

Where to Collect Samples For a Small Public Water System

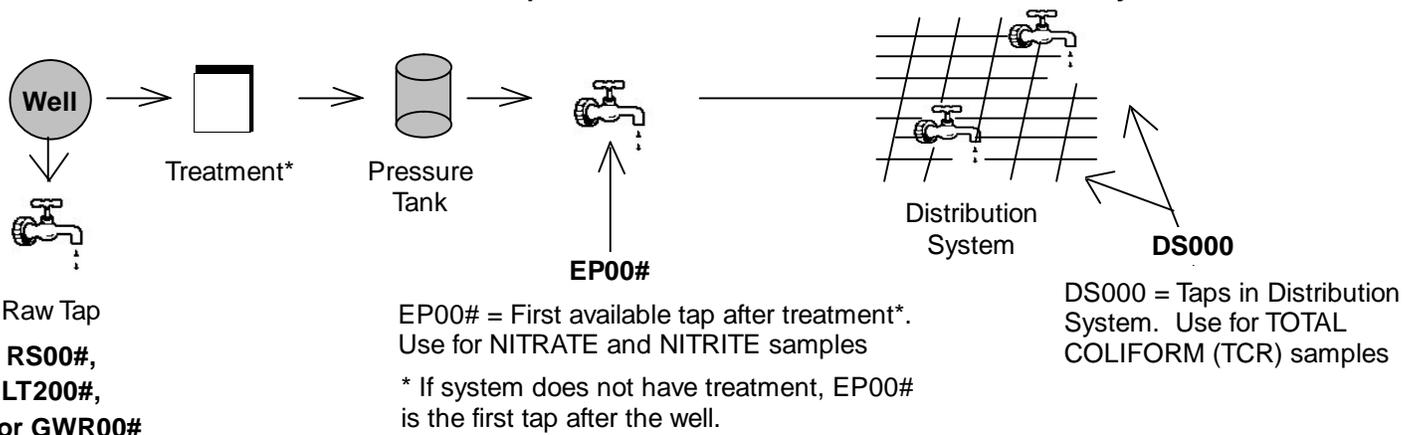

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8131112 VAN WERT CINEMAS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: VAN WERT CINEMAS DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

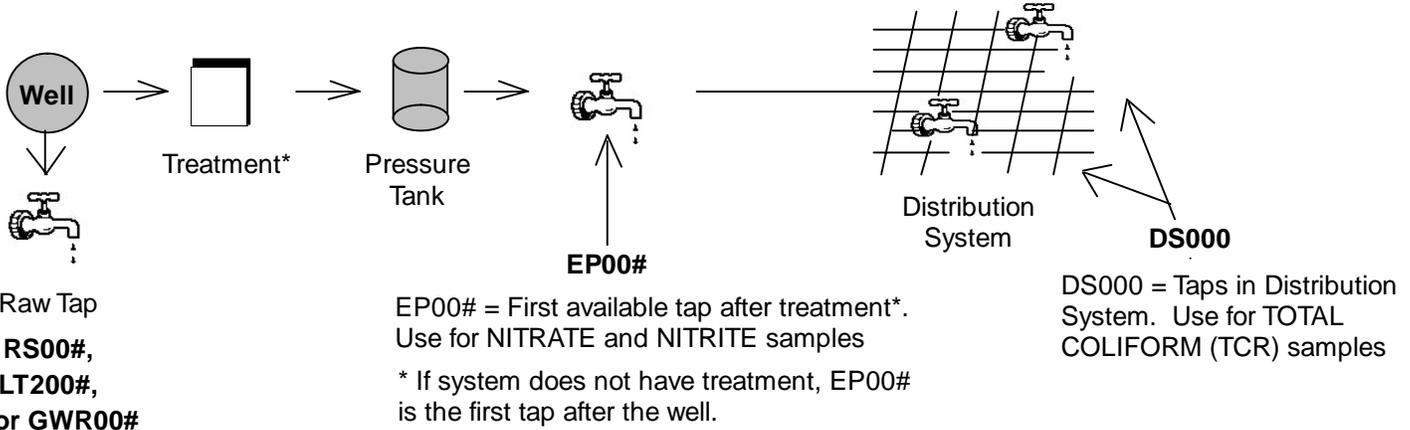

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8131112 VAN WERT CINEMAS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **8159432** Facility Name: **VAN WERT CINEMAS**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2016 and 10/31/2016

Where to Collect Samples For a Small Public Water System

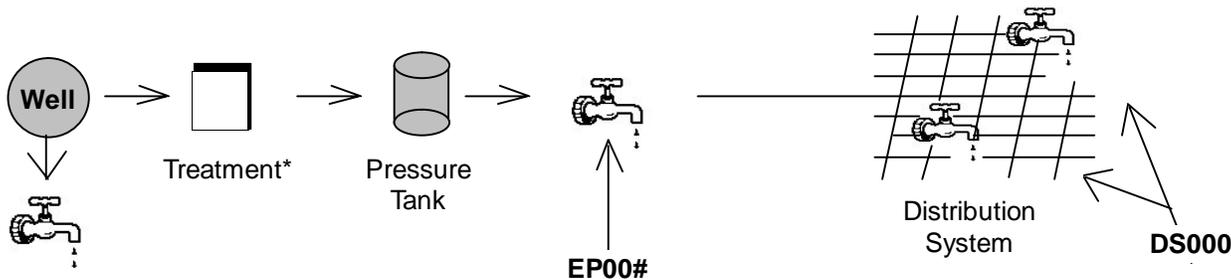

Raw Tap
RS00#,
LT200#,
 or **GWR00#**

EP00# = First available tap after treatment*.
 Use for NITRATE and NITRITE samples
 * If system does not have treatment, EP00#
 is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8131212 RAMBLERS ROOST RESTAURANT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: RAMBLERS ROOST DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

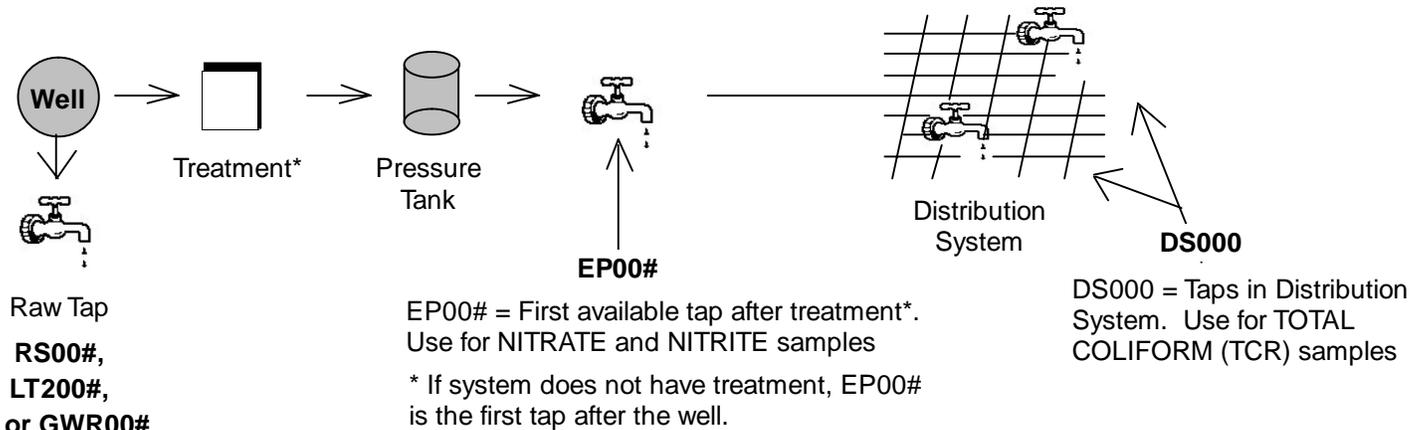

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8131212 RAMBLERS ROOST RESTAURANT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **8159433** Facility Name: **RAMBLERS ROOST**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2016 and 10/31/2016

Where to Collect Samples For a Small Public Water System

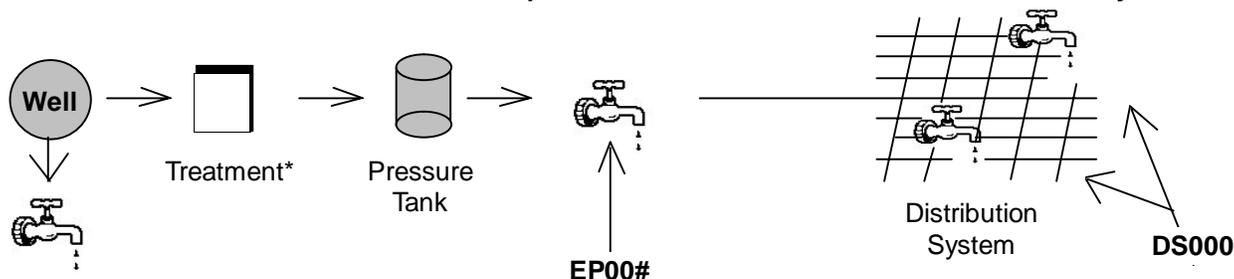

Raw Tap
RS00#,
LT200#,
 or **GWR00#**

EP00# = First available tap after treatment*.
 Use for NITRATE and NITRITE samples
 * If system does not have treatment, EP00#
 is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8131312 COUNTRYSIDE CHAPEL UM CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: COUNTRYSIDE CHAPEL UM DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

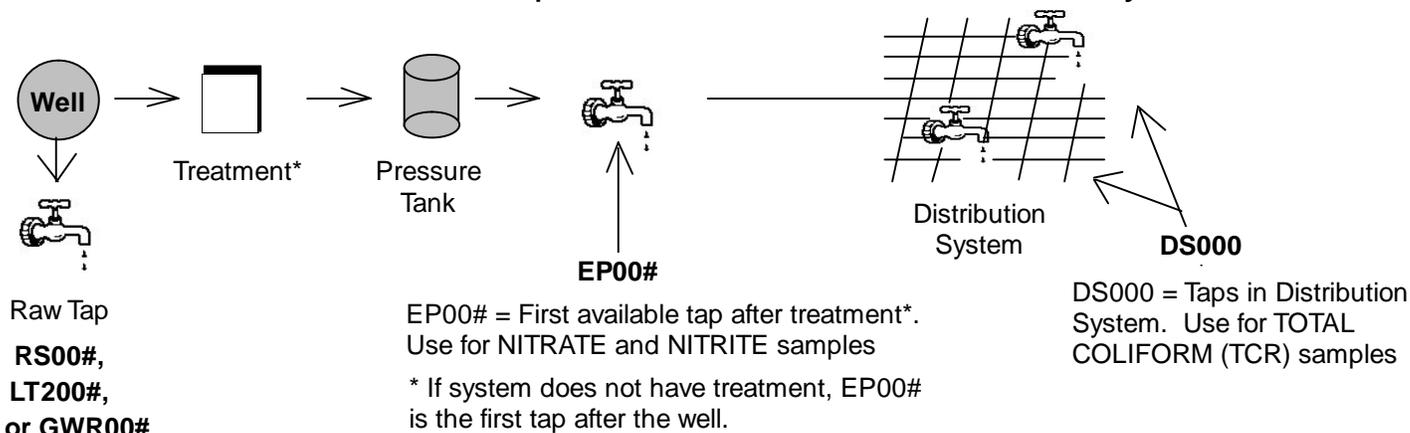

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8131312 COUNTRYSIDE CHAPEL UM CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **8159434** Facility Name: **COUNTRYSIDE CHAPEL UM**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2016 and 10/31/2016

Where to Collect Samples For a Small Public Water System

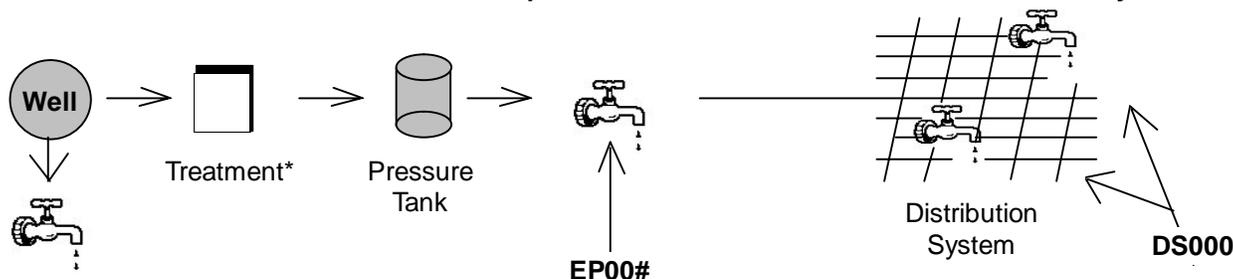

Raw Tap
RS00#,
LT200#,
or **GWR00#**

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples
* If system does not have treatment, EP00#
is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8131712 E & R TRAILER SALES

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: E AND R TRAILER SALES DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

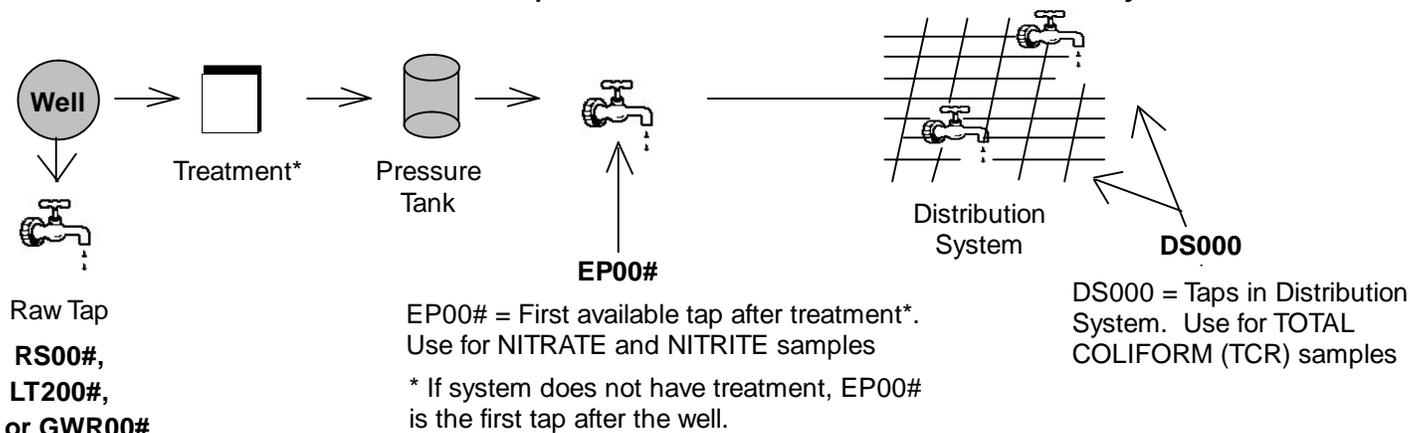

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8131712 E & R TRAILER SALES

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **8159436** Facility Name: **E AND R TRAILER SALES**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2016 and 10/31/2016

Where to Collect Samples For a Small Public Water System

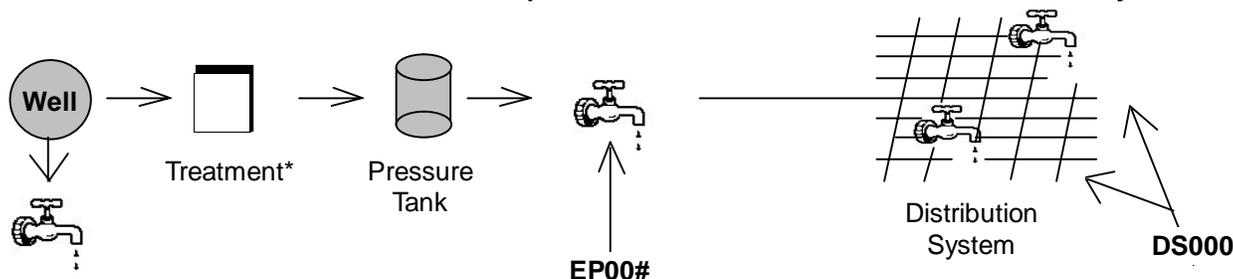

Raw Tap
RS00#,
LT200#,
or **GWR00#**

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples
* If system does not have treatment, EP00#
is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8131812 HICKORY STICKS GOLF CLUB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: HICKORY STICKS GOLF CLUB DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

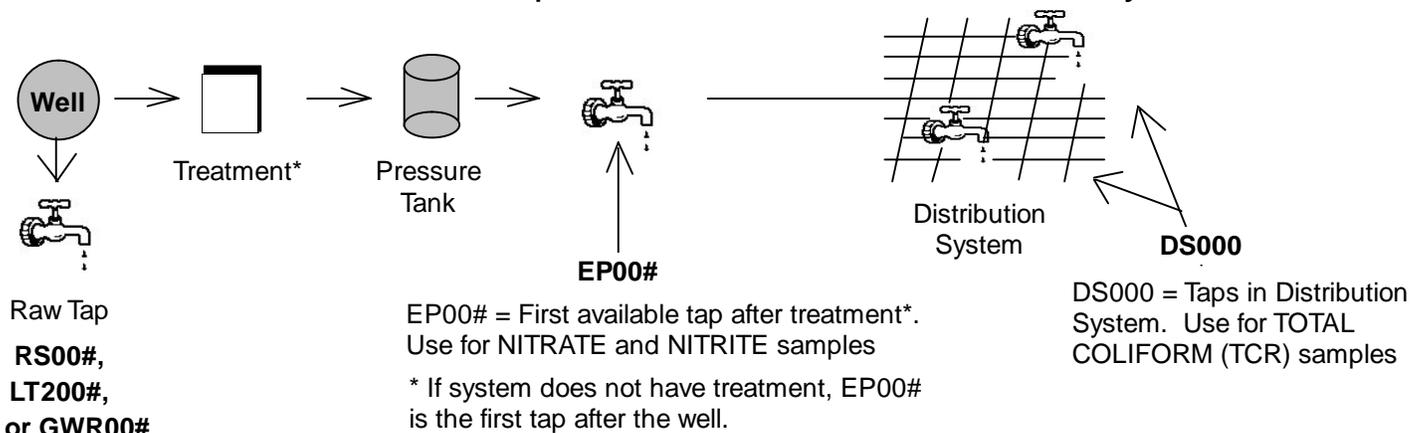

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8131812 HICKORY STICKS GOLF CLUB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **8159437** Facility Name: **HICKORY STICKS GOLF CLUB**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

Where to Collect Samples For a Small Public Water System

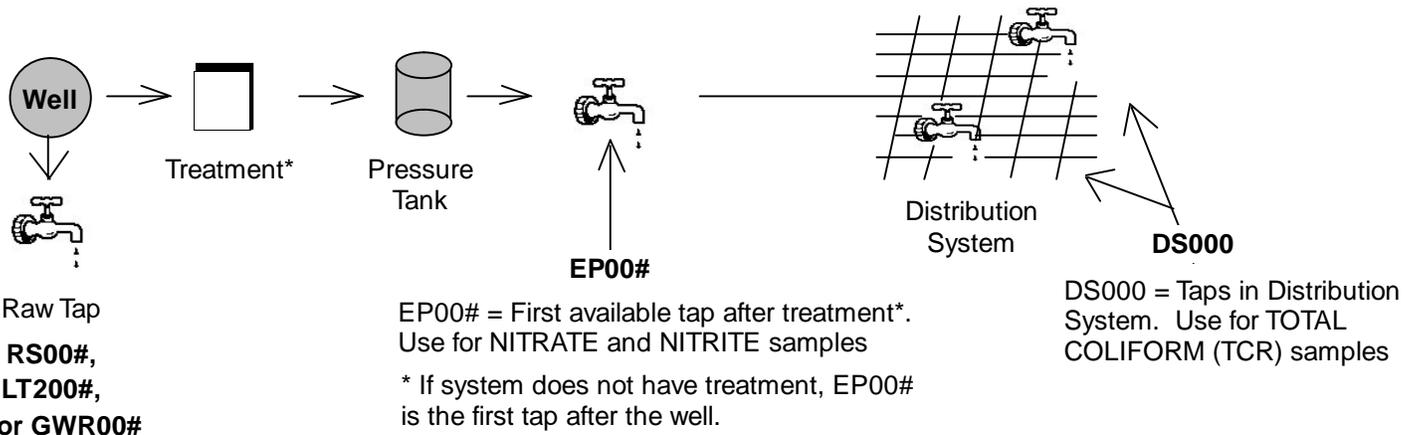

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8132312 FIRST BAPTIST CHURCH - VAN WERT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: FIRST BAPTIST CHURCH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

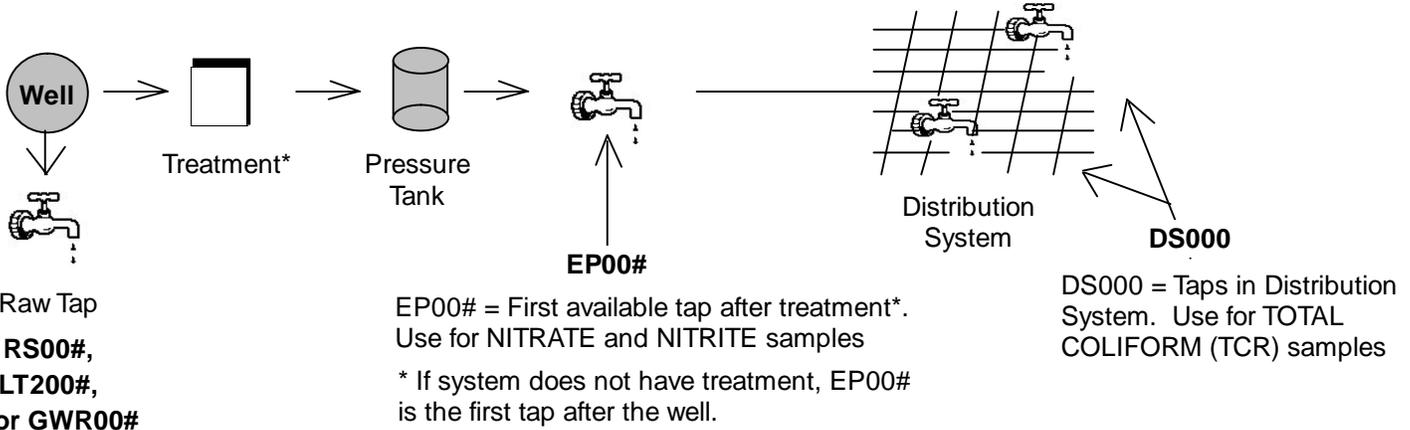

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8132312 FIRST BAPTIST CHURCH - VAN WERT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **8159440** Facility Name: **FIRST BAPTIST CHURCH**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2016 and 10/31/2016

Where to Collect Samples For a Small Public Water System

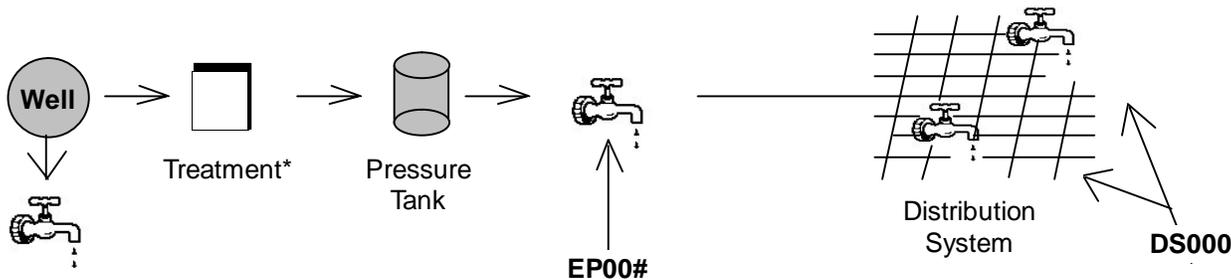

Raw Tap
RS00#,
LT200#,
or **GWR00#**

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples
* If system does not have treatment, EP00#
is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8133012 HUGGY BEAR CAMPGROUND PHASE I

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: HUGGY BEAR CAMPGROUND DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

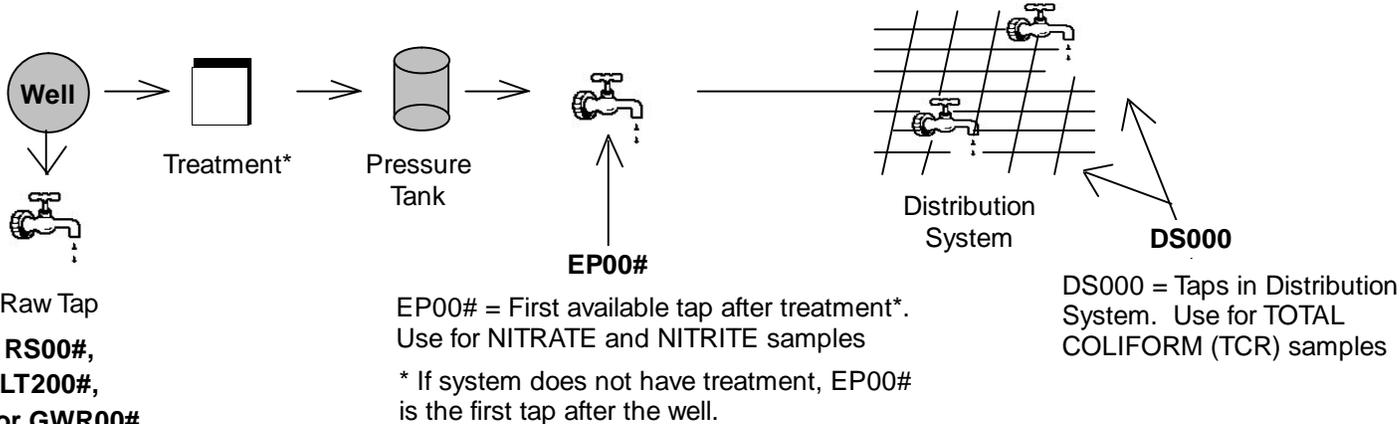

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8133012 HUGGY BEAR CAMPGROUND PHASE I

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **8159443** Facility Name: **HUGGY BEAR CAMPGROUND**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

Where to Collect Samples For a Small Public Water System

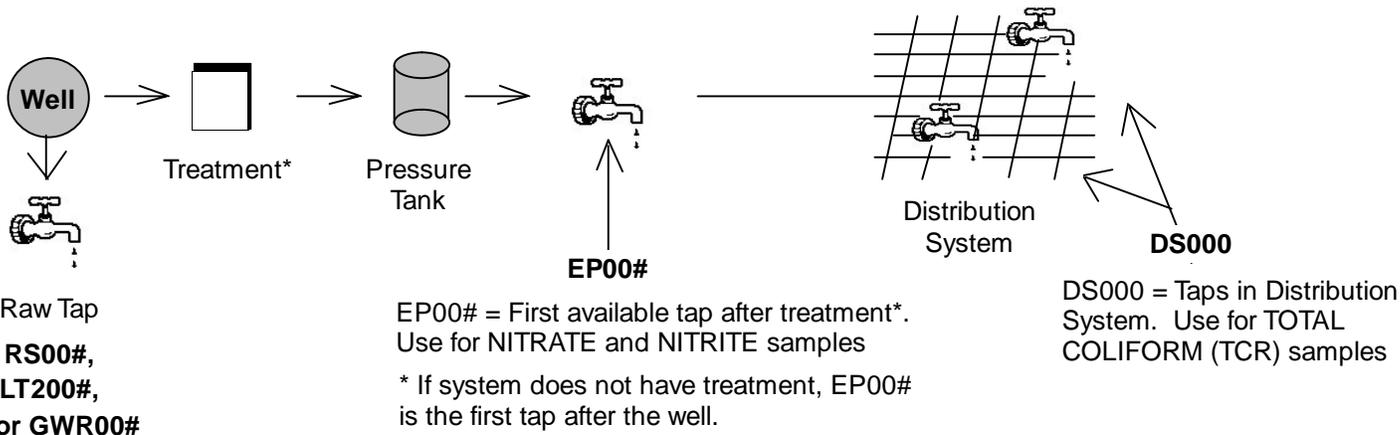

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8133812 PLEASANT CHAPEL UM CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: PLEASANT CHAPEL U. METH. DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

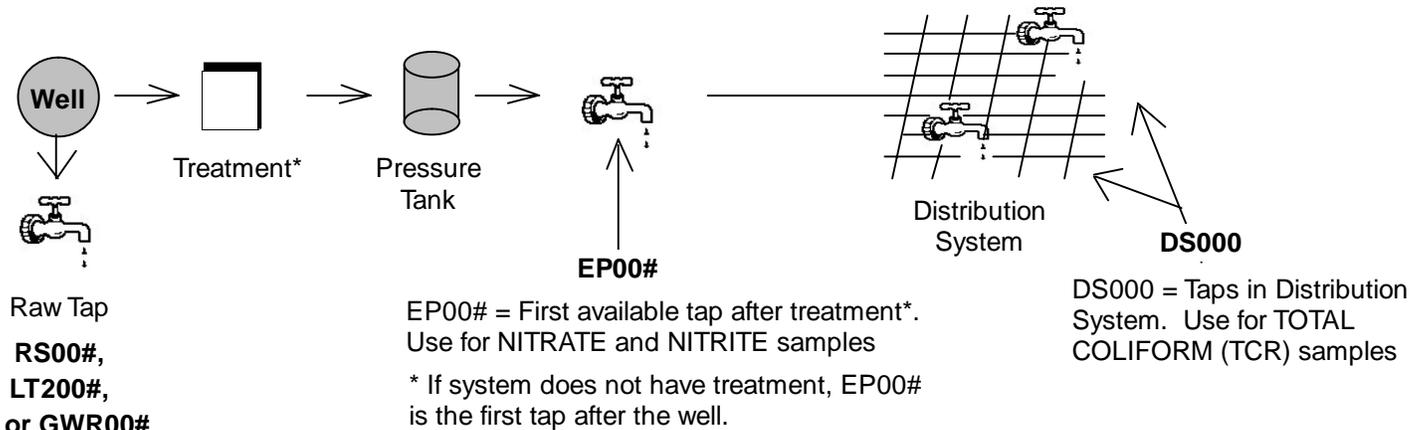

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8133812 PLEASANT CHAPEL UM CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **8159446** Facility Name: **PLEASANT CHAPEL U METH**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

Where to Collect Samples For a Small Public Water System

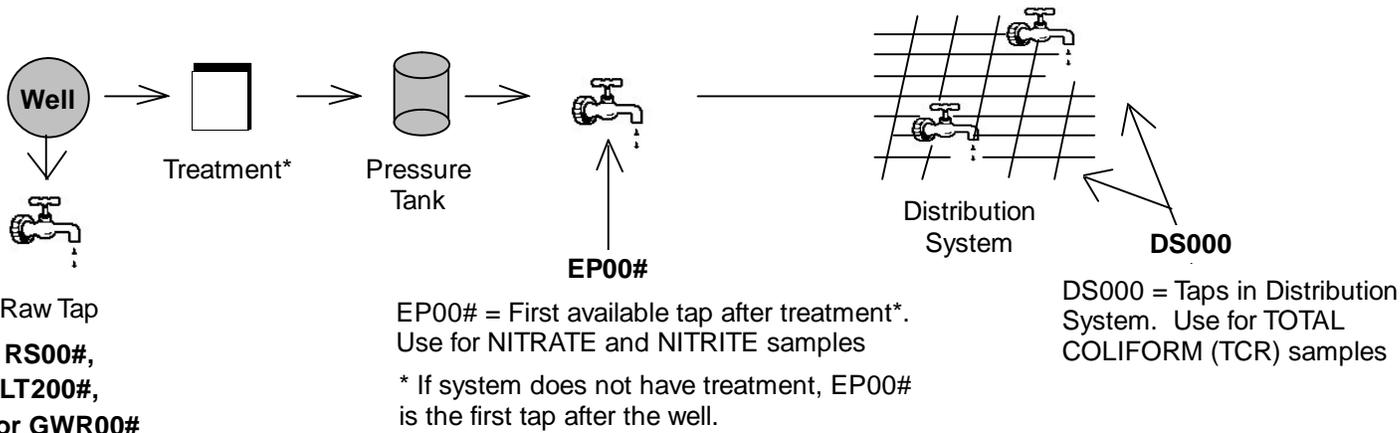

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8133912 TIMBERWOODS CAMPING RESORT

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: TIMBERWOODS CAMPING RESORT DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 9/30/2016 1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

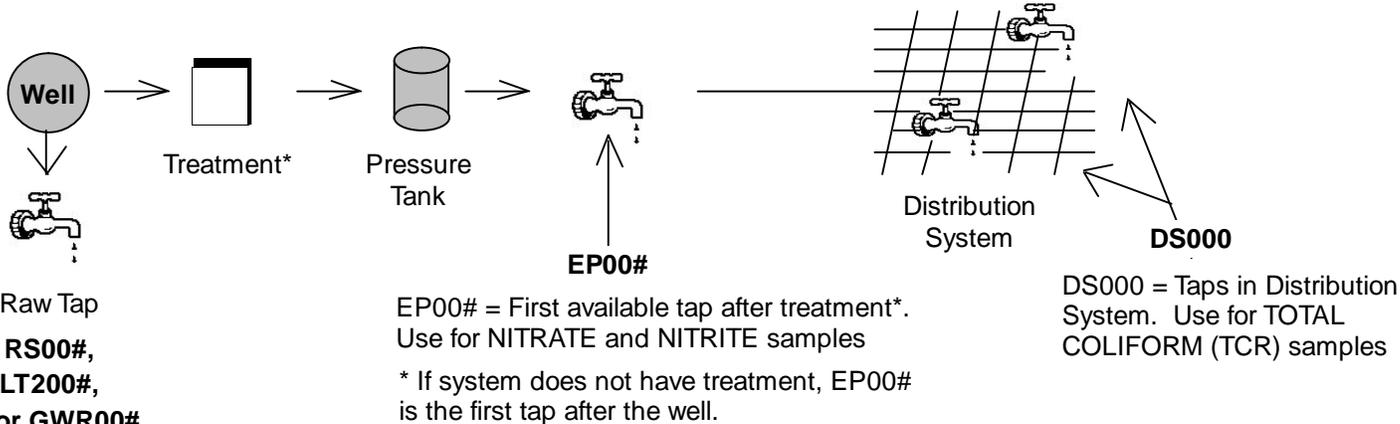

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8133912 TIMBERWOODS CAMPING RESORT

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 8159447 Facility Name: TIMBERWOODS CAMPING RESORT

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

Where to Collect Samples For a Small Public Water System

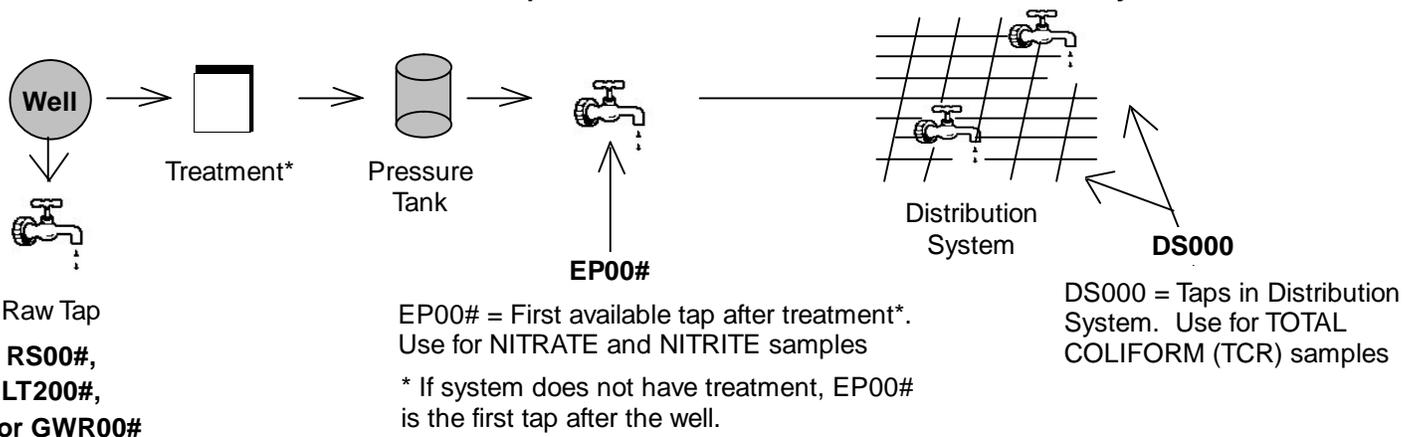

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH8134212 COOPER FARMS COOKED MEATS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 8159449	Facility Name: COOPER FARMS COOKED MEATS VAN WERT	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2016 and 10/31/2016

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 6/1/2016 and 10/31/2016

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 Not Required

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2016 and 10/31/2016



OH8134212 COOPER FARMS COOKED MEATS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **COOPER FOODS PROCESSED M DISTRIBUTI** Facility Class: **CLASS 1**
SMP ID: **DS000**

Chemicals **Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 Not Required

TOTAL COLIFORM (TCR) - 3100
1 Sample(s) Required between 1/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000
1 Sample(s) Required between 1/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: **DS1** Facility Name: **COOPER FOODS PROCESSED M DISTRIBUTI** Facility Class: **CLASS 1**
SMP ID: **DS201** ADDRESS NOT KNOWN

Chemicals **Monitoring Requirements**

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH8134312 REDEEMER LUTHERAN CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: REDEEMER LUTHERAN CHURCH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

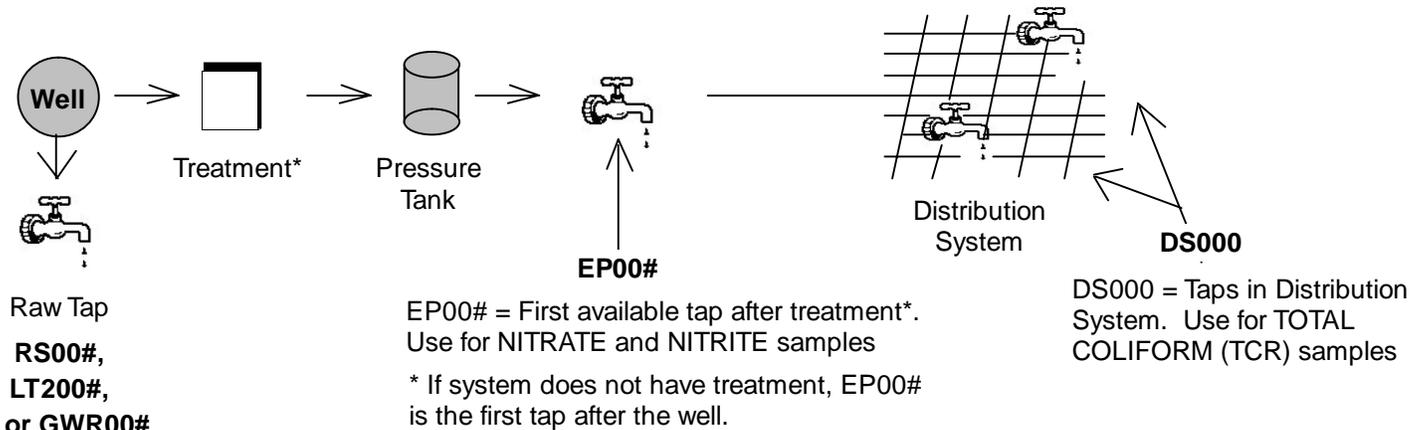

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8134312 REDEEMER LUTHERAN CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **8159450** Facility Name: **REDEEMER LUTHERAN CHURCH**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

Where to Collect Samples For a Small Public Water System

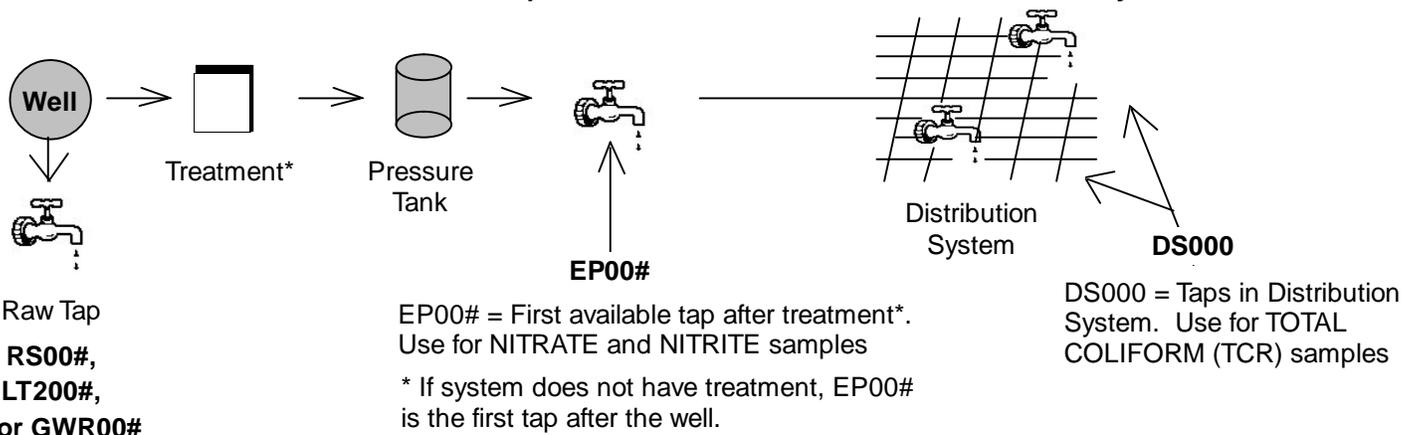

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8134712 ST PAULS REFORMED CHURCH IN AMERICA

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ST PAULS REFORMD CH AMERICA DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

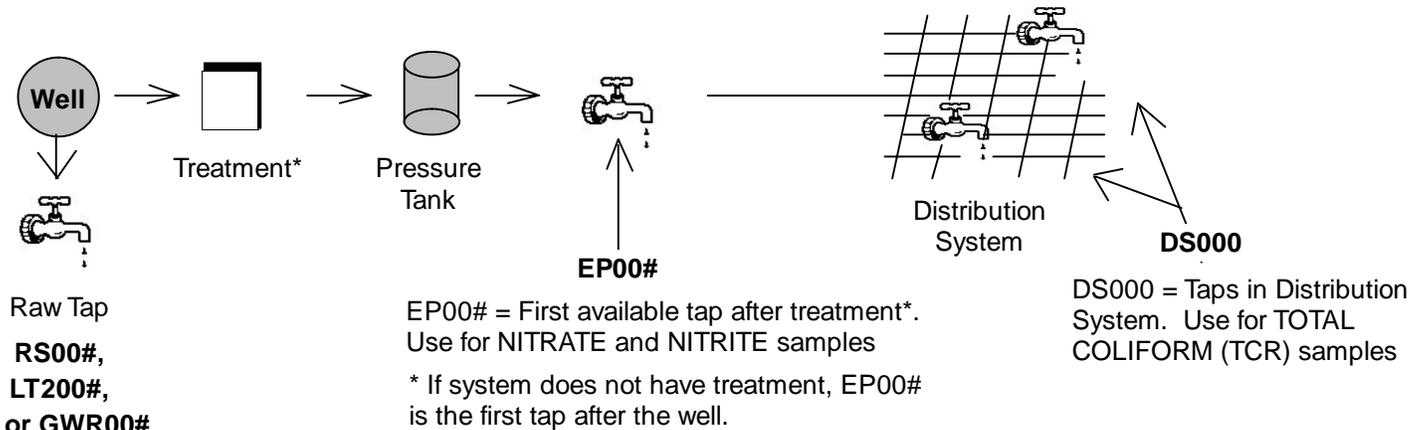

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8134712 ST PAULS REFORMED CHURCH IN AMERICA

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 8159451	Facility Name: SAINT PAULS REFORMED CHURCH AMERICA
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

Where to Collect Samples For a Small Public Water System

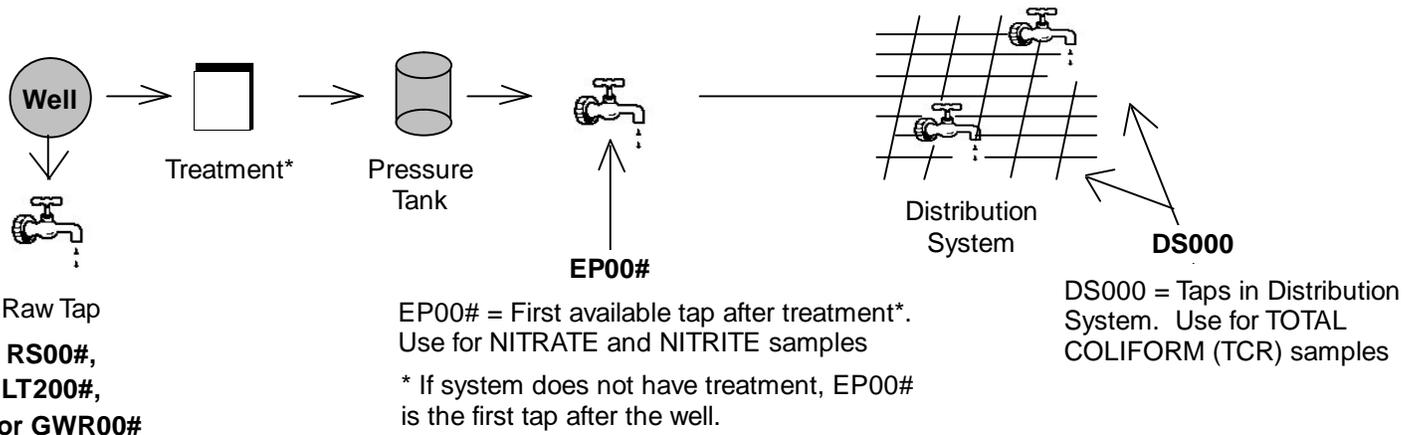

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8134812 ST THOMAS LUTHERAN CHURCH-VAN WERT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ST THOMAS LUTHERAN CH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

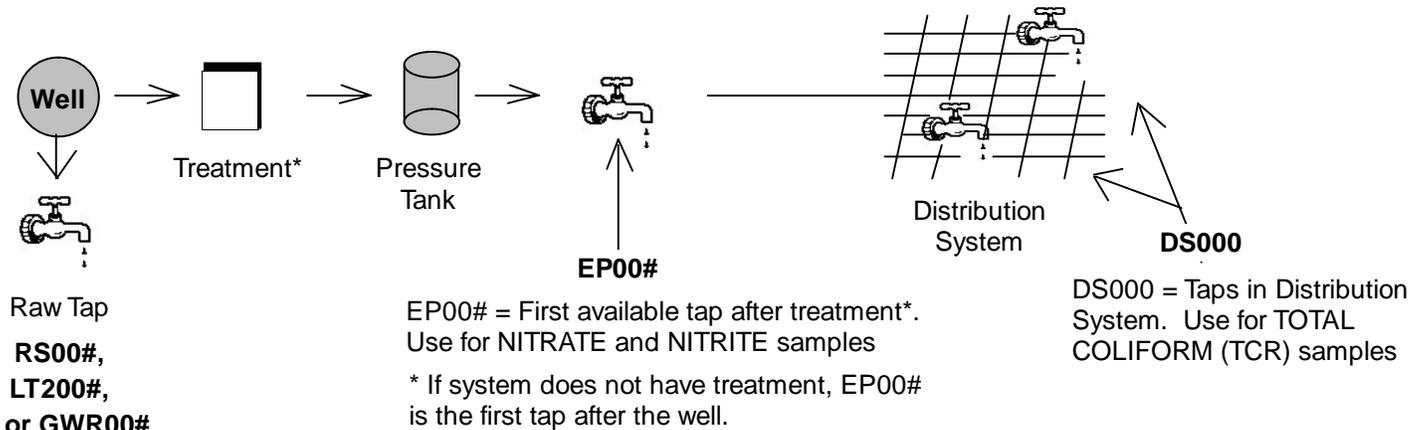

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8134812 ST THOMAS LUTHERAN CHURCH-VAN WERT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **8159452** Facility Name: **SAINT THOMAS LUTHERAN CHURCH**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2016 and 10/31/2016

Where to Collect Samples For a Small Public Water System

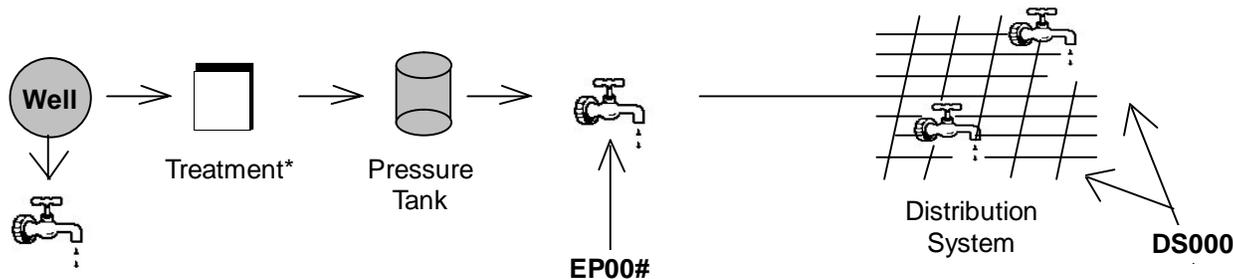

Raw Tap
RS00#,
LT200#,
 or **GWR00#**

EP00# = First available tap after treatment*.
 Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00#
 is the first tap after the well.

DS000 = Taps in Distribution
 System. Use for TOTAL
 COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8134912 SALEM UNITED PRESBYTERIAN CH-VENEDOCIA

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: SALEM PRESBYTERIAN CH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

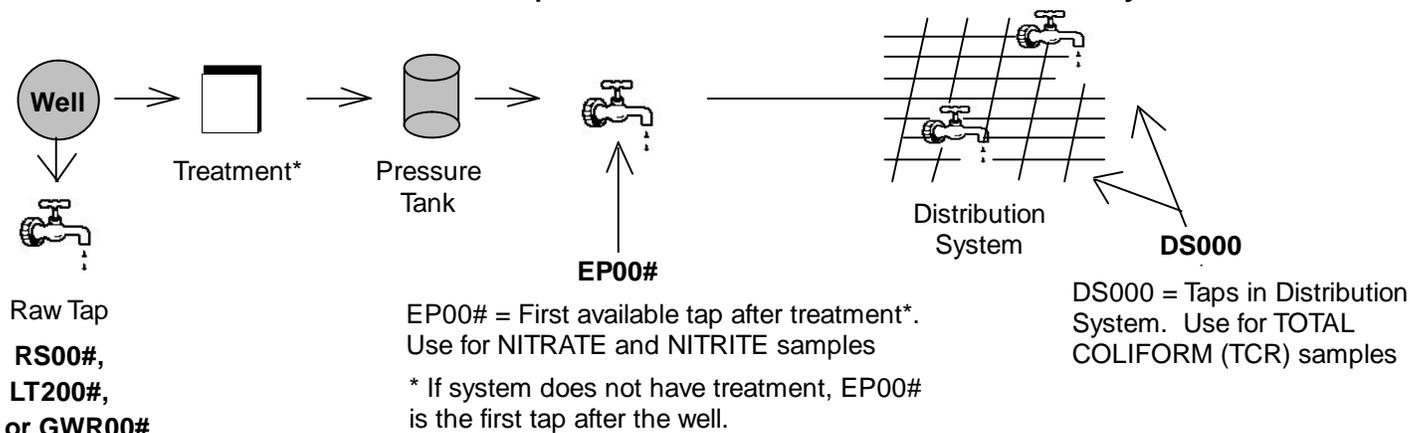

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8134912 SALEM UNITED PRESBYTERIAN CH-VENEDOCIA

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **8159453** Facility Name: **SALEM PRESBYTERIAN CHURCH**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2016 and 10/31/2016

Where to Collect Samples For a Small Public Water System

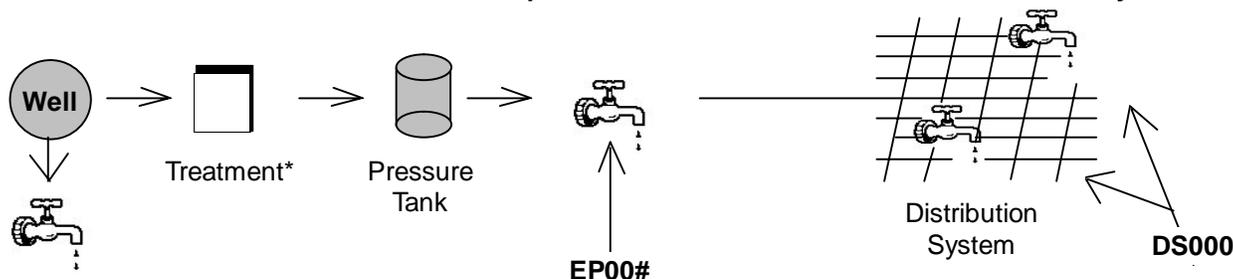

Raw Tap
RS00#,
LT200#,
or **GWR00#**

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples
* If system does not have treatment, EP00#
is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8135312 VAN-DEL DRIVE-IN

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: VAN-DEL DRIVE-IN DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 9/30/2016

Where to Collect Samples For a Small Public Water System

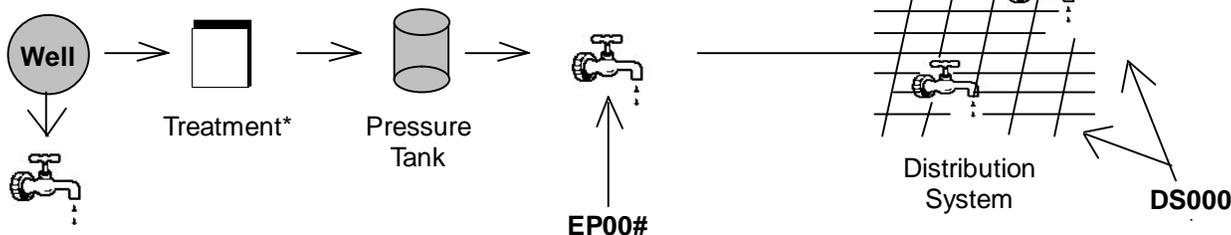

Raw Tap
RS00#,
LT200#,
or **GWR00#**

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples
* If system does not have treatment, EP00# is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8135312 VAN-DEL DRIVE-IN

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **8159455** Facility Name: **VAN-DEL DRIVE-IN**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

Where to Collect Samples For a Small Public Water System

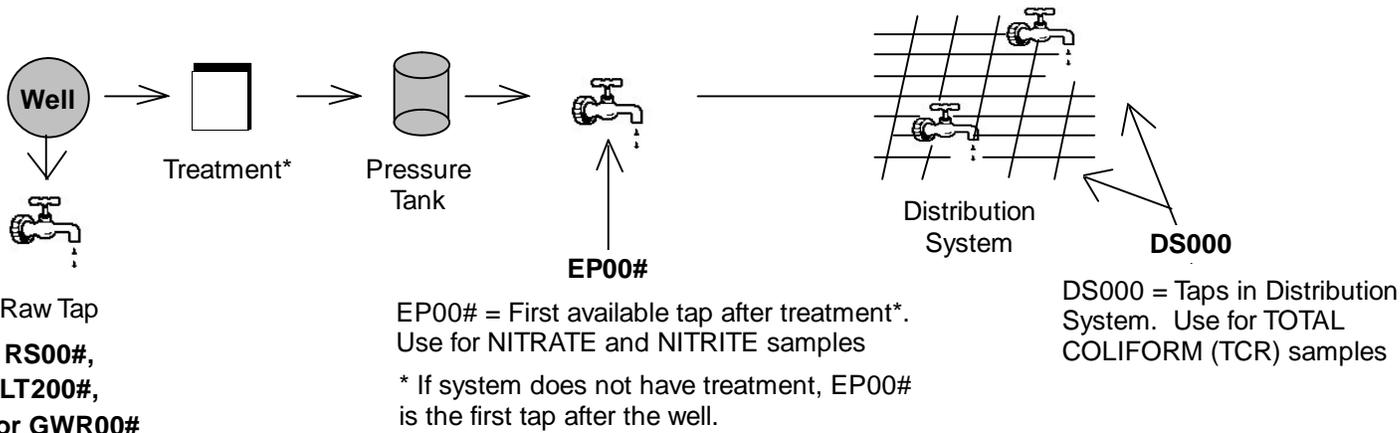

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8136512 WREN RESTAURANT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: WREN RESTAURANT DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

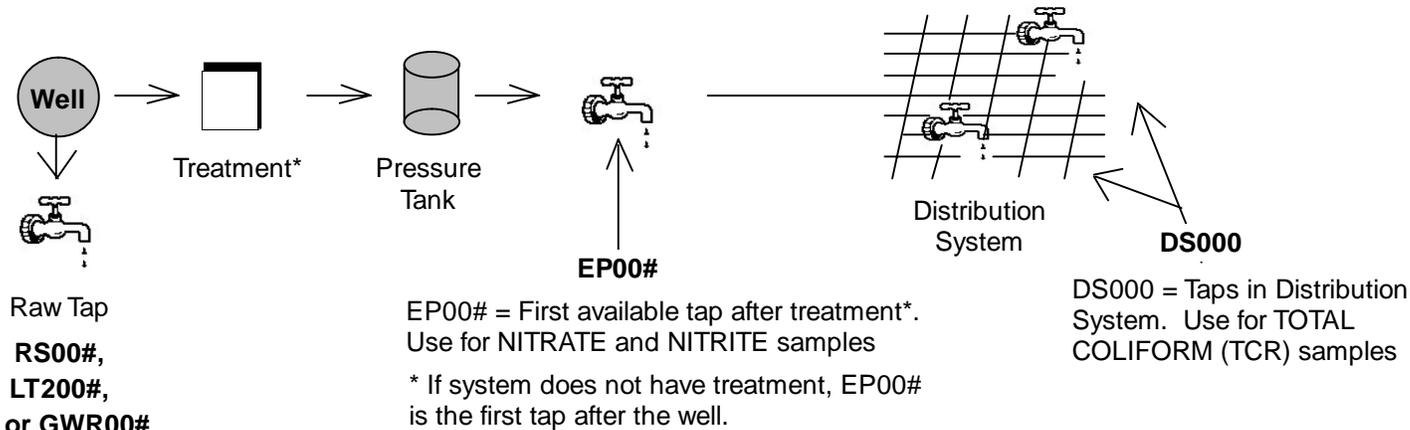

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8136512 WREN RESTAURANT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **8159458** Facility Name: **WREN RESTAURANT**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2016 and 10/31/2016

Where to Collect Samples For a Small Public Water System

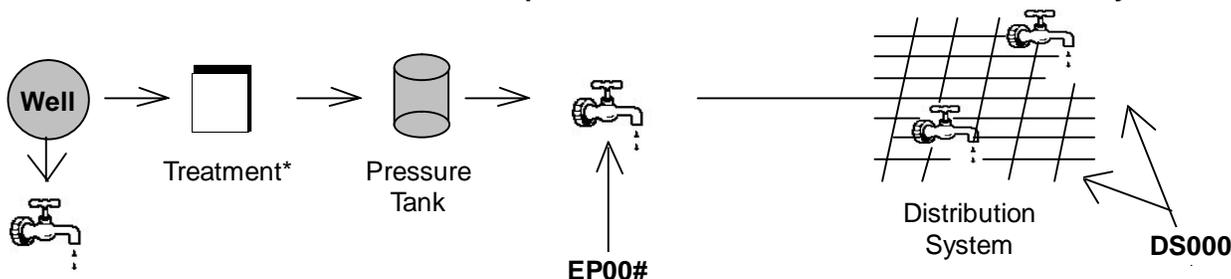

Raw Tap
RS00#,
LT200#,
 or **GWR00#**

EP00# = First available tap after treatment*.
 Use for NITRATE and NITRITE samples
 * If system does not have treatment, EP00#
 is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8136612 ODOT REST AREA 1-27 EB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ODOT-REST AREA 1-27 DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

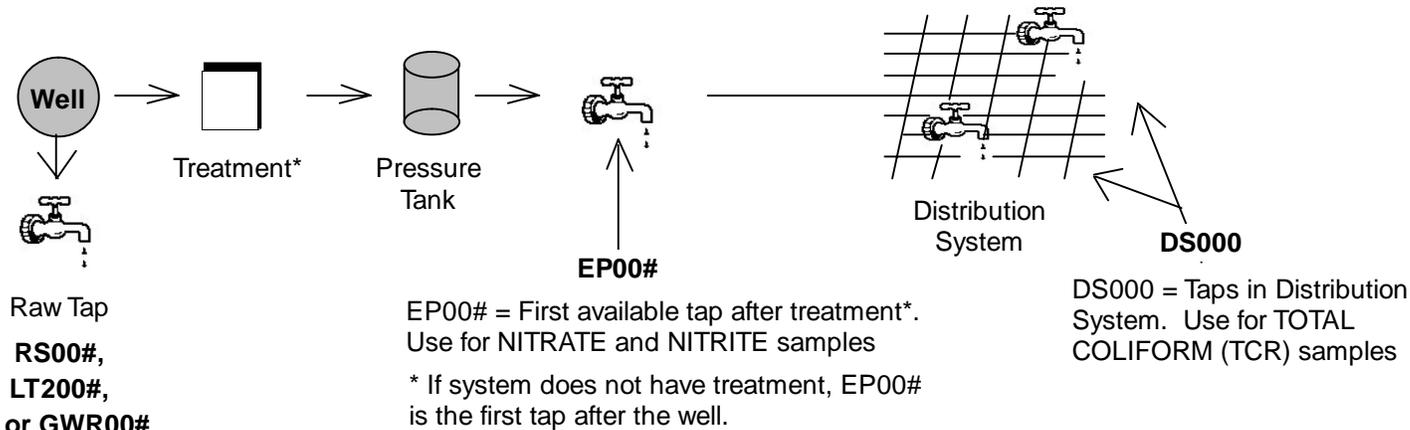

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8136612 ODOT REST AREA 1-27 EB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 8159459	Facility Name: ODOT REST AREA 1-27
Location SMP ID: EP001	Facility Source: Ground Water
Facility Class: CLASS A	

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

Where to Collect Samples For a Small Public Water System

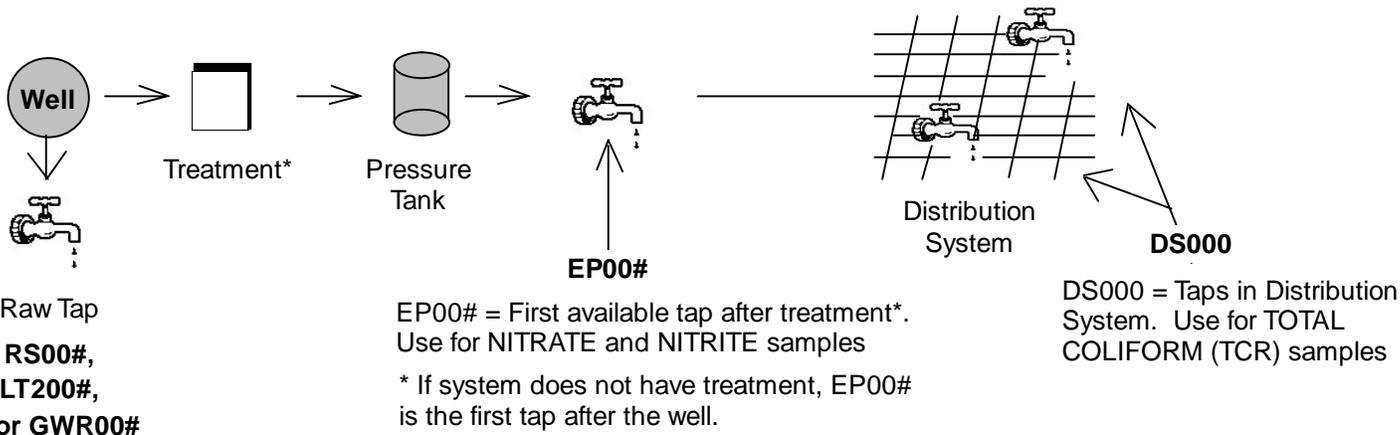

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8136712 ODOT REST AREA 1-28 WB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ODOT REST AREA 1-28 DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

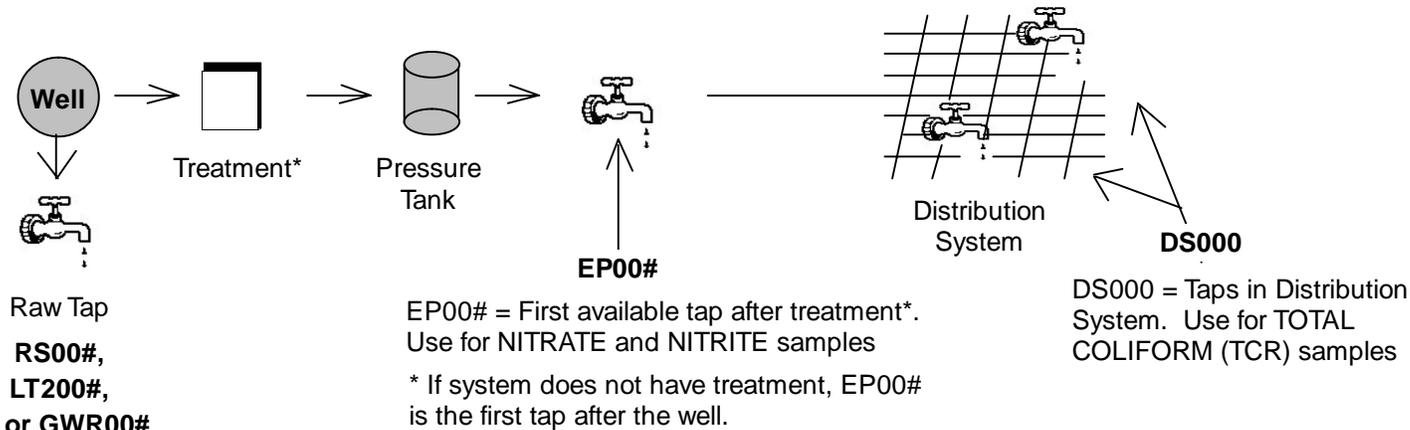

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8136712 ODOT REST AREA 1-28 WB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 8159460	Facility Name: ODOT REST AREA 1-28
Location SMP ID: EP001	Facility Source: Ground Water
	Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

Where to Collect Samples For a Small Public Water System

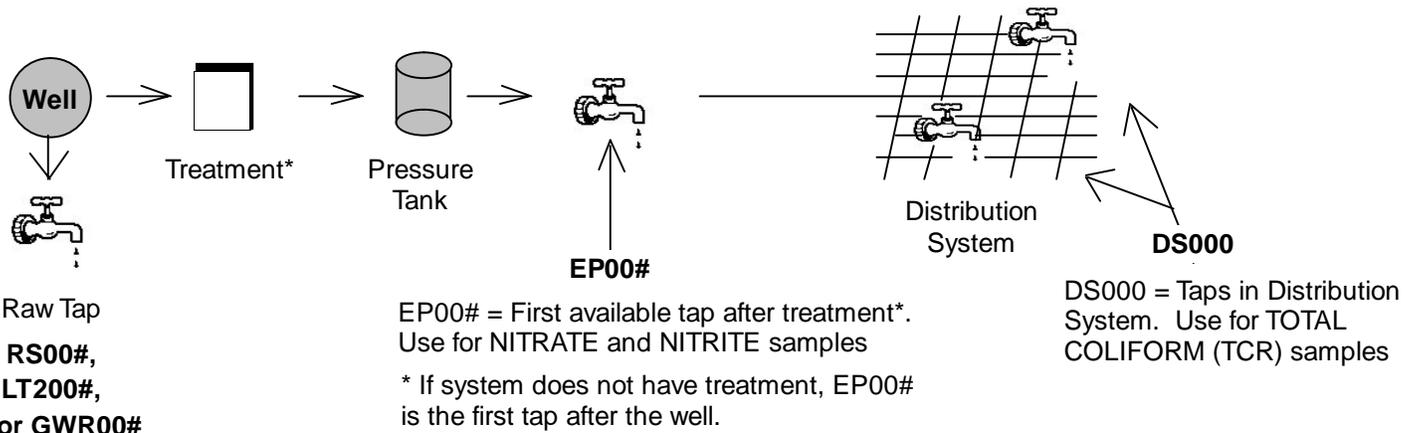

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8136912 HUGGY BEAR CAMPGROUND PHASE II

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: HUGGY BEAR CAMPGROUND PH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

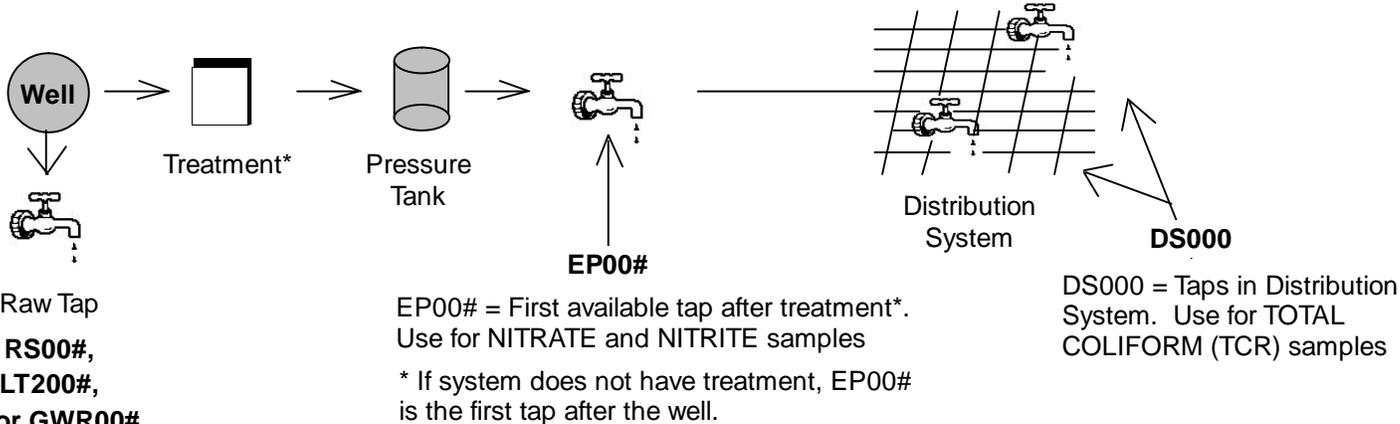

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8136912 HUGGY BEAR CAMPGROUND PHASE II

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 8159462	Facility Name: HUGGY BEAR CAMPGROUND PHASE II
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

Where to Collect Samples For a Small Public Water System

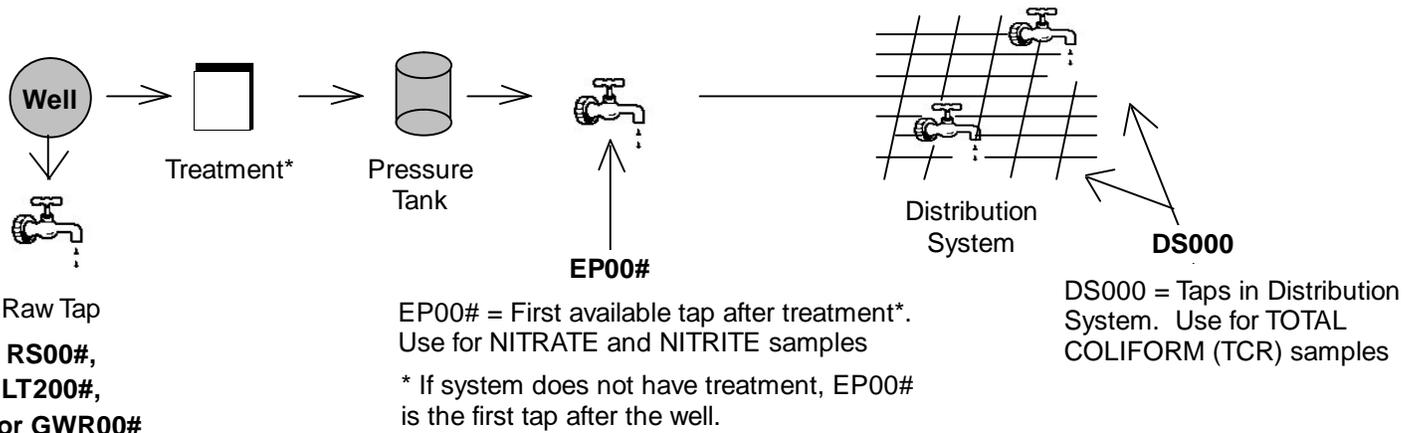

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8137012 CAMP CLAY - YMCA

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CAMP CLAY YMCA DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

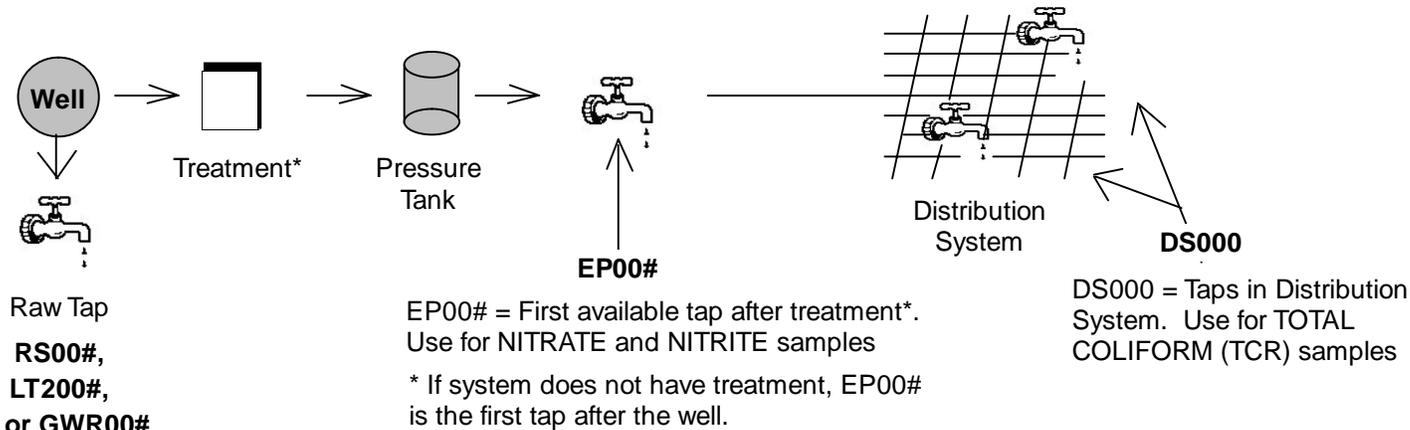

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8137012 CAMP CLAY - YMCA

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **8160968** Facility Name: **CAMP CLAY-YMCA**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

Where to Collect Samples For a Small Public Water System

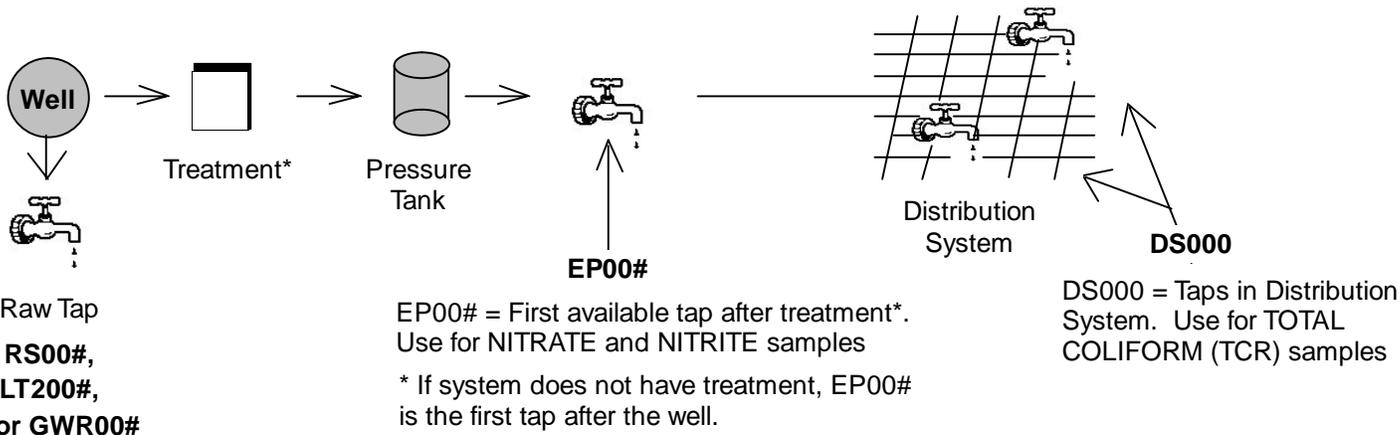

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8137112 NORTH UNION UNITED METH CH - VAN WERT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: NORTH UNION UNITED METHODIST CHURCH DIST
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

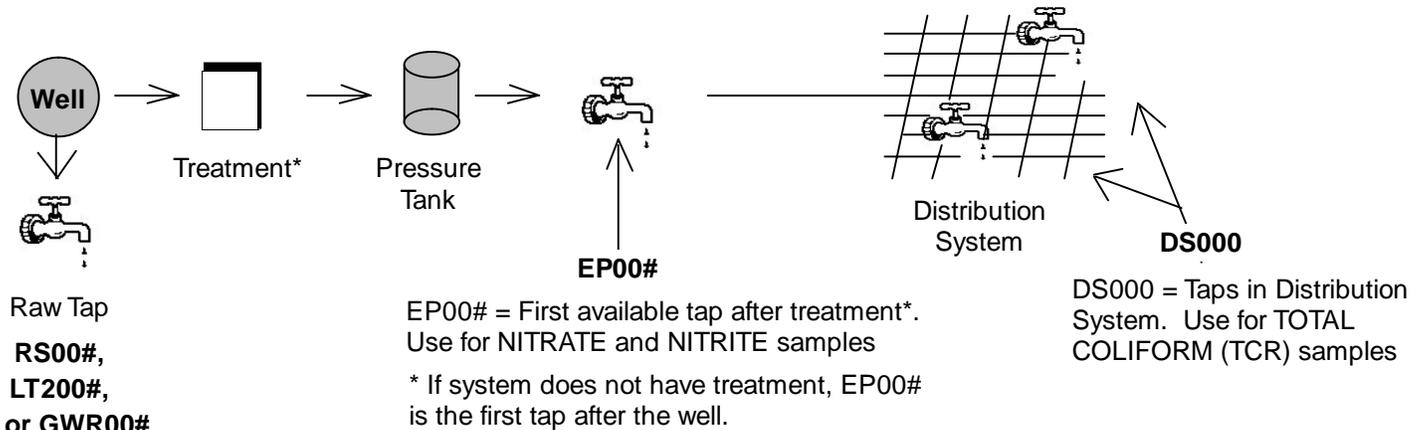

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8137112 NORTH UNION UNITED METH CH - VAN WERT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 8160969	Facility Name: NORTH UNION UNITED METHODIST CHURCH
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

Where to Collect Samples For a Small Public Water System

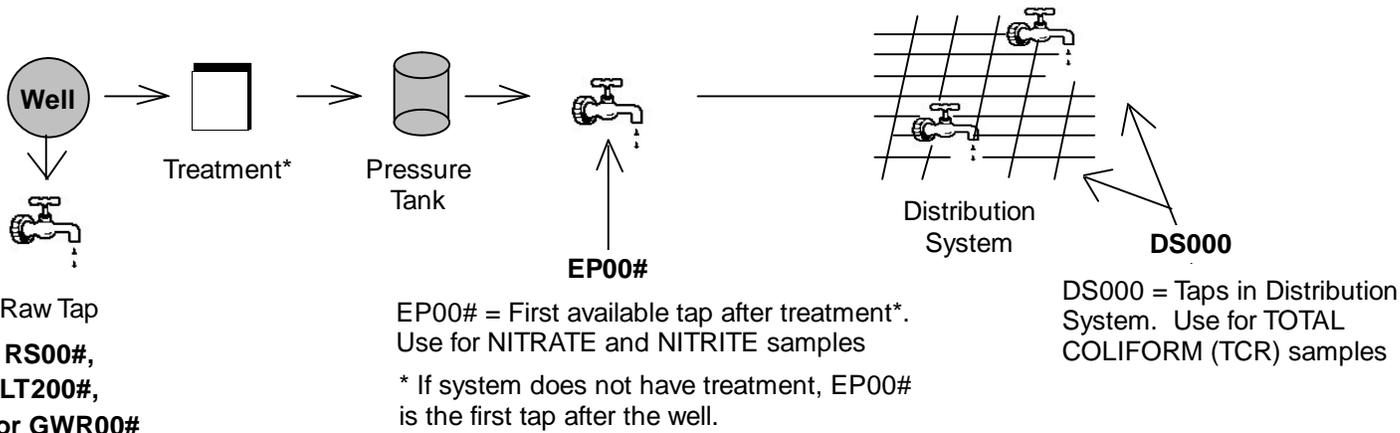

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH8137212 LINCOLNVIEW K-12 SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 8162231	Facility Name: LINCOLNVIEW K-12 SCHOOL	
Location	SMP ID: EP002	Facility Source: Ground Water	Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2016 and 10/31/2016



OH8137212 LINCOLNVIEW K-12 SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **LINCOLNVIEW K-12 SCHOOL DISTRIBUTION** Facility Class: **CLASS 1**
SMP ID: **DS000**

Chemicals **Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 Not Required

TOTAL COLIFORM (TCR) - 3100
1 Sample(s) Required between 1/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000
1 Sample(s) Required between 1/1/2016 and 3/31/2016
1 Sample(s) Required between 4/1/2016 and 6/30/2016
1 Sample(s) Required between 7/1/2016 and 9/30/2016
1 Sample(s) Required between 10/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: **DS1** Facility Name: **LINCOLNVIEW K-12 SCHOOL DISTRIBUTION** Facility Class: **CLASS 1**
SMP ID: **DS201** ADDRESS NOT KNOWN

Chemicals **Monitoring Requirements**

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location Facility ID: **DS1** Facility Name: **LINCOLNVIEW K-12 SCHOOL DISTRIBUTION** Facility Class: **CLASS 1**
SMP ID: **DS202** ADDRESS NOT KNOWN

Chemicals **Monitoring Requirements**

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH8137312 CAMP CLAY YMCA- NATURE CENTER

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CAMP CLAY NATURE CENTER DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

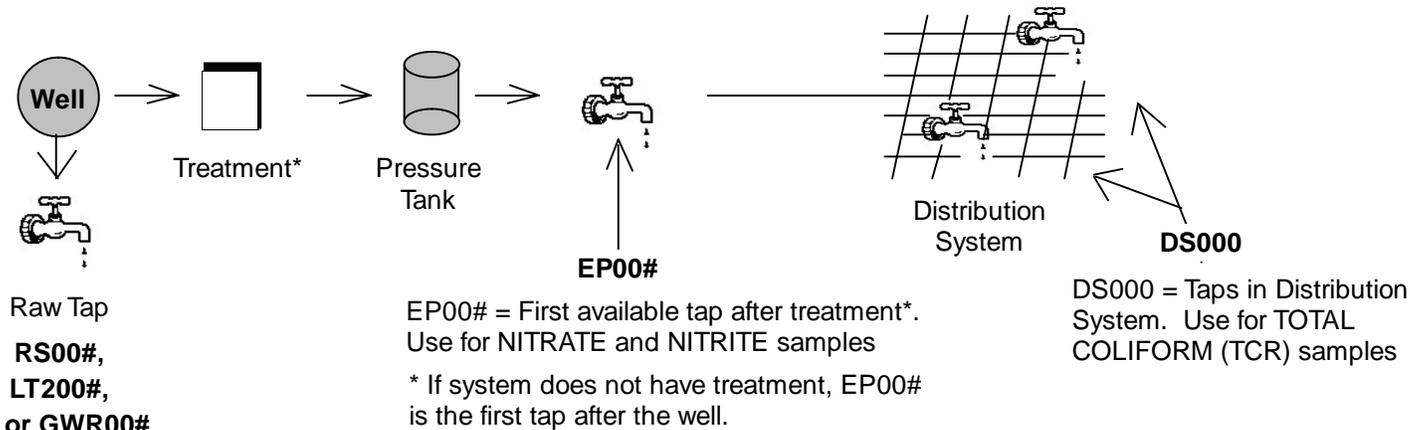

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8137312 CAMP CLAY YMCA- NATURE CENTER

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **8161496** Facility Name: **CAMP CLAY NATURE CENTER**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2016 and 10/31/2016

Where to Collect Samples For a Small Public Water System

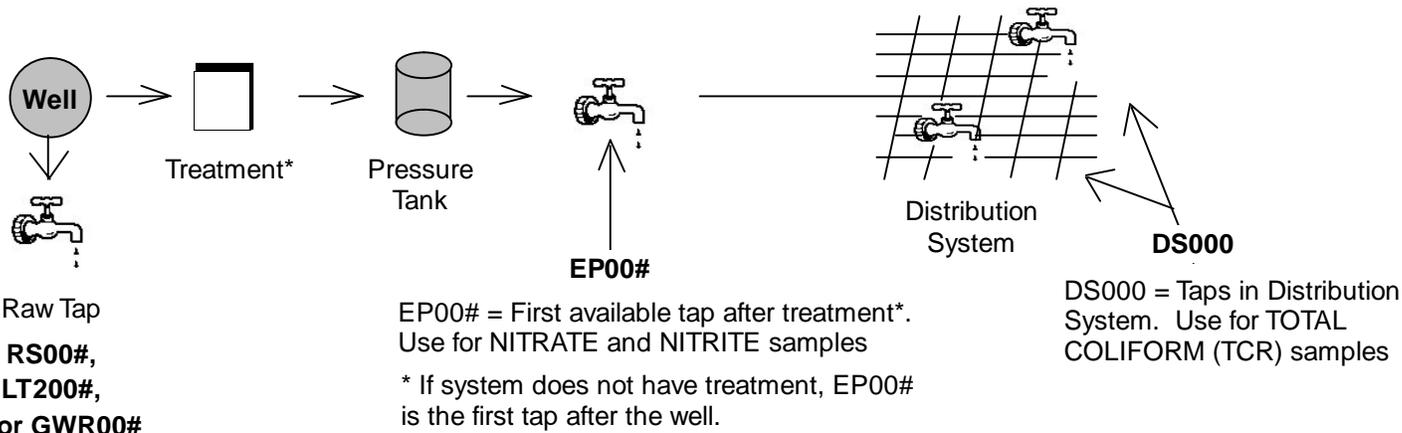

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8137412 KINGSLEY CHURCH OF VAN WERT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: KINGSLEY UNITED METHODIST CHURCH DISTRIB
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

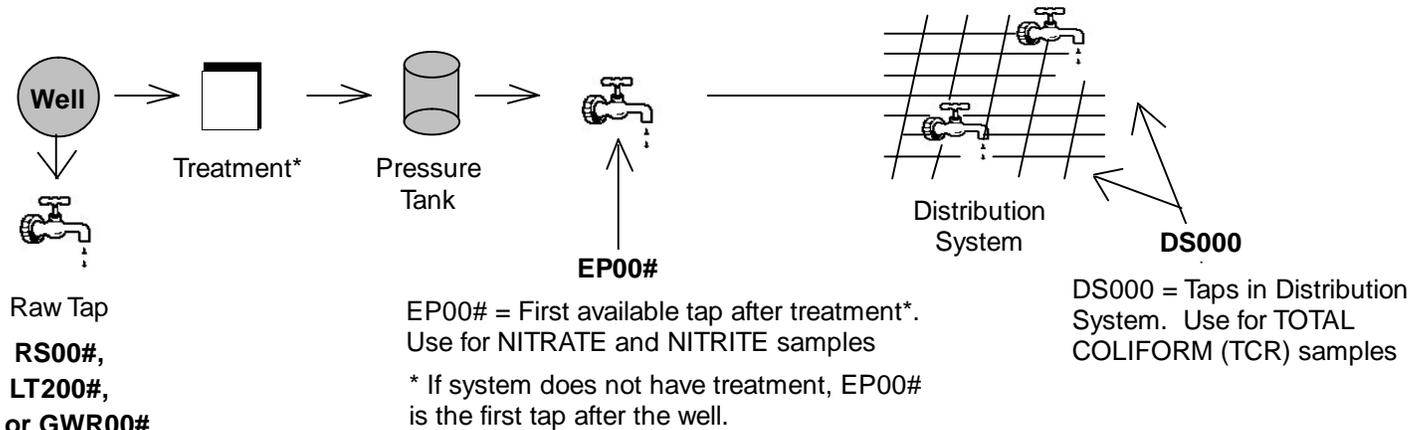

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8137412 KINGSLEY CHURCH OF VAN WERT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 8161533	Facility Name: KINGLSEY UNITED METHODIST CHURCH
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

Where to Collect Samples For a Small Public Water System

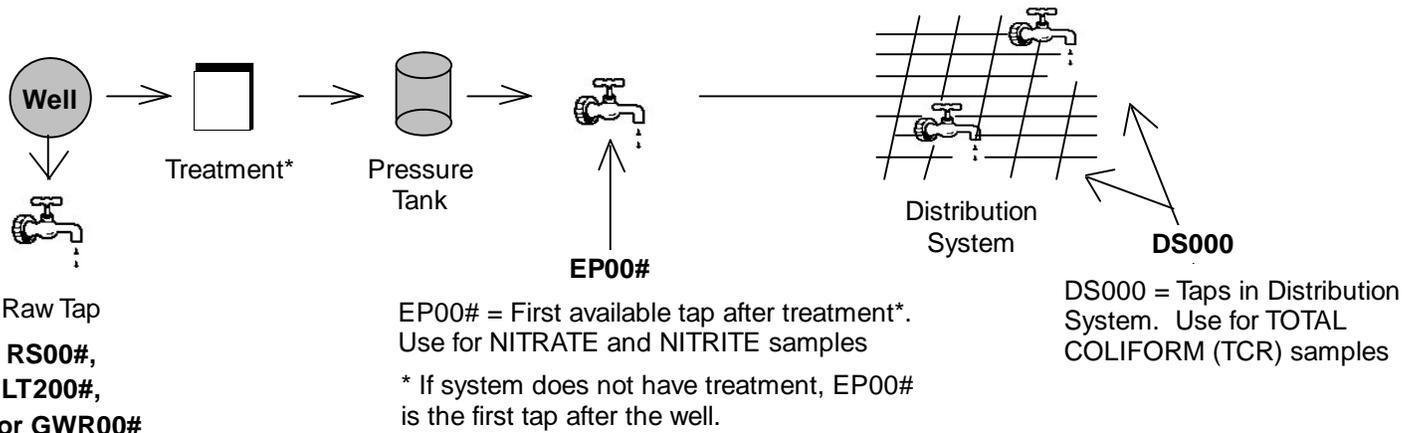

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8137512 HUGGY BEAR CAMPGROUND PHASE III

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: HUGGY BEAR CAMPGROUND PHASE III DIST
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

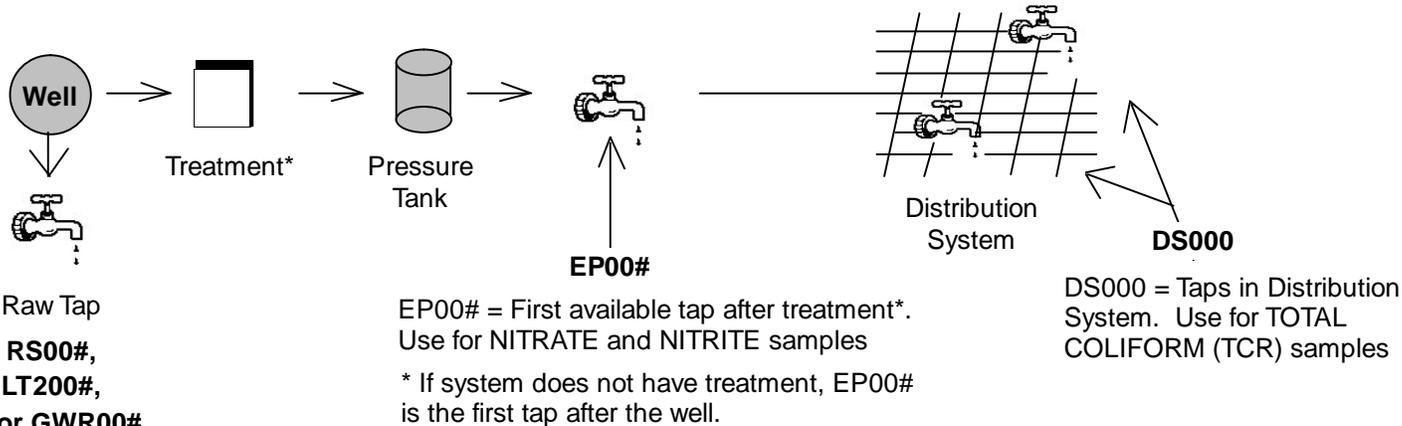

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8137512 HUGGY BEAR CAMPGROUND PHASE III

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 8162083	Facility Name: HUGGY BEAR CAMPGROUND PHASE III
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

Where to Collect Samples For a Small Public Water System

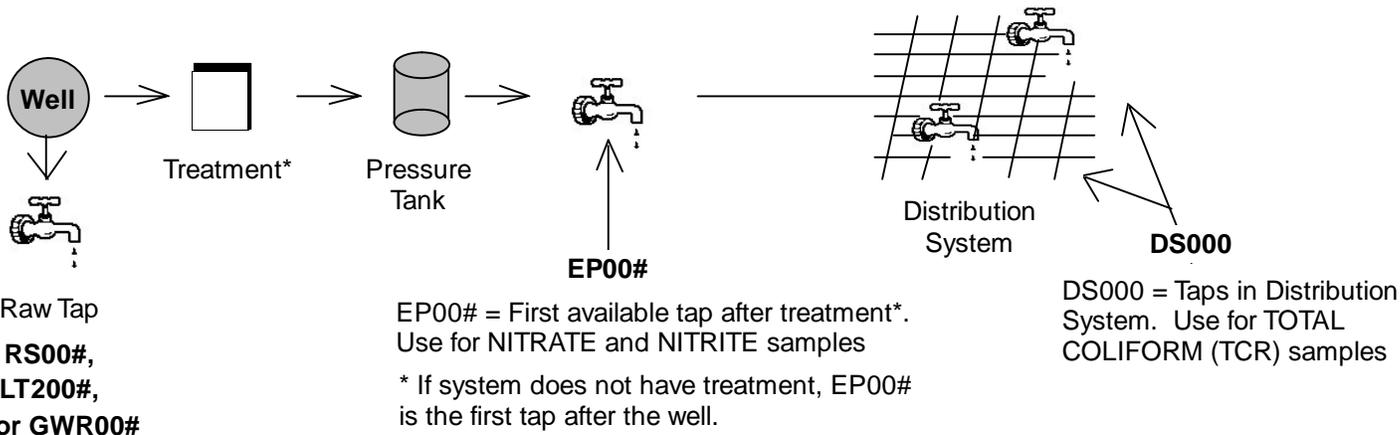

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8138012 LINCOLNVIEW BIBLE BOARD

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: LINCOLNVIEW BIBLE BOARD DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

Where to Collect Samples For a Small Public Water System

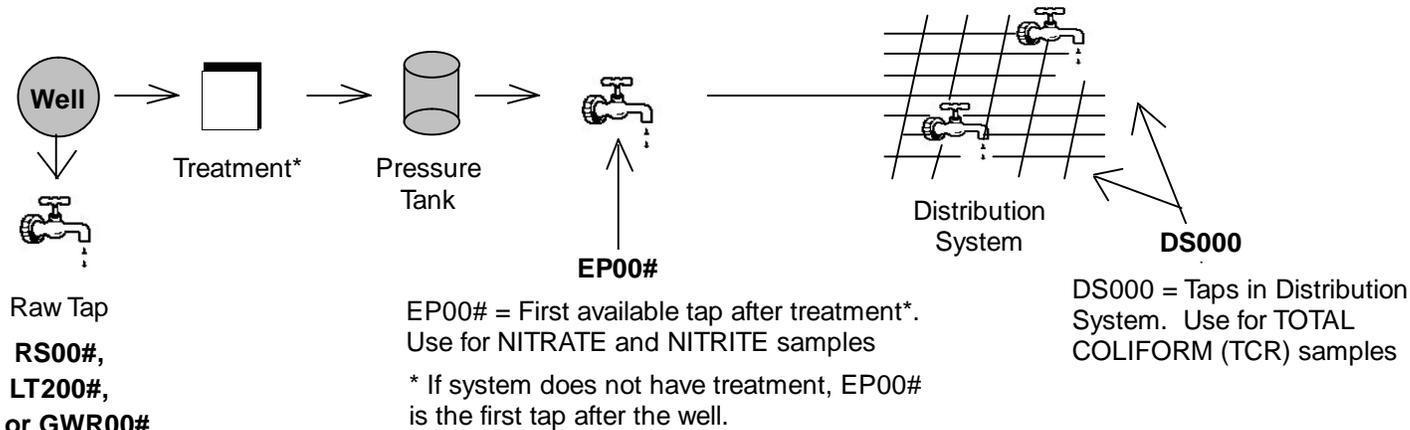

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8138012 LINCOLNVIEW BIBLE BOARD

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **8162462** Facility Name: **LINCOLNVIEW BIBLE BOARD**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

Where to Collect Samples For a Small Public Water System

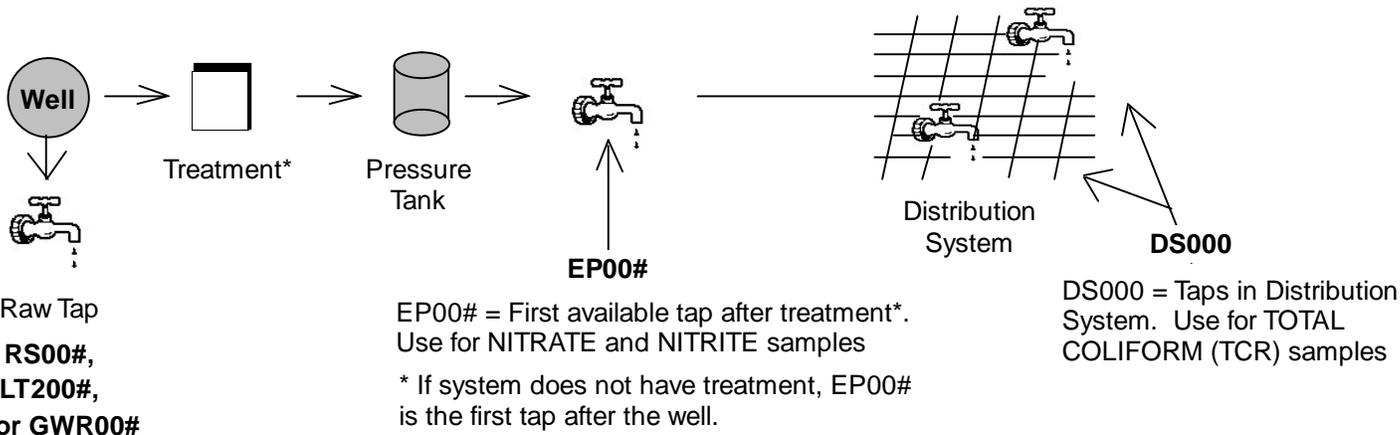

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!