



**OH8600012 BRYAN CITY**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>8659808</b>	Facility Name: <b>BRYAN CITY</b>	Facility Class: <b>CLASS 2</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2016 and 10/31/2016



**OH8600012 BRYAN CITY**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>BRYAN CITY, DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**Chemicals Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 Not Required

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100

10 Sample(s) Required between	1/1/2016	and	1/31/2016
10 Sample(s) Required between	2/1/2016	and	2/29/2016
10 Sample(s) Required between	3/1/2016	and	3/31/2016
10 Sample(s) Required between	4/1/2016	and	4/30/2016
10 Sample(s) Required between	5/1/2016	and	5/31/2016
10 Sample(s) Required between	6/1/2016	and	6/30/2016
10 Sample(s) Required between	7/1/2016	and	7/31/2016
10 Sample(s) Required between	8/1/2016	and	8/31/2016
10 Sample(s) Required between	9/1/2016	and	9/30/2016
10 Sample(s) Required between	10/1/2016	and	10/31/2016
10 Sample(s) Required between	11/1/2016	and	11/30/2016
10 Sample(s) Required between	12/1/2016	and	12/31/2016

TOTAL CHLORINE - 1000

10 Sample(s) Required between	1/1/2016	and	1/31/2016
10 Sample(s) Required between	2/1/2016	and	2/29/2016
10 Sample(s) Required between	3/1/2016	and	3/31/2016
10 Sample(s) Required between	4/1/2016	and	4/30/2016
10 Sample(s) Required between	5/1/2016	and	5/31/2016
10 Sample(s) Required between	6/1/2016	and	6/30/2016
10 Sample(s) Required between	7/1/2016	and	7/31/2016
10 Sample(s) Required between	8/1/2016	and	8/31/2016
10 Sample(s) Required between	9/1/2016	and	9/30/2016
10 Sample(s) Required between	10/1/2016	and	10/31/2016
10 Sample(s) Required between	11/1/2016	and	11/30/2016
10 Sample(s) Required between	12/1/2016	and	12/31/2016

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>BRYAN CITY, DISTRIBUTION</b> <b>107 DOROTHY DRIVE</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

**OH8600012 BRYAN CITY**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>BRYAN CITY, DISTRIBUTION</b> <b>1407 SOUTH MAIN STREET</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH8600312 EDGERTON VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>8659810</b>	Facility Name: <b>EDGERTON WTP</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2016 and 10/31/2016



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

**OH8600312 EDGERTON VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>EDGERTON, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 Not Required

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100

2 Sample(s) Required between	1/1/2016	and	1/31/2016
2 Sample(s) Required between	2/1/2016	and	2/29/2016
2 Sample(s) Required between	3/1/2016	and	3/31/2016
2 Sample(s) Required between	4/1/2016	and	4/30/2016
2 Sample(s) Required between	5/1/2016	and	5/31/2016
2 Sample(s) Required between	6/1/2016	and	6/30/2016
2 Sample(s) Required between	7/1/2016	and	7/31/2016
2 Sample(s) Required between	8/1/2016	and	8/31/2016
2 Sample(s) Required between	9/1/2016	and	9/30/2016
2 Sample(s) Required between	10/1/2016	and	10/31/2016
2 Sample(s) Required between	11/1/2016	and	11/30/2016
2 Sample(s) Required between	12/1/2016	and	12/31/2016

TOTAL CHLORINE - 1000

2 Sample(s) Required between	1/1/2016	and	1/31/2016
2 Sample(s) Required between	2/1/2016	and	2/29/2016
2 Sample(s) Required between	3/1/2016	and	3/31/2016
2 Sample(s) Required between	4/1/2016	and	4/30/2016
2 Sample(s) Required between	5/1/2016	and	5/31/2016
2 Sample(s) Required between	6/1/2016	and	6/30/2016
2 Sample(s) Required between	7/1/2016	and	7/31/2016
2 Sample(s) Required between	8/1/2016	and	8/31/2016
2 Sample(s) Required between	9/1/2016	and	9/30/2016
2 Sample(s) Required between	10/1/2016	and	10/31/2016
2 Sample(s) Required between	11/1/2016	and	11/30/2016
2 Sample(s) Required between	12/1/2016	and	12/31/2016

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>EDGERTON, VILLAGE OF DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

**OH8600312 EDGERTON VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>EDGERTON, VILLAGE OF DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH8600512 EDON VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>8659812</b>	Facility Name: <b>EDON VILLAGE WTP</b>	
<b>Location</b>	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	Facility Class: <b>CLASS 1</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 7/1/2016 and 9/30/2016



**OH8600512 EDON VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>EDON, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2016 and 9/30/2016

*Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>*

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between 1/1/2016 and 1/31/2016

1 Sample(s) Required between 2/1/2016 and 2/29/2016

1 Sample(s) Required between 3/1/2016 and 3/31/2016

1 Sample(s) Required between 4/1/2016 and 4/30/2016

1 Sample(s) Required between 5/1/2016 and 5/31/2016

1 Sample(s) Required between 6/1/2016 and 6/30/2016

1 Sample(s) Required between 7/1/2016 and 7/31/2016

1 Sample(s) Required between 8/1/2016 and 8/31/2016

1 Sample(s) Required between 9/1/2016 and 9/30/2016

1 Sample(s) Required between 10/1/2016 and 10/31/2016

1 Sample(s) Required between 11/1/2016 and 11/30/2016

1 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000

1 Sample(s) Required between 1/1/2016 and 1/31/2016

1 Sample(s) Required between 2/1/2016 and 2/29/2016

1 Sample(s) Required between 3/1/2016 and 3/31/2016

1 Sample(s) Required between 4/1/2016 and 4/30/2016

1 Sample(s) Required between 5/1/2016 and 5/31/2016

1 Sample(s) Required between 6/1/2016 and 6/30/2016

1 Sample(s) Required between 7/1/2016 and 7/31/2016

1 Sample(s) Required between 8/1/2016 and 8/31/2016

1 Sample(s) Required between 9/1/2016 and 9/30/2016

1 Sample(s) Required between 10/1/2016 and 10/31/2016

1 Sample(s) Required between 11/1/2016 and 11/30/2016

1 Sample(s) Required between 12/1/2016 and 12/31/2016

**Samples should be collected at the same time and place as the Total Coliform samples.**



**OH8600512 EDON VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>EDON, VILLAGE OF DISTRIBUTION</b> <b>304 LEANNE STREET</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>EDON, VILLAGE OF DISTRIBUTION</b> <b>320 PARKWAY STREET</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH8600812 NORTH PINE ESTATES**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>8659814</b>	Facility Name: <b>NORTH PINE ESTATES LLC</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**  
 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
 Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
RADIOLOGICALS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2016 and 10/31/2016



**OH8600812 NORTH PINE ESTATES**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Location** Facility ID: **DS1** Facility Name: **DISTRIBUTION SYSTEM**  
SMP ID: **DS000**

**Chemicals**

**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022

Not Required

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between	1/1/2016	and	1/31/2016
1 Sample(s) Required between	2/1/2016	and	2/29/2016
1 Sample(s) Required between	3/1/2016	and	3/31/2016
1 Sample(s) Required between	4/1/2016	and	4/30/2016
1 Sample(s) Required between	5/1/2016	and	5/31/2016
1 Sample(s) Required between	6/1/2016	and	6/30/2016
1 Sample(s) Required between	7/1/2016	and	7/31/2016
1 Sample(s) Required between	8/1/2016	and	8/31/2016
1 Sample(s) Required between	9/1/2016	and	9/30/2016
1 Sample(s) Required between	10/1/2016	and	10/31/2016
1 Sample(s) Required between	11/1/2016	and	11/30/2016
1 Sample(s) Required between	12/1/2016	and	12/31/2016

TOTAL CHLORINE - 1000

1 Sample(s) Required between	1/1/2016	and	1/31/2016
1 Sample(s) Required between	2/1/2016	and	2/29/2016
1 Sample(s) Required between	3/1/2016	and	3/31/2016
1 Sample(s) Required between	4/1/2016	and	4/30/2016
1 Sample(s) Required between	5/1/2016	and	5/31/2016
1 Sample(s) Required between	6/1/2016	and	6/30/2016
1 Sample(s) Required between	7/1/2016	and	7/31/2016
1 Sample(s) Required between	8/1/2016	and	8/31/2016
1 Sample(s) Required between	9/1/2016	and	9/30/2016
1 Sample(s) Required between	10/1/2016	and	10/31/2016
1 Sample(s) Required between	11/1/2016	and	11/30/2016
1 Sample(s) Required between	12/1/2016	and	12/31/2016

*Samples should be collected at the same time and place as the Total Coliform samples.*

**Sampling Location** Facility ID: **DS1** Facility Name: **DISTRIBUTION SYSTEM**  
SMP ID: **DS201** **05571 STATE ROUTE 15 LOT #10**

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

*Sample for all the analytes listed below:*

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH8600912 MONTPELIER VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>8662191</b>	Facility Name: <b>MONTPELIER VILLAGE 2</b>	
<b>Location</b>	SMP ID: <b>EP002</b>	Facility Source: <b>Ground Water</b>	Facility Class: <b>CLASS 2</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**  
 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
 Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2016 and 10/31/2016



OH8600912 MONTPELIER VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>MONTPELIER, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 20 Sample(s) Required between 6/1/2016 and 9/30/2016

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: http://epa.ohio.gov/ddagw/reporting.aspx

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100

5 Sample(s) Required between 1/1/2016 and 1/31/2016

5 Sample(s) Required between 2/1/2016 and 2/29/2016

5 Sample(s) Required between 3/1/2016 and 3/31/2016

5 Sample(s) Required between 4/1/2016 and 4/30/2016

5 Sample(s) Required between 5/1/2016 and 5/31/2016

5 Sample(s) Required between 6/1/2016 and 6/30/2016

5 Sample(s) Required between 7/1/2016 and 7/31/2016

5 Sample(s) Required between 8/1/2016 and 8/31/2016

5 Sample(s) Required between 9/1/2016 and 9/30/2016

5 Sample(s) Required between 10/1/2016 and 10/31/2016

5 Sample(s) Required between 11/1/2016 and 11/30/2016

5 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000

5 Sample(s) Required between 1/1/2016 and 1/31/2016

5 Sample(s) Required between 2/1/2016 and 2/29/2016

5 Sample(s) Required between 3/1/2016 and 3/31/2016

5 Sample(s) Required between 4/1/2016 and 4/30/2016

5 Sample(s) Required between 5/1/2016 and 5/31/2016

5 Sample(s) Required between 6/1/2016 and 6/30/2016

5 Sample(s) Required between 7/1/2016 and 7/31/2016

5 Sample(s) Required between 8/1/2016 and 8/31/2016

5 Sample(s) Required between 9/1/2016 and 9/30/2016

5 Sample(s) Required between 10/1/2016 and 10/31/2016

5 Sample(s) Required between 11/1/2016 and 11/30/2016

5 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.



**OH8600912 MONTPELIER VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>MONTPELIER, VILLAGE OF DISTRIBUTION</b> <b>14469 COUNTY ROAD 15</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

<b>Chemicals</b>	<b>Monitoring Requirements</b>
------------------	--------------------------------

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>MONTPELIER, VILLAGE OF DISTRIBUTION</b> <b>580 STEUBEN ST</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

<b>Chemicals</b>	<b>Monitoring Requirements</b>
------------------	--------------------------------

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH8601012 AQUA OHIO - NORLICK**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>8659816</b>	Facility Name: <b>AQUA OHIO - NORLICK</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**  
 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
 Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
RADIOLOGICALS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2016 and 10/31/2016



**OH8601012 AQUA OHIO - NORLICK**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>AQUA OHIO - NORLICK DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**Chemicals Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 Not Required

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2016	and	1/31/2016
	1 Sample(s) Required between	2/1/2016	and	2/29/2016
	1 Sample(s) Required between	3/1/2016	and	3/31/2016
	1 Sample(s) Required between	4/1/2016	and	4/30/2016
	1 Sample(s) Required between	5/1/2016	and	5/31/2016
	1 Sample(s) Required between	6/1/2016	and	6/30/2016
	1 Sample(s) Required between	7/1/2016	and	7/31/2016
	1 Sample(s) Required between	8/1/2016	and	8/31/2016
	1 Sample(s) Required between	9/1/2016	and	9/30/2016
	1 Sample(s) Required between	10/1/2016	and	10/31/2016
	1 Sample(s) Required between	11/1/2016	and	11/30/2016
	1 Sample(s) Required between	12/1/2016	and	12/31/2016

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2016	and	1/31/2016
	1 Sample(s) Required between	2/1/2016	and	2/29/2016
	1 Sample(s) Required between	3/1/2016	and	3/31/2016
	1 Sample(s) Required between	4/1/2016	and	4/30/2016
	1 Sample(s) Required between	5/1/2016	and	5/31/2016
	1 Sample(s) Required between	6/1/2016	and	6/30/2016
	1 Sample(s) Required between	7/1/2016	and	7/31/2016
	1 Sample(s) Required between	8/1/2016	and	8/31/2016
	1 Sample(s) Required between	9/1/2016	and	9/30/2016
	1 Sample(s) Required between	10/1/2016	and	10/31/2016
	1 Sample(s) Required between	11/1/2016	and	11/30/2016
	1 Sample(s) Required between	12/1/2016	and	12/31/2016

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>AQUA OHIO - NORLICK DISTRIBUTION</b> <b>121 SCOTT DRIVE</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH8601112 NORTHLAND SENIOR COMMUNITY**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>8659817</b>	Facility Name: <b>NORTHLAND SR COMMUNITY</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**  
 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
 Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2016 and 10/31/2016



**OH8601112 NORTHLAND SENIOR COMMUNITY**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Location** Facility ID: **DS1** Facility Name: **NORTHLAND SR COMM DISTRIBUTION**  
SMP ID: **DS000**

**Chemicals Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 Not Required

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2016	and	1/31/2016
	1 Sample(s) Required between	2/1/2016	and	2/29/2016
	1 Sample(s) Required between	3/1/2016	and	3/31/2016
	1 Sample(s) Required between	4/1/2016	and	4/30/2016
	1 Sample(s) Required between	5/1/2016	and	5/31/2016
	1 Sample(s) Required between	6/1/2016	and	6/30/2016
	1 Sample(s) Required between	7/1/2016	and	7/31/2016
	1 Sample(s) Required between	8/1/2016	and	8/31/2016
	1 Sample(s) Required between	9/1/2016	and	9/30/2016
	1 Sample(s) Required between	10/1/2016	and	10/31/2016
	1 Sample(s) Required between	11/1/2016	and	11/30/2016
	1 Sample(s) Required between	12/1/2016	and	12/31/2016

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2016	and	1/31/2016
	1 Sample(s) Required between	2/1/2016	and	2/29/2016
	1 Sample(s) Required between	3/1/2016	and	3/31/2016
	1 Sample(s) Required between	4/1/2016	and	4/30/2016
	1 Sample(s) Required between	5/1/2016	and	5/31/2016
	1 Sample(s) Required between	6/1/2016	and	6/30/2016
	1 Sample(s) Required between	7/1/2016	and	7/31/2016
	1 Sample(s) Required between	8/1/2016	and	8/31/2016
	1 Sample(s) Required between	9/1/2016	and	9/30/2016
	1 Sample(s) Required between	10/1/2016	and	10/31/2016
	1 Sample(s) Required between	11/1/2016	and	11/30/2016
	1 Sample(s) Required between	12/1/2016	and	12/31/2016

*Samples should be collected at the same time and place as the Total Coliform samples.*

**Sampling Location** Facility ID: **DS1** Facility Name: **NORTHLAND SR COMM DISTRIBUTION**  
SMP ID: **DS201** ADDRESS NOT KNOWN

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH8601212 OAKWOOD MHP**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>8659818</b>	Facility Name: <b>OAKWOOD MHP STU 1</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020	
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 4/1/2016 and 6/30/2016



**OH8601212 OAKWOOD MHP**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>8660632</b> SMP ID: <b>EP002</b>	Facility Name: <b>OAKWOOD MHP STU 2</b> Facility Source: <b>Ground Water</b>	Facility Class: <b>CLASS A</b>
--------------------------	---	---	--------------------------------

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**  
 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
 Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS <i>Sample for all the analytes listed below:</i> ANTIMONY, TOTAL - 1074   ARSENIC - 1005   BARIUM - 1010   BERYLLIUM, TOTAL - 1075   CADMIUM - 1015   CHROMIUM - 1020 CYANIDE - 1024   FLUORIDE - 1025   MERCURY - 1035   NICKEL - 1036   SELENIUM - 1045   THALLIUM, TOTAL - 1085	1 Sample(s) Required between 6/1/2016 and 10/31/2016
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 7/1/2016 and 9/30/2016



**OH8601212 OAKWOOD MHP**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Location** Facility ID: **DS1** Facility Name: **OAKWOOD MHP DISTRIBUTION**  
SMP ID: **DS000**

**Chemicals**

**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022

Not Required

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between	1/1/2016	and	1/31/2016
1 Sample(s) Required between	2/1/2016	and	2/29/2016
1 Sample(s) Required between	3/1/2016	and	3/31/2016
1 Sample(s) Required between	4/1/2016	and	4/30/2016
1 Sample(s) Required between	5/1/2016	and	5/31/2016
1 Sample(s) Required between	6/1/2016	and	6/30/2016
1 Sample(s) Required between	7/1/2016	and	7/31/2016
1 Sample(s) Required between	8/1/2016	and	8/31/2016
1 Sample(s) Required between	9/1/2016	and	9/30/2016
1 Sample(s) Required between	10/1/2016	and	10/31/2016
1 Sample(s) Required between	11/1/2016	and	11/30/2016
1 Sample(s) Required between	12/1/2016	and	12/31/2016

TOTAL CHLORINE - 1000

1 Sample(s) Required between	1/1/2016	and	1/31/2016
1 Sample(s) Required between	2/1/2016	and	2/29/2016
1 Sample(s) Required between	3/1/2016	and	3/31/2016
1 Sample(s) Required between	4/1/2016	and	4/30/2016
1 Sample(s) Required between	5/1/2016	and	5/31/2016
1 Sample(s) Required between	6/1/2016	and	6/30/2016
1 Sample(s) Required between	7/1/2016	and	7/31/2016
1 Sample(s) Required between	8/1/2016	and	8/31/2016
1 Sample(s) Required between	9/1/2016	and	9/30/2016
1 Sample(s) Required between	10/1/2016	and	10/31/2016
1 Sample(s) Required between	11/1/2016	and	11/30/2016
1 Sample(s) Required between	12/1/2016	and	12/31/2016

*Samples should be collected at the same time and place as the Total Coliform samples.*

**Sampling Location** Facility ID: **DS1** Facility Name: **OAKWOOD MHP DISTRIBUTION**  
SMP ID: **DS201** ADDRESS NOT KNOWN

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

*Sample for all the analytes listed below:*

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH8601312 PIONEER VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>8659819</b>	Facility Name: <b>PIONEER, VILLAGE OF</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**  
 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
 Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
RADIOLOGICALS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2016 and 10/31/2016



**OH8601312 PIONEER VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>PIONEER, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**Chemicals Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2016 and 9/30/2016

*Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>*

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100

2 Sample(s) Required between 1/1/2016 and 1/31/2016

2 Sample(s) Required between 2/1/2016 and 2/29/2016

2 Sample(s) Required between 3/1/2016 and 3/31/2016

2 Sample(s) Required between 4/1/2016 and 4/30/2016

2 Sample(s) Required between 5/1/2016 and 5/31/2016

2 Sample(s) Required between 6/1/2016 and 6/30/2016

2 Sample(s) Required between 7/1/2016 and 7/31/2016

2 Sample(s) Required between 8/1/2016 and 8/31/2016

2 Sample(s) Required between 9/1/2016 and 9/30/2016

2 Sample(s) Required between 10/1/2016 and 10/31/2016

2 Sample(s) Required between 11/1/2016 and 11/30/2016

2 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000

2 Sample(s) Required between 1/1/2016 and 1/31/2016

2 Sample(s) Required between 2/1/2016 and 2/29/2016

2 Sample(s) Required between 3/1/2016 and 3/31/2016

2 Sample(s) Required between 4/1/2016 and 4/30/2016

2 Sample(s) Required between 5/1/2016 and 5/31/2016

2 Sample(s) Required between 6/1/2016 and 6/30/2016

2 Sample(s) Required between 7/1/2016 and 7/31/2016

2 Sample(s) Required between 8/1/2016 and 8/31/2016

2 Sample(s) Required between 9/1/2016 and 9/30/2016

2 Sample(s) Required between 10/1/2016 and 10/31/2016

2 Sample(s) Required between 11/1/2016 and 11/30/2016

2 Sample(s) Required between 12/1/2016 and 12/31/2016

**Samples should be collected at the same time and place as the Total Coliform samples.**



**OH8601312 PIONEER VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>PIONEER, VILLAGE OF DISTRIBUTION</b> <b>504 NORTH STATE ST.</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

<b>Chemicals</b>	<b>Monitoring Requirements</b>
------------------	--------------------------------

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>PIONEER, VILLAGE OF DISTRIBUTION</b> <b>600 SOUTH STATE ST.</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

<b>Chemicals</b>	<b>Monitoring Requirements</b>
------------------	--------------------------------

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH8601512 AQUA OHIO - SENECA**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>8659820</b>	Facility Name: <b>AQUA OHIO - SENECA</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
ARSENIC - 1005	1 Sample(s) Required between 1/1/2016 and 3/31/2016 1 Sample(s) Required between 4/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 9/30/2016 1 Sample(s) Required between 10/1/2016 and 12/31/2016
INORGANICS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
<i>Sample for all the analytes listed below:</i>	
<i>ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTA CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL</i>	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2016 and 10/31/2016



OH8601512 AQUA OHIO - SENECA

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>AQUA OHIO - SENECA DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between	1/1/2016	and	1/31/2016
1 Sample(s) Required between	2/1/2016	and	2/29/2016
1 Sample(s) Required between	3/1/2016	and	3/31/2016
1 Sample(s) Required between	4/1/2016	and	4/30/2016
1 Sample(s) Required between	5/1/2016	and	5/31/2016
1 Sample(s) Required between	6/1/2016	and	6/30/2016
1 Sample(s) Required between	7/1/2016	and	7/31/2016
1 Sample(s) Required between	8/1/2016	and	8/31/2016
1 Sample(s) Required between	9/1/2016	and	9/30/2016
1 Sample(s) Required between	10/1/2016	and	10/31/2016
1 Sample(s) Required between	11/1/2016	and	11/30/2016
1 Sample(s) Required between	12/1/2016	and	12/31/2016

TOTAL CHLORINE - 1000

1 Sample(s) Required between	1/1/2016	and	1/31/2016
1 Sample(s) Required between	2/1/2016	and	2/29/2016
1 Sample(s) Required between	3/1/2016	and	3/31/2016
1 Sample(s) Required between	4/1/2016	and	4/30/2016
1 Sample(s) Required between	5/1/2016	and	5/31/2016
1 Sample(s) Required between	6/1/2016	and	6/30/2016
1 Sample(s) Required between	7/1/2016	and	7/31/2016
1 Sample(s) Required between	8/1/2016	and	8/31/2016
1 Sample(s) Required between	9/1/2016	and	9/30/2016
1 Sample(s) Required between	10/1/2016	and	10/31/2016
1 Sample(s) Required between	11/1/2016	and	11/30/2016
1 Sample(s) Required between	12/1/2016	and	12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>AQUA OHIO - SENECA DISTRIBUTION</b> <b>233 SENECA DRIVE</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

**OH8601512 AQUA OHIO - SENECA**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>AQUA OHIO - SENECA DISTRIBUTION</b> <b>708 SENECA DRIVE</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH8601712 STRYKER VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>8659822</b>	Facility Name: <b>STRYKER VILLAGE</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2016 and 10/31/2016



**OH8601712 STRYKER VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>STRYKER, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**Chemicals Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 Not Required

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100

2 Sample(s) Required between	1/1/2016	and	1/31/2016
2 Sample(s) Required between	2/1/2016	and	2/29/2016
2 Sample(s) Required between	3/1/2016	and	3/31/2016
2 Sample(s) Required between	4/1/2016	and	4/30/2016
2 Sample(s) Required between	5/1/2016	and	5/31/2016
2 Sample(s) Required between	6/1/2016	and	6/30/2016
2 Sample(s) Required between	7/1/2016	and	7/31/2016
2 Sample(s) Required between	8/1/2016	and	8/31/2016
2 Sample(s) Required between	9/1/2016	and	9/30/2016
2 Sample(s) Required between	10/1/2016	and	10/31/2016
2 Sample(s) Required between	11/1/2016	and	11/30/2016
2 Sample(s) Required between	12/1/2016	and	12/31/2016

TOTAL CHLORINE - 1000

2 Sample(s) Required between	1/1/2016	and	1/31/2016
2 Sample(s) Required between	2/1/2016	and	2/29/2016
2 Sample(s) Required between	3/1/2016	and	3/31/2016
2 Sample(s) Required between	4/1/2016	and	4/30/2016
2 Sample(s) Required between	5/1/2016	and	5/31/2016
2 Sample(s) Required between	6/1/2016	and	6/30/2016
2 Sample(s) Required between	7/1/2016	and	7/31/2016
2 Sample(s) Required between	8/1/2016	and	8/31/2016
2 Sample(s) Required between	9/1/2016	and	9/30/2016
2 Sample(s) Required between	10/1/2016	and	10/31/2016
2 Sample(s) Required between	11/1/2016	and	11/30/2016
2 Sample(s) Required between	12/1/2016	and	12/31/2016

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>STRYKER, VILLAGE OF DISTRIBUTION</b> <b>203 NORTH DEPOT STREET</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

**OH8601712 STRYKER VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>STRYKER, VILLAGE OF DISTRIBUTION</b> <b>206 NORTH DEFIANCE STREET</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

<b>Chemicals</b>	<b>Monitoring Requirements</b>
------------------	--------------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS202
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH8601812 WEST UNITY VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>8659823</b>	Facility Name: <b>WEST UNITY WTP</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**  
 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
 Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2016 and 10/31/2016



OH8601812 WEST UNITY VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>WEST UNITY, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2016 and 9/30/2016

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: http://epa.ohio.gov/ddagw/reporting.aspx

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100

2 Sample(s) Required between 1/1/2016 and 1/31/2016

2 Sample(s) Required between 2/1/2016 and 2/29/2016

2 Sample(s) Required between 3/1/2016 and 3/31/2016

2 Sample(s) Required between 4/1/2016 and 4/30/2016

2 Sample(s) Required between 5/1/2016 and 5/31/2016

2 Sample(s) Required between 6/1/2016 and 6/30/2016

2 Sample(s) Required between 7/1/2016 and 7/31/2016

2 Sample(s) Required between 8/1/2016 and 8/31/2016

2 Sample(s) Required between 9/1/2016 and 9/30/2016

2 Sample(s) Required between 10/1/2016 and 10/31/2016

2 Sample(s) Required between 11/1/2016 and 11/30/2016

2 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000

2 Sample(s) Required between 1/1/2016 and 1/31/2016

2 Sample(s) Required between 2/1/2016 and 2/29/2016

2 Sample(s) Required between 3/1/2016 and 3/31/2016

2 Sample(s) Required between 4/1/2016 and 4/30/2016

2 Sample(s) Required between 5/1/2016 and 5/31/2016

2 Sample(s) Required between 6/1/2016 and 6/30/2016

2 Sample(s) Required between 7/1/2016 and 7/31/2016

2 Sample(s) Required between 8/1/2016 and 8/31/2016

2 Sample(s) Required between 9/1/2016 and 9/30/2016

2 Sample(s) Required between 10/1/2016 and 10/31/2016

2 Sample(s) Required between 11/1/2016 and 11/30/2016

2 Sample(s) Required between 12/1/2016 and 12/31/2016

Samples should be collected at the same time and place as the Total Coliform samples.



**OH8601812 WEST UNITY VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>WEST UNITY, VILLAGE OF DISTRIBUTION</b> <b>104 LE ANN LANE</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

<b>Chemicals</b>	<b>Monitoring Requirements</b>
------------------	--------------------------------

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>WEST UNITY, VILLAGE OF DISTRIBUTION</b> <b>210 NORTH ST</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

<b>Chemicals</b>	<b>Monitoring Requirements</b>
------------------	--------------------------------

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH8601912 WILLIAMS CO/HILLSIDE COUNTRY LIVING**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>8659824</b>	Facility Name: <b>WILLIAMS CO/HILLSIDE CTRY LIVING</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**  
 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
 Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
RADIOLOGICALS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2016 and 10/31/2016



**OH8601912 WILLIAMS CO/HILLSIDE COUNTRY LIVING**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2016**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>WILLIAMS CO/HILLSIDE CTRY LIVING DIST</b>
	SMP ID: <b>DS000</b>	

**Chemicals Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2016 and 9/30/2016

*Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>*

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between 1/1/2016 and 1/31/2016

1 Sample(s) Required between 2/1/2016 and 2/29/2016

1 Sample(s) Required between 3/1/2016 and 3/31/2016

1 Sample(s) Required between 4/1/2016 and 4/30/2016

1 Sample(s) Required between 5/1/2016 and 5/31/2016

1 Sample(s) Required between 6/1/2016 and 6/30/2016

1 Sample(s) Required between 7/1/2016 and 7/31/2016

1 Sample(s) Required between 8/1/2016 and 8/31/2016

1 Sample(s) Required between 9/1/2016 and 9/30/2016

1 Sample(s) Required between 10/1/2016 and 10/31/2016

1 Sample(s) Required between 11/1/2016 and 11/30/2016

1 Sample(s) Required between 12/1/2016 and 12/31/2016

TOTAL CHLORINE - 1000

1 Sample(s) Required between 1/1/2016 and 1/31/2016

1 Sample(s) Required between 2/1/2016 and 2/29/2016

1 Sample(s) Required between 3/1/2016 and 3/31/2016

1 Sample(s) Required between 4/1/2016 and 4/30/2016

1 Sample(s) Required between 5/1/2016 and 5/31/2016

1 Sample(s) Required between 6/1/2016 and 6/30/2016

1 Sample(s) Required between 7/1/2016 and 7/31/2016

1 Sample(s) Required between 8/1/2016 and 8/31/2016

1 Sample(s) Required between 9/1/2016 and 9/30/2016

1 Sample(s) Required between 10/1/2016 and 10/31/2016

1 Sample(s) Required between 11/1/2016 and 11/30/2016

1 Sample(s) Required between 12/1/2016 and 12/31/2016

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>WILLIAMS CO/HILLSIDE CTRY LIVING DIST</b>
	SMP ID: <b>DS201</b>	<b>HERITAGE KITCHEN HANDWASH SI</b>

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2016 and 9/30/2016 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH8631912 PULASKI HEAD START**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>8659837</b>	Facility Name: <b>PULASKI HEAD START</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**  
 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
 Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2016 and 10/31/2016



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

**OH8631912 PULASKI HEAD START**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1 Facility Name: PULASKI HEAD START DISTRIBUTION**  
**Location SMP ID: DS000**

**Chemicals**

**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022

Not Required

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between 1/1/2016 and 3/31/2016  
1 Sample(s) Required between 4/1/2016 and 6/30/2016  
1 Sample(s) Required between 7/1/2016 and 9/30/2016  
1 Sample(s) Required between 10/1/2016 and 12/31/2016

**OH8632312 SAMS PLACE TAVERN**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: SAMS PLACE DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

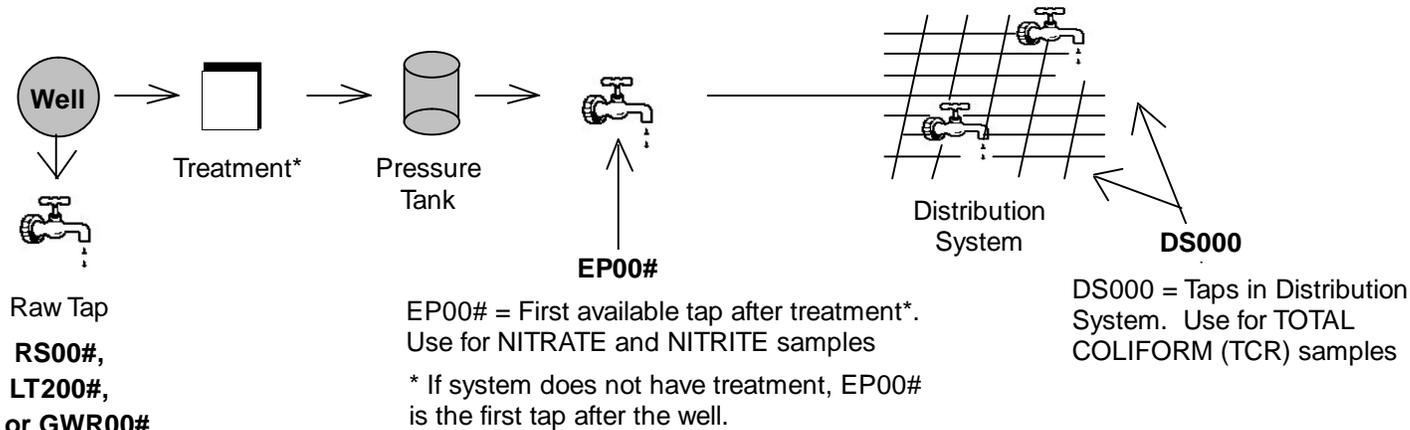

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8632312 SAMS PLACE TAVERN**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **8659841** Facility Name: **SAMS PLACE**

**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

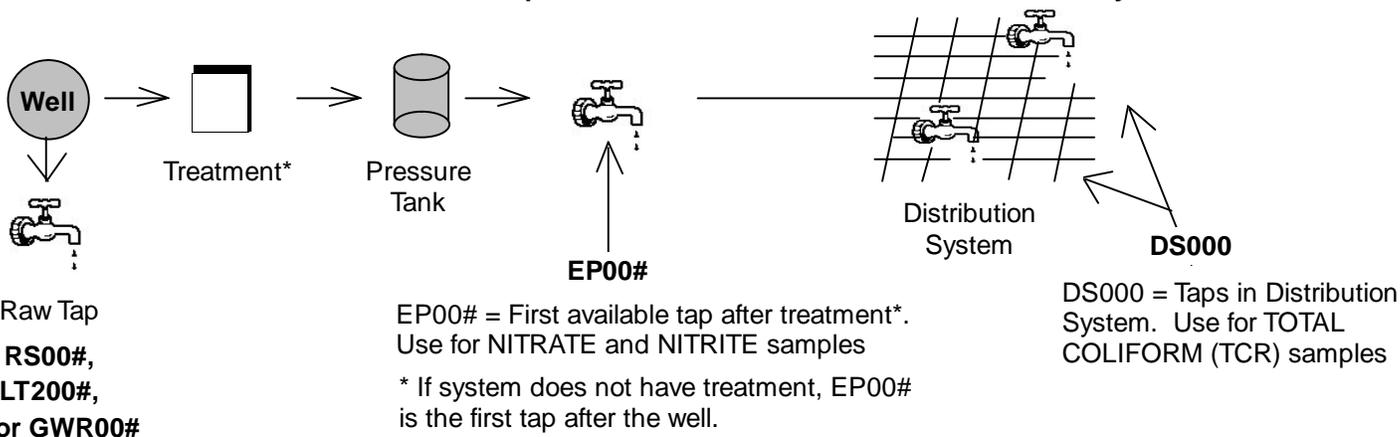

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8633112 WINDWOOD HOLLOW GOLF COURSE**

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: WINDWOOD HOLLOW GOLF COU DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 9/30/2016

**Where to Collect Samples For a Small Public Water System**

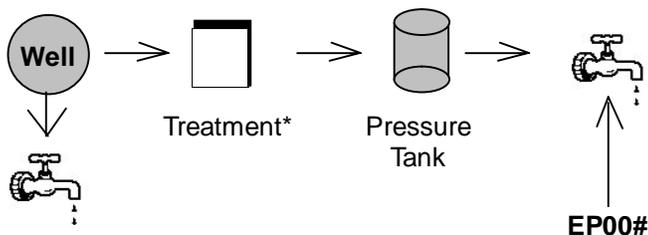

Raw Tap  
**RS00#,**  
**LT200#,**  
**or GWR00#**

EP00# = First available tap after treatment\*.  
Use for NITRATE and NITRITE samples  
\* If system does not have treatment, EP00# is the first tap after the well.

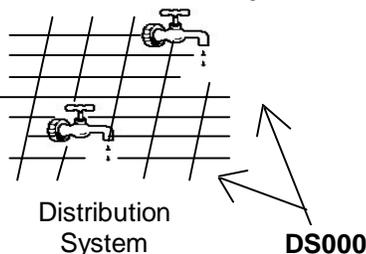

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8633112 WINDWOOD HOLLOW GOLF COURSE**

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **8659846** Facility Name: **WINDWOOD HOLLOW GOLF COURSE**

**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

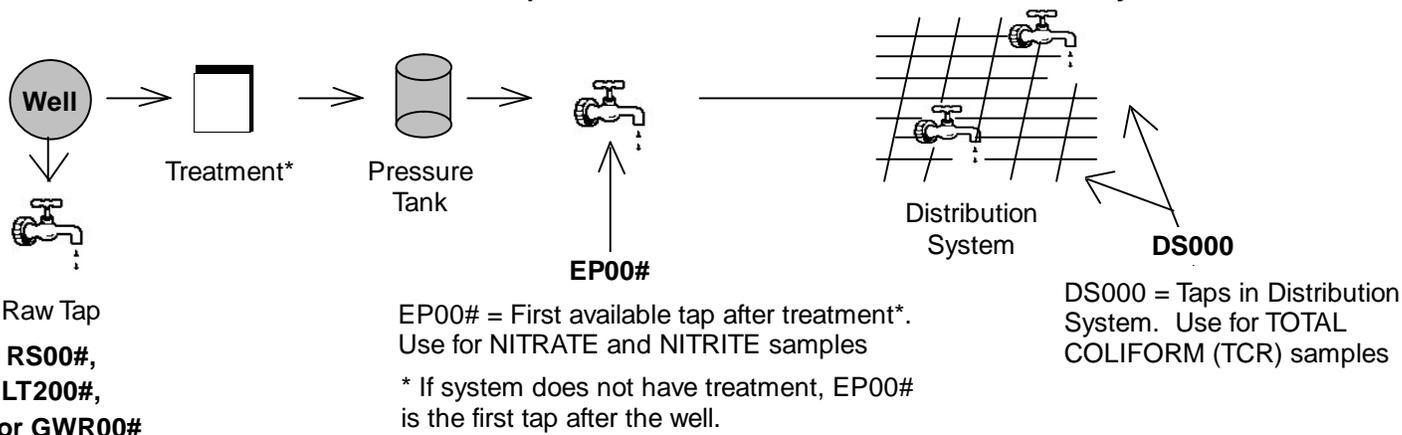

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH8633312 AIRMATE COMPANY**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>8659848</b>	Facility Name: <b>AIRMATE CO INC</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2016 and 10/31/2016



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

**OH8633312 AIRMATE COMPANY**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1 Facility Name: AIRMATE CO INC DISTRIBUTION**  
**Location SMP ID: DS000**

**Chemicals**

**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022

Not Required

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between 1/1/2016 and 3/31/2016  
1 Sample(s) Required between 4/1/2016 and 6/30/2016  
1 Sample(s) Required between 7/1/2016 and 9/30/2016  
1 Sample(s) Required between 10/1/2016 and 12/31/2016

**OH8633512 D AND L TOWN AND COUNTRY**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> D & LTOWN CO DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

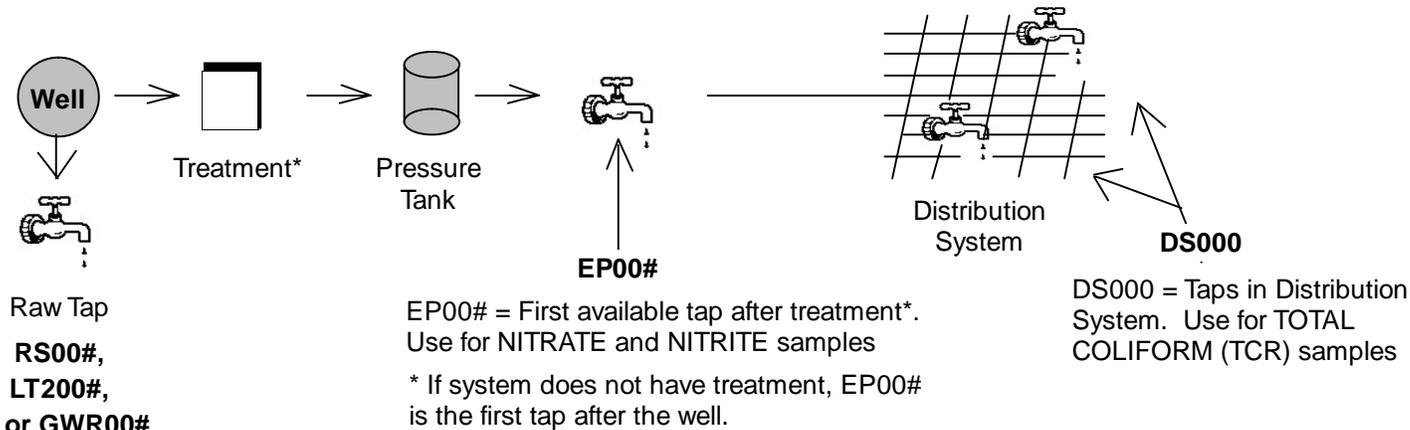

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8633512 D AND L TOWN AND COUNTRY**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **8659850** Facility Name: **D & L TOWN AND COUNTRY**

**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

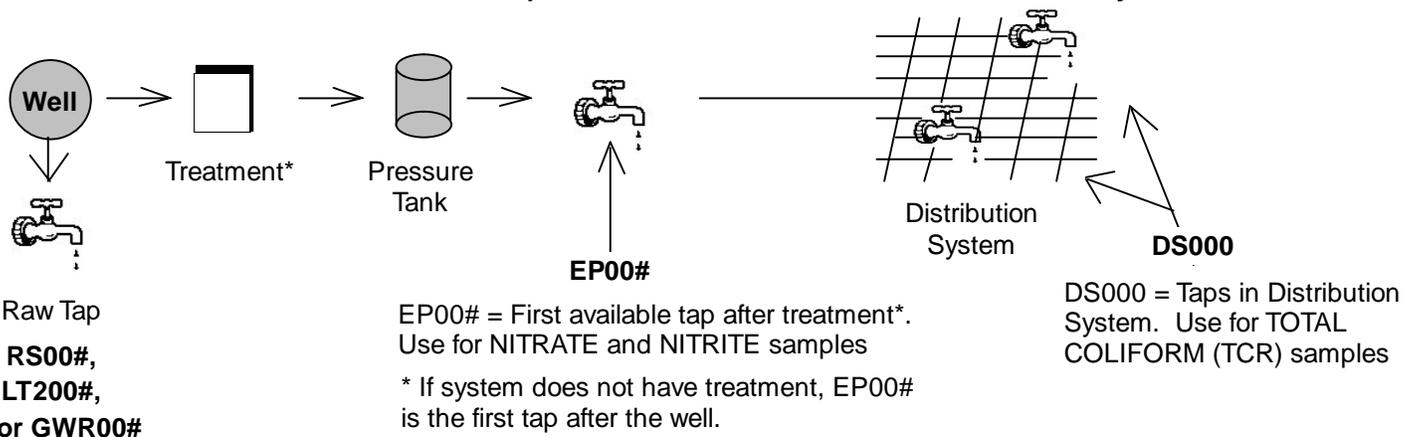

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH8633612 ANDERSON VREELAND**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>8659851</b>	Facility Name: <b>ANDERSON VREELAND</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2016 and 10/31/2016



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

**OH8633612 ANDERSON VREELAND**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>ANDERSON VREELAND DISTRIBUTION</b>
	SMP ID: <b>DS000</b>	

**Chemicals**

**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022

Not Required

**OH8633912 PIONEER SCOUT RESERVE [BSA]-CAMP**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: PIONEER SCOUT RES-CAMP DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

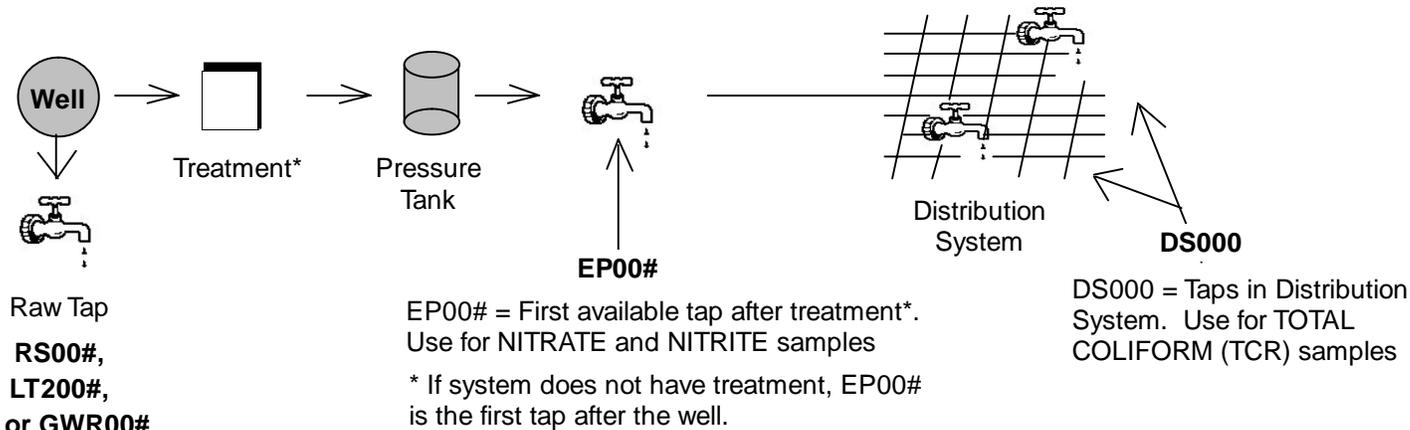

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8633912 PIONEER SCOUT RESERVE [BSA]-CAMP**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 8659854 Facility Name: PIONEER SCOUT RES - CAMP**

**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

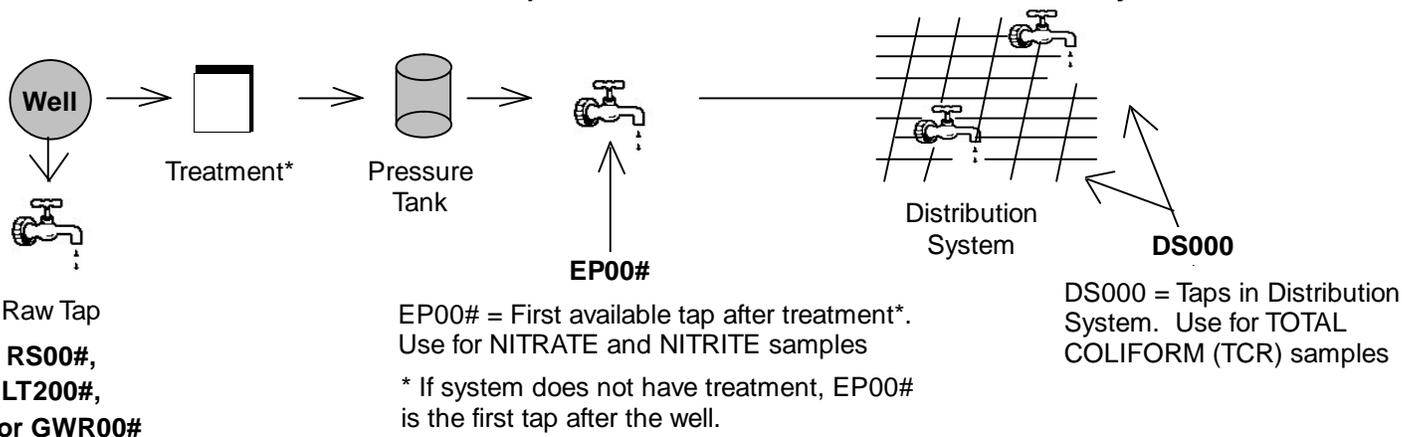

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8634112 BRIDGEWATER COMMUNITY CHURCH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: BRIDGEWATER COMMUNITY CH DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

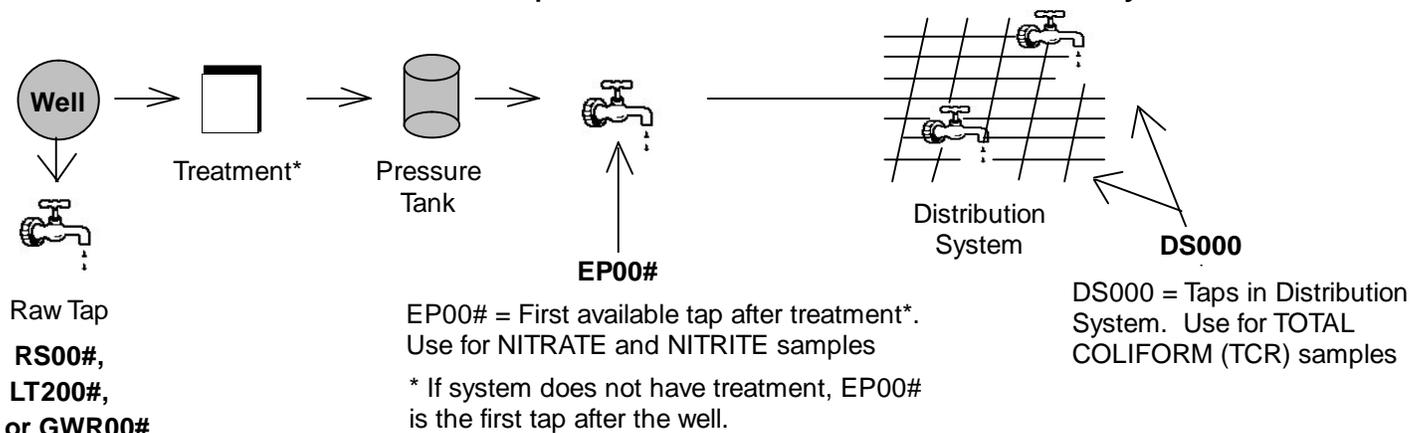

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8634112 BRIDGEWATER COMMUNITY CHURCH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 8659855	<b>Facility Name:</b> BRIDGEWATER COMMUNITY CHURCH
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

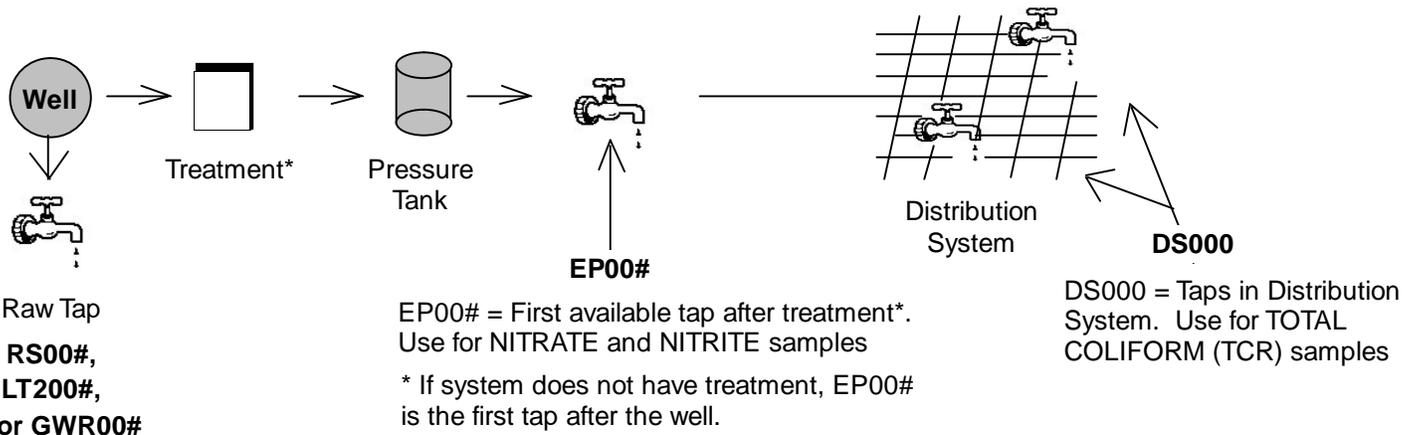

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8634512 CAMP DICLAIR**

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> CAMP DICLAIR DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 9/30/2016

**Where to Collect Samples For a Small Public Water System**

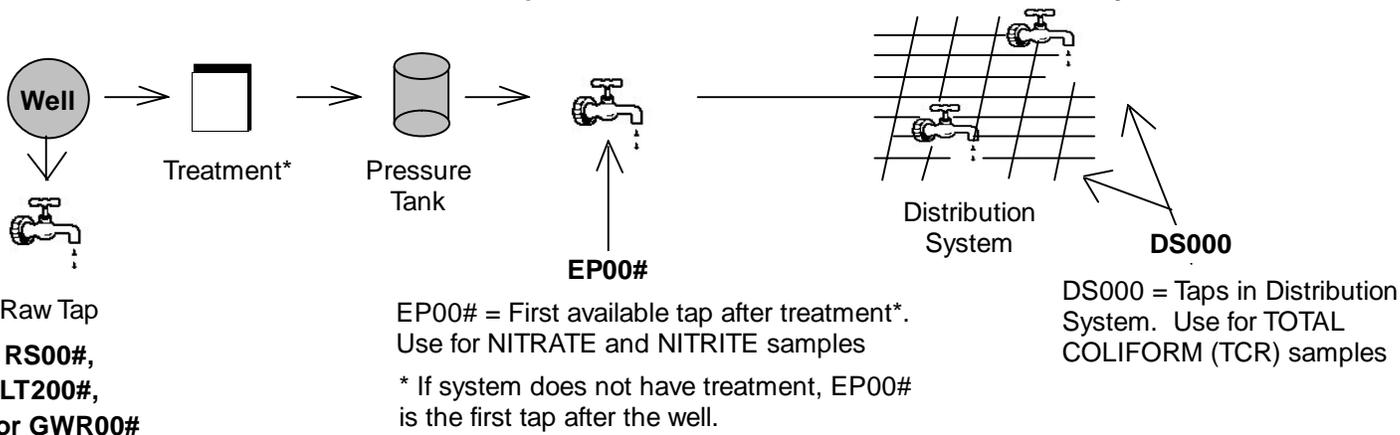

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8634512 CAMP DICLAIR**

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **8659856** Facility Name: **CAMP DICLAIR**

**Location** SMP ID: **EP001** Facility Source: **Ground Water**

**Chemicals**

**Monitoring Requirements**


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

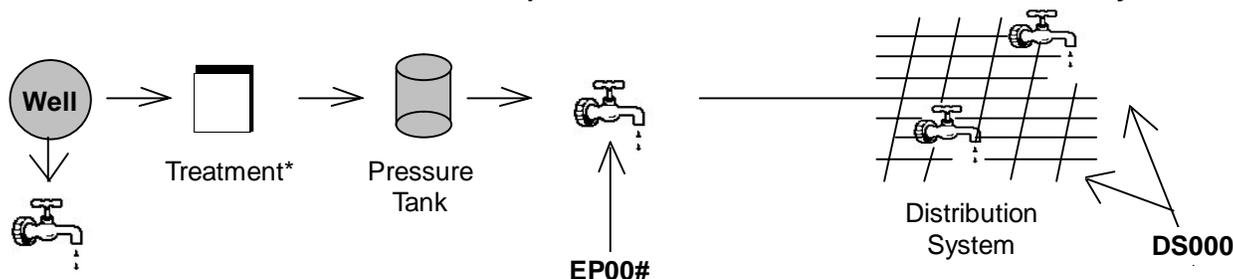

Raw Tap  
**RS00#**,  
**LT200#**,  
or **GWR00#**

EP00# = First available tap after treatment\*.  
Use for NITRATE and NITRITE samples  
\* If system does not have treatment, EP00#  
is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH8634812 WILLIAMS COUNTY ENGINEER OFFICE**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>8659858</b>	Facility Name: <b>WILLIAMS COUNTY GARAGE</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 10/1/2016 and 12/31/2016



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

**OH8634812 WILLIAMS COUNTY ENGINEER OFFICE**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Location** Facility ID: **DS1** Facility Name: **WILLIAMS COUNTY GARAGE DISTRIBUTION**  
SMP ID: **DS000**

**Chemicals**

**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022

Not Required

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between 1/1/2016 and 3/31/2016  
1 Sample(s) Required between 4/1/2016 and 6/30/2016  
1 Sample(s) Required between 7/1/2016 and 9/30/2016  
1 Sample(s) Required between 10/1/2016 and 12/31/2016

**OH8635512 LOVEBERRYS FUNNY FARM CAMPGROUND**

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: LOVEBERRYS FUNNY FARM CAMPGROUND DISTRIB</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 9/30/2016

**Where to Collect Samples For a Small Public Water System**

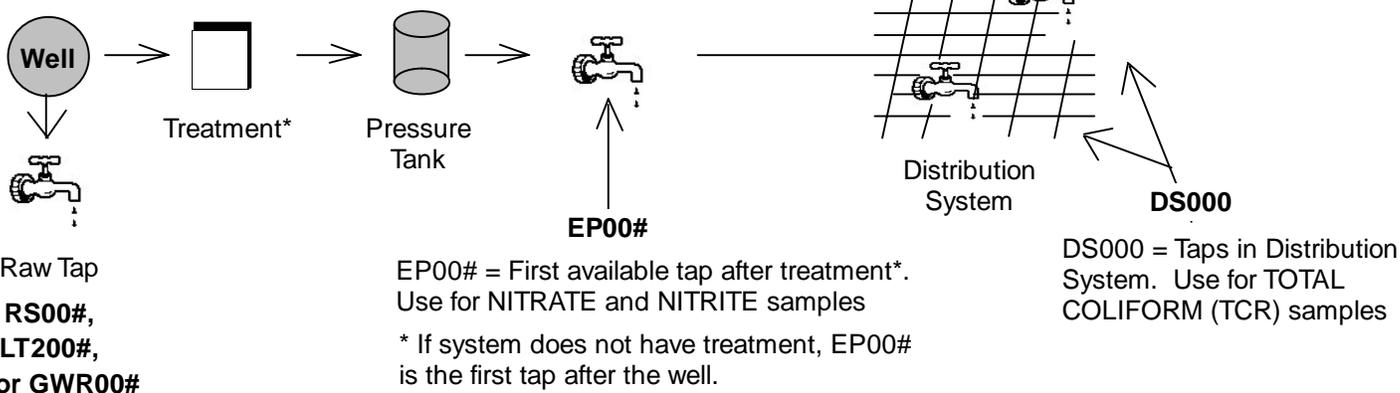

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8635512 LOVEBERRYS FUNNY FARM CAMPGROUND**

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 8659860	<b>Facility Name:</b> LOVEBERRYS FUNNY FARM CAMPGROUND STU 1
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

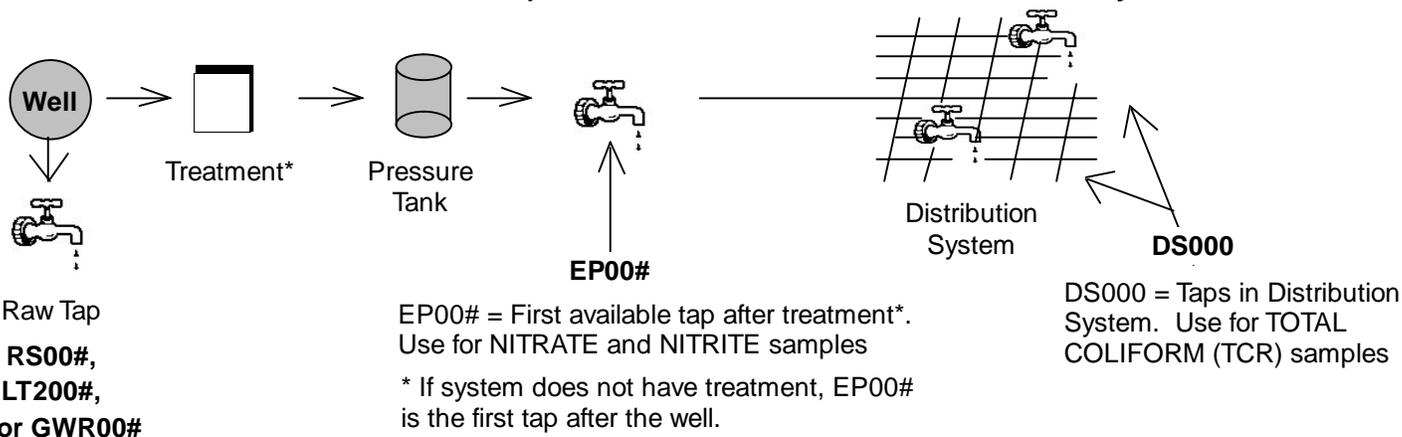

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8635512 LOVEBERRYS FUNNY FARM CAMPGROUND**

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> LOVEBERRYS FUNNY FARM CAMPGROUND DISTRIB
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 9/30/2016

**Where to Collect Samples For a Small Public Water System**

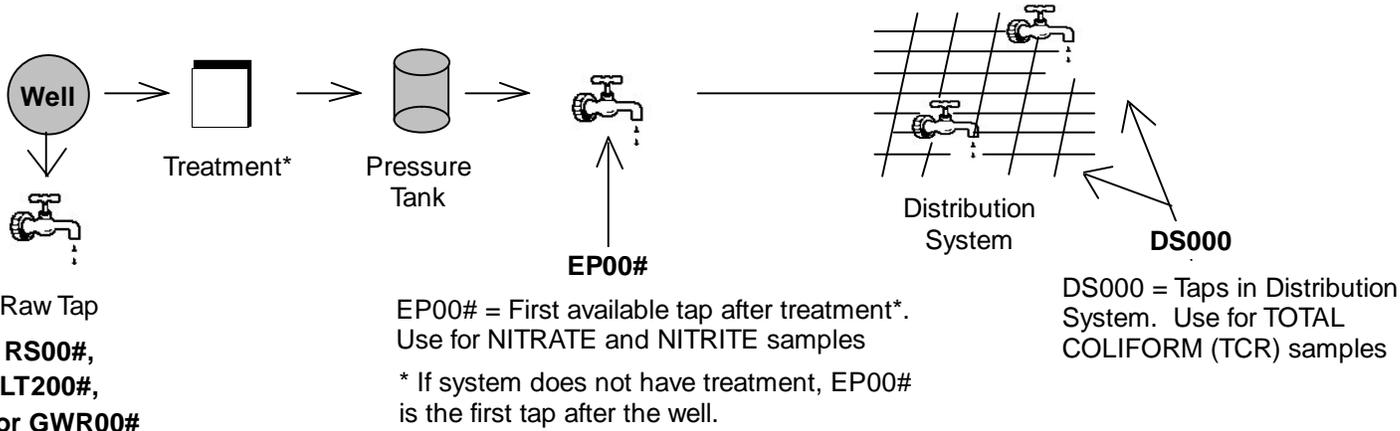

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8635512 LOVEBERRYS FUNNY FARM CAMPGROUND**

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 8660634	<b>Facility Name:</b> LOVEBERRYS FUNNY FARM CAMPGROUND STU 2
<b>Location SMP ID:</b> EP002	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

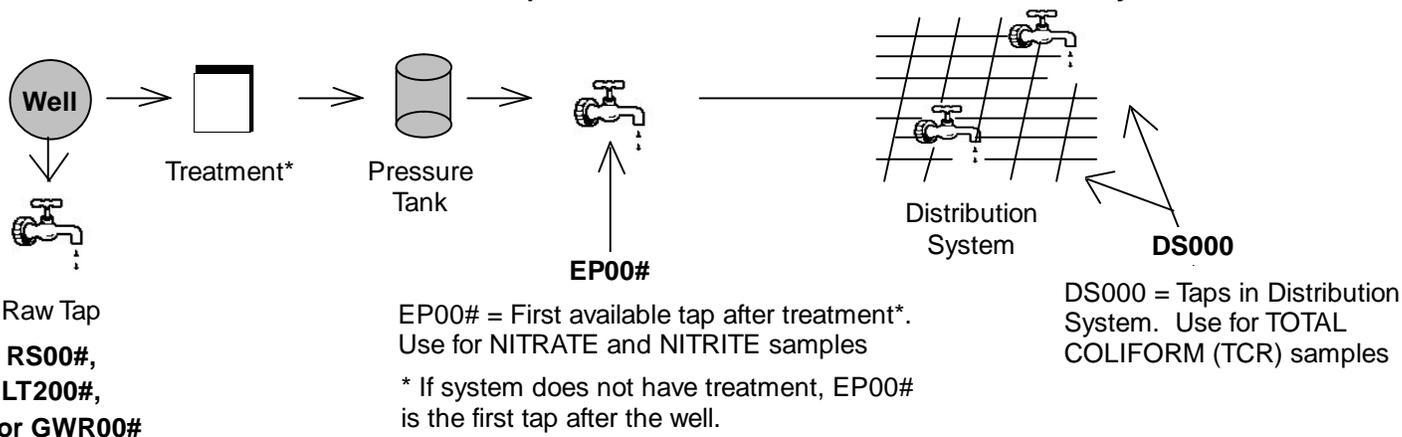

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8636212 LAZY RIVER CAMPGROUND-PIONEER**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: LAZY RIVER CAMP DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

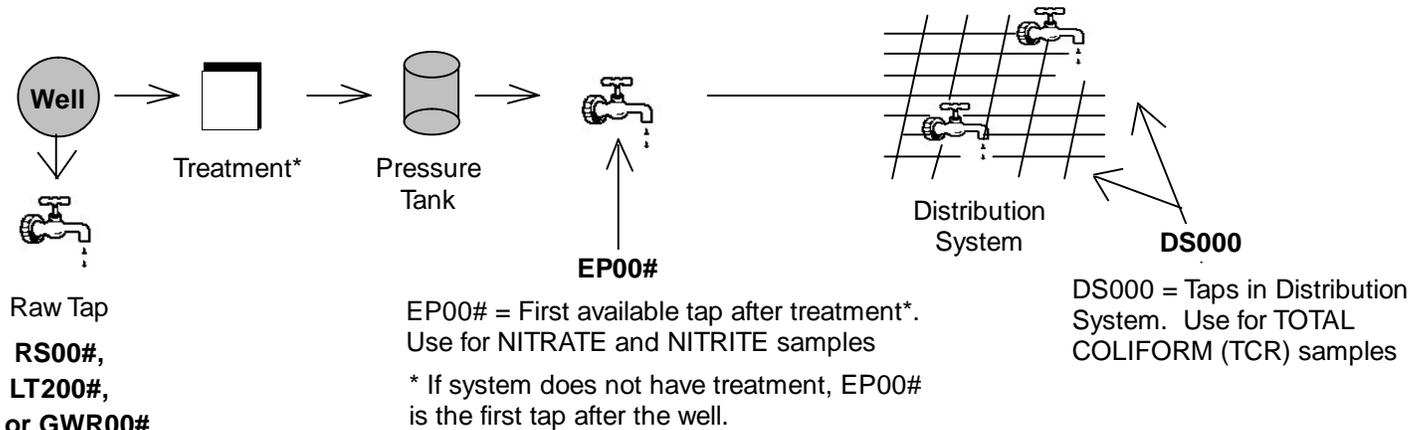

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8636212 LAZY RIVER CAMPGROUND-PIONEER**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **8659862** Facility Name: **LAZY RIVER CAMP**

**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

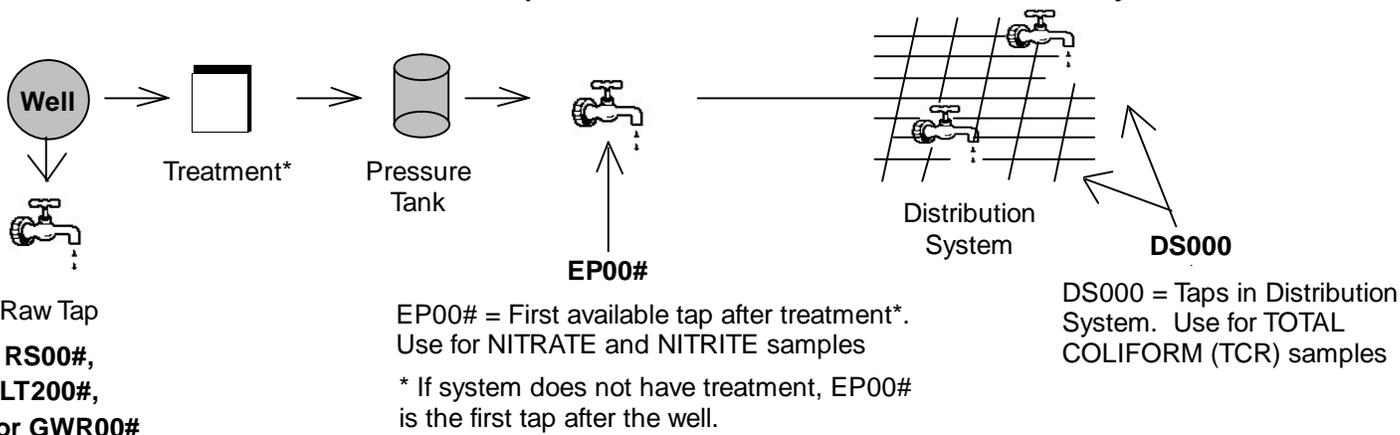

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8636312 LOCKPORT MENNONITE CHURCH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: LOCKPORT MENNONITE CH DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

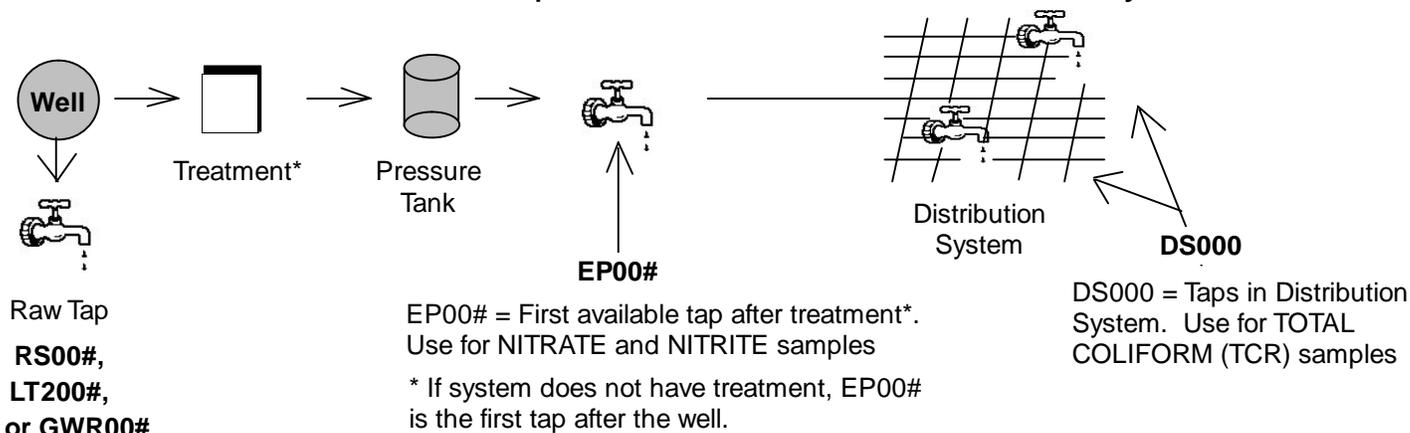

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8636312 LOCKPORT MENNONITE CHURCH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **8659863** Facility Name: **LOCKPORT MENNONITE CHURCH**

**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

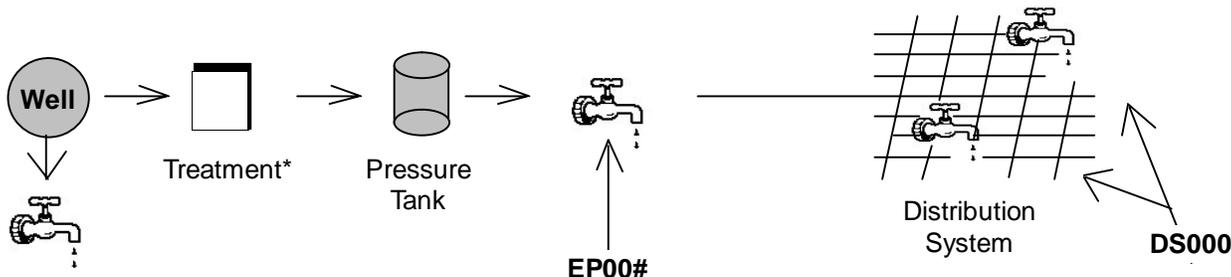

Raw Tap  
**RS00#**,  
**LT200#**,  
 or **GWR00#**

EP00# = First available tap after treatment\*.  
 Use for NITRATE and NITRITE samples  
 \* If system does not have treatment, EP00#  
 is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH8636412 MANUFACTURED HOUSING ENTERPRISE**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>8659864</b>	Facility Name: <b>MANUFACT HSING ENT</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2016 and 10/31/2016



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

**OH8636412 MANUFACTURED HOUSING ENTERPRISE**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>MANUFACTURED HSING ENT DISTBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

<b>Chemicals</b>	<b>Monitoring Requirements</b>
LEAD - 1030 AND COPPER - 1022	Not Required
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016 1 Sample(s) Required between 4/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 9/30/2016 1 Sample(s) Required between 10/1/2016 and 12/31/2016

**OH8636712 ORCHARD HILLS GOLF CLUB**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: ORCHARD HILLS CTY CLUB DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

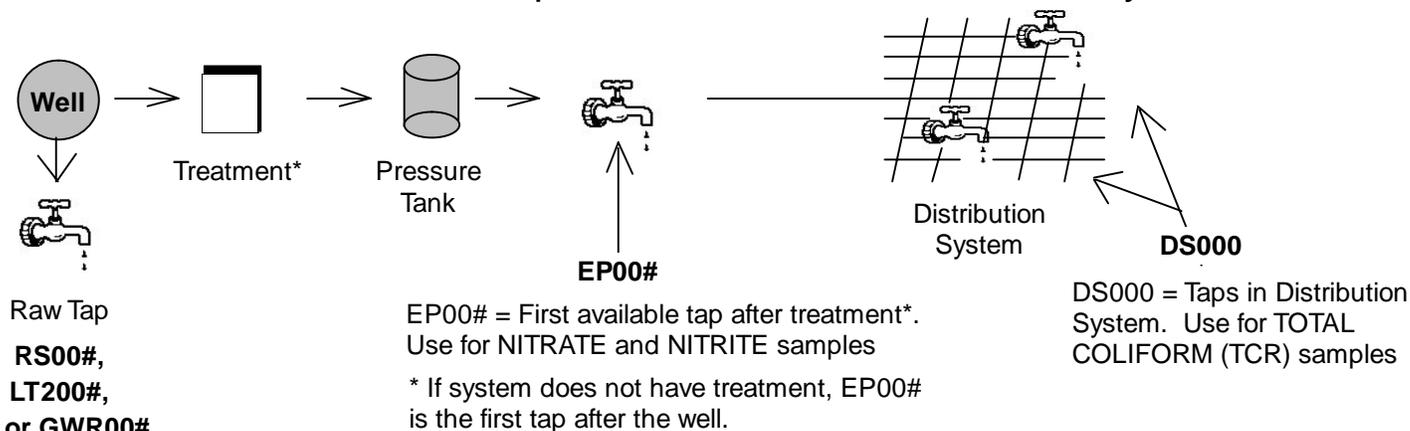

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8636712 ORCHARD HILLS GOLF CLUB**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 8659865 Facility Name: ORCHARD HILLS GOLF CLUB**

**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

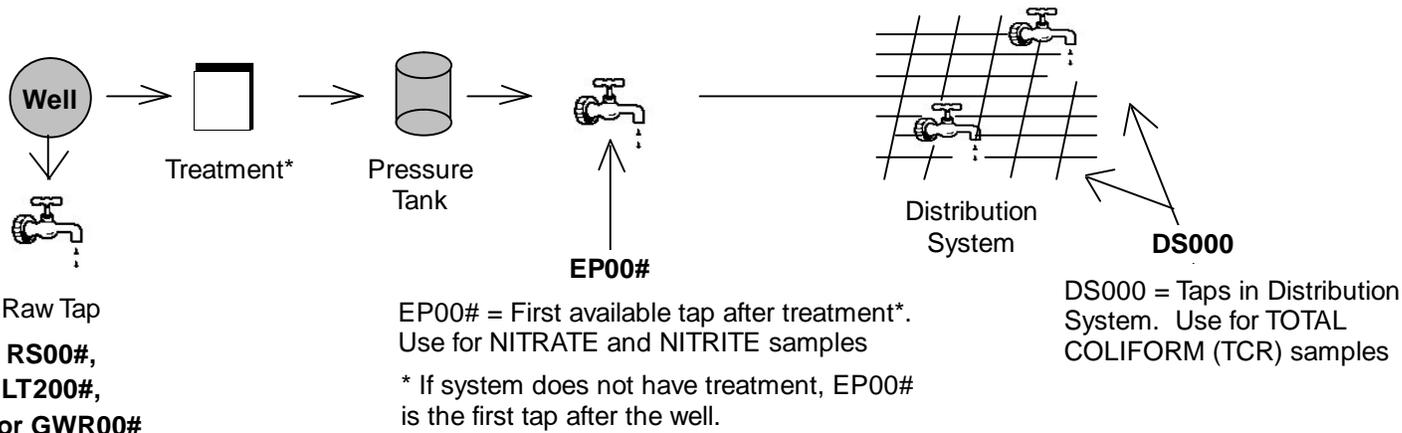

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8636812 NEW LIFE WORSHIP CENTER- BRYAN**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: NEW LIFE TEMPLE DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

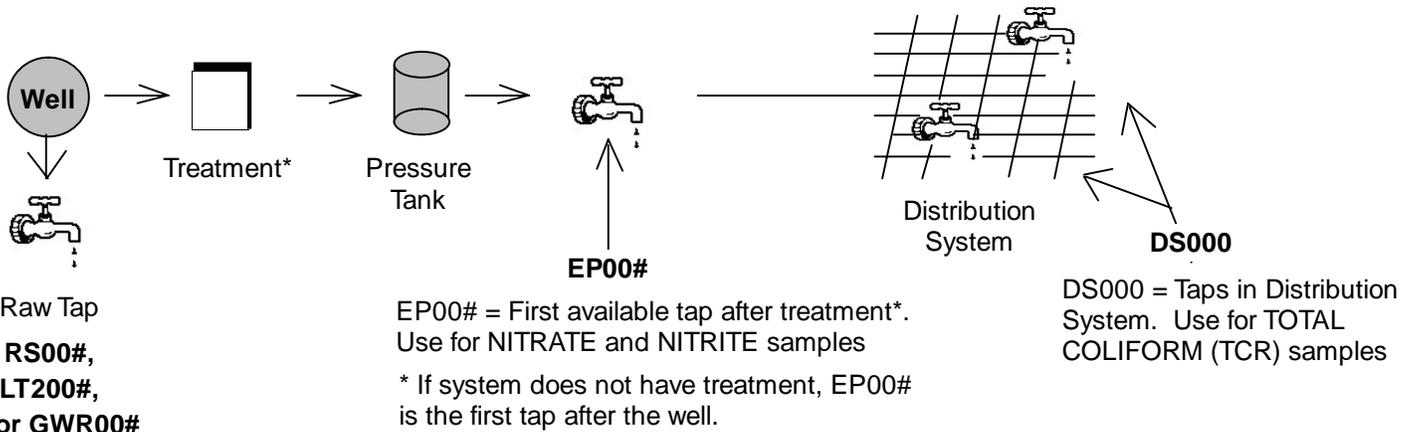

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8636812 NEW LIFE WORSHIP CENTER- BRYAN**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **8659866** Facility Name: **NEW LIFE WORSHIP CENTER**

**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

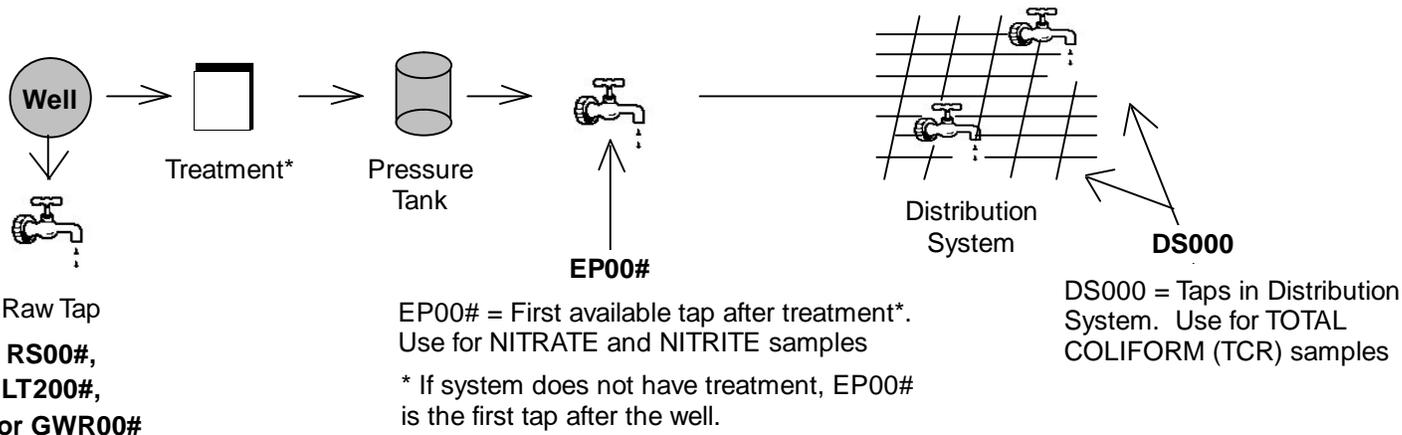

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8636912 PINE GROVE MENNONITE CHURCH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: PINE GROVE MENNONITE CH DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

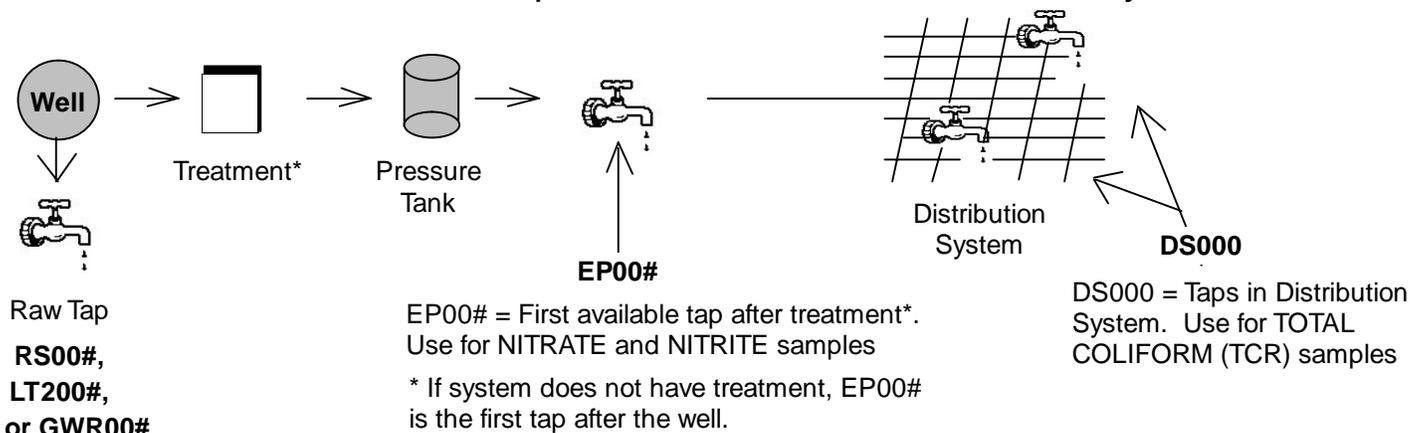

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8636912 PINE GROVE MENNONITE CHURCH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 8659867 Facility Name: PINE GROVE MENNONITE CHURCH**

**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

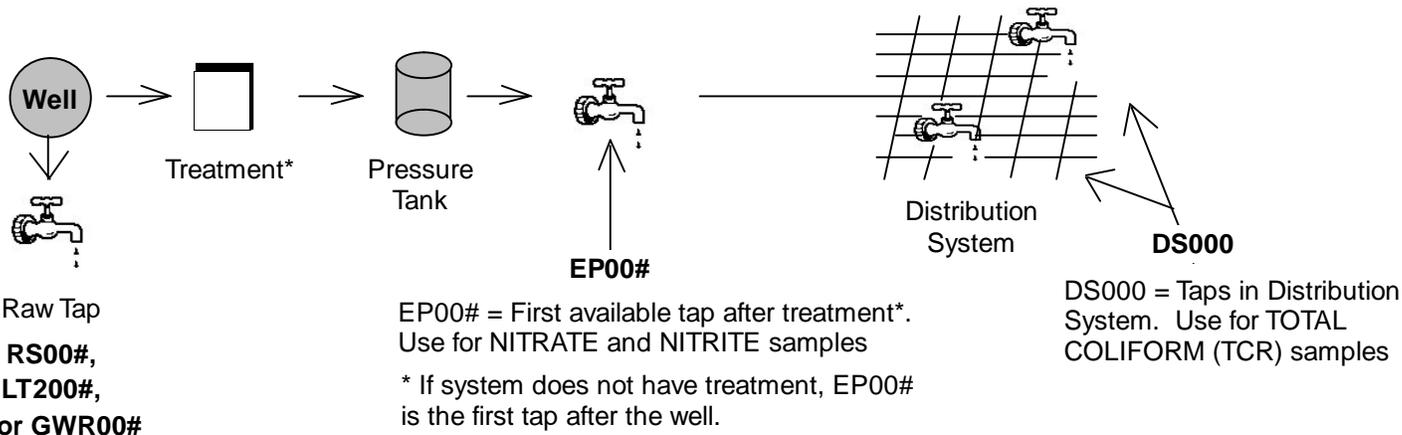

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8637012 PIONEER SCOUT RESERVE [BSA]-POOL**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> PIONEER SCOUT RES-POOL DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

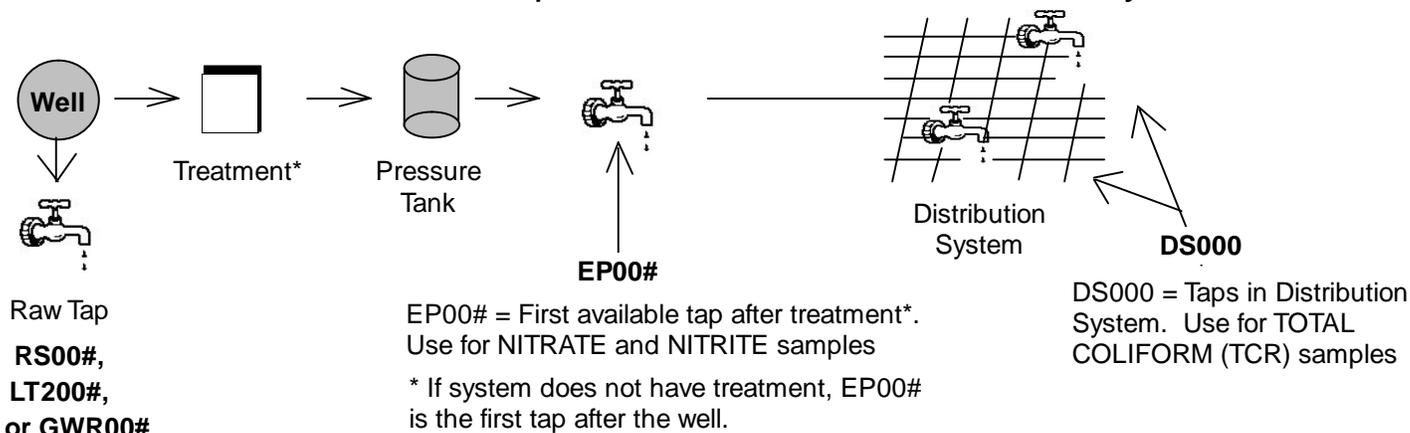

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8637012 PIONEER SCOUT RESERVE [BSA]-POOL**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **8659868** Facility Name: **PIONEER SCOUT RES - POOL**

**Location** SMP ID: **EP001** Facility Source: **Ground Water**

**Chemicals**

**Monitoring Requirements**


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

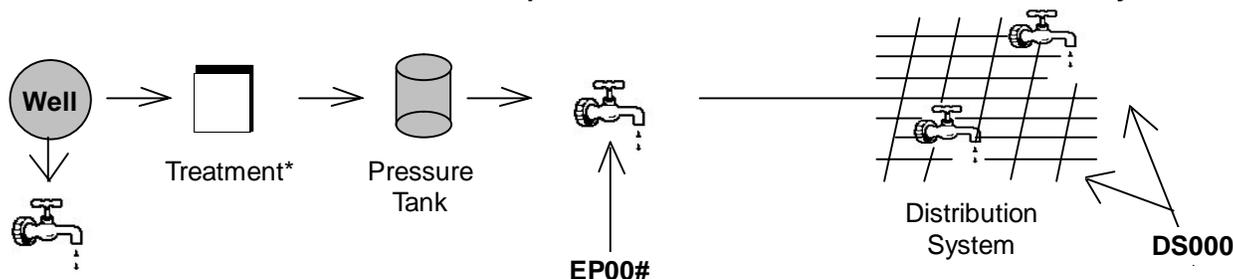

Raw Tap  
**RS00#,**  
**LT200#,**  
or **GWR00#**

EP00# = First available tap after treatment\*.  
Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00#  
is the first tap after the well.

DS000 = Taps in Distribution  
System. Use for TOTAL  
COLIFORM (TCR) samples

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8637312 PULASKI UNITED METHODIST CH-BRYAN**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: PULASKI UM CHURCH DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

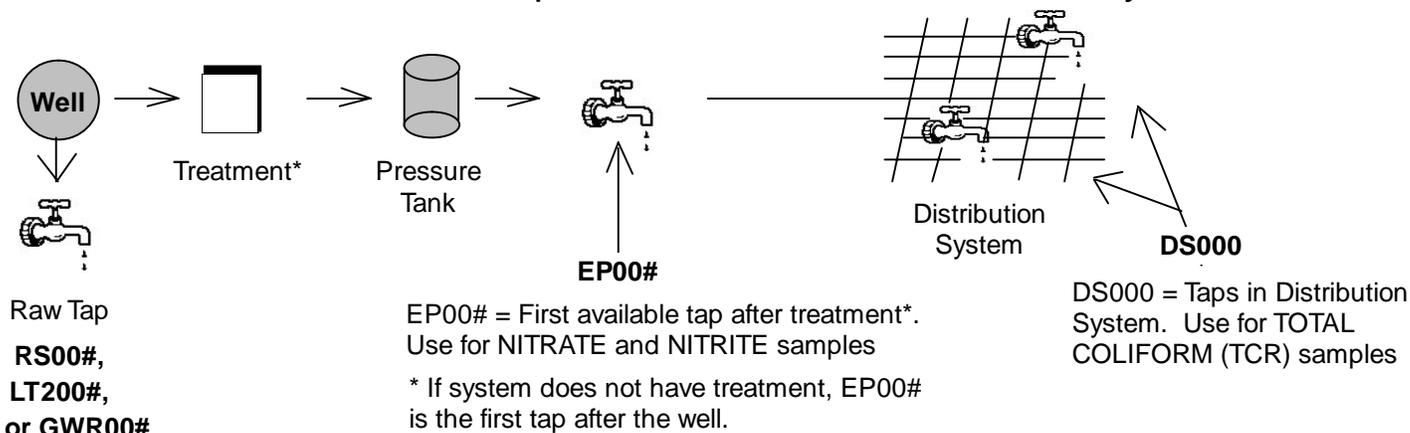

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8637312 PULASKI UNITED METHODIST CH-BRYAN**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 8659870 Facility Name: PULASKI UNITED METHODIST CHURCH**

**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

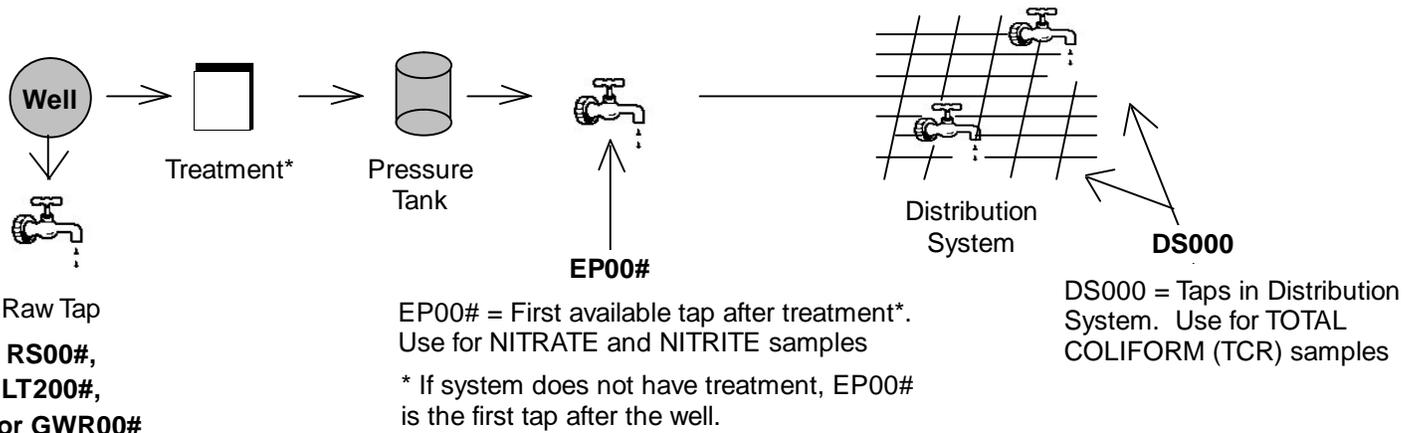

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8637712 SHADY SHORE CAMPGROUND**

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: SHADY SHORE CAMPGROUND DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 9/30/2016

**Where to Collect Samples For a Small Public Water System**

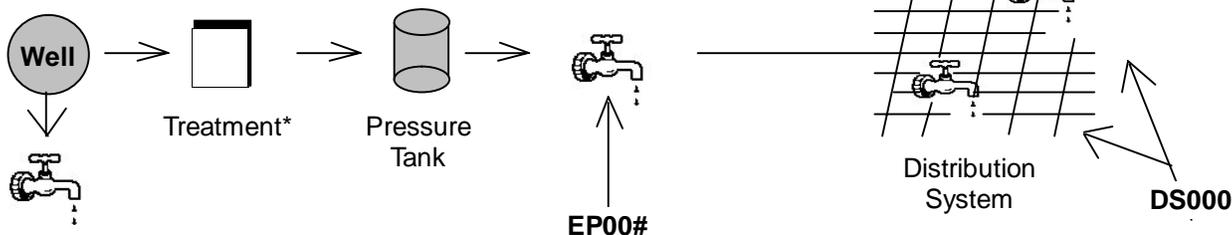

Raw Tap  
**RS00#,**  
**LT200#,**  
**or GWR00#**

EP00# = First available tap after treatment\*.  
Use for NITRATE and NITRITE samples  
\* If system does not have treatment, EP00# is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8637712 SHADY SHORE CAMPGROUND**

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **8659872** Facility Name: **SHADY SHORE CAMPGROUND**

**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

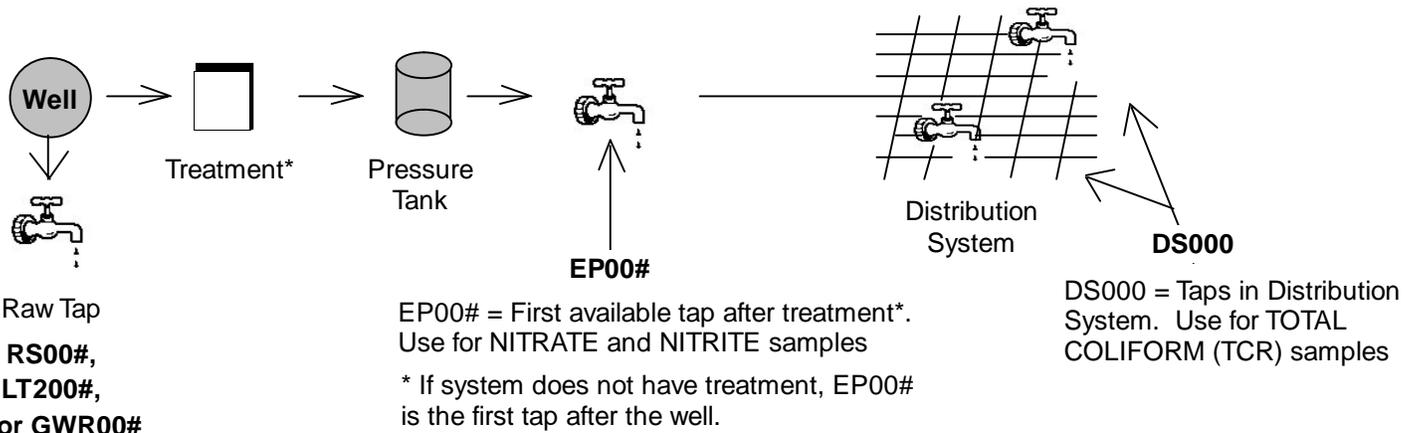

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8637812 SILVER CREEK CH OF THE BRETHERN**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: SILVER CREEK CHURCH DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

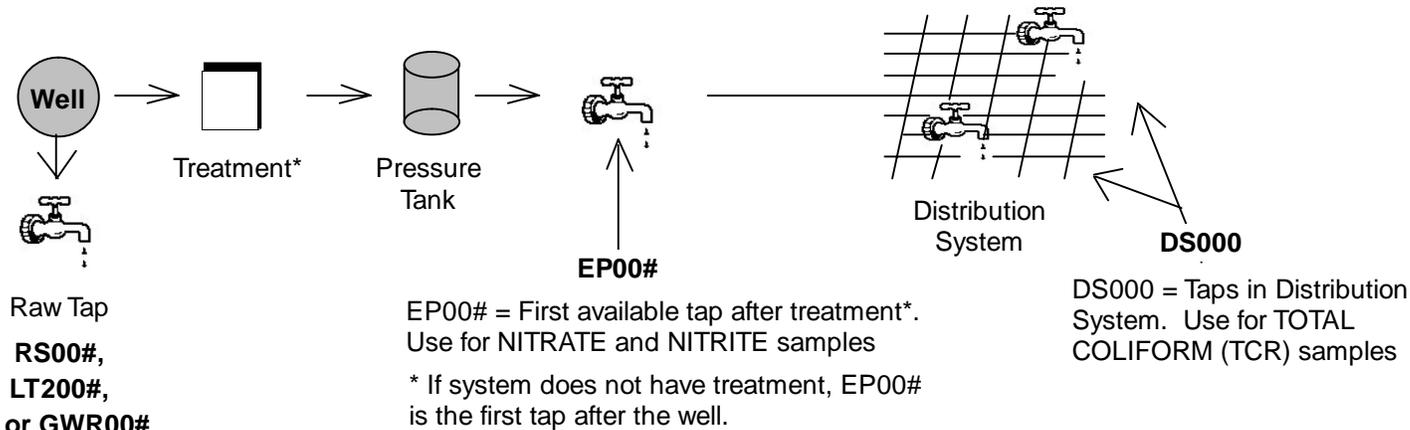

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8637812 SILVER CREEK CH OF THE BRETHERN**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **8659873** Facility Name: **SILVER CREEK CHURCH**

**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

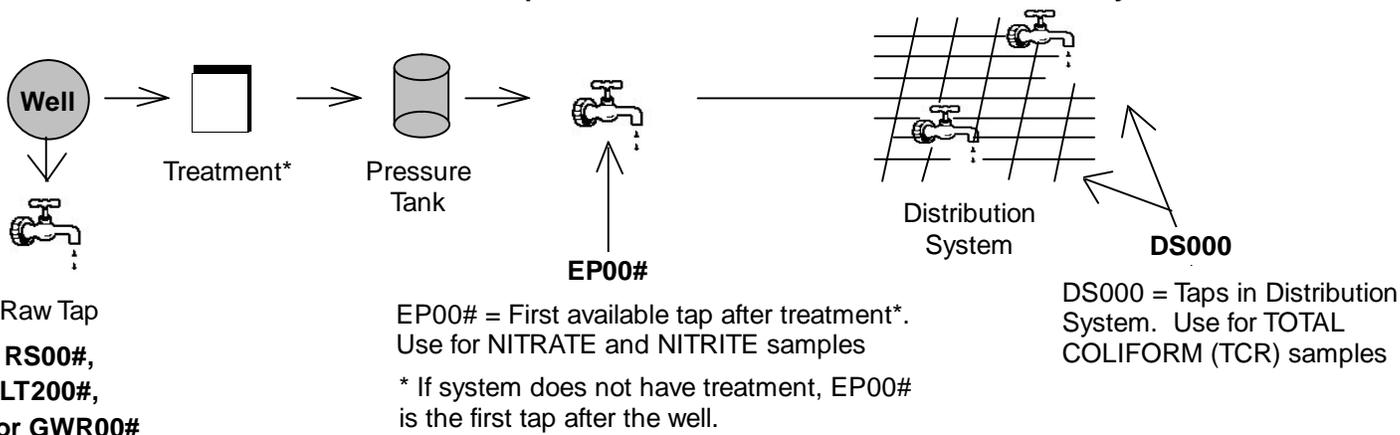

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8637912 SUBURBAN GOLF CLUB**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: SUBURBAN GOLF DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

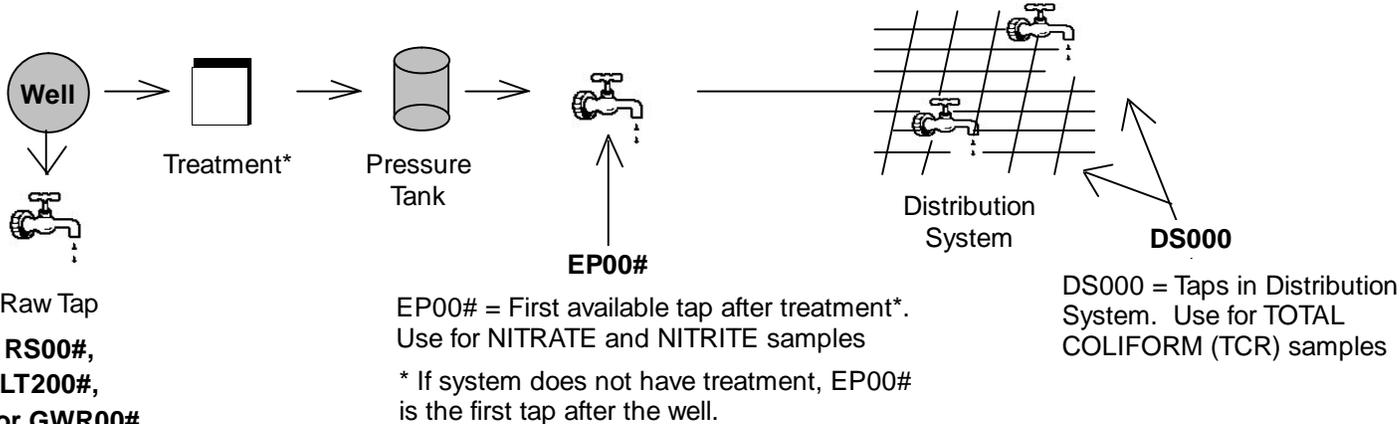

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8637912 SUBURBAN GOLF CLUB**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 8659874 Facility Name: SUBURBAN GOLF**

**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

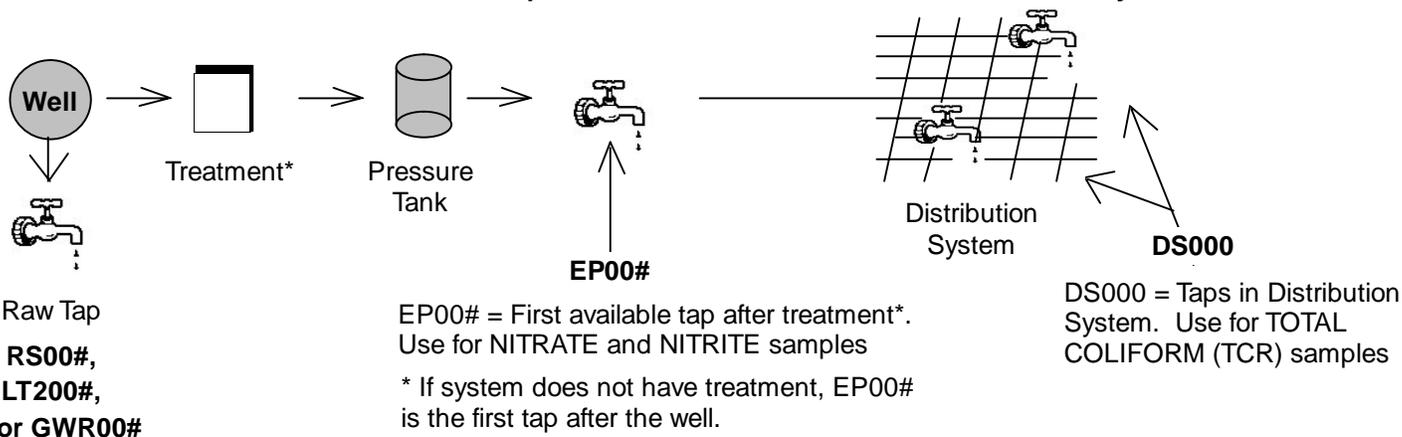

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8638012 M AND D SUBURBAN INN**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: M&amp;D SUBURBAN INN DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

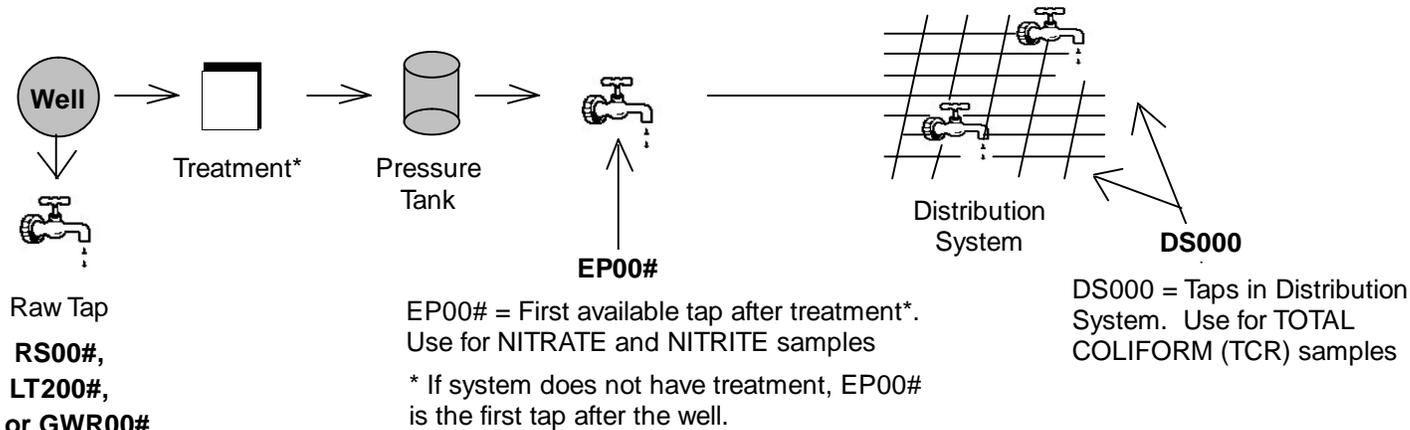

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8638012 M AND D SUBURBAN INN**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **8659875** Facility Name: **M & D SUBURBAN INN**

**Location** SMP ID: **EP001** Facility Source: **Ground Water**

**Chemicals**

**Monitoring Requirements**


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

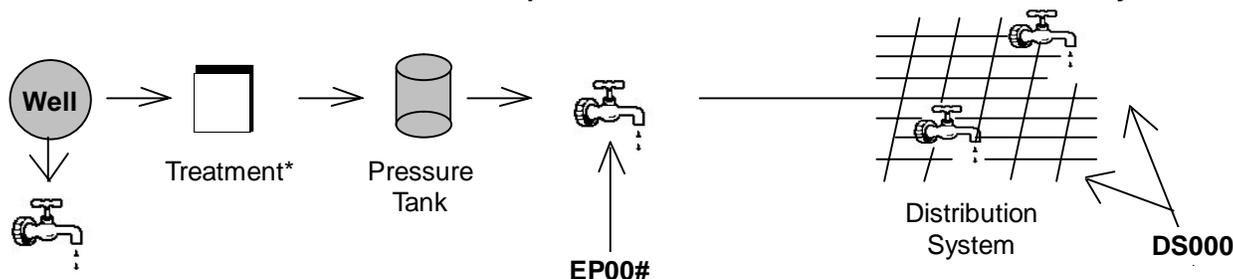

Raw Tap  
**RS00#,**  
**LT200#,**  
or **GWR00#**

EP00# = First available tap after treatment\*.  
Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00#  
is the first tap after the well.

DS000 = Taps in Distribution  
System. Use for TOTAL  
COLIFORM (TCR) samples

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8638512 WEST BETHESDA PRESBYTERIAN CHURCH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: 8659877 Facility Name: WEST BETHESDA CHURCH  
**Location** SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

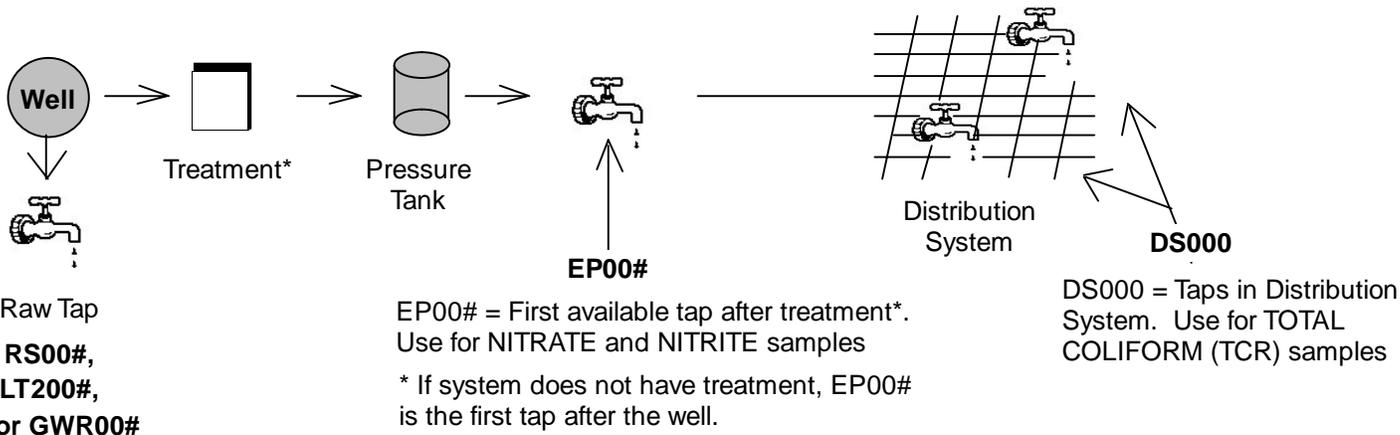

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH8639512 RIVER OF LIFE WORSHIP CENTER**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>8659883</b>	Facility Name: <b>RIVER OF LIFE WORSHIP CENTER</b>
<b>Location</b>	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>
		Facility Class: <b>CLASS A</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2016 and 10/31/2016



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

**OH8639512 RIVER OF LIFE WORSHIP CENTER**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Location** Facility ID: **DS1** Facility Name: **RIVER OF LIFE WORSHIP CNTR DISTRIBUTIC**  
SMP ID: **DS000**

**Chemicals**

**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022

Not Required

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between 1/1/2016 and 3/31/2016  
1 Sample(s) Required between 4/1/2016 and 6/30/2016  
1 Sample(s) Required between 7/1/2016 and 9/30/2016  
1 Sample(s) Required between 10/1/2016 and 12/31/2016

**OH8639612 STUCKEY AMLC**

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> STUCKEY AMLC DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 9/30/2016

**Where to Collect Samples For a Small Public Water System**

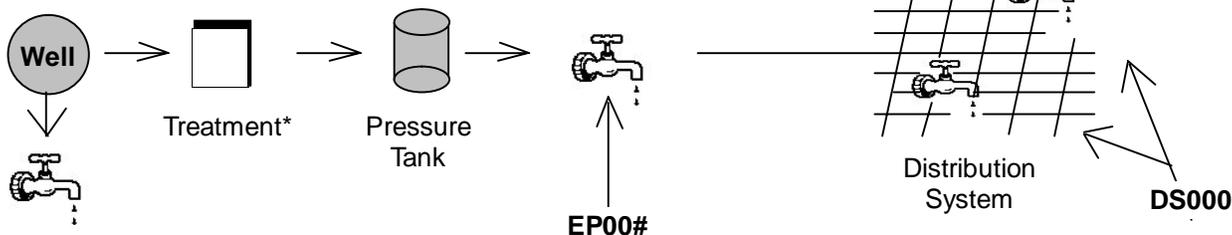

Raw Tap  
**RS00#,**  
**LT200#,**  
or **GWR00#**

EP00# = First available tap after treatment\*.  
Use for NITRATE and NITRITE samples  
\* If system does not have treatment, EP00# is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8639612 STUCKEY AMLC**

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **8659884** Facility Name: **STUCKEY ALMC**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2016 and 3/31/2016 1 Sample(s) Required between 4/1/2016 and 6/30/2016 1 Sample(s) Required between 7/1/2016 and 9/30/2016 1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

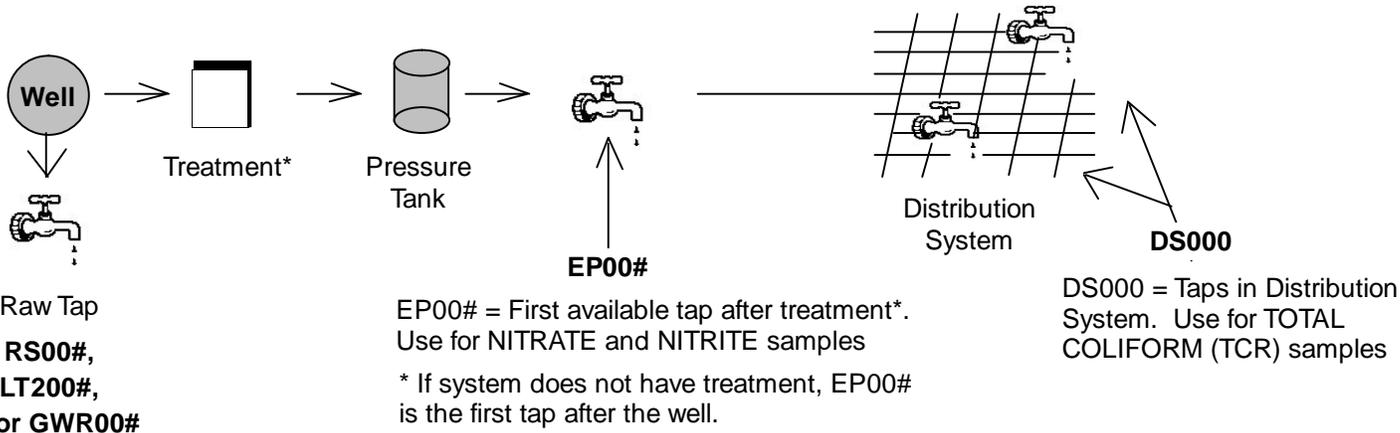

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8639812 BRYAN FUEL STOP**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: BRYAN FUEL STOP DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

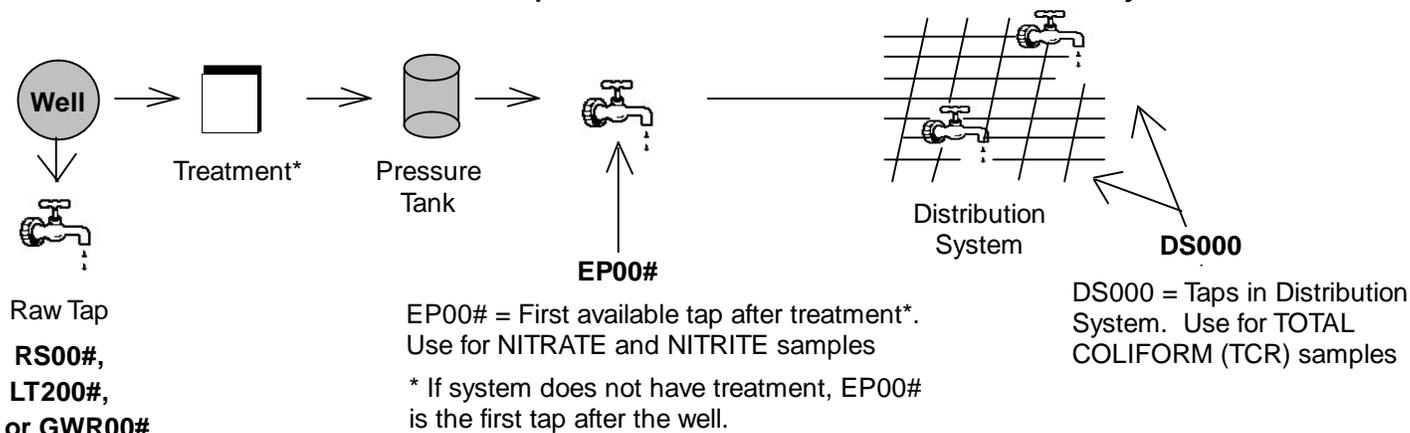

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8639812 BRYAN FUEL STOP**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **8659886** Facility Name: **BRYAN FUEL STOP**

**Location** SMP ID: **EP001** Facility Source: **Ground Water**

**Chemicals**

**Monitoring Requirements**


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

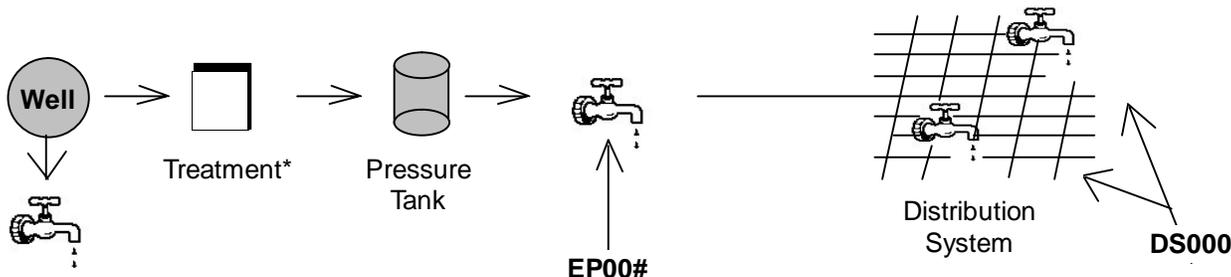

Raw Tap  
**RS00#,**  
**LT200#,**  
or **GWR00#**

EP00# = First available tap after treatment\*.  
Use for NITRATE and NITRITE samples  
\* If system does not have treatment, EP00#  
is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH8640112 OTC-KUNKLE MAINTENANCE BUILDING**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>8659889</b>	Facility Name: <b>OTC - KUNKLE MAINT BUILDING</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**  
 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
 Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2016 and 10/31/2016



Effective Date: 01/01/2016

2016 DISTRIBUTION SCHEDULE

**OH8640112 OTC-KUNKLE MAINTENANCE BUILDING**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Location** Facility ID: **DS1** Facility Name: **OTC-KUNKLE MAINT BLDG DISTRIBUTION**  
SMP ID: **DS000**

**Chemicals**

**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022

Not Required

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between 1/1/2016 and 3/31/2016  
1 Sample(s) Required between 4/1/2016 and 6/30/2016  
1 Sample(s) Required between 7/1/2016 and 9/30/2016  
1 Sample(s) Required between 10/1/2016 and 12/31/2016

**OH8640412 PATRIOT HILLS GOLF COURSE**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1 Facility Name: DISTRIBUTION**  
**Location SMP ID: DS000 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

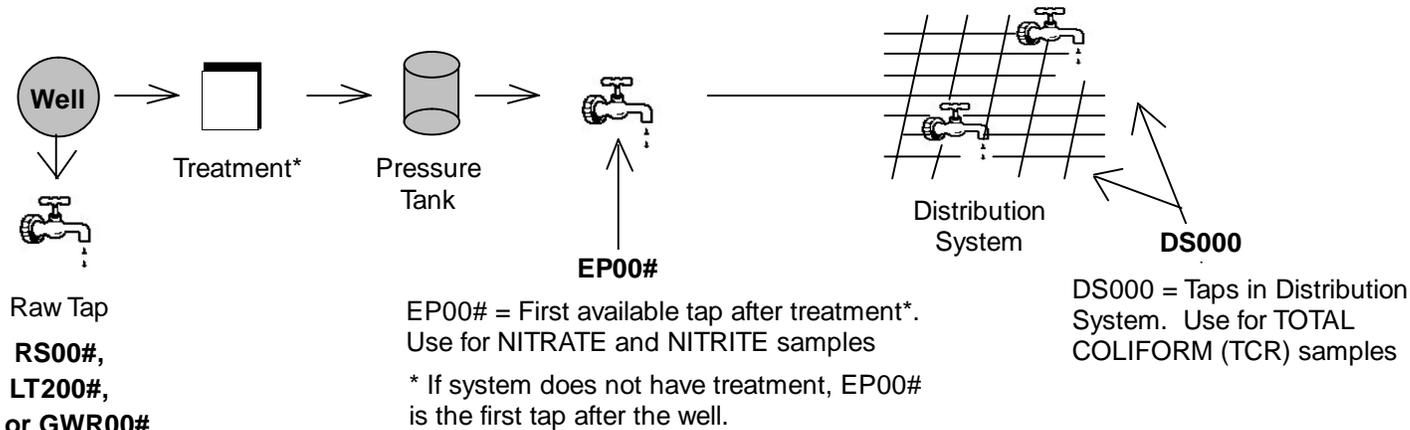

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8640412 PATRIOT HILLS GOLF COURSE**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 8659892 Facility Name: PATRIOT HILLS GOLF COURSE**

**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

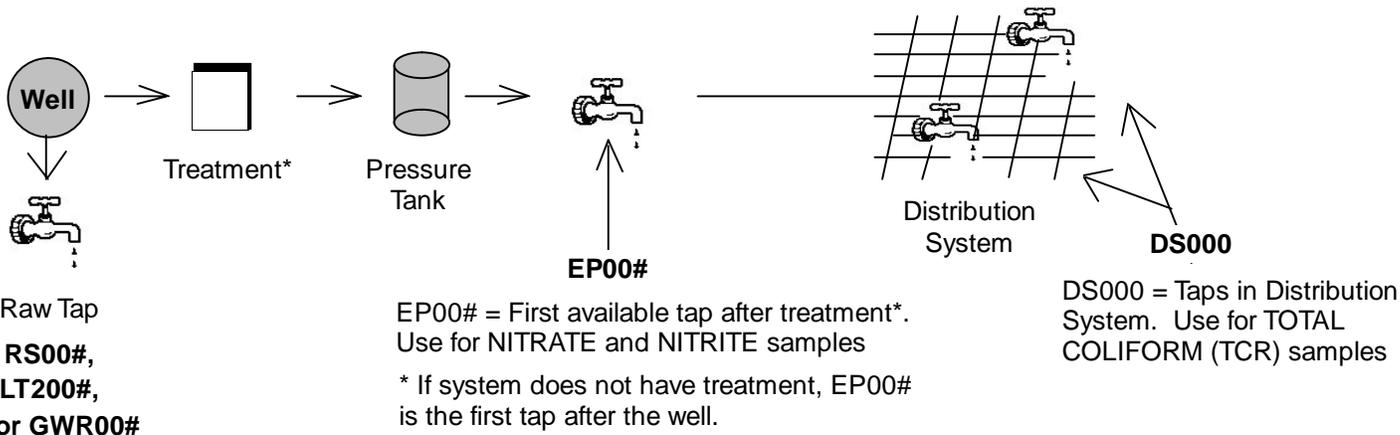

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8640612 VICTORY BARN CHURCH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: VICTORY BARN CHURCH DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

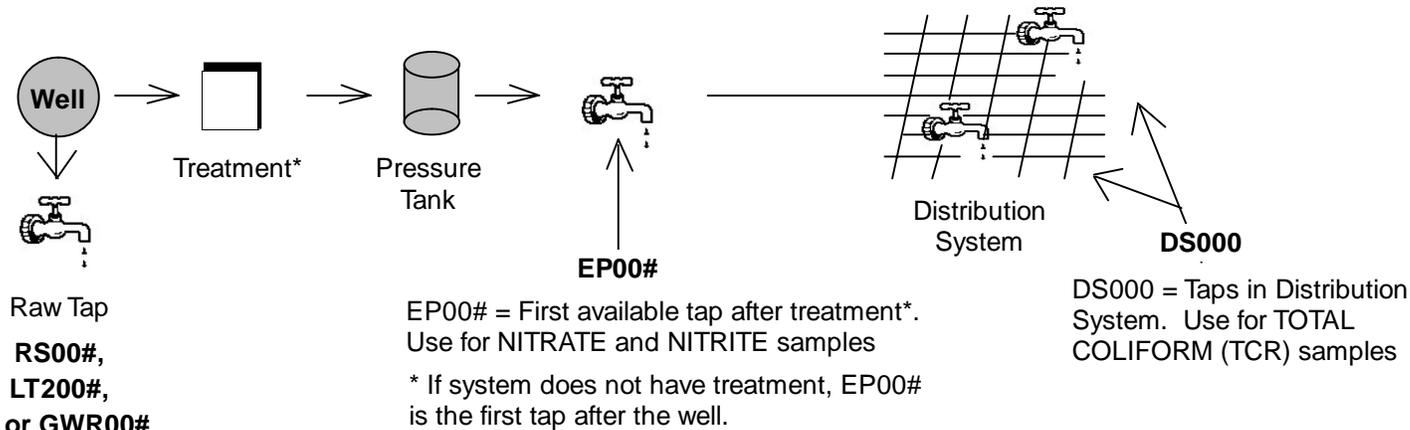

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8640612 VICTORY BARN CHURCH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **8659894** Facility Name: **VICTORY BARN CHURCH**

**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

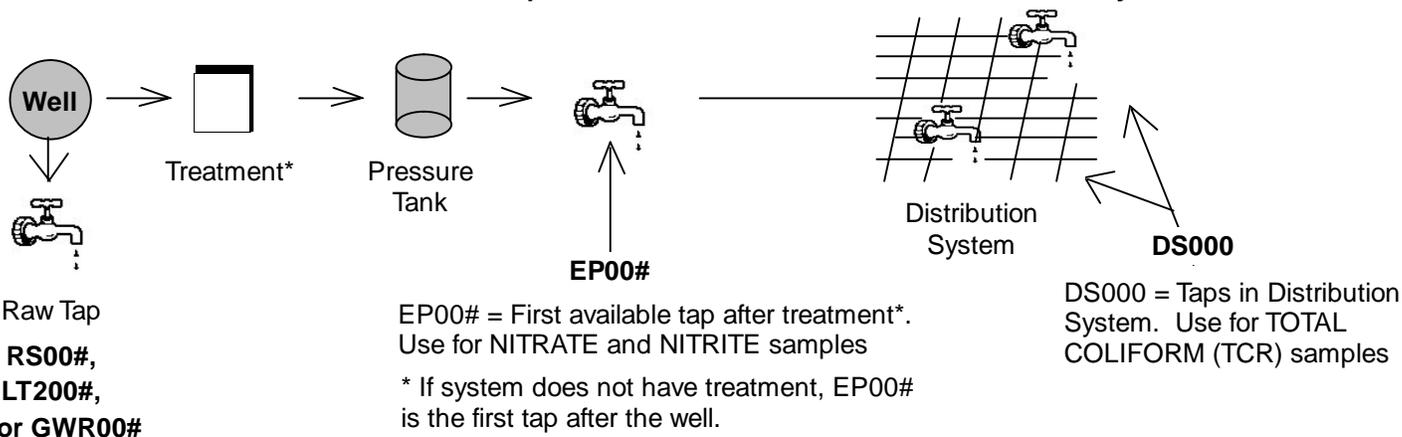

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8641212 HIDDEN VALLEY CAMPGROUND-ARCHBOLD**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: HIDDEN VALLEY DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2016 and 4/30/2016
	1 Sample(s) Required between 5/1/2016 and 5/31/2016
	1 Sample(s) Required between 6/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 7/31/2016
	1 Sample(s) Required between 8/1/2016 and 8/31/2016
	1 Sample(s) Required between 9/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

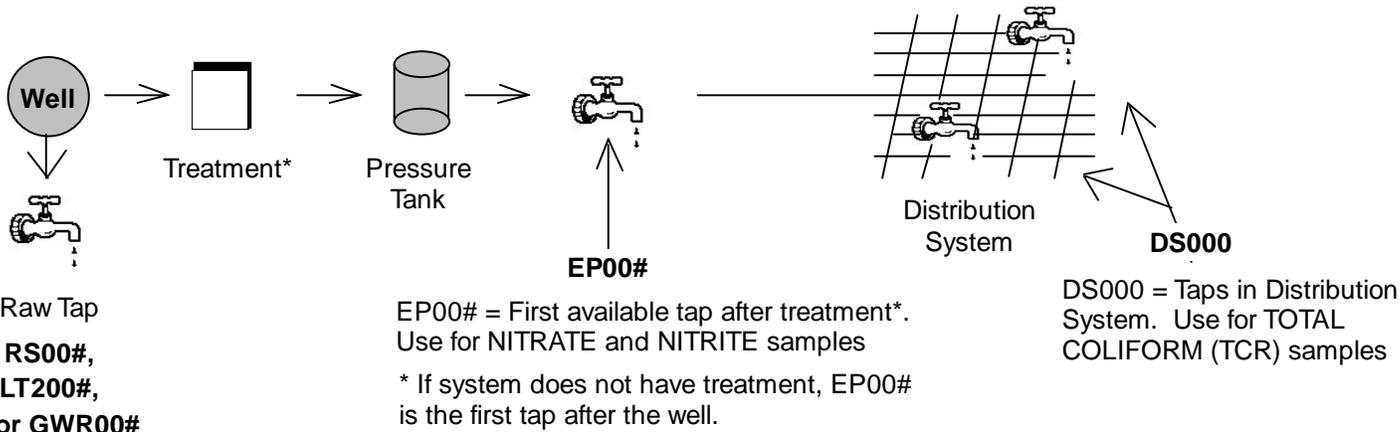

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8641212 HIDDEN VALLEY CAMPGROUND-ARCHBOLD**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 8661991 Facility Name: HIDDEN VALLEY CAMPGROUND**

**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

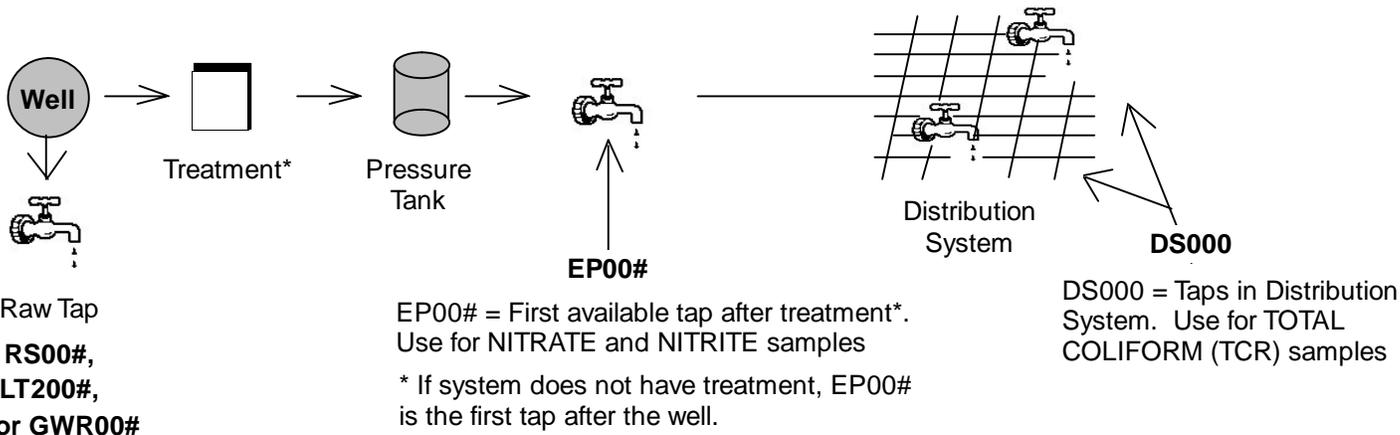

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8641512 NEW HOPE COMMUNITY CHURCH-BRYAN**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: NEW HOPE COMMUNITY CHURCH DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

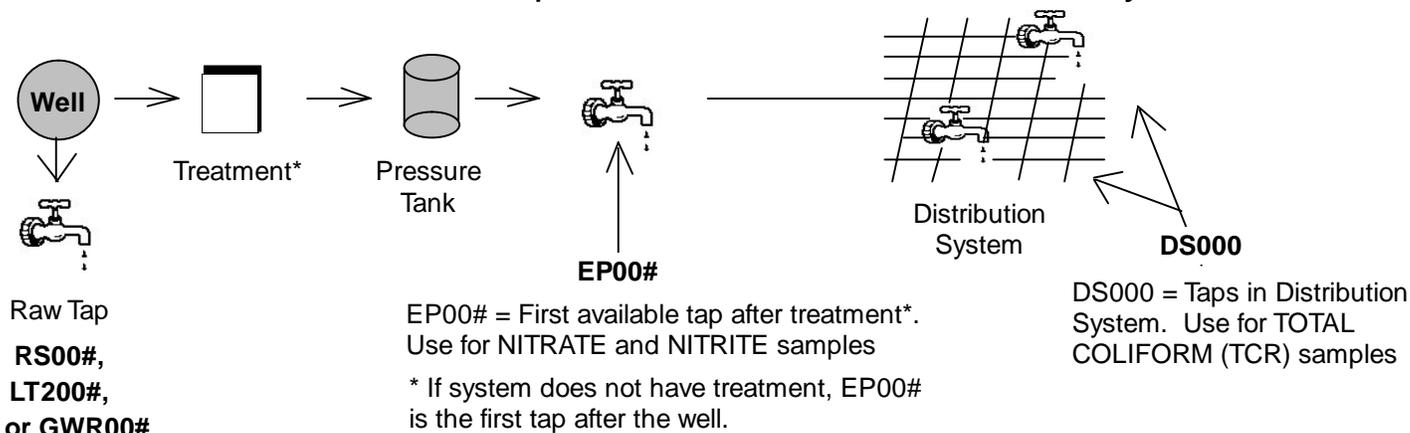

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8641512 NEW HOPE COMMUNITY CHURCH-BRYAN**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b> Facility ID: <b>8660988</b>	Facility Name: <b>NEW HOPE COMMUNITY CHURCH</b>
<b>Location</b> SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b> Facility Class: <b>CLASS A</b>

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

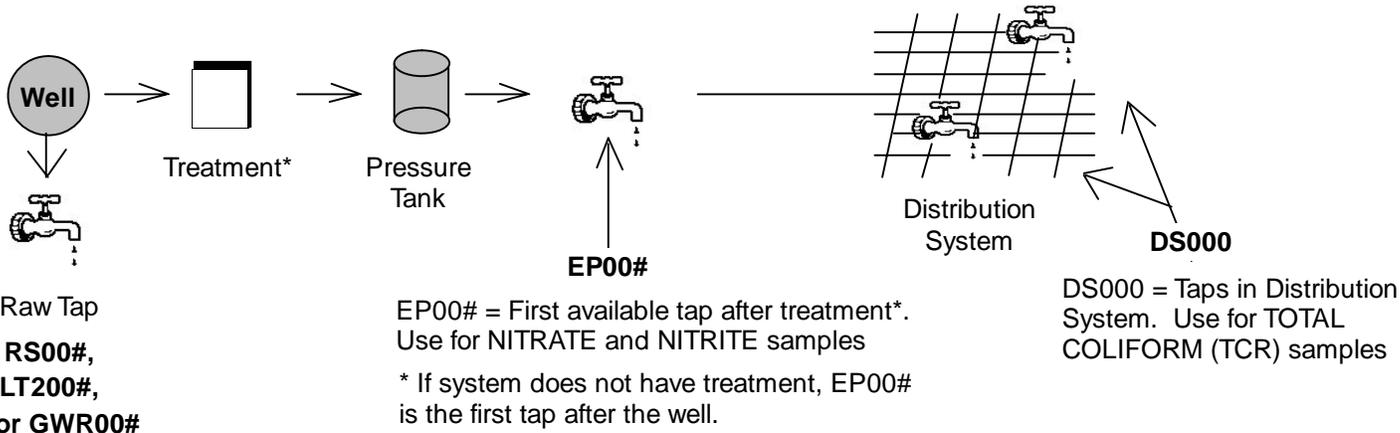

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8641712 PLEASANT RIDGE DUNKARD BRETH CH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: PLEASANT RIDGE DUNKARD BRETH CH DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2016 and 3/31/2016
	1 Sample(s) Required between 4/1/2016 and 6/30/2016
	1 Sample(s) Required between 7/1/2016 and 9/30/2016
	1 Sample(s) Required between 10/1/2016 and 12/31/2016

**Where to Collect Samples For a Small Public Water System**

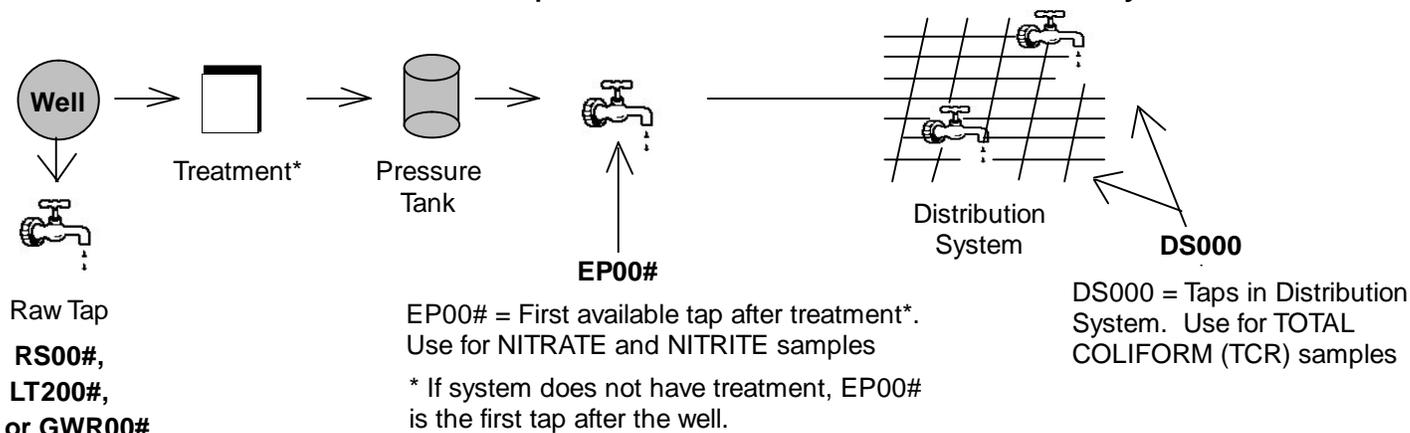

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH8641712 PLEASANT RIDGE DUNKARD BRETH CH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID: 8662026</b>	<b>Facility Name: PLEASANT RIDGE DUNKARD BRETH CHURCH</b>
<b>Location SMP ID: EP001</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016

**Where to Collect Samples For a Small Public Water System**

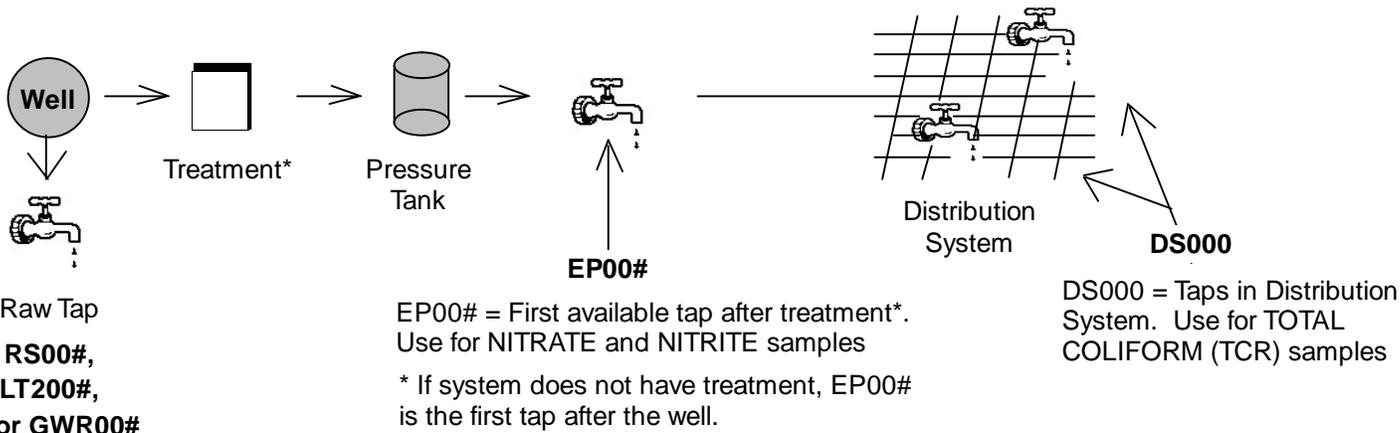

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH8641812 TRUFAST ORGANIZATION**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>8662117</b>	Facility Name: <b>TRUFAST CORPORATION</b>	
<b>Location</b>	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	Facility Class: <b>CLASS A</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	1 Sample(s) Required between 6/1/2016 and 10/31/2016
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2016 and 10/31/2016
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2016 and 10/31/2016

