



Effective Date: 01/01/2017

2017 ENTRY POINT SCHEDULE

OH1600012 COSHOCTON PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1653599 SMP ID: EP001	Facility Name: COSHOCTON WTP Facility Source: Ground Water	Facility Class: CLASS 3
--------------------------	---	---	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2017 and 10/31/2017
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2017 and 5/31/2017
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2017 and 10/31/2017



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

OH1600012 COSHOCTON PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: COSHOCTON DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

TOTAL COLIFORM (TCR) - 3100	10 Sample(s) Required between 1/1/2017 and 1/31/2017
	10 Sample(s) Required between 2/1/2017 and 2/28/2017
	10 Sample(s) Required between 3/1/2017 and 3/31/2017
	10 Sample(s) Required between 4/1/2017 and 4/30/2017
	10 Sample(s) Required between 5/1/2017 and 5/31/2017
	10 Sample(s) Required between 6/1/2017 and 6/30/2017
	10 Sample(s) Required between 7/1/2017 and 7/31/2017
	10 Sample(s) Required between 8/1/2017 and 8/31/2017
	10 Sample(s) Required between 9/1/2017 and 9/30/2017
	10 Sample(s) Required between 10/1/2017 and 10/31/2017
	10 Sample(s) Required between 11/1/2017 and 11/30/2017
	10 Sample(s) Required between 12/1/2017 and 12/31/2017

TOTAL CHLORINE - 1000	10 Sample(s) Required between 1/1/2017 and 1/31/2017
	10 Sample(s) Required between 2/1/2017 and 2/28/2017
	10 Sample(s) Required between 3/1/2017 and 3/31/2017
	10 Sample(s) Required between 4/1/2017 and 4/30/2017
	10 Sample(s) Required between 5/1/2017 and 5/31/2017
	10 Sample(s) Required between 6/1/2017 and 6/30/2017
	10 Sample(s) Required between 7/1/2017 and 7/31/2017
	10 Sample(s) Required between 8/1/2017 and 8/31/2017
	10 Sample(s) Required between 9/1/2017 and 9/30/2017
	10 Sample(s) Required between 10/1/2017 and 10/31/2017
	10 Sample(s) Required between 11/1/2017 and 11/30/2017
	10 Sample(s) Required between 12/1/2017 and 12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: COSHOCTON DISTRIBUTION 2742 CR 271	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

OH1600012 COSHOCTON PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: COSHOCTON DISTRIBUTION 1991 OTSEGO AVE.	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2017 and 9/30/2017at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH1600212 EDGEWOOD TERRACE MHP PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1653600	Facility Name: EDGEWOOD TERRACE MHP	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2017 and 10/31/2017
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2017 and 5/31/2017
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2017 and 10/31/2017



OH1600212 EDGEWOOD TERRACE MHP PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: EDGEWOOD TERRACE MHP DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2017 and 9/30/2017

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Form 5105 with appendix must be submitted to Ohio EPA within ten days from the end of the month(s) in which samples are collected. Forms are available online at: http://epa.ohio.gov/ddagw/reporting.aspx. For questions contact your Ohio EPA District Office representative.

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between 1/1/2017 and 1/31/2017
1 Sample(s) Required between 2/1/2017 and 2/28/2017
1 Sample(s) Required between 3/1/2017 and 3/31/2017
1 Sample(s) Required between 4/1/2017 and 4/30/2017
1 Sample(s) Required between 5/1/2017 and 5/31/2017
1 Sample(s) Required between 6/1/2017 and 6/30/2017
1 Sample(s) Required between 7/1/2017 and 7/31/2017
1 Sample(s) Required between 8/1/2017 and 8/31/2017
1 Sample(s) Required between 9/1/2017 and 9/30/2017
1 Sample(s) Required between 10/1/2017 and 10/31/2017
1 Sample(s) Required between 11/1/2017 and 11/30/2017
1 Sample(s) Required between 12/1/2017 and 12/31/2017

TOTAL CHLORINE - 1000

1 Sample(s) Required between 1/1/2017 and 1/31/2017
1 Sample(s) Required between 2/1/2017 and 2/28/2017
1 Sample(s) Required between 3/1/2017 and 3/31/2017
1 Sample(s) Required between 4/1/2017 and 4/30/2017
1 Sample(s) Required between 5/1/2017 and 5/31/2017
1 Sample(s) Required between 6/1/2017 and 6/30/2017
1 Sample(s) Required between 7/1/2017 and 7/31/2017
1 Sample(s) Required between 8/1/2017 and 8/31/2017
1 Sample(s) Required between 9/1/2017 and 9/30/2017
1 Sample(s) Required between 10/1/2017 and 10/31/2017
1 Sample(s) Required between 11/1/2017 and 11/30/2017
1 Sample(s) Required between 12/1/2017 and 12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

OH1600212 EDGEWOOD TERRACE MHP PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: EDGEWOOD TERRACE MHP DISTRIBUTION	Facility Class: CLASS 1
	SMP ID: DS201	ADDRESS NOT KNOWN	

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2017 and 9/30/2017at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2017

2017 ENTRY POINT SCHEDULE

OH1600412 HOUSE OF JACOB

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1653602 SMP ID: EP001	Facility Name: HOUSE OF JACOB WTP Facility Source: Ground Water	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2017 and 10/31/2017
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 3/31/2017
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2017 and 5/31/2017
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2017 and 10/31/2017



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

OH1600412 HOUSE OF JACOB

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: HOUSE OF JACOB DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 1/31/2017 1 Sample(s) Required between 2/1/2017 and 2/28/2017 1 Sample(s) Required between 3/1/2017 and 3/31/2017 1 Sample(s) Required between 4/1/2017 and 4/30/2017 1 Sample(s) Required between 5/1/2017 and 5/31/2017 1 Sample(s) Required between 6/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 7/31/2017 1 Sample(s) Required between 8/1/2017 and 8/31/2017 1 Sample(s) Required between 9/1/2017 and 9/30/2017 1 Sample(s) Required between 10/1/2017 and 10/31/2017 1 Sample(s) Required between 11/1/2017 and 11/30/2017 1 Sample(s) Required between 12/1/2017 and 12/31/2017
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2017 and 1/31/2017 1 Sample(s) Required between 2/1/2017 and 2/28/2017 1 Sample(s) Required between 3/1/2017 and 3/31/2017 1 Sample(s) Required between 4/1/2017 and 4/30/2017 1 Sample(s) Required between 5/1/2017 and 5/31/2017 1 Sample(s) Required between 6/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 7/31/2017 1 Sample(s) Required between 8/1/2017 and 8/31/2017 1 Sample(s) Required between 9/1/2017 and 9/30/2017 1 Sample(s) Required between 10/1/2017 and 10/31/2017 1 Sample(s) Required between 11/1/2017 and 11/30/2017 1 Sample(s) Required between 12/1/2017 and 12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: HOUSE OF JACOB DISTRIBUTION 25520 TOWNSHIP ROAD 39	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH1600612 WARSAW PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1653603	Facility Name: WARSAW	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2017 and 10/31/2017
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2017 and 5/31/2017
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2017 and 10/31/2017



OH1600612 WARSAW PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: WARSAW DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 1/31/2017
	1 Sample(s) Required between 2/1/2017 and 2/28/2017
	1 Sample(s) Required between 3/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 4/30/2017
	1 Sample(s) Required between 5/1/2017 and 5/31/2017
	1 Sample(s) Required between 6/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 7/31/2017
	1 Sample(s) Required between 8/1/2017 and 8/31/2017
	1 Sample(s) Required between 9/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 10/31/2017
	1 Sample(s) Required between 11/1/2017 and 11/30/2017
	1 Sample(s) Required between 12/1/2017 and 12/31/2017

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2017 and 1/31/2017
	1 Sample(s) Required between 2/1/2017 and 2/28/2017
	1 Sample(s) Required between 3/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 4/30/2017
	1 Sample(s) Required between 5/1/2017 and 5/31/2017
	1 Sample(s) Required between 6/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 7/31/2017
	1 Sample(s) Required between 8/1/2017 and 8/31/2017
	1 Sample(s) Required between 9/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 10/31/2017
	1 Sample(s) Required between 11/1/2017 and 11/30/2017
	1 Sample(s) Required between 12/1/2017 and 12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: WARSAW DISTRIBUTION 714 BEECH STREET	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2017 and 9/30/2017at: DS201
-------------------------	--

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

OH1600612 WARSAW PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: WARSAW DISTRIBUTION 197 SPRING MOUNTAIN ROAD	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2017 and 9/30/2017at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH1600712 WEST LAFAYETTE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1653604 SMP ID: EP001	Facility Name: WEST LAFAYETTE WTP Facility Source: Ground Water	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2017 and 10/31/2017
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2017 and 5/31/2017
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2017 and 10/31/2017



OH1600712 WEST LAFAYETTE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: WEST LAFAYETTE DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

TOTAL COLIFORM (TCR) - 3100	3 Sample(s) Required between 1/1/2017 and 1/31/2017
	3 Sample(s) Required between 2/1/2017 and 2/28/2017
	3 Sample(s) Required between 3/1/2017 and 3/31/2017
	3 Sample(s) Required between 4/1/2017 and 4/30/2017
	3 Sample(s) Required between 5/1/2017 and 5/31/2017
	3 Sample(s) Required between 6/1/2017 and 6/30/2017
	3 Sample(s) Required between 7/1/2017 and 7/31/2017
	3 Sample(s) Required between 8/1/2017 and 8/31/2017
	3 Sample(s) Required between 9/1/2017 and 9/30/2017
	3 Sample(s) Required between 10/1/2017 and 10/31/2017
	3 Sample(s) Required between 11/1/2017 and 11/30/2017
	3 Sample(s) Required between 12/1/2017 and 12/31/2017

TOTAL CHLORINE - 1000	3 Sample(s) Required between 1/1/2017 and 1/31/2017
	3 Sample(s) Required between 2/1/2017 and 2/28/2017
	3 Sample(s) Required between 3/1/2017 and 3/31/2017
	3 Sample(s) Required between 4/1/2017 and 4/30/2017
	3 Sample(s) Required between 5/1/2017 and 5/31/2017
	3 Sample(s) Required between 6/1/2017 and 6/30/2017
	3 Sample(s) Required between 7/1/2017 and 7/31/2017
	3 Sample(s) Required between 8/1/2017 and 8/31/2017
	3 Sample(s) Required between 9/1/2017 and 9/30/2017
	3 Sample(s) Required between 10/1/2017 and 10/31/2017
	3 Sample(s) Required between 11/1/2017 and 11/30/2017
	3 Sample(s) Required between 12/1/2017 and 12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: WEST LAFAYETTE DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2017 and 9/30/2017at: DS201
-------------------------	--

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

OH1600712 WEST LAFAYETTE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: WEST LAFAYETTE DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2017 and 9/30/2017at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH1600811 ECHOING HILLS VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1662407 SMP ID: EP002	Facility Name: ECHOING HILLS VILLAGE PLANT Facility Source: Ground Water	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 1/1/2017 and 5/31/2017

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 1 Sample(s) Required between 1/1/2017 and 5/31/2017

NITRATE - 1040 1 Sample(s) Required between 1/1/2017 and 5/31/2017

RADIOLOGICALS
1 Sample(s) Required between 1/1/2017 and 3/31/2017
1 Sample(s) Required between 4/1/2017 and 6/30/2017
1 Sample(s) Required between 7/1/2017 and 9/30/2017
1 Sample(s) Required between 10/1/2017 and 12/31/2017

Sample for all the analytes listed below:

GROSS ALPHA - 4002 RADIUM-228 - 4030

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 6/1/2017 and 10/31/2017

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC)
1 Sample(s) Required between 1/1/2017 and 3/31/2017
1 Sample(s) Required between 4/1/2017 and 6/30/2017
1 Sample(s) Required between 7/1/2017 and 9/30/2017
1 Sample(s) Required between 10/1/2017 and 12/31/2017



OH1600811 ECHOING HILLS VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: ECHOING HILLS VILLAGE DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 1/1/2017 and 6/30/2017
	10 Sample(s) Required between 7/1/2017 and 12/31/2017

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Form 5105 with appendix must be submitted to Ohio EPA within ten days from the end of the month(s) in which samples are collected. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>. For questions contact your Ohio EPA District Office representative.

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 1/31/2017
	1 Sample(s) Required between 2/1/2017 and 2/28/2017
	1 Sample(s) Required between 3/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 4/30/2017
	1 Sample(s) Required between 5/1/2017 and 5/31/2017
	1 Sample(s) Required between 6/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 7/31/2017
	1 Sample(s) Required between 8/1/2017 and 8/31/2017
	1 Sample(s) Required between 9/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 10/31/2017
	1 Sample(s) Required between 11/1/2017 and 11/30/2017
	1 Sample(s) Required between 12/1/2017 and 12/31/2017

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2017 and 1/31/2017
	1 Sample(s) Required between 2/1/2017 and 2/28/2017
	1 Sample(s) Required between 3/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 4/30/2017
	1 Sample(s) Required between 5/1/2017 and 5/31/2017
	1 Sample(s) Required between 6/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 7/31/2017
	1 Sample(s) Required between 8/1/2017 and 8/31/2017
	1 Sample(s) Required between 9/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 10/31/2017
	1 Sample(s) Required between 11/1/2017 and 11/30/2017
	1 Sample(s) Required between 12/1/2017 and 12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.



Effective Date: 01/13/2017

2017 DISTRIBUTION SCHEDULE

OH1600811 ECHOING HILLS VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: ECHOING HILLS VILLAGE DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2017 and 9/30/2017at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH1601012 MILLERS ACRES HOME OWNER ASSOCIATION

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1653606 SMP ID: EP001	Facility Name: MILLERS ACRES HOME OWNER ASSN Facility Source: Ground Water	Facility Class: CLASS A
--------------------------	---	---	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

Chemicals	Monitoring Requirements
INORGANICS <i>Sample for all the analytes listed below:</i> ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	1 Sample(s) Required between 6/1/2017 and 10/31/2017
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017
RADIOLOGICALS <i>Sample for all the analytes listed below:</i> GROSS ALPHA - 4002 RADIUM-228 - 4030	1 Sample(s) Required between 1/1/2017 and 5/31/2017
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 <i>Sample for all the analytes listed below:</i> ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	1 Sample(s) Required between 1/1/2017 and 5/31/2017
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2017 and 10/31/2017



OH1601012 MILLERS ACRES HOME OWNER ASSOCIATION

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: MILLERS ACRES HOME OWNER DISTRIBUTIO
Location SMP ID: DS000

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022

Not Required

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between 1/1/2017 and 1/31/2017
1 Sample(s) Required between 2/1/2017 and 2/28/2017
1 Sample(s) Required between 3/1/2017 and 3/31/2017
1 Sample(s) Required between 4/1/2017 and 4/30/2017
1 Sample(s) Required between 5/1/2017 and 5/31/2017
1 Sample(s) Required between 6/1/2017 and 6/30/2017
1 Sample(s) Required between 7/1/2017 and 7/31/2017
1 Sample(s) Required between 8/1/2017 and 8/31/2017
1 Sample(s) Required between 9/1/2017 and 9/30/2017
1 Sample(s) Required between 10/1/2017 and 10/31/2017
1 Sample(s) Required between 11/1/2017 and 11/30/2017
1 Sample(s) Required between 12/1/2017 and 12/31/2017

TOTAL CHLORINE - 1000

1 Sample(s) Required between 1/1/2017 and 1/31/2017
1 Sample(s) Required between 2/1/2017 and 2/28/2017
1 Sample(s) Required between 3/1/2017 and 3/31/2017
1 Sample(s) Required between 4/1/2017 and 4/30/2017
1 Sample(s) Required between 5/1/2017 and 5/31/2017
1 Sample(s) Required between 6/1/2017 and 6/30/2017
1 Sample(s) Required between 7/1/2017 and 7/31/2017
1 Sample(s) Required between 8/1/2017 and 8/31/2017
1 Sample(s) Required between 9/1/2017 and 9/30/2017
1 Sample(s) Required between 10/1/2017 and 10/31/2017
1 Sample(s) Required between 11/1/2017 and 11/30/2017
1 Sample(s) Required between 12/1/2017 and 12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Facility ID: DS1 Facility Name: MILLERS ACRES HOME OWNER DISTRIBUTIO
Location SMP ID: DS201 ADDRESS NOT KNOWN

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/8/2017 and 7/14/2017at: DS201
Dual Sample Required between 10/8/2017 and 10/14/2017at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



OH1601312 BOMAC MOBILE HOME PARK

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1653609 SMP ID: EP001	Facility Name: BOMAC Facility Source: Ground Water	Facility Class: CLASS A
--------------------------	---	---	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2017 and 10/31/2017
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2017 and 5/31/2017
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2017 and 10/31/2017



OH1601312 BOMAC MOBILE HOME PARK

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: BOMAC DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2017 and 9/30/2017
-------------------------------	---

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Form 5105 with appendix must be submitted to Ohio EPA within ten days from the end of the month(s) in which samples are collected. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>. For questions contact your Ohio EPA District Office representative.

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 1/31/2017
	1 Sample(s) Required between 2/1/2017 and 2/28/2017
	1 Sample(s) Required between 3/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 4/30/2017
	1 Sample(s) Required between 5/1/2017 and 5/31/2017
	1 Sample(s) Required between 6/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 7/31/2017
	1 Sample(s) Required between 8/1/2017 and 8/31/2017
	1 Sample(s) Required between 9/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 10/31/2017
	1 Sample(s) Required between 11/1/2017 and 11/30/2017
	1 Sample(s) Required between 12/1/2017 and 12/31/2017

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2017 and 1/31/2017
	1 Sample(s) Required between 2/1/2017 and 2/28/2017
	1 Sample(s) Required between 3/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 4/30/2017
	1 Sample(s) Required between 5/1/2017 and 5/31/2017
	1 Sample(s) Required between 6/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 7/31/2017
	1 Sample(s) Required between 8/1/2017 and 8/31/2017
	1 Sample(s) Required between 9/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 10/31/2017
	1 Sample(s) Required between 11/1/2017 and 11/30/2017
	1 Sample(s) Required between 12/1/2017 and 12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

OH1601312 BOMAC MOBILE HOME PARK

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: BOMAC DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2017 and 9/30/2017at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH1630112 WALHONDING HILLS CAMP

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: WALHONDING HILLS CAMP DISTRIBUTION
Location SMP ID: SUP01	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

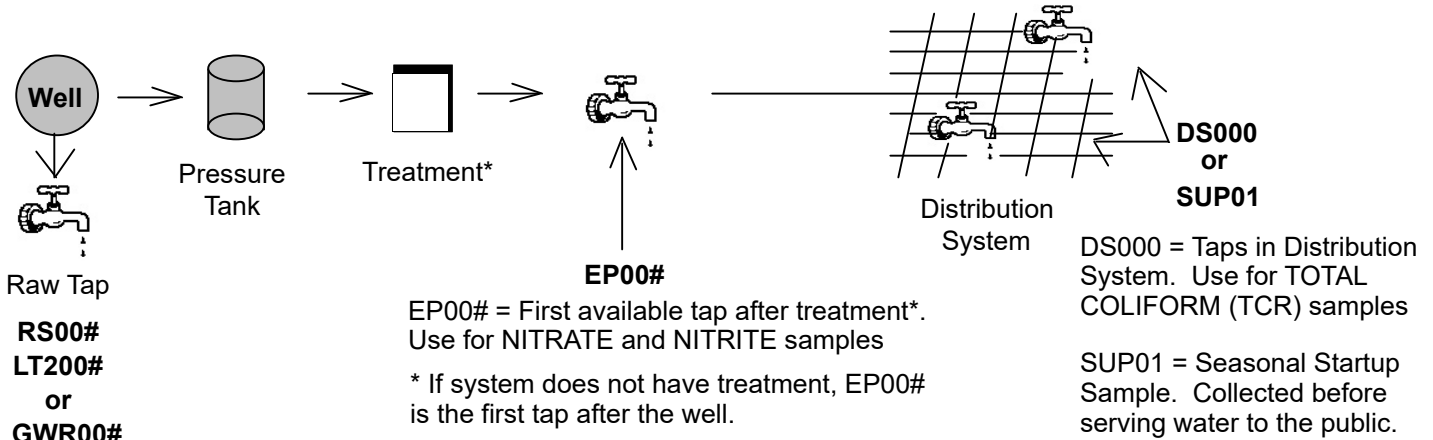

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1630112 WALHONDING HILLS CAMP

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: WALHONDING HILLS CAMP DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System

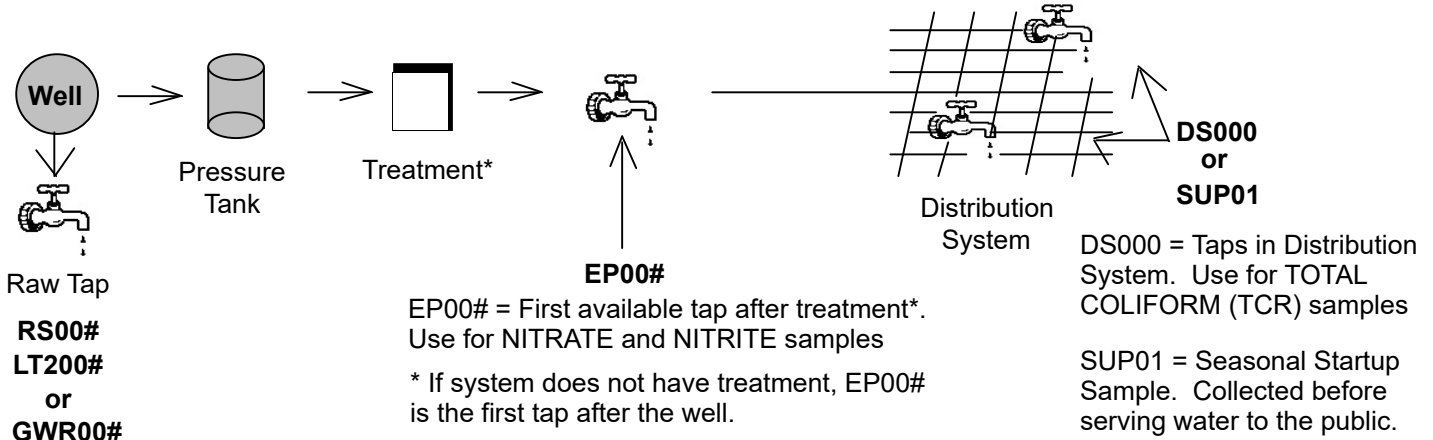

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1630112 WALHONDING HILLS CAMP

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653610 Facility Name: WALHONDING HILLS CAMP INC
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2017

2017 ENTRY POINT SCHEDULE

OH1630511 CONESVILLE GENERATING STATION

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1653612	Facility Name: CONESVILLE GENERATING STATION	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2017 and 10/31/2017

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 1/1/2017 and 5/31/2017

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 1/1/2017 and 5/31/2017

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2017 and 10/31/2017



OH1630511 CONESVILLE GENERATING STATION

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **CONESVILLE GENERATING ST DISTRIBUTION** Facility Class: **CLASS 1**
SMP ID: **DS000**

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017 1 Sample(s) Required between 4/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 9/30/2017 1 Sample(s) Required between 10/1/2017 and 12/31/2017
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2017 and 3/31/2017 1 Sample(s) Required between 4/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 9/30/2017 1 Sample(s) Required between 10/1/2017 and 12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: **DS1** Facility Name: **CONESVILLE GENERATING ST DISTRIBUTION** Facility Class: **CLASS 1**
SMP ID: **DS201** ADDRESS NOT KNOWN

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2017 and 2/7/2017at: DS201 Dual Sample Required between 5/1/2017 and 5/7/2017at: DS201 Dual Sample Required between 8/1/2017 and 8/7/2017at: DS201 Dual Sample Required between 11/1/2017 and 11/7/2017at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH1630712 CONESVILLE ELEMENTARY SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1653614	Facility Name: CONESVILLE ELEMENTARY SCHOOL	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

DIOXIN - 2063

Not Required

INORGANICS

1 Sample(s) Required between 6/1/2017 and 10/31/2017

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 7/1/2017 and 9/30/2017

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1

1 Sample(s) Required between 1/1/2017 and 5/31/2017

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC)

1 Sample(s) Required between 6/1/2017 and 10/31/2017



OH1630712 CONESVILLE ELEMENTARY SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **CONESVILLE ELEMENTARY SC DISTRIBUTION** Facility Class: **CLASS 1**
SMP ID: **DS000**

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017 1 Sample(s) Required between 4/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 9/30/2017 1 Sample(s) Required between 10/1/2017 and 12/31/2017
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2017 and 3/31/2017 1 Sample(s) Required between 4/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 9/30/2017 1 Sample(s) Required between 10/1/2017 and 12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: **DS1** Facility Name: **CONESVILLE ELEMENTARY SC DISTRIBUTION** Facility Class: **CLASS 1**
SMP ID: **DS201** ADDRESS NOT KNOWN

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2017 and 9/30/2017at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH1631112 FOREST HILL LAKE, INC.-CAMP PWS

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **FOREST HILL LAKE, INC.-C DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

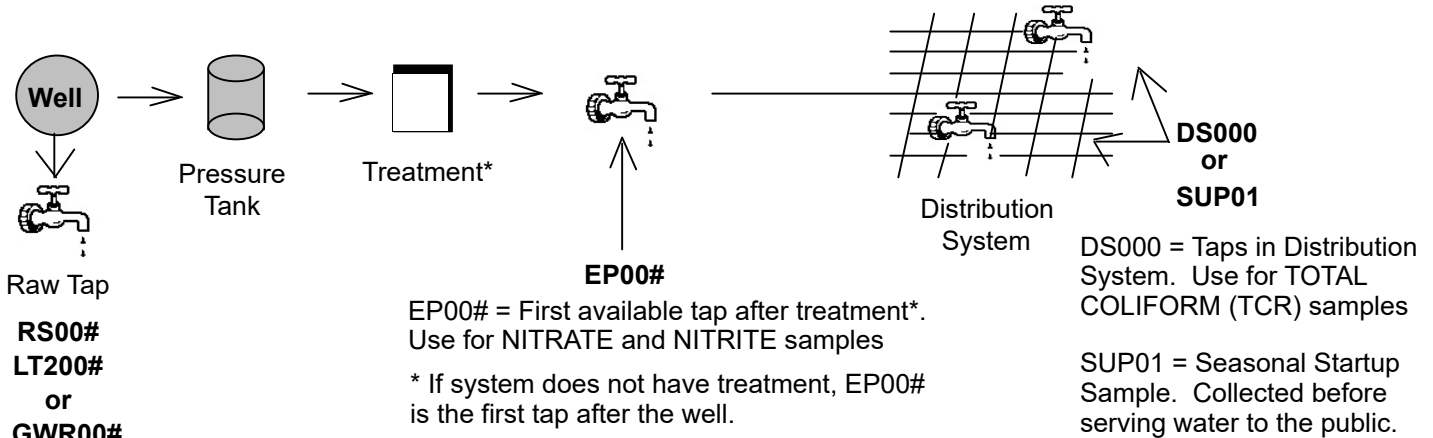

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1631112 FOREST HILL LAKE, INC.-CAMP PWS

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: FOREST HILL LAKE, INC.-C DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 9/30/2017

Where to Collect Samples For a Small Public Water System

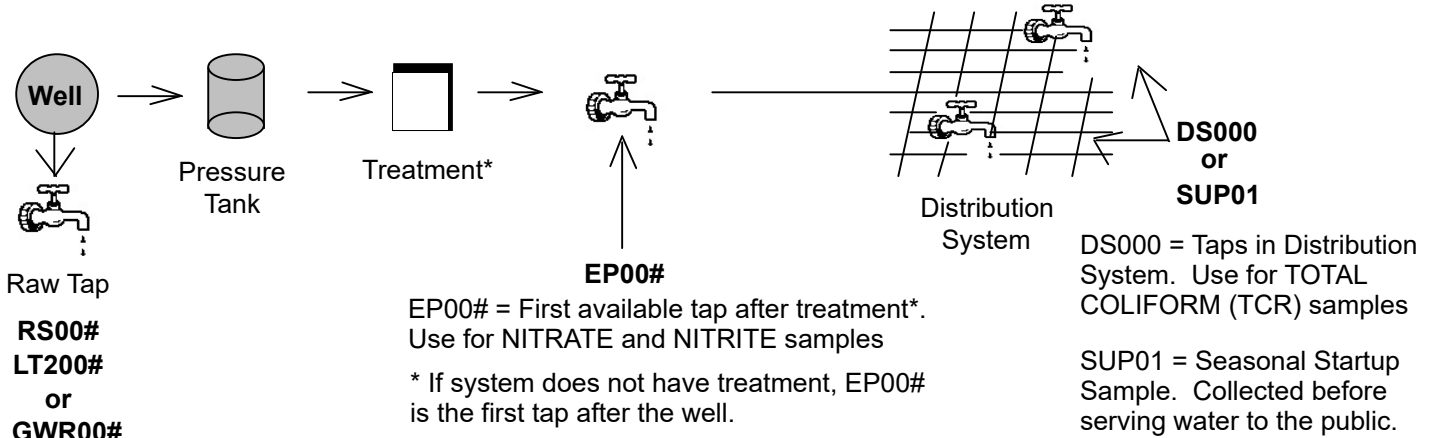

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1631112 FOREST HILL LAKE, INC.-CAMP PWS

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653616 Facility Name: FOREST HILL LAKE INC CAMP
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1631212 FOREST HILL LAKE, INC.-FSO PWS

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: FOREST HILL LAKE, INC.-F DISTRIBUTION
Location SMP ID: SUP01	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

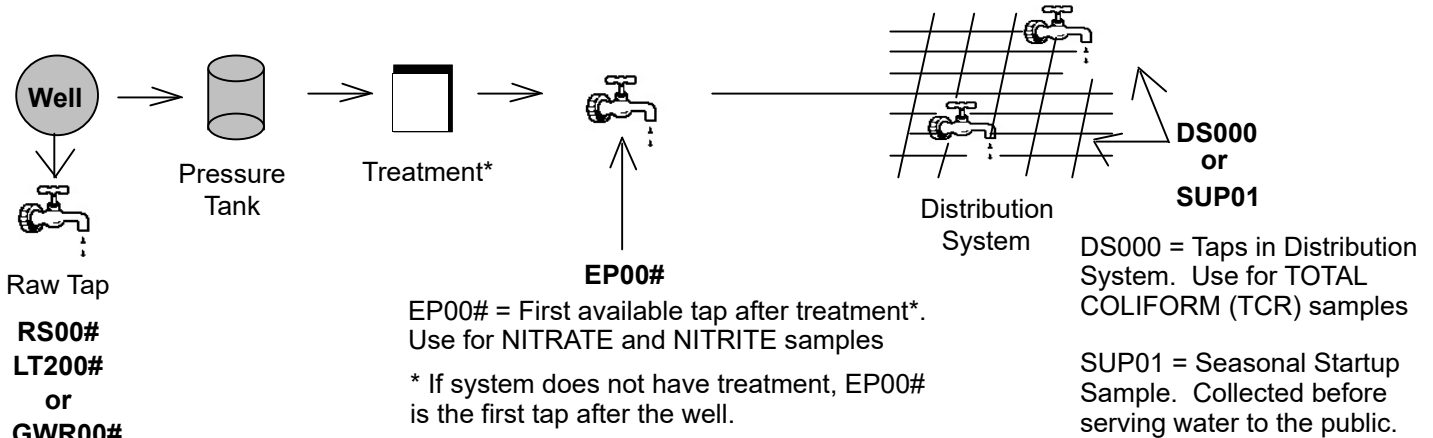

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1631212 FOREST HILL LAKE, INC.-FSO PWS

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: FOREST HILL LAKE, INC.-F DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 9/30/2017

Where to Collect Samples For a Small Public Water System

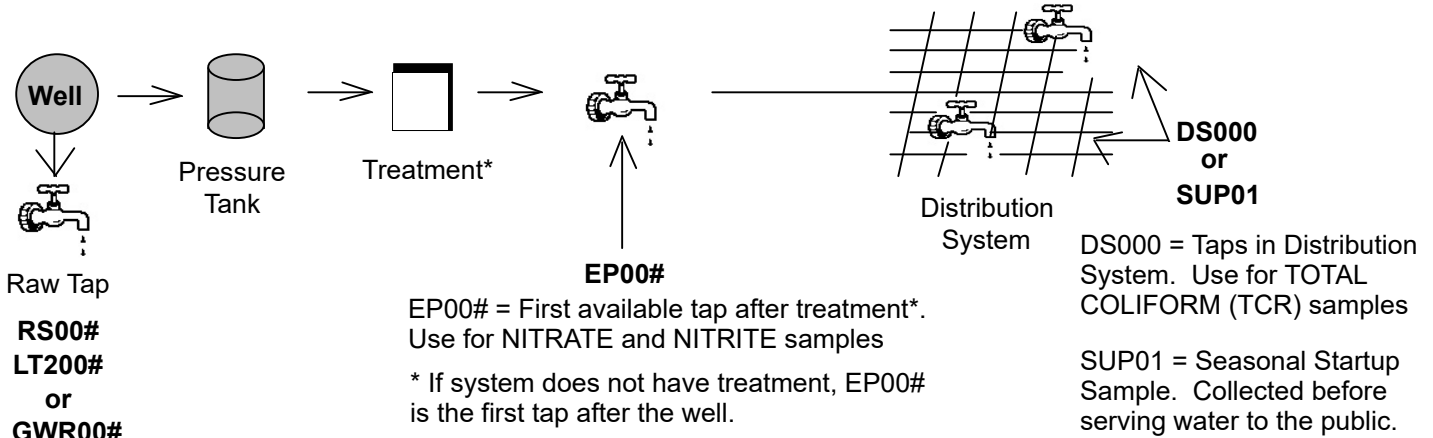

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1631212 FOREST HILL LAKE, INC.-FSO PWS

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653617 Facility Name: FOREST HILL LAKE INC FSO
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1631612 HICKORY FLAT GOLF COURSE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **HICKORY FLAT GOLF COURSE DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System

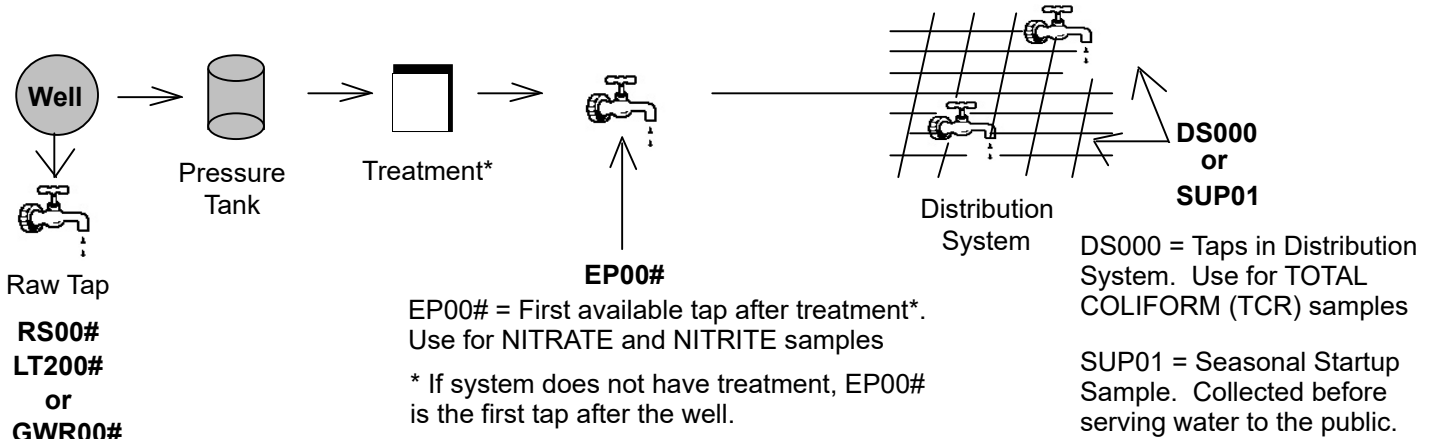

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1631612 HICKORY FLAT GOLF COURSE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653619 Facility Name: HICKORY FLAT GOLF COURSE
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2017

2017 ENTRY POINT SCHEDULE

OH1632012 KEENE ELEMENTARY SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1653621	Facility Name: KEENE ELEMENTARY SCHOOL	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2017 and 10/31/2017

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 1/1/2017 and 5/31/2017

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 1/1/2017 and 5/31/2017

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2017 and 10/31/2017



OH1632012 KEENE ELEMENTARY SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **KEENE ELEMENTARY SCHOOL DISTRIBUTION** Facility Class: **CLASS 1**
SMP ID: **DS000**

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017 1 Sample(s) Required between 4/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 9/30/2017 1 Sample(s) Required between 10/1/2017 and 12/31/2017
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2017 and 3/31/2017 1 Sample(s) Required between 4/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 9/30/2017 1 Sample(s) Required between 10/1/2017 and 12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: **DS1** Facility Name: **KEENE ELEMENTARY SCHOOL DISTRIBUTION** Facility Class: **CLASS 1**
SMP ID: **DS201** ADDRESS NOT KNOWN

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2017 and 9/30/2017at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH1632112 LAKE LILA (BACK WELL)

System Type: Transient Noncommunity

Operating Period: 4/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **LAKE LILA (BACK-WELL) DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

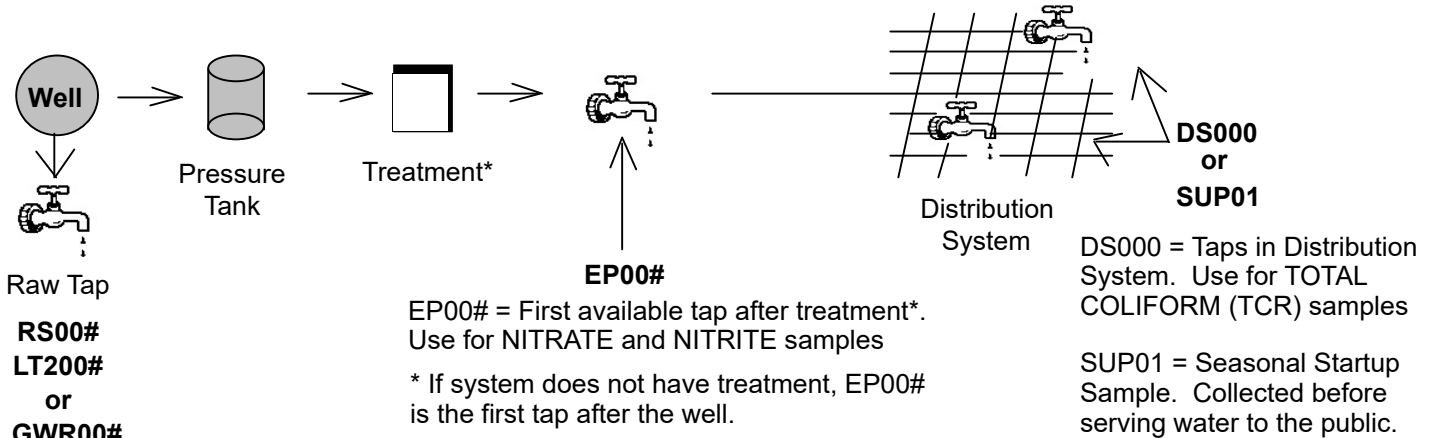

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1632112 LAKE LILA (BACK WELL)

System Type: Transient Noncommunity

Operating Period: 4/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: LAKE LILA (BACK-WELL) DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System

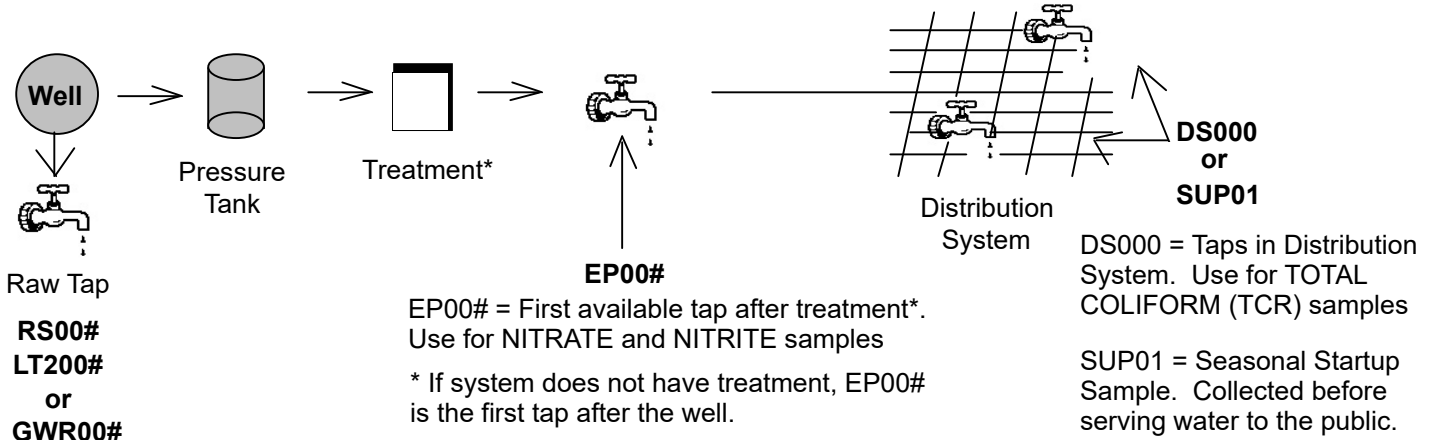

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1632112 LAKE LILA (BACK WELL)

System Type: Transient Noncommunity

Operating Period: 4/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653622 Facility Name: LAKE LILA BACK WELL
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System

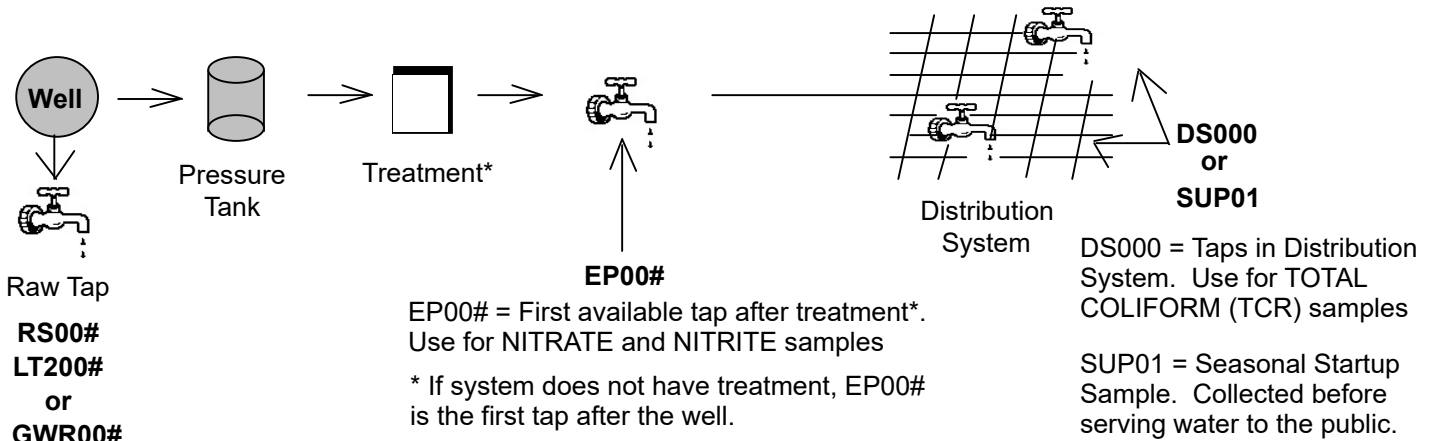

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1632212 LAKE LILA (FRONT-WELL)

System Type: Transient Noncommunity

Operating Period: 4/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **LAKE LILA (FRONT-WELL) DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

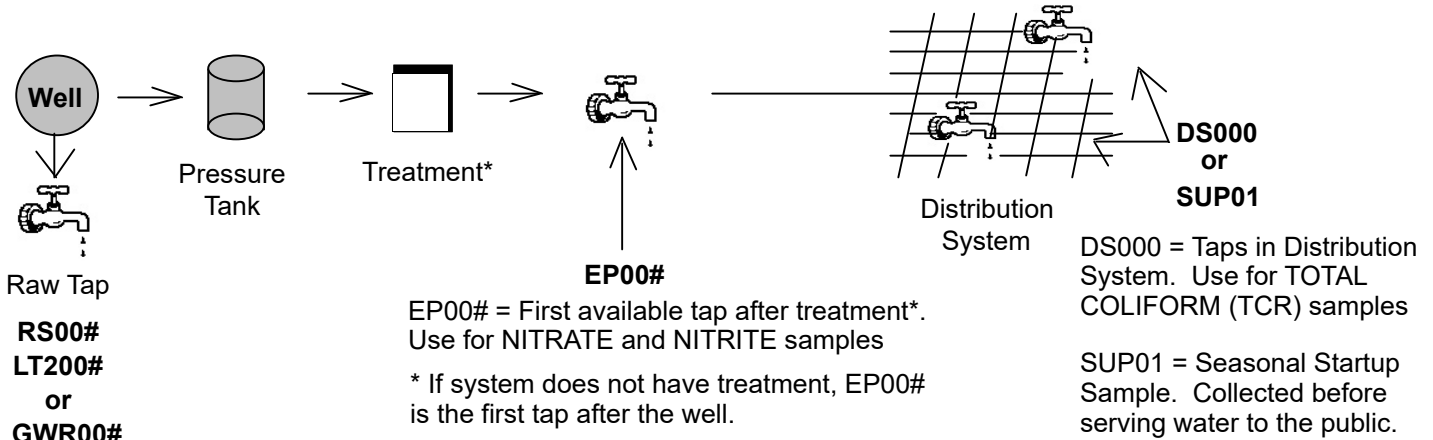

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1632212 LAKE LILA (FRONT-WELL)

System Type: Transient Noncommunity

Operating Period: 4/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: LAKE LILA (FRONT-WELL) DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System

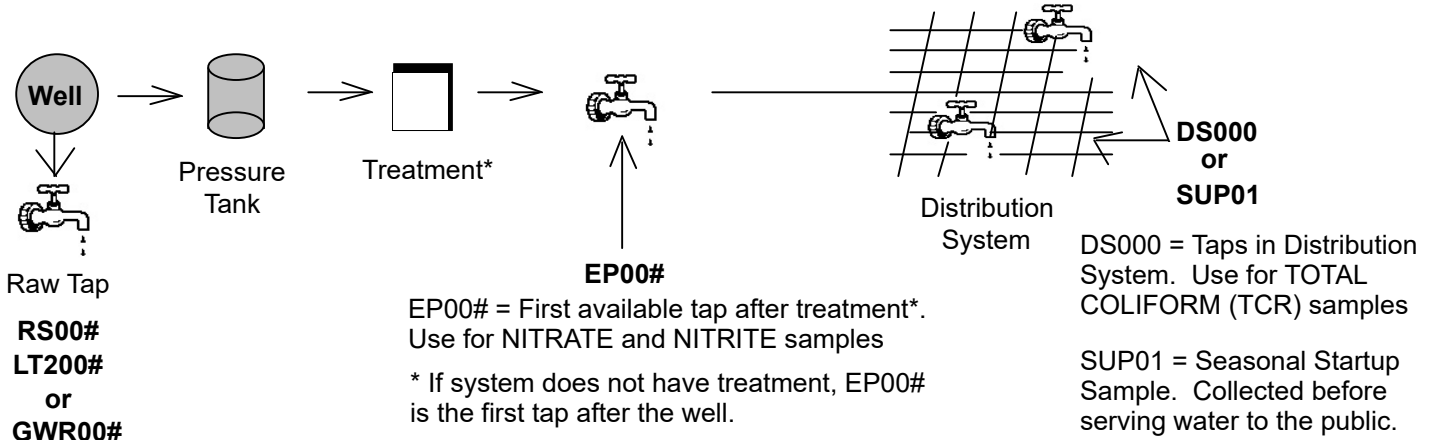

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1632212 LAKE LILA (FRONT-WELL)

System Type: Transient Noncommunity

Operating Period: 4/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653623 Facility Name: LAKE LILA FRONT WELL
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System

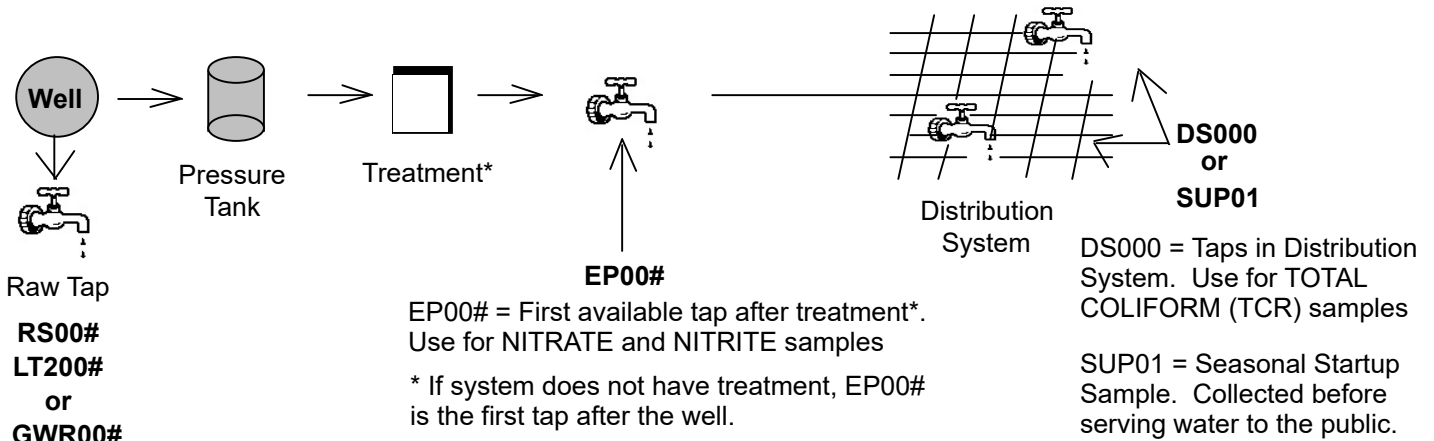

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1632312 PEGGY SUES STEAK AND RIBS PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: PEGGY SUES STEAK & RIBS DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1632312 PEGGY SUES STEAK AND RIBS PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653624 Facility Name: PEGGY SUES STEAK & RIBS
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1632512 MUSKINGUM VALLEY SCOUT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **MUSKINGUM VALLEY SCOUT DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

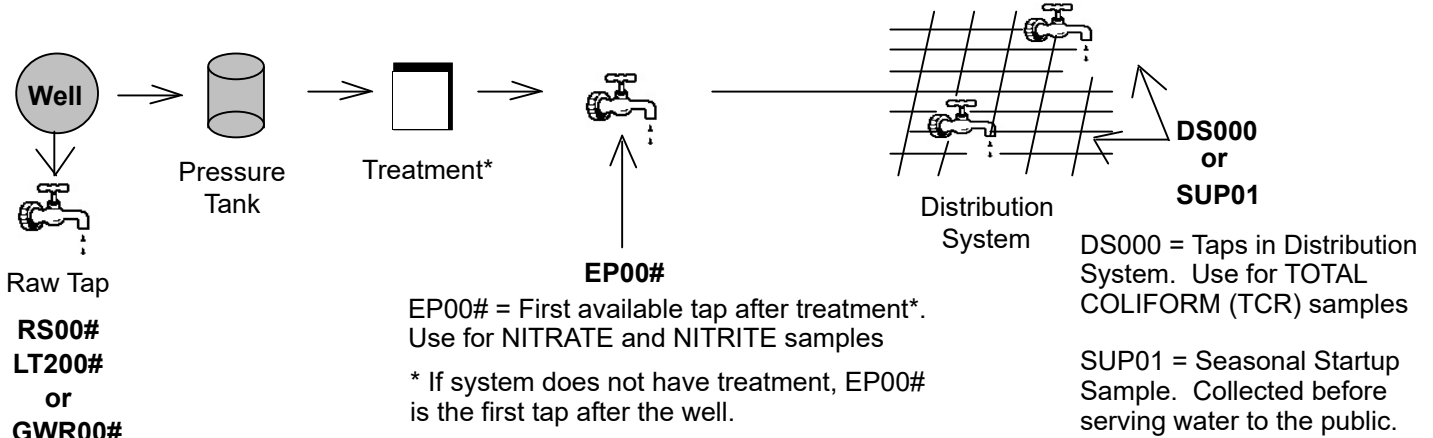

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1632512 MUSKINGUM VALLEY SCOUT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: MUSKINGUM VALLEY SCOUT DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System

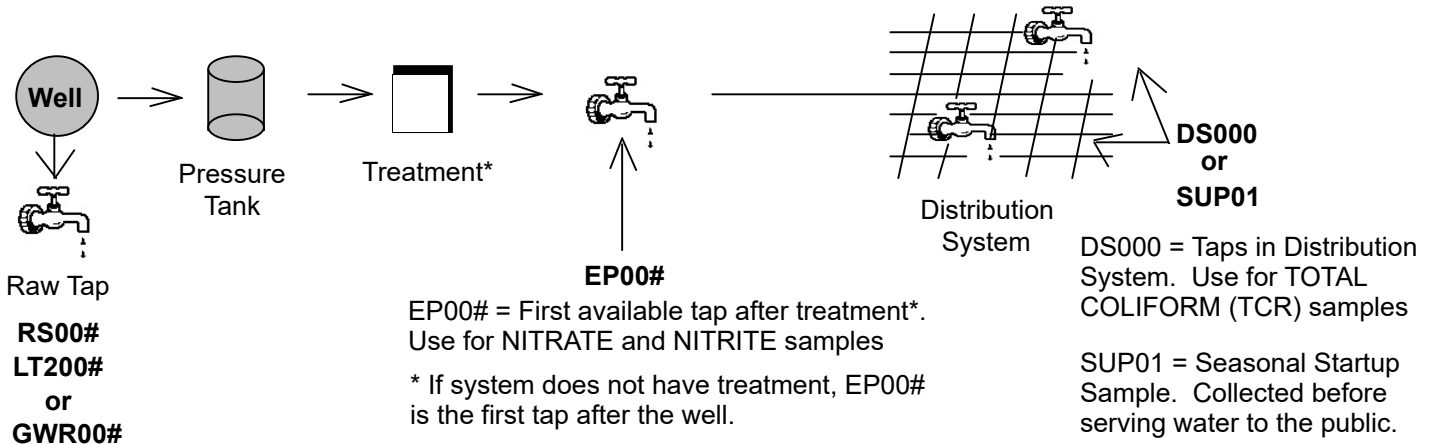

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1632512 MUSKINGUM VALLEY SCOUT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653625	Facility Name: MUSKINGUM VALLEY SCOUT RESERVATION
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1632712 WHISPERING FALLS, INC.

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **WHISPERING FALLS, INC. DISTRIBUTION**
 Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System

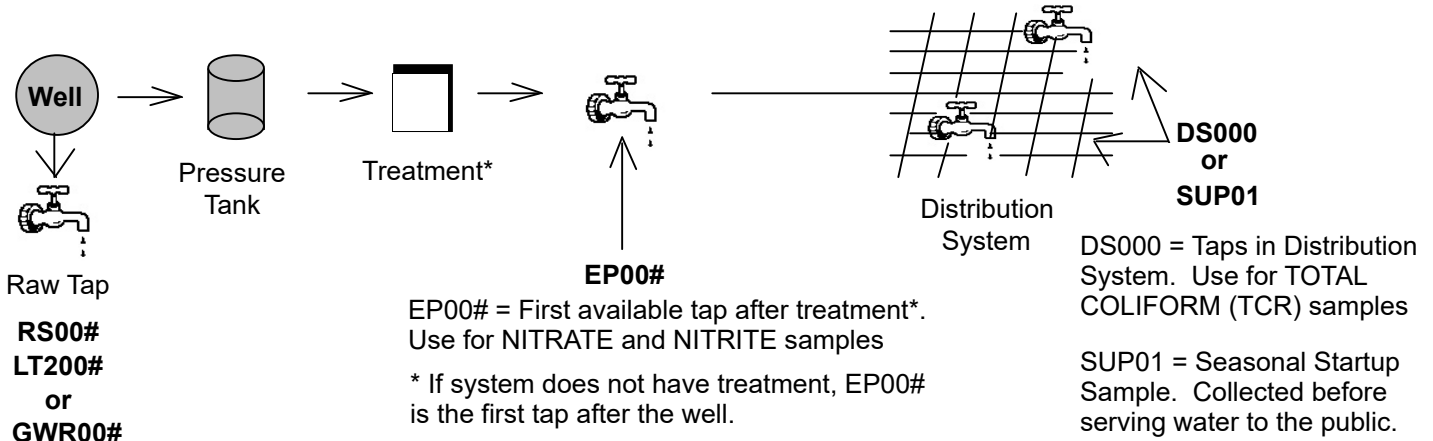

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1632712 WHISPERING FALLS, INC.

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653627 Facility Name: WHISPERING FALLS INC
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1632812 PLAINFIELD COMMUNITY CENTER

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653628 Facility Name: PLAINFIELD COMMUNITY CENTER
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017

Where to Collect Samples For a Small Public Water System

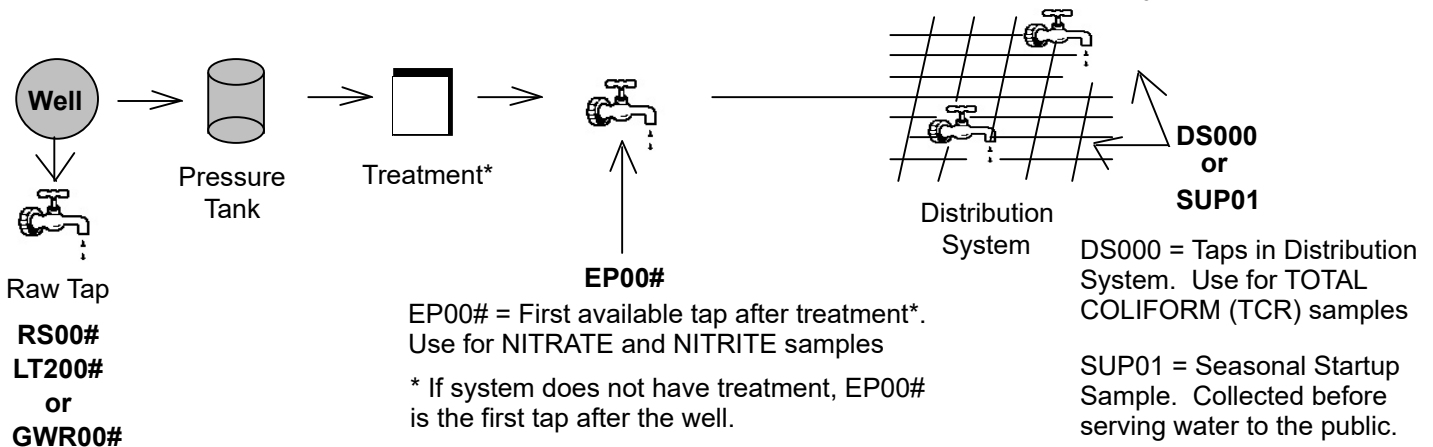

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1632912 RIVERGREEN GOLF PRO SHOP PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: RIVERGREEN GOLF CLUB DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1632912 RIVERGREEN GOLF PRO SHOP PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653629 Facility Name: RIVERGREEN GOLF CLUB

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System

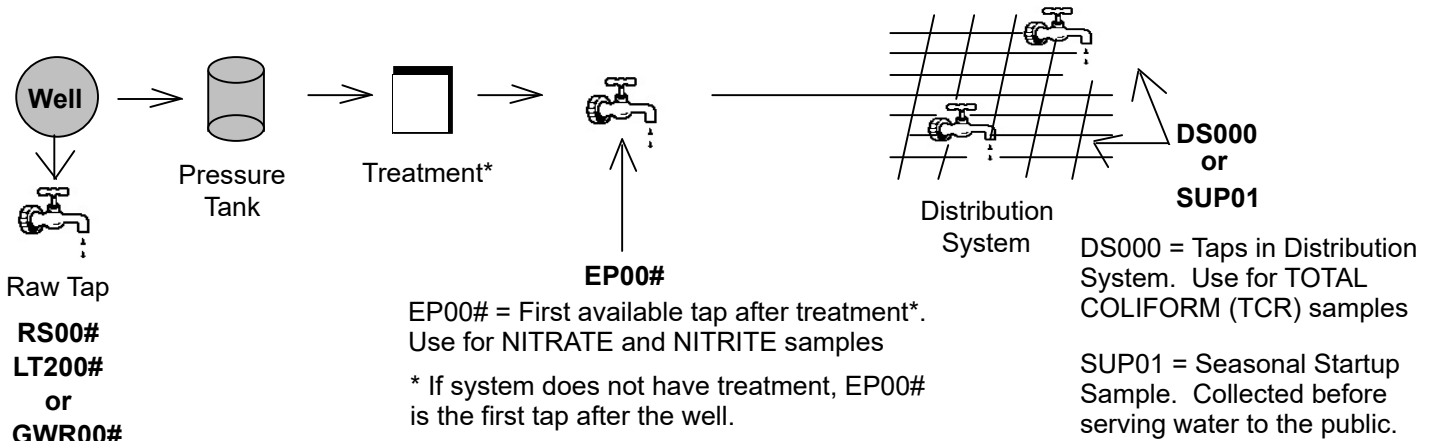

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1633012 RIVERGREEN GOLF COURSE CLUB HOUSE PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: RIVERGREEN GOLF COURSE DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1633012 RIVERGREEN GOLF COURSE CLUB HOUSE PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653630 Facility Name: RIVERGREEN GOLF COURSE
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2017

2017 ENTRY POINT SCHEDULE

OH1633112 RIVERVIEW HIGH SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1653631	Facility Name: RIVERVIEW LOCAL SCH DIST	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2017 and 10/31/2017

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 1/1/2017 and 5/31/2017

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 1/1/2017 and 5/31/2017

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2017 and 10/31/2017



OH1633112 RIVERVIEW HIGH SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: RIVERVIEW HIGH SCHOOL DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2017 and 1/31/2017
	2 Sample(s) Required between 2/1/2017 and 2/28/2017
	2 Sample(s) Required between 3/1/2017 and 3/31/2017
	2 Sample(s) Required between 4/1/2017 and 4/30/2017
	2 Sample(s) Required between 5/1/2017 and 5/31/2017
	2 Sample(s) Required between 6/1/2017 and 6/30/2017
	2 Sample(s) Required between 7/1/2017 and 7/31/2017
	2 Sample(s) Required between 8/1/2017 and 8/31/2017
	2 Sample(s) Required between 9/1/2017 and 9/30/2017
	2 Sample(s) Required between 10/1/2017 and 10/31/2017
	2 Sample(s) Required between 11/1/2017 and 11/30/2017
	2 Sample(s) Required between 12/1/2017 and 12/31/2017

TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2017 and 1/31/2017
	2 Sample(s) Required between 2/1/2017 and 2/28/2017
	2 Sample(s) Required between 3/1/2017 and 3/31/2017
	2 Sample(s) Required between 4/1/2017 and 4/30/2017
	2 Sample(s) Required between 5/1/2017 and 5/31/2017
	2 Sample(s) Required between 6/1/2017 and 6/30/2017
	2 Sample(s) Required between 7/1/2017 and 7/31/2017
	2 Sample(s) Required between 8/1/2017 and 8/31/2017
	2 Sample(s) Required between 9/1/2017 and 9/30/2017
	2 Sample(s) Required between 10/1/2017 and 10/31/2017
	2 Sample(s) Required between 11/1/2017 and 11/30/2017
	2 Sample(s) Required between 12/1/2017 and 12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: RIVERVIEW HIGH SCHOOL DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2017 and 9/30/2017at: DS201
-------------------------	--

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

OH1633112 RIVERVIEW HIGH SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: RIVERVIEW HIGH SCHOOL DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2017 and 9/30/2017at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2017

2017 ENTRY POINT SCHEDULE

OH1633812 UNION ELEMENTARY SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1653632	Facility Name: UNION ELEMENTARY SCHOOL	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2017 and 10/31/2017

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 1/1/2017 and 5/31/2017

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 1/1/2017 and 5/31/2017

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2017 and 10/31/2017



OH1633812 UNION ELEMENTARY SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: UNION ELEMENTARY SCHOOL DISTRIBUTION
--------------------------	---	--

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017 1 Sample(s) Required between 4/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 9/30/2017 1 Sample(s) Required between 10/1/2017 and 12/31/2017
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2017 and 3/31/2017 1 Sample(s) Required between 4/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 9/30/2017 1 Sample(s) Required between 10/1/2017 and 12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: UNION ELEMENTARY SCHOOL DISTRIBUTION ADDRESS NOT KNOWN
--------------------------	---	--

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2017 and 9/30/2017at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2017

2017 ENTRY POINT SCHEDULE

OH1633912 AK STEEL COSHOCTON WORKS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1653633	Facility Name: AK STEEL CORP	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2017 and 10/31/2017

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 1/1/2017 and 5/31/2017

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 1/1/2017 and 5/31/2017

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2017 and 10/31/2017



OH1633912 AK STEEL COSHOCTON WORKS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: AK STEEL DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2017 and 9/30/2017

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Form 5105 with appendix must be submitted to Ohio EPA within ten days from the end of the month(s) in which samples are collected. Forms are available online at: http://epa.ohio.gov/ddagw/reporting.aspx. For questions contact your Ohio EPA District Office representative.

TOTAL COLIFORM (TCR) - 3100 1 Sample(s) Required between 1/1/2017 and 3/31/2017
1 Sample(s) Required between 4/1/2017 and 6/30/2017
1 Sample(s) Required between 7/1/2017 and 9/30/2017
1 Sample(s) Required between 10/1/2017 and 12/31/2017

TOTAL CHLORINE - 1000 1 Sample(s) Required between 1/1/2017 and 3/31/2017
1 Sample(s) Required between 4/1/2017 and 6/30/2017
1 Sample(s) Required between 7/1/2017 and 9/30/2017
1 Sample(s) Required between 10/1/2017 and 12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: AK STEEL DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2017 and 9/30/2017at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950

OH1634012 UNUSUAL SHOPPE AND JUNCTION

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: UNUSUAL SHOPPE & JUNCTIO DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System

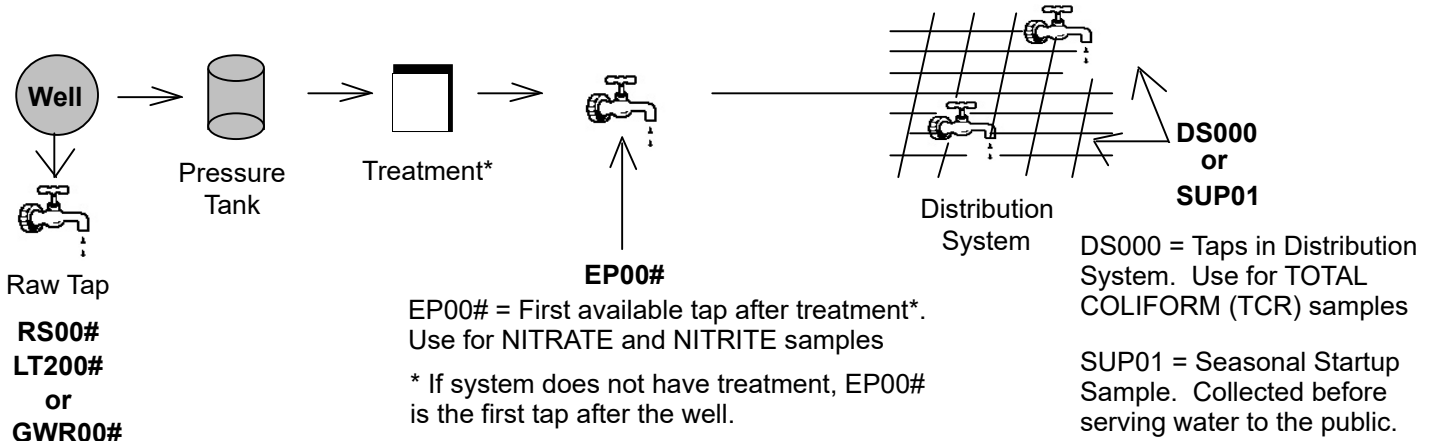

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1634012 UNUSUAL SHOPPE AND JUNCTION

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653634 Facility Name: UNUSUAL SHOPPE & JUNCTION
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 4/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 9/30/2017 1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System

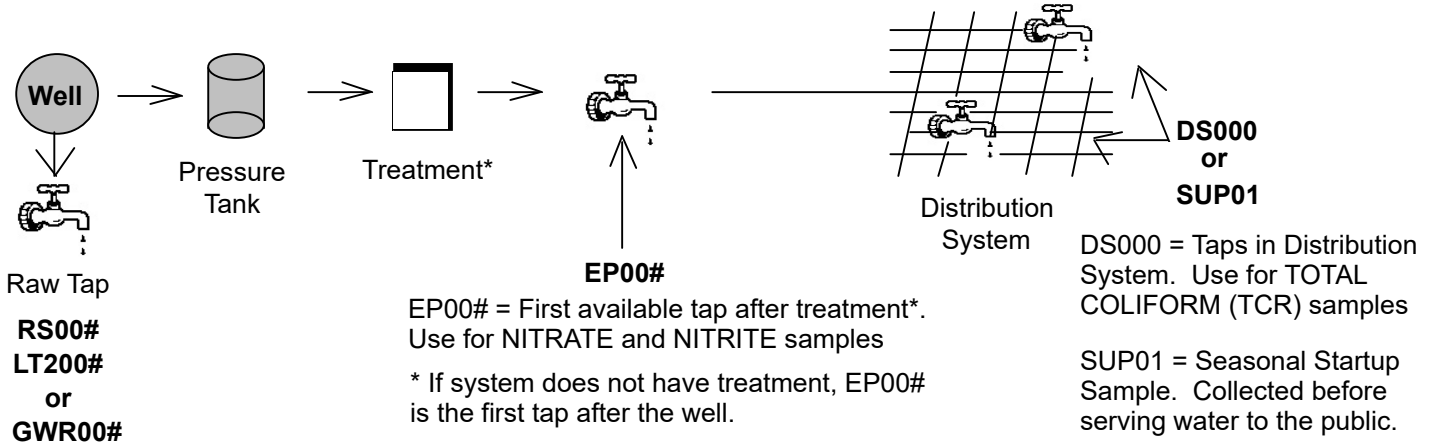

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1634612 FRESNO BIBLE CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **FRESNO BIBLE CHURCH DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System

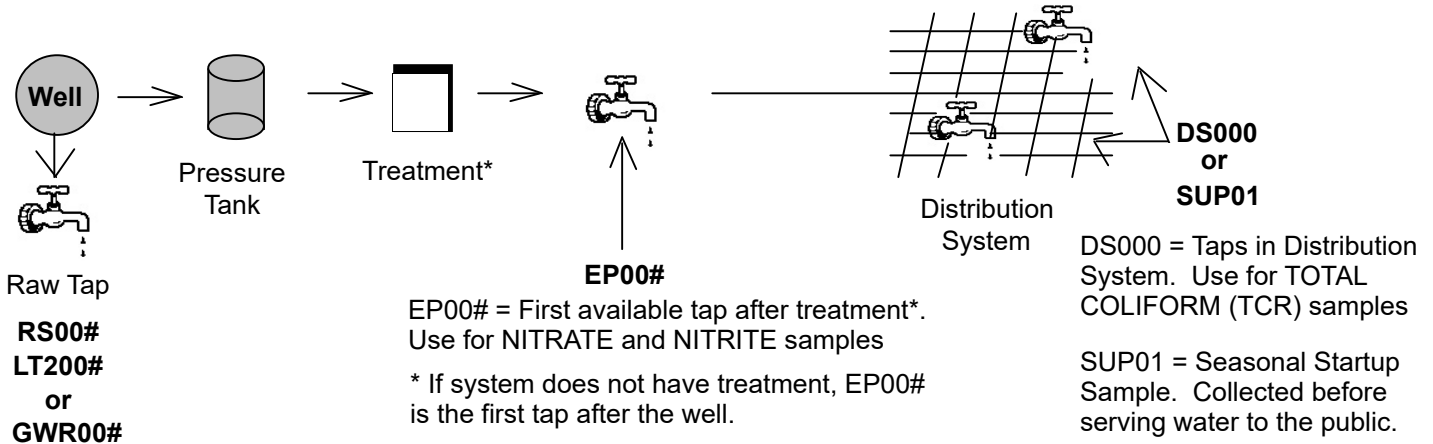

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1634612 FRESNO BIBLE CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653637 Facility Name: FRESNO BIBLE CHURCH
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1635412 PILGRIM HILLS CONFERENCE CENTER PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **PILGRIM HILLS CONFERENCE CENTER DISTRIBU**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System

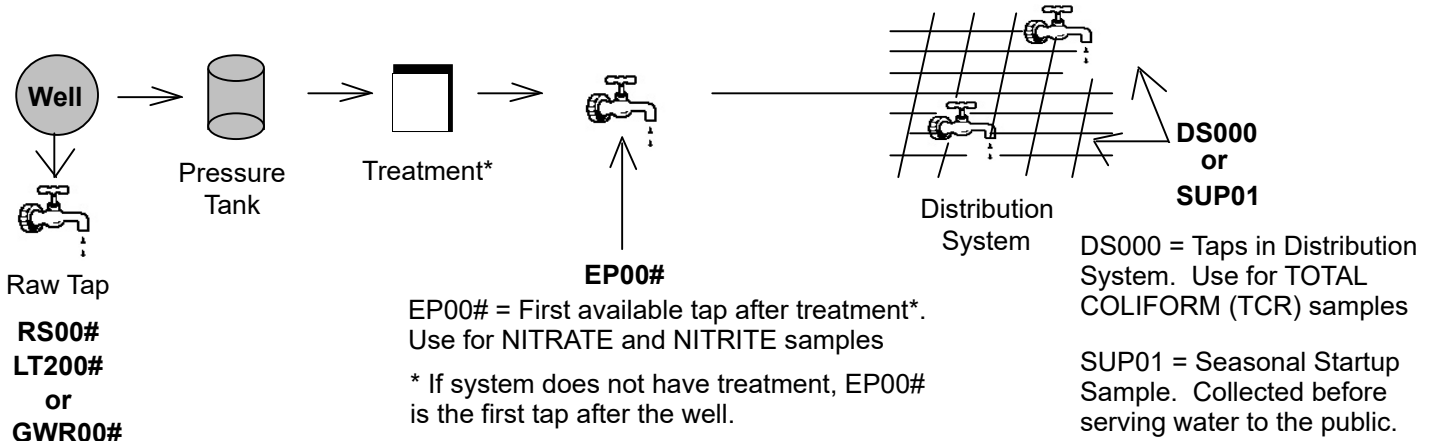

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1635412 PILGRIM HILLS CONFERENCE CENTER PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653639 Facility Name: PILGRIM HILLS CONFERENCE CENTER
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1636512 KINGDOM HALL OF JEHOVAHS WITNESS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: KINGDOM HALL OF JEHOVAHS DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 1/31/2017
	1 Sample(s) Required between 2/1/2017 and 2/28/2017
	1 Sample(s) Required between 3/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 4/30/2017
	1 Sample(s) Required between 5/1/2017 and 5/31/2017
	1 Sample(s) Required between 6/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 7/31/2017
	1 Sample(s) Required between 8/1/2017 and 8/31/2017
	1 Sample(s) Required between 9/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 10/31/2017
	1 Sample(s) Required between 11/1/2017 and 11/30/2017
	1 Sample(s) Required between 12/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System

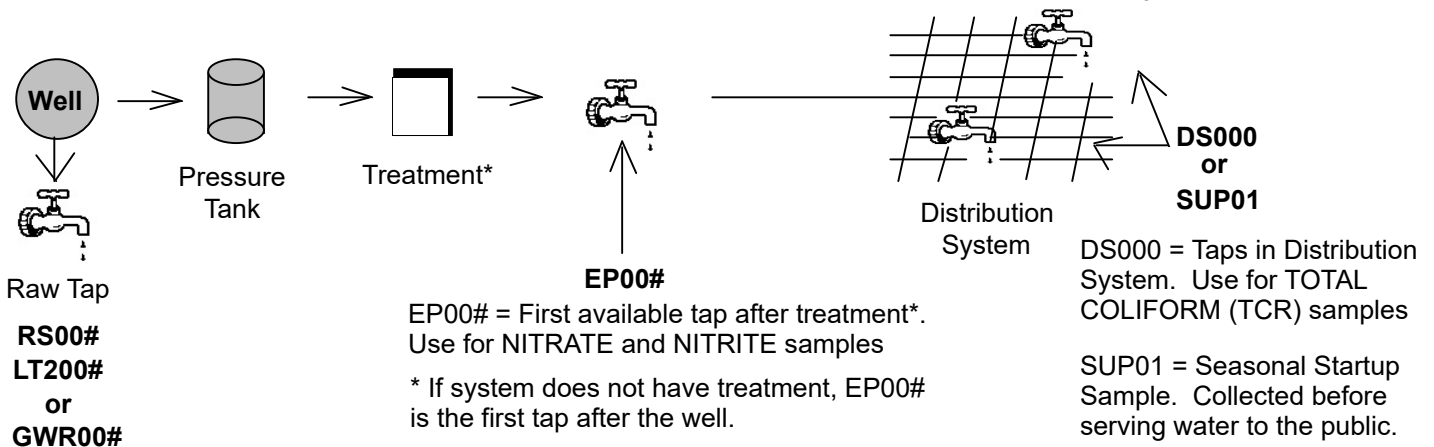

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1636512 KINGDOM HALL OF JEHOVAHS WITNESS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653648 Facility Name: KINGDOM HALL OF JEHOVAHS WITNE

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System

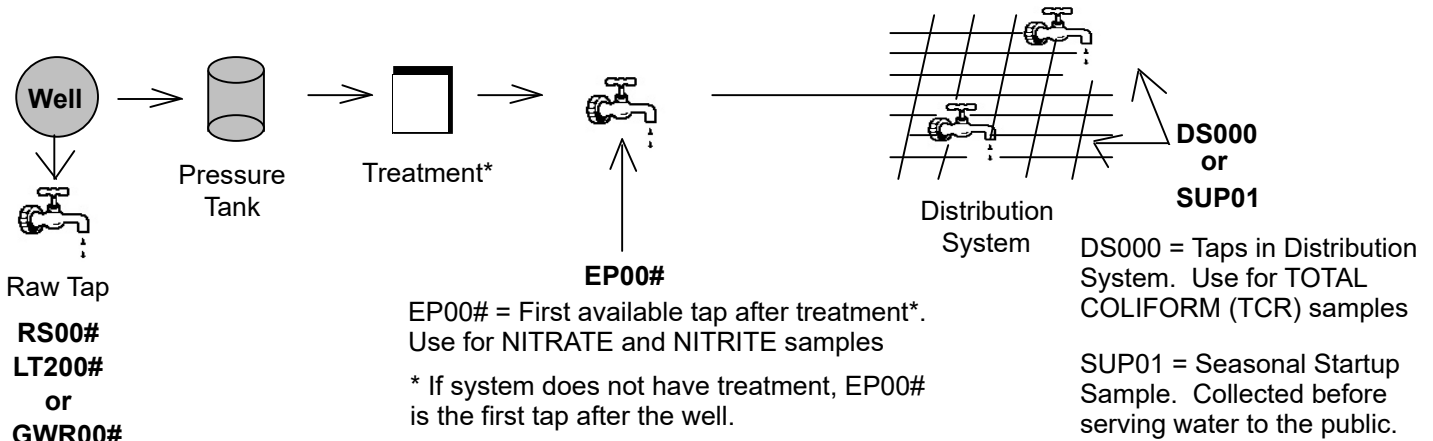

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1637012 RIVER GREENS GOLFCOURSE SHELTER PWS

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **RIVER GREEN GOLFCOURSE S DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

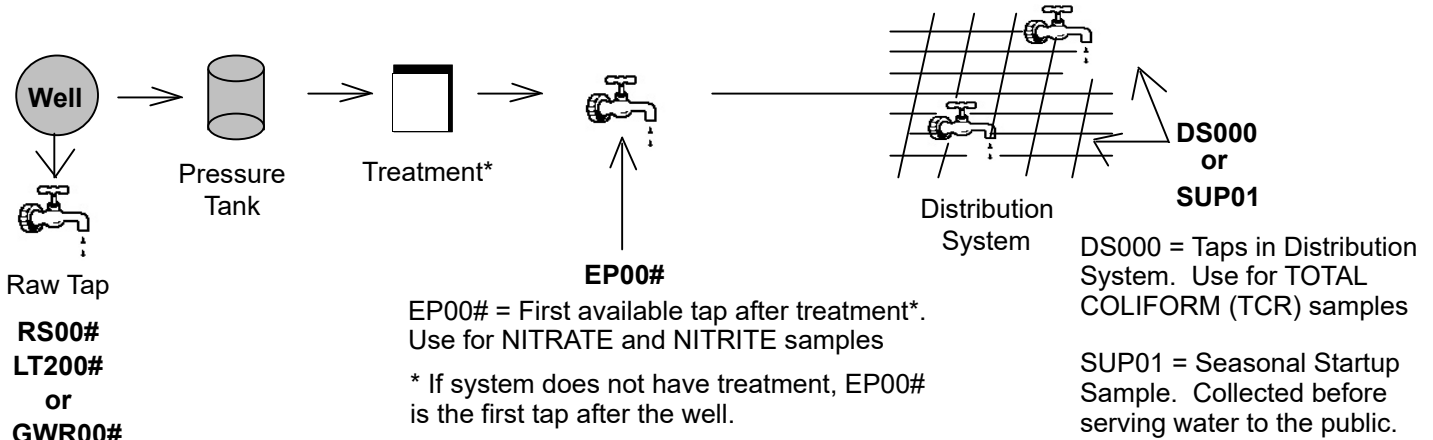

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1637012 RIVER GREENS GOLFCOURSE SHELTER PWS

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: RIVER GREEN GOLFCOURSE S DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System

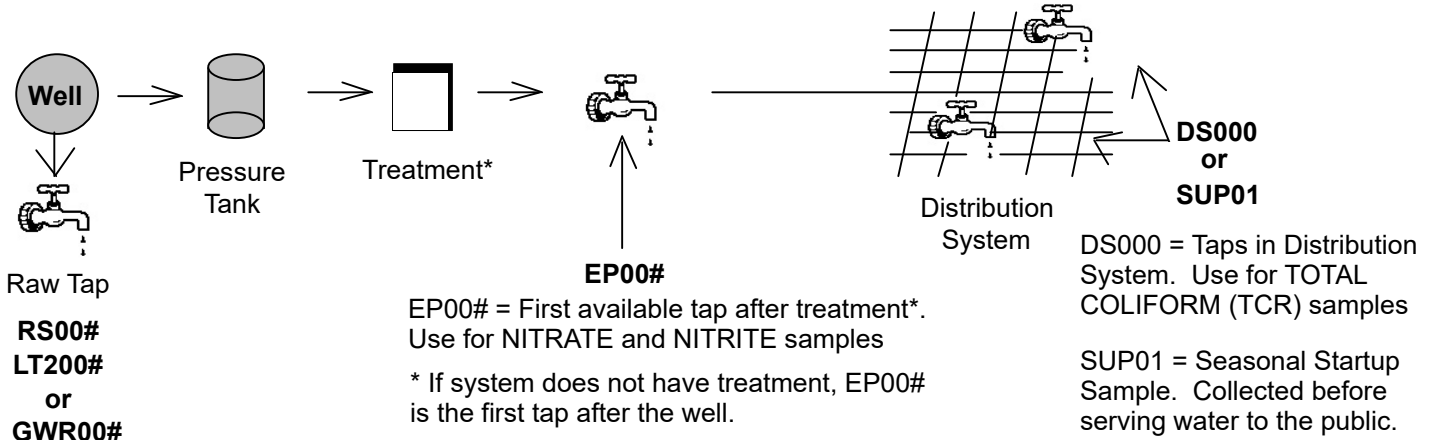

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1637012 RIVER GREENS GOLFCOURSE SHELTER PWS

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653652 Facility Name: RIVERGREENS GOLF COURSE SHELTER
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1637212 GOSPEL HILL MINISTRY

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: GOSPEL HILL MINISTRY DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System

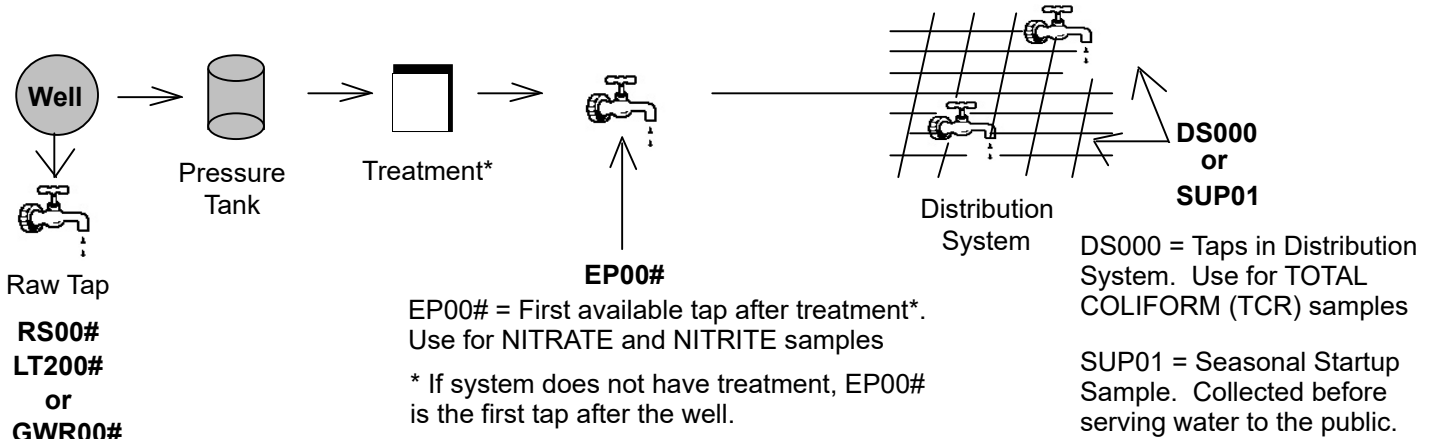

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1637212 GOSPEL HILL MINISTRY

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653654	Facility Name: GOSPEL HILL MINISTRY
Location SMP ID: EP001	Facility Source: Ground Water
	Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System

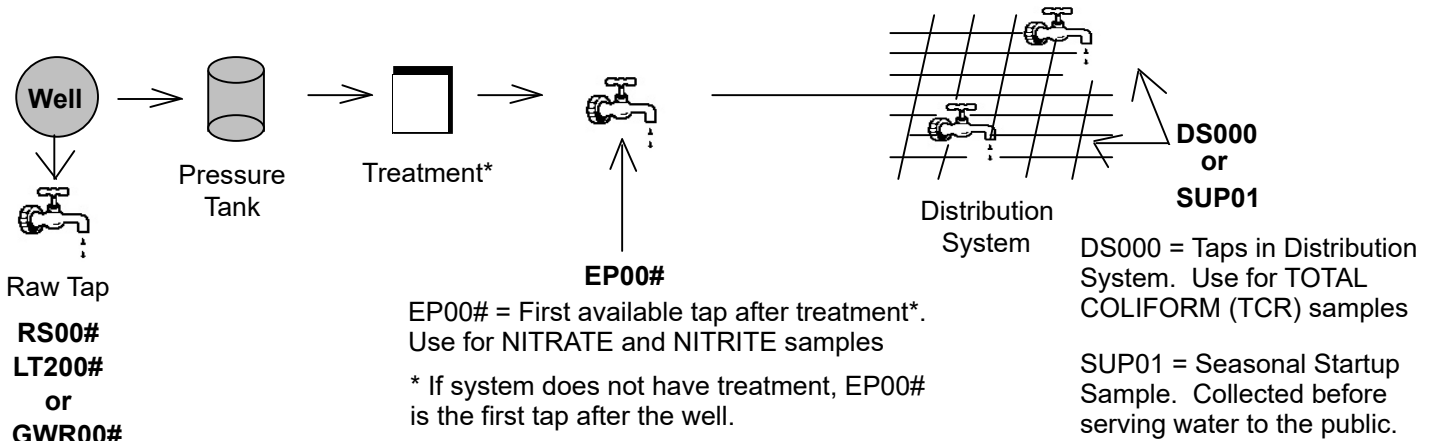

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 07/14/2017

2017 ENTRY POINT SCHEDULE

OH1637412 SALEM AMISH FELLOWSHIP CHURCH SCHOOL PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1660815 Facility Name: SALEM AMISH FELLOWSHIP CHURCH
Location SMP ID: EP001 Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2017 and 10/31/2017

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 1/1/2017 and 5/31/2017

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 6/1/2017 and 10/31/2017

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 7/1/2017 and 9/30/2017

1 Sample(s) Required between 10/1/2017 and 12/31/2017



Effective Date: 07/14/2017

2017 DISTRIBUTION SCHEDULE

OH1637412 SALEM AMISH FELLOWSHIP CHURCH SCHOOL PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: SALEM AMISH FELLOWSHIP CHURCH DISTRIE
--------------------------	---	---

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 7/1/2017 and 12/31/2017

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Form 5105 with appendix must be submitted to Ohio EPA within ten days from the end of the month(s) in which samples are collected. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>. For questions contact your Ohio EPA District Office representative.

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between 1/1/2017 and 3/31/2017

1 Sample(s) Required between 4/1/2017 and 6/30/2017

1 Sample(s) Required between 7/1/2017 and 9/30/2017

1 Sample(s) Required between 10/1/2017 and 12/31/2017

OH1637712 KEENE UNITED METHODIST CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **KEENE UNITED METHODIST CHURCH DISTRIBUTI**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System

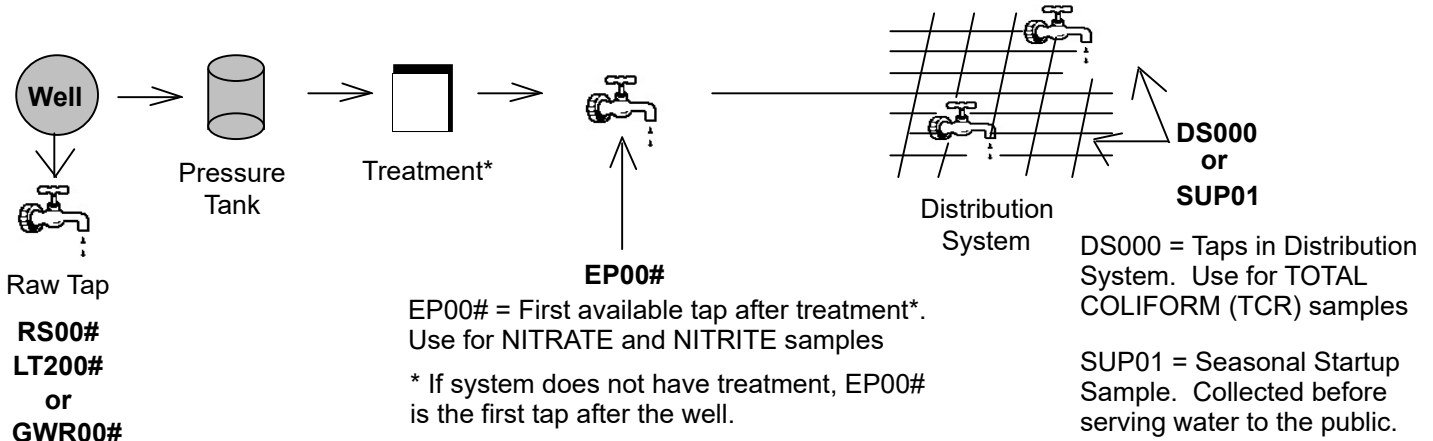

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1637712 KEENE UNITED METHODIST CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1660945 Facility Name: KEENE UNITED METHODIST CHURCH
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1637912 CONESVILLE UNITED METHODIST CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CONESVILLE UNITED METHODIST CHURCH DISTR
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1637912 CONESVILLE UNITED METHODIST CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1661401	Facility Name: CONESVILLE UNITED METHODIST CHURCH
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1638012 PERRY CHAPEL BAPTIST CHURCH-OLD CHURCH P

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: PERRY CHAPEL BAPTIST CHURCH - OLD CHURCH
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System

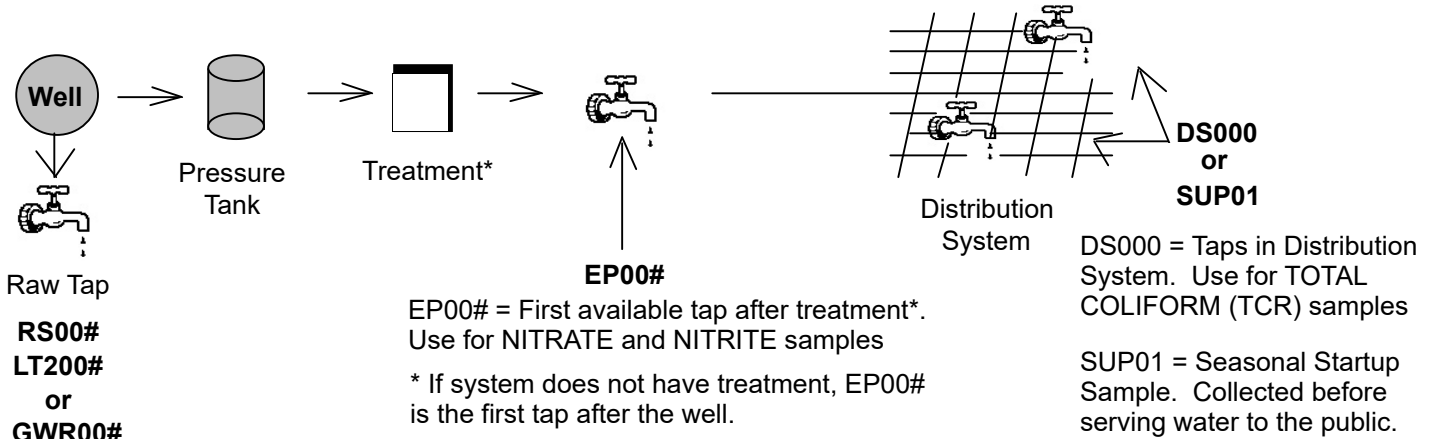

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1638012 PERRY CHAPEL BAPTIST CHURCH-OLD CHURCH P

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1661548	Facility Name: PERRY CHAPEL BAPTIST CHURCH-OLD CHURCH
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1638112 PERRY CHAPEL BAPTIST CHURCH-NEW CHURCH P

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: PERRY CHAPEL BAPTIST CHURCH - NEW CHURCH
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1638112 PERRY CHAPEL BAPTIST CHURCH-NEW CHURCH P

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1661549	Facility Name: PERRY CHAPEL BAPTIST CHURCH-NEW CHURCH
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System

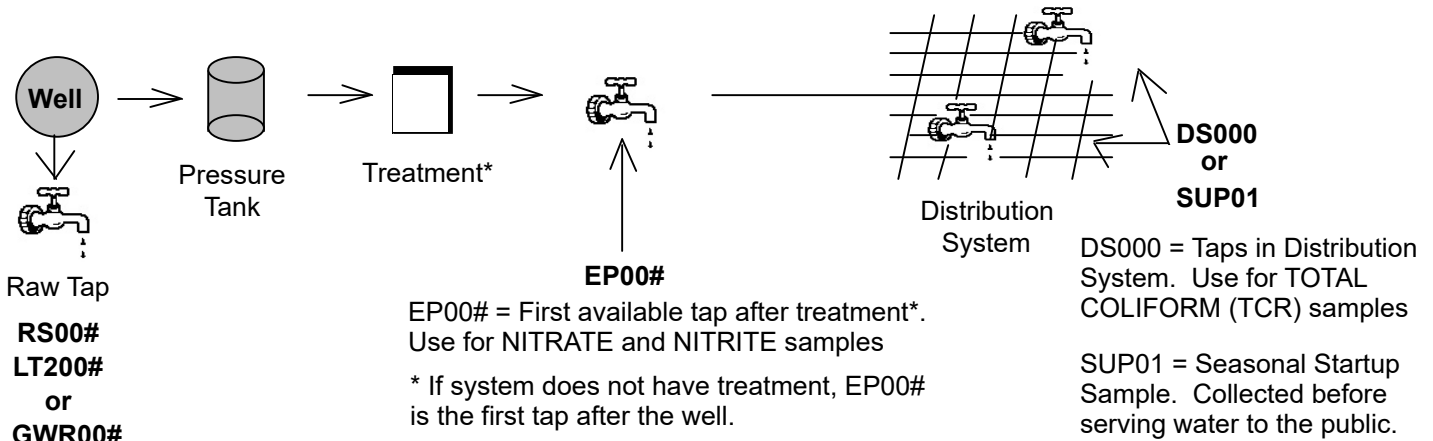

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1638212 RAVENS GLENN WINERY PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **RAVENS GLENN WINERY DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System

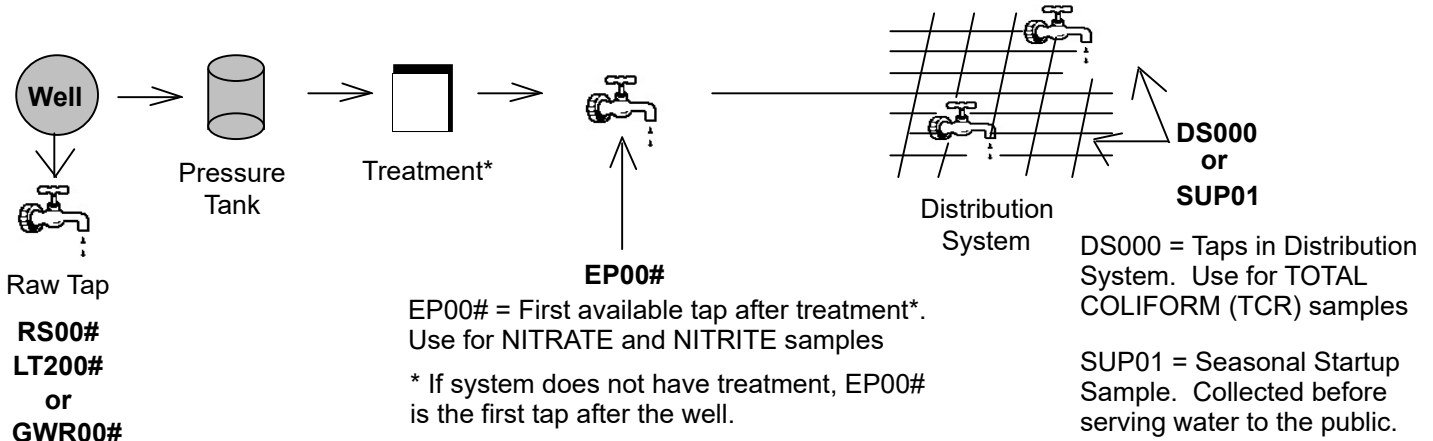

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1638212 RAVENS GLENN WINERY PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1661607 Facility Name: RAVENS GLENN WINERY
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1638312 PRAIRIE CHAPEL UNITED METHODIST CHURCH P

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **PRAIRIE CHAPEL UMC DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1638312 PRAIRIE CHAPEL UNITED METHODIST CHURCH P

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1661796	Facility Name: PRAIRIE CHAPEL UNITED METHODIST CHURCH
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 7/1/2017 and 9/30/2017

Where to Collect Samples For a Small Public Water System

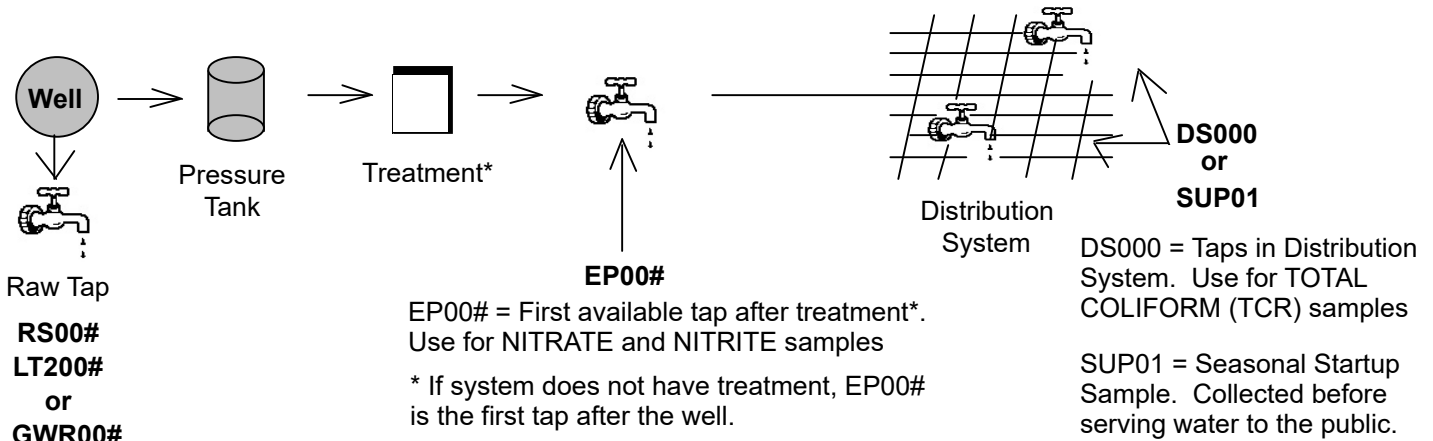

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH1638412 THREE RIVERS ENERGY LLC PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1662073	Facility Name: COSHOCTON ETHANOL LLC	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2017 and 10/31/2017

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 1/1/2017 and 5/31/2017

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 6/1/2017 and 10/31/2017

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2017 and 10/31/2017



OH1638412 THREE RIVERS ENERGY LLC PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: COSHOCTON ETHANOL LLC DISTRIBUTION
Location SMP ID: DS000

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2017 and 9/30/2017

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Form 5105 with appendix must be submitted to Ohio EPA within ten days from the end of the month(s) in which samples are collected. Forms are available online at: http://epa.ohio.gov/ddagw/reporting.aspx. For questions contact your Ohio EPA District Office representative.

TOTAL COLIFORM (TCR) - 3100 1 Sample(s) Required between 1/1/2017 and 3/31/2017
1 Sample(s) Required between 4/1/2017 and 6/30/2017
1 Sample(s) Required between 7/1/2017 and 9/30/2017
1 Sample(s) Required between 10/1/2017 and 12/31/2017

Sampling Facility ID: DS1 Facility Name: COSHOCTON ETHANOL LLC DISTRIBUTION
Location SMP ID: DS201 ADDRESS NOT KNOWN

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2017 and 9/30/2017at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950

OH1638512 CHILI CROSSROADS CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CHILI CROSSROADS CHURCH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1638512 CHILI CROSSROADS CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1662102 Facility Name: CHILI CROSSROADS CHURCH
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH1638612 SCHLABACH WOOD DESIGN PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1662186	Facility Name: SCHLABACH WOOD DESIGN	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2017 and 10/31/2017

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 1/1/2017 and 5/31/2017

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 1/1/2017 and 5/31/2017

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2017 and 10/31/2017



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

OH1638612 SCHLABACH WOOD DESIGN PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: SCHLABACH WOOD DESIGN DISTRIBUTION
	SMP ID: DS000	

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022

Not Required

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between	1/1/2017	and	3/31/2017
1 Sample(s) Required between	4/1/2017	and	6/30/2017
1 Sample(s) Required between	7/1/2017	and	9/30/2017
1 Sample(s) Required between	10/1/2017	and	12/31/2017

OH1638912 RAINBOW HILLS VINEYARDS PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: RAINBOW HILL VINEYARDS DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System

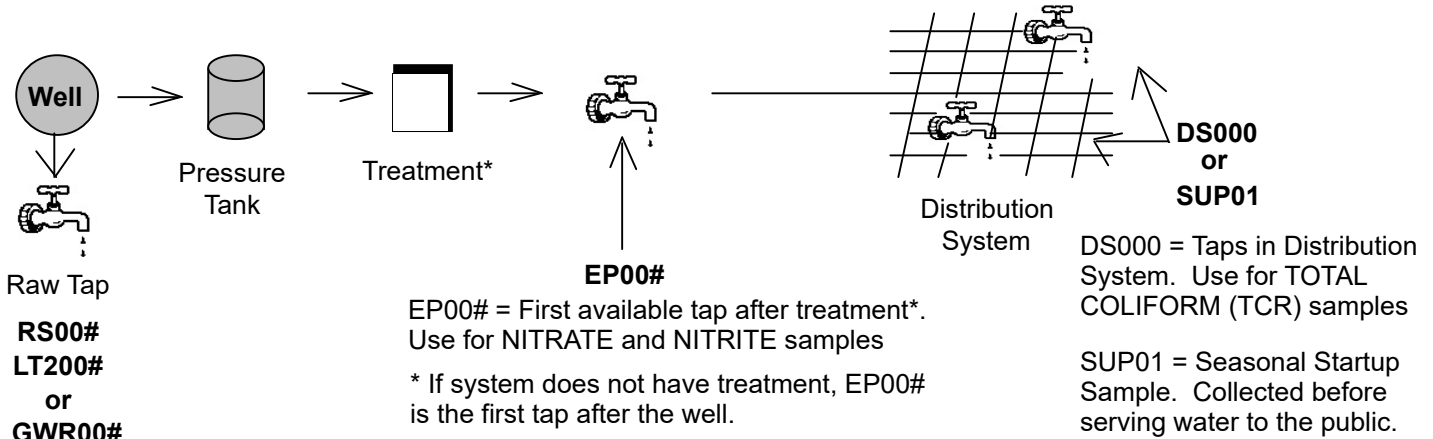

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1638912 RAINBOW HILLS VINEYARDS PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1662406 Facility Name: RAINBOW HILL VINEYARDS
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!