



OH3600312 GREENFIELD CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 3655021	Facility Name: GREENFIELD WATER DEPARTMENT
Location	SMP ID: EP001	Facility Source: Ground Water Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 7/1/2017 and 9/30/2017
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 2	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 3	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 4	1 Sample(s) Required between 4/1/2017 and 6/30/2017
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

OH3600312 GREENFIELD CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: GREENFIELD,CITY OF DISTRIBUTION	Facility Class: CLASS 1
-------------------	-----------------------------------	--	-------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 20 Sample(s) Required between 6/1/2017 and 9/30/2017

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Form 5105 with appendix must be submitted to Ohio EPA within ten days from the end of the month(s) in which samples are collected. Forms are available online at: http://epa.ohio.gov/ddagw/reporting.aspx. For questions contact your Ohio EPA District Office representative.

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100

6 Sample(s) Required between 1/1/2017 and 1/31/2017

6 Sample(s) Required between 2/1/2017 and 2/28/2017

6 Sample(s) Required between 3/1/2017 and 3/31/2017

6 Sample(s) Required between 4/1/2017 and 4/30/2017

6 Sample(s) Required between 5/1/2017 and 5/31/2017

6 Sample(s) Required between 6/1/2017 and 6/30/2017

6 Sample(s) Required between 7/1/2017 and 7/31/2017

6 Sample(s) Required between 8/1/2017 and 8/31/2017

6 Sample(s) Required between 9/1/2017 and 9/30/2017

6 Sample(s) Required between 10/1/2017 and 10/31/2017

6 Sample(s) Required between 11/1/2017 and 11/30/2017

6 Sample(s) Required between 12/1/2017 and 12/31/2017

TOTAL CHLORINE - 1000

6 Sample(s) Required between 1/1/2017 and 1/31/2017

6 Sample(s) Required between 2/1/2017 and 2/28/2017

6 Sample(s) Required between 3/1/2017 and 3/31/2017

6 Sample(s) Required between 4/1/2017 and 4/30/2017

6 Sample(s) Required between 5/1/2017 and 5/31/2017

6 Sample(s) Required between 6/1/2017 and 6/30/2017

6 Sample(s) Required between 7/1/2017 and 7/31/2017

6 Sample(s) Required between 8/1/2017 and 8/31/2017

6 Sample(s) Required between 9/1/2017 and 9/30/2017

6 Sample(s) Required between 10/1/2017 and 10/31/2017

6 Sample(s) Required between 11/1/2017 and 11/30/2017

6 Sample(s) Required between 12/1/2017 and 12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.



OH3600312 GREENFIELD CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: GREENFIELD,CITY OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: GREENFIELD,CITY OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2017

2017 ENTRY POINT SCHEDULE

OH3600514 HIGHLAND COUNTY WATER COMPANY, INC.

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 3655022	Facility Name: HIGHLAND COUNTY WATER CO INC
Location	SMP ID: EP001	Facility Source: Ground Water Facility Class: CLASS 2

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

OH3600514 HIGHLAND COUNTY WATER COMPANY, INC.

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **HIGHLAND COUNTY WATER CO DISTRIBUTION** Facility Class: **CLASS 2**
SMP ID: **DS000**

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100
30 Sample(s) Required between 1/1/2017 and 1/31/2017
30 Sample(s) Required between 2/1/2017 and 2/28/2017
30 Sample(s) Required between 3/1/2017 and 3/31/2017
30 Sample(s) Required between 4/1/2017 and 4/30/2017
30 Sample(s) Required between 5/1/2017 and 5/31/2017
30 Sample(s) Required between 6/1/2017 and 6/30/2017
30 Sample(s) Required between 7/1/2017 and 7/31/2017
30 Sample(s) Required between 8/1/2017 and 8/31/2017
30 Sample(s) Required between 9/1/2017 and 9/30/2017
30 Sample(s) Required between 10/1/2017 and 10/31/2017
30 Sample(s) Required between 11/1/2017 and 11/30/2017
30 Sample(s) Required between 12/1/2017 and 12/31/2017

TOTAL CHLORINE - 1000
30 Sample(s) Required between 1/1/2017 and 1/31/2017
30 Sample(s) Required between 2/1/2017 and 2/28/2017
30 Sample(s) Required between 3/1/2017 and 3/31/2017
30 Sample(s) Required between 4/1/2017 and 4/30/2017
30 Sample(s) Required between 5/1/2017 and 5/31/2017
30 Sample(s) Required between 6/1/2017 and 6/30/2017
30 Sample(s) Required between 7/1/2017 and 7/31/2017
30 Sample(s) Required between 8/1/2017 and 8/31/2017
30 Sample(s) Required between 9/1/2017 and 9/30/2017
30 Sample(s) Required between 10/1/2017 and 10/31/2017
30 Sample(s) Required between 11/1/2017 and 11/30/2017
30 Sample(s) Required between 12/1/2017 and 12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: **DS1** Facility Name: **HIGHLAND COUNTY WATER CO DISTRIBUTION** Facility Class: **CLASS 2**
SMP ID: **DS201** ADDRESS NOT KNOWN

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

OH3600514 HIGHLAND COUNTY WATER COMPANY, INC.

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: HIGHLAND COUNTY WATER CO DISTRIBUTION	Facility Class: CLASS 2
	SMP ID: DS202	ADDRESS NOT KNOWN	

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH3600614 HILLSBORO CITY

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3655023	Facility Name: HILLSBORO WTP	Facility Class: CLASS 3
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

Chemicals	Monitoring Requirements
------------------	--------------------------------

INORGANICS	1 Sample(s) Required between 1/1/2017 and 5/31/2017
------------	---

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020
 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 1/31/2017
	1 Sample(s) Required between 2/1/2017 and 2/28/2017
	1 Sample(s) Required between 3/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 4/30/2017
	1 Sample(s) Required between 5/1/2017 and 5/31/2017
	1 Sample(s) Required between 6/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 7/31/2017
	1 Sample(s) Required between 8/1/2017 and 8/31/2017
	1 Sample(s) Required between 9/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 10/31/2017
	1 Sample(s) Required between 11/1/2017 and 11/30/2017
	1 Sample(s) Required between 12/1/2017 and 12/31/2017

RADIOLOGICALS	Not Required
---------------	--------------

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2017 and 6/30/2017
---	---

VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2017 and 5/31/2017
----------------------------------	---

TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 1/1/2017 and 1/31/2017
	1 Paired Sample Set Required between 2/1/2017 and 2/28/2017
	1 Paired Sample Set Required between 3/1/2017 and 3/31/2017
	1 Paired Sample Set Required between 4/1/2017 and 4/30/2017
	1 Paired Sample Set Required between 5/1/2017 and 5/31/2017
	1 Paired Sample Set Required between 6/1/2017 and 6/30/2017
	1 Paired Sample Set Required between 7/1/2017 and 7/31/2017
	1 Paired Sample Set Required between 8/1/2017 and 8/31/2017
	1 Paired Sample Set Required between 9/1/2017 and 9/30/2017
	1 Paired Sample Set Required between 10/1/2017 and 10/31/2017
	1 Paired Sample Set Required between 11/1/2017 and 11/30/2017
	1 Paired Sample Set Required between 12/1/2017 and 12/31/2017

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



Effective Date: 01/01/2017

2017 ENTRY POINT SCHEDULE

OH3600614 HILLSBORO CITY

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3655023 SMP ID: EP001/LT2001	Facility Name: HILLSBORO WTP Facility Source: Surface Water	Facility Class: CLASS 3
--------------------------	--	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

Chemicals	Monitoring Requirements
------------------	--------------------------------

TOTAL MICROCYSTINS	1 Sample Set Required WEEKLY*
--------------------	-------------------------------

Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. A week is defined as Sunday through Saturday.

**Weekly sampling unless requirements for seasonal reduced monitoring are met (November through April). Biweekly raw seasonal reduced monitoring must be conducted at the same time as cyanobacteria screening sample. Any microcystins detection during seasonal reduced monitoring triggers collection of raw and finished samples within 24 hours and a return to weekly monitoring at both raw and finished sample points. For questions about seasonal reduced monitoring please contact your Ohio EPA District Office HAB Coordinator.*



OH3600614 HILLSBORO CITY

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3655023 SMP ID: LT2001	Facility Name: HILLSBORO WTP Facility Source: Surface Water	Facility Class: CLASS 3
--------------------------	--	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

Chemicals	Monitoring Requirements
------------------	--------------------------------

CYANOBACTERIA SCREENING	1 Sample(s) Required between 1/1/2017 and 1/7/2017
	1 Sample(s) Required between 1/15/2017 and 1/21/2017
	1 Sample(s) Required between 1/29/2017 and 2/4/2017
	1 Sample(s) Required between 2/12/2017 and 2/18/2017
	1 Sample(s) Required between 2/26/2017 and 3/4/2017
	1 Sample(s) Required between 3/12/2017 and 3/18/2017
	1 Sample(s) Required between 3/26/2017 and 4/1/2017
	1 Sample(s) Required between 4/9/2017 and 4/15/2017
	1 Sample(s) Required between 4/23/2017 and 4/29/2017
	1 Sample(s) Required between 5/7/2017 and 5/13/2017
	1 Sample(s) Required between 5/21/2017 and 5/27/2017
	1 Sample(s) Required between 6/4/2017 and 6/10/2017
	1 Sample(s) Required between 6/18/2017 and 6/24/2017
	1 Sample(s) Required between 7/2/2017 and 7/8/2017
	1 Sample(s) Required between 7/16/2017 and 7/22/2017
	1 Sample(s) Required between 7/30/2017 and 8/5/2017
	1 Sample(s) Required between 8/13/2017 and 8/19/2017
	1 Sample(s) Required between 8/27/2017 and 9/2/2017
	1 Sample(s) Required between 9/10/2017 and 9/16/2017
	1 Sample(s) Required between 9/24/2017 and 9/30/2017
1 Sample(s) Required between 10/8/2017 and 10/14/2017	
1 Sample(s) Required between 10/22/2017 and 10/28/2017	
1 Sample(s) Required between 11/5/2017 and 11/11/2017	
1 Sample(s) Required between 11/19/2017 and 11/25/2017	
1 Sample(s) Required between 12/3/2017 and 12/9/2017	
1 Sample(s) Required between 12/17/2017 and 12/23/2017	

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 and must be collected at the same time as the raw total microcystins sample. SAMPLES MUST BE SHIPPED OVERNIGHT ON ICE ON THE DAY OF COLLECTION AND ARRIVE AT OHIO EPA DIVISION OF ENVIRONMENTAL SERVICES (DES) BY NOON MONDAY THROUGH THURSDAY ONLY! If lab capacity is found to be adequate, cyanobacteria screening samples will no longer be analyzed, free of charge, by Ohio EPA DES beginning June 1, 2017.



OH3600614 HILLSBORO CITY

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: HILLSBORO, CITY OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

TOTAL COLIFORM (TCR) - 3100	8 Sample(s) Required between	1/1/2017	and	1/31/2017
	8 Sample(s) Required between	2/1/2017	and	2/28/2017
	8 Sample(s) Required between	3/1/2017	and	3/31/2017
	8 Sample(s) Required between	4/1/2017	and	4/30/2017
	8 Sample(s) Required between	5/1/2017	and	5/31/2017
	8 Sample(s) Required between	6/1/2017	and	6/30/2017
	8 Sample(s) Required between	7/1/2017	and	7/31/2017
	8 Sample(s) Required between	8/1/2017	and	8/31/2017
	8 Sample(s) Required between	9/1/2017	and	9/30/2017
	8 Sample(s) Required between	10/1/2017	and	10/31/2017
	8 Sample(s) Required between	11/1/2017	and	11/30/2017
	8 Sample(s) Required between	12/1/2017	and	12/31/2017

TOTAL CHLORINE - 1000	8 Sample(s) Required between	1/1/2017	and	1/31/2017
	8 Sample(s) Required between	2/1/2017	and	2/28/2017
	8 Sample(s) Required between	3/1/2017	and	3/31/2017
	8 Sample(s) Required between	4/1/2017	and	4/30/2017
	8 Sample(s) Required between	5/1/2017	and	5/31/2017
	8 Sample(s) Required between	6/1/2017	and	6/30/2017
	8 Sample(s) Required between	7/1/2017	and	7/31/2017
	8 Sample(s) Required between	8/1/2017	and	8/31/2017
	8 Sample(s) Required between	9/1/2017	and	9/30/2017
	8 Sample(s) Required between	10/1/2017	and	10/31/2017
	8 Sample(s) Required between	11/1/2017	and	11/30/2017
	8 Sample(s) Required between	12/1/2017	and	12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: HILLSBORO, CITY OF DISTRIBUTION 959 WEST MAIN STREET	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS	Dual Sample Required between	1/1/2017	and	1/7/2017 at: DS201
	Dual Sample Required between	4/1/2017	and	4/7/2017 at: DS201
	Dual Sample Required between	7/1/2017	and	7/7/2017 at: DS201
	Dual Sample Required between	10/1/2017	and	10/7/2017 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

OH3600614 HILLSBORO CITY

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: HILLSBORO, CITY OF DISTRIBUTION 298 WOODLANDER	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 1/1/2017 and 1/7/2017 at: DS202
	Dual Sample Required between 4/1/2017 and 4/7/2017 at: DS202
	Dual Sample Required between 7/1/2017 and 7/7/2017 at: DS202
	Dual Sample Required between 10/1/2017 and 10/7/2017 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH3600712 LEESBURG VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 3655024	Facility Name: LEESBURG WTP	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.
 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
 Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

Chemicals	Monitoring Requirements
ARSENIC - 1005	1 Sample(s) Required between 1/1/2017 and 3/31/2017 1 Sample(s) Required between 4/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 9/30/2017 1 Sample(s) Required between 10/1/2017 and 12/31/2017
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH3600712 LEESBURG VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: LEESBURG,VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2017 and 9/30/2017

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Form 5105 with appendix must be submitted to Ohio EPA within ten days from the end of the month(s) in which samples are collected. Forms are available online at: http://epa.ohio.gov/ddagw/reporting.aspx. For questions contact your Ohio EPA District Office representative.

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100

2 Sample(s) Required between 1/1/2017 and 1/31/2017

2 Sample(s) Required between 2/1/2017 and 2/28/2017

2 Sample(s) Required between 3/1/2017 and 3/31/2017

2 Sample(s) Required between 4/1/2017 and 4/30/2017

2 Sample(s) Required between 5/1/2017 and 5/31/2017

2 Sample(s) Required between 6/1/2017 and 6/30/2017

2 Sample(s) Required between 7/1/2017 and 7/31/2017

2 Sample(s) Required between 8/1/2017 and 8/31/2017

2 Sample(s) Required between 9/1/2017 and 9/30/2017

2 Sample(s) Required between 10/1/2017 and 10/31/2017

2 Sample(s) Required between 11/1/2017 and 11/30/2017

2 Sample(s) Required between 12/1/2017 and 12/31/2017

TOTAL CHLORINE - 1000

2 Sample(s) Required between 1/1/2017 and 1/31/2017

2 Sample(s) Required between 2/1/2017 and 2/28/2017

2 Sample(s) Required between 3/1/2017 and 3/31/2017

2 Sample(s) Required between 4/1/2017 and 4/30/2017

2 Sample(s) Required between 5/1/2017 and 5/31/2017

2 Sample(s) Required between 6/1/2017 and 6/30/2017

2 Sample(s) Required between 7/1/2017 and 7/31/2017

2 Sample(s) Required between 8/1/2017 and 8/31/2017

2 Sample(s) Required between 9/1/2017 and 9/30/2017

2 Sample(s) Required between 10/1/2017 and 10/31/2017

2 Sample(s) Required between 11/1/2017 and 11/30/2017

2 Sample(s) Required between 12/1/2017 and 12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

OH3600712 LEESBURG VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: LEESBURG,VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: LEESBURG,VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2017

2017 ENTRY POINT SCHEDULE

OH3600915 LYNCHBURG VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 3655025	Facility Name: LYNCHBURG WATER DEPARTMENT
Location	SMP ID: EP001	Facility Source: Ground Water Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

OH3600915 LYNCHBURG VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: LYNCHBURG,VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required
ASBESTOS - 1094	Not Required
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2017 and 1/31/2017 2 Sample(s) Required between 2/1/2017 and 2/28/2017 2 Sample(s) Required between 3/1/2017 and 3/31/2017 2 Sample(s) Required between 4/1/2017 and 4/30/2017 2 Sample(s) Required between 5/1/2017 and 5/31/2017 2 Sample(s) Required between 6/1/2017 and 6/30/2017 2 Sample(s) Required between 7/1/2017 and 7/31/2017 2 Sample(s) Required between 8/1/2017 and 8/31/2017 2 Sample(s) Required between 9/1/2017 and 9/30/2017 2 Sample(s) Required between 10/1/2017 and 10/31/2017 2 Sample(s) Required between 11/1/2017 and 11/30/2017 2 Sample(s) Required between 12/1/2017 and 12/31/2017
TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2017 and 1/31/2017 2 Sample(s) Required between 2/1/2017 and 2/28/2017 2 Sample(s) Required between 3/1/2017 and 3/31/2017 2 Sample(s) Required between 4/1/2017 and 4/30/2017 2 Sample(s) Required between 5/1/2017 and 5/31/2017 2 Sample(s) Required between 6/1/2017 and 6/30/2017 2 Sample(s) Required between 7/1/2017 and 7/31/2017 2 Sample(s) Required between 8/1/2017 and 8/31/2017 2 Sample(s) Required between 9/1/2017 and 9/30/2017 2 Sample(s) Required between 10/1/2017 and 10/31/2017 2 Sample(s) Required between 11/1/2017 and 11/30/2017 2 Sample(s) Required between 12/1/2017 and 12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: LYNCHBURG,VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

OH3600915 LYNCHBURG VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: LYNCHBURG,VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH3632312 NORTH BAY COTTAGES AND BAIT SHOP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: NORTH BAY COTTAGES & BAI DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System

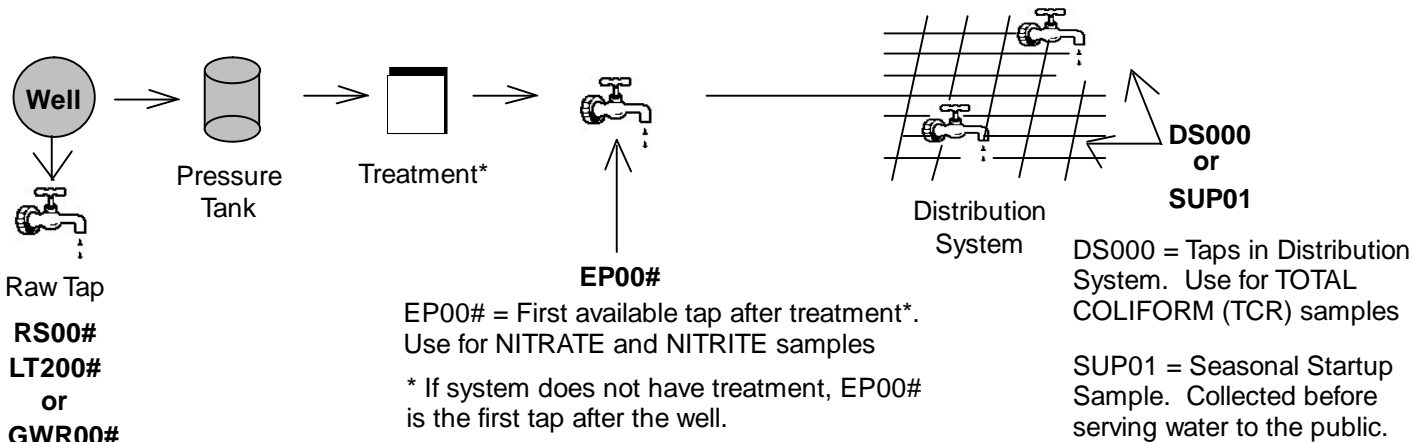

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3632312 NORTH BAY COTTAGES AND BAIT SHOP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3655034 Facility Name: NORTH BAY COTTAGES & BAIT SHOP

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System

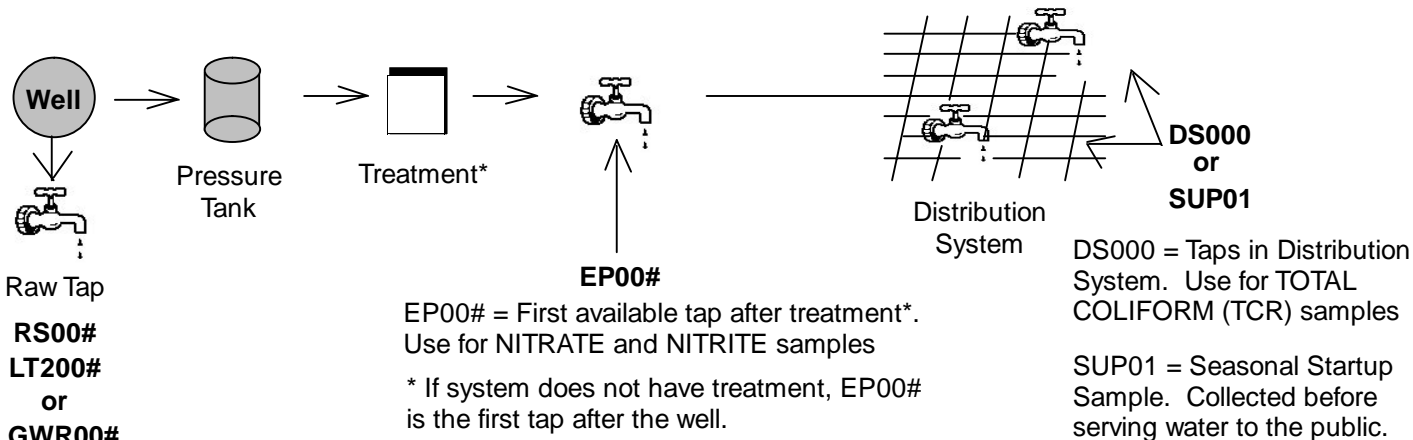

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3634412 COUNTRY CORNER MARKET PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: COUNTRY CORNER MARKET DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System

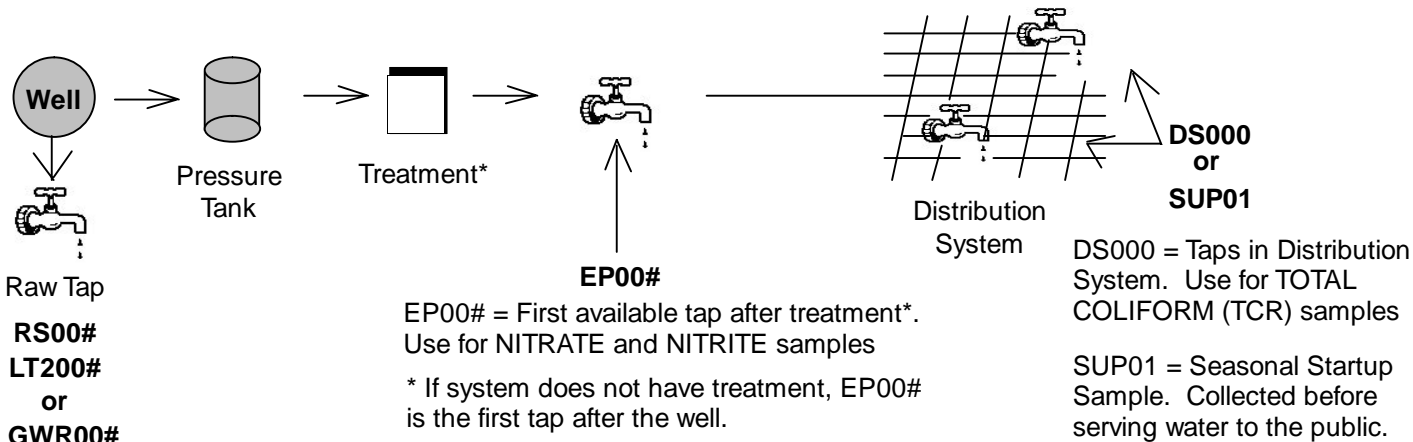

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3634412 COUNTRY CORNER MARKET PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3660933** Facility Name: **COUNTRY CORNER MARKET**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System

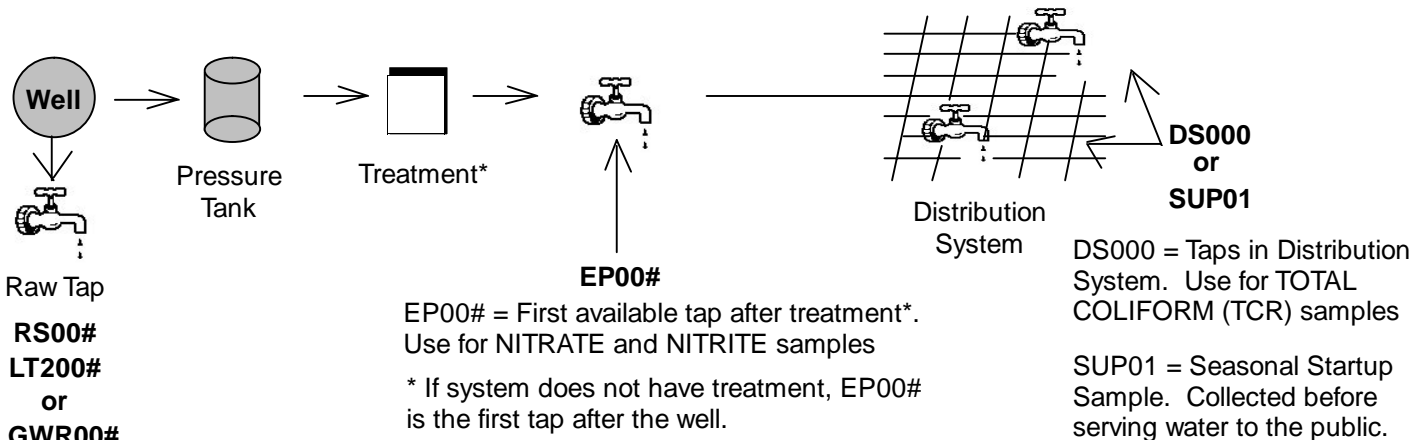

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3636812 GOOD SHEPHERD U B CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: GOOD SHEPHERD U B CHURCH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System

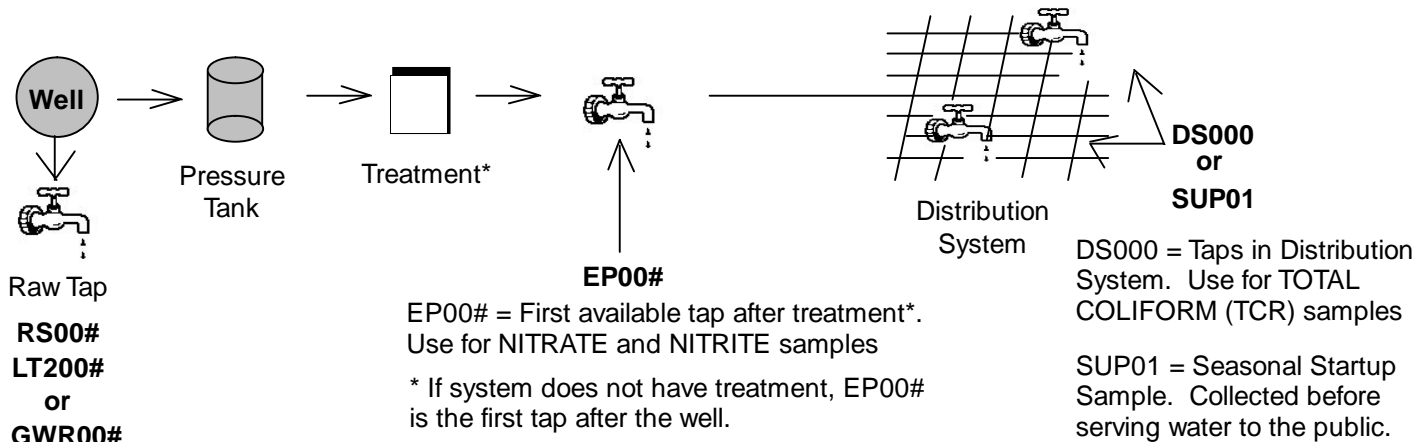

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3636812 GOOD SHEPHERD U B CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3655042** Facility Name: **UNITED BRETHREN CHURCH**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System

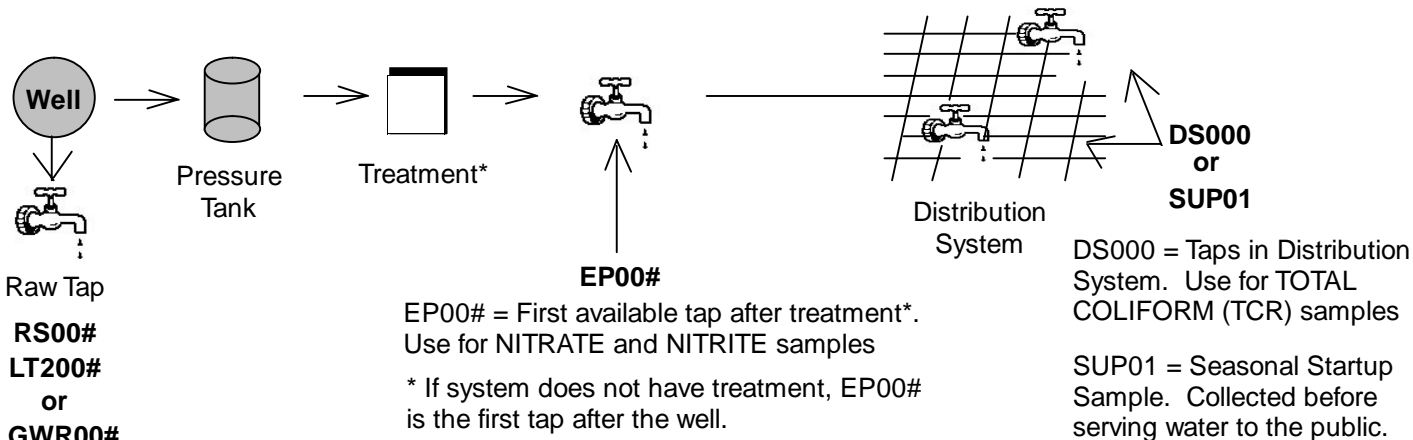

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3636912 FAITH AND LIGHT MENNONITE CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: FAITH AND LIGHT MENNONITE DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System

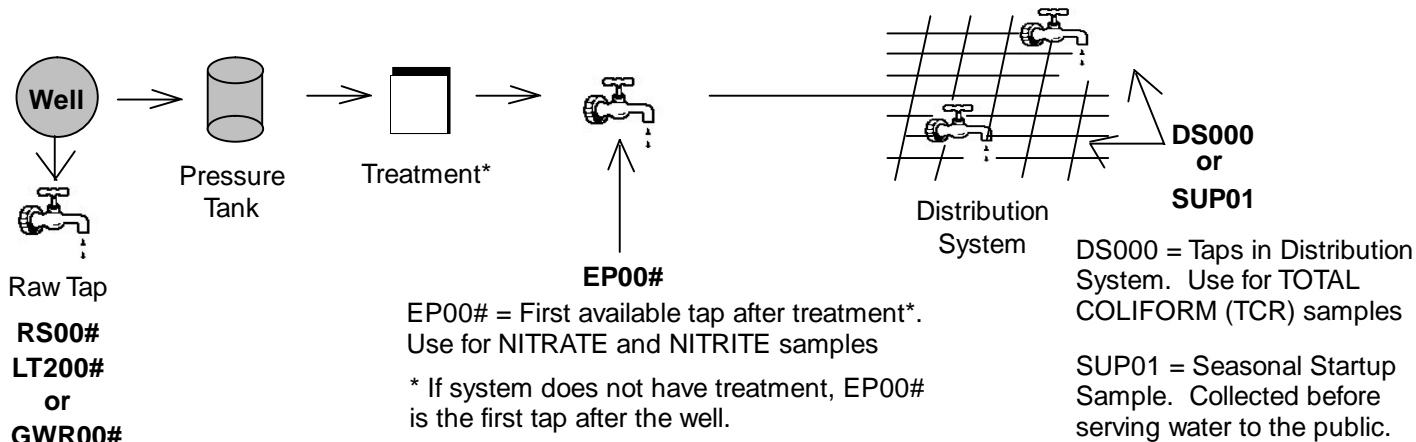

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3636912 FAITH AND LIGHT MENNONITE CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3655043	Facility Name: FAITH AND LIGHT MENNONITE CHURCH
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System

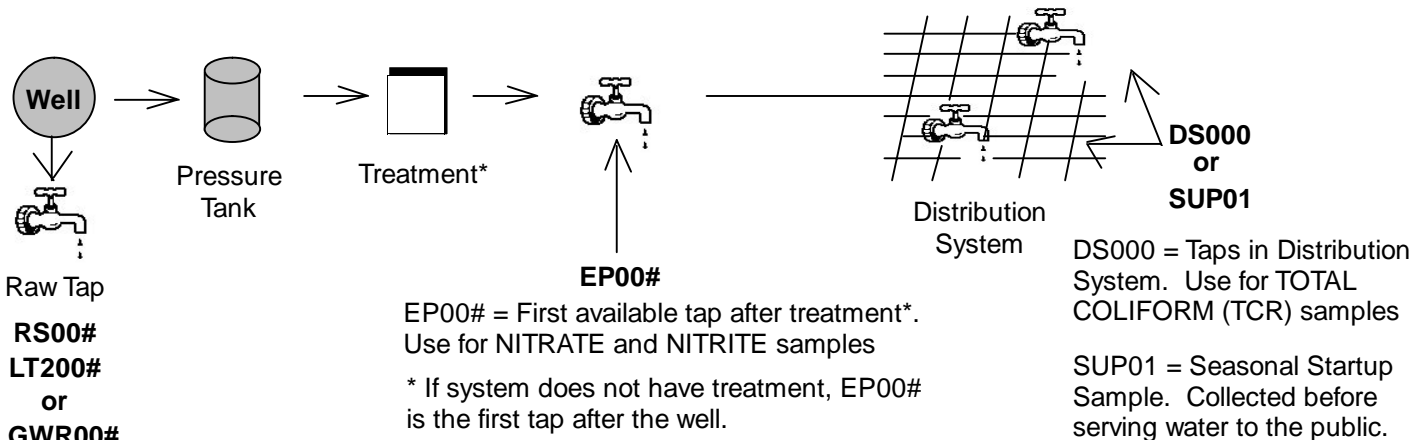

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3637012 CEDAR HILL CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CEDAR HILL CAMPGROUND DISTRIBUTION
Location SMP ID: SUP01	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

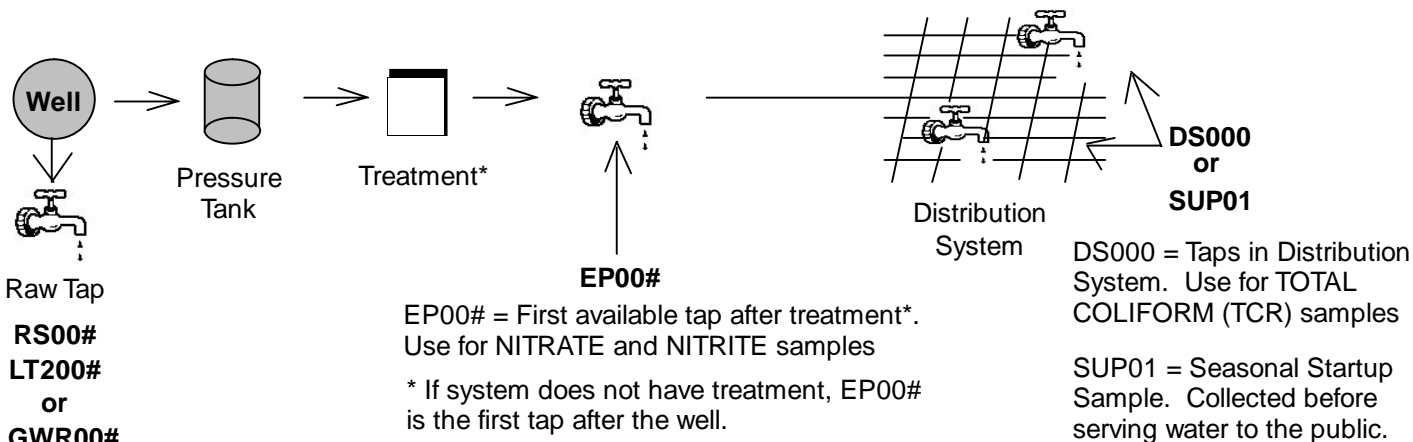

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3637012 CEDAR HILL CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CEDAR HILL CAMPGROUND DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/1/2017 and 5/31/2017
	1 Sample(s) Required between 6/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 7/31/2017
	1 Sample(s) Required between 8/1/2017 and 8/31/2017
	1 Sample(s) Required between 9/1/2017 and 9/30/2017

Where to Collect Samples For a Small Public Water System

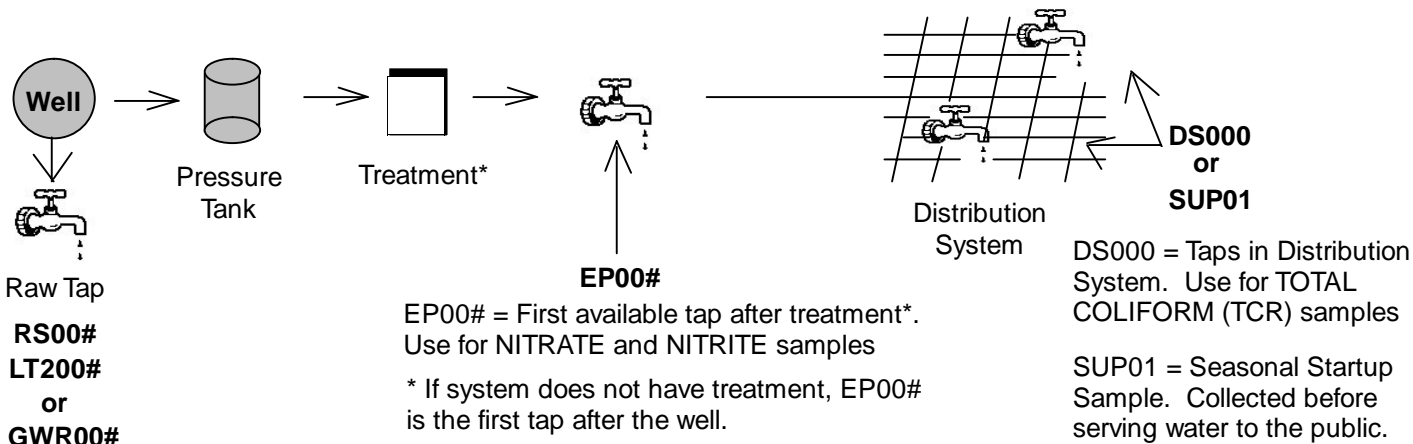

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3637012 CEDAR HILL CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3655044** Facility Name: **CEDAR HILL CAMPGROUND**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System

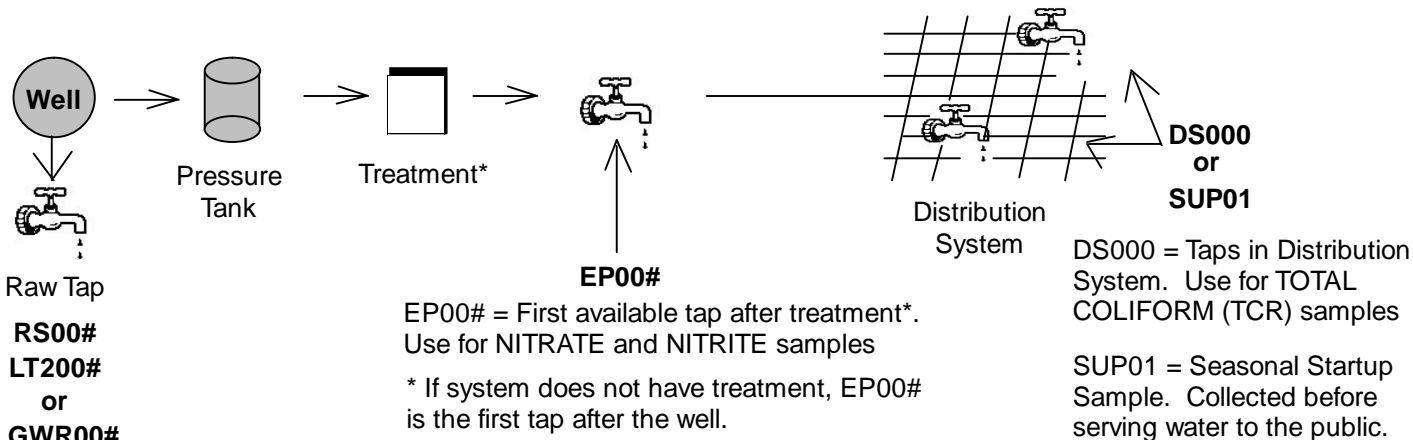

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!