



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH5500012 COUNTRY MEADOWS CONDO.

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5556482	Facility Name: COUNTRY MEADOWS CONDO ASSOC	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020	
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2018 and 10/31/2018

OH5500012 COUNTRY MEADOWS CONDO.

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: COUNTRY MEADOWS CONDO. DISTRIBUTION
	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: COUNTRY MEADOWS CONDO. DISTRIBUTION
	SMP ID: DS201	8467 BENNETT DRIVE

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 05/25/2018

2018 DISTRIBUTION SCHEDULE

OH5500012 COUNTRY MEADOWS CONDO.

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: COUNTRY MEADOWS CONDO. DISTRIBUTION
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH5500112 COVINGTON VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5556483	Facility Name: COVINGTON VILLAGE	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020	
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2018 and 10/31/2018



OH5500112 COVINGTON VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: COVINGTON, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	3 Sample(s) Required between	1/1/2018 and 1/31/2018
	3 Sample(s) Required between	2/1/2018 and 2/28/2018
	3 Sample(s) Required between	3/1/2018 and 3/31/2018
	3 Sample(s) Required between	4/1/2018 and 4/30/2018
	3 Sample(s) Required between	5/1/2018 and 5/31/2018
	3 Sample(s) Required between	6/1/2018 and 6/30/2018
	3 Sample(s) Required between	7/1/2018 and 7/31/2018
	3 Sample(s) Required between	8/1/2018 and 8/31/2018
	3 Sample(s) Required between	9/1/2018 and 9/30/2018
	3 Sample(s) Required between	10/1/2018 and 10/31/2018
	3 Sample(s) Required between	11/1/2018 and 11/30/2018
	3 Sample(s) Required between	12/1/2018 and 12/31/2018

TOTAL CHLORINE - 1000	3 Sample(s) Required between	1/1/2018 and 1/31/2018
	3 Sample(s) Required between	2/1/2018 and 2/28/2018
	3 Sample(s) Required between	3/1/2018 and 3/31/2018
	3 Sample(s) Required between	4/1/2018 and 4/30/2018
	3 Sample(s) Required between	5/1/2018 and 5/31/2018
	3 Sample(s) Required between	6/1/2018 and 6/30/2018
	3 Sample(s) Required between	7/1/2018 and 7/31/2018
	3 Sample(s) Required between	8/1/2018 and 8/31/2018
	3 Sample(s) Required between	9/1/2018 and 9/30/2018
	3 Sample(s) Required between	10/1/2018 and 10/31/2018
	3 Sample(s) Required between	11/1/2018 and 11/30/2018
	3 Sample(s) Required between	12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: COVINGTON, VILLAGE OF DISTRIBUTION 938 EAST WALNUT STREET	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS	Dual Sample Required between	7/1/2018 and 9/30/2018 at: DS201
-------------------------	------------------------------	----------------------------------

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH5500112 COVINGTON VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: COVINGTON, VILLAGE OF DISTRIBUTION 2000 INDUSTRIAL DRIVE	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: COVINGTON, VILLAGE OF DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH5500312 A AND R RECK MOBILE HOME PARK

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5556485	Facility Name: A AND R RECK MHP	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 3	1 Sample(s) Required between 4/1/2018 and 6/30/2018
<i>Sample for all the analytes listed below:</i>	
BHC-GAMMA (LINDANE) - 2010 DIQUAT - 2032 GLYPHOSATE - 2034 METHOXYCHLOR - 2015 POLYCHLORINATED BIPHENYLS (PCB) - 2383	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 10/1/2018 and 12/31/2018



OH5500312 A AND R RECK MOBILE HOME PARK

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **A AND R RECK MHP DISTRIBUTION**
SMP ID: **DS000**

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2018 and 1/31/2018
	1 Sample(s) Required between	2/1/2018 and 2/28/2018
	1 Sample(s) Required between	3/1/2018 and 3/31/2018
	1 Sample(s) Required between	4/1/2018 and 4/30/2018
	1 Sample(s) Required between	5/1/2018 and 5/31/2018
	1 Sample(s) Required between	6/1/2018 and 6/30/2018
	1 Sample(s) Required between	7/1/2018 and 7/31/2018
	1 Sample(s) Required between	8/1/2018 and 8/31/2018
	1 Sample(s) Required between	9/1/2018 and 9/30/2018
	1 Sample(s) Required between	10/1/2018 and 10/31/2018
	1 Sample(s) Required between	11/1/2018 and 11/30/2018
	1 Sample(s) Required between	12/1/2018 and 12/31/2018

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2018 and 1/31/2018
	1 Sample(s) Required between	2/1/2018 and 2/28/2018
	1 Sample(s) Required between	3/1/2018 and 3/31/2018
	1 Sample(s) Required between	4/1/2018 and 4/30/2018
	1 Sample(s) Required between	5/1/2018 and 5/31/2018
	1 Sample(s) Required between	6/1/2018 and 6/30/2018
	1 Sample(s) Required between	7/1/2018 and 7/31/2018
	1 Sample(s) Required between	8/1/2018 and 8/31/2018
	1 Sample(s) Required between	9/1/2018 and 9/30/2018
	1 Sample(s) Required between	10/1/2018 and 10/31/2018
	1 Sample(s) Required between	11/1/2018 and 11/30/2018
	1 Sample(s) Required between	12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: **DS1** Facility Name: **A AND R RECK MHP DISTRIBUTION**
SMP ID: **DS201** ADDRESS NOT KNOWN

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS	Dual Sample Required between	7/1/2018 and 9/30/2018 at: DS201
-------------------------	------------------------------	----------------------------------

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2018

2018 DISTRIBUTION SCHEDULE

OH5500312 A AND R RECK MOBILE HOME PARK

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: A AND R RECK MHP DISTRIBUTION
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH5500412 FLETCHER VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5556486 SMP ID: EP001	Facility Name: FLETCHER PWS Facility Source: Ground Water	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2018 and 10/31/2018



OH5500412 FLETCHER VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: FLETCHER,VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2018 and 1/31/2018
	1 Sample(s) Required between	2/1/2018 and 2/28/2018
	1 Sample(s) Required between	3/1/2018 and 3/31/2018
	1 Sample(s) Required between	4/1/2018 and 4/30/2018
	1 Sample(s) Required between	5/1/2018 and 5/31/2018
	1 Sample(s) Required between	6/1/2018 and 6/30/2018
	1 Sample(s) Required between	7/1/2018 and 7/31/2018
	1 Sample(s) Required between	8/1/2018 and 8/31/2018
	1 Sample(s) Required between	9/1/2018 and 9/30/2018
	1 Sample(s) Required between	10/1/2018 and 10/31/2018
	1 Sample(s) Required between	11/1/2018 and 11/30/2018
	1 Sample(s) Required between	12/1/2018 and 12/31/2018

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2018 and 1/31/2018
	1 Sample(s) Required between	2/1/2018 and 2/28/2018
	1 Sample(s) Required between	3/1/2018 and 3/31/2018
	1 Sample(s) Required between	4/1/2018 and 4/30/2018
	1 Sample(s) Required between	5/1/2018 and 5/31/2018
	1 Sample(s) Required between	6/1/2018 and 6/30/2018
	1 Sample(s) Required between	7/1/2018 and 7/31/2018
	1 Sample(s) Required between	8/1/2018 and 8/31/2018
	1 Sample(s) Required between	9/1/2018 and 9/30/2018
	1 Sample(s) Required between	10/1/2018 and 10/31/2018
	1 Sample(s) Required between	11/1/2018 and 11/30/2018
	1 Sample(s) Required between	12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: FLETCHER,VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS	Dual Sample Required between	7/1/2018 and 9/30/2018 at: DS201
-------------------------	------------------------------	----------------------------------

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH5500412 FLETCHER VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: FLETCHER,VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: FLETCHER,VILLAGE OF DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH5500612 LAURA VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5556488	Facility Name: LAURA WATER DEPARTMENT	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

Chemicals	Monitoring Requirements	
INORGANICS	1 Sample(s) Required between	6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020		
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085		
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between	6/1/2018 and 10/31/2018
RADIOLOGICALS	1 Sample(s) Required between	6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>		
GROSS ALPHA - 4002 RADIUM-228 - 4030		
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	6/1/2018 and 10/31/2018



OH5500612 LAURA VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: LAURA, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2018 and 1/31/2018
	1 Sample(s) Required between	2/1/2018 and 2/28/2018
	1 Sample(s) Required between	3/1/2018 and 3/31/2018
	1 Sample(s) Required between	4/1/2018 and 4/30/2018
	1 Sample(s) Required between	5/1/2018 and 5/31/2018
	1 Sample(s) Required between	6/1/2018 and 6/30/2018
	1 Sample(s) Required between	7/1/2018 and 7/31/2018
	1 Sample(s) Required between	8/1/2018 and 8/31/2018
	1 Sample(s) Required between	9/1/2018 and 9/30/2018
	1 Sample(s) Required between	10/1/2018 and 10/31/2018
	1 Sample(s) Required between	11/1/2018 and 11/30/2018
	1 Sample(s) Required between	12/1/2018 and 12/31/2018

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2018 and 1/31/2018
	1 Sample(s) Required between	2/1/2018 and 2/28/2018
	1 Sample(s) Required between	3/1/2018 and 3/31/2018
	1 Sample(s) Required between	4/1/2018 and 4/30/2018
	1 Sample(s) Required between	5/1/2018 and 5/31/2018
	1 Sample(s) Required between	6/1/2018 and 6/30/2018
	1 Sample(s) Required between	7/1/2018 and 7/31/2018
	1 Sample(s) Required between	8/1/2018 and 8/31/2018
	1 Sample(s) Required between	9/1/2018 and 9/30/2018
	1 Sample(s) Required between	10/1/2018 and 10/31/2018
	1 Sample(s) Required between	11/1/2018 and 11/30/2018
	1 Sample(s) Required between	12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: LAURA, VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 07/13/2018

2018 DISTRIBUTION SCHEDULE

OH5500612 LAURA VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: LAURA, VILLAGE OF DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 7/1/2018 and 12/31/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH5501211 PIQUA CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5562258	Facility Name: PIQUA WTP - NEW	Facility Class: CLASS 4
	SMP ID: EP002	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
-----------	-------------------------

INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
------------	--

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020
 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

RADIOLOGICALS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
---------------	--

Sample for all the analytes listed below:

GROSS ALPHA - 4002 RADIUM-228 - 4030

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2018 and 10/31/2018
----------------------------------	--



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH5501211 PIQUA CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 5562258	Facility Name: PIQUA WTP - NEW	
Location	SMP ID: EP002/LT2002	Facility Source: Surface Water	Facility Class: CLASS 4

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

Chemicals

Monitoring Requirements

TOTAL MICROCYSTINS

1 Sample Set Required WEEKLY*

Total microcystins sample set refers to one raw source water sample at LT2002 and one finished water sample at EP002. A week is defined as Sunday through Saturday.

**Weekly sampling unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. Reduced monitoring is contingent on a public water system continuing to experience NO raw or finished water total microcystins detections. Any total microcystins detections during routine (weekly) or reduced sampling will trigger additional sampling. Please refer to the website above for specifics on follow-up sampling requirements.*



OH5501211 PIQUA CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 5562258	Facility Name: PIQUA WTP - NEW	
Location	SMP ID: LT2002	Facility Source: Surface Water	Facility Class: CLASS 4

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
CYANOBACTERIA SCREENING	1 Sample(s) Required between 12/31/2017 and 1/6/2018
	1 Sample(s) Required between 1/14/2018 and 1/20/2018
	1 Sample(s) Required between 1/28/2018 and 2/3/2018
	1 Sample(s) Required between 2/11/2018 and 2/17/2018
	1 Sample(s) Required between 2/25/2018 and 3/3/2018
	1 Sample(s) Required between 3/11/2018 and 3/17/2018
	1 Sample(s) Required between 3/25/2018 and 3/31/2018
	1 Sample(s) Required between 4/8/2018 and 4/14/2018
	1 Sample(s) Required between 4/22/2018 and 4/28/2018
	1 Sample(s) Required between 5/6/2018 and 5/12/2018
	1 Sample(s) Required between 5/20/2018 and 5/26/2018
	1 Sample(s) Required between 6/3/2018 and 6/9/2018
	1 Sample(s) Required between 6/17/2018 and 6/23/2018
	1 Sample(s) Required between 7/1/2018 and 7/7/2018
	1 Sample(s) Required between 7/15/2018 and 7/21/2018
	1 Sample(s) Required between 7/29/2018 and 8/4/2018
	1 Sample(s) Required between 8/12/2018 and 8/18/2018
	1 Sample(s) Required between 8/26/2018 and 9/1/2018
	1 Sample(s) Required between 9/9/2018 and 9/15/2018
	1 Sample(s) Required between 9/23/2018 and 9/29/2018
1 Sample(s) Required between 10/7/2018 and 10/13/2018	
1 Sample(s) Required between 10/21/2018 and 10/27/2018	
1 Sample(s) Required between 11/4/2018 and 11/10/2018	
1 Sample(s) Required between 11/18/2018 and 11/24/2018	
1 Sample(s) Required between 12/2/2018 and 12/8/2018	
1 Sample(s) Required between 12/16/2018 and 12/22/2018	

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. As of 12/31/17, all public water systems are responsible for contracting with a lab certified to perform cyanobacteria screening (qPCR). Please review the website for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections, and certified labs that can perform analysis.

OH5501211 PIQUA CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: PIQUA, CITY OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements		
TOTAL COLIFORM (TCR) - 3100	20 Sample(s) Required between	1/1/2018	and 1/31/2018
	20 Sample(s) Required between	2/1/2018	and 2/28/2018
	20 Sample(s) Required between	3/1/2018	and 3/31/2018
	20 Sample(s) Required between	4/1/2018	and 4/30/2018
	20 Sample(s) Required between	5/1/2018	and 5/31/2018
	20 Sample(s) Required between	6/1/2018	and 6/30/2018
	20 Sample(s) Required between	7/1/2018	and 7/31/2018
	20 Sample(s) Required between	8/1/2018	and 8/31/2018
	20 Sample(s) Required between	9/1/2018	and 9/30/2018
	20 Sample(s) Required between	10/1/2018	and 10/31/2018
	20 Sample(s) Required between	11/1/2018	and 11/30/2018
	20 Sample(s) Required between	12/1/2018	and 12/31/2018
	TOTAL CHLORINE - 1000	20 Sample(s) Required between	1/1/2018
20 Sample(s) Required between		2/1/2018	and 2/28/2018
20 Sample(s) Required between		3/1/2018	and 3/31/2018
20 Sample(s) Required between		4/1/2018	and 4/30/2018
20 Sample(s) Required between		5/1/2018	and 5/31/2018
20 Sample(s) Required between		6/1/2018	and 6/30/2018
20 Sample(s) Required between		7/1/2018	and 7/31/2018
20 Sample(s) Required between		8/1/2018	and 8/31/2018
20 Sample(s) Required between		9/1/2018	and 9/30/2018
20 Sample(s) Required between		10/1/2018	and 10/31/2018
20 Sample(s) Required between		11/1/2018	and 11/30/2018
20 Sample(s) Required between		12/1/2018	and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: PIQUA, CITY OF DISTRIBUTION 839 SOUTH MAIN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements		
DISINFECTION BYPRODUCTS	Dual Sample Required between	3/8/2018	and 3/14/2018 at: DS201
	Dual Sample Required between	6/8/2018	and 6/14/2018 at: DS201
	Dual Sample Required between	9/8/2018	and 9/14/2018 at: DS201
	Dual Sample Required between	12/8/2018	and 12/14/2018 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH5501211 PIQUA CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: PIQUA, CITY OF DISTRIBUTION 200 N. SUNSET	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 3/8/2018 and 3/14/2018 at: DS202
	Dual Sample Required between 6/8/2018 and 6/14/2018 at: DS202
	Dual Sample Required between 9/8/2018 and 9/14/2018 at: DS202
	Dual Sample Required between 12/8/2018 and 12/14/2018 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS203	Facility Name: PIQUA, CITY OF DISTRIBUTION 8605 HETZLER	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 3/8/2018 and 3/14/2018 at: DS203
	Dual Sample Required between 6/8/2018 and 6/14/2018 at: DS203
	Dual Sample Required between 9/8/2018 and 9/14/2018 at: DS203
	Dual Sample Required between 12/8/2018 and 12/14/2018 at: DS203

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS204	Facility Name: PIQUA, CITY OF DISTRIBUTION 1500 S. MAIN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 3/8/2018 and 3/14/2018 at: DS204
	Dual Sample Required between 6/8/2018 and 6/14/2018 at: DS204
	Dual Sample Required between 9/8/2018 and 9/14/2018 at: DS204
	Dual Sample Required between 12/8/2018 and 12/14/2018 at: DS204

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: PIQUA, CITY OF DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	60 Sample(s) Required between 1/1/2018 and 6/30/2018



Effective Date: 01/01/2018

2018 DISTRIBUTION SCHEDULE

OH5501211 PIQUA CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: PIQUA, CITY OF DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	60 Sample(s) Required between 7/1/2018 and 12/31/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH5501312 PLEASANT HILL VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5556492 SMP ID: EP001	Facility Name: PLEASANT HILL VLG Facility Source: Ground Water	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
INORGANICS <i>Sample for all the analytes listed below:</i> ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	1 Sample(s) Required between 6/1/2018 and 10/31/2018
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 10/1/2018 and 12/31/2018
RADIOLOGICALS <i>Sample for all the analytes listed below:</i> GROSS ALPHA - 4002 RADIUM-228 - 4030	1 Sample(s) Required between 6/1/2018 and 10/31/2018
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 2	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 3 <i>Sample for all the analytes listed below:</i> BHC-GAMMA (LINDANE) - 2010 DIQUAT - 2032 GLYPHOSATE - 2034 METHOXYCHLOR - 2015 POLYCHLORINATED BIPHENYLS (PCB) - 2383	1 Sample(s) Required between 4/1/2018 and 6/30/2018
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 4	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2018 and 10/31/2018



OH5501312 PLEASANT HILL VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: PLEASANT HILL, VLG. OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between	1/1/2018 and 1/31/2018
	2 Sample(s) Required between	2/1/2018 and 2/28/2018
	2 Sample(s) Required between	3/1/2018 and 3/31/2018
	2 Sample(s) Required between	4/1/2018 and 4/30/2018
	2 Sample(s) Required between	5/1/2018 and 5/31/2018
	2 Sample(s) Required between	6/1/2018 and 6/30/2018
	2 Sample(s) Required between	7/1/2018 and 7/31/2018
	2 Sample(s) Required between	8/1/2018 and 8/31/2018
	2 Sample(s) Required between	9/1/2018 and 9/30/2018
	2 Sample(s) Required between	10/1/2018 and 10/31/2018
	2 Sample(s) Required between	11/1/2018 and 11/30/2018
	2 Sample(s) Required between	12/1/2018 and 12/31/2018

TOTAL CHLORINE - 1000	2 Sample(s) Required between	1/1/2018 and 1/31/2018
	2 Sample(s) Required between	2/1/2018 and 2/28/2018
	2 Sample(s) Required between	3/1/2018 and 3/31/2018
	2 Sample(s) Required between	4/1/2018 and 4/30/2018
	2 Sample(s) Required between	5/1/2018 and 5/31/2018
	2 Sample(s) Required between	6/1/2018 and 6/30/2018
	2 Sample(s) Required between	7/1/2018 and 7/31/2018
	2 Sample(s) Required between	8/1/2018 and 8/31/2018
	2 Sample(s) Required between	9/1/2018 and 9/30/2018
	2 Sample(s) Required between	10/1/2018 and 10/31/2018
	2 Sample(s) Required between	11/1/2018 and 11/30/2018
	2 Sample(s) Required between	12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: PLEASANT HILL, VLG. OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS	Dual Sample Required between	7/1/2018 and 9/30/2018 at: DS201
-------------------------	------------------------------	----------------------------------

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 05/25/2018

2018 DISTRIBUTION SCHEDULE

OH5501312 PLEASANT HILL VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: PLEASANT HILL, VLG. OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: PLEASANT HILL, VLG. OF DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH5501612 TROY CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5556495	Facility Name: TROY CITY	Facility Class: CLASS 3
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

Chemicals	Monitoring Requirements	
INORGANICS	1 Sample(s) Required between	6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020		
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085		
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between	6/1/2018 and 10/31/2018
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	1/1/2018 and 3/31/2018
	1 Sample(s) Required between	4/1/2018 and 6/30/2018
	1 Sample(s) Required between	7/1/2018 and 9/30/2018
	1 Sample(s) Required between	10/1/2018 and 12/31/2018



OH5501612 TROY CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: TROY, CITY OF DISTRIBUTION	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

TOTAL COLIFORM (TCR) - 3100	30 Sample(s) Required between	1/1/2018 and 1/31/2018
	30 Sample(s) Required between	2/1/2018 and 2/28/2018
	30 Sample(s) Required between	3/1/2018 and 3/31/2018
	30 Sample(s) Required between	4/1/2018 and 4/30/2018
	30 Sample(s) Required between	5/1/2018 and 5/31/2018
	30 Sample(s) Required between	6/1/2018 and 6/30/2018
	30 Sample(s) Required between	7/1/2018 and 7/31/2018
	30 Sample(s) Required between	8/1/2018 and 8/31/2018
	30 Sample(s) Required between	9/1/2018 and 9/30/2018
	30 Sample(s) Required between	10/1/2018 and 10/31/2018
	30 Sample(s) Required between	11/1/2018 and 11/30/2018
	30 Sample(s) Required between	12/1/2018 and 12/31/2018

TOTAL CHLORINE - 1000	30 Sample(s) Required between	1/1/2018 and 1/31/2018
	30 Sample(s) Required between	2/1/2018 and 2/28/2018
	30 Sample(s) Required between	3/1/2018 and 3/31/2018
	30 Sample(s) Required between	4/1/2018 and 4/30/2018
	30 Sample(s) Required between	5/1/2018 and 5/31/2018
	30 Sample(s) Required between	6/1/2018 and 6/30/2018
	30 Sample(s) Required between	7/1/2018 and 7/31/2018
	30 Sample(s) Required between	8/1/2018 and 8/31/2018
	30 Sample(s) Required between	9/1/2018 and 9/30/2018
	30 Sample(s) Required between	10/1/2018 and 10/31/2018
	30 Sample(s) Required between	11/1/2018 and 11/30/2018
	30 Sample(s) Required between	12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: TROY, CITY OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH5501612 TROY CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: TROY, CITY OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: TROY, CITY OF DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required



OH5501711 WEST MILTON VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Table with 4 columns: Sampling Location, Facility ID, Facility Name, Facility Class. Values: DS1, WEST MILTON, VILLAGE OF DISTRIBUTION, CLASS 1.

Chemicals Monitoring Requirements

ASBESTOS - 1094 Not Required

Table with 3 columns: Parameter, Samples, Dates. Parameter: TOTAL COLIFORM (TCR) - 3100. Samples: 5. Dates: 1/1/2018 to 12/31/2018.

Table with 3 columns: Parameter, Samples, Dates. Parameter: TOTAL CHLORINE - 1000. Samples: 5. Dates: 1/1/2018 to 12/31/2018.

Samples should be collected at the same time and place as the Total Coliform samples.

Table with 4 columns: Sampling Location, Facility ID, Facility Name, Facility Class. Values: DS201, ADDRESS NOT KNOWN, CLASS 1.

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



OH5501711 WEST MILTON VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: WEST MILTON, VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: WEST MILTON, VILLAGE OF DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required



OH5501912 PARIS COURT MHP

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5556497	Facility Name: PARIS COURT MHP	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

Chemicals	Monitoring Requirements	
ARSENIC - 1005	1 Sample(s) Required between	1/1/2018 and 3/31/2018
	1 Sample(s) Required between	4/1/2018 and 6/30/2018
	1 Sample(s) Required between	7/1/2018 and 9/30/2018
	1 Sample(s) Required between	10/1/2018 and 12/31/2018
INORGANICS	1 Sample(s) Required between	6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTAL - 1015 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024		
FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL		
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between	6/1/2018 and 10/31/2018
RADIOLOGICALS	1 Sample(s) Required between	6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>		
GROSS ALPHA - 4002 RADIUM-228 - 4030		
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	6/1/2018 and 10/31/2018

OH5501912 PARIS COURT MHP

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: PARIS COURT MHP DISTRIBUTION
	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: PARIS COURT MHP DISTRIBUTION
	SMP ID: DS201	ADDRESS NOT KNOWN

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2018

2018 DISTRIBUTION SCHEDULE

OH5501912 PARIS COURT MHP

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: PARIS COURT MHP DISTRIBUTION
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH5502203 MIAMI CO-DEER CLIFF RUN PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: MIAMI CO-DEER CLIF RUN S DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2018 and 1/31/2018
	1 Sample(s) Required between	2/1/2018 and 2/28/2018
	1 Sample(s) Required between	3/1/2018 and 3/31/2018
	1 Sample(s) Required between	4/1/2018 and 4/30/2018
	1 Sample(s) Required between	5/1/2018 and 5/31/2018
	1 Sample(s) Required between	6/1/2018 and 6/30/2018
	1 Sample(s) Required between	7/1/2018 and 7/31/2018
	1 Sample(s) Required between	8/1/2018 and 8/31/2018
	1 Sample(s) Required between	9/1/2018 and 9/30/2018
	1 Sample(s) Required between	10/1/2018 and 10/31/2018
	1 Sample(s) Required between	11/1/2018 and 11/30/2018
	1 Sample(s) Required between	12/1/2018 and 12/31/2018

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2018 and 1/31/2018
	1 Sample(s) Required between	2/1/2018 and 2/28/2018
	1 Sample(s) Required between	3/1/2018 and 3/31/2018
	1 Sample(s) Required between	4/1/2018 and 4/30/2018
	1 Sample(s) Required between	5/1/2018 and 5/31/2018
	1 Sample(s) Required between	6/1/2018 and 6/30/2018
	1 Sample(s) Required between	7/1/2018 and 7/31/2018
	1 Sample(s) Required between	8/1/2018 and 8/31/2018
	1 Sample(s) Required between	9/1/2018 and 9/30/2018
	1 Sample(s) Required between	10/1/2018 and 10/31/2018
	1 Sample(s) Required between	11/1/2018 and 11/30/2018
	1 Sample(s) Required between	12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: MIAMI CO-DEER CLIF RUN S DISTRIBUTION 7987 CLIFFWOOD DRIVE	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS	Dual Sample Required between	7/1/2018 and 9/30/2018 at: DS201
-------------------------	------------------------------	----------------------------------

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH5502203 MIAMI CO-DEER CLIFF RUN PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: MIAMI CO-DEER CLIF RUN S DISTRIBUTION	Facility Class: CLASS 1
	SMP ID: DS202	ADDRESS NOT KNOWN	

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1	Facility Name: MIAMI CO-DEER CLIF RUN S DISTRIBUTION	Facility Class: CLASS 1
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs	

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH5502303 MIAMI CO-N25A EXTENSION

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: MIAMI CO-N25A EXTENSION DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between	1/1/2018 and 1/31/2018
	2 Sample(s) Required between	2/1/2018 and 2/28/2018
	2 Sample(s) Required between	3/1/2018 and 3/31/2018
	2 Sample(s) Required between	4/1/2018 and 4/30/2018
	2 Sample(s) Required between	5/1/2018 and 5/31/2018
	2 Sample(s) Required between	6/1/2018 and 6/30/2018
	2 Sample(s) Required between	7/1/2018 and 7/31/2018
	2 Sample(s) Required between	8/1/2018 and 8/31/2018
	2 Sample(s) Required between	9/1/2018 and 9/30/2018
	2 Sample(s) Required between	10/1/2018 and 10/31/2018
	2 Sample(s) Required between	11/1/2018 and 11/30/2018
	2 Sample(s) Required between	12/1/2018 and 12/31/2018

TOTAL CHLORINE - 1000	2 Sample(s) Required between	1/1/2018 and 1/31/2018
	2 Sample(s) Required between	2/1/2018 and 2/28/2018
	2 Sample(s) Required between	3/1/2018 and 3/31/2018
	2 Sample(s) Required between	4/1/2018 and 4/30/2018
	2 Sample(s) Required between	5/1/2018 and 5/31/2018
	2 Sample(s) Required between	6/1/2018 and 6/30/2018
	2 Sample(s) Required between	7/1/2018 and 7/31/2018
	2 Sample(s) Required between	8/1/2018 and 8/31/2018
	2 Sample(s) Required between	9/1/2018 and 9/30/2018
	2 Sample(s) Required between	10/1/2018 and 10/31/2018
	2 Sample(s) Required between	11/1/2018 and 11/30/2018
	2 Sample(s) Required between	12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: MIAMI CO-N25A EXTENSION DISTRIBUTION 2200 NORTH COUNTY ROAD 25A	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH5502303 MIAMI CO-N25A EXTENSION

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: MIAMI CO-N25A EXTENSION DISTRIBUTION UNKNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: MIAMI CO-N25A EXTENSION DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH5502503 MIAMI CO-CAMP TROY PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: MIAMI CO-CAMP TROY DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	4 Sample(s) Required between	1/1/2018	and	1/31/2018
	4 Sample(s) Required between	2/1/2018	and	2/28/2018
	4 Sample(s) Required between	3/1/2018	and	3/31/2018
	4 Sample(s) Required between	4/1/2018	and	4/30/2018
	4 Sample(s) Required between	5/1/2018	and	5/31/2018
	4 Sample(s) Required between	6/1/2018	and	6/30/2018
	4 Sample(s) Required between	7/1/2018	and	7/31/2018
	4 Sample(s) Required between	8/1/2018	and	8/31/2018
	4 Sample(s) Required between	9/1/2018	and	9/30/2018
	4 Sample(s) Required between	10/1/2018	and	10/31/2018
	4 Sample(s) Required between	11/1/2018	and	11/30/2018
	4 Sample(s) Required between	12/1/2018	and	12/31/2018

TOTAL CHLORINE - 1000	4 Sample(s) Required between	1/1/2018	and	1/31/2018
	4 Sample(s) Required between	2/1/2018	and	2/28/2018
	4 Sample(s) Required between	3/1/2018	and	3/31/2018
	4 Sample(s) Required between	4/1/2018	and	4/30/2018
	4 Sample(s) Required between	5/1/2018	and	5/31/2018
	4 Sample(s) Required between	6/1/2018	and	6/30/2018
	4 Sample(s) Required between	7/1/2018	and	7/31/2018
	4 Sample(s) Required between	8/1/2018	and	8/31/2018
	4 Sample(s) Required between	9/1/2018	and	9/30/2018
	4 Sample(s) Required between	10/1/2018	and	10/31/2018
	4 Sample(s) Required between	11/1/2018	and	11/30/2018
	4 Sample(s) Required between	12/1/2018	and	12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: MIAMI CO-CAMP TROY DISTRIBUTION 2370 ROSEWOOD DRIVE	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS	Dual Sample Required between	7/1/2018	and	9/30/2018 at: DS201
-------------------------	------------------------------	----------	-----	---------------------

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH5502503 MIAMI CO-CAMP TROY PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: MIAMI CO-CAMP TROY DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: MIAMI CO-CAMP TROY DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 20 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH5502703 BETHEL TOWNSHIP WATER SYSTEM PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: DS1 SMP ID: DS000 Facility Name: BETHEL TOWNSHIP WATER SYSTEM DISTRIBI Facility Class: CLASS 1

Chemicals Monitoring Requirements

Table with 3 columns: Chemicals, Monitoring Requirements, and Dates. Includes rows for TOTAL COLIFORM (TCR) - 3100 with 12 sampling requirements from 1/1/2018 to 12/31/2018.

Table with 3 columns: Chemicals, Monitoring Requirements, and Dates. Includes rows for TOTAL CHLORINE - 1000 with 12 sampling requirements from 1/1/2018 to 12/31/2018.

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: DS1 SMP ID: DS201 Facility Name: BETHEL TOWNSHIP WATER SYSTEM DISTRIBI Facility Class: CLASS 1

Chemicals Monitoring Requirements

Table with 3 columns: Chemicals, Monitoring Requirements, and Dates. Includes row for DISINFECTION BYPRODUCTS with Dual Sample Required between 7/1/2018 and 9/30/2018 at DS201.

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



Effective Date: 01/01/2018

2018 DISTRIBUTION SCHEDULE

OH5502703 BETHEL TOWNSHIP WATER SYSTEM PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: BETHEL TOWNSHIP WATER SYSTEM DISTRI	Facility Class: CLASS 1
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs	

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required

OH5530212 AMVETS POST 66

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: AMVETS POST 66 DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5530212 AMVETS POST 66

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5556502 Facility Name: AMVETS POST 66
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5530412 BRUKNER NATURE CENTER

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: BRUKNER NATURE CENTER DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5530412 BRUKNER NATURE CENTER

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5556503 Facility Name: BRUKNER NATURE CENTER
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

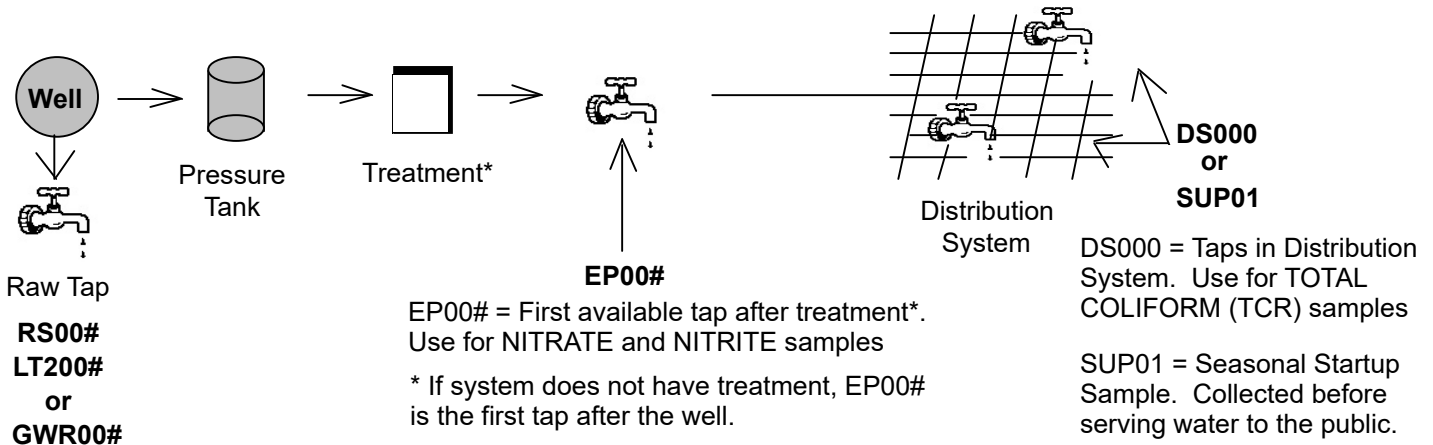

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5531312 THE DOLPHIN SWIM CLUB OF TROY INC

System Type: Transient Noncommunity

Operating Period: 5/1 to 8/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **DOLPHIN SWIM CLUB DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

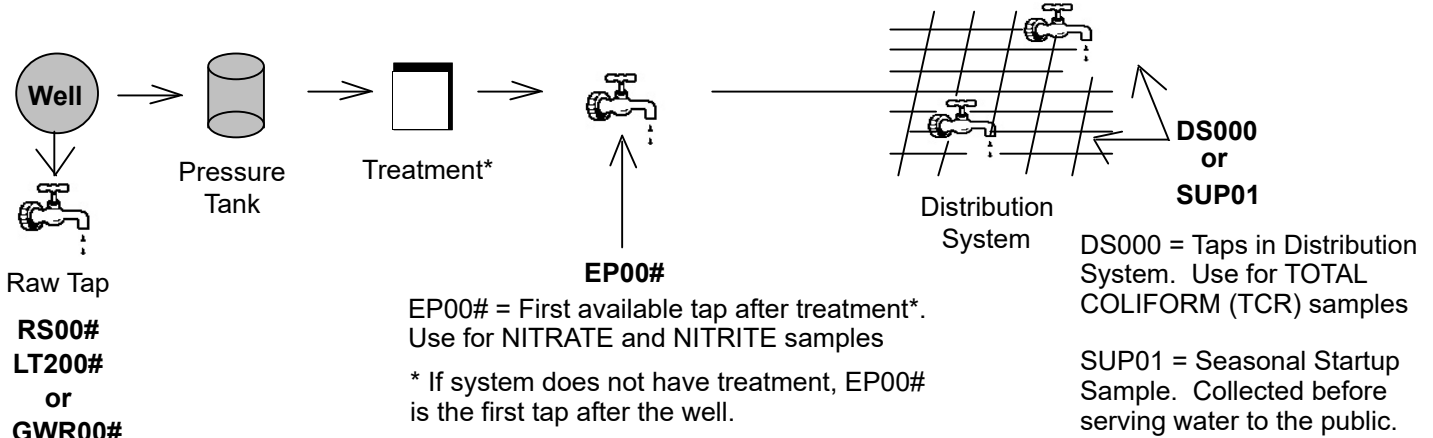

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5531312 THE DOLPHIN SWIM CLUB OF TROY INC

System Type: Transient Noncommunity

Operating Period: 5/1 to 8/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: DOLPHIN SWIM CLUB DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018

Where to Collect Samples For a Small Public Water System

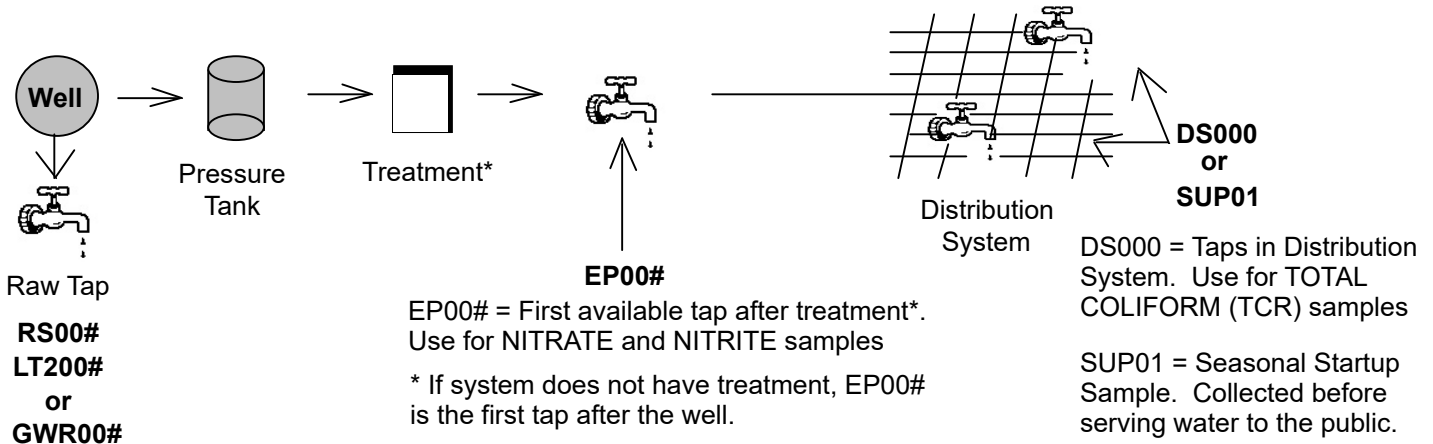

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5531312 THE DOLPHIN SWIM CLUB OF TROY INC

System Type: Transient Noncommunity

Operating Period: 5/1 to 8/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5556507 Facility Name: DOLPHIN SWIM CLUB
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

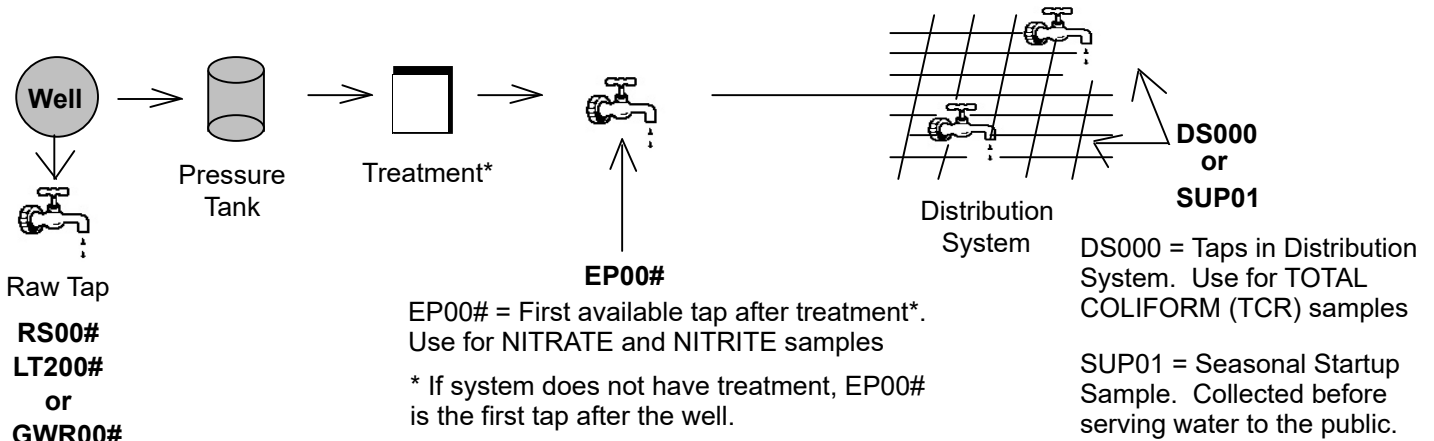

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5532212 HOMESTEAD GOLF COURSE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: HOMESTEAD GOLF COURSE DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

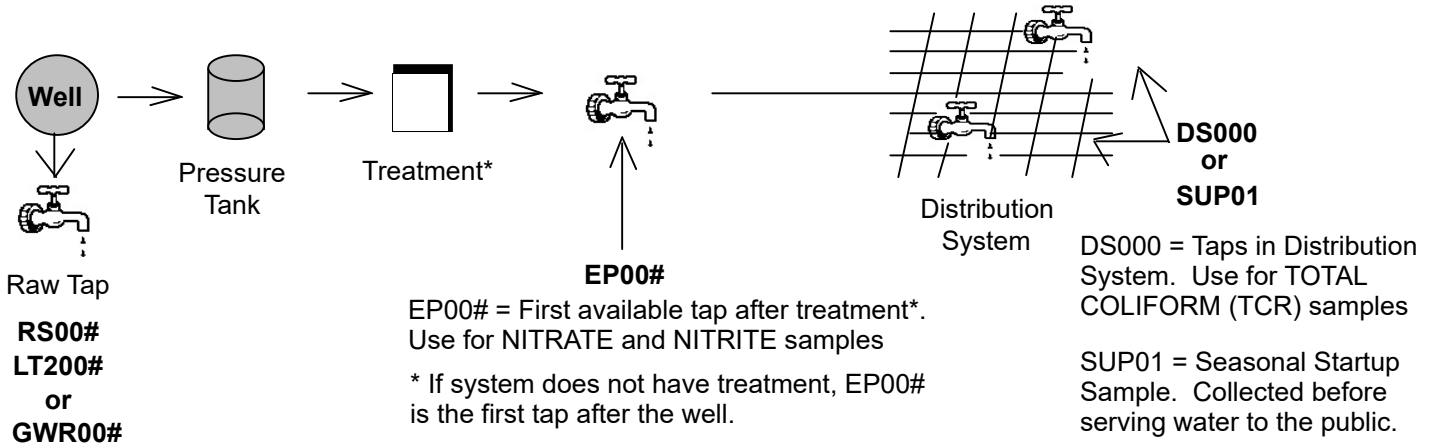

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5532212 HOMESTEAD GOLF COURSE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5556508 Facility Name: HOMESTEAD GOLF COURSE

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 4/1/2018 and 6/30/2018

Where to Collect Samples For a Small Public Water System

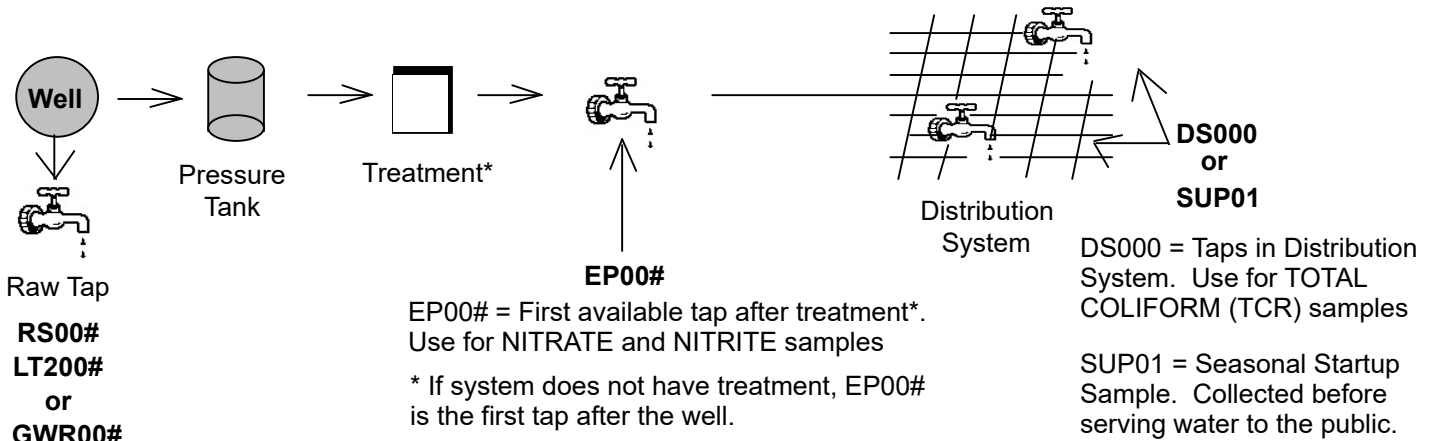

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5532412 INDIAN HILLS 4H CAMP PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: INDIAN HILLS 4H CAMP DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

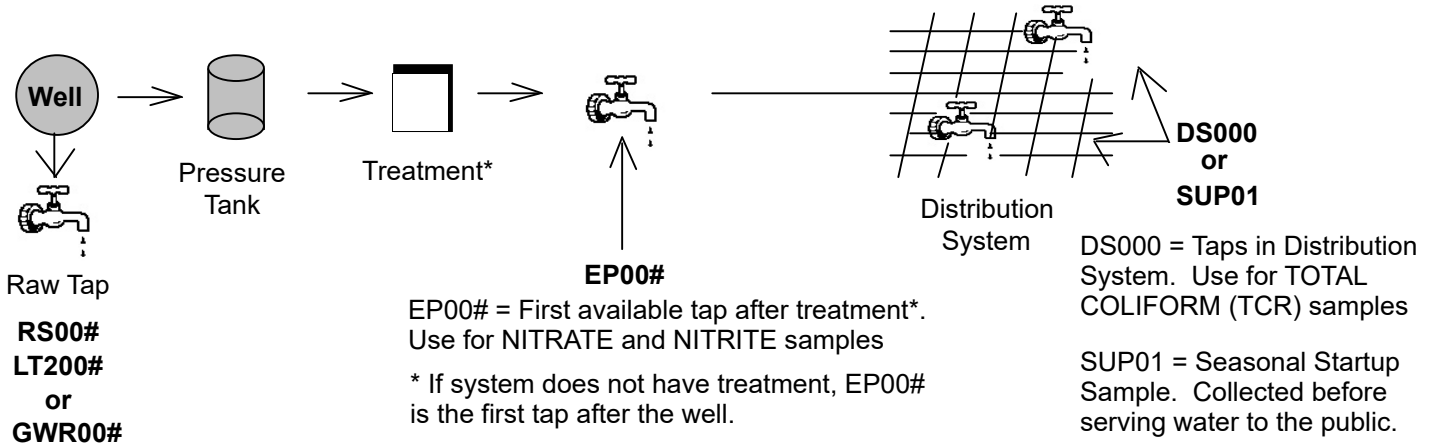

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5532412 INDIAN HILLS 4H CAMP PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5556509 Facility Name: INDIAN HILLS 4H CAMP
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 3/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5533612 STILLWATER RIDGE, INC.

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: STILLWATER RIDGE, INC. DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

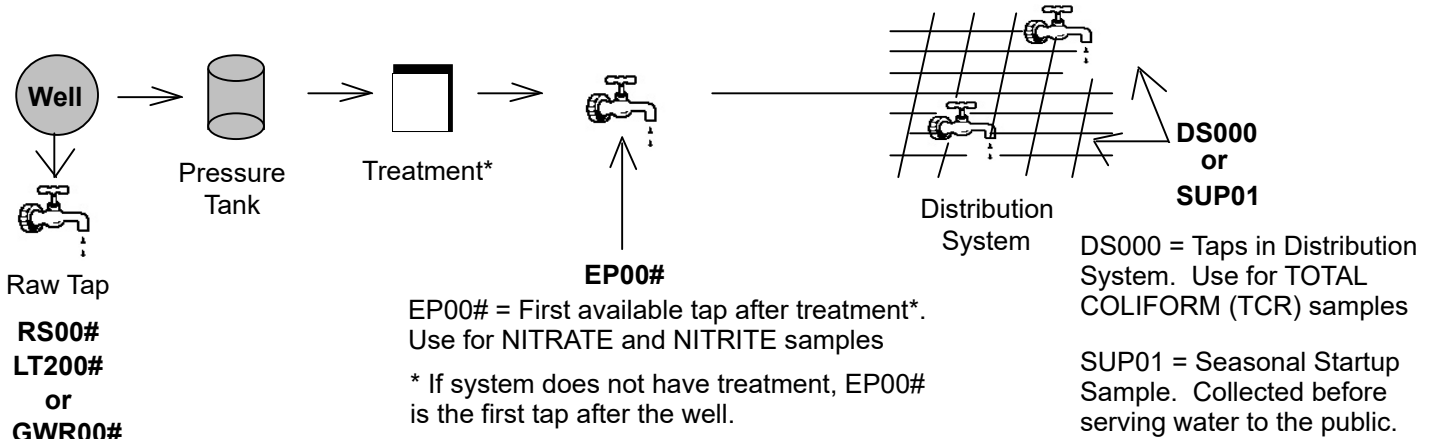

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5533612 STILLWATER RIDGE, INC.

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5556514 Facility Name: STILLWATER RIDGE INC
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 4/1/2018 and 6/30/2018

Where to Collect Samples For a Small Public Water System

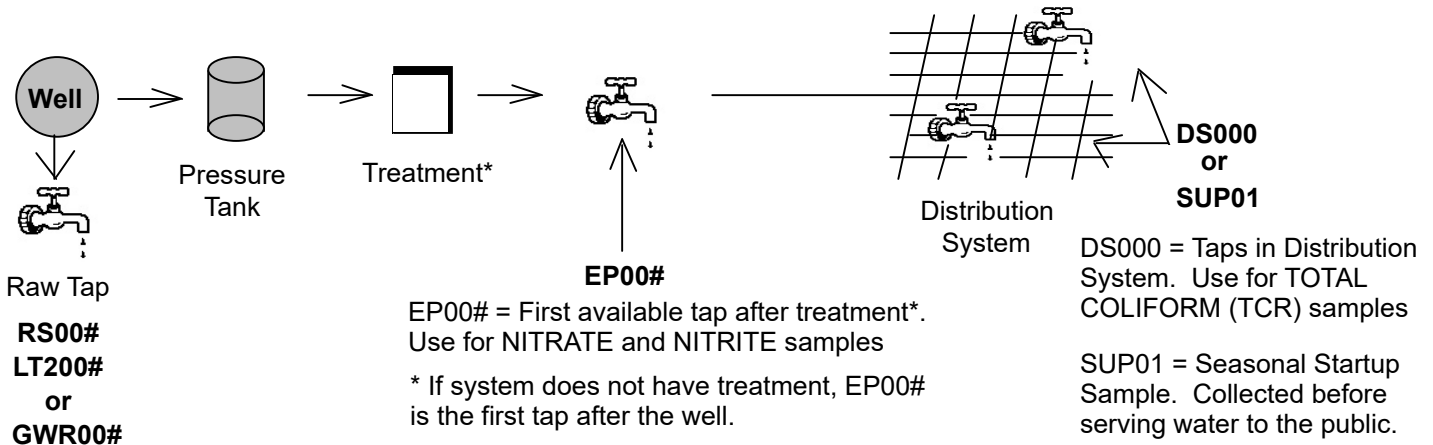

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5534012 POOR FARMERS CAMP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: POOR FARMERS CAMP DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

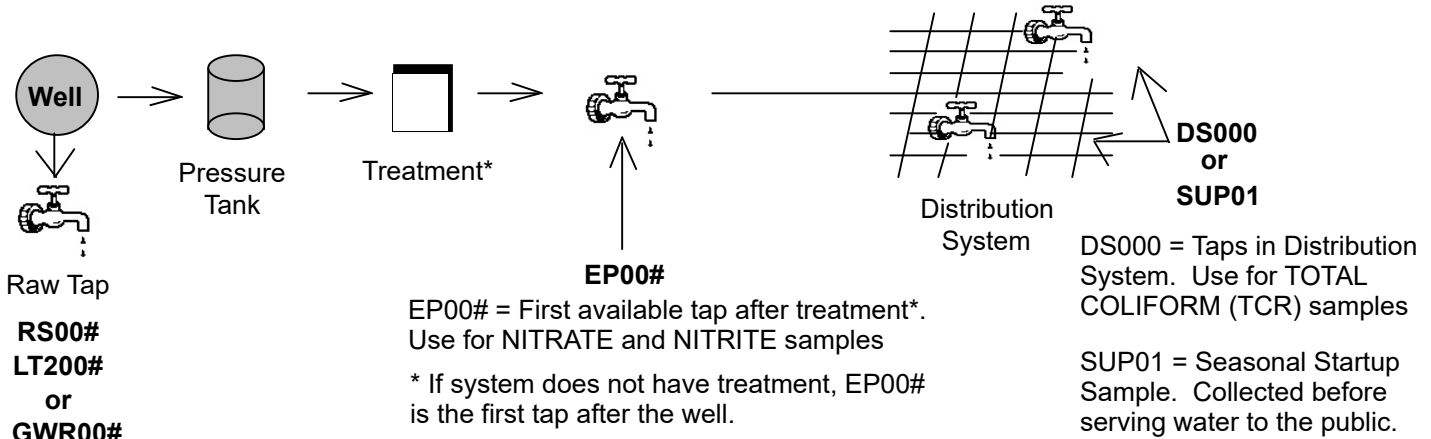

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5534012 POOR FARMERS CAMP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5556516 Facility Name: POOR FARMERS CAMP
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

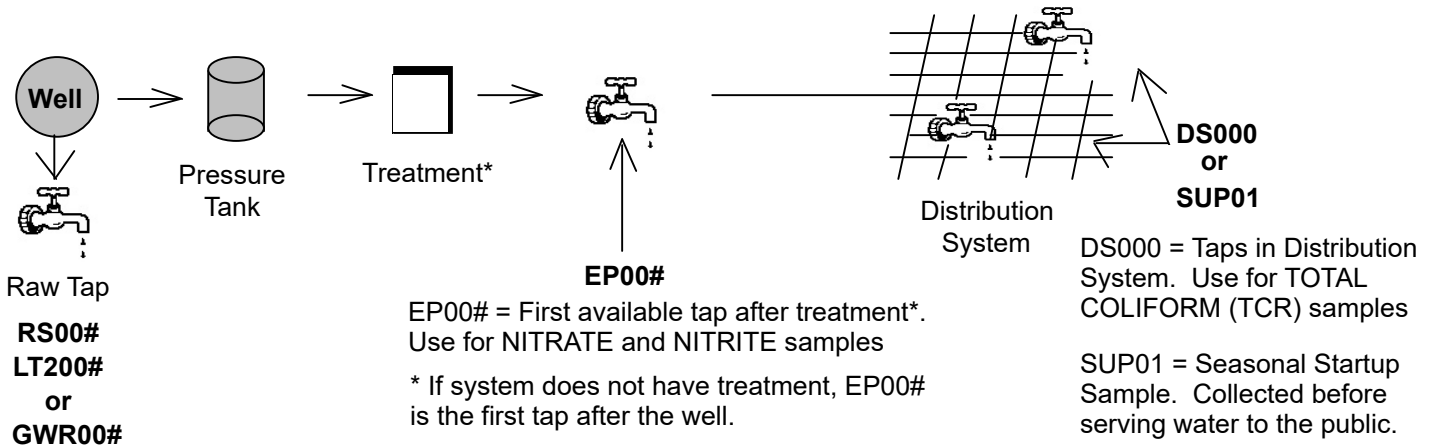

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5534912 TIP TOP CAMP NORTH

System Type: Transient Noncommunity

Operating Period: 7/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **TIP TOP CAMP NORTH DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

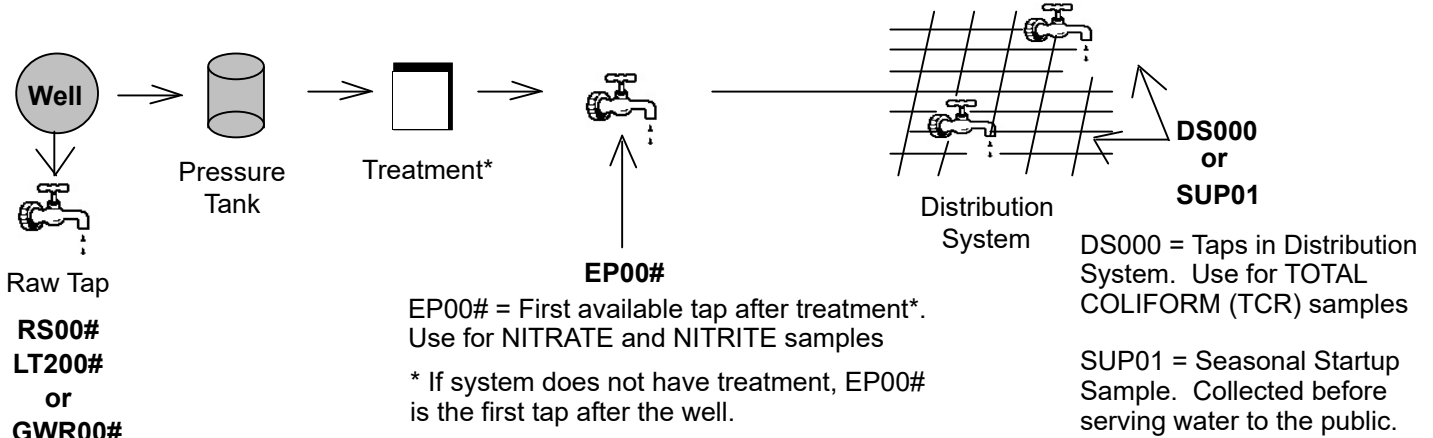

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5534912 TIP TOP CAMP NORTH

System Type: Transient Noncommunity

Operating Period: 7/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: TIP TOP CAMP NORTH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

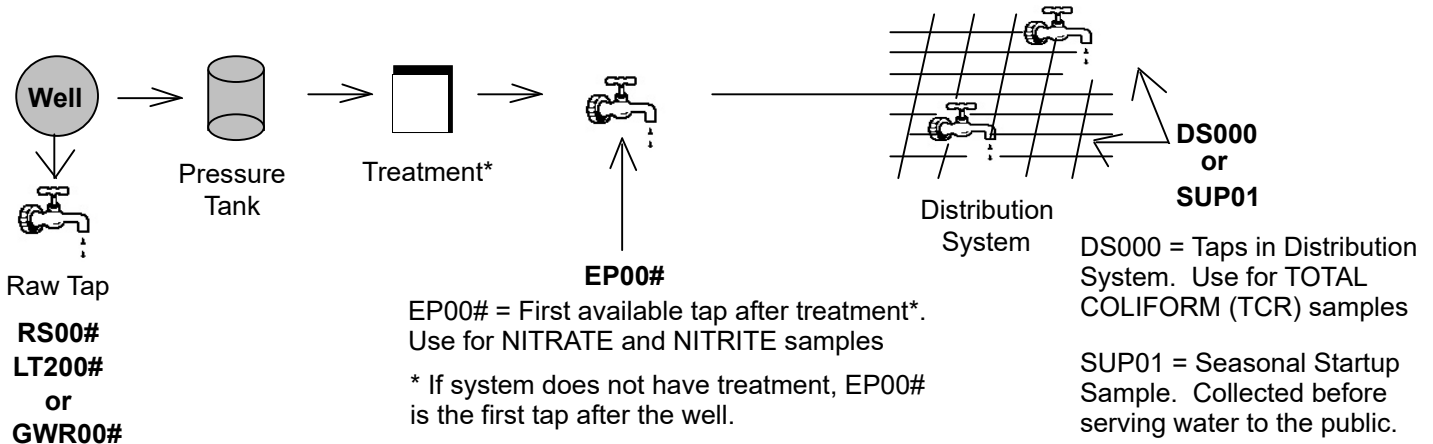

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5534912 TIP TOP CAMP NORTH

System Type: Transient Noncommunity

Operating Period: 7/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5556519 Facility Name: TIP TOP CAMP NO 1
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5535612 TROY FISH AND GAME CLUB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: TROY FISH & GAME CLUB DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5535612 TROY FISH AND GAME CLUB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5562255 Facility Name: TROY FISH & GAME PROTECTIVE ASSN INC
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

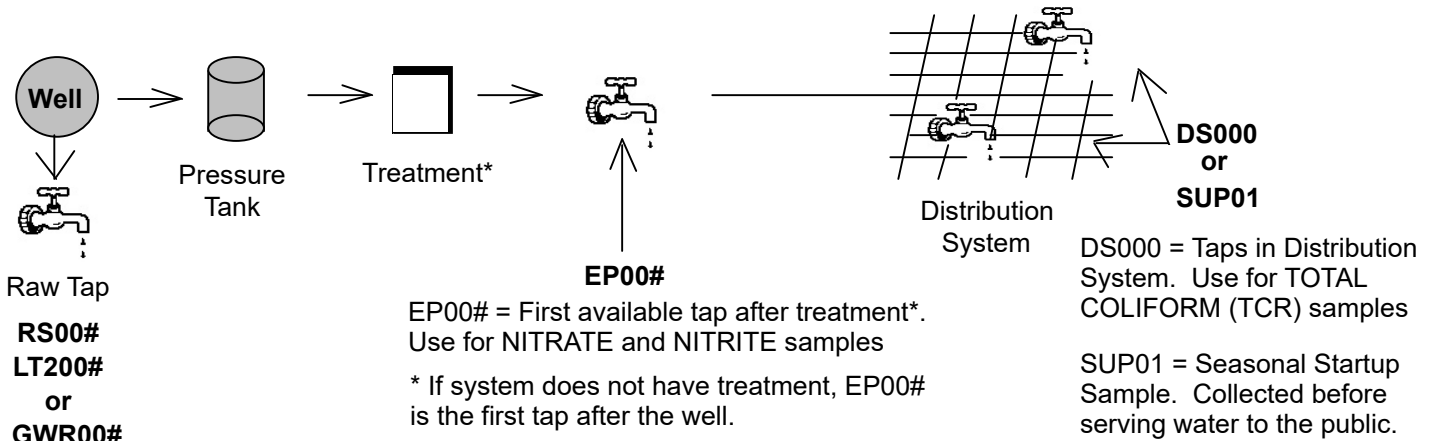

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5536412 36 SKATE CLUB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: 36 SKATE CLUB DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

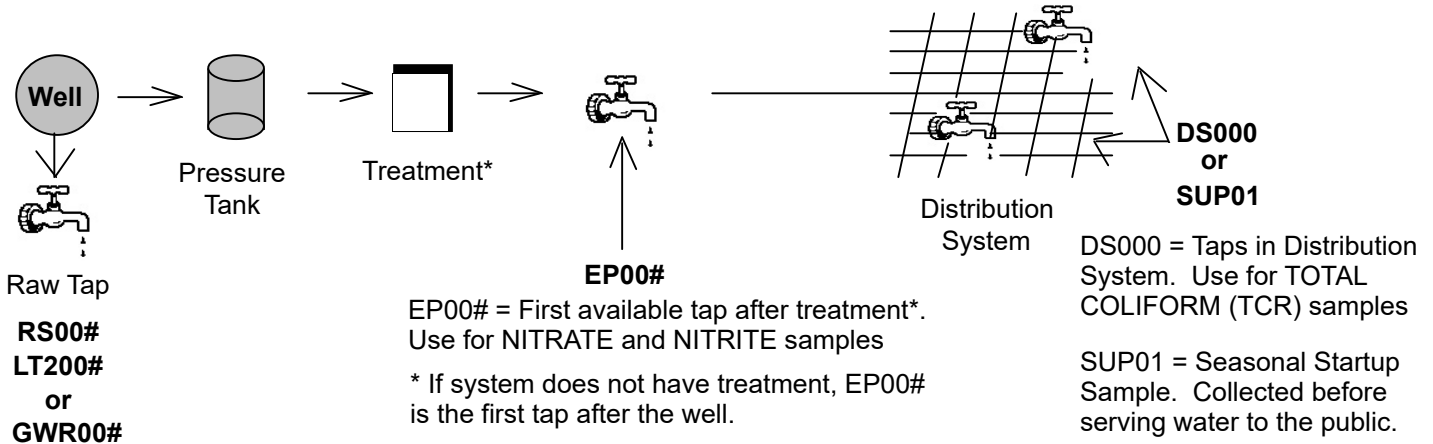

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5536412 36 SKATE CLUB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5556526 Facility Name: 36 SKATE CLUB
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

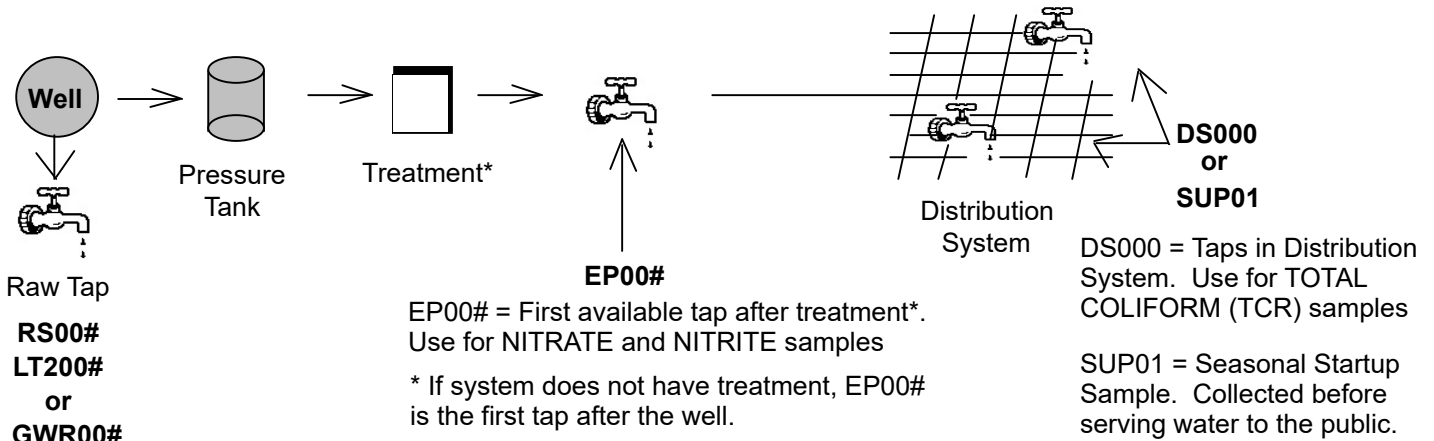

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5536812 BRUSH CREEK CHURCH OF GOD

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: BRUSHCREEK CHURCH OF GOD DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

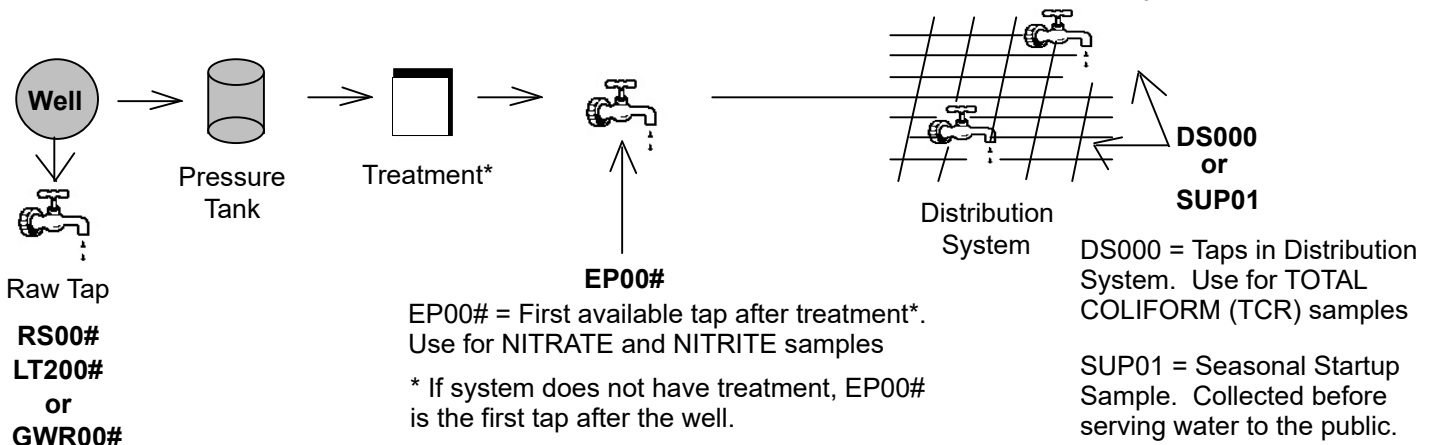

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5536812 BRUSH CREEK CHURCH OF GOD

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5556528 Facility Name: BRUSHCREEK CHURCH OF GOD
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2018 and 5/31/2018
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 3/31/2018

Where to Collect Samples For a Small Public Water System

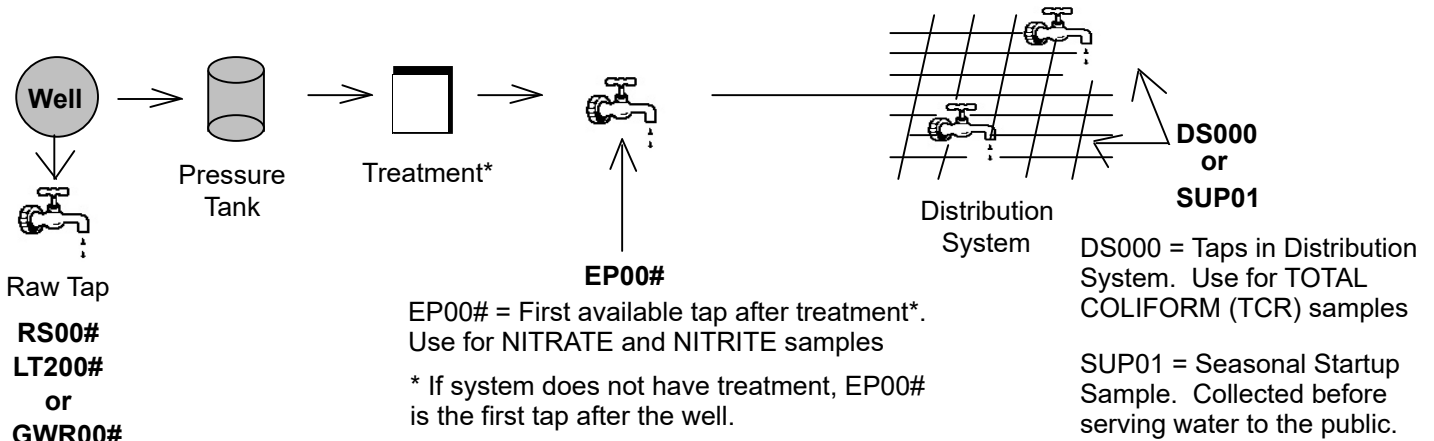

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH5537712 ELIZABETH TOWNSHIP COMMUNITY CENTER

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5556532	Facility Name: ELIZABETH TOWNSHIP COMMUNITY CENTER
	SMP ID: EP001	Facility Source: Ground Water
		Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2018 and 10/31/2018

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 1/1/2018 and 3/31/2018

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 Not Required

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 2 Not Required

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 3 1 Sample(s) Required between 4/1/2018 and 6/30/2018

Sample for all the analytes listed below:

BHC-GAMMA (LINDANE) - 2010 DIQUAT - 2032 GLYPHOSATE - 2034

METHOXYCHLOR - 2015 POLYCHLORINATED BIPHENYLS (PCB) - 2383

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 4 Not Required

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2018 and 10/31/2018



OH5537712 ELIZABETH TOWNSHIP COMMUNITY CENTER

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **ELIZABETH TWP COMMUNITY CTR DISTRIBUT** Facility Class: **CLASS 1**
SMP ID: **DS000**

Chemicals Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100
1 Sample(s) Required between 1/1/2018 and 3/31/2018
1 Sample(s) Required between 4/1/2018 and 6/30/2018
1 Sample(s) Required between 7/1/2018 and 9/30/2018
1 Sample(s) Required between 10/1/2018 and 12/31/2018

TOTAL CHLORINE - 1000
1 Sample(s) Required between 1/1/2018 and 3/31/2018
1 Sample(s) Required between 4/1/2018 and 6/30/2018
1 Sample(s) Required between 7/1/2018 and 9/30/2018
1 Sample(s) Required between 10/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: **DS1** Facility Name: **ELIZABETH TWP COMMUNITY CTR DISTRIBUT** Facility Class: **CLASS 1**
SMP ID: **DS201** ADDRESS NOT KNOWN

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location Facility ID: **DS1** Facility Name: **ELIZABETH TWP COMMUNITY CTR DISTRIBUT** Facility Class: **CLASS 1**
SMP ID: **LC###** Refer to your Lead and Copper plan for SMP IDs

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH5538812 A.B. GRAHAM MEMORIAL CENTER PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: A.B. GRAHAM MEMORIAL CTR DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5538812 A.B. GRAHAM MEMORIAL CENTER PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5556533 Facility Name: A.B. GRAHAM MEMORIAL CTR

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

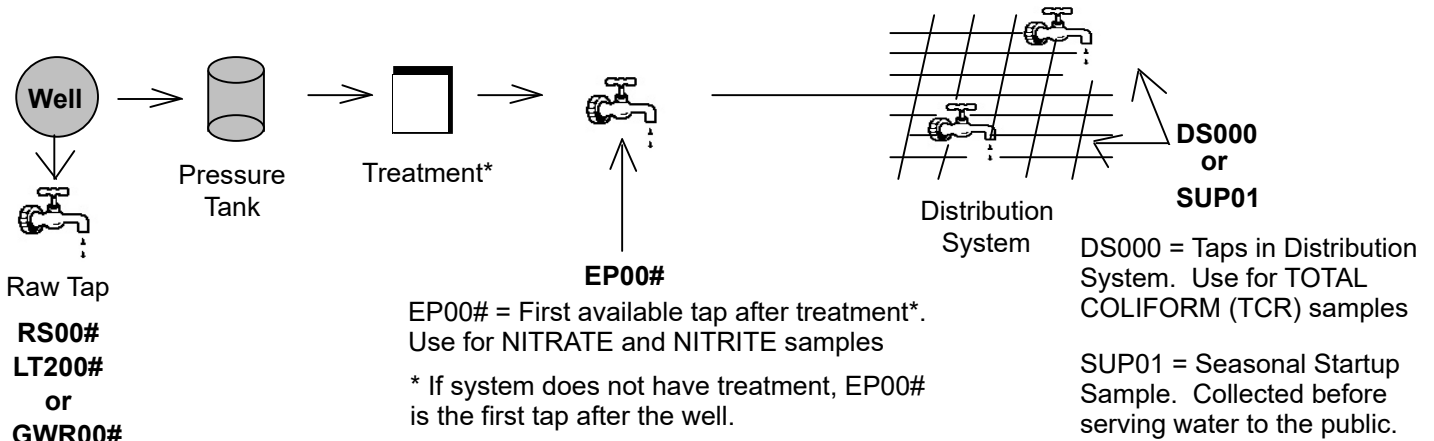

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5540512 SKYVIEW WESLEYAN CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: SKYVIEW WESLEYAN CHURCH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

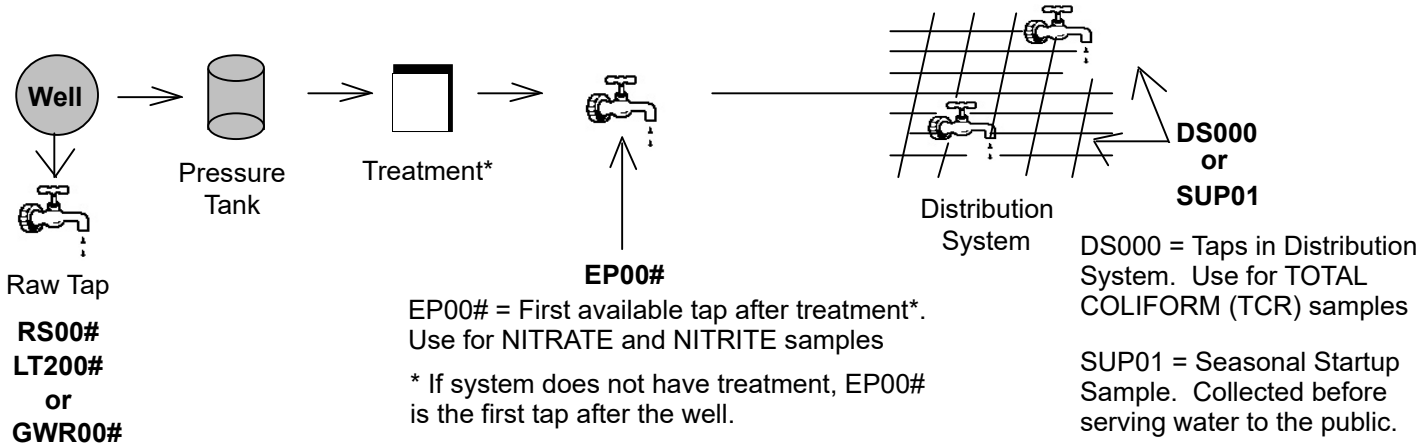

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5540512 SKYVIEW WESLEYAN CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5556539 Facility Name: SKYVIEW WESLEYAN CHURCH
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

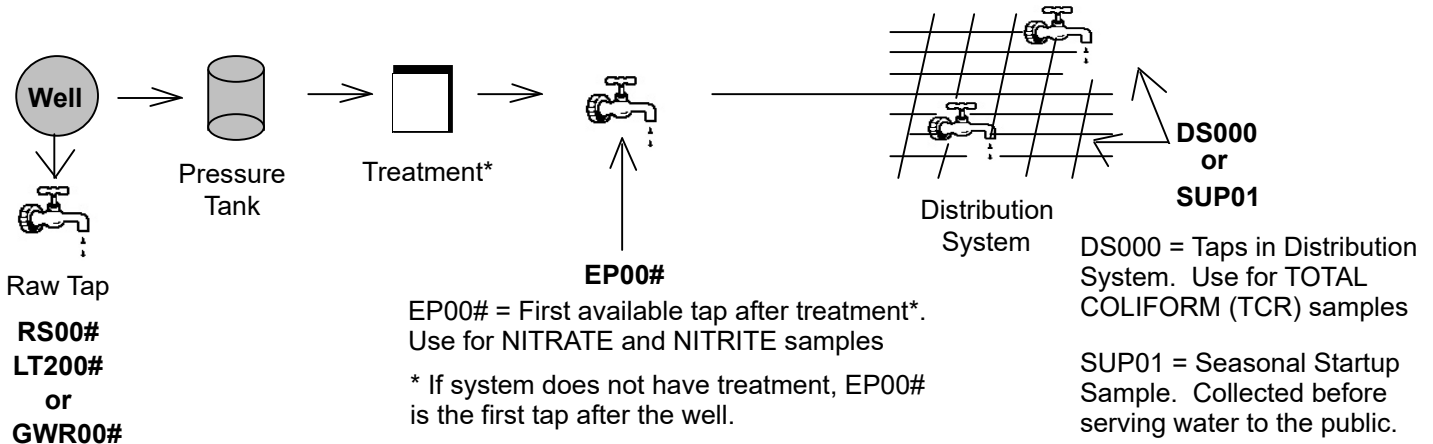

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5542612 CHARITY BAPTIST CHURCH OF TIPP CITY

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CHARITY BAPTIST CHURCH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

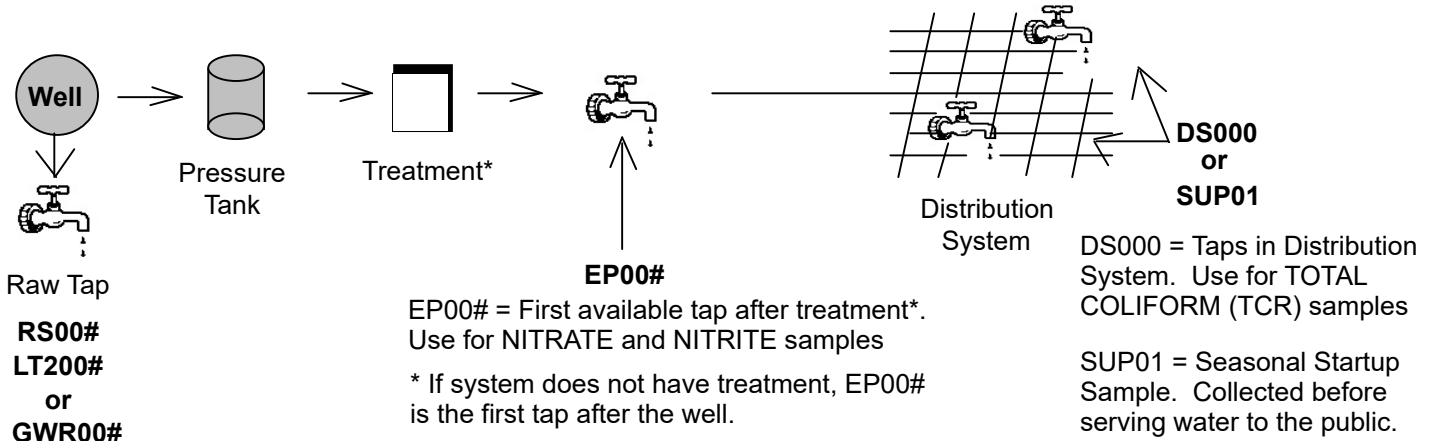

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5542612 CHARITY BAPTIST CHURCH OF TIPP CITY

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5556550 Facility Name: CHARITY BAPTIST CHURCH OF TIPP CITY

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

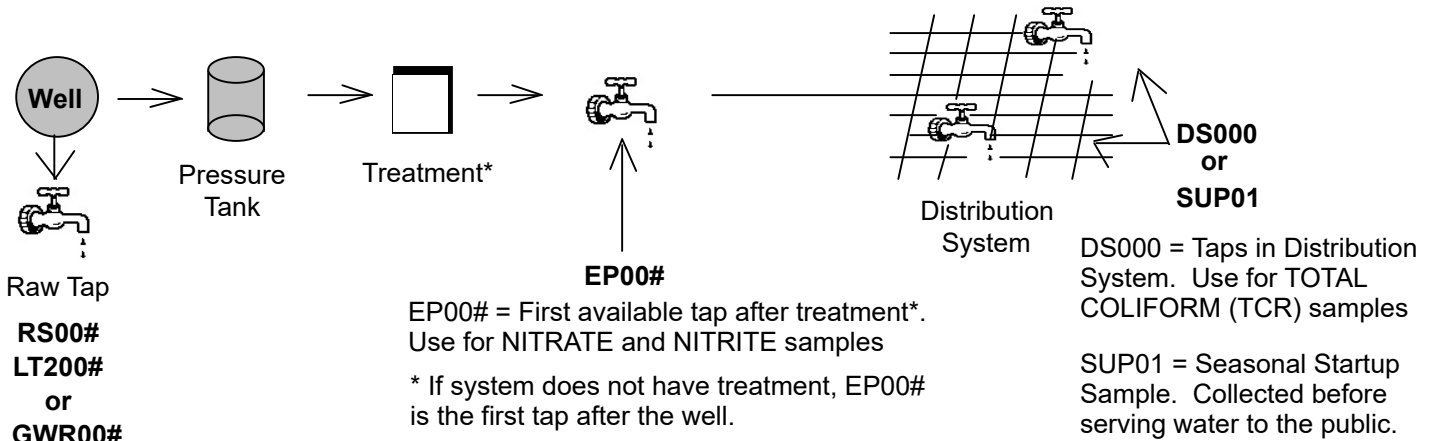

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5543112 PIQUA CHRISTIAN CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: PIQUA CHRISTIAN CHURCH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5543112 PIQUA CHRISTIAN CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5556554 Facility Name: PIQUA CHRISTIAN CHURCH
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5543212 DAYTON OHIO FM GROUP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CHURCH OF JESUS CHRIST-P DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5543212 DAYTON OHIO FM GROUP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5556555 Facility Name: CHURCH OF JESUS CHRISTPIQUA
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5543312 ST. TERESA OF INFANT JESUS PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: ST. TERESA OF INFANT JES DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5543312 ST. TERESA OF INFANT JESUS PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5556556 Facility Name: SAINT TERESA OF INFANT JESUS
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

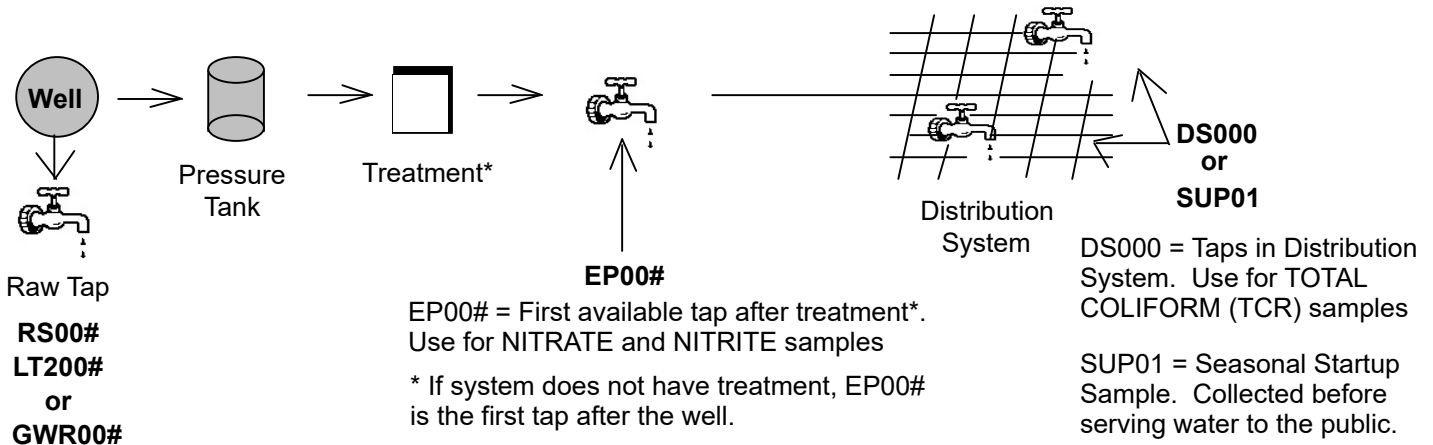

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5544212 FOUR WINDS GOSPEL ASSEMBLY

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **FOUR WINDS GOSPEL ASSEMBLY DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5544212 FOUR WINDS GOSPEL ASSEMBLY

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5556559 Facility Name: FOUR WINDS GOSPEL ASSEMBLY

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 6/1/2018 and 10/31/2018
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

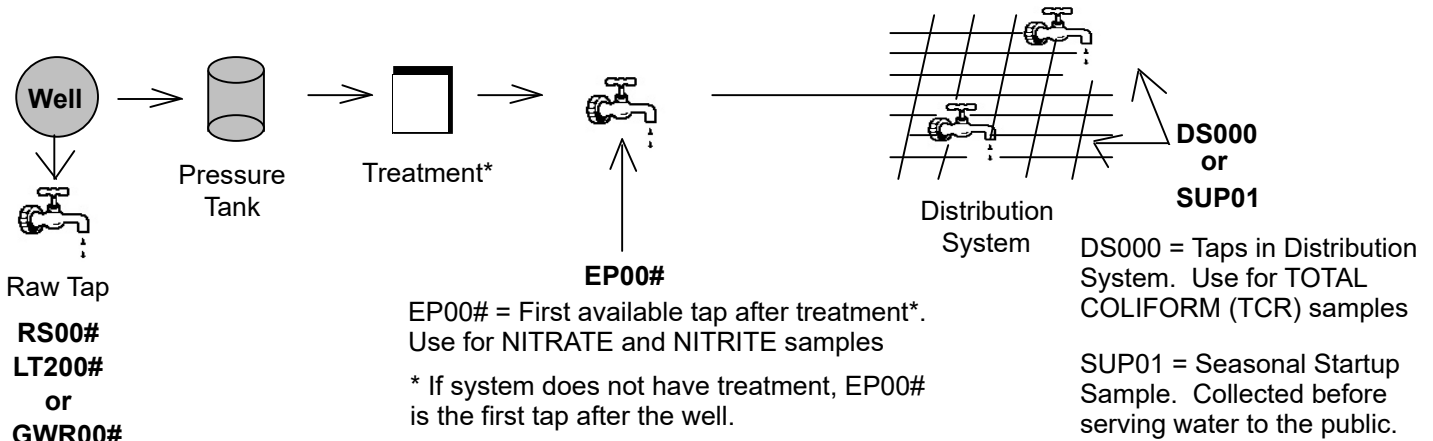

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5544512 LENA BAPTIST CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: LENA BAPTIST CHURCH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

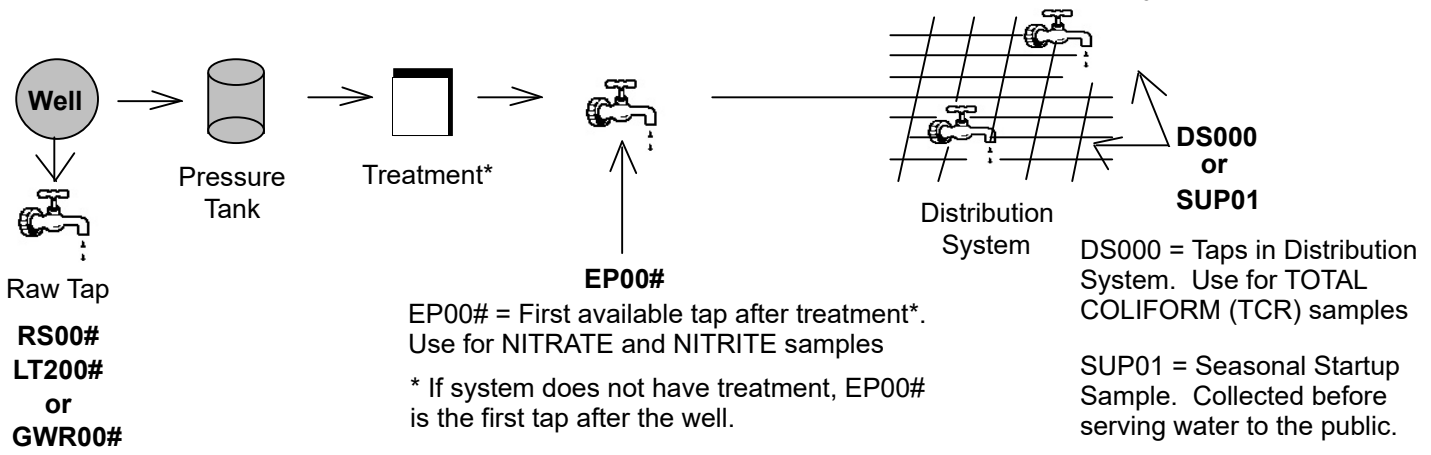

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5544512 LENA BAPTIST CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5556560 Facility Name: LENA BAPTIST CHURCH

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

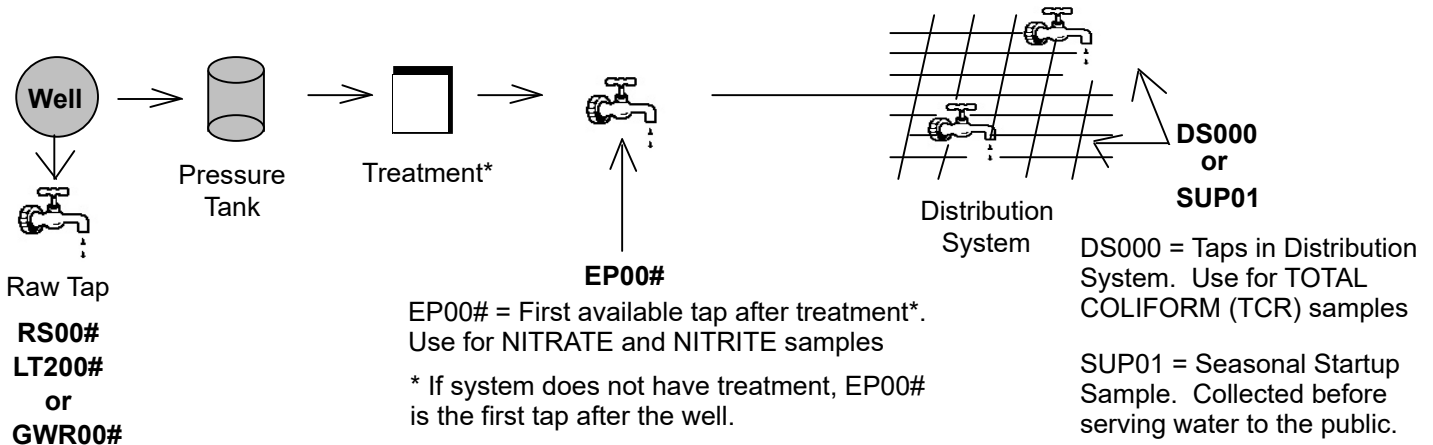

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH5544812 MIAMI EAST SCHOOLS PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5556562	Facility Name: MIAMI EAST SCHOOLS PWS	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2018 and 10/31/2018

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 6/1/2018 and 10/31/2018

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 Not Required

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 1/1/2018 and 3/31/2018



OH5544812 MIAMI EAST SCHOOLS PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: MIAMI EAST SCHOOLS DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2018 and 1/31/2018
	2 Sample(s) Required between 2/1/2018 and 2/28/2018
	2 Sample(s) Required between 3/1/2018 and 3/31/2018
	2 Sample(s) Required between 4/1/2018 and 4/30/2018
	2 Sample(s) Required between 5/1/2018 and 5/31/2018
	2 Sample(s) Required between 6/1/2018 and 6/30/2018
	2 Sample(s) Required between 7/1/2018 and 7/31/2018
	2 Sample(s) Required between 8/1/2018 and 8/31/2018
	2 Sample(s) Required between 9/1/2018 and 9/30/2018
	2 Sample(s) Required between 10/1/2018 and 10/31/2018
	2 Sample(s) Required between 11/1/2018 and 11/30/2018
	2 Sample(s) Required between 12/1/2018 and 12/31/2018
TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2018 and 1/31/2018
	2 Sample(s) Required between 2/1/2018 and 2/28/2018
	2 Sample(s) Required between 3/1/2018 and 3/31/2018
	2 Sample(s) Required between 4/1/2018 and 4/30/2018
	2 Sample(s) Required between 5/1/2018 and 5/31/2018
	2 Sample(s) Required between 6/1/2018 and 6/30/2018
	2 Sample(s) Required between 7/1/2018 and 7/31/2018
	2 Sample(s) Required between 8/1/2018 and 8/31/2018
	2 Sample(s) Required between 9/1/2018 and 9/30/2018
	2 Sample(s) Required between 10/1/2018 and 10/31/2018
	2 Sample(s) Required between 11/1/2018 and 11/30/2018
	2 Sample(s) Required between 12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: MIAMI EAST SCHOOLS DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2018 and 2/7/2018 at: DS201
	Dual Sample Required between 5/1/2018 and 5/7/2018 at: DS201
	Dual Sample Required between 8/1/2018 and 8/7/2018 at: DS201
	Dual Sample Required between 11/1/2018 and 11/7/2018 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH5544812 MIAMI EAST SCHOOLS PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: MIAMI EAST SCHOOLS DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2018 and 2/7/2018 at: DS202
	Dual Sample Required between 5/1/2018 and 5/7/2018 at: DS202
	Dual Sample Required between 8/1/2018 and 8/7/2018 at: DS202
	Dual Sample Required between 11/1/2018 and 11/7/2018 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: MIAMI EAST SCHOOLS DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH5545112 NASHVILLE UNITED CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: NASHVILLE UNITED CHURCH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5545112 NASHVILLE UNITED CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5556565 Facility Name: NASHVILLE UNITED CHURCH OF CHRIST
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

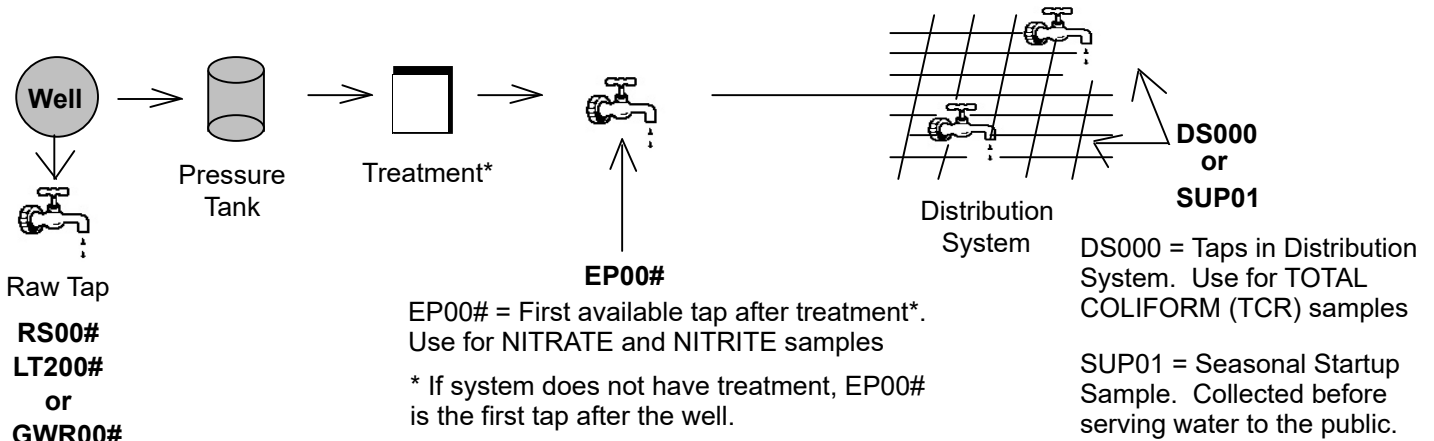

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5545612 POTSDAM METHODIST CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: POTSDAM METHODIST CHURCH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5545612 POTSDAM METHODIST CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5556566 Facility Name: POTSDAM METHODIST CHURCH
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

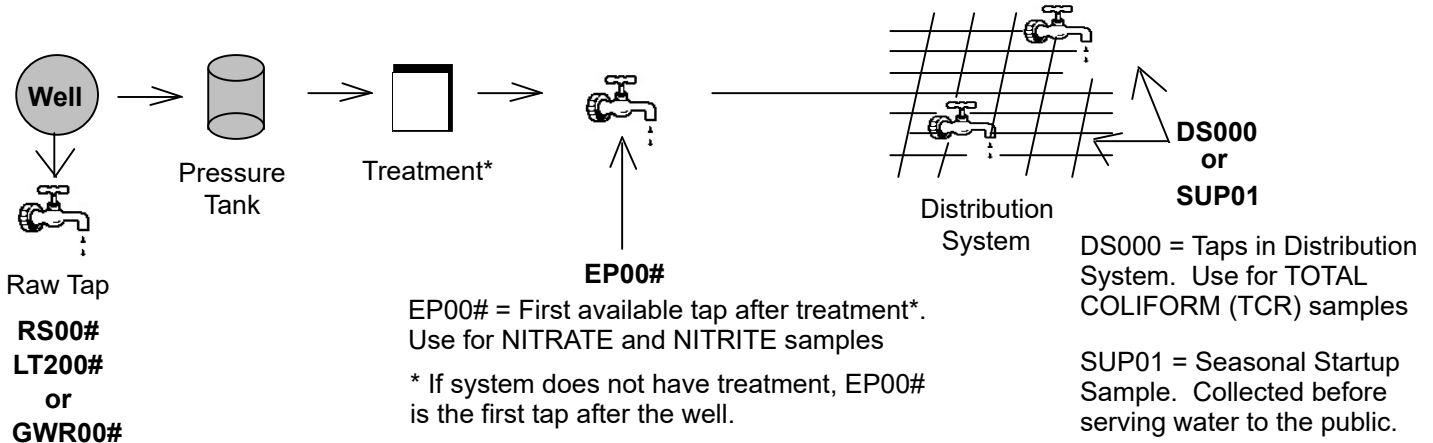

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5545812 ROLLING HILLS GIRL SCOUT CAMP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **ROLLING HILLS GIRL SCOUT DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

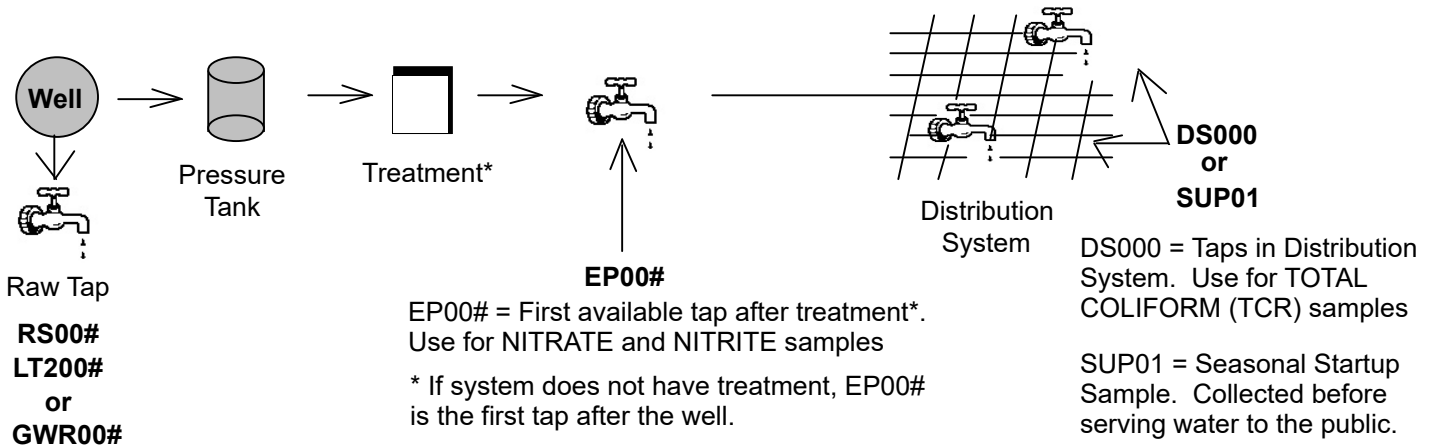

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5545812 ROLLING HILLS GIRL SCOUT CAMP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5556568 Facility Name: ROLLING HILLS GIRL SCOUT CAMP
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5546012 SEVENTH DAY ADVENTIST SCHOOL

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: SEVENTH DAY ADVENTIST DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

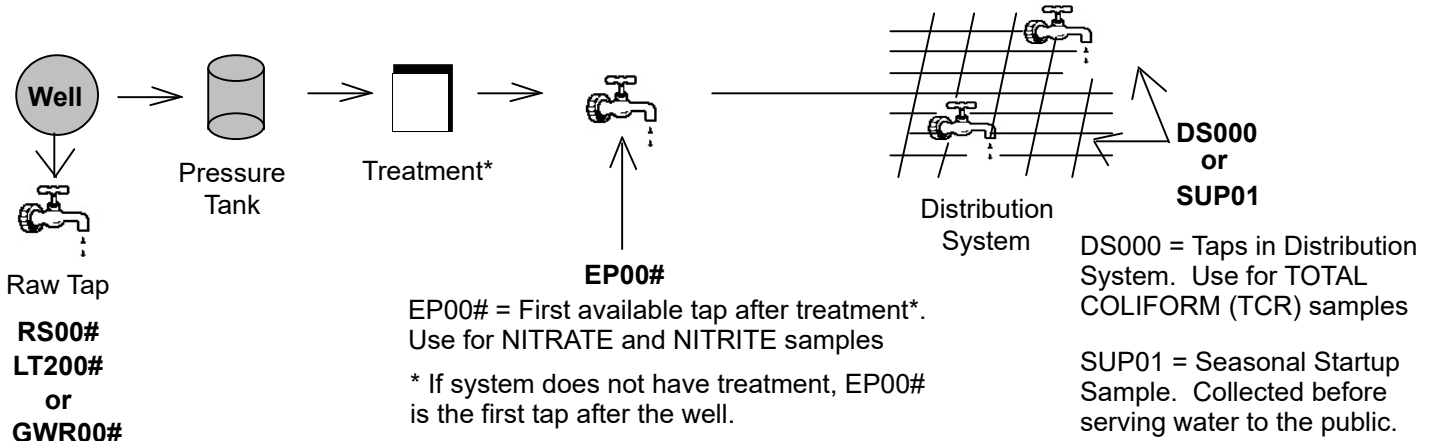

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5546012 SEVENTH DAY ADVENTIST SCHOOL

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5556570 Facility Name: SEVENTH DAY ADVENTIST
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

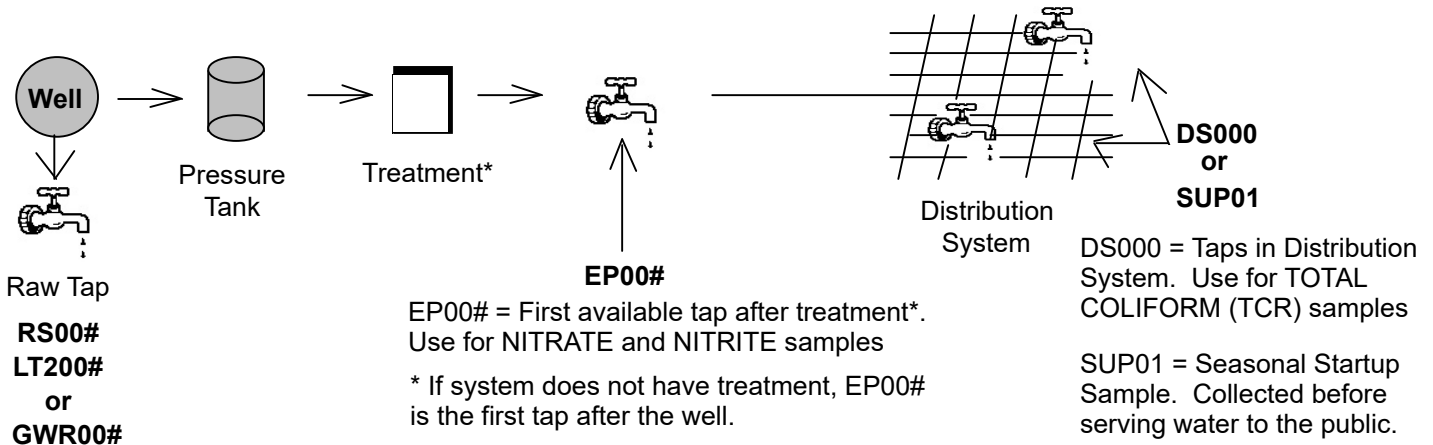

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5546612 STILLWATER PRAIRIE RESERVE PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: STILLWATER PRAIRIE RESER DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5546612 STILLWATER PRAIRIE RESERVE PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5556572	Facility Name: STILLWATER PRAIRIE RESERVE
Location SMP ID: EP001	Facility Source: Ground Water
	Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

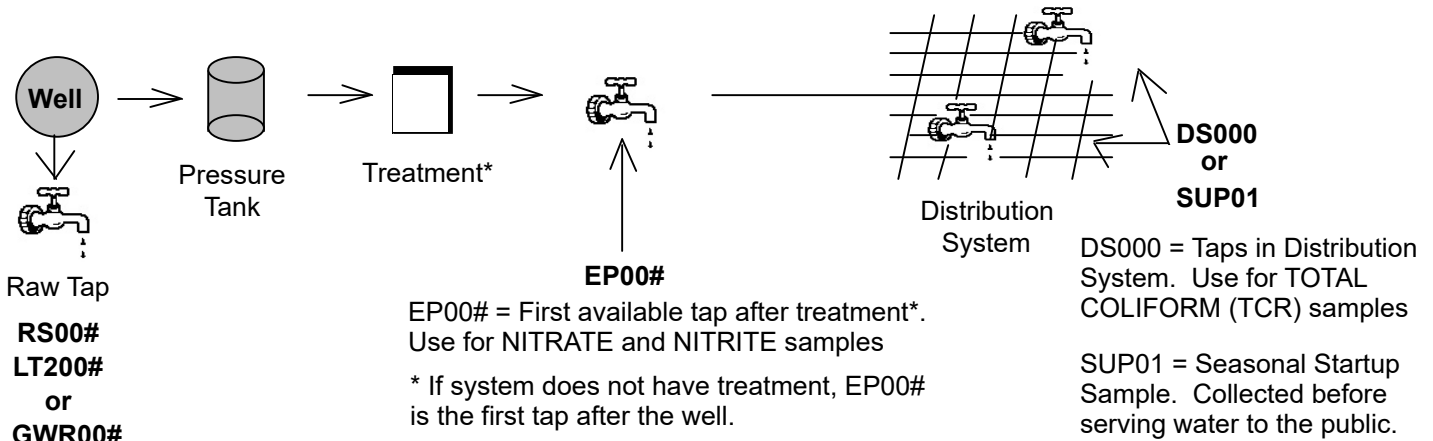

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5547712 GINGHAMSBURG UMC SOUTH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: GINGHAMSBURG UMC SOUTH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

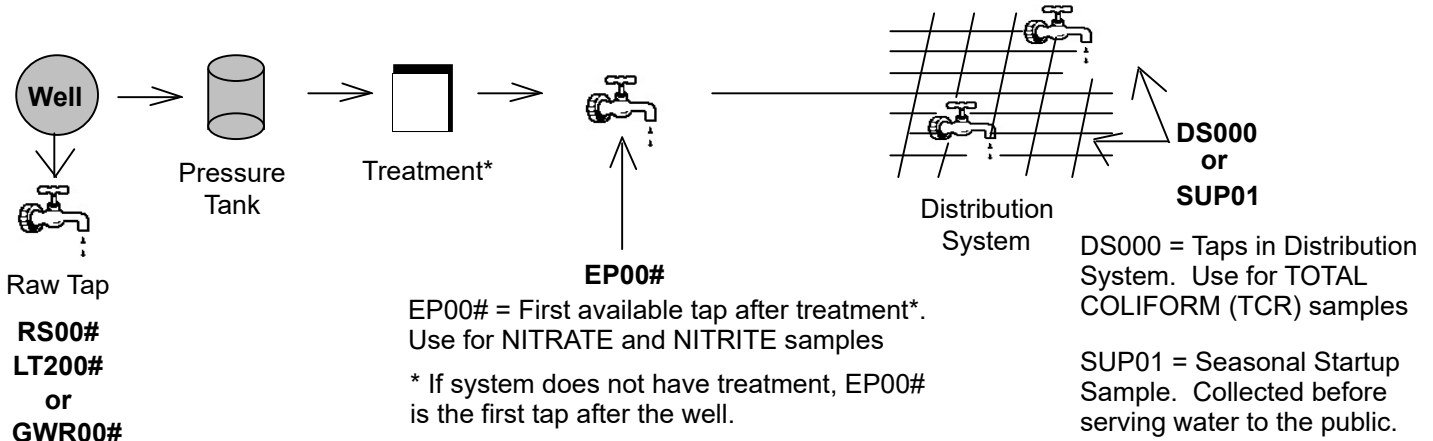

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5547712 GINGHAMSBURG UMC SOUTH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5556576 Facility Name: GINGHAMSBURG U METH CHURCH
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

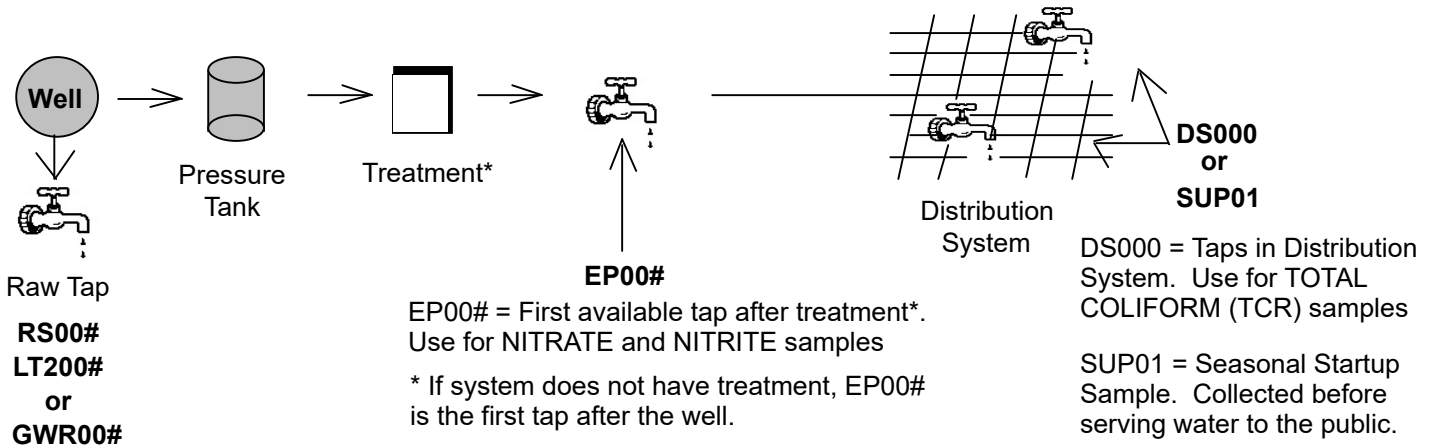

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH5548012 WRENA, LLC

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5556578	Facility Name: WRENA, LLC	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
ARSENIC - 1005	1 Sample(s) Required between 1/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 12/31/2018
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTAL - 1015 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2018 and 10/31/2018



OH5548012 WRENA, LLC

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **WRENA, LLC DISTRIBUTION**
Location SMP ID: **DS000**

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2018	and	3/31/2018
	1 Sample(s) Required between	4/1/2018	and	6/30/2018
	1 Sample(s) Required between	7/1/2018	and	9/30/2018
	1 Sample(s) Required between	10/1/2018	and	12/31/2018

Sampling Facility ID: **DS1** Facility Name: **WRENA, LLC DISTRIBUTION**
Location SMP ID: **LC###** Refer to your Lead and Copper plan for SMP IDs

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between	6/1/2018	and	9/30/2018
-------------------------------	------------------------------	----------	-----	-----------

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH5548512 FULTON FARM CAMP PWS

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **FULTON FARMS CAMP DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

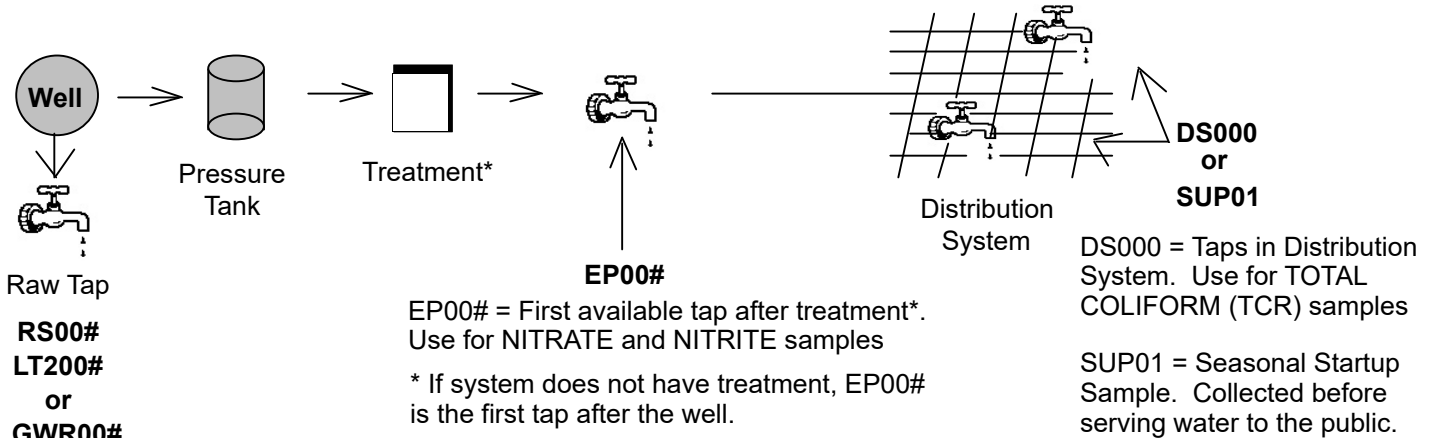

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5548512 FULTON FARM CAMP PWS

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: FULTON FARMS CAMP DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 11/30/2018

Where to Collect Samples For a Small Public Water System

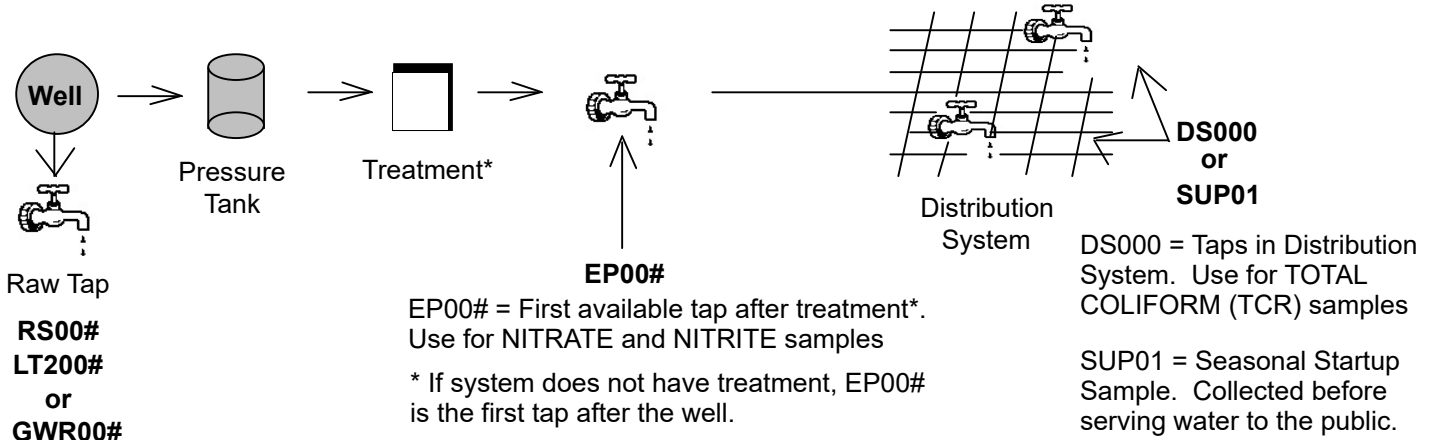

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5548512 FULTON FARM CAMP PWS

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5556583 Facility Name: FULTON FARMS CAMP

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

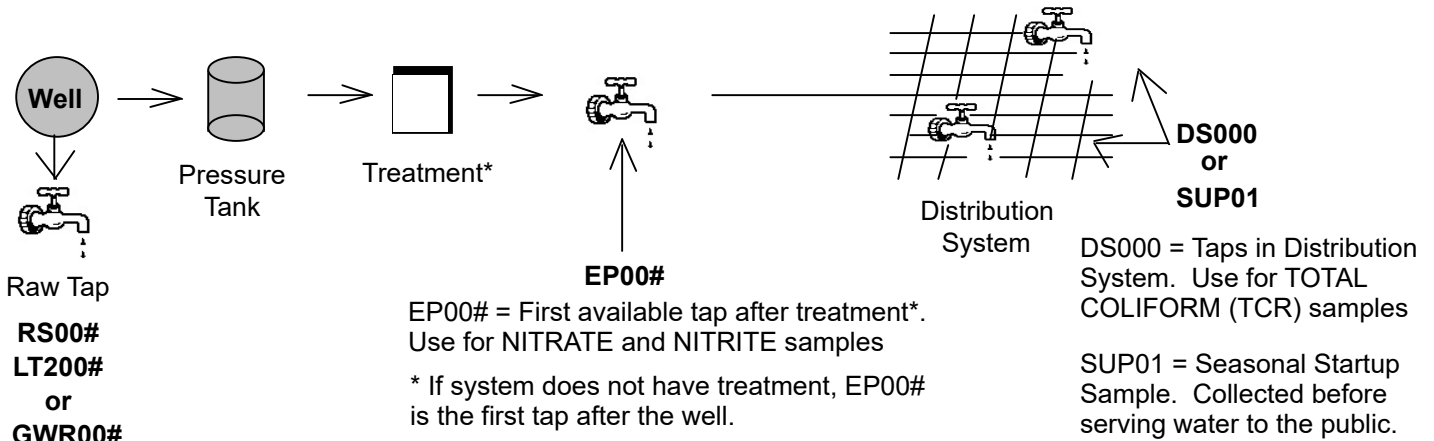

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5548912 AMVETS POST 88

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5556587 Facility Name: AMVETS POST 88
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

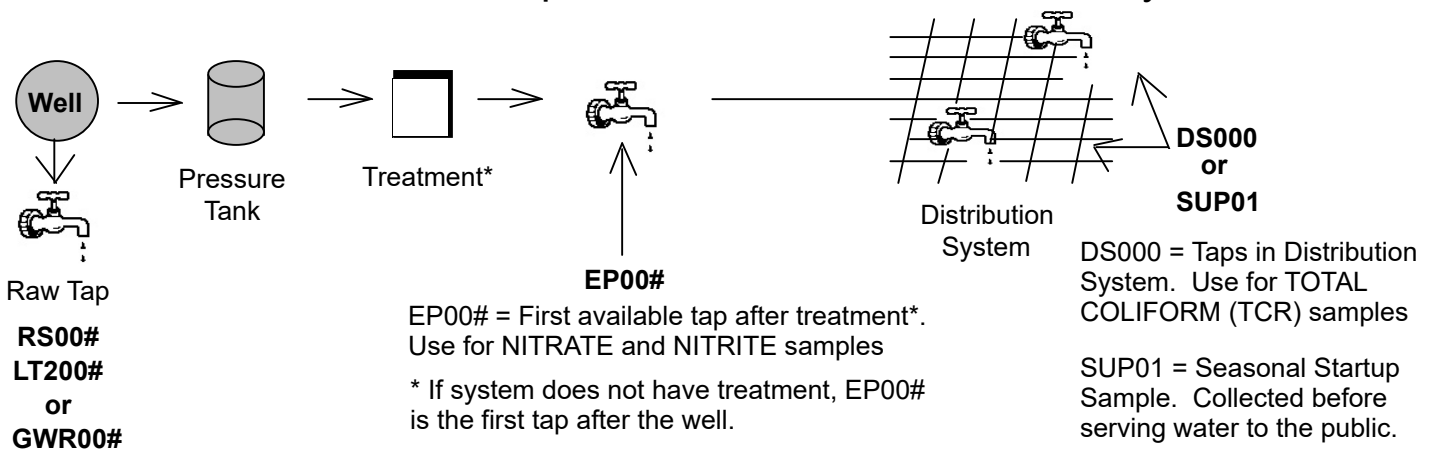

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5549012 TROY C CLUB HALFWAYHOUSE

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **TROY C CLUB HALFWAYHOUSE DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

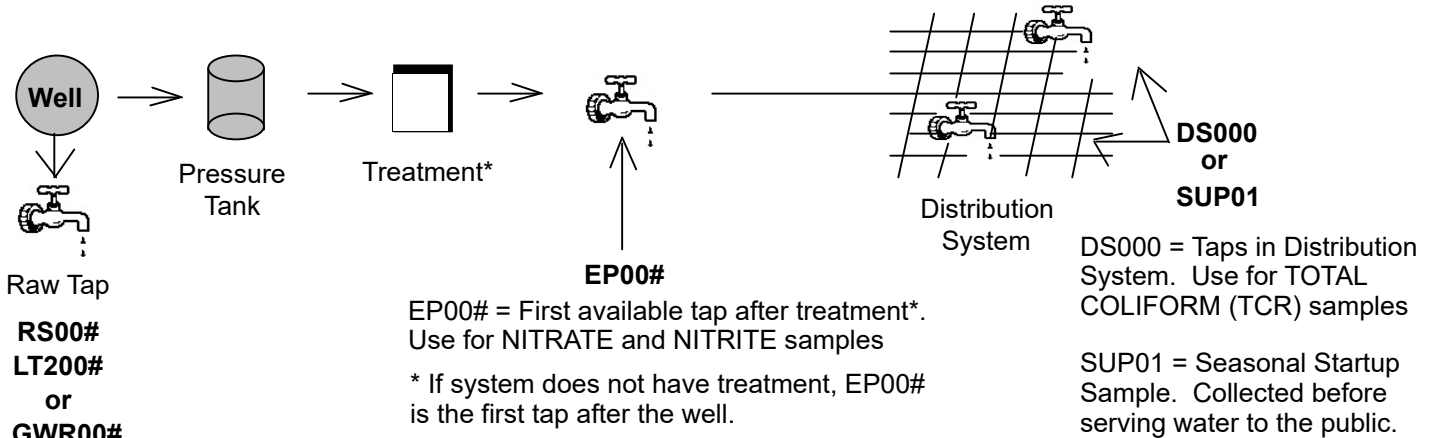

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5549012 TROY C CLUB HALFWAYHOUSE

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: TROY C CLUB HALFWAYHOUSE DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018

Where to Collect Samples For a Small Public Water System

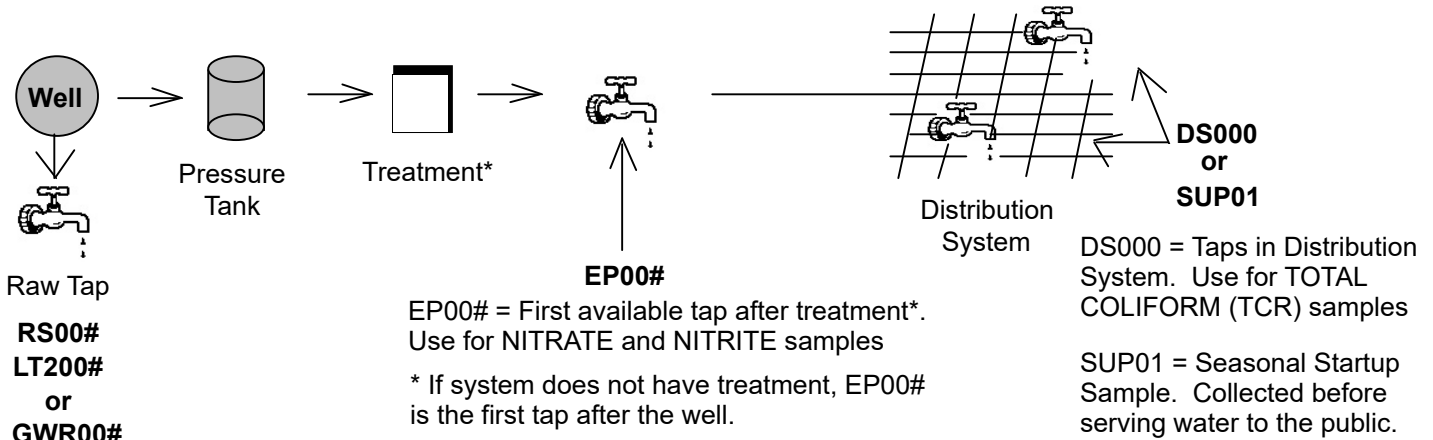

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5549012 TROY C CLUB HALFWAYHOUSE

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5556588 Facility Name: TROY C CLUB HAFTWAY HOUSE

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

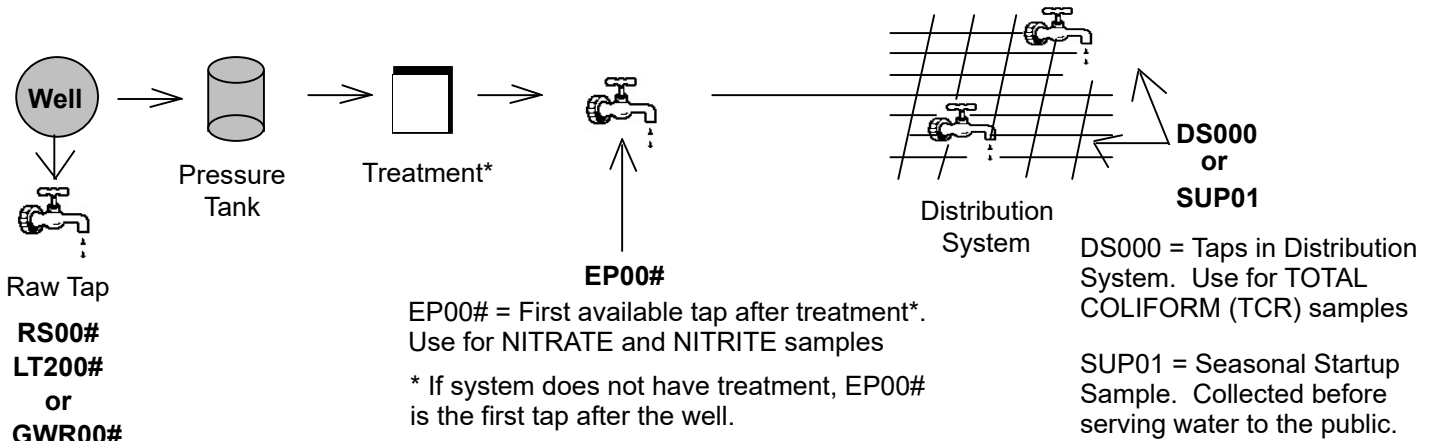

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5549312 THE BARN MINISTRIES INC

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: THE BARN MINISTRIES INC DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5549312 THE BARN MINISTRIES INC

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5556591 Facility Name: THE BARN
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5549612 GARBRY'S BIG WOODS RESERVE WETLAND PWS

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **GARBRY'S BIG WOODS RES W DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

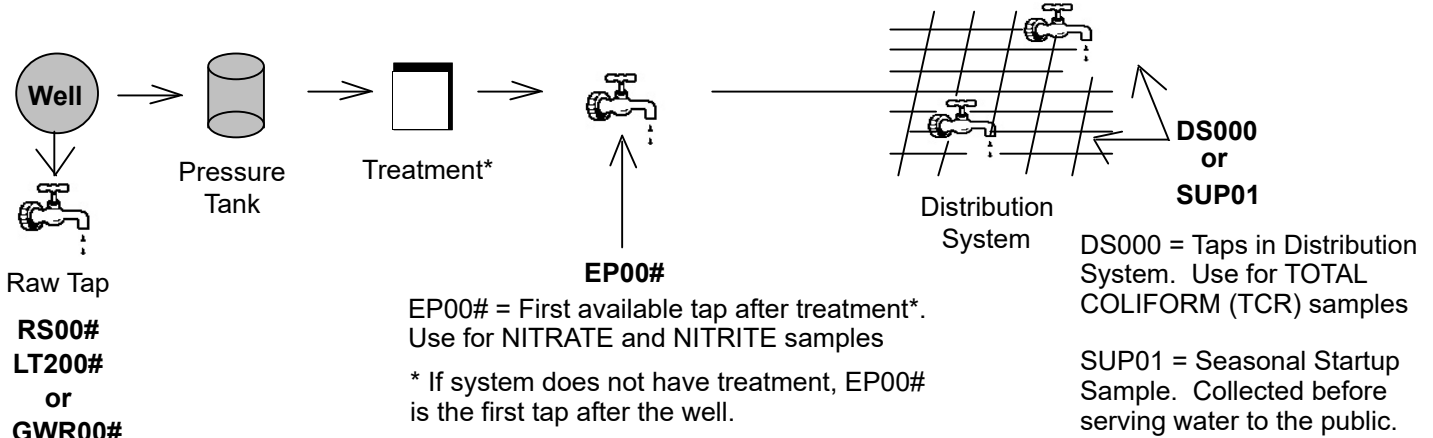

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5549612 GARBRY'S BIG WOODS RESERVE WETLAND PWS

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: GARBRY'S BIG WOODS RES W DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018

Where to Collect Samples For a Small Public Water System

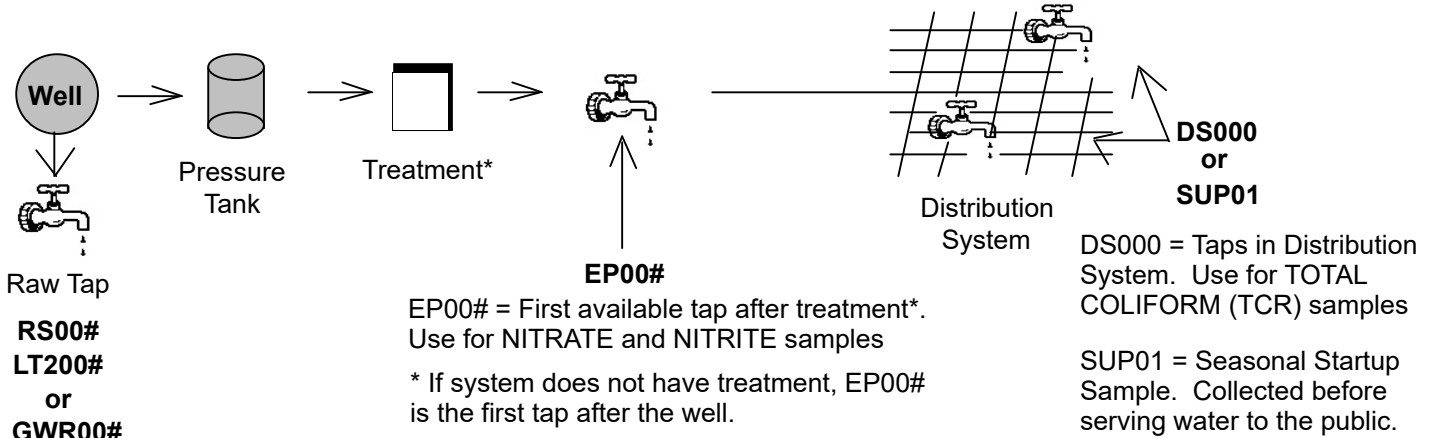

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5549612 GARBRY'S BIG WOODS RESERVE WETLAND PWS

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5556594 Facility Name: GARBRY'S BIG WOODS RES WETLAND

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

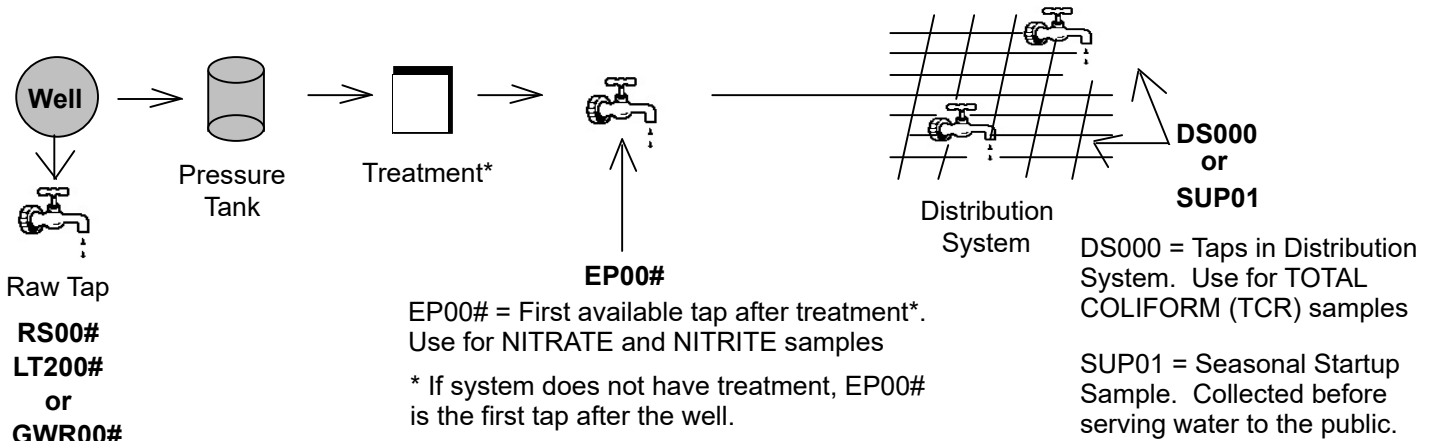

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5550112 BUDGETEL INN & SUITES-PIQUA

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **BUDGETEL INN & SUITES-PIQUA DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5550112 BUDGETEL INN & SUITES-PIQUA

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5556598 Facility Name: BUDGETEL INN & SUITES-PIQUA
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

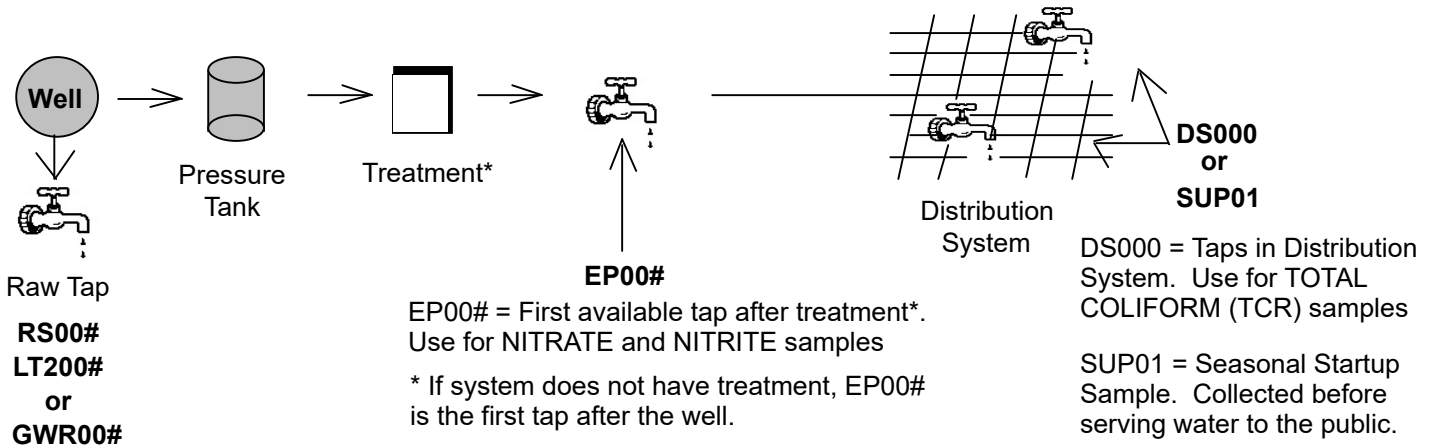

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5550212 KINGDOM HALL JEHOVAH WITNESS-HUBER

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: KINGDOM HALL JEH WITNESS DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

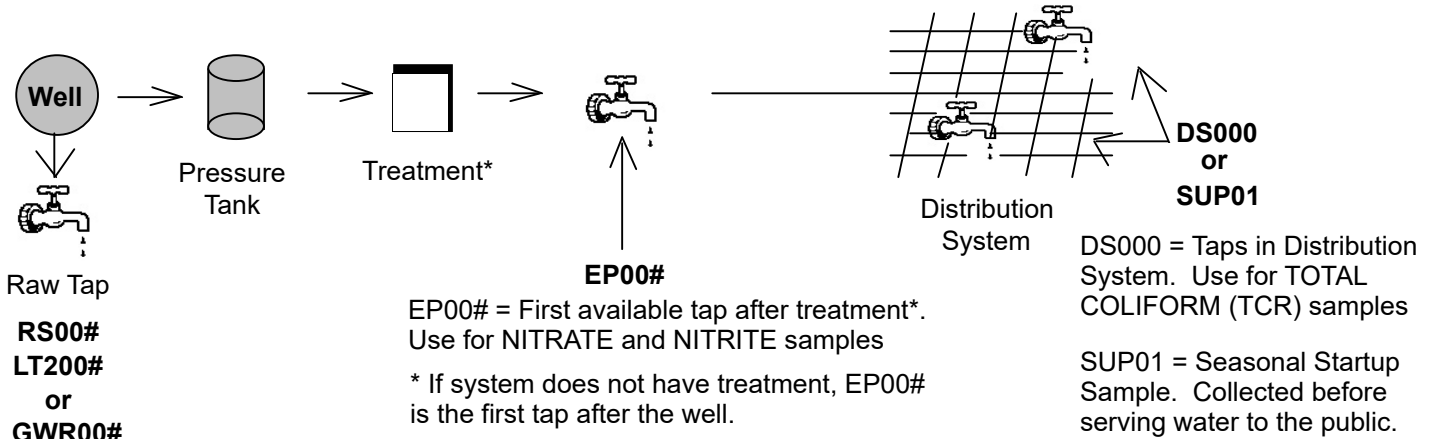

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5550212 KINGDOM HALL JEHOVAH WITNESS-HUBER

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5556599 Facility Name: KINGDOM HALL JEHOVAH WITNESSES
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5550312 WACO MUSEUM PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: WACO MUSEUM DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

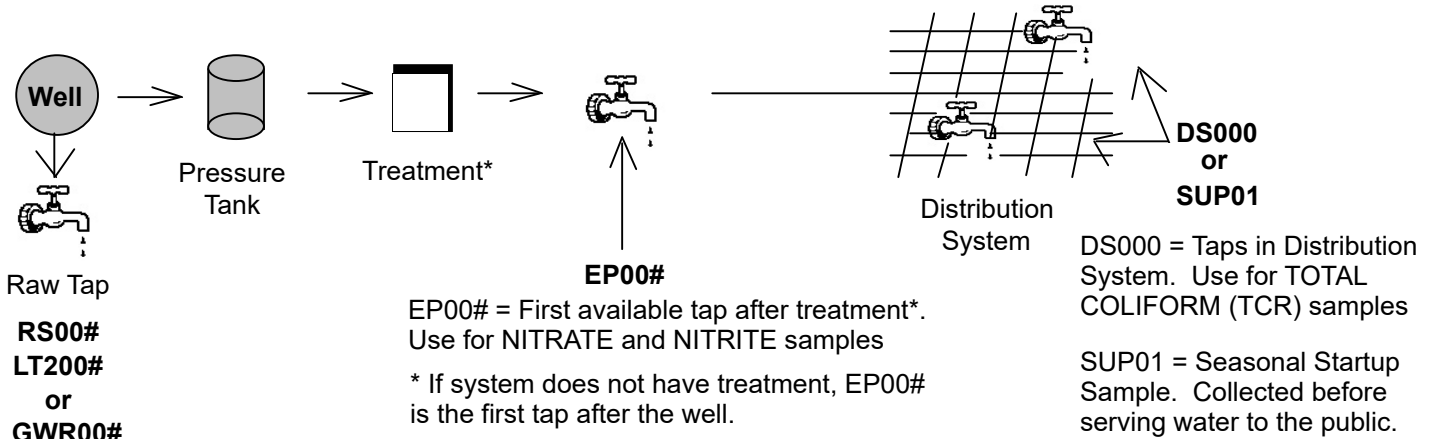

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5550312 WACO MUSEUM PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5561468 Facility Name: WACO MUSEUM
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

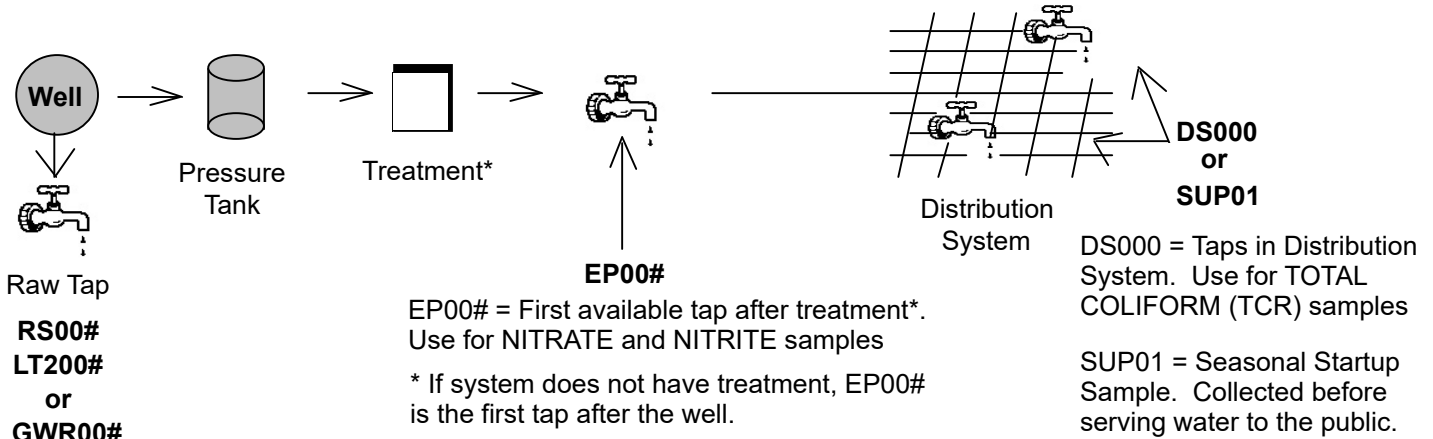

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5550512 FRIENDSHIP COMMUNITY CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: FRIENDSHIP COMMUNITY CHU DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5550512 FRIENDSHIP COMMUNITY CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5556600 Facility Name: FRIENDSHIP COMMUNITY CHURCH
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5551012 FULTON FARM PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: FULTON FARM DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

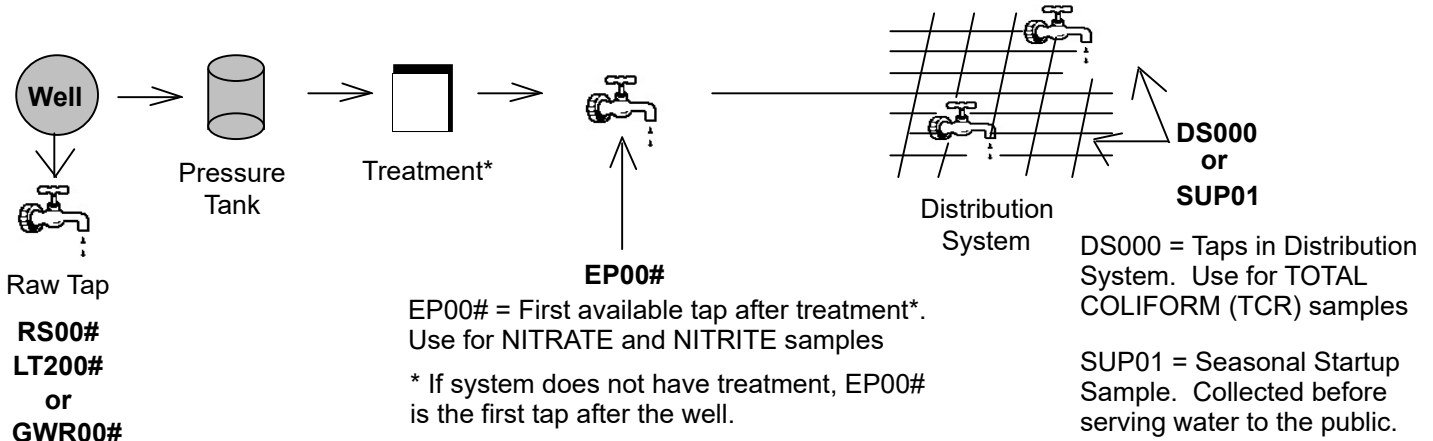

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5551012 FULTON FARM PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5560669 Facility Name: FULTON FARM

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

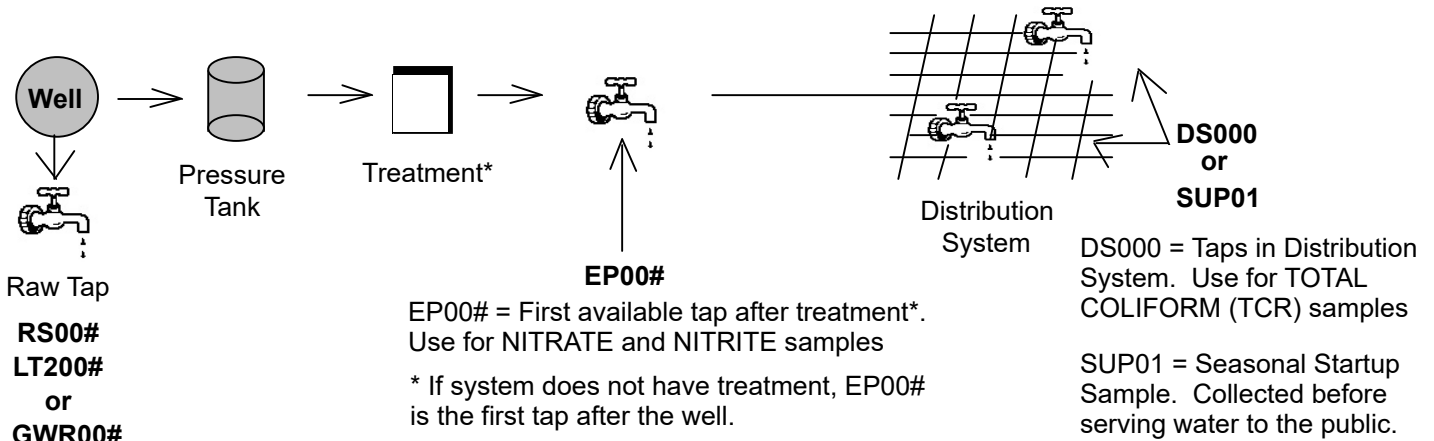

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5551212 HOMESTEAD GOLF COURSE RESTROOM PWS

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: HOMESTEAD GOLF COURSE RESTROOM DISTRIBUT
Location SMP ID: SUP01	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

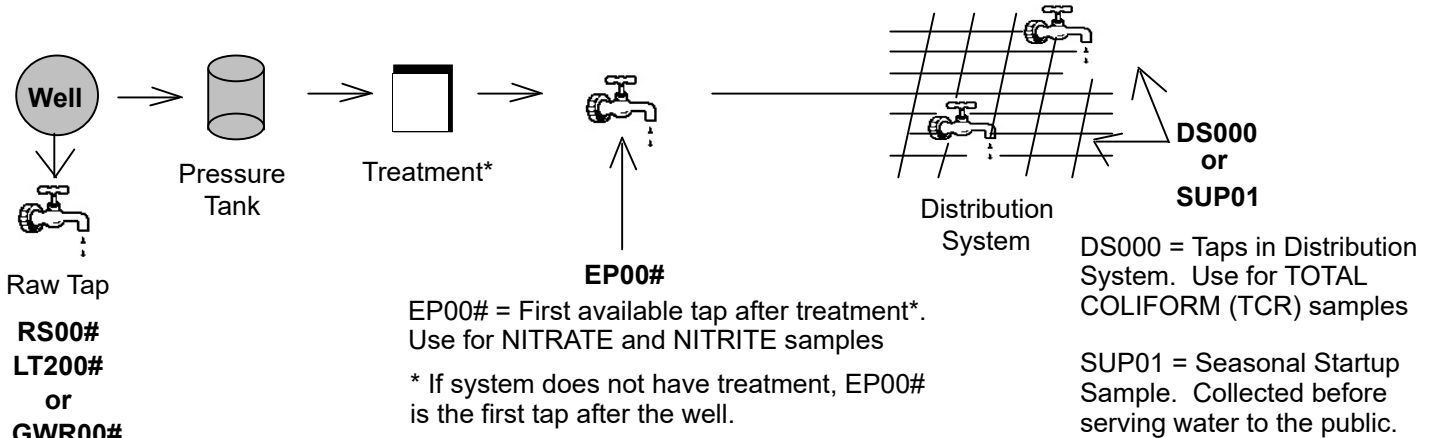

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5551212 HOMESTEAD GOLF COURSE RESTROOM PWS

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: HOMESTEAD GOLF COURSE RESTROOM DISTRIBUT
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018

Where to Collect Samples For a Small Public Water System

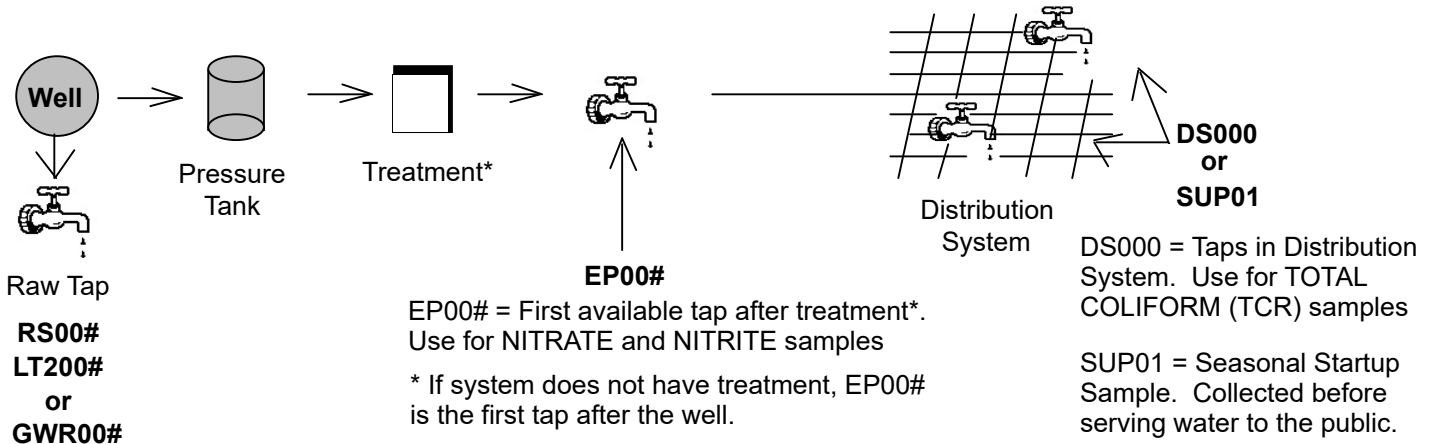

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5551212 HOMESTEAD GOLF COURSE RESTROOM PWS

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5560757 Facility Name: HOMESTEAD GOLF COURSE-RESTROOM

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

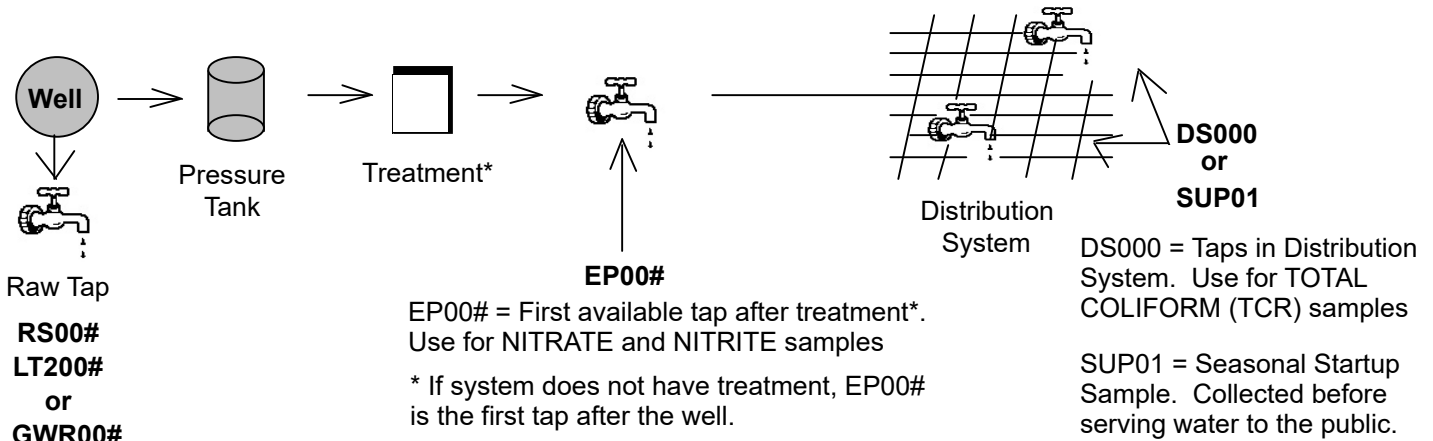

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5551512 KINGDOM HALL OF JEHOVAHS WITNESSES-TROY

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **KINGDOM HALL OF JEHOVAHS WITNESS DISTRIB**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5551512 KINGDOM HALL OF JEHOVAHS WITNESSES-TROY

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5561008	Facility Name: KINGDOM HALL OF JEHOVAHS WITNESSES CHURC
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5551612 OLD GERMAN BAPTIST BRETHERN CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: OLD GERMAN BAPTIST BRETHERN CHURCH DISTR
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5551612 OLD GERMAN BAPTIST BRETHERN CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5561027	Facility Name: OLD GERMAN BAPTIST BRETHERN CHURCH
Location SMP ID: EP001	Facility Source: Ground Water
	Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH5552112 FIRST BAPTIST CHURCH OF NEW CARLISLE-DAY

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5561449	Facility Name: FIRST BAPTIST CHURCH OF NEW CARLISLE-DAY	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2018 and 10/31/2018

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 6/1/2018 and 10/31/2018

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 Not Required

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2018 and 10/31/2018



Effective Date: 01/01/2018

2018 DISTRIBUTION SCHEDULE

OH5552112 FIRST BAPTIST CHURCH OF NEW CARLISLE-DAY

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: FIRST BAPTIST CHURCH OF NEW CARLISLE I
	SMP ID: DS000	

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2018	and	3/31/2018
	1 Sample(s) Required between	4/1/2018	and	6/30/2018
	1 Sample(s) Required between	7/1/2018	and	9/30/2018
	1 Sample(s) Required between	10/1/2018	and	12/31/2018

Sampling Location	Facility ID: DS1	Facility Name: FIRST BAPTIST CHURCH OF NEW CARLISLE I
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

OH5552312 CHARLESTON FALLS PRESERVE - RESTROOM PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CHARLESTON FALLS PRESERVE-RR DISTR
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

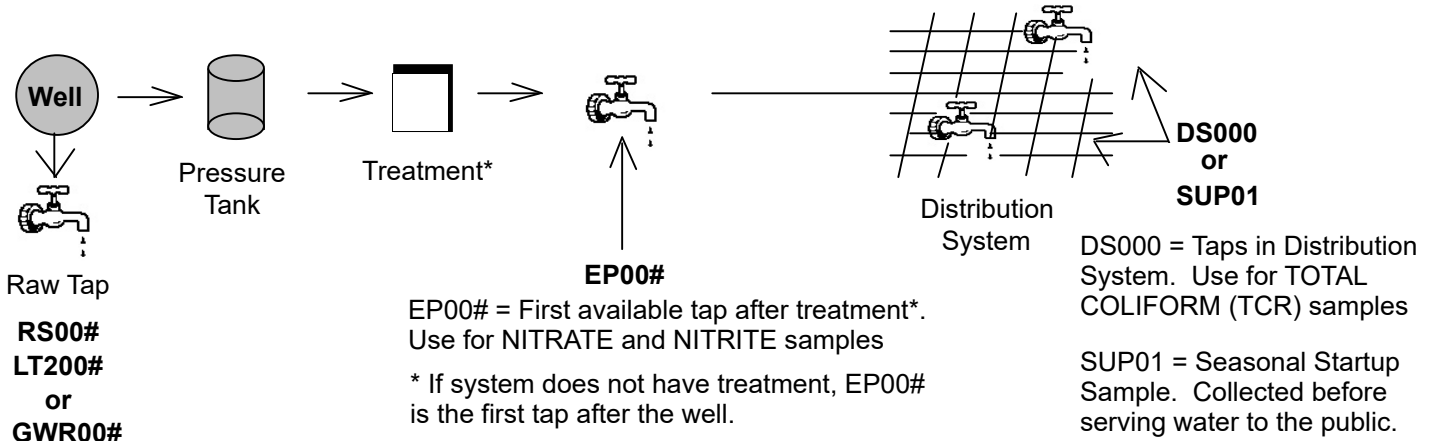

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5552312 CHARLESTON FALLS PRESERVE - RESTROOM PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5561557 Facility Name: CHARLESTON FALLS PRESERVE-RR
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5552412 PIQUA FISH AND GAME CLUB PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: PIQUA FISH & GAME CLUB DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5552412 PIQUA FISH AND GAME CLUB PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5561516 Facility Name: PIQUA FISH & GAME CLUB

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

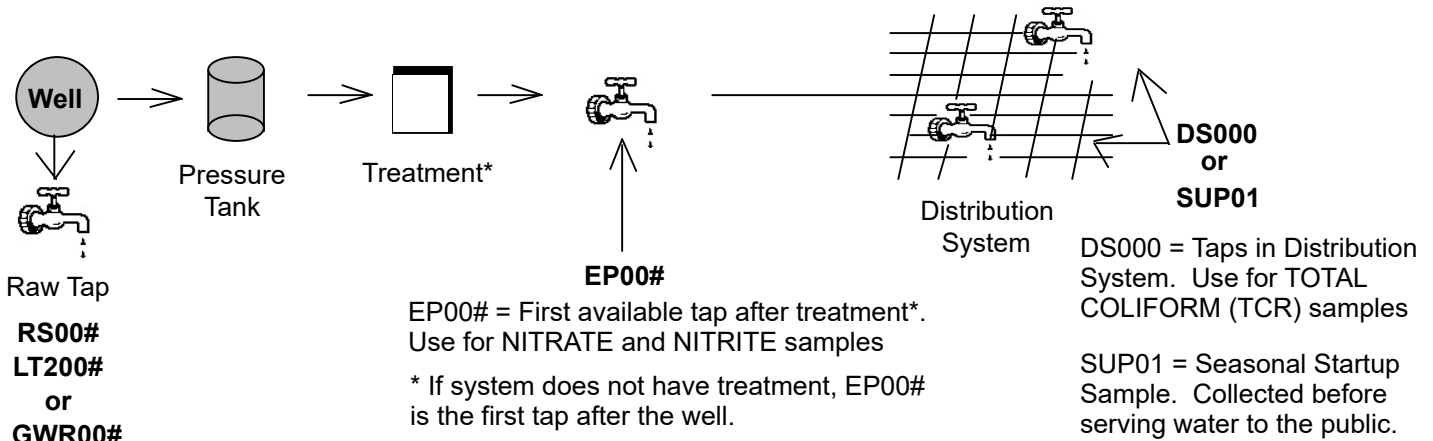

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5552612 HOLLY'S CAFE & CARRY OUT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **HOLLY'S CAFE & CARRY OUT DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5552612 HOLLY'S CAFE & CARRY OUT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5561639 Facility Name: HOLLY'S CAFE & CARRY OUT

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

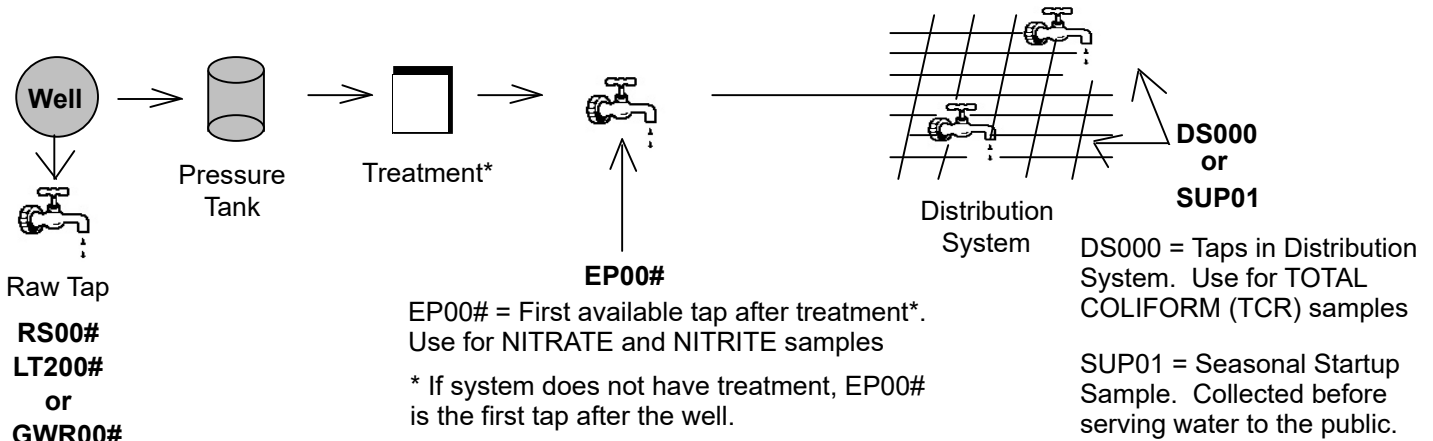

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5552712 STILLWATER COMMUNITY CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: STILLWATER COMMUNITY CHURCH DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

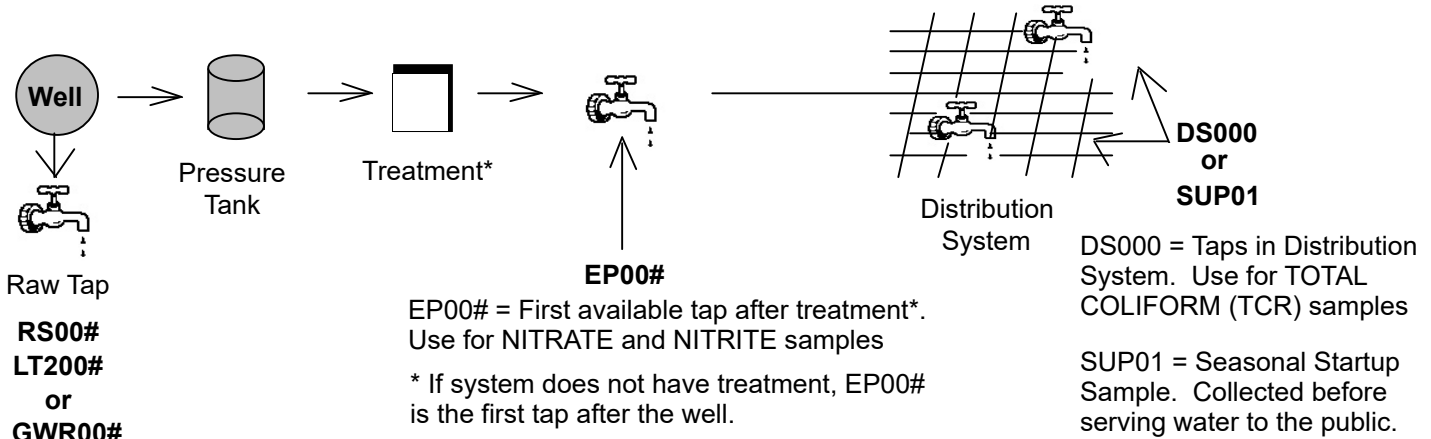

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5552712 STILLWATER COMMUNITY CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5561662 Facility Name: STILLWATER COMMUNITY CHURCH
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

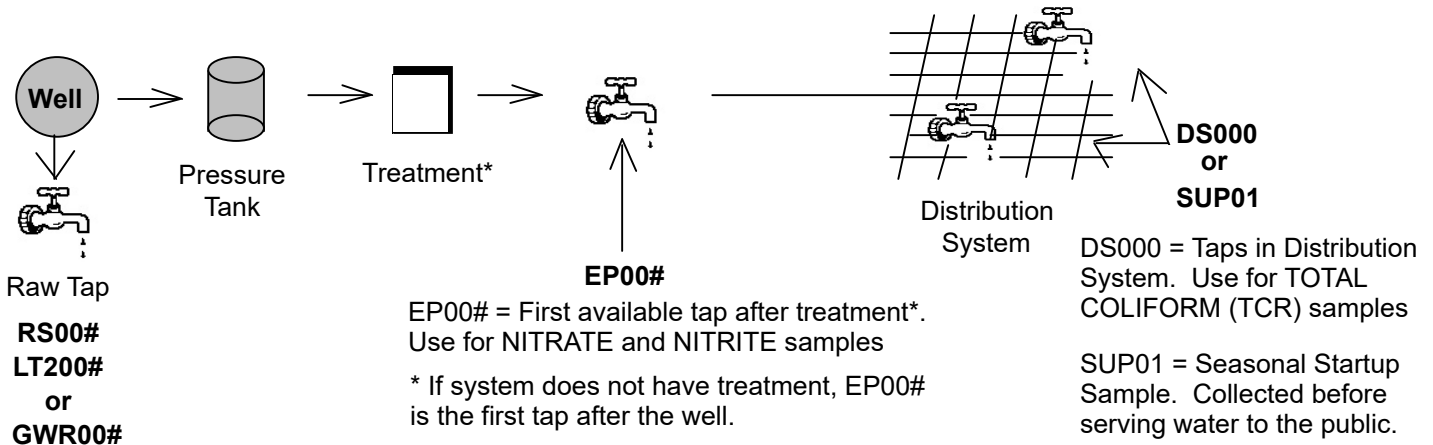

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH5553212 WEST CHARLESTON CHURCH OF THE BRETHREN

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5561880	Facility Name: WEST CHARLESTON CHURCH OF THE BRETHREN 2	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2018 and 10/31/2018

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 6/1/2018 and 10/31/2018

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 4/1/2018 and 6/30/2018

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 2 Not Required

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 3 1 Sample(s) Required between 4/1/2018 and 6/30/2018

Sample for all the analytes listed below:

BHC-GAMMA (LINDANE) - 2010 DIQUAT - 2032 GLYPHOSATE - 2034
METHOXYCHLOR - 2015 POLYCHLORINATED BIPHENYLS (PCB) - 2383

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 4 Not Required

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2018 and 10/31/2018



OH5553212 WEST CHARLESTON CHURCH OF THE BRETHREN

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: WEST CHARLESTON CHURCH OF THE BRETH
--------------------------	---	---

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: WEST CHARLESTON CHURCH OF THE BRETH Refer to your Lead and Copper plan for SMP IDs
--------------------------	---	--

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH5553312 AILERON

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: AILERON
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5553312 AILERON

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5561888 Facility Name: AILERON TREATMENT PLANT
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

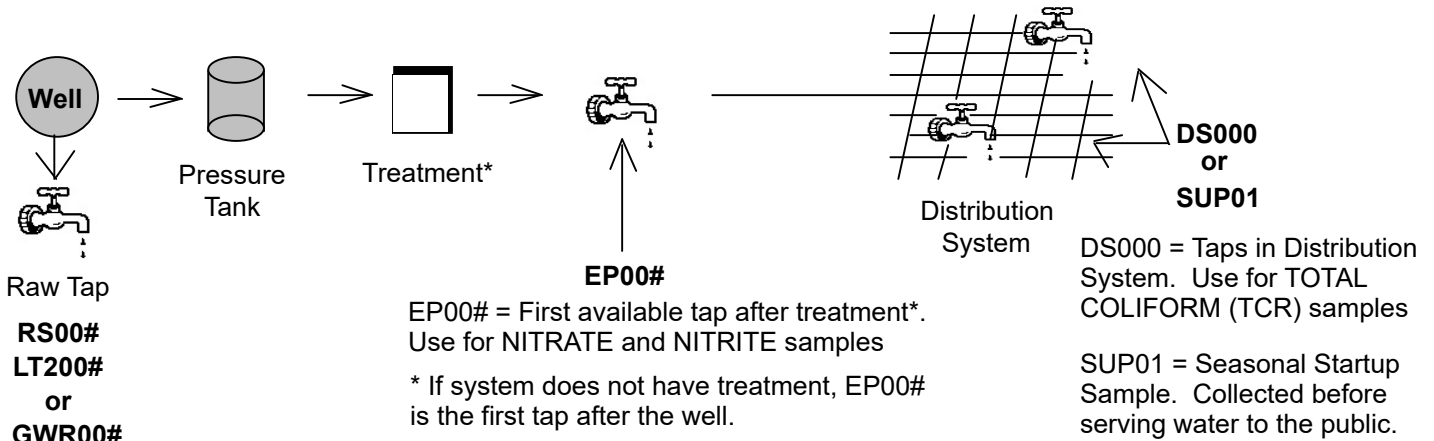

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5553412 VFW 6557 PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: VFW 6557 DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

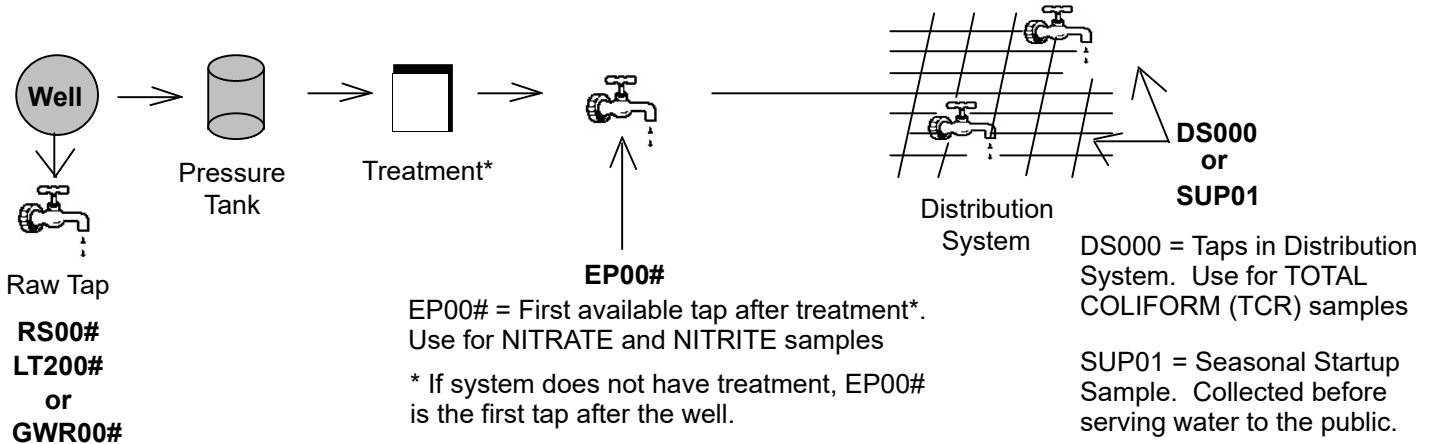

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5553412 VFW 6557 PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5561942 Facility Name: VFW 6557
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

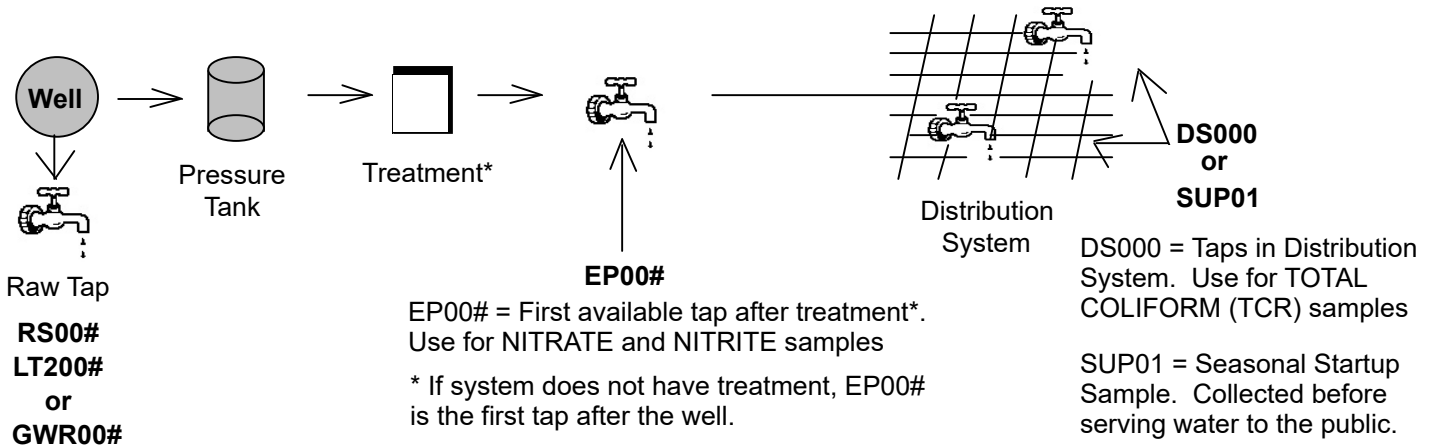

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH5553612 NAWA

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5562098	Facility Name: NAWA	Facility Class: CLASS 3
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020	
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2018 and 10/31/2018



OH5553612 NAWA

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: NAWA DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	25 Sample(s) Required between	1/1/2018 and 1/31/2018
	25 Sample(s) Required between	2/1/2018 and 2/28/2018
	25 Sample(s) Required between	3/1/2018 and 3/31/2018
	25 Sample(s) Required between	4/1/2018 and 4/30/2018
	25 Sample(s) Required between	5/1/2018 and 5/31/2018
	25 Sample(s) Required between	6/1/2018 and 6/30/2018
	25 Sample(s) Required between	7/1/2018 and 7/31/2018
	25 Sample(s) Required between	8/1/2018 and 8/31/2018
	25 Sample(s) Required between	9/1/2018 and 9/30/2018
	25 Sample(s) Required between	10/1/2018 and 10/31/2018
	25 Sample(s) Required between	11/1/2018 and 11/30/2018
	25 Sample(s) Required between	12/1/2018 and 12/31/2018

TOTAL CHLORINE - 1000	25 Sample(s) Required between	1/1/2018 and 1/31/2018
	25 Sample(s) Required between	2/1/2018 and 2/28/2018
	25 Sample(s) Required between	3/1/2018 and 3/31/2018
	25 Sample(s) Required between	4/1/2018 and 4/30/2018
	25 Sample(s) Required between	5/1/2018 and 5/31/2018
	25 Sample(s) Required between	6/1/2018 and 6/30/2018
	25 Sample(s) Required between	7/1/2018 and 7/31/2018
	25 Sample(s) Required between	8/1/2018 and 8/31/2018
	25 Sample(s) Required between	9/1/2018 and 9/30/2018
	25 Sample(s) Required between	10/1/2018 and 10/31/2018
	25 Sample(s) Required between	11/1/2018 and 11/30/2018
	25 Sample(s) Required between	12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: NAWA DISTRIBUTION 4671 POPLAR CREEK VANDALIA	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH5553612 NAWA

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: NAWA DISTRIBUTION	Facility Class: CLASS 1
	SMP ID: DS202	3060 S. CO. RD. 25A TIPP CITY	

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS202
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1	Facility Name: NAWA DISTRIBUTION	Facility Class: CLASS 1
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs	

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------



OH5553614 MONROE TOWNSHIP WATER & SEWER DIST PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: DISTRIBUTION DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 7/1/2018 and 12/31/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.