



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

**OH5800112 CHESTERHILL VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>5856720</b>	Facility Name: <b>CHESTERHILL VILLAGE</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

<b>Chemicals</b>	<b>Monitoring Requirements</b>	
INORGANICS	1 Sample(s) Required between	6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020		
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085		
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between	6/1/2018 and 10/31/2018
RADIOLOGICALS	1 Sample(s) Required between	6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>		
GROSS ALPHA - 4002 RADIUM-228 - 4030		
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	6/1/2018 and 10/31/2018



**OH5800112 CHESTERHILL VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>CHESTERHILL, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	-------------------------------------------------	------------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>CHESTERHILL, VILLAGE OF DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	-------------------------------------------------	----------------------------------------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018at: DS201
-------------------------	--------------------------------------------------------------

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH5800112 CHESTERHILL VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>CHESTERHILL, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>DS202</b>	<b>ADDRESS NOT KNOWN</b>	

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2018 and 9/30/2018at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>CHESTERHILL, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>LC###</b>	<b>Refer to your Lead and Copper plan for SMP IDs</b>	

**Chemicals Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 Not Required

**OH5800212 RIVERS EDGE OF MALTA**

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> RIVERS EDGE OF MALTA DISTRIBUTION
<b>Location SMP ID:</b> SUP01	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5800212 RIVERS EDGE OF MALTA**

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> RIVERS EDGE OF MALTA DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018

**Where to Collect Samples For a Small Public Water System**

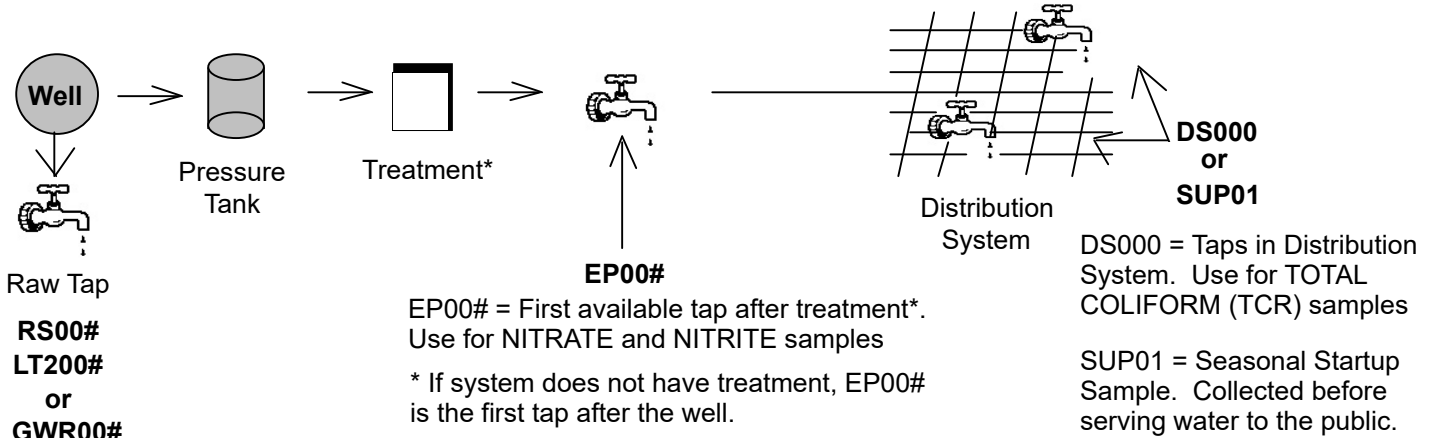

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5800212 RIVERS EDGE OF MALTA**

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5856721 Facility Name: RIVERS EDGE OF MALTA**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

**OH5800412 MALTA VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>5856722</b> SMP ID: <b>EP001</b>	Facility Name: <b>MALTA WTP</b> Facility Source: <b>Ground Water</b>	Facility Class: <b>CLASS 1</b>
--------------------------	-----------------------------------------------------	-------------------------------------------------------------------------	--------------------------------

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2018 and 10/31/2018



**OH5800412 MALTA VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>MALTA, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	-------------------------------------------------	------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>MALTA, VILLAGE OF DISTRIBUTION</b> <b>149 SOUTH MAIN STREET</b>	Facility Class: <b>CLASS 1</b>
--------------------------	-------------------------------------------------	--------------------------------------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018at: DS201
-------------------------	--------------------------------------------------------------

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950





Effective Date: 06/15/2018

2018 DISTRIBUTION SCHEDULE

**OH5800412 MALTA VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>MALTA, VILLAGE OF DISTRIBUTION</b> <b>260 FRONT STREET</b>	Facility Class: <b>CLASS 1</b>
--------------------------	-------------------------------------------------	---------------------------------------------------------------------------------	--------------------------------

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2018 and 9/30/2018at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>LC###</b>	Facility Name: <b>MALTA, VILLAGE OF DISTRIBUTION</b> <b>Refer to your Lead and Copper plan for SMP IDs</b>	Facility Class: <b>CLASS 1</b>
--------------------------	-------------------------------------------------	---------------------------------------------------------------------------------------------------------------	--------------------------------

**Chemicals Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2018 and 9/30/2018

*Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.*



OH5800512 MCCONNELSVILLE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>MCCONNELSVILLE, VILLAGE DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	-------------------------------------------------	------------------------------------------------------------	--------------------------------

Chemicals Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between	1/1/2018 and	1/31/2018
	2 Sample(s) Required between	2/1/2018 and	2/28/2018
	2 Sample(s) Required between	3/1/2018 and	3/31/2018
	2 Sample(s) Required between	4/1/2018 and	4/30/2018
	2 Sample(s) Required between	5/1/2018 and	5/31/2018
	2 Sample(s) Required between	6/1/2018 and	6/30/2018
	2 Sample(s) Required between	7/1/2018 and	7/31/2018
	2 Sample(s) Required between	8/1/2018 and	8/31/2018
	2 Sample(s) Required between	9/1/2018 and	9/30/2018
	2 Sample(s) Required between	10/1/2018 and	10/31/2018
	2 Sample(s) Required between	11/1/2018 and	11/30/2018
	2 Sample(s) Required between	12/1/2018 and	12/31/2018

TOTAL CHLORINE - 1000	2 Sample(s) Required between	1/1/2018 and	1/31/2018
	2 Sample(s) Required between	2/1/2018 and	2/28/2018
	2 Sample(s) Required between	3/1/2018 and	3/31/2018
	2 Sample(s) Required between	4/1/2018 and	4/30/2018
	2 Sample(s) Required between	5/1/2018 and	5/31/2018
	2 Sample(s) Required between	6/1/2018 and	6/30/2018
	2 Sample(s) Required between	7/1/2018 and	7/31/2018
	2 Sample(s) Required between	8/1/2018 and	8/31/2018
	2 Sample(s) Required between	9/1/2018 and	9/30/2018
	2 Sample(s) Required between	10/1/2018 and	10/31/2018
	2 Sample(s) Required between	11/1/2018 and	11/30/2018
	2 Sample(s) Required between	12/1/2018 and	12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>MCCONNELSVILLE, VILLAGE DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	-------------------------------------------------	----------------------------------------------------------------------------------------	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS	Dual Sample Required between	7/1/2018 and	9/30/2018	at: DS201
-------------------------	------------------------------	--------------	-----------	-----------

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH5800512 MCCONNELSVILLE VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>MCCONNELSVILLE, VILLAGE DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>DS202</b>	<b>ADDRESS NOT KNOWN</b>	

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2018 and 9/30/2018at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>MCCONNELSVILLE, VILLAGE DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>LC###</b>	<b>Refer to your Lead and Copper plan for SMP IDs</b>	

**Chemicals Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2018 and 9/30/2018

*Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.*



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH5800712 WOODLAND HILLS ESTATES II

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>5856724</b>	Facility Name: <b>WOODLAND HILLS ESTATES</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020	
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**OH5800712 WOODLAND HILLS ESTATES II**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>WOODLAND HILLS ESTATES DISTRIBUTION</b>
	SMP ID: <b>DS000</b>	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>WOODLAND HILLS ESTATES DISTRIBUTION</b>
	SMP ID: <b>DS201</b>	<b>ADDRESS NOT KNOWN</b>

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2018

2018 DISTRIBUTION SCHEDULE

**OH5800712 WOODLAND HILLS ESTATES II**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>WOODLAND HILLS ESTATES DISTRIBUTION</b>
<b>Location</b>	SMP ID: <b>LC###</b>	<b>Refer to your Lead and Copper plan for SMP IDs</b>

**Chemicals Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2018 and 9/30/2018

*Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.*



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

**OH5800912 STOCKPORT VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>5856725</b>	Facility Name: <b>STOCKPORT VILLAGE</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020	
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 7/1/2018 and 9/30/2018



OH5800912 STOCKPORT VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>STOCKPORT, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	-------------------------------------------------	----------------------------------------------------------	--------------------------------

Chemicals Monitoring Requirements

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2018 and	1/31/2018
	1 Sample(s) Required between	2/1/2018 and	2/28/2018
	1 Sample(s) Required between	3/1/2018 and	3/31/2018
	1 Sample(s) Required between	4/1/2018 and	4/30/2018
	1 Sample(s) Required between	5/1/2018 and	5/31/2018
	1 Sample(s) Required between	6/1/2018 and	6/30/2018
	1 Sample(s) Required between	7/1/2018 and	7/31/2018
	1 Sample(s) Required between	8/1/2018 and	8/31/2018
	1 Sample(s) Required between	9/1/2018 and	9/30/2018
	1 Sample(s) Required between	10/1/2018 and	10/31/2018
	1 Sample(s) Required between	11/1/2018 and	11/30/2018
	1 Sample(s) Required between	12/1/2018 and	12/31/2018

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2018 and	1/31/2018
	1 Sample(s) Required between	2/1/2018 and	2/28/2018
	1 Sample(s) Required between	3/1/2018 and	3/31/2018
	1 Sample(s) Required between	4/1/2018 and	4/30/2018
	1 Sample(s) Required between	5/1/2018 and	5/31/2018
	1 Sample(s) Required between	6/1/2018 and	6/30/2018
	1 Sample(s) Required between	7/1/2018 and	7/31/2018
	1 Sample(s) Required between	8/1/2018 and	8/31/2018
	1 Sample(s) Required between	9/1/2018 and	9/30/2018
	1 Sample(s) Required between	10/1/2018 and	10/31/2018
	1 Sample(s) Required between	11/1/2018 and	11/30/2018
	1 Sample(s) Required between	12/1/2018 and	12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>STOCKPORT, VILLAGE OF DISTRIBUTION</b> <b>2771 SOUTH RIVERVIEW RD.</b>	Facility Class: <b>CLASS 1</b>
--------------------------	-------------------------------------------------	---------------------------------------------------------------------------------------------	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2018 and 9/30/2018at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950





Effective Date: 06/15/2018

2018 DISTRIBUTION SCHEDULE

OH5800912 STOCKPORT VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>STOCKPORT, VILLAGE OF DISTRIBUTION</b> <b>1850 ROSEWOOD STREET</b>	Facility Class: <b>CLASS 1</b>
--------------------------	-------------------------------------------------	-----------------------------------------------------------------------------------------	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2018 and 9/30/2018at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>LC###</b>	Facility Name: <b>STOCKPORT, VILLAGE OF DISTRIBUTION</b> <b>Refer to your Lead and Copper plan for SMP IDs</b>	Facility Class: <b>CLASS 1</b>
--------------------------	-------------------------------------------------	-------------------------------------------------------------------------------------------------------------------	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx. For questions contact your Ohio EPA District Office representative.



**OH5801003 MORGAN MEIGSVILLE RURAL**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Location** Facility ID: **DS1** Facility Name: **MORGAN MEIGSVILLE RURAL DISTRIBUTION** Facility Class: **CLASS 1**  
SMP ID: **DS000**

**Chemicals**

**Monitoring Requirements**

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2018	and	1/31/2018
	1 Sample(s) Required between	2/1/2018	and	2/28/2018
	1 Sample(s) Required between	3/1/2018	and	3/31/2018
	1 Sample(s) Required between	4/1/2018	and	4/30/2018
	1 Sample(s) Required between	5/1/2018	and	5/31/2018
	1 Sample(s) Required between	6/1/2018	and	6/30/2018
	1 Sample(s) Required between	7/1/2018	and	7/31/2018
	1 Sample(s) Required between	8/1/2018	and	8/31/2018
	1 Sample(s) Required between	9/1/2018	and	9/30/2018
	1 Sample(s) Required between	10/1/2018	and	10/31/2018
	1 Sample(s) Required between	11/1/2018	and	11/30/2018
	1 Sample(s) Required between	12/1/2018	and	12/31/2018

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2018	and	1/31/2018
	1 Sample(s) Required between	2/1/2018	and	2/28/2018
	1 Sample(s) Required between	3/1/2018	and	3/31/2018
	1 Sample(s) Required between	4/1/2018	and	4/30/2018
	1 Sample(s) Required between	5/1/2018	and	5/31/2018
	1 Sample(s) Required between	6/1/2018	and	6/30/2018
	1 Sample(s) Required between	7/1/2018	and	7/31/2018
	1 Sample(s) Required between	8/1/2018	and	8/31/2018
	1 Sample(s) Required between	9/1/2018	and	9/30/2018
	1 Sample(s) Required between	10/1/2018	and	10/31/2018
	1 Sample(s) Required between	11/1/2018	and	11/30/2018
	1 Sample(s) Required between	12/1/2018	and	12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

**Sampling Location** Facility ID: **DS1** Facility Name: **MORGAN MEIGSVILLE RURAL DISTRIBUTION** Facility Class: **CLASS 1**  
SMP ID: **DS201** ADDRESS NOT KNOWN

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between	7/1/2018	and	9/30/2018	at: DS201
-------------------------	------------------------------	----------	-----	-----------	-----------

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH5801003 MORGAN MEIGSVILLE RURAL**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>MORGAN MEIGSVILLE RURAL DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>DS202</b>	<b>ADDRESS NOT KNOWN</b>	

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018at: DS202
-------------------------	--------------------------------------------------------------

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>MORGAN MEIGSVILLE RURAL DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>LC###</b>	<b>Refer to your Lead and Copper plan for SMP IDs</b>	

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------



OH5801103 MORGAN MEIGSVILLE - WEST MALTA PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Table with 4 columns: Sampling Location, Facility ID, Facility Name, Facility Class. Values: DS1, MORGAN MEIGSVILLE - WEST MALTA DIST, CLASS 1, DS000.

Chemicals Monitoring Requirements

Table for TOTAL COLIFORM (TCR) - 3100. Columns: Chemicals, Monitoring Requirements. Lists 12 monthly sampling requirements from 1/1/2018 to 12/31/2018.

Table for TOTAL CHLORINE - 1000. Columns: Chemicals, Monitoring Requirements. Lists 12 monthly sampling requirements from 1/1/2018 to 12/31/2018.

Samples should be collected at the same time and place as the Total Coliform samples.

Table with 4 columns: Sampling Location, Facility ID, Facility Name, Facility Class. Values: DS201, MORGAN MEIGSVILLE - WEST MALTA DIST, CLASS 1, ADDRESS NOT KNOWN.

Chemicals Monitoring Requirements

Table for DISINFECTION BYPRODUCTS. Columns: Chemicals, Monitoring Requirements. Value: Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



**OH5801103 MORGAN MEIGSVILLE - WEST MALTA PWS**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>MORGAN MEIGSVILLE - WEST MALTA DIST</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	-------------------------------------------------	---------------------------------------------------------------------------------------	--------------------------------

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2018 and 9/30/2018at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>LC###</b>	Facility Name: <b>MORGAN MEIGSVILLE - WEST MALTA DIST</b> <b>Refer to your Lead and Copper plan for SMP IDs</b>	Facility Class: <b>CLASS 1</b>
--------------------------	-------------------------------------------------	--------------------------------------------------------------------------------------------------------------------	--------------------------------

**Chemicals Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2018 and 9/30/2018

*Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.*



**OH5801203 MORGAN MEIGSVILLE - SR 376 PWS**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Location** Facility ID: **DS1** Facility Name: **MORGAN MEIGSVILLE - SR 376 DISTRIBUTION**  
SMP ID: **DS000**

**Chemicals**

**Monitoring Requirements**

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2018	and	1/31/2018
	1 Sample(s) Required between	2/1/2018	and	2/28/2018
	1 Sample(s) Required between	3/1/2018	and	3/31/2018
	1 Sample(s) Required between	4/1/2018	and	4/30/2018
	1 Sample(s) Required between	5/1/2018	and	5/31/2018
	1 Sample(s) Required between	6/1/2018	and	6/30/2018
	1 Sample(s) Required between	7/1/2018	and	7/31/2018
	1 Sample(s) Required between	8/1/2018	and	8/31/2018
	1 Sample(s) Required between	9/1/2018	and	9/30/2018
	1 Sample(s) Required between	10/1/2018	and	10/31/2018
	1 Sample(s) Required between	11/1/2018	and	11/30/2018
	1 Sample(s) Required between	12/1/2018	and	12/31/2018

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2018	and	1/31/2018
	1 Sample(s) Required between	2/1/2018	and	2/28/2018
	1 Sample(s) Required between	3/1/2018	and	3/31/2018
	1 Sample(s) Required between	4/1/2018	and	4/30/2018
	1 Sample(s) Required between	5/1/2018	and	5/31/2018
	1 Sample(s) Required between	6/1/2018	and	6/30/2018
	1 Sample(s) Required between	7/1/2018	and	7/31/2018
	1 Sample(s) Required between	8/1/2018	and	8/31/2018
	1 Sample(s) Required between	9/1/2018	and	9/30/2018
	1 Sample(s) Required between	10/1/2018	and	10/31/2018
	1 Sample(s) Required between	11/1/2018	and	11/30/2018
	1 Sample(s) Required between	12/1/2018	and	12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

**Sampling Location** Facility ID: **DS1** Facility Name: **MORGAN MEIGSVILLE - SR 376 DISTRIBUTION**  
SMP ID: **DS201** ADDRESS NOT KNOWN

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between	7/1/2018	and	9/30/2018	at: DS201
-------------------------	------------------------------	----------	-----	-----------	-----------

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH5830312 MOOSE LODGE**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1 Facility Name: MOOSE LODGE DISTRIBUTION**  
**Location SMP ID: DS000 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

**Where to Collect Samples For a Small Public Water System**

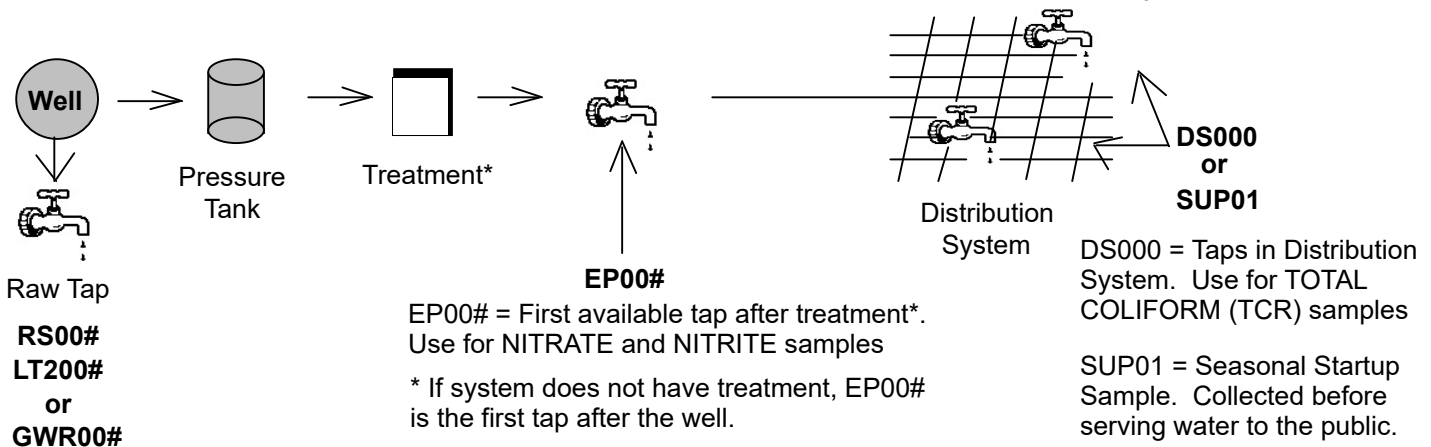

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH5830312 MOOSE LODGE**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5856728 Facility Name: MOOSE LODGE**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH5831112 MIBA BEARINGS US LLC

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>5856730</b>	Facility Name: <b>MIBA BEARINGS US LLC</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2018 and 10/31/2018

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 6/1/2018 and 10/31/2018

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 Not Required

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2018 and 10/31/2018



**OH5831112 MIBA BEARINGS US LLC**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>MIBA BEARINGS US LLC DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	-------------------------------------------------	---------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>LC###</b>	Facility Name: <b>MIBA BEARINGS US LLC DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
<b>Refer to your Lead and Copper plan for SMP IDs</b>			

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2018 and 9/30/2018

*Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.*

**OH5831212 OHIO POWER/HOOK LAKE-A1**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **OHIO POWER/HOOK LAKE-A1 DISTRIBUTION**  
**Location** SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5831212 OHIO POWER/HOOK LAKE-A1**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5856731 Facility Name: OHIO POWER HOOK LAKE A1**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5831312 OHIO POWER/HOOK LAKE-A3**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **OHIO POWER/HOOK LAKE-A3 DISTRIBUTION**  
**Location** SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**

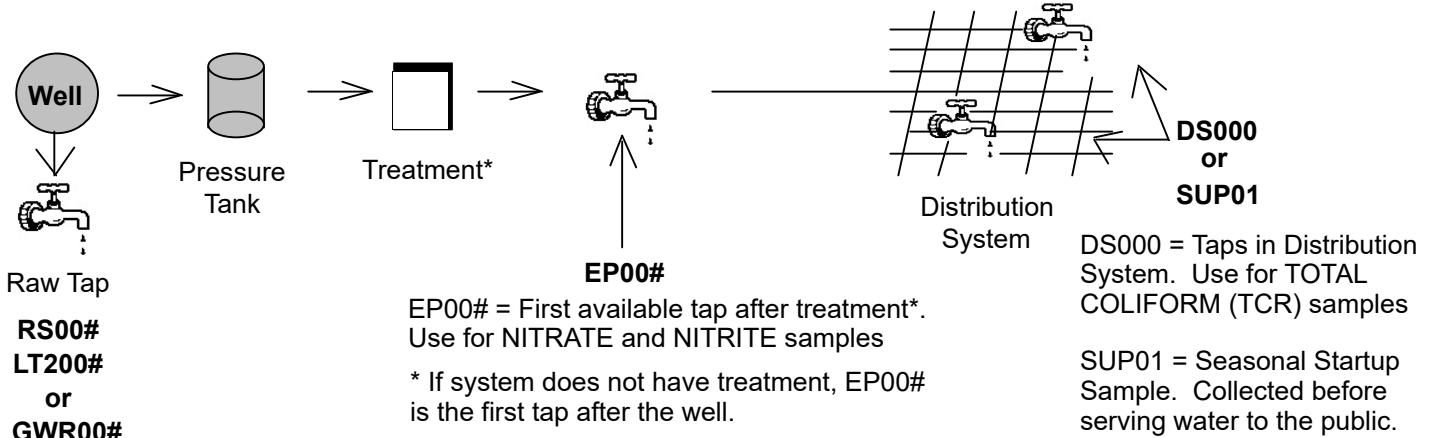

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5831312 OHIO POWER/HOOK LAKE-A3**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> OHIO POWER/HOOK LAKE-A3 DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018

**Where to Collect Samples For a Small Public Water System**

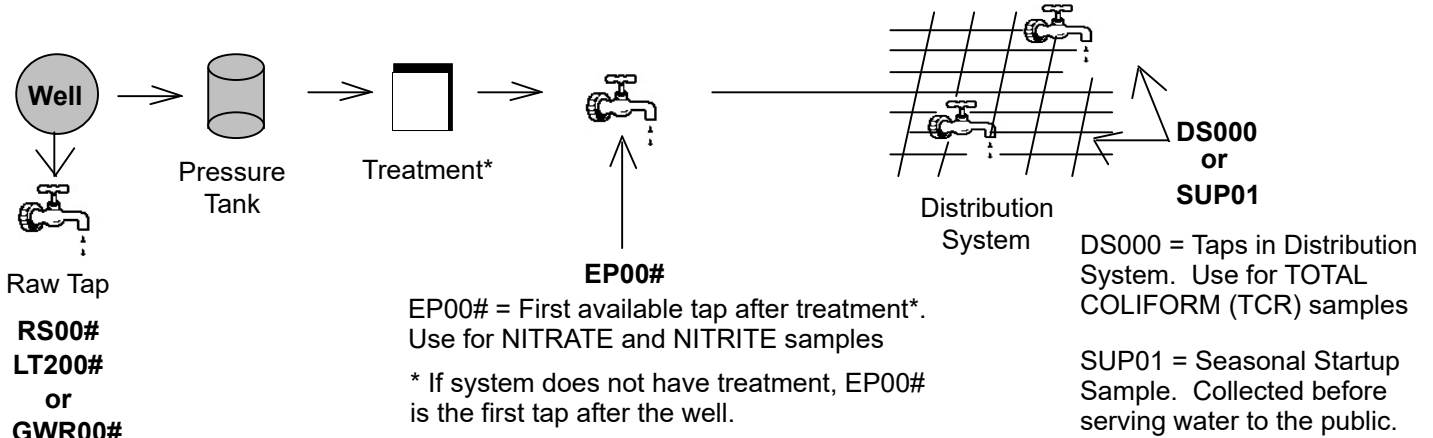

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5831312 OHIO POWER/HOOK LAKE-A3**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5856732 Facility Name: OHIO POWER HOOK LAKE A3**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH5832912 OHIO POWER/SAND HOLLOW-C1**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> OHIO POWER/SAND HOLLOW-C DISTRIBUTION
<b>Location SMP ID:</b> SUP01	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**

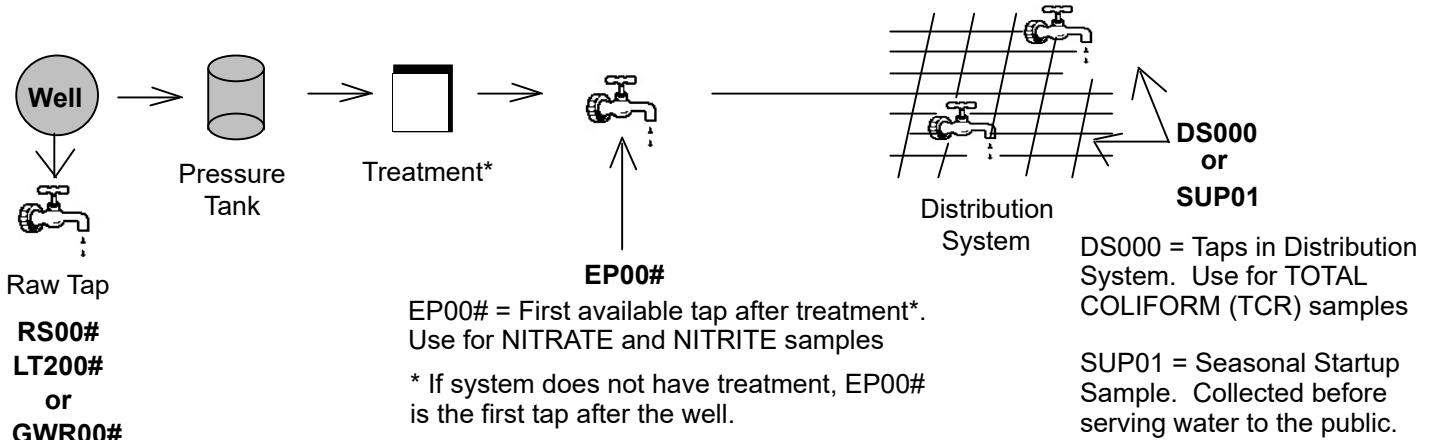

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5832912 OHIO POWER/SAND HOLLOW-C1**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5856740 Facility Name: OHIO POWER SAND HOLLOW C1**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**

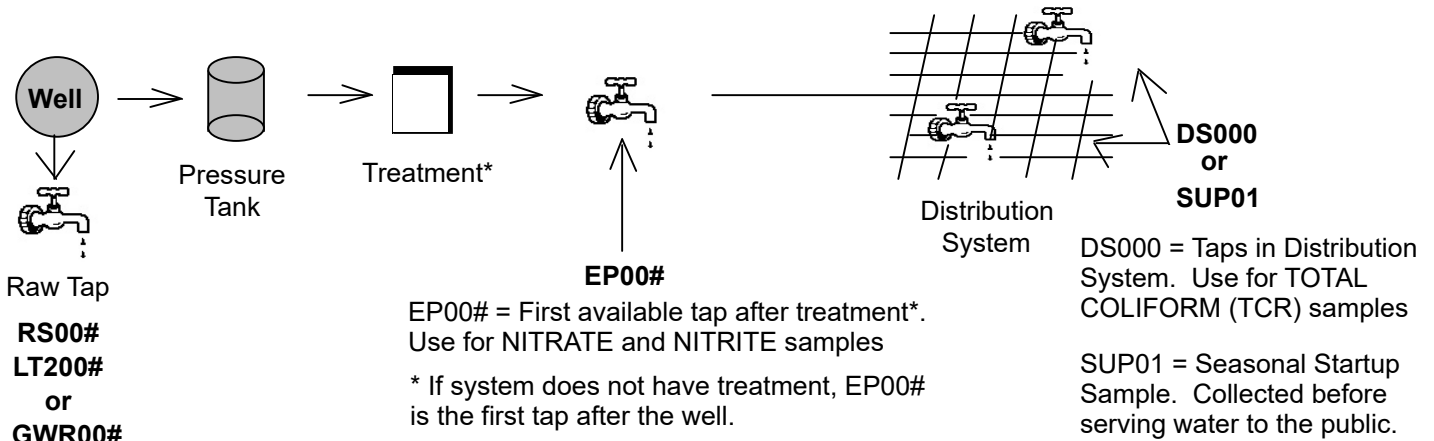

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5833112 OHIO POWER/SAND HOLLOW-C3**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **OHIO POWER/SAND HOLLOW-C DISTRIBUTION**  
**Location** SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5833112 OHIO POWER/SAND HOLLOW-C3**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5856742 Facility Name: OHIO POWER SAND HOLLOW C3**

**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**

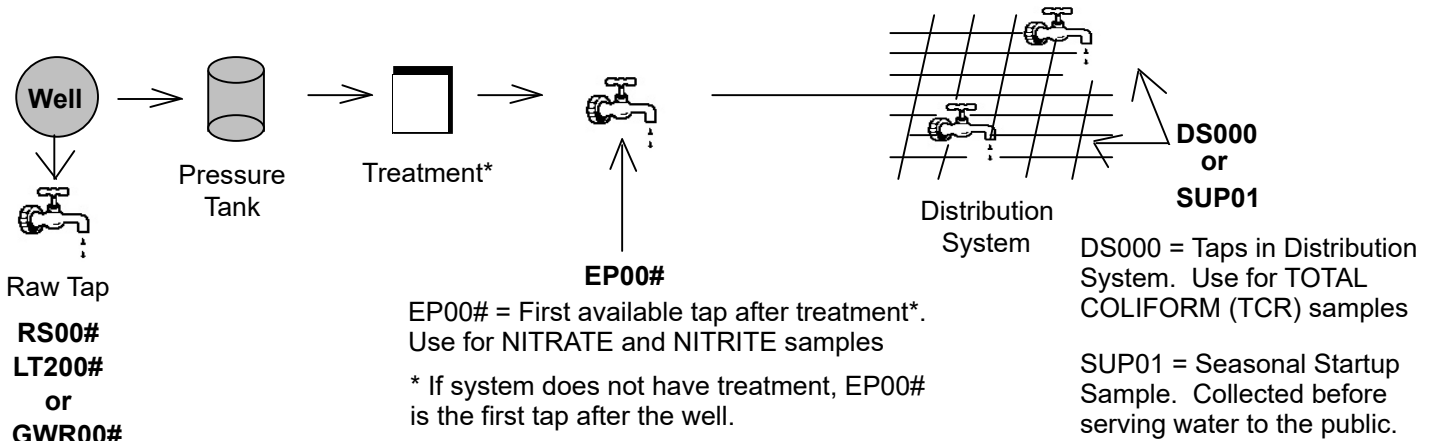

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5833312 OHIO POWER/SAWMILL-D1**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **OHIO POWER/SAWMILL-D1 DISTRIBUTION**  
**Location** SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5833312 OHIO POWER/SAWMILL-D1**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> OHIO POWER/SAWMILL-D1 DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018

**Where to Collect Samples For a Small Public Water System**

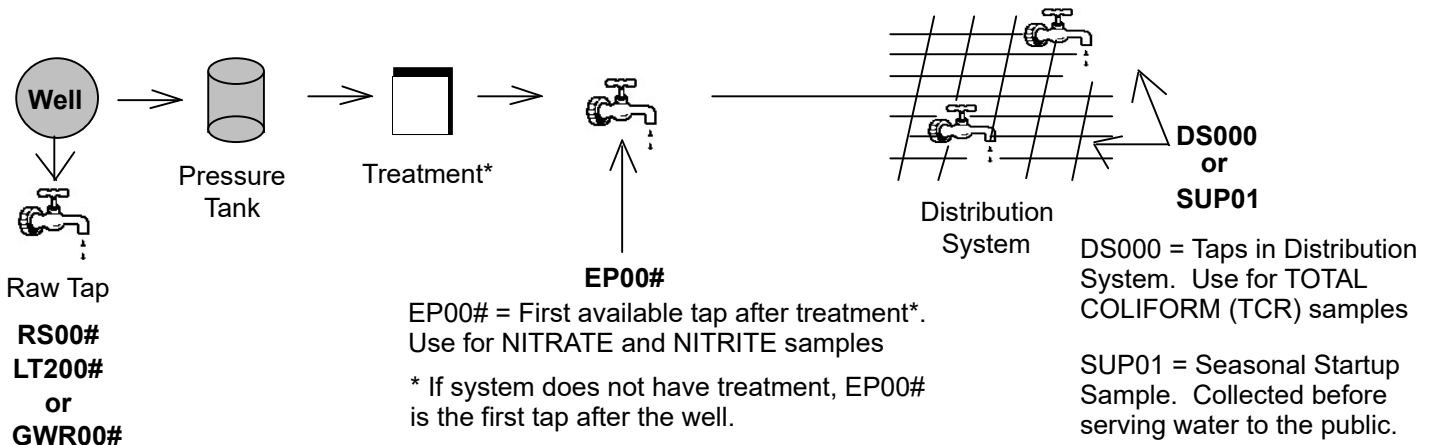

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5833312 OHIO POWER/SAWMILL-D1**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5856743 Facility Name: OHIO POWER SAWMILL D1**

**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**

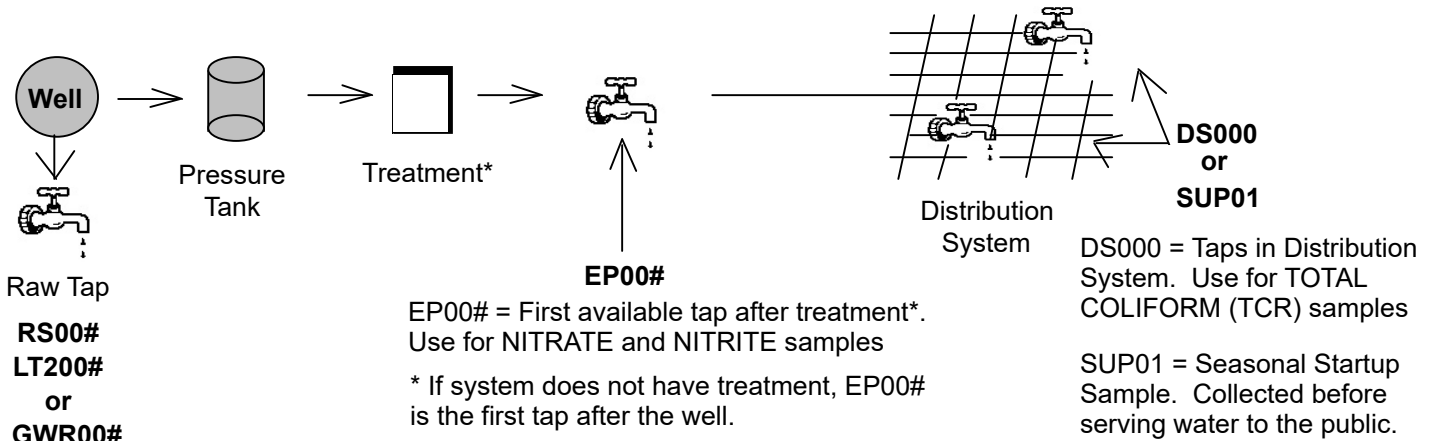

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH5833712 MALTA INDUSTRIAL PARK, LTD

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>5856746</b>	Facility Name: <b>MALTA INDUSTRIAL PARK, LTD</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2018 and 10/31/2018

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 6/1/2018 and 10/31/2018

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 Not Required

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2018 and 10/31/2018





**OH5833712 MALTA INDUSTRIAL PARK, LTD**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>MALTA INDUSTRIAL PARK, LTD DISTRIBUTION</b>
	SMP ID: <b>DS000</b>	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>MALTA INDUSTRIAL PARK, LTD DISTRIBUTION</b>
	SMP ID: <b>LC###</b>	<b>Refer to your Lead and Copper plan for SMP IDs</b>

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 7/1/2018 and 12/31/2018

*Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.*

**OH5833812 OHIO POWER/WINDY HILL-E**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **OHIO POWER/WINDY HILL-E DISTRIBUTION**  
**Location** SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5833812 OHIO POWER/WINDY HILL-E**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5856747 Facility Name: OHIO POWER WINDY HILL E**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5833912 OHIO POWER/WOOD GROVE-H**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> OHIO POWER/WOOD GROVE-H DISTRIBUTION
<b>Location SMP ID:</b> SUP01	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**

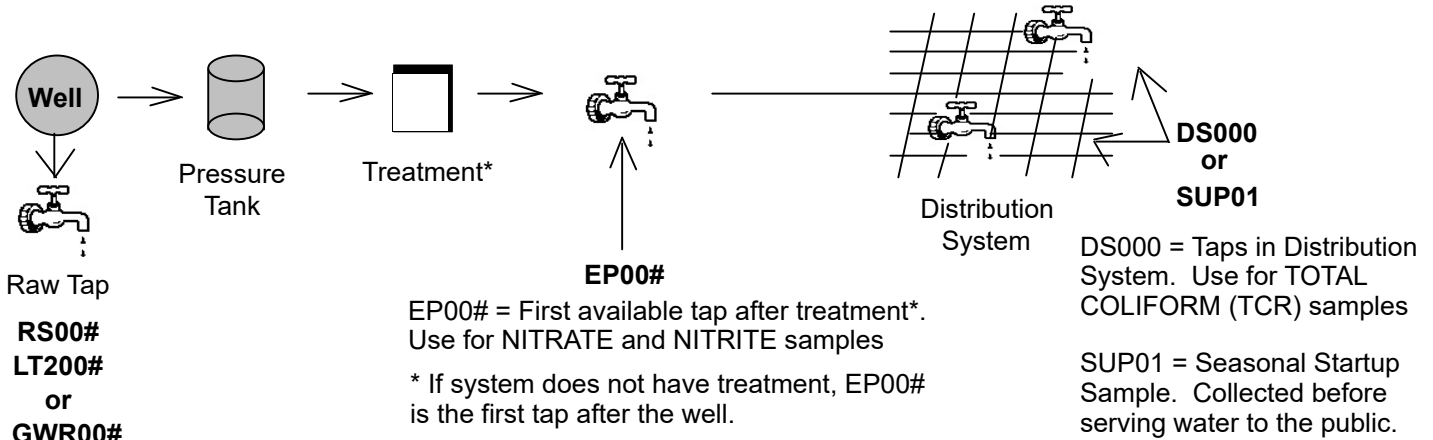

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5833912 OHIO POWER/WOOD GROVE-H**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> OHIO POWER/WOOD GROVE-H DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 11/30/2018

**Where to Collect Samples For a Small Public Water System**

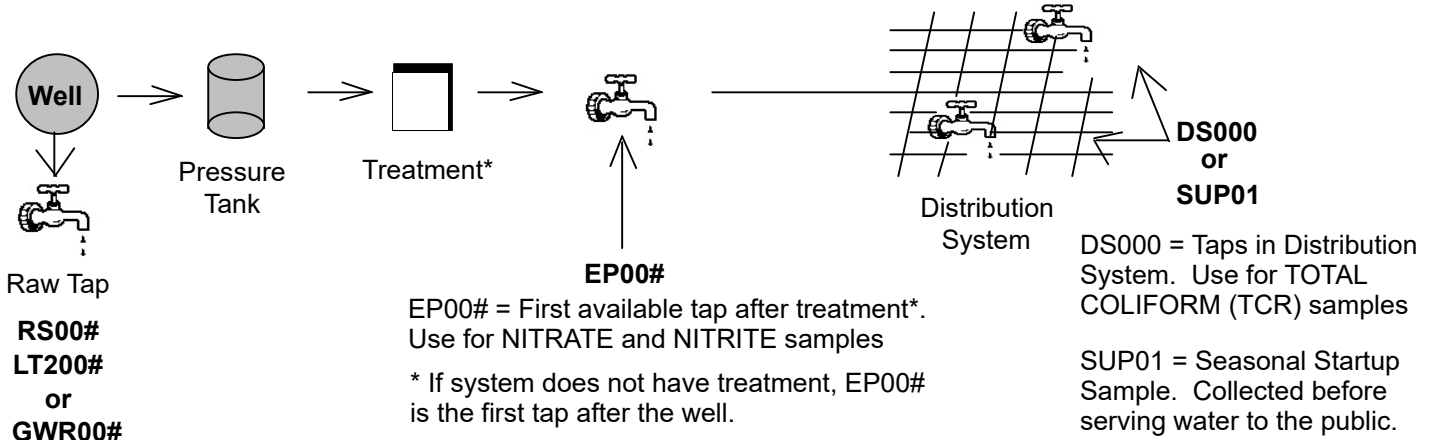

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5833912 OHIO POWER/WOOD GROVE-H**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5856748 Facility Name: OHIO POWER WOOD GROVE H**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5836412 OHIO POWER/BICENT-K1**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **OHIO POWER/BICENT-K1 DISTRIBUTION**  
**Location** SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**

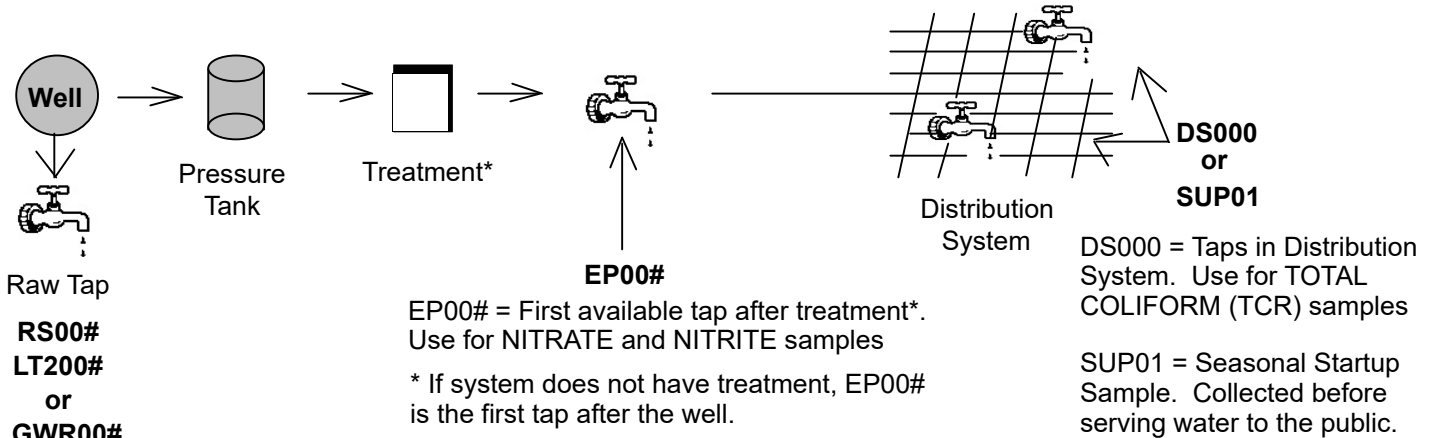

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5836412 OHIO POWER/BICENT-K1**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> OHIO POWER/BICENT-K1 DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 11/30/2018

**Where to Collect Samples For a Small Public Water System**

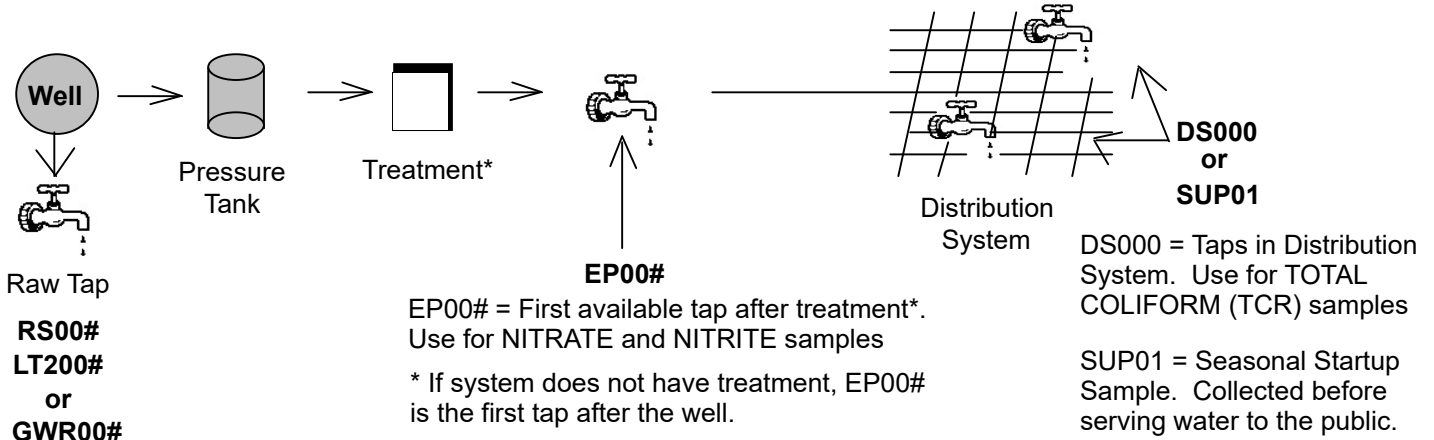

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH5836412 OHIO POWER/BICENT-K1**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 6156756 Facility Name: OHIO POWER BICENTENNIAL K1**

**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**

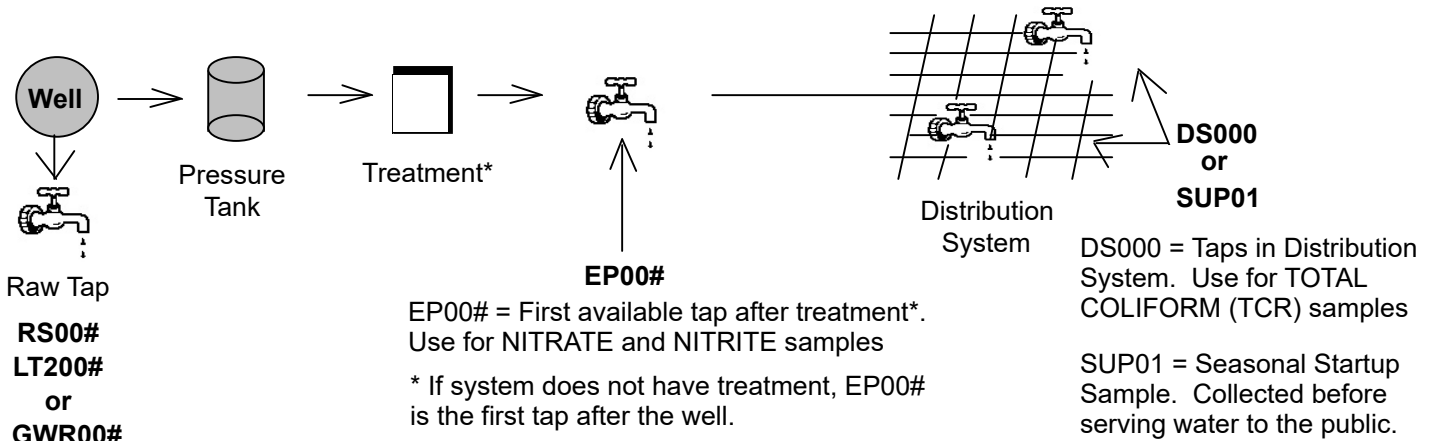

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5836512 OHIO POWER/BICENT-K2**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **OHIO POWER/BICENT-K2 DISTRIBUTION**  
**Location** SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5836512 OHIO POWER/BICENT-K2**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: 6156757 Facility Name: OHIO POWER BICENTENNIAL K2  
**Location** SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

**OH5836612 MAHLE ENGINE COMPONENTS**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>5860713</b>	Facility Name: <b>MAHLE ENGINE COMPONENTS</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**Chemicals**

**Monitoring Requirements**

INORGANICS 1 Sample(s) Required between 6/1/2018 and 10/31/2018

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 6/1/2018 and 10/31/2018

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 Not Required

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2018 and 10/31/2018



**OH5836612 MAHLE ENGINE COMPONENTS**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **MAHLE ENG COMP DISTRIBUTION**  
**Location** SMP ID: **DS000**

**Chemicals**

**Monitoring Requirements**

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2018	and	3/31/2018
	1 Sample(s) Required between	4/1/2018	and	6/30/2018
	1 Sample(s) Required between	7/1/2018	and	9/30/2018
	1 Sample(s) Required between	10/1/2018	and	12/31/2018

**Sampling** Facility ID: **DS1** Facility Name: **MAHLE ENG COMP DISTRIBUTION**  
**Location** SMP ID: **LC###** Refer to your Lead and Copper plan for SMP IDs

**Chemicals**

**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between	6/1/2018	and	9/30/2018
-------------------------------	------------------------------	----------	-----	-----------

*Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.*

**OH5836712 MORGAN HARDWARE**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> MORGAN HARDWARE DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5836712 MORGAN HARDWARE**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5861411 Facility Name: MORGAN HARDWARE TREATMENT PLANT**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**

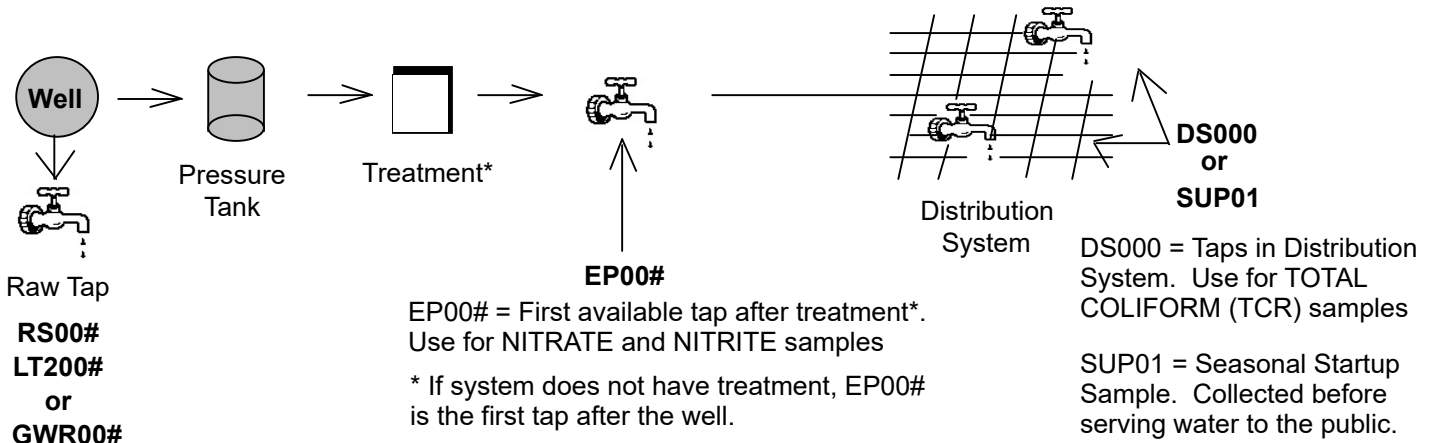

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5836713 BOONDOCKS BBQ & GRILL PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1 Facility Name: BOONDOCKS BBQ & GRILL DISTRIBUTION**  
**Location SMP ID: DS000 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH5836713 BOONDOCKS BBQ & GRILL PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: 5861412 Facility Name: BOONDOCKS BBQ & GRILL  
**Location** SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**