

**OH6200412 CATAWBA SHORES M H COURT**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> CATAWBA SHORES M H COURT DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6200412 CATAWBA SHORES M H COURT**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 6256887 Facility Name: CATAWBA SHORES MHP**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

**OH6200712 ELMORE VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>6256889</b> SMP ID: <b>EP001</b>	Facility Name: <b>ELMORE VILLAGE</b> Facility Source: <b>Ground Water</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required

**OH6200712 ELMORE VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>ELMORE, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2018 and 1/31/2018
	2 Sample(s) Required between 2/1/2018 and 2/28/2018
	2 Sample(s) Required between 3/1/2018 and 3/31/2018
	2 Sample(s) Required between 4/1/2018 and 4/30/2018
	2 Sample(s) Required between 5/1/2018 and 5/31/2018
	2 Sample(s) Required between 6/1/2018 and 6/30/2018
	2 Sample(s) Required between 7/1/2018 and 7/31/2018
	2 Sample(s) Required between 8/1/2018 and 8/31/2018
	2 Sample(s) Required between 9/1/2018 and 9/30/2018
	2 Sample(s) Required between 10/1/2018 and 10/31/2018
	2 Sample(s) Required between 11/1/2018 and 11/30/2018
	2 Sample(s) Required between 12/1/2018 and 12/31/2018

TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2018 and 1/31/2018
	2 Sample(s) Required between 2/1/2018 and 2/28/2018
	2 Sample(s) Required between 3/1/2018 and 3/31/2018
	2 Sample(s) Required between 4/1/2018 and 4/30/2018
	2 Sample(s) Required between 5/1/2018 and 5/31/2018
	2 Sample(s) Required between 6/1/2018 and 6/30/2018
	2 Sample(s) Required between 7/1/2018 and 7/31/2018
	2 Sample(s) Required between 8/1/2018 and 8/31/2018
	2 Sample(s) Required between 9/1/2018 and 9/30/2018
	2 Sample(s) Required between 10/1/2018 and 10/31/2018
	2 Sample(s) Required between 11/1/2018 and 11/30/2018
	2 Sample(s) Required between 12/1/2018 and 12/31/2018

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>ELMORE, VILLAGE OF DISTRIBUTION</b> <b>805 OHIO AVE</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2018

2018 DISTRIBUTION SCHEDULE

**OH6200712 ELMORE VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>ELMORE, VILLAGE OF DISTRIBUTION</b> <b>633 STATE ST</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2018 and 9/30/2018at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>LC###</b>	Facility Name: <b>ELMORE, VILLAGE OF DISTRIBUTION</b> <b>Refer to your Lead and Copper plan for SMP IDs</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**Chemicals Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 Not Required



OH6201003 GENOA VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>GENOA, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	3 Sample(s) Required between	1/1/2018	and	1/31/2018
	3 Sample(s) Required between	2/1/2018	and	2/28/2018
	3 Sample(s) Required between	3/1/2018	and	3/31/2018
	3 Sample(s) Required between	4/1/2018	and	4/30/2018
	3 Sample(s) Required between	5/1/2018	and	5/31/2018
	3 Sample(s) Required between	6/1/2018	and	6/30/2018
	3 Sample(s) Required between	7/1/2018	and	7/31/2018
	3 Sample(s) Required between	8/1/2018	and	8/31/2018
	3 Sample(s) Required between	9/1/2018	and	9/30/2018
	3 Sample(s) Required between	10/1/2018	and	10/31/2018
	3 Sample(s) Required between	11/1/2018	and	11/30/2018
	3 Sample(s) Required between	12/1/2018	and	12/31/2018

TOTAL CHLORINE - 1000	3 Sample(s) Required between	1/1/2018	and	1/31/2018
	3 Sample(s) Required between	2/1/2018	and	2/28/2018
	3 Sample(s) Required between	3/1/2018	and	3/31/2018
	3 Sample(s) Required between	4/1/2018	and	4/30/2018
	3 Sample(s) Required between	5/1/2018	and	5/31/2018
	3 Sample(s) Required between	6/1/2018	and	6/30/2018
	3 Sample(s) Required between	7/1/2018	and	7/31/2018
	3 Sample(s) Required between	8/1/2018	and	8/31/2018
	3 Sample(s) Required between	9/1/2018	and	9/30/2018
	3 Sample(s) Required between	10/1/2018	and	10/31/2018
	3 Sample(s) Required between	11/1/2018	and	11/30/2018
	3 Sample(s) Required between	12/1/2018	and	12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>GENOA, VILLAGE OF DISTRIBUTION</b> <b>3998 EDINBOURGH CT. GENOA</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS	Dual Sample Required between	2/8/2018	and	2/14/2018	at: DS201
	Dual Sample Required between	5/8/2018	and	5/14/2018	at: DS201
	Dual Sample Required between	8/8/2018	and	8/14/2018	at: DS201
	Dual Sample Required between	11/8/2018	and	11/14/2018	at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH6201003 GENOA VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>GENOA, VILLAGE OF DISTRIBUTION</b> <b>22038 W. ST. RT. 579 WILLISTON</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/8/2018 and 2/14/2018at: DS202
	Dual Sample Required between 5/8/2018 and 5/14/2018at: DS202
	Dual Sample Required between 8/8/2018 and 8/14/2018at: DS202
	Dual Sample Required between 11/8/2018 and 11/14/2018at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>LC###</b>	Facility Name: <b>GENOA, VILLAGE OF DISTRIBUTION</b> <b>Refer to your Lead and Copper plan for SMP IDs</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	20 Sample(s) Required between 1/1/2018 and 6/30/2018
	20 Sample(s) Required between 7/1/2018 and 12/31/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

**OH6201212 GREEN VALLEY MOBILE HOME PARK**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>6256894</b> SMP ID: <b>EP001</b>	Facility Name: <b>GREEN VALLEY MHP</b> Facility Source: <b>Ground Water</b>	Facility Class: <b>CLASS A</b>
--------------------------	---	--	--------------------------------

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required





OH6201212 GREEN VALLEY MOBILE HOME PARK

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: GREEN VALLEY MHP DISTRIBUTION
Location SMP ID: DS000

Chemicals

Monitoring Requirements

Table with 3 columns: Chemicals, Monitoring Requirements, and Dates. Includes rows for TOTAL COLIFORM (TCR) - 3100 with 12 sampling requirements from 1/1/2018 to 12/31/2018.

Table with 3 columns: Chemicals, Monitoring Requirements, and Dates. Includes rows for TOTAL CHLORINE - 1000 with 12 sampling requirements from 1/1/2018 to 12/31/2018.

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Facility ID: DS1 Facility Name: GREEN VALLEY MHP DISTRIBUTION
Location SMP ID: DS201 LOT #29 (2.0)

Chemicals

Monitoring Requirements

Table with 3 columns: Chemicals, Monitoring Requirements, and Dates. Includes row for DISINFECTION BYPRODUCTS with Dual Sample Required between 7/1/2018 and 9/30/2018 at DS201.

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950





Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

**OH6201312 GREENWOOD MOBILE HOME PK**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>6256895</b> SMP ID: <b>EP001</b>	Facility Name: <b>GREENWOOD MHP</b> Facility Source: <b>Ground Water</b>	Facility Class: <b>CLASS A</b>
--------------------------	---	---	--------------------------------

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required

**OH6201312 GREENWOOD MOBILE HOME PK**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>GREENWOOD MOBILE HOME PK DISTRIBUTIC</b>
	SMP ID: <b>DS000</b>	

**Chemicals**

**Monitoring Requirements**

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2018	and	1/31/2018
	1 Sample(s) Required between	2/1/2018	and	2/28/2018
	1 Sample(s) Required between	3/1/2018	and	3/31/2018
	1 Sample(s) Required between	4/1/2018	and	4/30/2018
	1 Sample(s) Required between	5/1/2018	and	5/31/2018
	1 Sample(s) Required between	6/1/2018	and	6/30/2018
	1 Sample(s) Required between	7/1/2018	and	7/31/2018
	1 Sample(s) Required between	8/1/2018	and	8/31/2018
	1 Sample(s) Required between	9/1/2018	and	9/30/2018
	1 Sample(s) Required between	10/1/2018	and	10/31/2018
	1 Sample(s) Required between	11/1/2018	and	11/30/2018
	1 Sample(s) Required between	12/1/2018	and	12/31/2018

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2018	and	1/31/2018
	1 Sample(s) Required between	2/1/2018	and	2/28/2018
	1 Sample(s) Required between	3/1/2018	and	3/31/2018
	1 Sample(s) Required between	4/1/2018	and	4/30/2018
	1 Sample(s) Required between	5/1/2018	and	5/31/2018
	1 Sample(s) Required between	6/1/2018	and	6/30/2018
	1 Sample(s) Required between	7/1/2018	and	7/31/2018
	1 Sample(s) Required between	8/1/2018	and	8/31/2018
	1 Sample(s) Required between	9/1/2018	and	9/30/2018
	1 Sample(s) Required between	10/1/2018	and	10/31/2018
	1 Sample(s) Required between	11/1/2018	and	11/30/2018
	1 Sample(s) Required between	12/1/2018	and	12/31/2018

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>GREENWOOD MOBILE HOME PK DISTRIBUTIC</b>
	SMP ID: <b>DS201</b>	<b>ADDRESS NOT KNOWN</b>

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between	7/1/2018	and	9/30/2018	at: DS201
-------------------------	------------------------------	----------	-----	-----------	-----------

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH6201911 LAKE ERIE UTILITIES COMP**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> LAKE ERIE UTILITIES COMP DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Surface Water
	<b>Facility Class:</b> CLASS 1

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	4 Sample(s) Required between 1/1/2018 and 1/31/2018
	4 Sample(s) Required between 2/1/2018 and 2/28/2018
	4 Sample(s) Required between 3/1/2018 and 3/31/2018
	4 Sample(s) Required between 4/1/2018 and 4/30/2018
	4 Sample(s) Required between 5/1/2018 and 5/31/2018
	4 Sample(s) Required between 6/1/2018 and 6/30/2018
	4 Sample(s) Required between 7/1/2018 and 7/31/2018
	4 Sample(s) Required between 8/1/2018 and 8/31/2018
	4 Sample(s) Required between 9/1/2018 and 9/30/2018
	4 Sample(s) Required between 10/1/2018 and 10/31/2018
	4 Sample(s) Required between 11/1/2018 and 11/30/2018
	4 Sample(s) Required between 12/1/2018 and 12/31/2018

**Where to Collect Samples For a Small Public Water System**

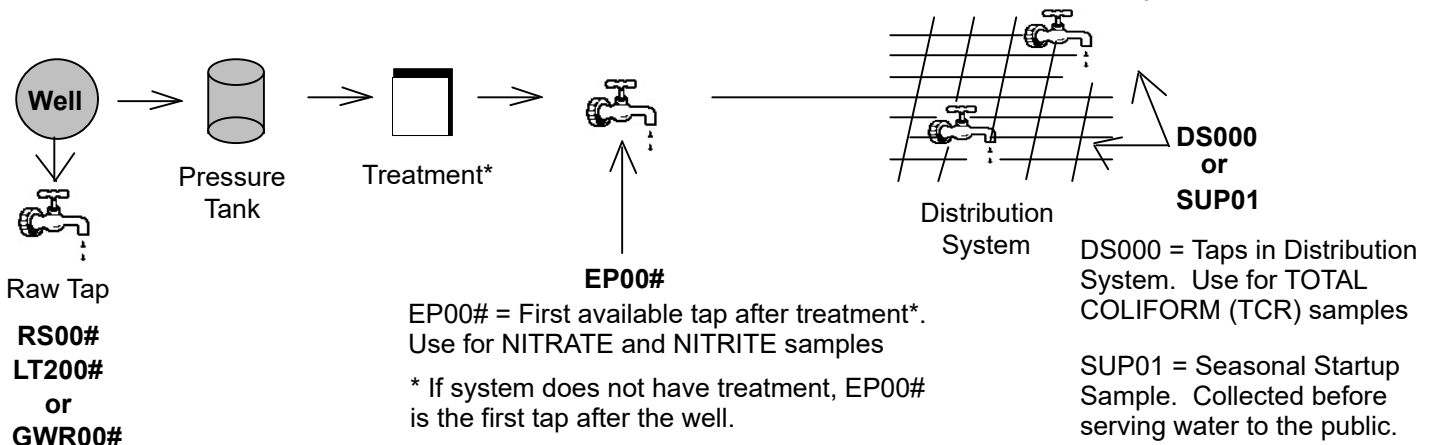

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH6201911 LAKE ERIE UTILITIES COMP**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID: 6262096</b>	<b>Facility Name: LAKE ERIE UTILITIES CO 2</b>
<b>Location SMP ID: LT2001</b>	<b>Facility Source: Surface Water</b>
	<b>Facility Class: CLASS 3</b>

<b>Chemicals</b>	<b>Monitoring Requirements</b>
CYANOBACTERIA SCREENING	1 Sample(s) Required between 12/31/2017 and 1/6/2018
	1 Sample(s) Required between 1/14/2018 and 1/20/2018
	1 Sample(s) Required between 1/28/2018 and 2/3/2018
	1 Sample(s) Required between 2/11/2018 and 2/17/2018
	1 Sample(s) Required between 2/25/2018 and 3/3/2018
	1 Sample(s) Required between 3/11/2018 and 3/17/2018
	1 Sample(s) Required between 3/25/2018 and 3/31/2018
	1 Sample(s) Required between 4/8/2018 and 4/14/2018
	1 Sample(s) Required between 4/22/2018 and 4/28/2018
	1 Sample(s) Required between 5/6/2018 and 5/12/2018
	1 Sample(s) Required between 5/20/2018 and 5/26/2018
	1 Sample(s) Required between 6/3/2018 and 6/9/2018
	1 Sample(s) Required between 6/17/2018 and 6/23/2018
	1 Sample(s) Required between 7/1/2018 and 7/7/2018
	1 Sample(s) Required between 7/15/2018 and 7/21/2018
	1 Sample(s) Required between 7/29/2018 and 8/4/2018
	1 Sample(s) Required between 8/12/2018 and 8/18/2018
	1 Sample(s) Required between 8/26/2018 and 9/1/2018
	1 Sample(s) Required between 9/9/2018 and 9/15/2018
	1 Sample(s) Required between 9/23/2018 and 9/29/2018
	1 Sample(s) Required between 10/7/2018 and 10/13/2018
	1 Sample(s) Required between 10/21/2018 and 10/27/2018
	1 Sample(s) Required between 11/4/2018 and 11/10/2018
	1 Sample(s) Required between 11/18/2018 and 11/24/2018
1 Sample(s) Required between 12/2/2018 and 12/8/2018	

**OH6201911 LAKE ERIE UTILITIES COMP**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 6262096	<b>Facility Name:</b> LAKE ERIE UTILITIES CO 2	
<b>Location SMP ID:</b> LT2001	<b>Facility Source:</b> Surface Water	<b>Facility Class:</b> CLASS 3

Chemicals	Monitoring Requirements
CYANOBACTERIA SCREENING	1 Sample(s) Required between 12/16/2018 and 12/22/2018

*Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 and must be collected at the same time as the raw total microcystins sample. SAMPLES MUST BE SHIPPED OVERNIGHT ON ICE ON THE DAY OF COLLECTION AND ARRIVE AT OHIO EPA DIVISION OF ENVIRONMENTAL SERVICES (DES) BY NOON MONDAY THROUGH THURSDAY ONLY! If lab capacity is found to be adequate, cyanobacteria screening samples will no longer be analyzed, free of charge, by Ohio EPA DES beginning June 1, 2017.*

**Where to Collect Samples For a Small Public Water System**

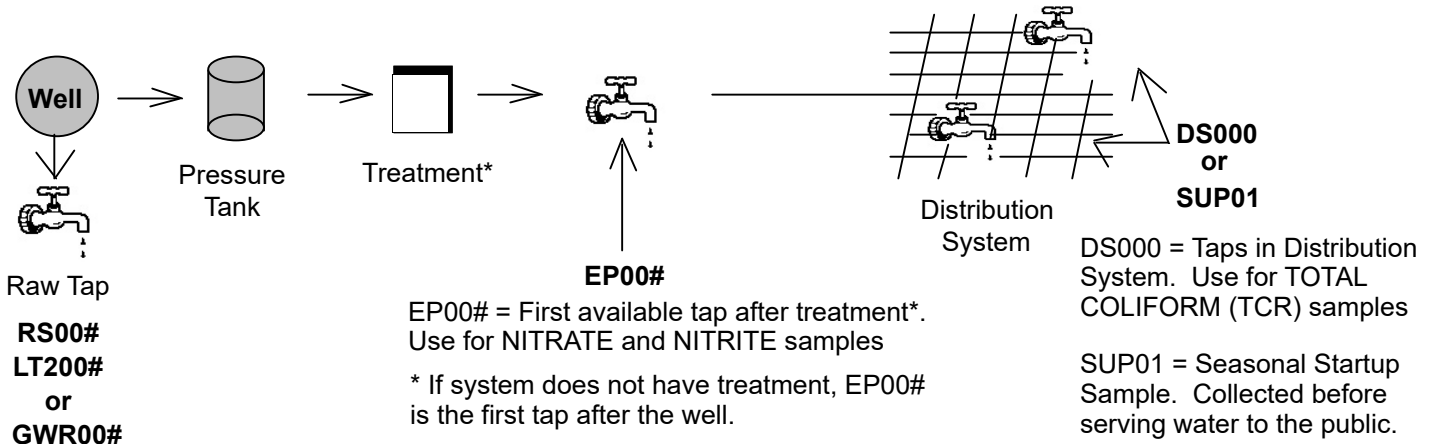

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH6201911 LAKE ERIE UTILITIES COMP**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 6262096	<b>Facility Name:</b> LAKE ERIE UTILITIES CO 2	
<b>Location SMP ID:</b> EP002/LT200	<b>Facility Source:</b> Surface Water	<b>Facility Class:</b> CLASS 3


Chemicals	Monitoring Requirements
-----------	-------------------------

TOTAL MICROCYSTINS	1 Sample Set Required WEEKLY*
--------------------	-------------------------------

*Total microcystins sample set refers to one raw source water sample at LT200# and one finished water sample at EP00#. A week is defined as Sunday through Saturday.*

*\*Weekly sampling unless requirements for seasonal reduced monitoring are met (November through April). Biweekly raw seasonal reduced monitoring must be conducted at the same time as cyanobacteria screening sample. Any microcystins detection during seasonal reduced monitoring triggers collection of raw and finished samples within 24 hours and a return to weekly monitoring at both raw and finished sample points. For questions about seasonal reduced monitoring please contact your Ohio EPA District Office HAB Coordinator.*

## Where to Collect Samples For a Small Public Water System

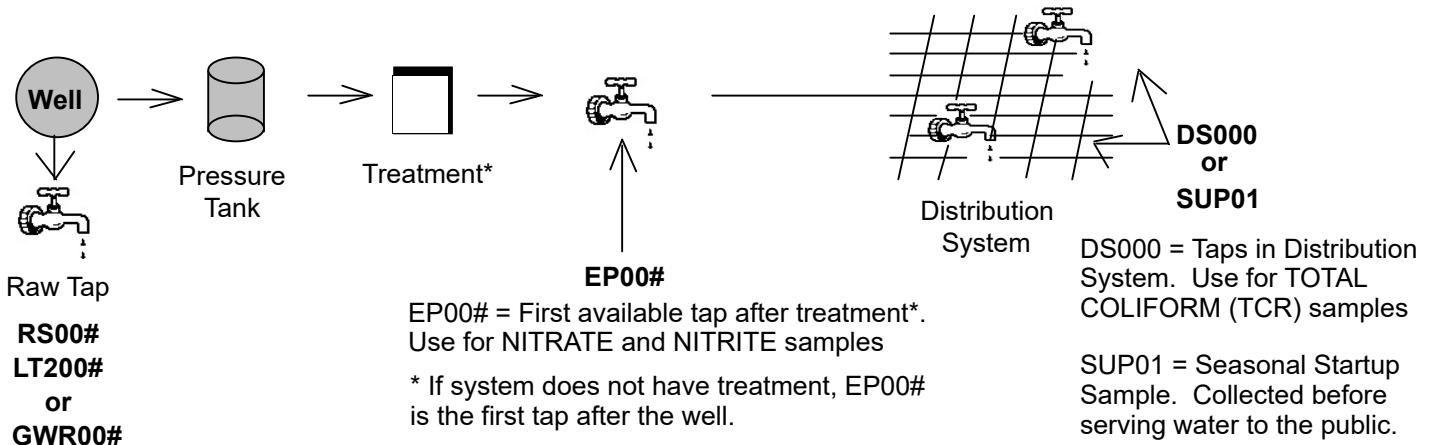

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH6201911 LAKE ERIE UTILITIES COMP**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b> Facility ID: <b>6262096</b>	Facility Name: <b>LAKE ERIE UTILITIES CO 2</b>
<b>Location</b> SMP ID: <b>EP002</b>	Facility Source: <b>Surface Water</b> Facility Class: <b>CLASS 3</b>

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 1/31/2018 1 Sample(s) Required between 2/1/2018 and 2/28/2018 1 Sample(s) Required between 3/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 4/30/2018 1 Sample(s) Required between 5/1/2018 and 5/31/2018 1 Sample(s) Required between 6/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 7/31/2018 1 Sample(s) Required between 8/1/2018 and 8/31/2018 1 Sample(s) Required between 9/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 10/31/2018 1 Sample(s) Required between 11/1/2018 and 11/30/2018

**OH6201911 LAKE ERIE UTILITIES COMP**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 6262096	<b>Facility Name:</b> LAKE ERIE UTILITIES CO 2
<b>Location SMP ID:</b> EP002	<b>Facility Source:</b> Surface Water
<b>Facility Class:</b> CLASS 3	

Chemicals	Monitoring Requirements
NITRATE - 1040	1 Sample(s) Required between 12/1/2018 and 12/31/2018

**Where to Collect Samples For a Small Public Water System**

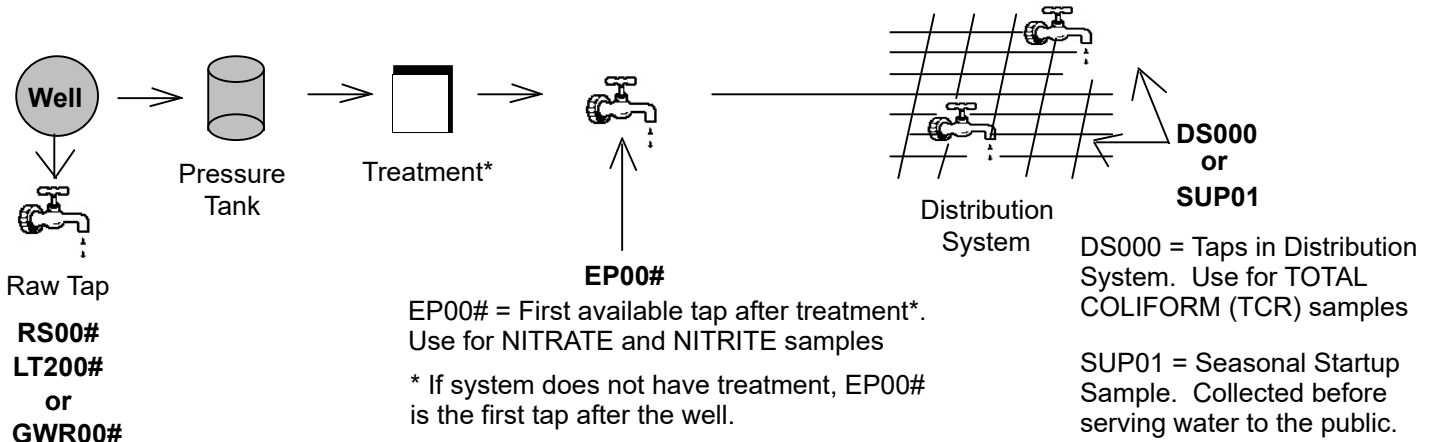

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



OH6202411 MARBLEHEAD VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>6256904</b>	Facility Name: <b>MARBLEHEAD VILLAGE</b>	Facility Class: <b>CLASS 3</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Surface Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020	
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 1/31/2018 1 Sample(s) Required between 2/1/2018 and 2/28/2018 1 Sample(s) Required between 3/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 4/30/2018 1 Sample(s) Required between 5/1/2018 and 5/31/2018 1 Sample(s) Required between 6/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 7/31/2018 1 Sample(s) Required between 8/1/2018 and 8/31/2018 1 Sample(s) Required between 9/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 10/31/2018 1 Sample(s) Required between 11/1/2018 and 11/30/2018 1 Sample(s) Required between 12/1/2018 and 12/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2018 and 6/30/2018
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2018 and 10/31/2018
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 1/1/2018 and 1/31/2018 1 Paired Sample Set Required between 2/1/2018 and 2/28/2018 1 Paired Sample Set Required between 3/1/2018 and 3/31/2018 1 Paired Sample Set Required between 4/1/2018 and 4/30/2018 1 Paired Sample Set Required between 5/1/2018 and 5/31/2018 1 Paired Sample Set Required between 6/1/2018 and 6/30/2018 1 Paired Sample Set Required between 7/1/2018 and 7/31/2018 1 Paired Sample Set Required between 8/1/2018 and 8/31/2018 1 Paired Sample Set Required between 9/1/2018 and 9/30/2018 1 Paired Sample Set Required between 10/1/2018 and 10/31/2018 1 Paired Sample Set Required between 11/1/2018 and 11/30/2018 1 Paired Sample Set Required between 12/1/2018 and 12/31/2018

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

**OH6202411 MARBLEHEAD VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>6256904</b>	Facility Name: <b>MARBLEHEAD VILLAGE</b>	
<b>Location</b>	SMP ID: <b>EP001/LT2001</b>	Facility Source: <b>Surface Water</b>	Facility Class: <b>CLASS 3</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

**Chemicals**

**Monitoring Requirements**

TOTAL MICROCYSTINS

1 Sample Set Required WEEKLY\*

*Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. A week is defined as Sunday through Saturday.*

*\*Weekly sampling unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. Reduced monitoring is contingent on a public water system continuing to experience NO raw or finished water total microcystins detections. Any total microcystins detections during routine (weekly) or reduced sampling will trigger additional sampling. Please refer to the website above for specifics on follow-up sampling requirements.*



OH6202411 MARBLEHEAD VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling</b>	Facility ID: <b>6256904</b>	Facility Name: <b>MARBLEHEAD VILLAGE</b>	
<b>Location</b>	SMP ID: <b>LT2001</b>	Facility Source: <b>Surface Water</b>	Facility Class: <b>CLASS 3</b>

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
CYANOBACTERIA SCREENING	1 Sample(s) Required between 12/31/2017 and 1/6/2018
	1 Sample(s) Required between 1/14/2018 and 1/20/2018
	1 Sample(s) Required between 1/28/2018 and 2/3/2018
	1 Sample(s) Required between 2/11/2018 and 2/17/2018
	1 Sample(s) Required between 2/25/2018 and 3/3/2018
	1 Sample(s) Required between 3/11/2018 and 3/17/2018
	1 Sample(s) Required between 3/25/2018 and 3/31/2018
	1 Sample(s) Required between 4/8/2018 and 4/14/2018
	1 Sample(s) Required between 4/22/2018 and 4/28/2018
	1 Sample(s) Required between 5/6/2018 and 5/12/2018
	1 Sample(s) Required between 5/20/2018 and 5/26/2018
	1 Sample(s) Required between 6/3/2018 and 6/9/2018
	1 Sample(s) Required between 6/17/2018 and 6/23/2018
	1 Sample(s) Required between 7/1/2018 and 7/7/2018
	1 Sample(s) Required between 7/15/2018 and 7/21/2018
	1 Sample(s) Required between 7/29/2018 and 8/4/2018
	1 Sample(s) Required between 8/12/2018 and 8/18/2018
	1 Sample(s) Required between 8/26/2018 and 9/1/2018
	1 Sample(s) Required between 9/9/2018 and 9/15/2018
	1 Sample(s) Required between 9/23/2018 and 9/29/2018
1 Sample(s) Required between 10/7/2018 and 10/13/2018	
1 Sample(s) Required between 10/21/2018 and 10/27/2018	
1 Sample(s) Required between 11/4/2018 and 11/10/2018	
1 Sample(s) Required between 11/18/2018 and 11/24/2018	
1 Sample(s) Required between 12/2/2018 and 12/8/2018	
1 Sample(s) Required between 12/16/2018 and 12/22/2018	

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. As of 12/31/17, all public water systems are responsible for contracting with a lab certified to perform cyanobacteria screening (qPCR). Please review the website for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections, and certified labs that can perform analysis.

**OH6202411 MARBLEHEAD VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>MARBLEHEAD VILLAGE DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	4 Sample(s) Required between 1/1/2018 and 1/31/2018
	4 Sample(s) Required between 2/1/2018 and 2/28/2018
	4 Sample(s) Required between 3/1/2018 and 3/31/2018
	4 Sample(s) Required between 4/1/2018 and 4/30/2018
	4 Sample(s) Required between 5/1/2018 and 5/31/2018
	4 Sample(s) Required between 6/1/2018 and 6/30/2018
	4 Sample(s) Required between 7/1/2018 and 7/31/2018
	4 Sample(s) Required between 8/1/2018 and 8/31/2018
	4 Sample(s) Required between 9/1/2018 and 9/30/2018
	4 Sample(s) Required between 10/1/2018 and 10/31/2018
	4 Sample(s) Required between 11/1/2018 and 11/30/2018
	4 Sample(s) Required between 12/1/2018 and 12/31/2018
TOTAL CHLORINE - 1000	4 Sample(s) Required between 1/1/2018 and 1/31/2018
	4 Sample(s) Required between 2/1/2018 and 2/28/2018
	4 Sample(s) Required between 3/1/2018 and 3/31/2018
	4 Sample(s) Required between 4/1/2018 and 4/30/2018
	4 Sample(s) Required between 5/1/2018 and 5/31/2018
	4 Sample(s) Required between 6/1/2018 and 6/30/2018
	4 Sample(s) Required between 7/1/2018 and 7/31/2018
	4 Sample(s) Required between 8/1/2018 and 8/31/2018
	4 Sample(s) Required between 9/1/2018 and 9/30/2018
	4 Sample(s) Required between 10/1/2018 and 10/31/2018
	4 Sample(s) Required between 11/1/2018 and 11/30/2018
	4 Sample(s) Required between 12/1/2018 and 12/31/2018

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>MARBLEHEAD VILLAGE DISTRIBUTION</b> <b>10269 E BAYSHORE RD</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2018 and 2/7/2018at: DS201
	Dual Sample Required between 5/1/2018 and 5/7/2018at: DS201
	Dual Sample Required between 8/1/2018 and 8/7/2018at: DS201
	Dual Sample Required between 11/1/2018 and 11/7/2018at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH6202411 MARBLEHEAD VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>MARBLEHEAD VILLAGE DISTRIBUTION</b> <b>113 LAKE BREEZE CIRCLE</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2018 and 2/7/2018at: DS202 Dual Sample Required between 5/1/2018 and 5/7/2018at: DS202 Dual Sample Required between 8/1/2018 and 8/7/2018at: DS202 Dual Sample Required between 11/1/2018 and 11/7/2018at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>LC###</b>	Facility Name: <b>MARBLEHEAD VILLAGE DISTRIBUTION</b> <b>Refer to your Lead and Copper plan for SMP IDs</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.





OH6202603 OAK HARBOR VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: OAK HARBOR VILLAGE DISTRIBUTION SYSTE Facility Class: CLASS 1
Location SMP ID: DS000

Chemicals Monitoring Requirements

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100 5 Sample(s) Required between 1/1/2018 and 1/31/2018
5 Sample(s) Required between 2/1/2018 and 2/28/2018
5 Sample(s) Required between 3/1/2018 and 3/31/2018
5 Sample(s) Required between 4/1/2018 and 4/30/2018
5 Sample(s) Required between 5/1/2018 and 5/31/2018
5 Sample(s) Required between 6/1/2018 and 6/30/2018
5 Sample(s) Required between 7/1/2018 and 7/31/2018
5 Sample(s) Required between 8/1/2018 and 8/31/2018
5 Sample(s) Required between 9/1/2018 and 9/30/2018
5 Sample(s) Required between 10/1/2018 and 10/31/2018
5 Sample(s) Required between 11/1/2018 and 11/30/2018
5 Sample(s) Required between 12/1/2018 and 12/31/2018

TOTAL CHLORINE - 1000 5 Sample(s) Required between 1/1/2018 and 1/31/2018
5 Sample(s) Required between 2/1/2018 and 2/28/2018
5 Sample(s) Required between 3/1/2018 and 3/31/2018
5 Sample(s) Required between 4/1/2018 and 4/30/2018
5 Sample(s) Required between 5/1/2018 and 5/31/2018
5 Sample(s) Required between 6/1/2018 and 6/30/2018
5 Sample(s) Required between 7/1/2018 and 7/31/2018
5 Sample(s) Required between 8/1/2018 and 8/31/2018
5 Sample(s) Required between 9/1/2018 and 9/30/2018
5 Sample(s) Required between 10/1/2018 and 10/31/2018
5 Sample(s) Required between 11/1/2018 and 11/30/2018
5 Sample(s) Required between 12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Facility ID: DS1 Facility Name: OAK HARBOR VILLAGE DISTRIBUTION SYSTE Facility Class: CLASS 1
Location SMP ID: DS201 9735 W. SR 163

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 1/1/2018 and 1/7/2018at: DS201
Dual Sample Required between 4/1/2018 and 4/7/2018at: DS201
Dual Sample Required between 7/1/2018 and 7/7/2018at: DS201
Dual Sample Required between 10/1/2018 and 10/7/2018at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



OH6202603 OAK HARBOR VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>OAK HARBOR VILLAGE DISTRIBUTION SYSTE</b> <b>601 N. BENTON ST.</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 1/1/2018 and 1/7/2018at: DS202
	Dual Sample Required between 4/1/2018 and 4/7/2018at: DS202
	Dual Sample Required between 7/1/2018 and 7/7/2018at: DS202
	Dual Sample Required between 10/1/2018 and 10/7/2018at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>LC###</b>	Facility Name: <b>OAK HARBOR VILLAGE DISTRIBUTION SYSTE</b> <b>Refer to your Lead and Copper plan for SMP IDs</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	20 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



**OH6203211 PORT CLINTON CITY**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>PORT CLINTON CITY DISTRIBUTION SYSTEM</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	7 Sample(s) Required between 1/1/2018 and 1/31/2018
	7 Sample(s) Required between 2/1/2018 and 2/28/2018
	7 Sample(s) Required between 3/1/2018 and 3/31/2018
	7 Sample(s) Required between 4/1/2018 and 4/30/2018
	7 Sample(s) Required between 5/1/2018 and 5/31/2018
	7 Sample(s) Required between 6/1/2018 and 6/30/2018
	7 Sample(s) Required between 7/1/2018 and 7/31/2018
	7 Sample(s) Required between 8/1/2018 and 8/31/2018
	7 Sample(s) Required between 9/1/2018 and 9/30/2018
	7 Sample(s) Required between 10/1/2018 and 10/31/2018
	7 Sample(s) Required between 11/1/2018 and 11/30/2018
	7 Sample(s) Required between 12/1/2018 and 12/31/2018

TOTAL CHLORINE - 1000	7 Sample(s) Required between 1/1/2018 and 1/31/2018
	7 Sample(s) Required between 2/1/2018 and 2/28/2018
	7 Sample(s) Required between 3/1/2018 and 3/31/2018
	7 Sample(s) Required between 4/1/2018 and 4/30/2018
	7 Sample(s) Required between 5/1/2018 and 5/31/2018
	7 Sample(s) Required between 6/1/2018 and 6/30/2018
	7 Sample(s) Required between 7/1/2018 and 7/31/2018
	7 Sample(s) Required between 8/1/2018 and 8/31/2018
	7 Sample(s) Required between 9/1/2018 and 9/30/2018
	7 Sample(s) Required between 10/1/2018 and 10/31/2018
	7 Sample(s) Required between 11/1/2018 and 11/30/2018
	7 Sample(s) Required between 12/1/2018 and 12/31/2018

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>PORT CLINTON CITY DISTRIBUTION SYSTEM</b> <b>1868 EAST PERRY ST</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2018 and 2/7/2018at: DS201
	Dual Sample Required between 5/1/2018 and 5/7/2018at: DS201
	Dual Sample Required between 8/1/2018 and 8/7/2018at: DS201
	Dual Sample Required between 11/1/2018 and 11/7/2018at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH6203211 PORT CLINTON CITY

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>PORT CLINTON CITY DISTRIBUTION SYSTEM</b> <b>716 W THIRD ST</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2018 and 2/7/2018at: DS202
	Dual Sample Required between 5/1/2018 and 5/7/2018at: DS202
	Dual Sample Required between 8/1/2018 and 8/7/2018at: DS202
	Dual Sample Required between 11/1/2018 and 11/7/2018at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>LC###</b>	Facility Name: <b>PORT CLINTON CITY DISTRIBUTION SYSTEM</b> <b>Refer to your Lead and Copper plan for SMP IDs</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	20 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH6203311 PUT-IN-BAY VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>6256913</b>	Facility Name: <b>PUT-IN-BAY VILLAGE</b>	Facility Class: <b>CLASS 3</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Surface Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
-----------	-------------------------

INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
------------	--

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020  
 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

RADIOLOGICALS	Not Required
---------------	--------------

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2018 and 6/30/2018
---	---

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2018 and 10/31/2018
----------------------------------	--



**OH6203311 PUT-IN-BAY VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>6256913</b>	Facility Name: <b>PUT-IN-BAY VILLAGE</b>	
<b>Location</b>	SMP ID: <b>EP001/LT2001</b>	Facility Source: <b>Surface Water</b>	Facility Class: <b>CLASS 3</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
------------------	--------------------------------

TOTAL MICROCYSTINS	1 Sample Set Required WEEKLY*
--------------------	-------------------------------

*Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. A week is defined as Sunday through Saturday.*

*\*Weekly sampling unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. Reduced monitoring is contingent on a public water system continuing to experience NO raw or finished water total microcystins detections. Any total microcystins detections during routine (weekly) or reduced sampling will trigger additional sampling. Please refer to the website above for specifics on follow-up sampling requirements.*



**OH6203311 PUT-IN-BAY VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>6256913</b>	Facility Name: <b>PUT-IN-BAY VILLAGE</b>	
<b>Location</b>	SMP ID: <b>LT2001</b>	Facility Source: <b>Surface Water</b>	Facility Class: <b>CLASS 3</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
CYANOBACTERIA SCREENING	1 Sample(s) Required between 12/31/2017 and 1/6/2018
	1 Sample(s) Required between 1/14/2018 and 1/20/2018
	1 Sample(s) Required between 1/28/2018 and 2/3/2018
	1 Sample(s) Required between 2/11/2018 and 2/17/2018
	1 Sample(s) Required between 2/25/2018 and 3/3/2018
	1 Sample(s) Required between 3/11/2018 and 3/17/2018
	1 Sample(s) Required between 3/25/2018 and 3/31/2018
	1 Sample(s) Required between 4/8/2018 and 4/14/2018
	1 Sample(s) Required between 4/22/2018 and 4/28/2018
	1 Sample(s) Required between 5/6/2018 and 5/12/2018
	1 Sample(s) Required between 5/20/2018 and 5/26/2018
	1 Sample(s) Required between 6/3/2018 and 6/9/2018
	1 Sample(s) Required between 6/17/2018 and 6/23/2018
	1 Sample(s) Required between 7/1/2018 and 7/7/2018
	1 Sample(s) Required between 7/15/2018 and 7/21/2018
	1 Sample(s) Required between 7/29/2018 and 8/4/2018
	1 Sample(s) Required between 8/12/2018 and 8/18/2018
	1 Sample(s) Required between 8/26/2018 and 9/1/2018
	1 Sample(s) Required between 9/9/2018 and 9/15/2018
	1 Sample(s) Required between 9/23/2018 and 9/29/2018
1 Sample(s) Required between 10/7/2018 and 10/13/2018	
1 Sample(s) Required between 10/21/2018 and 10/27/2018	
1 Sample(s) Required between 11/4/2018 and 11/10/2018	
1 Sample(s) Required between 11/18/2018 and 11/24/2018	
1 Sample(s) Required between 12/2/2018 and 12/8/2018	
1 Sample(s) Required between 12/16/2018 and 12/22/2018	

*Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. As of 12/31/17, all public water systems are responsible for contracting with a lab certified to perform cyanobacteria screening (qPCR). Please review the website for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections, and certified labs that can perform analysis.*



**OH6203311 PUT-IN-BAY VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>PUT-IN-BAY VILLAGE DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	4 Sample(s) Required between 1/1/2018 and 1/31/2018
	4 Sample(s) Required between 2/1/2018 and 2/28/2018
	4 Sample(s) Required between 3/1/2018 and 3/31/2018
	4 Sample(s) Required between 4/1/2018 and 4/30/2018
	6 Sample(s) Required between 5/1/2018 and 5/31/2018
	6 Sample(s) Required between 6/1/2018 and 6/30/2018
	6 Sample(s) Required between 7/1/2018 and 7/31/2018
	6 Sample(s) Required between 8/1/2018 and 8/31/2018
	6 Sample(s) Required between 9/1/2018 and 9/30/2018
	4 Sample(s) Required between 10/1/2018 and 10/31/2018
	4 Sample(s) Required between 11/1/2018 and 11/30/2018
	4 Sample(s) Required between 12/1/2018 and 12/31/2018
	TOTAL CHLORINE - 1000
4 Sample(s) Required between 2/1/2018 and 2/28/2018	
4 Sample(s) Required between 3/1/2018 and 3/31/2018	
4 Sample(s) Required between 4/1/2018 and 4/30/2018	
6 Sample(s) Required between 5/1/2018 and 5/31/2018	
6 Sample(s) Required between 6/1/2018 and 6/30/2018	
6 Sample(s) Required between 7/1/2018 and 7/31/2018	
6 Sample(s) Required between 8/1/2018 and 8/31/2018	
6 Sample(s) Required between 9/1/2018 and 9/30/2018	
4 Sample(s) Required between 10/1/2018 and 10/31/2018	
4 Sample(s) Required between 11/1/2018 and 11/30/2018	
4 Sample(s) Required between 12/1/2018 and 12/31/2018	

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>PUT-IN-BAY VILLAGE DISTRIBUTION</b> <b>70 PARK</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 3/1/2018 and 3/7/2018at: DS201
	Dual Sample Required between 6/1/2018 and 6/7/2018at: DS201
	Dual Sample Required between 9/1/2018 and 9/7/2018at: DS201
	Dual Sample Required between 12/1/2018 and 12/7/2018at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950





OH6203311 PUT-IN-BAY VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>PUT-IN-BAY VILLAGE DISTRIBUTION</b> <b>1550 PIB ROAD</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 3/1/2018 and 3/7/2018at: DS202
	Dual Sample Required between 6/1/2018 and 6/7/2018at: DS202
	Dual Sample Required between 9/1/2018 and 9/7/2018at: DS202
	Dual Sample Required between 12/1/2018 and 12/7/2018at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>LC###</b>	Facility Name: <b>PUT-IN-BAY VILLAGE DISTRIBUTION</b> <b>Refer to your Lead and Copper plan for SMP IDs</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH6204112 CEDAR CREEK ESTATES

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>6256919</b>	Facility Name: <b>CEDAR CREEK ESTATES TP</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
ARSENIC - 1005	1 Sample(s) Required between 1/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 12/31/2018
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH6204112 CEDAR CREEK ESTATES

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>CEDAR CREEK ESTATES DISTRIBUTION</b>
	SMP ID: <b>DS000</b>	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>CEDAR CREEK ESTATES DISTRIBUTION</b>
	SMP ID: <b>DS201</b>	<b>ADDRESS NOT KNOWN</b>

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>CEDAR CREEK ESTATES DISTRIBUTION</b>
	SMP ID: <b>LC###</b>	<b>Refer to your Lead and Copper plan for SMP IDs</b>

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH6205011 OTTAWA COUNTY REGIONAL WATER DISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>6256925</b> SMP ID: <b>EP001</b>	Facility Name: <b>OTTAWA COUNTY REGIONAL WATER DISTRICT</b> Facility Source: <b>Surface Water</b>	Facility Class: <b>CLASS 4</b>
--------------------------	---	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 1/31/2018 1 Sample(s) Required between 2/1/2018 and 2/28/2018 1 Sample(s) Required between 3/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 4/30/2018 1 Sample(s) Required between 5/1/2018 and 5/31/2018 1 Sample(s) Required between 6/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 7/31/2018 1 Sample(s) Required between 8/1/2018 and 8/31/2018 1 Sample(s) Required between 9/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 10/31/2018 1 Sample(s) Required between 11/1/2018 and 11/30/2018 1 Sample(s) Required between 12/1/2018 and 12/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2018 and 6/30/2018
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 4/1/2018 and 6/30/2018
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 1/1/2018 and 1/31/2018 1 Paired Sample Set Required between 2/1/2018 and 2/28/2018 1 Paired Sample Set Required between 3/1/2018 and 3/31/2018 1 Paired Sample Set Required between 4/1/2018 and 4/30/2018 1 Paired Sample Set Required between 5/1/2018 and 5/31/2018 1 Paired Sample Set Required between 6/1/2018 and 6/30/2018 1 Paired Sample Set Required between 7/1/2018 and 7/31/2018 1 Paired Sample Set Required between 8/1/2018 and 8/31/2018 1 Paired Sample Set Required between 9/1/2018 and 9/30/2018 1 Paired Sample Set Required between 10/1/2018 and 10/31/2018 1 Paired Sample Set Required between 11/1/2018 and 11/30/2018 1 Paired Sample Set Required between 12/1/2018 and 12/31/2018

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



Effective Date: 01/19/2018

2018 ENTRY POINT SCHEDULE

**OH6205011 OTTAWA COUNTY REGIONAL WATER DISTRICT**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>6256925</b>	Facility Name: <b>OTTAWA COUNTY REGIONAL WATER DISTRICT</b>
<b>Location</b>	SMP ID: <b>EP001/LT2001</b>	Facility Source: <b>Surface Water</b> Facility Class: <b>CLASS 4</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

**Chemicals**

**Monitoring Requirements**

TOTAL MICROCYSTINS

1 Sample Set Required WEEKLY\*

*Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. A week is defined as Sunday through Saturday.*

*\*Weekly sampling unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. Reduced monitoring is contingent on a public water system continuing to experience NO raw or finished water total microcystins detections. Any total microcystins detections during routine (weekly) or reduced sampling will trigger additional sampling. Please refer to the website above for specifics on follow-up sampling requirements.*



OH6205011 OTTAWA COUNTY REGIONAL WATER DISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling</b>	Facility ID: <b>6256925</b>	Facility Name: <b>OTTAWA COUNTY REGIONAL WATER DISTRICT</b>
<b>Location</b>	SMP ID: <b>LT2001</b>	Facility Source: <b>Surface Water</b> Facility Class: <b>CLASS 4</b>

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
-----------	-------------------------

CYANOBACTERIA SCREENING	1 Sample(s) Required between 12/31/2017 and 1/6/2018
	1 Sample(s) Required between 1/14/2018 and 1/20/2018
	1 Sample(s) Required between 1/28/2018 and 2/3/2018
	1 Sample(s) Required between 2/11/2018 and 2/17/2018
	1 Sample(s) Required between 2/25/2018 and 3/3/2018
	1 Sample(s) Required between 3/11/2018 and 3/17/2018
	1 Sample(s) Required between 3/25/2018 and 3/31/2018
	1 Sample(s) Required between 4/8/2018 and 4/14/2018
	1 Sample(s) Required between 4/22/2018 and 4/28/2018
	1 Sample(s) Required between 5/6/2018 and 5/12/2018
	1 Sample(s) Required between 5/20/2018 and 5/26/2018
	1 Sample(s) Required between 6/3/2018 and 6/9/2018
	1 Sample(s) Required between 6/17/2018 and 6/23/2018
	1 Sample(s) Required between 7/1/2018 and 7/7/2018
	1 Sample(s) Required between 7/15/2018 and 7/21/2018
	1 Sample(s) Required between 7/29/2018 and 8/4/2018
	1 Sample(s) Required between 8/12/2018 and 8/18/2018
	1 Sample(s) Required between 8/26/2018 and 9/1/2018
	1 Sample(s) Required between 9/9/2018 and 9/15/2018
	1 Sample(s) Required between 9/23/2018 and 9/29/2018
1 Sample(s) Required between 10/7/2018 and 10/13/2018	
1 Sample(s) Required between 10/21/2018 and 10/27/2018	
1 Sample(s) Required between 11/4/2018 and 11/10/2018	
1 Sample(s) Required between 11/18/2018 and 11/24/2018	
1 Sample(s) Required between 12/2/2018 and 12/8/2018	
1 Sample(s) Required between 12/16/2018 and 12/22/2018	

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. As of 12/31/17, all public water systems are responsible for contracting with a lab certified to perform cyanobacteria screening (qPCR). Please review the website for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections, and certified labs that can perform analysis.

LT2 MONITORING	1 Sample(s) Required between 1/1/2018 and 1/5/2018
	1 Sample(s) Required between 2/3/2018 and 2/7/2018
	1 Sample(s) Required between 3/3/2018 and 3/7/2018
	1 Sample(s) Required between 3/31/2018 and 4/4/2018
	1 Sample(s) Required between 4/30/2018 and 5/4/2018
	1 Sample(s) Required between 6/2/2018 and 6/6/2018
	1 Sample(s) Required between 6/30/2018 and 7/4/2018

Monitor for: Cryptosporidium - 2078, E-coli count - 3014, Turbidity - 0100

LT2 MATRIX SPIKE SAMPLE	1 Sample(s) Required between 3/31/2018 and 4/4/2018
-------------------------	---



**OH6205011 OTTAWA COUNTY REGIONAL WATER DISTRICT**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>OTTAWA COUNTY REGIONAL DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	20 Sample(s) Required between 1/1/2018 and 1/31/2018
	20 Sample(s) Required between 2/1/2018 and 2/28/2018
	20 Sample(s) Required between 3/1/2018 and 3/31/2018
	20 Sample(s) Required between 4/1/2018 and 4/30/2018
	20 Sample(s) Required between 5/1/2018 and 5/31/2018
	20 Sample(s) Required between 6/1/2018 and 6/30/2018
	20 Sample(s) Required between 7/1/2018 and 7/31/2018
	20 Sample(s) Required between 8/1/2018 and 8/31/2018
	20 Sample(s) Required between 9/1/2018 and 9/30/2018
	20 Sample(s) Required between 10/1/2018 and 10/31/2018
	20 Sample(s) Required between 11/1/2018 and 11/30/2018
	20 Sample(s) Required between 12/1/2018 and 12/31/2018
TOTAL CHLORINE - 1000	20 Sample(s) Required between 1/1/2018 and 1/31/2018
	20 Sample(s) Required between 2/1/2018 and 2/28/2018
	20 Sample(s) Required between 3/1/2018 and 3/31/2018
	20 Sample(s) Required between 4/1/2018 and 4/30/2018
	20 Sample(s) Required between 5/1/2018 and 5/31/2018
	20 Sample(s) Required between 6/1/2018 and 6/30/2018
	20 Sample(s) Required between 7/1/2018 and 7/31/2018
	20 Sample(s) Required between 8/1/2018 and 8/31/2018
	20 Sample(s) Required between 9/1/2018 and 9/30/2018
	20 Sample(s) Required between 10/1/2018 and 10/31/2018
	20 Sample(s) Required between 11/1/2018 and 11/30/2018
	20 Sample(s) Required between 12/1/2018 and 12/31/2018

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>OTTAWA COUNTY REGIONAL DISTRIBUTION</b> <b>DANBURY TOWER</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2018 and 2/7/2018at: DS201
	Dual Sample Required between 5/1/2018 and 5/7/2018at: DS201
	Dual Sample Required between 8/1/2018 and 8/7/2018at: DS201
	Dual Sample Required between 11/1/2018 and 11/7/2018at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH6205011 OTTAWA COUNTY REGIONAL WATER DISTRICT**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>OTTAWA COUNTY REGIONAL DISTRIBUTION</b> <b>CATAWBA TOWER</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2018 and 2/7/2018at: DS202
	Dual Sample Required between 5/1/2018 and 5/7/2018at: DS202
	Dual Sample Required between 8/1/2018 and 8/7/2018at: DS202
	Dual Sample Required between 11/1/2018 and 11/7/2018at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS203</b>	Facility Name: <b>OTTAWA COUNTY REGIONAL DISTRIBUTION</b> <b>STATE OF OHIO ST.RT. 2 REST AREA</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2018 and 2/7/2018at: DS203
	Dual Sample Required between 5/1/2018 and 5/7/2018at: DS203
	Dual Sample Required between 8/1/2018 and 8/7/2018at: DS203
	Dual Sample Required between 11/1/2018 and 11/7/2018at: DS203

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS204</b>	Facility Name: <b>OTTAWA COUNTY REGIONAL DISTRIBUTION</b> <b>9400 NORTH SHORE BLVD</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2018 and 2/7/2018at: DS204
	Dual Sample Required between 5/1/2018 and 5/7/2018at: DS204
	Dual Sample Required between 8/1/2018 and 8/7/2018at: DS204
	Dual Sample Required between 11/1/2018 and 11/7/2018at: DS204

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>LC###</b>	Facility Name: <b>OTTAWA COUNTY REGIONAL DISTRIBUTION</b> <b>Refer to your Lead and Copper plan for SMP IDs</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required





OH6205111 CARROLL WATER AND SEWER

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>6256927</b>	Facility Name: <b>CARROLL WATER AND SEWER</b>	Facility Class: <b>CLASS 3</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Surface Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
BROMATE - 1011	1 Sample(s) Required between 1/1/2018 and 1/31/2018 1 Sample(s) Required between 2/1/2018 and 2/28/2018 1 Sample(s) Required between 3/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 4/30/2018 1 Sample(s) Required between 5/1/2018 and 5/31/2018 1 Sample(s) Required between 6/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 7/31/2018 1 Sample(s) Required between 8/1/2018 and 8/31/2018 1 Sample(s) Required between 9/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 10/31/2018 1 Sample(s) Required between 11/1/2018 and 11/30/2018 1 Sample(s) Required between 12/1/2018 and 12/31/2018
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 1/31/2018 1 Sample(s) Required between 2/1/2018 and 2/28/2018 1 Sample(s) Required between 3/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 4/30/2018 1 Sample(s) Required between 5/1/2018 and 5/31/2018 1 Sample(s) Required between 6/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 7/31/2018 1 Sample(s) Required between 8/1/2018 and 8/31/2018 1 Sample(s) Required between 9/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 10/31/2018 1 Sample(s) Required between 11/1/2018 and 11/30/2018 1 Sample(s) Required between 12/1/2018 and 12/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2018 and 6/30/2018
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 10/1/2018 and 12/31/2018
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 1/1/2018 and 1/31/2018 1 Paired Sample Set Required between 2/1/2018 and 2/28/2018 1 Paired Sample Set Required between 3/1/2018 and 3/31/2018 1 Paired Sample Set Required between 4/1/2018 and 4/30/2018 1 Paired Sample Set Required between 5/1/2018 and 5/31/2018 1 Paired Sample Set Required between 6/1/2018 and 6/30/2018 1 Paired Sample Set Required between 7/1/2018 and 7/31/2018



**OH6205111 CARROLL WATER AND SEWER**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>6256927</b>	Facility Name: <b>CARROLL WATER AND SEWER</b>	
<b>Location</b>	SMP ID: <b>EP001</b>	Facility Source: <b>Surface Water</b>	Facility Class: <b>CLASS 3</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

<b>Chemicals</b>	<b>Monitoring Requirements</b>		
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between	8/1/2018 and	8/31/2018
	1 Paired Sample Set Required between	9/1/2018 and	9/30/2018
	1 Paired Sample Set Required between	10/1/2018 and	10/31/2018
	1 Paired Sample Set Required between	11/1/2018 and	11/30/2018
	1 Paired Sample Set Required between	12/1/2018 and	12/31/2018

**A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.**



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

**OH6205111 CARROLL WATER AND SEWER**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>6256927</b>	Facility Name: <b>CARROLL WATER AND SEWER</b>	
<b>Location</b>	SMP ID: <b>EP001/LT2001</b>	Facility Source: <b>Surface Water</b>	Facility Class: <b>CLASS 3</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

**Chemicals**

**Monitoring Requirements**

TOTAL MICROCYSTINS

1 Sample Set Required WEEKLY\*

*Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. A week is defined as Sunday through Saturday.*

*\*Weekly sampling unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. Reduced monitoring is contingent on a public water system continuing to experience NO raw or finished water total microcystins detections. Any total microcystins detections during routine (weekly) or reduced sampling will trigger additional sampling. Please refer to the website above for specifics on follow-up sampling requirements.*



**OH6205111 CARROLL WATER AND SEWER**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>6256927</b>	Facility Name: <b>CARROLL WATER AND SEWER</b>	
<b>Location</b>	SMP ID: <b>LT2001</b>	Facility Source: <b>Surface Water</b>	Facility Class: <b>CLASS 3</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
------------------	--------------------------------

CYANOBACTERIA SCREENING	1 Sample(s) Required between 12/31/2017 and 1/6/2018
	1 Sample(s) Required between 1/14/2018 and 1/20/2018
	1 Sample(s) Required between 1/28/2018 and 2/3/2018
	1 Sample(s) Required between 2/11/2018 and 2/17/2018
	1 Sample(s) Required between 2/25/2018 and 3/3/2018
	1 Sample(s) Required between 3/11/2018 and 3/17/2018
	1 Sample(s) Required between 3/25/2018 and 3/31/2018
	1 Sample(s) Required between 4/8/2018 and 4/14/2018
	1 Sample(s) Required between 4/22/2018 and 4/28/2018
	1 Sample(s) Required between 5/6/2018 and 5/12/2018
	1 Sample(s) Required between 5/20/2018 and 5/26/2018
	1 Sample(s) Required between 6/3/2018 and 6/9/2018
	1 Sample(s) Required between 6/17/2018 and 6/23/2018
	1 Sample(s) Required between 7/1/2018 and 7/7/2018
	1 Sample(s) Required between 7/15/2018 and 7/21/2018
	1 Sample(s) Required between 7/29/2018 and 8/4/2018
	1 Sample(s) Required between 8/12/2018 and 8/18/2018
	1 Sample(s) Required between 8/26/2018 and 9/1/2018
	1 Sample(s) Required between 9/9/2018 and 9/15/2018
	1 Sample(s) Required between 9/23/2018 and 9/29/2018
1 Sample(s) Required between 10/7/2018 and 10/13/2018	
1 Sample(s) Required between 10/21/2018 and 10/27/2018	
1 Sample(s) Required between 11/4/2018 and 11/10/2018	
1 Sample(s) Required between 11/18/2018 and 11/24/2018	
1 Sample(s) Required between 12/2/2018 and 12/8/2018	
1 Sample(s) Required between 12/16/2018 and 12/22/2018	

*Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. As of 12/31/17, all public water systems are responsible for contracting with a lab certified to perform cyanobacteria screening (qPCR). Please review the website for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections, and certified labs that can perform analysis.*

**OH6205111 CARROLL WATER AND SEWER**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>CARROLL WATER AND SEWER DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 6/1/2018 and 6/30/2018
	2 Sample(s) Required between 7/1/2018 and 7/31/2018
	2 Sample(s) Required between 8/1/2018 and 8/31/2018
	2 Sample(s) Required between 9/1/2018 and 9/30/2018
	2 Sample(s) Required between 10/1/2018 and 10/31/2018
	2 Sample(s) Required between 11/1/2018 and 11/30/2018
	2 Sample(s) Required between 12/1/2018 and 12/31/2018
TOTAL CHLORINE - 1000	2 Sample(s) Required between 6/1/2018 and 6/30/2018
	2 Sample(s) Required between 7/1/2018 and 7/31/2018
	2 Sample(s) Required between 8/1/2018 and 8/31/2018
	2 Sample(s) Required between 9/1/2018 and 9/30/2018
	2 Sample(s) Required between 10/1/2018 and 10/31/2018
	2 Sample(s) Required between 11/1/2018 and 11/30/2018
	2 Sample(s) Required between 12/1/2018 and 12/31/2018

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>CARROLL WATER AND SEWER DISTRIBUTION</b> <b>11861 W SALEM CARROLL RD</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/8/2018 and 2/14/2018at: DS201
	Dual Sample Required between 5/8/2018 and 5/14/2018at: DS201
	Dual Sample Required between 8/8/2018 and 8/14/2018at: DS201
	Dual Sample Required between 11/8/2018 and 11/14/2018at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>CARROLL WATER AND SEWER DISTRIBUTION</b> <b>11080 W TOUSSAINT E RD</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/8/2018 and 2/14/2018at: DS202
	Dual Sample Required between 5/8/2018 and 5/14/2018at: DS202
	Dual Sample Required between 8/8/2018 and 8/14/2018at: DS202
	Dual Sample Required between 11/8/2018 and 11/14/2018at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2018

2018 DISTRIBUTION SCHEDULE

**OH6205111 CARROLL WATER AND SEWER**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>CARROLL WATER AND SEWER DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>LC###</b>	<b>Refer to your Lead and Copper plan for SMP IDs</b>	

**Chemicals**

**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022

Not Required

**OH6230412 BENCHMORE FARMS AMLC 2**

System Type: Transient Noncommunity

Operating Period: 7/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **BENCHMORE FARMS AMLC 2 DISTRIBUTION**  
**Location** SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**

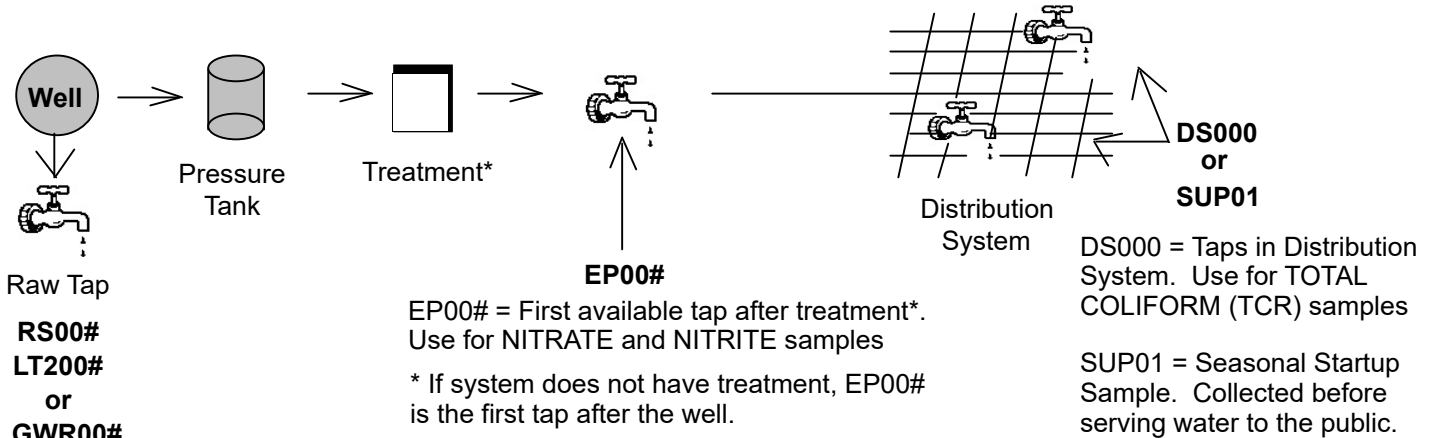

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6230412 BENCHMORE FARMS AMLC 2**

System Type: Transient Noncommunity

Operating Period: 7/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> BENCHMORE FARMS AMLC 2 DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018

**Where to Collect Samples For a Small Public Water System**

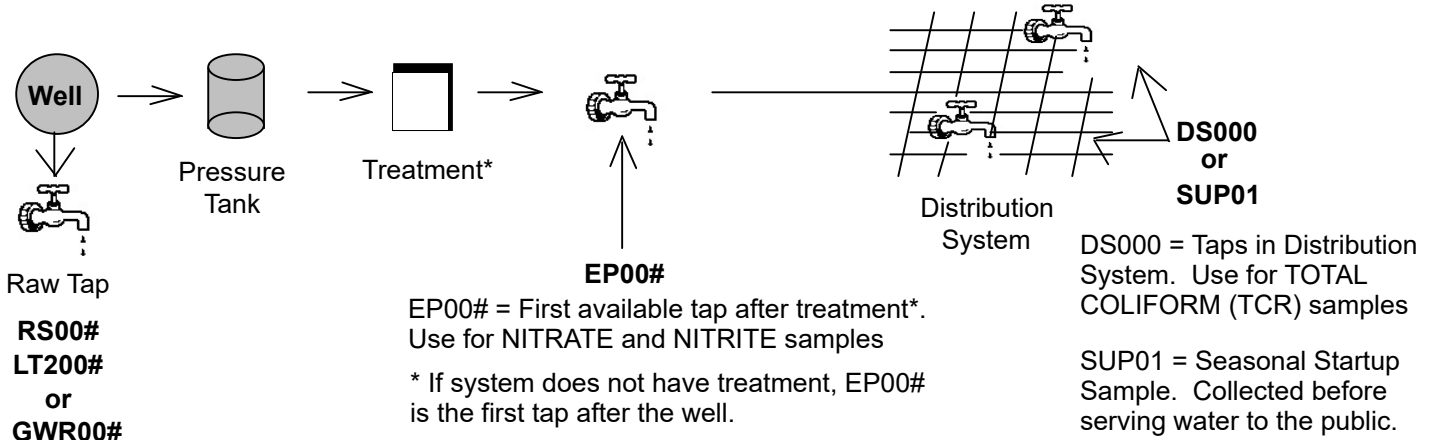

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH6230412 BENCHMORE FARMS AMLC 2**

System Type: Transient Noncommunity

Operating Period: 7/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: 6256928 Facility Name: BENCHMORE FARMS AMLC NO 2

**Location** SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6230512 BETHEL UNITED BROTHERS CHURCH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> BETHEL UNITED BROTHERS C DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6230512 BETHEL UNITED BRETHREN CHURCH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 6256929 Facility Name: BETHEL UNITED BRETHREN CHURCH**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6230612 BLACKBERRY CORNERS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> BLACKBERRY CORNERS DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6230612 BLACKBERRY CORNERS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 6256930 Facility Name: BLACKBERRY CORNERS**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6230912 ERNESTOS RESTAURANT**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **ERNESTOS RESTAURANT DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6230912 ERNESTOS RESTAURANT**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 6256932 Facility Name: ERNESTOS RESTAURANT**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6232012 COUNTRY KEG RESTAURANT**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> COUNTRY KEG, LLC DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH6232012 COUNTRY KEG RESTAURANT**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 6256941 Facility Name: COUNTRY KEG RESTAURANT**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

OH6232612 HILLE/ROTHERT AMLC

System Type: Transient Noncommunity

Operating Period: 5/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

Sampling Facility ID: **DS1** Facility Name: **HILLE/ROTHERT AMLC DISTRIBUTION**  
 Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6232612 HILLE/ROTHERT AMLC**

System Type: Transient Noncommunity

Operating Period: 5/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1 Facility Name: HILLE/ROTHERT AMLC DISTRIBUTION**  
**Location SMP ID: DS000 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/15/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018

**Where to Collect Samples For a Small Public Water System**

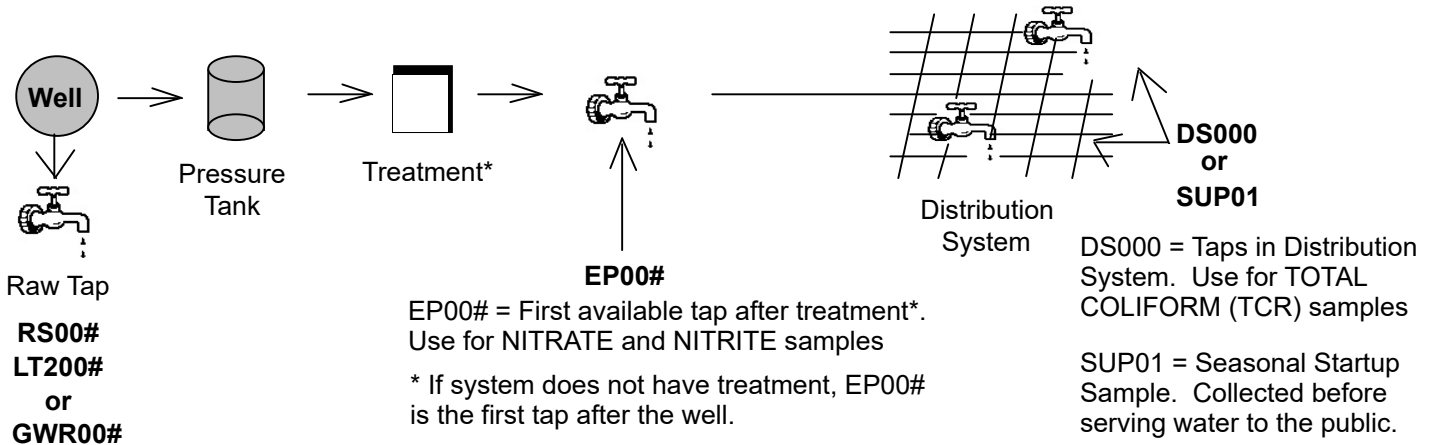

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6232612 HILLE/ROTHERT AMLC**

System Type: Transient Noncommunity

Operating Period: 5/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 6256944 Facility Name: HILLE/ROTHERT AMLC**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 12/31/2018

**Where to Collect Samples For a Small Public Water System**

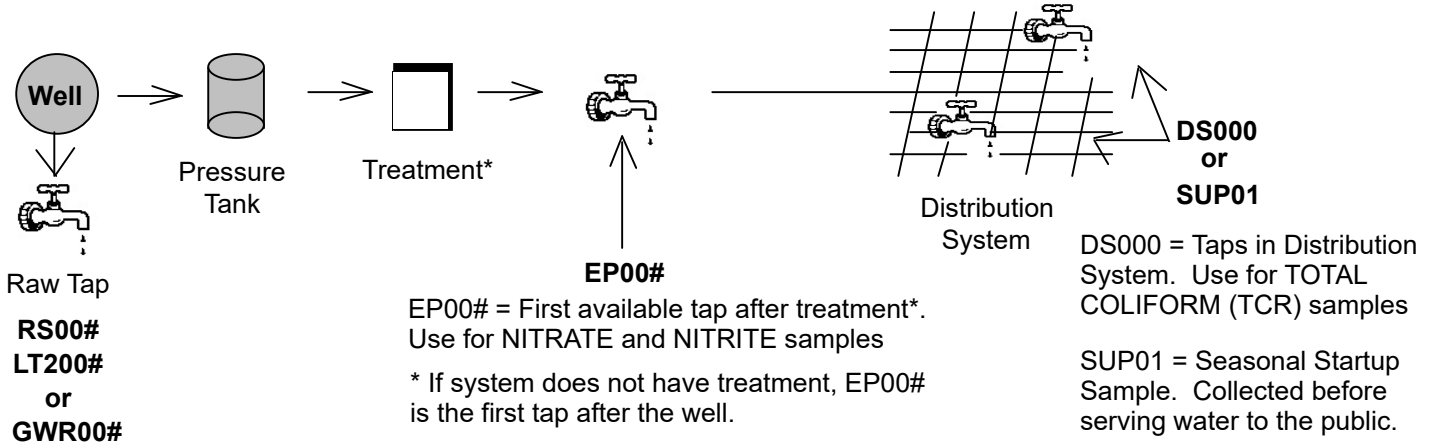

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6233212 TRI MOTOR SALES**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **TRI MOTOR SALES INC. DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6233212 TRI MOTOR SALES**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 6256948 Facility Name: TRI MOTOR SALES INC**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6233512 GRACE LUTHERAN CHURCH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> GRACE LUTHERAN CHURCH DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6233512 GRACE LUTHERAN CHURCH**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 6256949 Facility Name: GRACE LUTHERAN CHURCH**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**





Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

**OH6233812 NORTH POINT EDUCATION SERVICE CTR OTTAWA**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>6256952</b>	Facility Name: <b>NORTH POINT EDUCATION SERVICE CTR SCHOOL</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



**OH6233812 NORTH POINT EDUCATION SERVICE CTR OTTAWA**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>NORTH POINT EDUCATION SERV DISTRIBUTIC</b>
--------------------------	---	--

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>NORTH POINT EDUCATION SERV DISTRIBUTIC</b> <b>ADDRESS NOT KNOWN</b>
--------------------------	---	--

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>LC###</b>	Facility Name: <b>NORTH POINT EDUCATION SERV DISTRIBUTIC</b> <b>Refer to your Lead and Copper plan for SMP IDs</b>
--------------------------	---	---

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

**OH6234112 HASSELKUS AMLC**

System Type: Transient Noncommunity

Operating Period: 5/1 to 8/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **6256953** Facility Name: **HASSELKUS AMLC**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 12/31/2018

**Where to Collect Samples For a Small Public Water System**

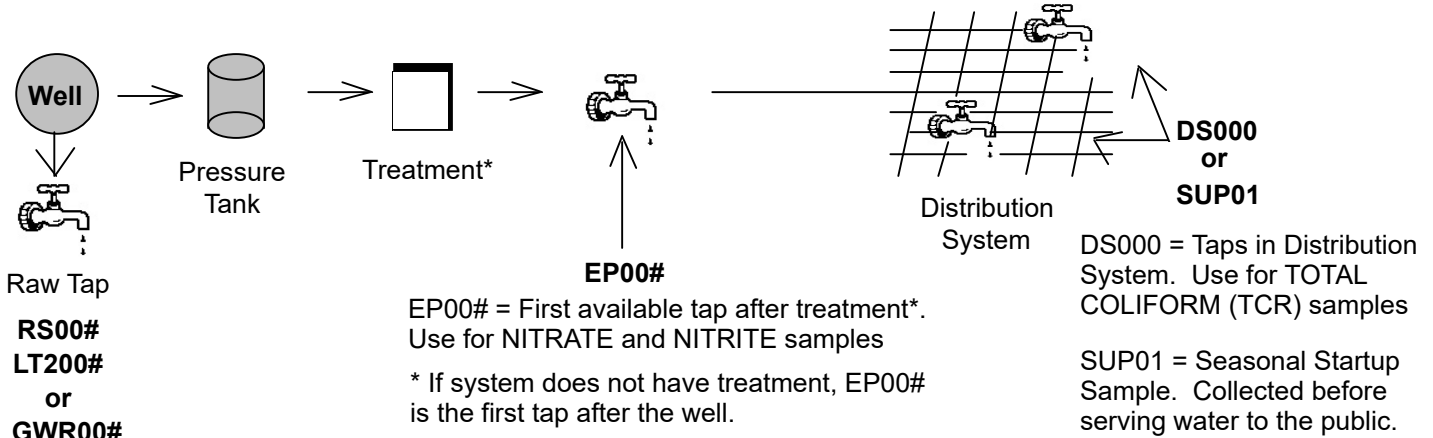

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6234412 LUCKEY HOMESTEAD FARMS AMLC PWS**

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1 Facility Name: LUCKEY HOMESTEAD FARM AM DISTRIBUTION**  
**Location SMP ID: SUP01 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**

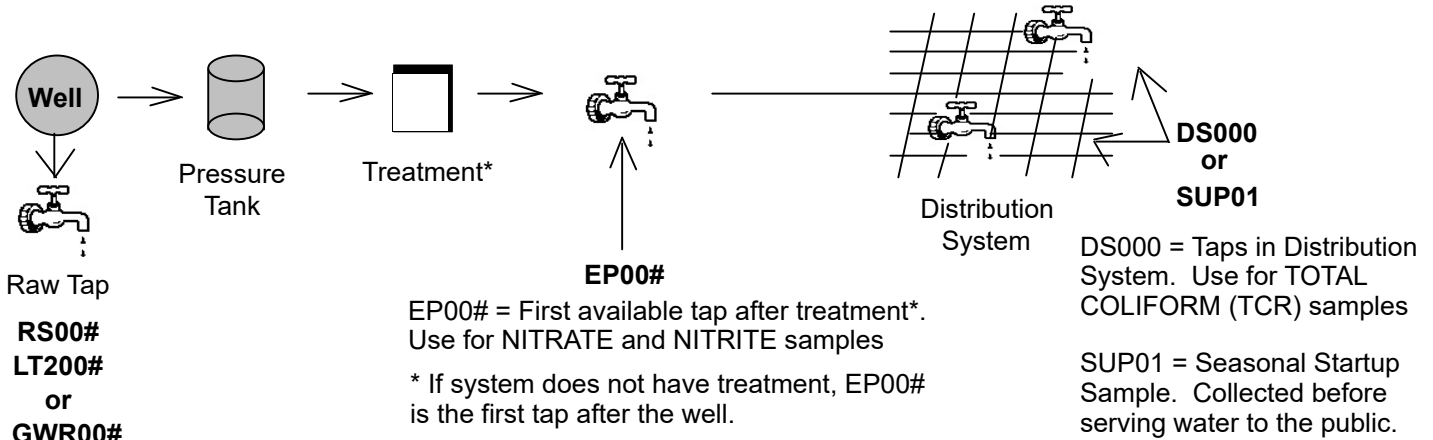

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6234412 LUCKEY HOMESTEAD FARMS AMLC PWS**

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> LUCKEY HOMESTEAD FARM AM DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 6/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018

**Where to Collect Samples For a Small Public Water System**

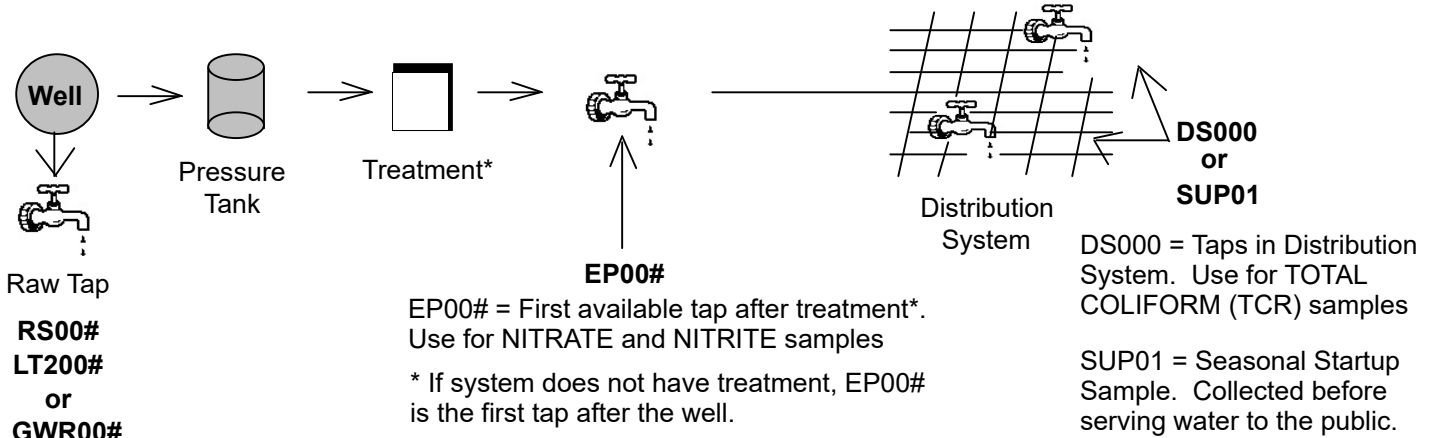

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6234412 LUCKEY HOMESTEAD FARMS AMLC PWS**

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 6256955 Facility Name: LUCKEY HOMESTEAD FARMS AMLC**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6235212 LIMESTONE TAVERN**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **LIMESTONE TAVERN DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6235212 LIMESTONE TAVERN**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 6256956 Facility Name: LIMESTONE TAVERN**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH6237012 ROTHERT AMLC**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **ROTHERT AMLC DISTRIBUTION**  
**Location** SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6237012 ROTHERT AMLC**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1 Facility Name: ROTHERT AMLC DISTRIBUTION**  
**Location SMP ID: DS000 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/24/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**

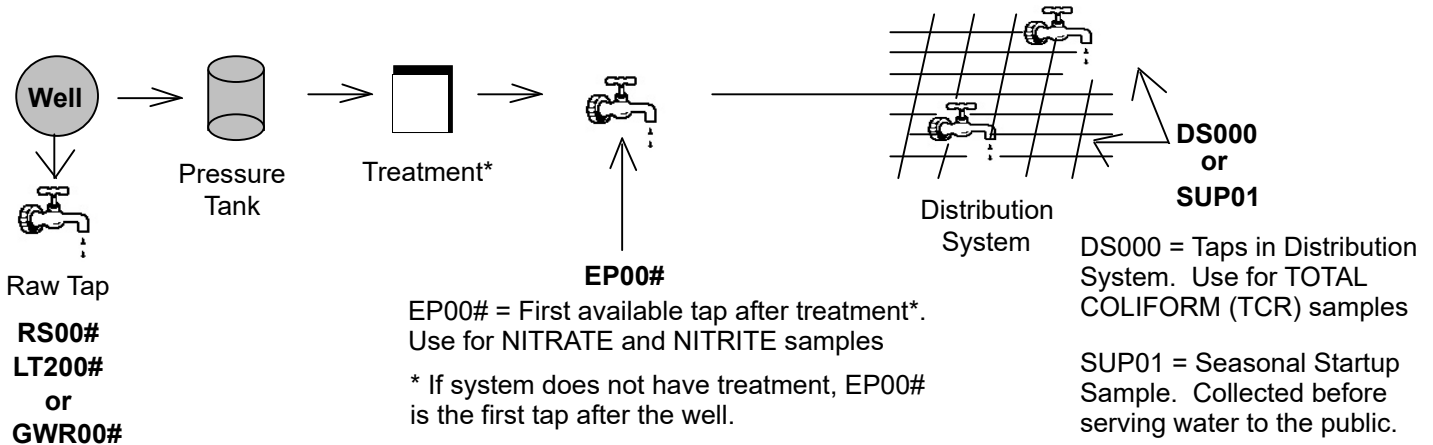

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6237012 ROTHERT AMLC**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **6256965** Facility Name: **ROTHERT AMLC**  
**Location** SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 12/31/2018

**Where to Collect Samples For a Small Public Water System**

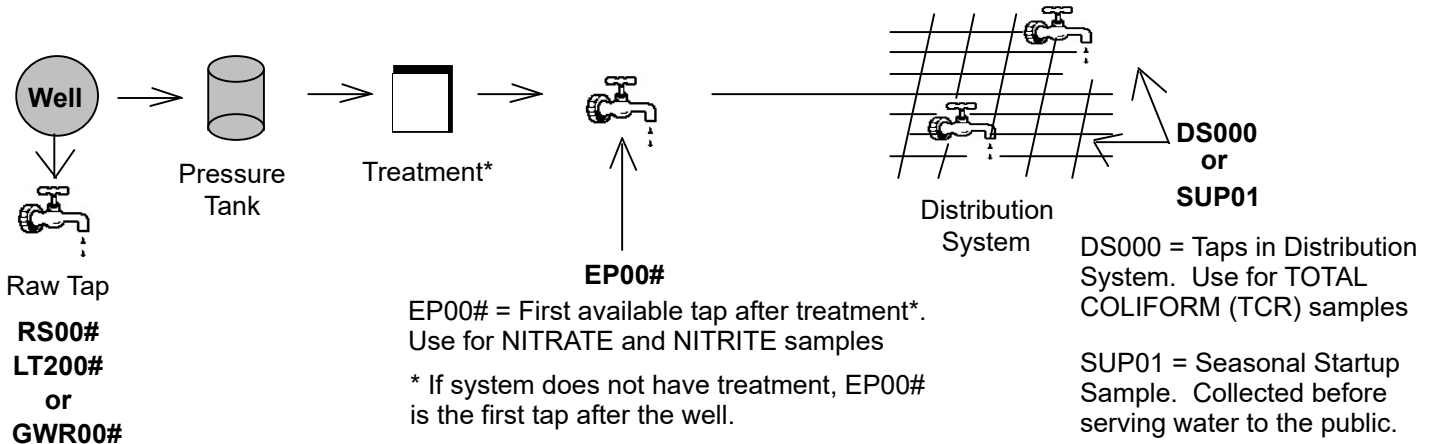

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6238012 ST JOHN LUTHERAN CHURCH ROCKY RIDGE**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> ST JOHN LUTHERAN CHURCH DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6238012 ST JOHN LUTHERAN CHURCH ROCKY RIDGE**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 6256970 Facility Name: SAINT JOHN LUTHERAN CHURCH**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



Effective Date: 07/13/2018

2018 ENTRY POINT SCHEDULE

OH6238112 ST PETERS LUTHERAN CHURCH/PRESCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>6256971</b>	Facility Name: <b>ST PETERS LUTHERAN CHURCH &amp; DAYCARE</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018



Effective Date: 07/13/2018

2018 DISTRIBUTION SCHEDULE

**OH6238112 ST PETERS LUTHERAN CHURCH/PRESCHOOL**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>ST PETERS LUTHERAN CHURCH &amp; DAYCARE</b>
	SMP ID: <b>DS000</b>	

**Chemicals**

**Monitoring Requirements**

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2018	and	3/31/2018
	1 Sample(s) Required between	4/1/2018	and	6/30/2018
	1 Sample(s) Required between	7/1/2018	and	9/30/2018
	1 Sample(s) Required between	10/1/2018	and	12/31/2018

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>ST PETERS LUTHERAN CHURCH &amp; DAYCARE</b>
	SMP ID: <b>LC###</b>	<b>Refer to your Lead and Copper plan for SMP IDs</b>

**Chemicals**

**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between	7/1/2018	and	12/31/2018
-------------------------------	------------------------------	----------	-----	------------

*Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.*

**OH6238412 CRAZY LADY SALOON**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> CRAZY LADY SALOON DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

**Where to Collect Samples For a Small Public Water System**

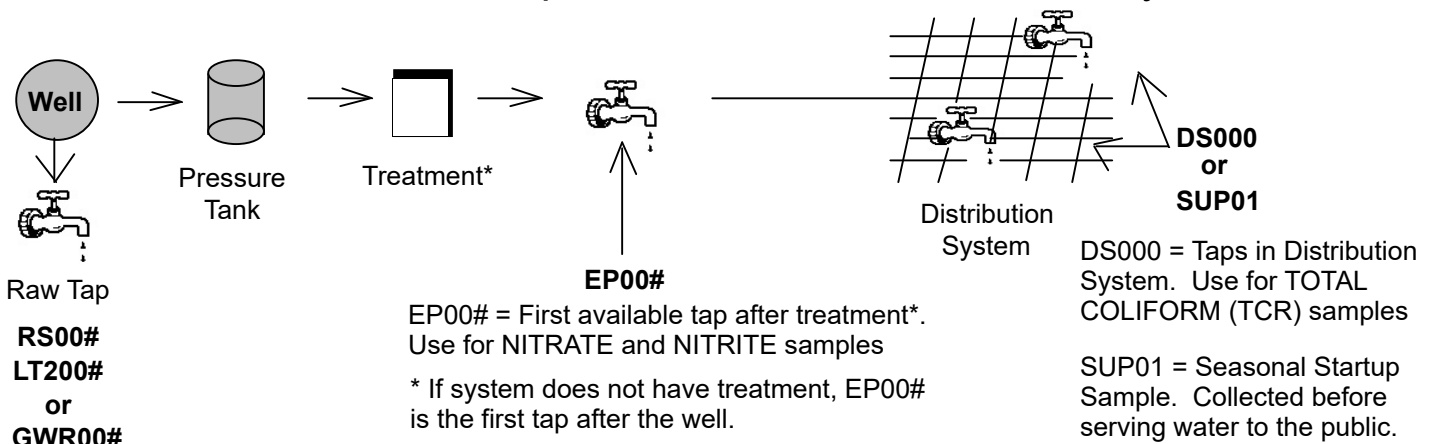

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH6238412 CRAZY LADY SALOON**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: 6256972 Facility Name: CRAZY LADY SALOON  
**Location** SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6238812 BENCH-SCHULTE FARMS AMLC PWS**

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **BENCH-SCHULTE FARMS AMLC DISTRIBUTION**  
**Location** SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**

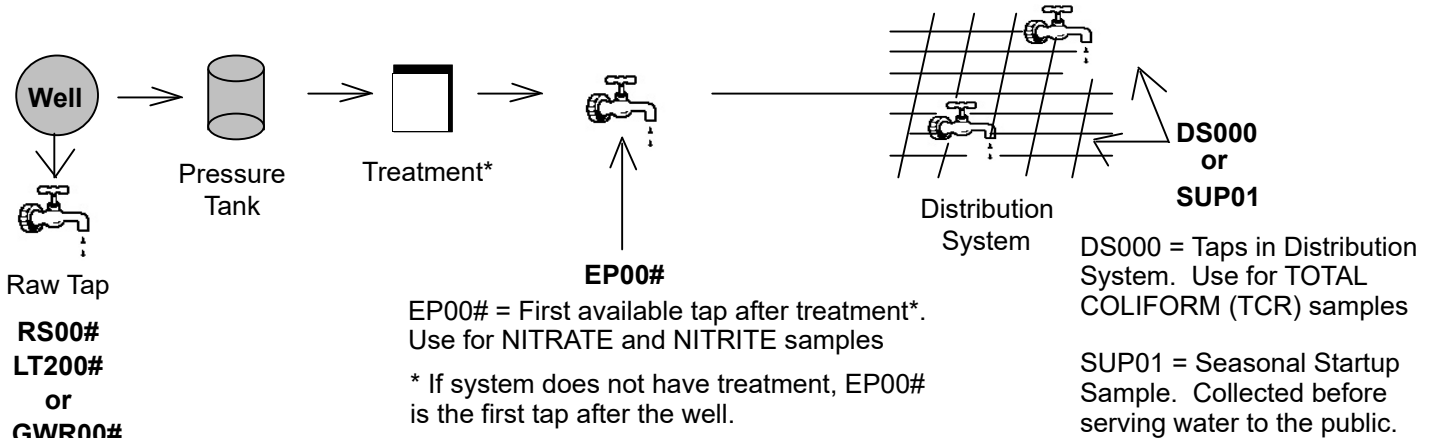

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6238812 BENCH-SCHULTE FARMS AMLC PWS**

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> BENCH-SCHULTE FARMS AMLC DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 6/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018

**Where to Collect Samples For a Small Public Water System**

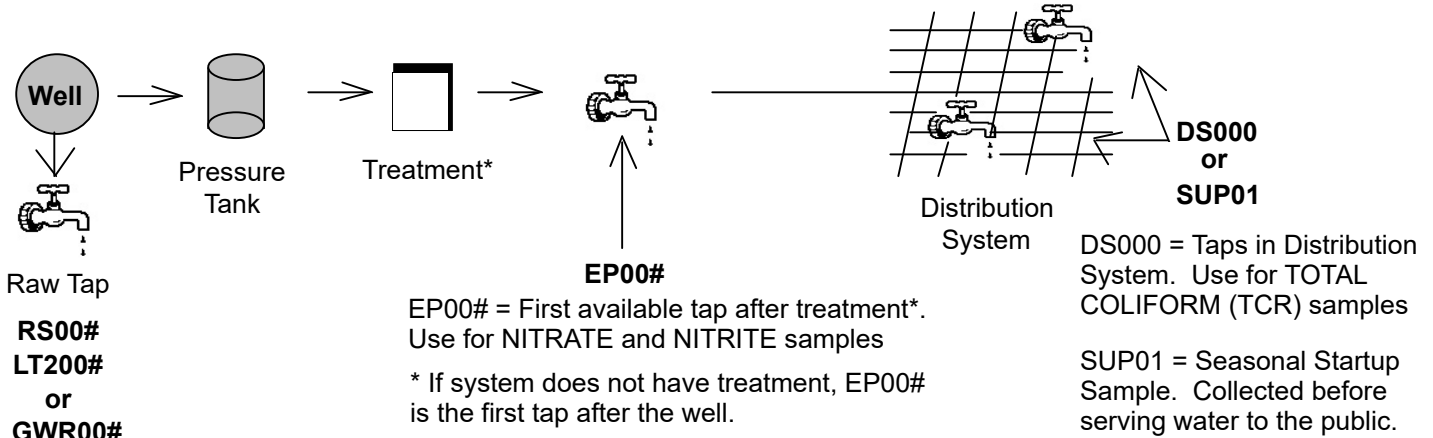

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6238812 BENCH-SCHULTE FARMS AMLC PWS**

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 6256973 Facility Name: SCHULTE AMLC**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6240712 CEDARLANE RV PARK**

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **CEDARLANE RV PARK DISTRIBUTION**  
**Location** SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6240712 CEDARLANE RV PARK**

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1 Facility Name: CEDARLANE RV PARK DISTRIBUTION**  
**Location SMP ID: DS000 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 10/15/2018

**Where to Collect Samples For a Small Public Water System**

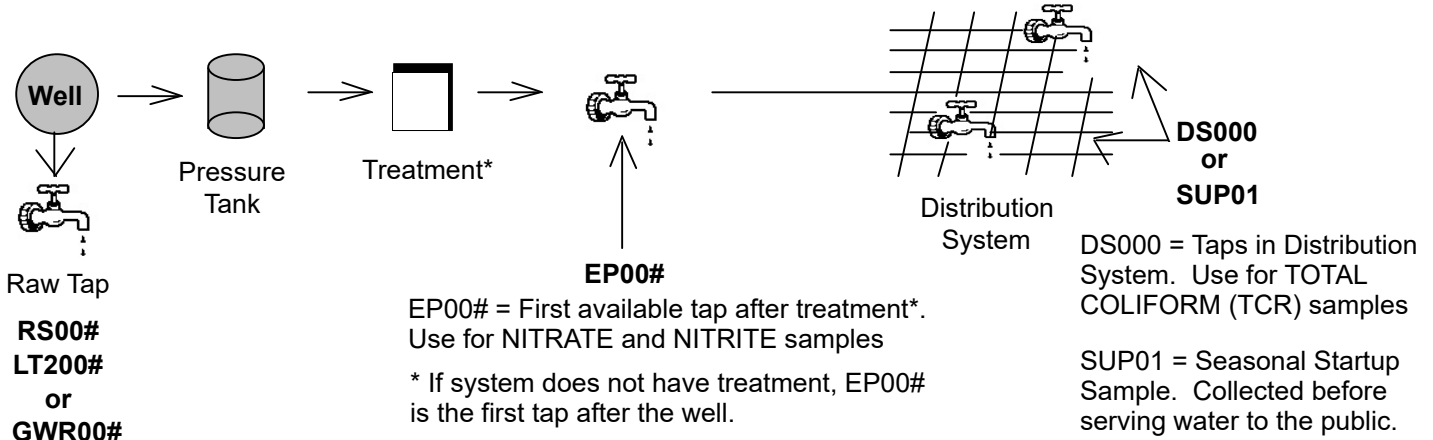

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6240712 CEDARLANE RV PARK**

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 6256980	<b>Facility Name:</b> CEDARLANE CAMPGROUND
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water
<b>Facility Class:</b> CLASS A	

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6241012 CHIPPEWA GOLF CLUB**

System Type: Transient Noncommunity

Operating Period: 4/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **CHIPPEWA GOLF CLUB DISTRIBUTION**  
**Location** SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH6241012 CHIPPEWA GOLF CLUB**

System Type: Transient Noncommunity

Operating Period: 4/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> CHIPPEWA GOLF CLUB DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

**Where to Collect Samples For a Small Public Water System**

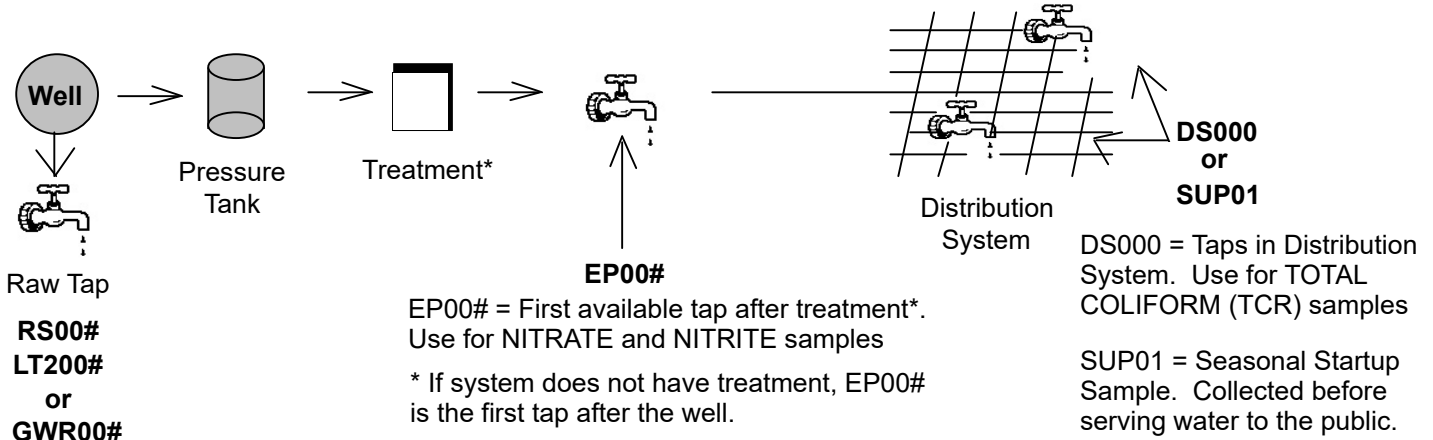

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6241012 CHIPPEWA GOLF CLUB**

System Type: Transient Noncommunity

Operating Period: 4/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 6256981 Facility Name: CHIPPEWA GOLF CLUB**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6242112 HANKS ON THE BAY REAR WELL**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**


<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> HANKS PLACE-WEST-WELL DISTRIBUTION
<b>Location SMP ID:</b> SUP01	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
-----------	-------------------------

TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public
-----------------------------------	---

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**

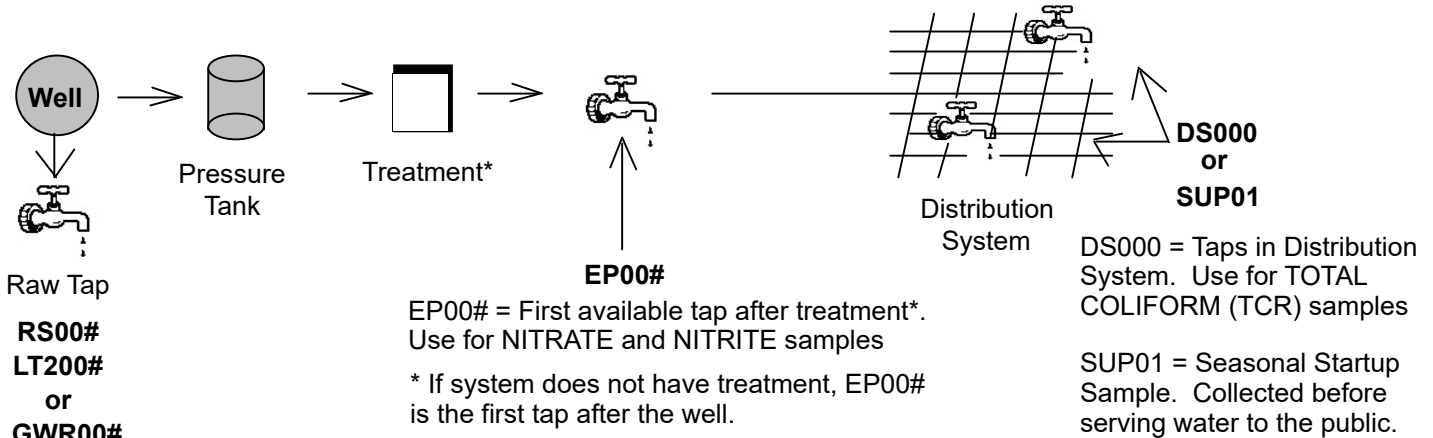

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6242112 HANKS ON THE BAY REAR WELL**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> HANKS PLACE-WEST-WELL DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/15/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/15/2018

**Where to Collect Samples For a Small Public Water System**

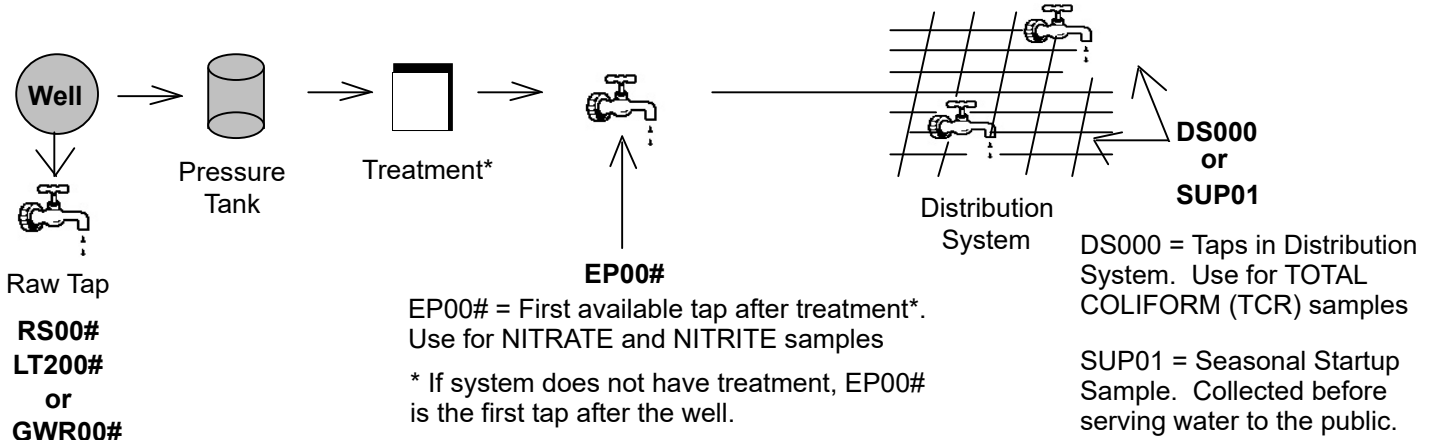

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6242112 HANKS ON THE BAY REAR WELL**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 6256990 Facility Name: HANKS PLACE WEST WELL**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6242212 HANKS ON THE BAY FRONT WELL**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **HANKS PLACE-EAST WELL DISTRIBUTION**  
**Location** SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6242212 HANKS ON THE BAY FRONT WELL**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> HANKS PLACE-EAST WELL DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/15/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/15/2018

**Where to Collect Samples For a Small Public Water System**

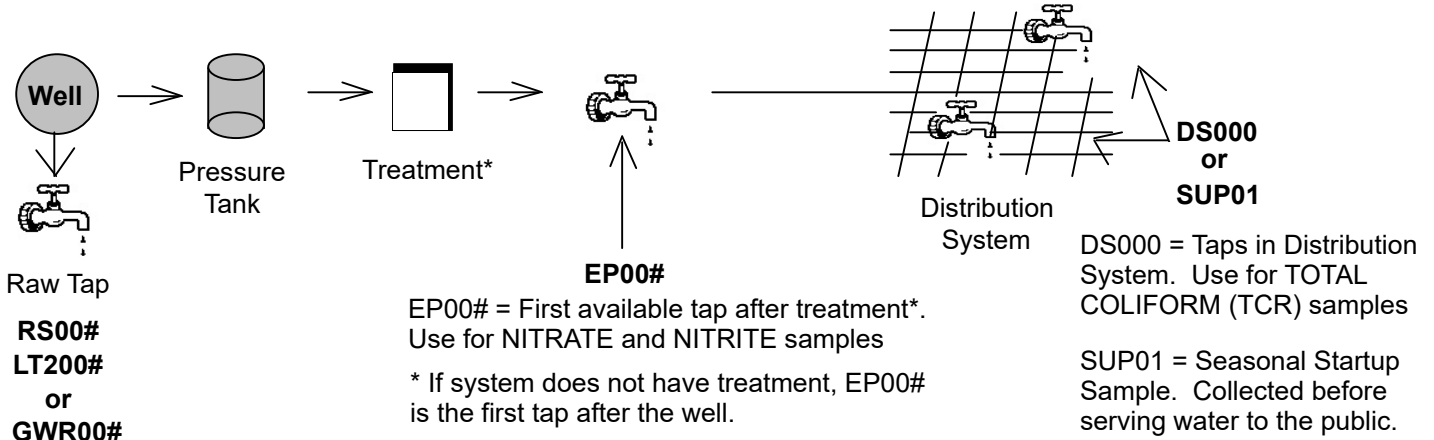

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6242212 HANKS ON THE BAY FRONT WELL**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 6256991 Facility Name: HANKS PLACE EAST WELL**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH6245212 SHADE ACRES CAMPGROUND AND RV PARK**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **SHADE ACRES CAMPGROUND & DISTRIBUTION**  
**Location** SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**

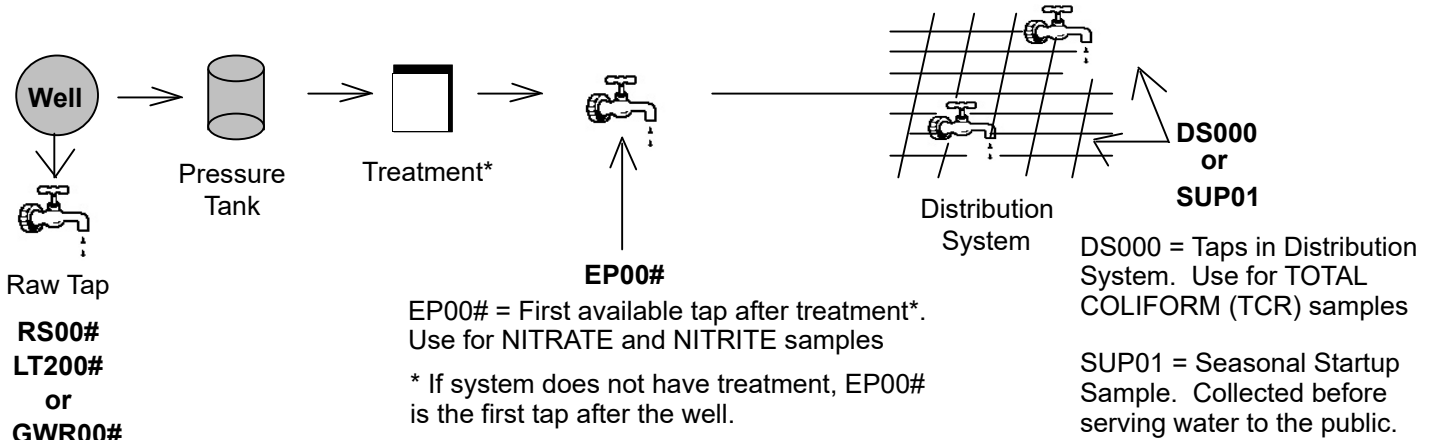

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6245212 SHADE ACRES CAMPGROUND AND RV PARK**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> SHADE ACRES CAMPGROUND & DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/15/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**

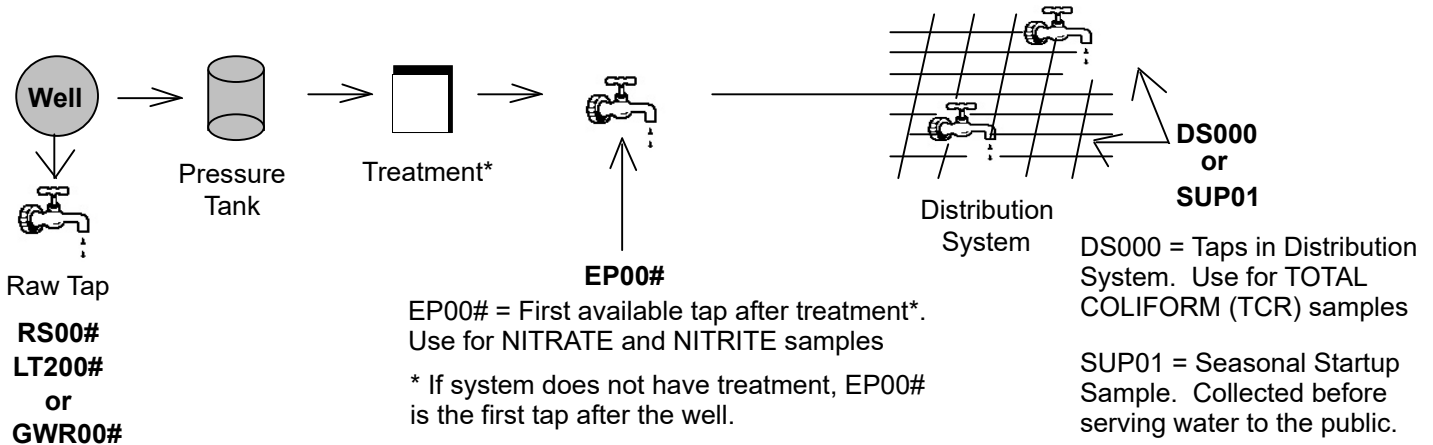

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6245212 SHADE ACRES CAMPGROUND AND RV PARK**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 6257010 Facility Name: SHADE ACRES CAMPGROUND & RV PK**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6246212 SUGAR CREEK GOLF CLUB**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> SUGAR CREEK GOLF CLUB DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6246212 SUGAR CREEK GOLF CLUB**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 6257015 Facility Name: SUGAR CREEK GOLF CLUB**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH6254112 GRAYMONT DOLIME (OH)

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>6257057</b>	Facility Name: <b>GRAYMONT DOLIME OH INC</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



**OH6254112 GRAYMONT DOLIME (OH)**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Location** Facility ID: **DS1** Facility Name: **GRAYMONT DOLIME (OH) INC DISTRIBUTION**  
SMP ID: **DS000**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

**Sampling Location** Facility ID: **DS1** Facility Name: **GRAYMONT DOLIME (OH) INC DISTRIBUTION**  
SMP ID: **DS201** ADDRESS NOT KNOWN

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

**Sampling Location** Facility ID: **DS1** Facility Name: **GRAYMONT DOLIME (OH) INC DISTRIBUTION**  
SMP ID: **LC###** Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/19/2018

2018 ENTRY POINT SCHEDULE

**OH6254612 THE RESORT AT ERIE LANDINGS**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>6257062</b>	Facility Name: <b>THE RESORT AT ERIE LANDINGS</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 4/1/2018 and 6/30/2018





OH6254612 THE RESORT AT ERIE LANDINGS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>RESORT ERIE LANDINGS DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2018 and 9/30/2018at: DS000

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
- 2) TTHM - 2950

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>LC###</b>	Facility Name: <b>RESORT ERIE LANDINGS DISTRIBUTION</b> <b>Refer to your Lead and Copper plan for SMP IDs</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 1/1/2018 and 6/30/2018 5 Sample(s) Required between 7/1/2018 and 12/31/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/01/2018

2018 DISTRIBUTION SCHEDULE

**OH6254612 THE RESORT AT ERIE LANDINGS**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2018**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>SUP01</b>	Facility Name: <b>RESORT ERIE LANDINGS DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals**

**Monitoring Requirements**

TOTAL COLIFORM - SEASONAL STARTUP

At least 1 negative Total Coliform  
Bacteria sample prior to serving  
water to the public

**\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\***

**OH6254712 BENCHMORE FARMS AMLC 1**

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **BENCHMORE FARMS AMLC 1 DISTRIBUTION**  
**Location** SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6254712 BENCHMORE FARMS AMLC 1**

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: 6257063 Facility Name: BENCHMORE FARMS AMLC NO 1  
**Location** SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6256812 BENCH-DICKINSON AMLC PWS**

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> BENCH-DICKINSON AMLC DISTRIBUTION
<b>Location SMP ID:</b> SUP01	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**

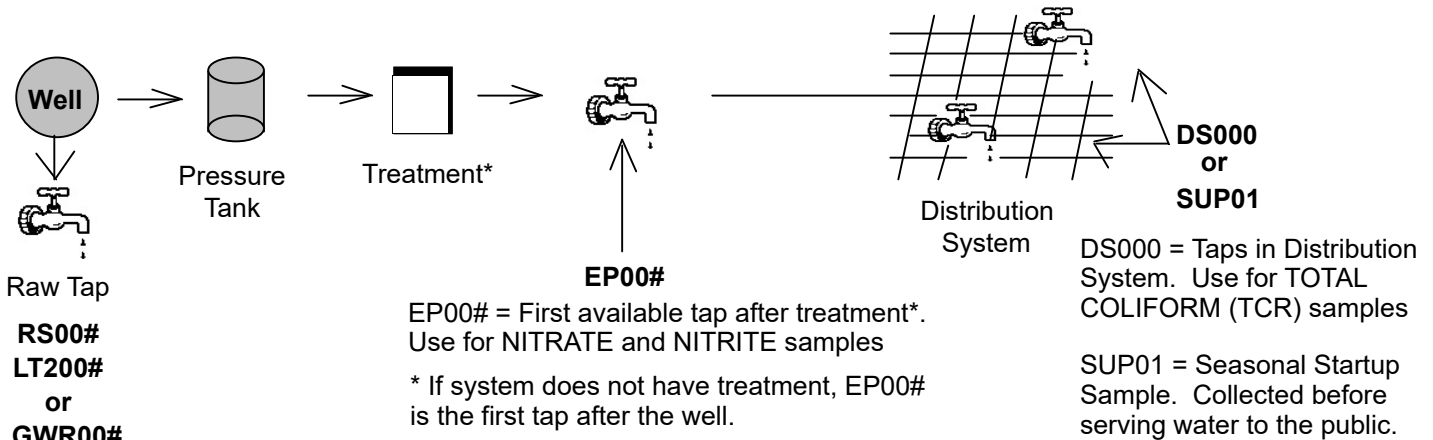

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6256812 BENCH-DICKINSON AMLC PWS**

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1 Facility Name: BENCH-DICKINSON AMLC DISTRIBUTION**

**Location SMP ID: DS000 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 6/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018

**Where to Collect Samples For a Small Public Water System**

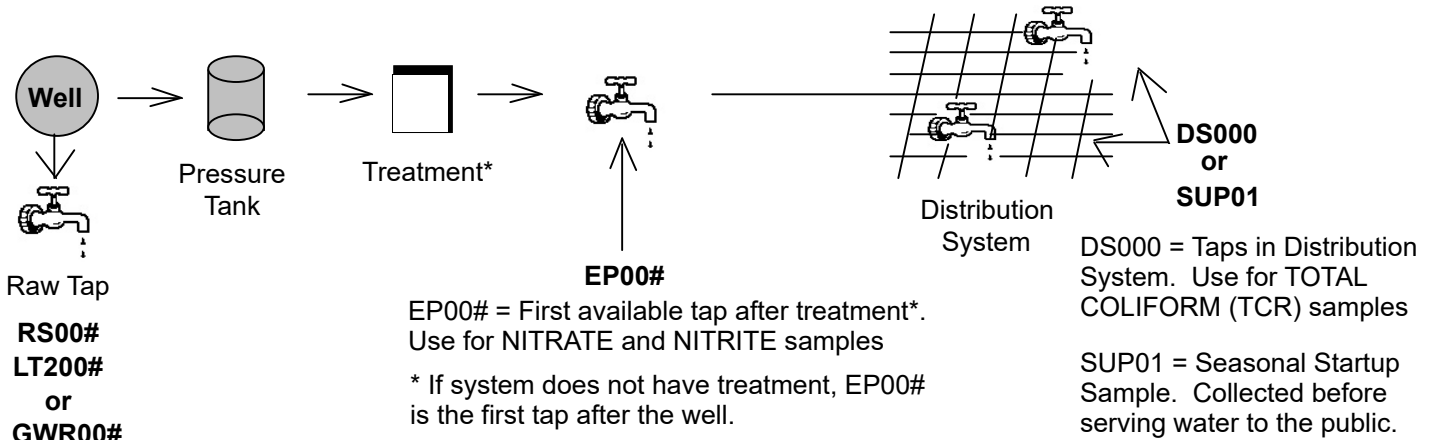

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6256812 BENCH-DICKINSON AMLC PWS**

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: 6257079 Facility Name: DICKINSON AMLC

**Location** SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6256912 BENCH, ROBERT AMLC PWS**

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **BENCH, ROBERT AMLC DISTRIBUTION**  
**Location** SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH6256912 BENCH, ROBERT AMLC PWS**

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> BENCH, ROBERT AMLC DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/8/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018

**Where to Collect Samples For a Small Public Water System**

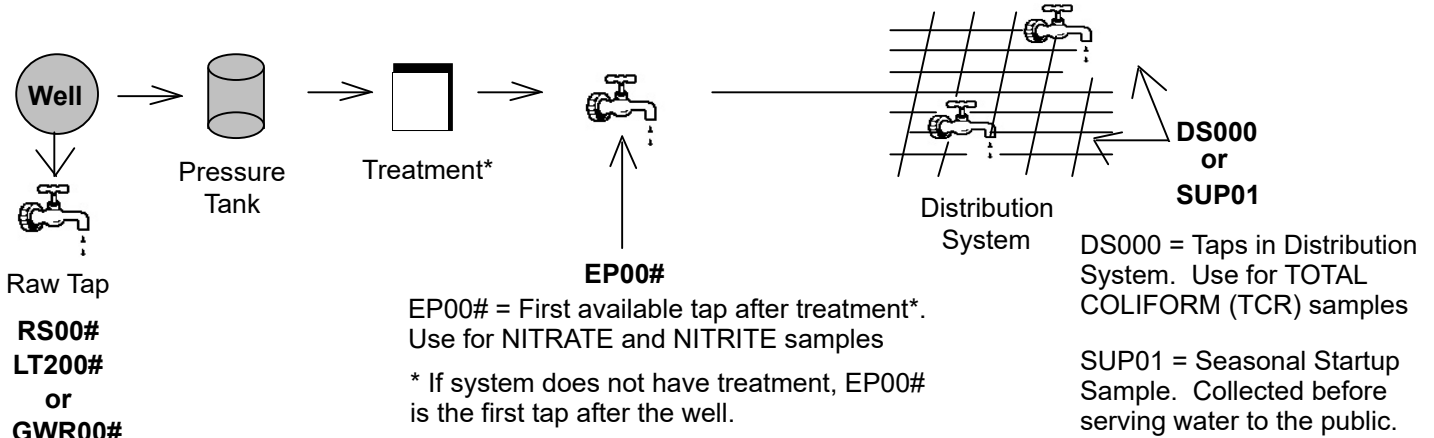

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6256912 BENCH, ROBERT AMLC PWS**

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 6257080 Facility Name: BENCH ROBERT AMLC**

**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

**OH6257412 GRACE BAPTIST CHURCH- OAK HARBOR**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>6257085</b>	Facility Name: <b>GRACE BAPTIST CHURCH</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
ARSENIC - 1005	1 Sample(s) Required between 1/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 12/31/2018
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between and



**OH6257412 GRACE BAPTIST CHURCH- OAK HARBOR**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>GRACE BAPTIST CHURCH DISTRIBUTION</b>
	SMP ID: <b>DS000</b>	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>GRACE BAPTIST CHURCH DISTRIBUTION</b>
	SMP ID: <b>LC###</b>	<b>Refer to your Lead and Copper plan for SMP IDs</b>

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2018 and 9/30/2018

*Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.*

**OH6258112 ST HAZARDS**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **ST. HAZARDS DISTRIBUTION**  
**Location** SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6258112 ST HAZARDS**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1 Facility Name: ST. HAZARDS DISTRIBUTION**  
**Location SMP ID: DS000 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/20/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 11/30/2018

**Where to Collect Samples For a Small Public Water System**

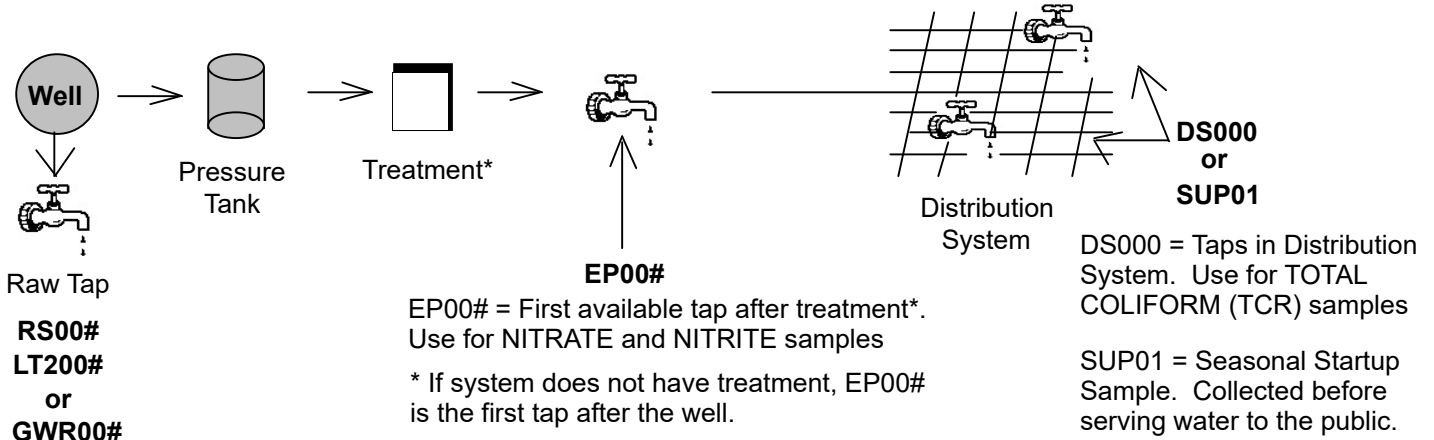

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6258112 ST HAZARDS**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 6257089	<b>Facility Name:</b> ST HAZARDS	
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water	<b>Facility Class:</b> CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6258712 FISHY BUSINESS, INC DBA J.F. WALLEYE**

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **J.F. WALLEYE MICRO-BREWE DISTRIBUTION**  
**Location** SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH6258712 FISHY BUSINESS, INC DBA J.F. WALLEYE**

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> J.F. WALLEYE MICRO-BREWE DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**

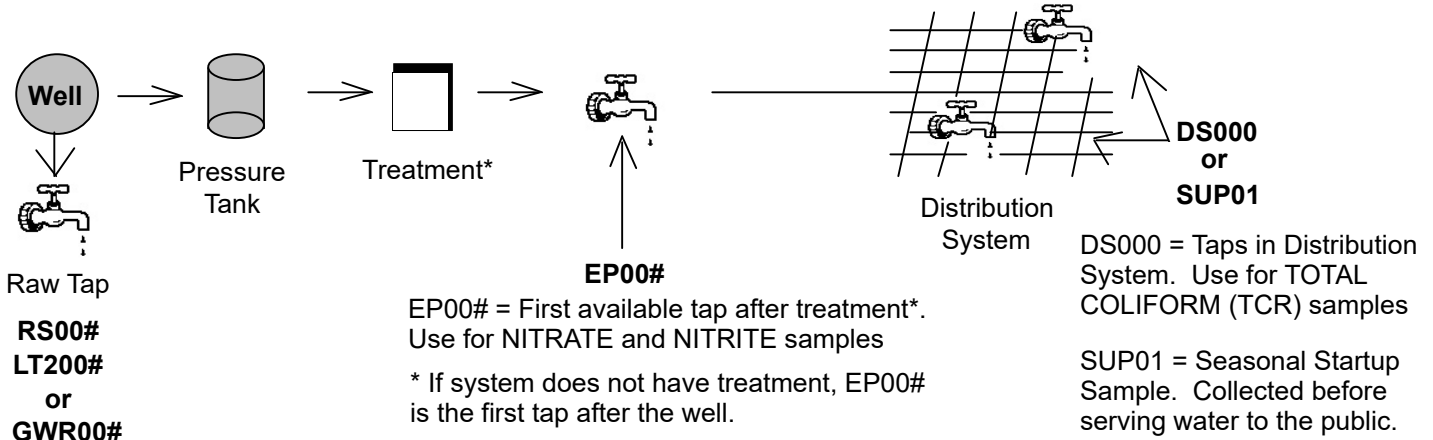

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6258712 FISHY BUSINESS, INC DBA J.F. WALLEYE**

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 6257094	<b>Facility Name:</b> JF WALLEYE MICRO BREWERY
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water
	<b>Facility Class:</b> CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6259112 ZION UNITED METHODIST CHURCH -GRAYTOWN**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1 Facility Name: ZION UNITED METHODIST CHURCH DISTRIBUTIO**  
**Location SMP ID: DS000 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

**Where to Collect Samples For a Small Public Water System**

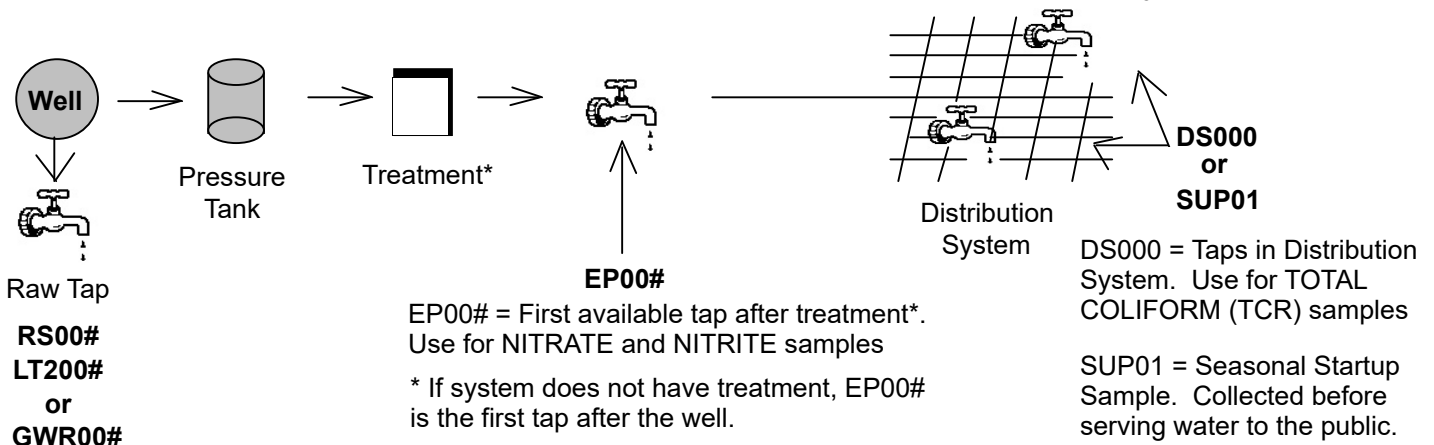

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH6259112 ZION UNITED METHODIST CHURCH -GRAYTOWN**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 6260732 Facility Name: ZION UNITED METHODIST CHURCH**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**