


# Section 303(d) Public Drinking Water Supply Use Categories Watershed Assessment Units

Ohio 2016 Integrated Report

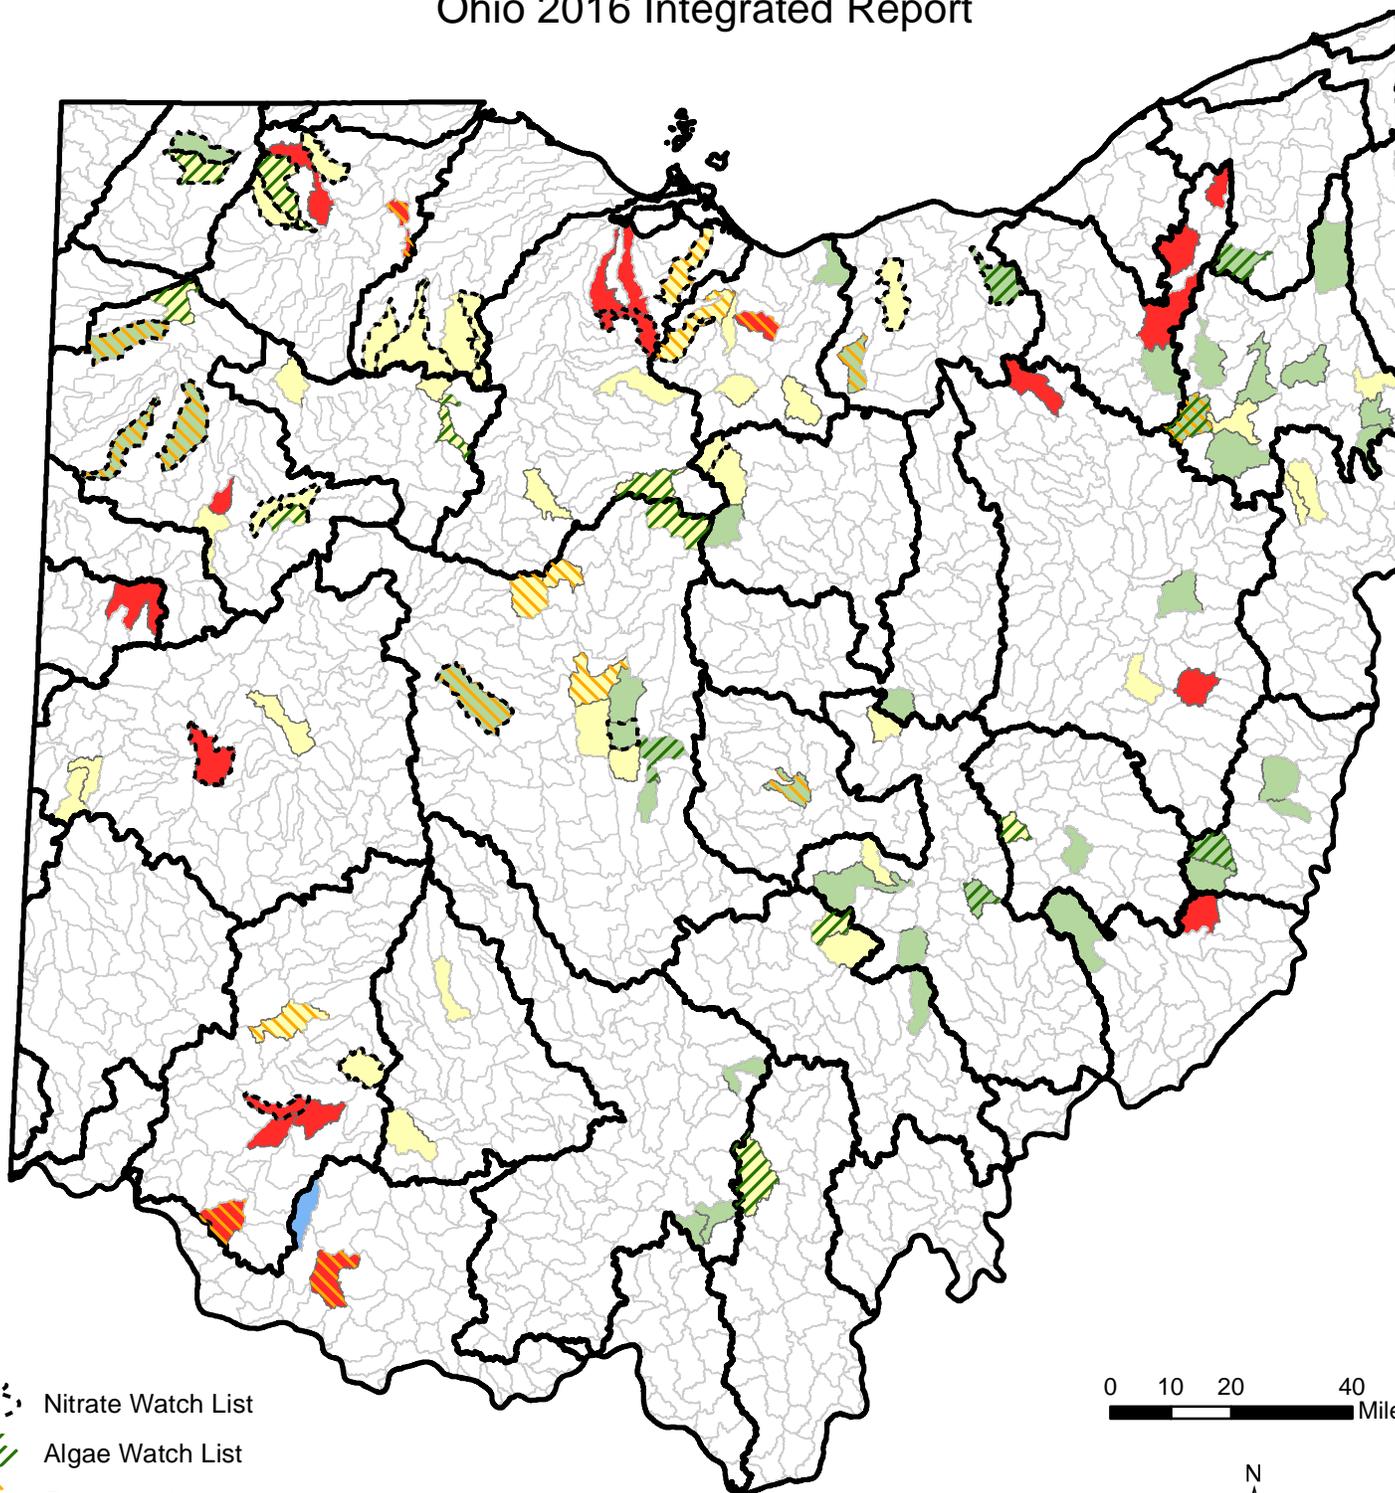

-  Nitrate Watch List
-  Algae Watch List
-  Pesticide Watch List
-  8-digit hydrologic units
-  0 - No waters currently utilized as PWS
-  1 - Use is fully supported
-  3/3i - No data or insufficient data
-  4A - TMDL approved
-  5 - Use is not supported

0 10 20 40  
Miles



Updated 6/27/2016