

2008 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH3100012 PWS NAME: ADDYSTON VILLAGE PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STU ID: 3154741 STU NAME: ADDYSTON VILLAGE OF

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE (AS N) - 1040	1 Sample(s) between 1/1/2008 and 5/31/2008
NITRITE	NITRITE (AS N) - 1041	Not Required
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

REMINDER: Consumer Confidence Report (CCR) is due July 1, 2008

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
<i>NITRATE Sample Date(s):</i>
<i>Date CCR sent to Ohio EPA:</i>

2008 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH3100012 PWS NAME: ADDYSTON VILLAGE PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: ADDYSTON, VILLAGE OF DISTRIBUTION

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	10 Sample(s) between 6/1/2008 and 9/30/2008
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** Not Required
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Monthly between 1/1/2008 and 12/31/2008
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
<i>Lead & Copper Sample Date(s):</i>												
<i>TCR Monthly Sample Date(s):</i>	<i>Jan</i>	<i>Feb</i>	<i>Mar</i>	<i>Apr</i>	<i>May</i>	<i>Jun</i>	<i>Jul</i>	<i>Aug</i>	<i>Sept</i>	<i>Oct</i>	<i>Nov</i>	<i>Dec</i>
<i>Total Chlorine Sample Date(s):</i>												

2008 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH3100112 PWS NAME: RED WOOD MOBILE HOME PARK

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STU ID: 3154742 STU NAME: RED WOOD MHP

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE (AS N) - 1040	1 Sample(s) Quarterly
NITRITE	NITRITE (AS N) - 1041	Not Required
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 2 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 4 List Below	1 Sample(s) between 4/1/2008 and 6/30/2008

REMINDER: Consumer Confidence Report (CCR) is due July 1, 2008

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

SOC Group 2 Chemicals: CARBOFURAN - 2046, OXAMYL (VYDATE) - 2036, PICLORAM - 2040, 2,4-D - 2105, PENTACHLOROPHENOL - 2326

SOC Group 4 Chemicals: BENZO (A) PYRENE - 2306, ENDOTHALL - 2033, DI(2-ETHYLHEXYL) - ADIPATE - 2035, DI(2-ETHYLHEXYL) - PHTHALATE - 2034

Use for Sample Tracking Purposes				
	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)
<i>NITRATE Quarterly Sample Date(s):</i>				
<i>SOC Group 4 Sample Date(s):</i>				
<i>Date CCR sent to Ohio EPA:</i>				

2008 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH3100512 PWS NAME: CLEVES VILLAGE PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STU ID: 3154746 STU NAME: CLEVES VILLAGE

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE (AS N) - 1040	1 Sample(s) between 1/1/2008 and 5/31/2008
NITRITE	NITRITE (AS N) - 1041	Not Required
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 2 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 4 List Below	1 Sample(s) between 4/1/2008 and 6/30/2008

REMINDER: Consumer Confidence Report (CCR) is due July 1, 2008

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

SOC Group 2 Chemicals: CARBOFURAN - 2046, OXAMYL (VYDATE) - 2036, PICLORAM - 2040, 2,4-D - 2105, PENTACHLOROPHENOL - 2326

SOC Group 4 Chemicals: BENZO (A) PYRENE - 2306, ENDOTHALL - 2033, DI(2-ETHYLHEXYL) - ADIPATE - 2035, DI(2-ETHYLHEXYL) - PHTHALATE - 2034

Use for Sample Tracking Purposes
<i>NITRATE Sample Date(s):</i>
<i>SOC Group 4 Sample Date(s):</i>
<i>Date CCR sent to Ohio EPA:</i>

2008 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH3100612 PWS NAME: DRY FORK MHP

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STU ID: 3154747 STU NAME: DRY FORK MHP

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE (AS N) - 1040	1 Sample(s) between 1/1/2008 and 5/31/2008
NITRITE	NITRITE (AS N) - 1041	Not Required
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 2 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 4 List Below	1 Sample(s) between 4/1/2008 and 6/30/2008

REMINDER: Consumer Confidence Report (CCR) is due July 1, 2008

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

SOC Group 2 Chemicals: CARBOFURAN - 2046, OXAMYL (VYDATE) - 2036, PICLORAM - 2040, 2,4-D - 2105, PENTACHLOROPHENOL - 2326

SOC Group 4 Chemicals: BENZO (A) PYRENE - 2306, ENDOTHALL - 2033, DI(2-ETHYLHEXYL) - ADIPATE - 2035, DI(2-ETHYLHEXYL) - PHTHALATE - 2034

Use for Sample Tracking Purposes
<i>NITRATE Sample Date(s):</i>
<i>SOC Group 4 Sample Date(s):</i>
<i>Date CCR sent to Ohio EPA:</i>

2008 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH3100612 PWS NAME: DRY FORK MHP

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: DRY FORK MOBILE HOME PAR DISTRIBUTION

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	5 Sample(s) between 6/1/2008 and 9/30/2008
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) between 7/1/2008 and 9/30/2008
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Monthly between 1/1/2008 and 12/31/2008
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
<i>Lead & Copper Sample Date(s):</i>												
<i>HAA5 & TTHM Sample Date(s):</i>												
<i>TCR Monthly Sample Date(s):</i>	<i>Jan</i>	<i>Feb</i>	<i>Mar</i>	<i>Apr</i>	<i>May</i>	<i>Jun</i>	<i>Jul</i>	<i>Aug</i>	<i>Sept</i>	<i>Oct</i>	<i>Nov</i>	<i>Dec</i>
<i>Total Chlorine Sample Date(s):</i>												

2008 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH3100712 PWS NAME: GLENDALE VILLAGE PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STU ID: 3154748 STU NAME: GLENDALE VILLAGE

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
ARSENIC	ARSENIC - 1005	1 Sample(s) Quarterly
NITRATE	NITRATE (AS N) - 1040	1 Sample(s) between 1/1/2008 and 5/31/2008
NITRITE	NITRITE (AS N) - 1041	CONTACT OHIO EPA
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

REMINDER: Consumer Confidence Report (CCR) is due July 1, 2008

INORGANIC Chemicals: ANTIMONY - 1074, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes				
	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)
<i>ARSENIC Quarterly Sample Date(s):</i>				
<i>NITRATE Sample Date(s):</i>				
<i>Date CCR sent to Ohio EPA:</i>				

2008 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH3100712 PWS NAME: GLENDALE VILLAGE PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: GLENDALE, VILLAGE OF DISTRIBUTION

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	10 Sample(s) between 6/1/2008 and 9/30/2008
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** Not Required
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Monthly between 1/1/2008 and 12/31/2008
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
<i>Lead & Copper Sample Date(s):</i>												
<i>TCR Monthly Sample Date(s):</i>	<i>Jan</i>	<i>Feb</i>	<i>Mar</i>	<i>Apr</i>	<i>May</i>	<i>Jun</i>	<i>Jul</i>	<i>Aug</i>	<i>Sept</i>	<i>Oct</i>	<i>Nov</i>	<i>Dec</i>
<i>Total Chlorine Sample Date(s):</i>												

2008 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH3100812 PWS NAME: HARRISON CITY PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STU ID: 3154749 STU NAME: HARRISON WATER DEPARTMENT

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE (AS N) - 1040	1 Sample(s) between 1/1/2008 and 5/31/2008
NITRITE	NITRITE (AS N) - 1041	Not Required
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

REMINDER: Consumer Confidence Report (CCR) is due July 1, 2008

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
<i>NITRATE Sample Date(s):</i>
<i>Date CCR sent to Ohio EPA:</i>

2008 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH3101112 PWS NAME: INDIAN HILL CITY PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STU ID: 3154752 STU NAME: INDIAN HILL PWS

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE (AS N) - 1040	1 Sample(s) between 1/1/2008 and 5/31/2008
NITRITE	NITRITE (AS N) - 1041	Not Required
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

REMINDER: Consumer Confidence Report (CCR) is due July 1, 2008

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
<i>NITRATE Sample Date(s):</i>
<i>Date CCR sent to Ohio EPA:</i>

2008 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH3101112 PWS NAME: INDIAN HILL CITY PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: INDIAN HILL, CITY OF DISTRIBUTION

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
ASBESTOS - 1094	Not Required
LEAD - 1030 & COPPER - 1022	60 Sample(s) between 1/1/2008 and 6/30/2008 60 Sample(s) between 7/1/2008 and 12/31/2008
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) between 7/1/2008 and 9/30/2008
TOTAL COLIFORM (TCR) - 3100	15 Sample(s) Monthly between 1/1/2008 and 12/31/2008
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

**** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)**

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

Asbestos Sampling Information

Collect one sample at a tap served by asbestos-cement pipe. The sample monitoring point (smp) code is DS000. Due to limited Laboratory capacity and a 48 hour filtering requirement, contact your lab early in the monitoring period to schedule a sampling date.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately. You should also continue to take Routine Samples according to this schedule.* If you have any questions, please contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes													
		1st Half Sample Date(s)					2nd Half Sample Date(s)						
<i>Lead & Copper Initial Monitoring Sample Date(s):</i>													
<i>HAA5 & TTHM Sample Date(s):</i>													
<i>TCR Monthly Sample Date(s):</i>		<i>Jan</i>	<i>Feb</i>	<i>Mar</i>	<i>Apr</i>	<i>May</i>	<i>Jun</i>	<i>Jul</i>	<i>Aug</i>	<i>Sept</i>	<i>Oct</i>	<i>Nov</i>	<i>Dec</i>
<i>Total Chlorine Sample Date(s):</i>													

2008 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH3101212 PWS NAME: LOCKLAND VILLAGE PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STU ID: 3154753 STU NAME: LOCKLAND VILLAGE

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE (AS N) - 1040	1 Sample(s) between 1/1/2008 and 5/31/2008
NITRITE	NITRITE (AS N) - 1041	Not Required
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

REMINDER: Consumer Confidence Report (CCR) is due July 1, 2008

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes
<i>NITRATE Sample Date(s):</i>
<i>Date CCR sent to Ohio EPA:</i>

2008 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH3101212 PWS NAME: LOCKLAND VILLAGE PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: LOCKLAND, VILLAGE OF DISTRIBUTION

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	20 Sample(s) between 6/1/2008 and 9/30/2008
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** Not Required
TOTAL COLIFORM (TCR) - 3100	4 Sample(s) Monthly between 1/1/2008 and 12/31/2008
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
<i>Lead & Copper Sample Date(s):</i>												
<i>TCR Monthly Sample Date(s):</i>	<i>Jan</i>	<i>Feb</i>	<i>Mar</i>	<i>Apr</i>	<i>May</i>	<i>Jun</i>	<i>Jul</i>	<i>Aug</i>	<i>Sept</i>	<i>Oct</i>	<i>Nov</i>	<i>Dec</i>
<i>Total Chlorine Sample Date(s):</i>												

2008 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH3101312 PWS NAME: LOTTON MOBILE HOME PARK

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STU ID: 3161787 STU NAME: LOTTON MHP

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE (AS N) - 1040	1 Sample(s) between 1/1/2008 and 5/31/2008
NITRITE	NITRITE (AS N) - 1041	Not Required
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 2 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 4 List Below	1 Sample(s) between 4/1/2008 and 6/30/2008

REMINDER: Consumer Confidence Report (CCR) is due July 1, 2008

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

SOC Group 2 Chemicals: CARBOFURAN - 2046, OXAMYL (VYDATE) - 2036, PICLORAM - 2040, 2,4-D - 2105, PENTACHLOROPHENOL - 2326

SOC Group 4 Chemicals: BENZO (A) PYRENE - 2306, ENDOTHALL - 2033, DI(2-ETHYLHEXYL) - ADIPATE - 2035, DI(2-ETHYLHEXYL) - PHTHALATE - 2034

Use for Sample Tracking Purposes
<i>NITRATE Sample Date(s):</i>
<i>SOC Group 4 Sample Date(s):</i>
<i>Date CCR sent to Ohio EPA:</i>

2008 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH3101312 PWS NAME: LOTTON MOBILE HOME PARK

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: LOTTON MOBILE HOME PARK DISTRIBUTION

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	5 Sample(s) between 6/1/2008 and 9/30/2008
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) between 7/1/2008 and 9/30/2008
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Monthly between 1/1/2008 and 12/31/2008
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
<i>Lead & Copper Sample Date(s):</i>												
<i>HAA5 & TTHM Sample Date(s):</i>												
<i>TCR Monthly Sample Date(s):</i>	<i>Jan</i>	<i>Feb</i>	<i>Mar</i>	<i>Apr</i>	<i>May</i>	<i>Jun</i>	<i>Jul</i>	<i>Aug</i>	<i>Sept</i>	<i>Oct</i>	<i>Nov</i>	<i>Dec</i>
<i>Total Chlorine Sample Date(s):</i>												

2008 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH3101703 PWS NAME: NORWOOD CITY PWS

PWS TYPE: Community SOURCE: Purchased Surface Water Sample Monitoring Point: DS000

FACILITY NAME: NORWOOD,CITY OF DISTRIBUTION

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	30 Sample(s) between 6/1/2008 and 9/30/2008
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) Quarterly
TOTAL COLIFORM (TCR) - 3100	20 Sample(s) Monthly between 1/1/2008 and 12/31/2008
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately. You should also continue to take Routine Samples according to this schedule.* If you have any questions, please contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
<i>Lead & Copper Sample Date(s):</i>												
<i>HAA5 & TTHM Quarterly Sample Date(s):</i>												
	<i>Jan - Mar Sample Date(s)</i>			<i>Apr - Jun Sample Date(s)</i>			<i>Jul - Sept Sample Date(s)</i>			<i>Oct - Dec Sample Date(s)</i>		
<i>TCR Monthly Sample Date(s):</i>	<i>Jan</i>	<i>Feb</i>	<i>Mar</i>	<i>Apr</i>	<i>May</i>	<i>Jun</i>	<i>Jul</i>	<i>Aug</i>	<i>Sept</i>	<i>Oct</i>	<i>Nov</i>	<i>Dec</i>
<i>Total Chlorine Sample Date(s):</i>												

2008 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH3101812 PWS NAME: READING CITY PWS

PWS TYPE: Community SOURCE: Purchased Surface Water Sample Monitoring Point: DS000

FACILITY NAME: READING,CITY OF DISTRIBUTION

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	30 Sample(s) between 6/1/2008 and 9/30/2008
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) Quarterly
TOTAL COLIFORM (TCR) - 3100	10 Sample(s) Monthly between 1/1/2008 and 12/31/2008
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately. You should also continue to take Routine Samples according to this schedule.* If you have any questions, please contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
<i>Lead & Copper Sample Date(s):</i>												
<i>HAA5 & TTHM Quarterly Sample Date(s):</i>												
	<i>Jan - Mar Sample Date(s)</i>			<i>Apr - Jun Sample Date(s)</i>			<i>Jul - Sept Sample Date(s)</i>			<i>Oct - Dec Sample Date(s)</i>		
<i>TCR Monthly Sample Date(s):</i>	<i>Jan</i>	<i>Feb</i>	<i>Mar</i>	<i>Apr</i>	<i>May</i>	<i>Jun</i>	<i>Jul</i>	<i>Aug</i>	<i>Sept</i>	<i>Oct</i>	<i>Nov</i>	<i>Dec</i>
<i>Total Chlorine Sample Date(s):</i>												

2008 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH3102212 PWS NAME: WYOMING CITY PWS

PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP001

STU ID: 3154760 STU NAME: WYOMING WATER WORKS

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
ARSENIC	ARSENIC - 1005	1 Sample(s) Quarterly
NITRATE	NITRATE (AS N) - 1040	1 Sample(s) between 1/1/2008 and 5/31/2008
NITRITE	NITRITE (AS N) - 1041	Not Required
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		1 Sample(s) Quarterly
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

REMINDER: Consumer Confidence Report (CCR) is due July 1, 2008

INORGANIC Chemicals: ANTIMONY - 1074, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes				
<i>ARSENIC Quarterly Sample Date(s):</i>	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)
<i>NITRATE Sample Date(s):</i>				
<i>VOC Quarterly Sample Date(s):</i>	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)
<i>Date CCR sent to Ohio EPA:</i>				

2008 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH3102303 PWS NAME: TWIN RIVERS WATER CORPORATION

PWS TYPE: Community SOURCE: Purchased Ground Water Sample Monitoring Point: DS000

FACILITY NAME: TWIN RIVERS WATER CORP. DISTRIBUTION

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	Not Required
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) between 7/1/2008 and 9/30/2008
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Monthly between 1/1/2008 and 12/31/2008
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes												
<i>HAA5 & TTHM Sample Date(s):</i>												
<i>TCR Monthly Sample Date(s):</i>	<i>Jan</i>	<i>Feb</i>	<i>Mar</i>	<i>Apr</i>	<i>May</i>	<i>Jun</i>	<i>Jul</i>	<i>Aug</i>	<i>Sept</i>	<i>Oct</i>	<i>Nov</i>	<i>Dec</i>
<i>Total Chlorine Sample Date(s):</i>												

2008 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH3102612 PWS NAME: CINCINNATI PUBLIC WATER SYSTEM
PWS TYPE: Community SOURCE: Ground Water Sample Monitoring Point: EP002
STU ID: 3154745 STU NAME: CINCINNATI PWS BOLTON PLANT
Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	1 Sample(s) between 1/1/2008 and 5/31/2008
NITRATE	NITRATE (AS N) - 1040	1 Sample(s) between 1/1/2008 and 5/31/2008
NITRITE	NITRITE (AS N) - 1041	Not Required
RADIOLOGICALS	GROSS ALPHA - 4002, RADIUM 228 - 4030	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

REMINDER: Consumer Confidence Report (CCR) is due July 1, 2008

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes												
<i>INORGANIC Sample Date(s):</i>												
<i>NITRATE Sample Date(s):</i>												
<i>TOC Monthly Sample Date(s):</i>	<i>Jan</i>	<i>Feb</i>	<i>Mar</i>	<i>Apr</i>	<i>May</i>	<i>Jun</i>	<i>Jul</i>	<i>Aug</i>	<i>Sept</i>	<i>Oct</i>	<i>Nov</i>	<i>Dec</i>
<i>Date CCR sent to Ohio EPA:</i>												

2008 CONTAMINANT MONITORING SCHEDULE


PWS ID: OH3130203 PWS NAME: BANKLICK TAVERN
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
STU ID: 3154762 STU NAME: BANKLICK TAVERN
Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 1/1/2008 and 5/31/2008	<i>Sample should be taken at EP001</i>
NITRITE - 1041	Not Required	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2008 and 12/31/2008	<i>Sample should be taken at DS000</i>

Where to Collect Samples For a Small Public Water System

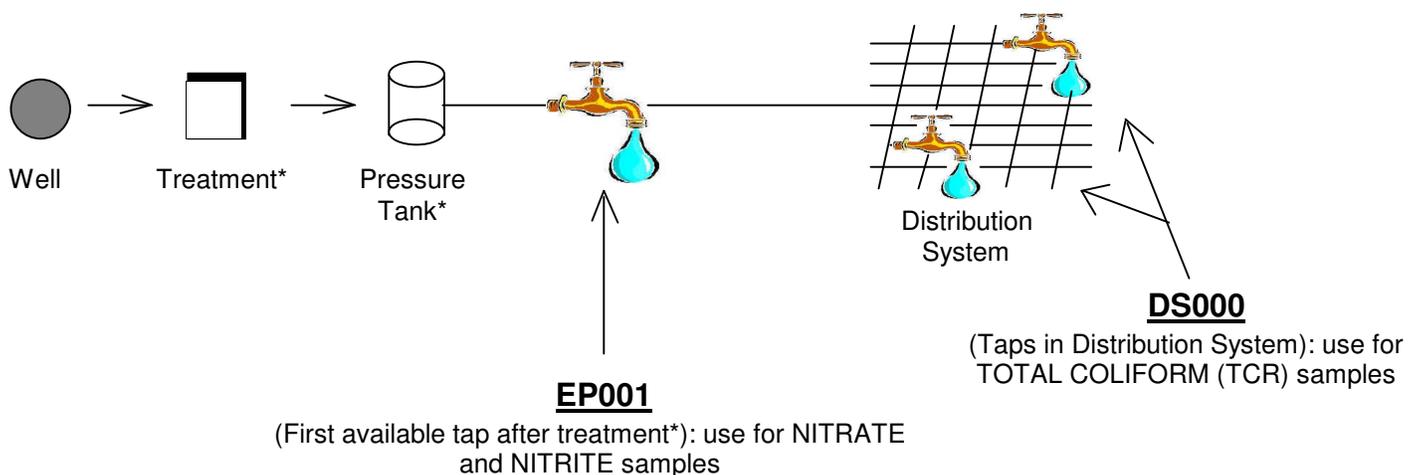

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2008 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH3130612 PWS NAME: CINCINNATI INCORPORATED

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: EP001

STU ID: 3154764 STU NAME: CINCINNATI INC

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE (AS N) - 1040	1 Sample(s) between 1/1/2008 and 3/31/2008
NITRITE	NITRITE (AS N) - 1041	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 4 List Below	1 Sample(s) between 4/1/2008 and 6/30/2008

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

SOC Group 4 Chemicals: BENZO (A) PYRENE - 2306, ENDOTHALL - 2033, DI(2-ETHYLHEXYL) - ADIPATE - 2035, DI(2-ETHYLHEXYL) - PHTHALATE - 2034

Use for Sample Tracking Purposes
<i>NITRATE Sample Date(s):</i>
<i>SOC Group 4 Sample Date(s):</i>

2008 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH3130612 PWS NAME: CINCINNATI INCORPORATED

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: CINCINNATI INCORPORATED DISTRIBUTION

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	5 Sample(s) between 6/1/2008 and 9/30/2008
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2008 and 12/31/2008

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month. If you receive a Total Coliform Positive result, contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

Use for Sample Tracking Purposes				
<i>Lead & Copper Sample Date(s):</i>				
<i>TCR Quarterly Sample Date(s):</i>				
	<i>Jan - Mar Sample Date(s)</i>	<i>Apr - Jun Sample Date(s)</i>	<i>Jul - Sept Sample Date(s)</i>	<i>Oct - Dec Sample Date(s)</i>

2008 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH3131612 PWS NAME: ELIZABETHTOWN ELEMENTARY

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: EP001

STU ID: 3154768 STU NAME: ELIZABETHTOWN ELEMENTARY SCHL

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE (AS N) - 1040	1 Sample(s) between 1/1/2008 and 3/31/2008
NITRITE	NITRITE (AS N) - 1041	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 4 List Below	1 Sample(s) between 4/1/2008 and 6/30/2008

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

SOC Group 4 Chemicals: BENZO (A) PYRENE - 2306, ENDOTHALL - 2033, DI(2-ETHYLHEXYL) - ADIPATE - 2035, DI(2-ETHYLHEXYL) - PHTHALATE - 2034

Use for Sample Tracking Purposes
<i>NITRATE Sample Date(s):</i>
<i>SOC Group 4 Sample Date(s):</i>

2008 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH3131612 PWS NAME: ELIZABETHTOWN ELEMENTARY

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: ELIZABETHTOWN ELEMENTARY DISTRIBUTION

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	Not Required
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2008 and 6/30/2008 1 Sample(s) Quarterly between 8/1/2008 and 12/31/2008

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule.

Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.

If you receive a Total Coliform Positive result, contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

Use for Sample Tracking Purposes				
	<i>Jan - Mar Sample Date(s)</i>	<i>Apr - Jun Sample Date(s)</i>	<i>Jul - Sept Sample Date(s)</i>	<i>Oct - Dec Sample Date(s)</i>
<i>TCR Quarterly Sample Date(s):</i>				

2008 CONTAMINANT MONITORING SCHEDULE


PWS ID: OH3132412 PWS NAME: TOWNSHIP FIELDS & TAVERN
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
STU ID: 3154771 STU NAME: TOWNSHIP FIELDS & TAVERN
Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 1/1/2008 and 5/31/2008	Sample should be taken at EP001
NITRITE - 1041	Not Required	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2008 and 12/31/2008	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

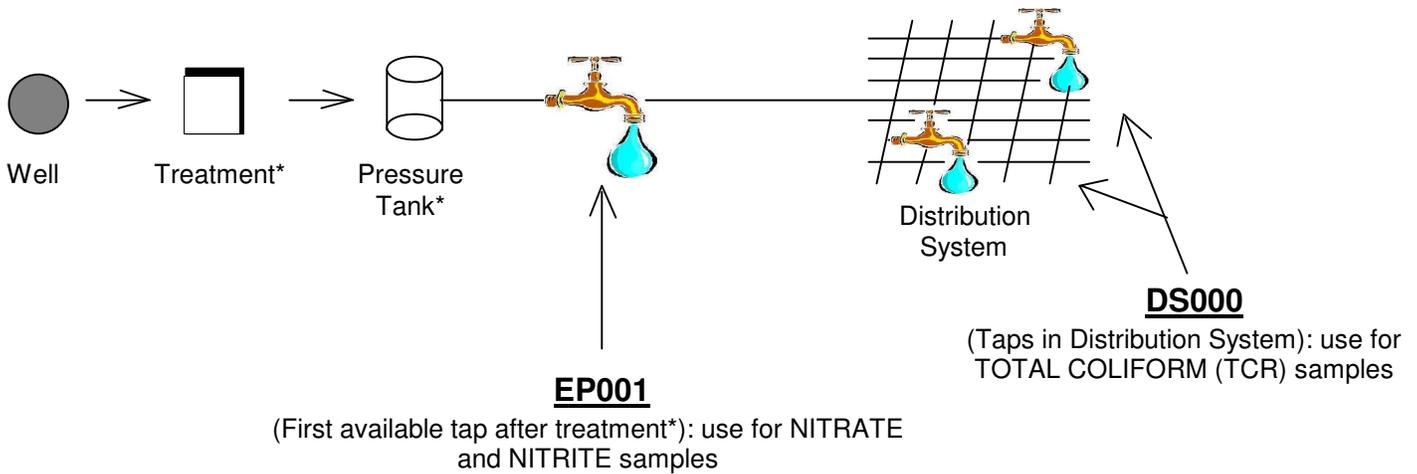

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2008 CONTAMINANT MONITORING SCHEDULE


PWS ID: OH3133103 PWS NAME: HILLVIEW GOLF COURSE
PWS TYPE: Transient Noncommunity SOURCE: Purchased Ground Water
STU ID: 3154772 STU NAME: HILLVIEW GOLF COURSE
Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2008 and 12/31/2008	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

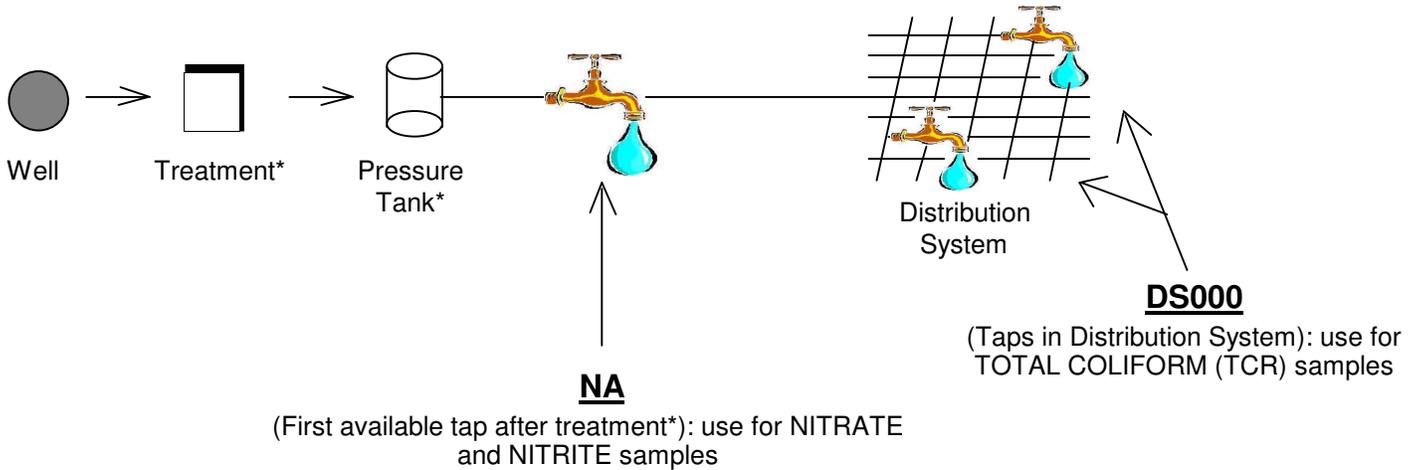

* If system does not have treatment, NA is the first tap after the well.

Use for Sample Tracking Purposes				
	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)
TCR Quarterly Sample Date(s):				

2008 CONTAMINANT MONITORING SCHEDULE


PWS ID: OH3134512 PWS NAME: MIAMITOWN LOUNGE
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
STU ID: 3154778 STU NAME: MIAMITOWN LOUNGE
Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 1/1/2008 and 5/31/2008	<i>Sample should be taken at EP001</i>
NITRITE - 1041	Not Required	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2008 and 12/31/2008	<i>Sample should be taken at DS000</i>

Where to Collect Samples For a Small Public Water System

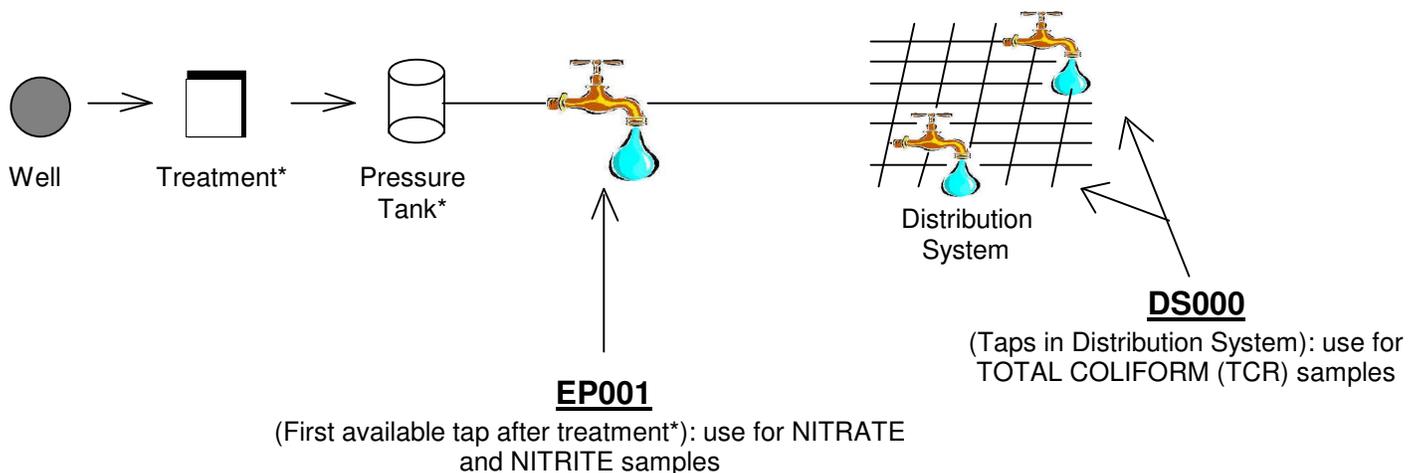

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2008 CONTAMINANT MONITORING SCHEDULE


PWS ID: OH3134812 PWS NAME: SMITTYS LOUNGE PWS
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
STU ID: 3154779 STU NAME: SMITTYS LOUNGE
Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 4/1/2008 and 6/30/2008	Sample should be taken at EP001
NITRITE - 1041	Not Required	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2008 and 12/31/2008	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

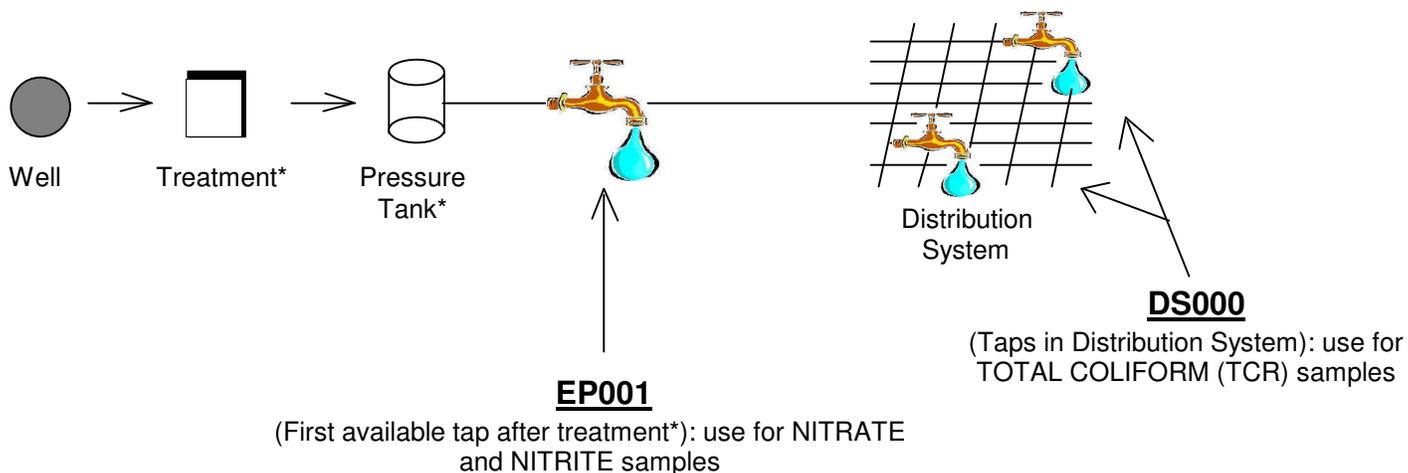

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2008 CONTAMINANT MONITORING SCHEDULE


PWS ID: OH3135012 PWS NAME: PASTIME PARK PWS
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
STU ID: 3154780 STU NAME: PASTIME PARK
Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 1/1/2008 and 5/31/2008	Sample should be taken at EP001
NITRITE - 1041	Not Required	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 3/1/2008 and 11/30/2008	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

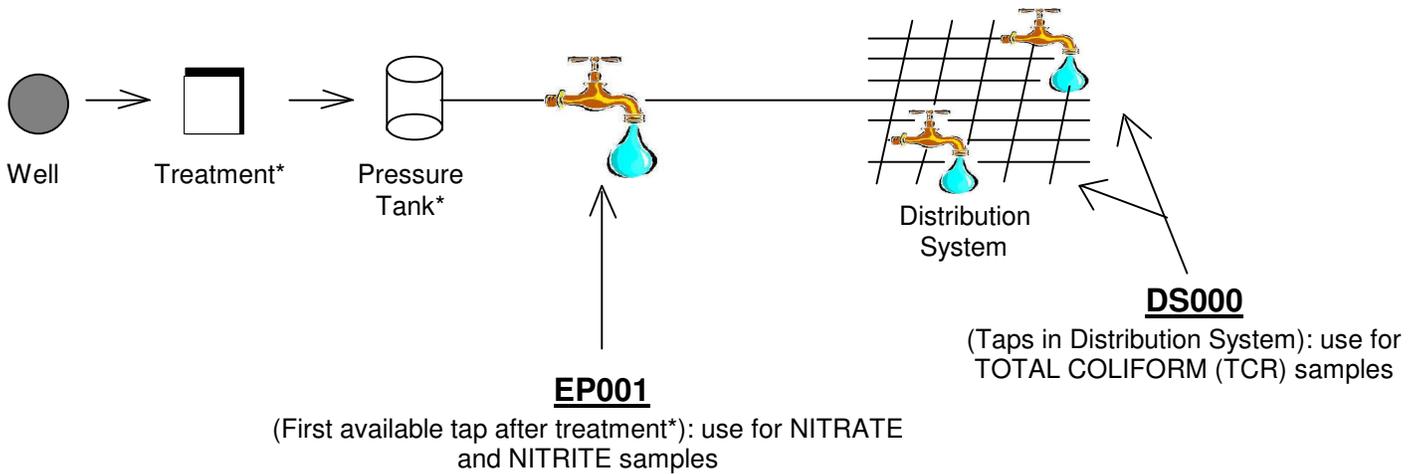

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2008 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH3135312 PWS NAME: TAYLOR CREEK YOUTH ORG. PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

STU ID: 3154782 STU NAME: TAYLOR CREEK YOUTH ORG


Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 1/1/2008 and 5/31/2008	<i>Sample should be taken at EP001</i>
NITRITE - 1041	Not Required	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 3/1/2008 and 10/31/2008	<i>Sample should be taken at DS000</i>

Where to Collect Samples For a Small Public Water System

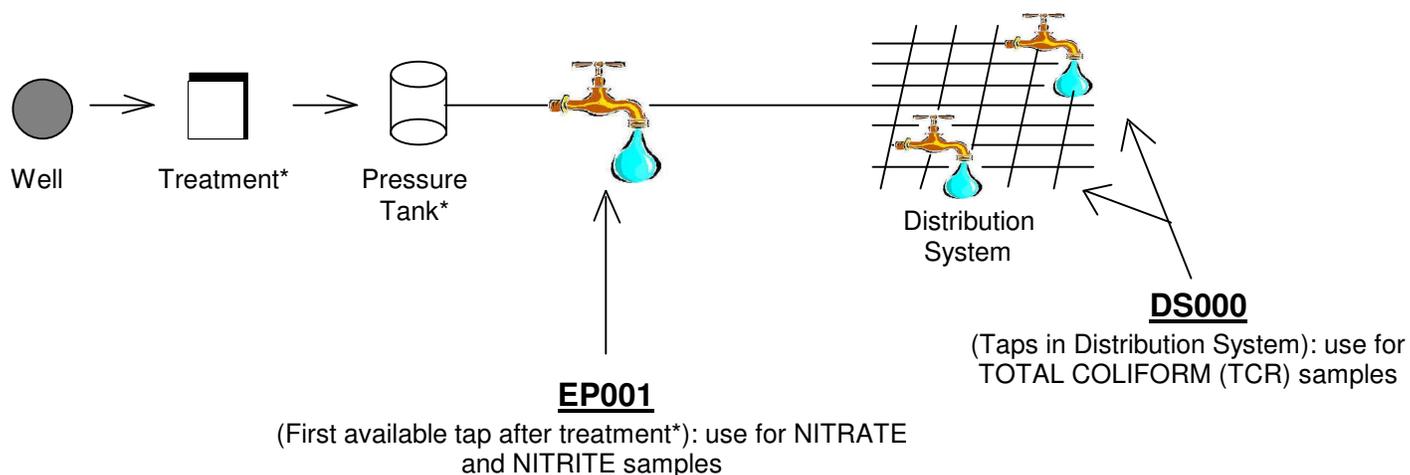

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2008 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH3136212 PWS NAME: WHITEWATER PROCESSING COMPANY

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: EP001

STU ID: 3154784 STU NAME: WHITEWATER PROCESSING CO

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE (AS N) - 1040	1 Sample(s) between 1/1/2008 and 5/31/2008
NITRITE	NITRITE (AS N) - 1041	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

Use for Sample Tracking Purposes

NITRATE Sample Date(s):

2008 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH3136212 PWS NAME: WHITEWATER PROCESSING COMPANY

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: WHITEWATER PROCESSING DISTRIBUTION

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	Not Required
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2008 and 12/31/2008

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month. If you receive a Total Coliform Positive result, contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

Use for Sample Tracking Purposes				
	<i>Jan - Mar Sample Date(s)</i>	<i>Apr - Jun Sample Date(s)</i>	<i>Jul - Sept Sample Date(s)</i>	<i>Oct - Dec Sample Date(s)</i>
<i>TCR Quarterly Sample Date(s):</i>				

2008 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH3137412 PWS NAME: CINCINNATI TECHNICAL CENTER

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: EP001

STU ID: 3154787 STU NAME: CINCINNATI CTC

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE (AS N) - 1040	1 Sample(s) between 10/1/2008 and 12/31/2008
NITRITE	NITRITE (AS N) - 1041	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 4 List Below	1 Sample(s) between 4/1/2008 and 6/30/2008

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

SOC Group 4 Chemicals: BENZO (A) PYRENE - 2306, ENDOTHALL - 2033, DI(2-ETHYLHEXYL) - ADIPATE - 2035, DI(2-ETHYLHEXYL) - PHTHALATE - 2034

Use for Sample Tracking Purposes
<i>NITRATE Sample Date(s):</i>
<i>SOC Group 4 Sample Date(s):</i>

2008 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH3137412 PWS NAME: CINCINNATI TECHNICAL CENTER

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: CINCINNATI TECHNICAL CEN DISTRIBUTION

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	Not Required
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 4/1/2008 and 10/31/2008

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

Use for Sample Tracking Purposes				
	<i>Jan - Mar Sample Date(s)</i>	<i>Apr - Jun Sample Date(s)</i>	<i>Jul - Sept Sample Date(s)</i>	<i>Oct - Dec Sample Date(s)</i>
<i>TCR Quarterly Sample Date(s):</i>				

2008 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH3138112 PWS NAME: ROBINS NEST GOLF COURSE PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

STU ID: 3154791 STU NAME: ROBINS NEST GOLF COURSE


Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 1/1/2008 and 3/31/2008	<i>Sample should be taken at EP001</i>
NITRITE - 1041	Not Required	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2008 and 12/31/2008	<i>Sample should be taken at DS000</i>

Where to Collect Samples For a Small Public Water System

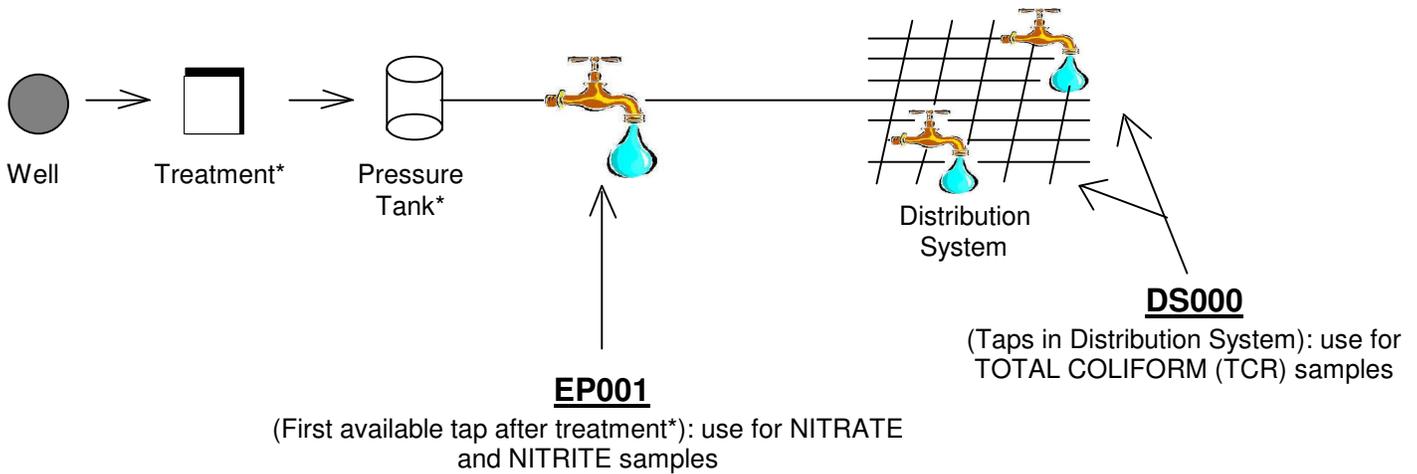

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2008 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH3138312 PWS NAME: CINCINNATI TEST SYSTEMS 1

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: EP001

STU ID: 3154793 STU NAME: CINCINNATI TEST SYSTEMS NO 1

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE (AS N) - 1040	1 Sample(s) between 4/1/2008 and 6/30/2008
NITRITE	NITRITE (AS N) - 1041	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 4 List Below	1 Sample(s) between 4/1/2008 and 6/30/2008

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

SOC Group 4 Chemicals: BENZO (A) PYRENE - 2306, ENDOTHALL - 2033, DI(2-ETHYLHEXYL) - ADIPATE - 2035, DI(2-ETHYLHEXYL) - PHTHALATE - 2034

Use for Sample Tracking Purposes
<i>NITRATE Sample Date(s):</i>
<i>SOC Group 4 Sample Date(s):</i>

2008 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH3138312 PWS NAME: CINCINNATI TEST SYSTEMS 1

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: CINCINNATI TEST SYSTEMS NO 1 DISTRIBUTIO

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	Not Required
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** 1 Sample(s) between 7/1/2008 and 9/30/2008
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2008 and 12/31/2008
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes				
<i>HAA5 & TTHM Sample Date(s):</i>				
<i>TCR Quarterly Sample Date(s):</i>	<i>Jan - Mar Sample Date(s)</i>	<i>Apr - Jun Sample Date(s)</i>	<i>Jul - Sept Sample Date(s)</i>	<i>Oct - Dec Sample Date(s)</i>
<i>Total Chlorine Sample Date(s):</i>				

2008 CHEMICAL MONITORING ENTRY POINT SCHEDULE

PWS ID: OH3138412 PWS NAME: CINCINNATI TEST SYSTEMS 2

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: EP001

STU ID: 3154794 STU NAME: CINCINNATI TEST SYSTEMS NO 2

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Chemical Name - Code	Monitoring Requirements
INORGANICS	See Inorganic Chemical List Below	Not Required
NITRATE	NITRATE (AS N) - 1040	1 Sample(s) between 1/1/2008 and 5/31/2008
NITRITE	NITRITE (AS N) - 1041	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)		Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 1 List Below	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC)	See SOC Group 4 List Below	1 Sample(s) between 4/1/2008 and 6/30/2008

INORGANIC Chemicals: ANTIMONY - 1074, ARSENIC - 1005, BARIUM - 1010, BERYLLIUM - 1075, CADMIUM - 1015, CHROMIUM - 1020, CYANIDE - 1024, FLUORIDE - 1025, MERCURY - 1035, NICKEL - 1036, SELENIUM - 1045, THALLIUM - 1085

SOC Group 1 Chemicals: SIMAZINE - 2037, ATRAZINE - 2050, ALACHLOR (LASSO) - 2051

SOC Group 4 Chemicals: BENZO (A) PYRENE - 2306, ENDOTHALL - 2033, DI(2-ETHYLHEXYL) - ADIPATE - 2035, DI(2-ETHYLHEXYL) - PHTHALATE - 2034

Use for Sample Tracking Purposes
<i>NITRATE Sample Date(s):</i>
<i>SOC Group 4 Sample Date(s):</i>

2008 CONTAMINANT MONITORING DISTRIBUTION POINT SCHEDULE

PWS ID: OH3138412 PWS NAME: CINCINNATI TEST SYSTEMS 2

PWS TYPE: Nontransient Noncommunity SOURCE: Ground Water Sample Monitoring Point: DS000

FACILITY NAME: CINCINNATI TEST SYSTEMS NO 2 DISTRIBUTIO

Effective Date: 1/1/08

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for coliform, monthly operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemical Name - Code	Monitoring Requirements
LEAD - 1030 & COPPER - 1022	5 Sample(s) between 6/1/2008 and 9/30/2008
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TOTAL TRIHALOMETHANES (TTHM) - 2950	** Not Required
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2008 and 12/31/2008
TOTAL CHLORINE - 1000	*** Sample in the Distribution System

** Total Haloacetic Acids (HAA5) and Total Trihalomethanes (TTHM) Sampling Information (Disinfection Byproducts)

HAA5 and TTHM are part of a large group of chemicals known as disinfection byproducts. These samples should be collected from point(s) in the distribution system where the water age is the oldest. Use MR000 as the sample monitoring point. If your system is also required to collect HAA5 and TTHM samples from other locations in your distribution system, use RD000 as the sample monitoring point.

Questions concerning HAA5 and TTHM monitoring can be directed to Ohio EPA DDAGW Central Office at (614) 644-2752. Your district office representative is also available to provide assistance.

TOTAL COLIFORM (TCR) Sampling Information

PLEASE NOTE: Total Coliform Positive samples will increase your Total Coliform monitoring requirements beyond what is included in this schedule. *Monitoring will be at least temporarily increased to include 4 Repeat Samples to be taken immediately and 5 Routine Samples the next month.* If you receive a Total Coliform Positive result, contact your Southwest District Office - DDAGW representative immediately at 937-285-6357.

*** TOTAL CHLORINE Sampling Information

Total Chlorine samples are collected in the distribution system at the same time and place as Total Coliforms are sampled.

Use for Sample Tracking Purposes				
<i>Lead & Copper Sample Date(s):</i>				
<i>TCR Quarterly Sample Date(s):</i>	<i>Jan - Mar Sample Date(s)</i>	<i>Apr - Jun Sample Date(s)</i>	<i>Jul - Sept Sample Date(s)</i>	<i>Oct - Dec Sample Date(s)</i>

2008 CONTAMINANT MONITORING SCHEDULE


PWS ID: OH3138512 PWS NAME: CROSBY TOWNSHIP SENIOR
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
STU ID: 3154795 STU NAME: CROSBY TOWNSHIP SENIOR CENTER
Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 1/1/2008 and 5/31/2008	Sample should be taken at EP001
NITRITE - 1041	Not Required	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2008 and 12/31/2008	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

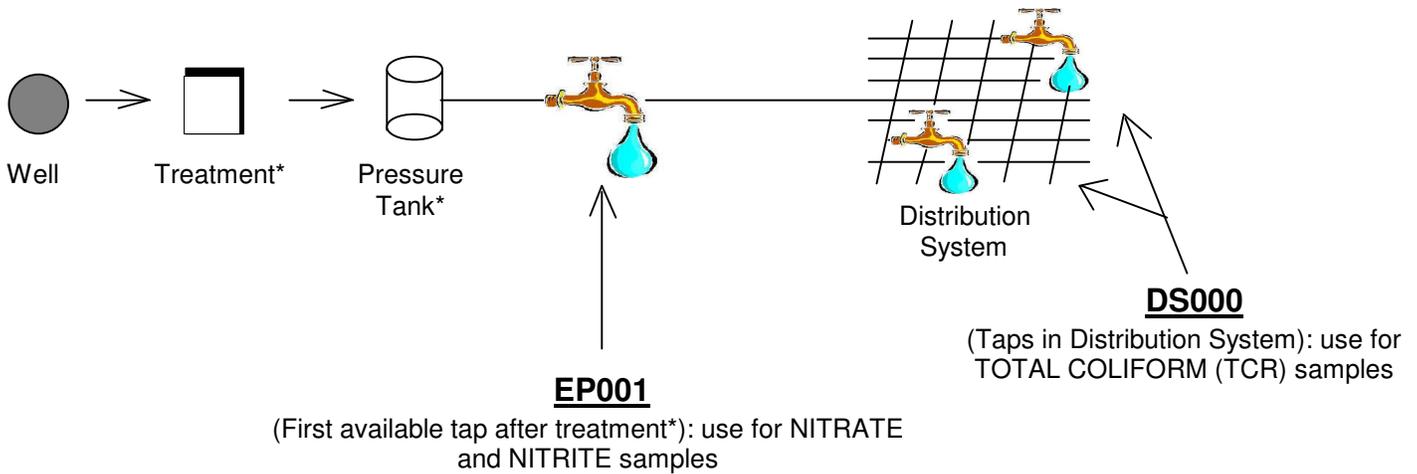

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2008 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH3138612 PWS NAME: AMAZING GRACE LUTHERAN CHURCH PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

STU ID: 3160910 STU NAME: AMAZING GRACE LUTHERAN CHURCH


Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 1/1/2008 and 5/31/2008	<i>Sample should be taken at EP001</i>
NITRITE - 1041	Not Required	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2008 and 12/31/2008	<i>Sample should be taken at DS000</i>

Where to Collect Samples For a Small Public Water System

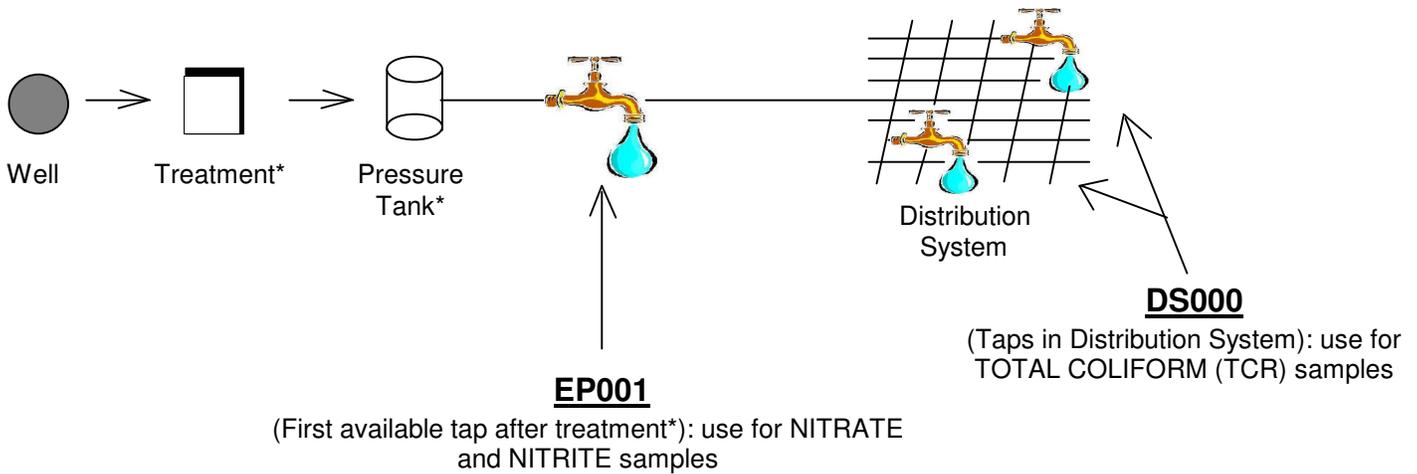

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2008 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH3138812 PWS NAME: WHITEWATER SENIOR CENTER PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

STU ID: 3161003 STU NAME: WHITEWATER SENIOR CTR


Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 1/1/2008 and 5/31/2008	<i>Sample should be taken at EP001</i>
NITRITE - 1041	Not Required	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2008 and 12/31/2008	<i>Sample should be taken at DS000</i>

Where to Collect Samples For a Small Public Water System

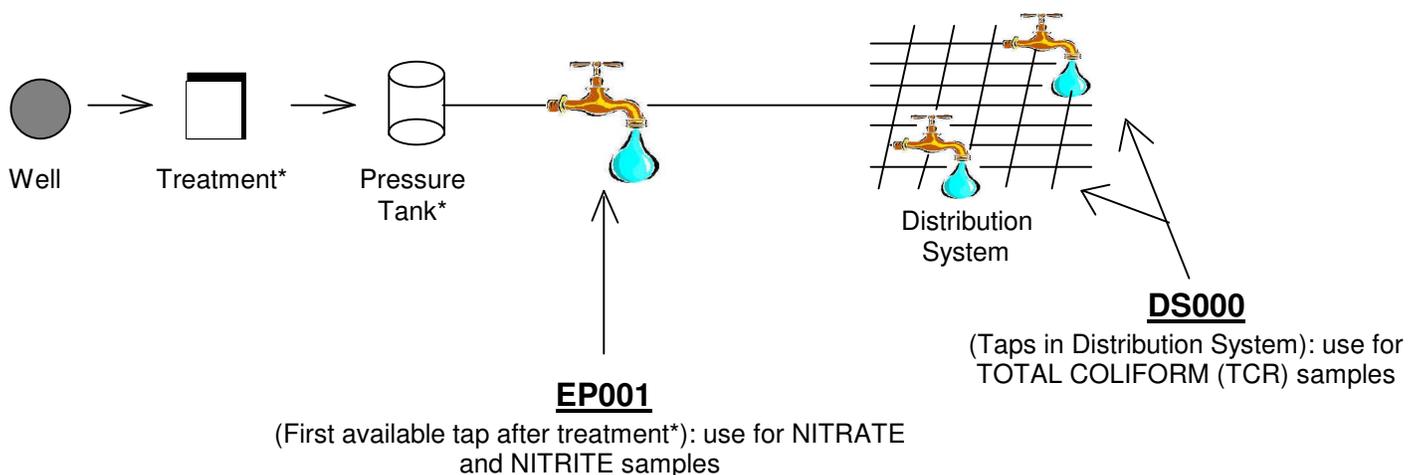

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2008 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH3139212 PWS NAME: ELIZABETHTOWN HALL & FIRE STATION PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

STU ID: 3161647 STU NAME: ELIZABETHTOWN HALL & FIRE STATION


Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 10/1/2008 and 12/31/2008	<i>Sample should be taken at EP001</i>
NITRITE - 1041	Not Required	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2008 and 12/31/2008	<i>Sample should be taken at DS000</i>

Where to Collect Samples For a Small Public Water System

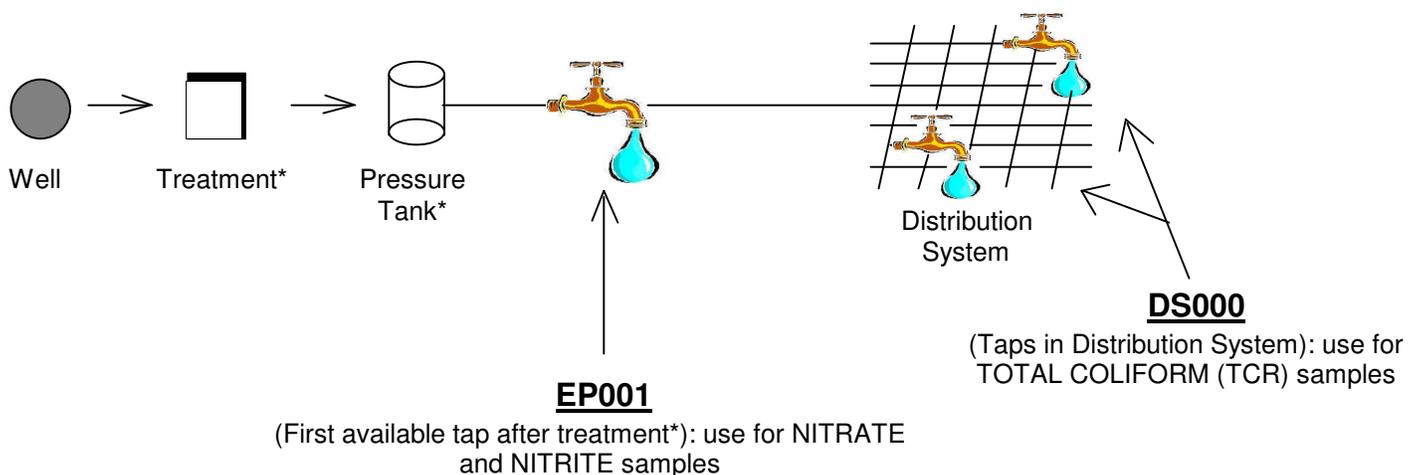

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2008 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH3139312 PWS NAME: ANDERSON TWP PRACTICE RANGE PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

STU ID: 3161823 STU NAME: ANDERSON TWP PRACTICE RANGE


Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 1/1/2008 and 5/31/2008	<i>Sample should be taken at EP001</i>
NITRITE - 1041	Not Required	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2008 and 12/31/2008	<i>Sample should be taken at DS000</i>

Where to Collect Samples For a Small Public Water System

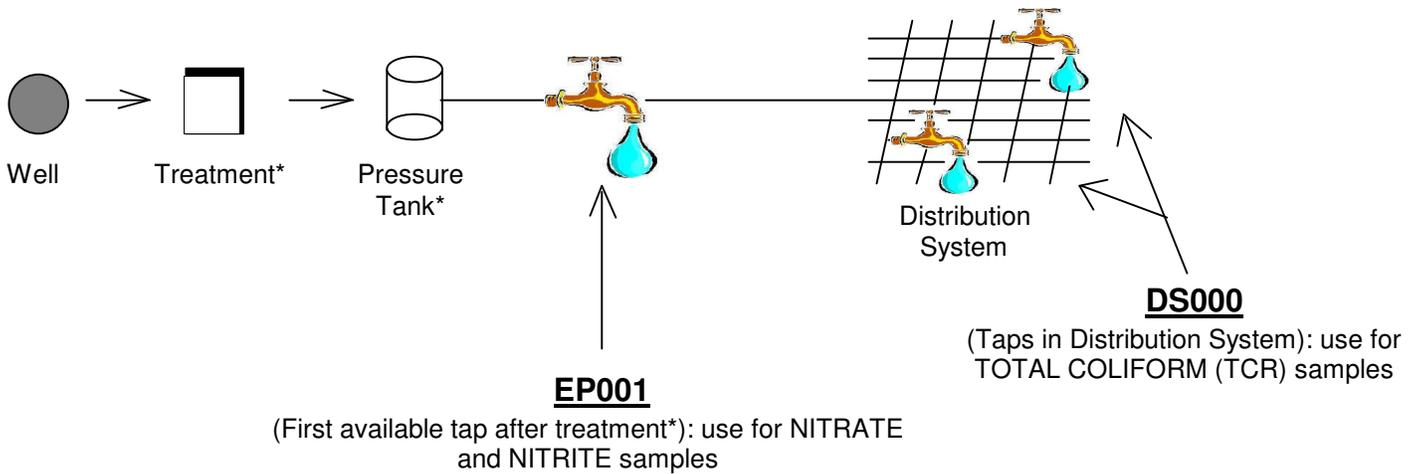

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2008 CONTAMINANT MONITORING SCHEDULE


PWS ID: OH3139412 PWS NAME: INDIAN HILL WINTER CLUB PWS
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
STU ID: 3161852 STU NAME: INDIAN HILL WINTER CLUB
Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 1/1/2008 and 5/31/2008	Sample should be taken at EP001
NITRITE - 1041	Not Required	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2008 and 3/31/2008	Sample should be taken at DS000
	1 Sample(s) Quarterly between 9/1/2008 and 12/31/2008	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

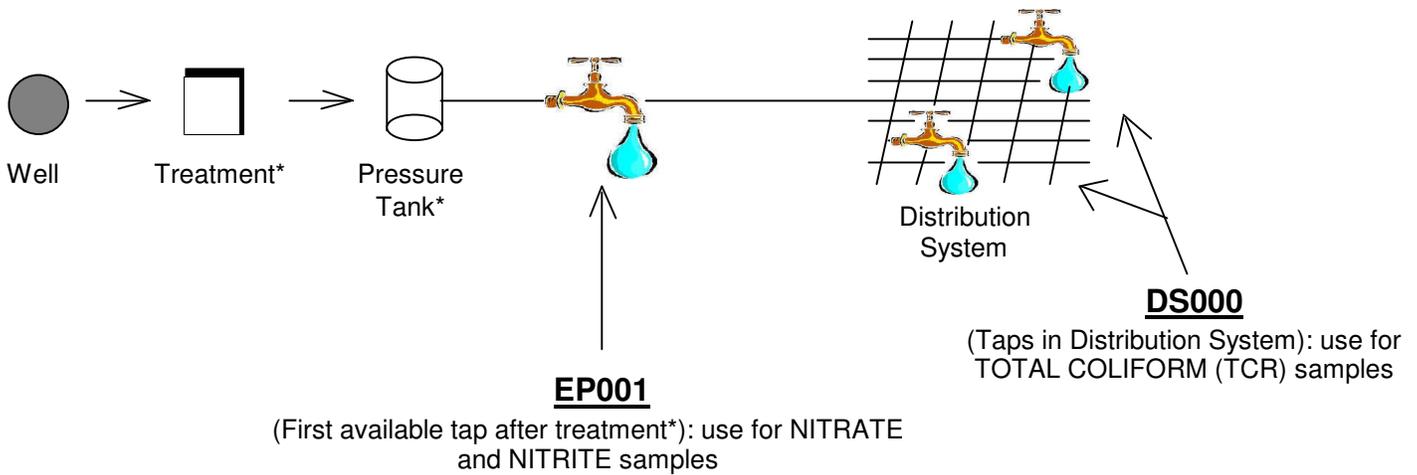

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2008 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH3139512 PWS NAME: NO WORRIES SPORTS BAR PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

STU ID: 3161871 STU NAME: NO WORRIES SPORTS BAR


Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 1/1/2008 and 5/31/2008	Sample should be taken at EP001
NITRITE - 1041	Not Required	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2008 and 12/31/2008	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

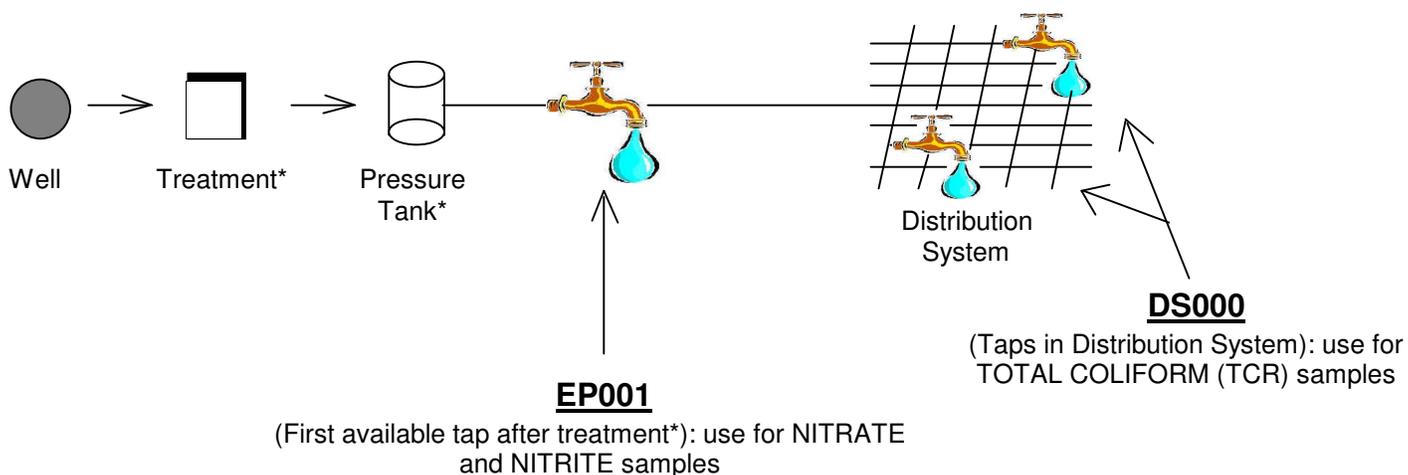

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2008 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH3139612 PWS NAME: THE ROOT BEER STAND PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

STU ID: 3161984 STU NAME: THE ROOT BEER STAND


Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 1/1/2008 and 5/31/2008	Sample should be taken at EP001
NITRITE - 1041	Not Required	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 4/1/2008 and 9/30/2008	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

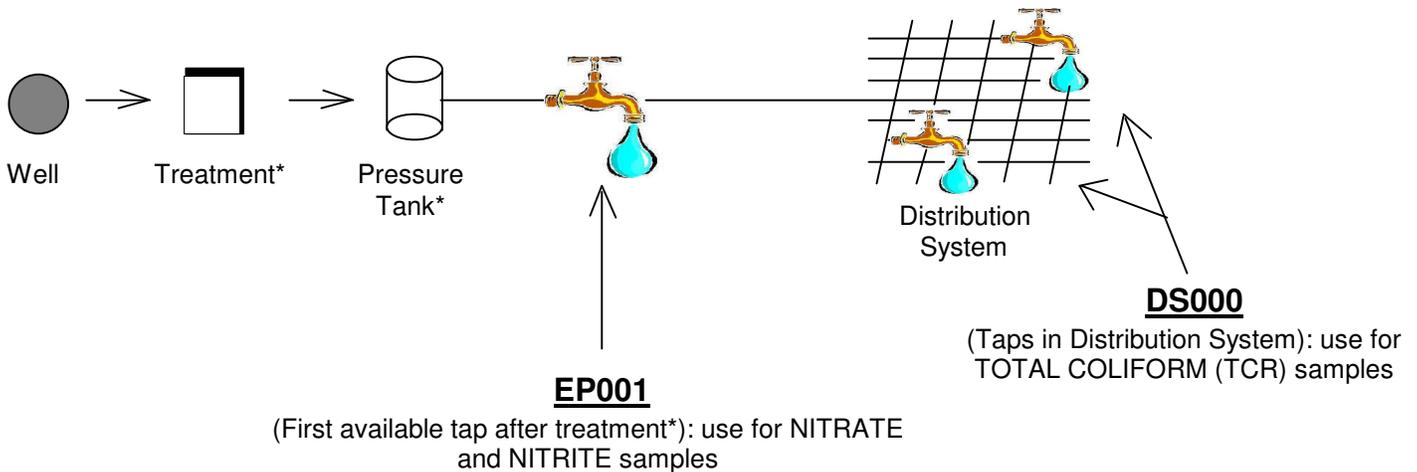

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

2008 CONTAMINANT MONITORING SCHEDULE


PWS ID: OH3139712 PWS NAME: FOUR SEASONS MARINA
PWS TYPE: Transient Noncommunity SOURCE: Ground Water
STU ID: 3162120 STU NAME: FOUR SEASONS MARINA
Effective Date: 1/1/08

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 1/1/2008 and 5/31/2008	<i>Sample should be taken at EP001</i>
NITRITE - 1041	1 Sample(s) between 1/1/2008 and 5/31/2008	<i>Sample should be taken at EP001</i>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2008 and 12/31/2008	<i>Sample should be taken at DS000</i>

Where to Collect Samples For a Small Public Water System

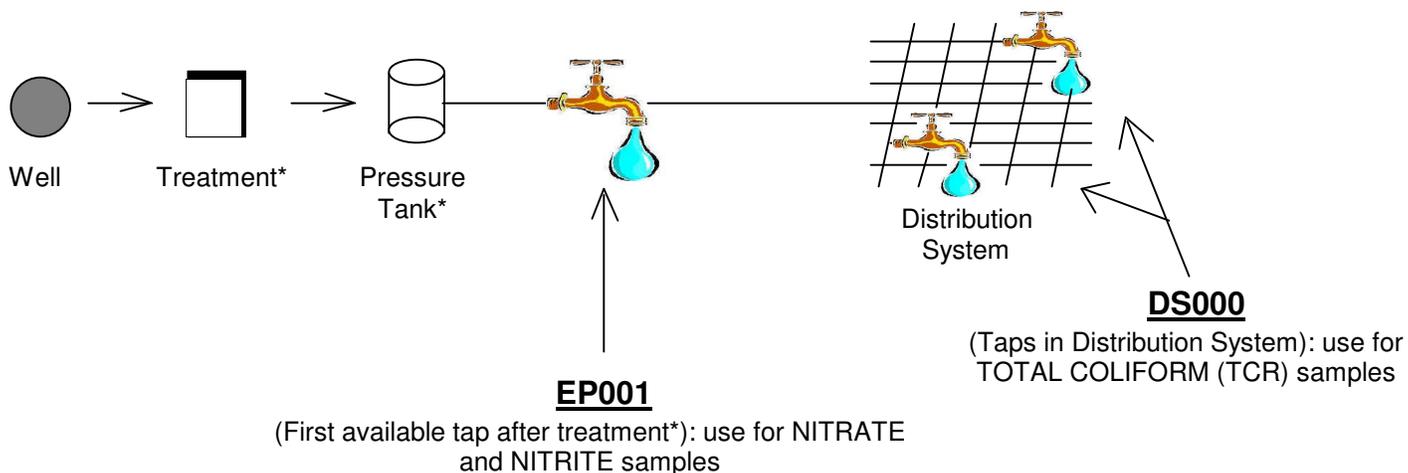

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
Nitrite Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)