



OH2400012 VILLAGE OF BLOOMINGBURG

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 2454040	Facility Name: BLOOMINGBURG PWS	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

Chemicals	Monitoring Requirements
ARSENIC - 1005	1 Sample(s) Required between 1/1/2017 and 3/31/2017 1 Sample(s) Required between 4/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 9/30/2017 1 Sample(s) Required between 10/1/2017 and 12/31/2017
INORGANICS	1 Sample(s) Required between 6/1/2017 and 10/31/2017
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTA. CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017
RADIOLOGICALS	1 Sample(s) Required between 6/1/2017 and 10/31/2017
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2017 and 5/31/2017
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2017 and 10/31/2017



OH2400012 VILLAGE OF BLOOMINGBURG

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **BLOOMINGBURG, VILLAGE OF DISTRIBUTION** Facility Class: **CLASS 1**
SMP ID: **DS000**

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2017 and 9/30/2017

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Form 5105 with appendix must be submitted to Ohio EPA within ten days from the end of the month(s) in which samples are collected. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>. For questions contact your Ohio EPA District Office representative.

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100
1 Sample(s) Required between 1/1/2017 and 1/31/2017
1 Sample(s) Required between 2/1/2017 and 2/28/2017
1 Sample(s) Required between 3/1/2017 and 3/31/2017
1 Sample(s) Required between 4/1/2017 and 4/30/2017
1 Sample(s) Required between 5/1/2017 and 5/31/2017
1 Sample(s) Required between 6/1/2017 and 6/30/2017
1 Sample(s) Required between 7/1/2017 and 7/31/2017
1 Sample(s) Required between 8/1/2017 and 8/31/2017
1 Sample(s) Required between 9/1/2017 and 9/30/2017
1 Sample(s) Required between 10/1/2017 and 10/31/2017
1 Sample(s) Required between 11/1/2017 and 11/30/2017
1 Sample(s) Required between 12/1/2017 and 12/31/2017

TOTAL CHLORINE - 1000
1 Sample(s) Required between 1/1/2017 and 1/31/2017
1 Sample(s) Required between 2/1/2017 and 2/28/2017
1 Sample(s) Required between 3/1/2017 and 3/31/2017
1 Sample(s) Required between 4/1/2017 and 4/30/2017
1 Sample(s) Required between 5/1/2017 and 5/31/2017
1 Sample(s) Required between 6/1/2017 and 6/30/2017
1 Sample(s) Required between 7/1/2017 and 7/31/2017
1 Sample(s) Required between 8/1/2017 and 8/31/2017
1 Sample(s) Required between 9/1/2017 and 9/30/2017
1 Sample(s) Required between 10/1/2017 and 10/31/2017
1 Sample(s) Required between 11/1/2017 and 11/30/2017
1 Sample(s) Required between 12/1/2017 and 12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

OH2400012 VILLAGE OF BLOOMINGBURG

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: BLOOMINGBURG, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
	SMP ID: DS201	ADDRESS NOT KNOWN	

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1	Facility Name: BLOOMINGBURG, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
	SMP ID: DS202	ADDRESS NOT KNOWN	

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH2400112 FAYETTE CO.-CULPEPPER SUBDIVISION

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 2454041 SMP ID: EP001	Facility Name: FAYETTE CO. CULPEPPER SUBDIVISION Facility Source: Ground Water	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2017 and 10/31/2017
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017
RADIOLOGICALS	1 Sample(s) Required between 6/1/2017 and 10/31/2017
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2017 and 5/31/2017
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2017 and 10/31/2017



OH2400112 FAYETTE CO.-CULPEPPER SUBDIVISION

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: FAYETTE CO.CULPEPPER DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between	1/1/2017	and	1/31/2017
1 Sample(s) Required between	2/1/2017	and	2/28/2017
1 Sample(s) Required between	3/1/2017	and	3/31/2017
1 Sample(s) Required between	4/1/2017	and	4/30/2017
1 Sample(s) Required between	5/1/2017	and	5/31/2017
1 Sample(s) Required between	6/1/2017	and	6/30/2017
1 Sample(s) Required between	7/1/2017	and	7/31/2017
1 Sample(s) Required between	8/1/2017	and	8/31/2017
1 Sample(s) Required between	9/1/2017	and	9/30/2017
1 Sample(s) Required between	10/1/2017	and	10/31/2017
1 Sample(s) Required between	11/1/2017	and	11/30/2017
1 Sample(s) Required between	12/1/2017	and	12/31/2017

TOTAL CHLORINE - 1000

1 Sample(s) Required between	1/1/2017	and	1/31/2017
1 Sample(s) Required between	2/1/2017	and	2/28/2017
1 Sample(s) Required between	3/1/2017	and	3/31/2017
1 Sample(s) Required between	4/1/2017	and	4/30/2017
1 Sample(s) Required between	5/1/2017	and	5/31/2017
1 Sample(s) Required between	6/1/2017	and	6/30/2017
1 Sample(s) Required between	7/1/2017	and	7/31/2017
1 Sample(s) Required between	8/1/2017	and	8/31/2017
1 Sample(s) Required between	9/1/2017	and	9/30/2017
1 Sample(s) Required between	10/1/2017	and	10/31/2017
1 Sample(s) Required between	11/1/2017	and	11/30/2017
1 Sample(s) Required between	12/1/2017	and	12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: FAYETTE CO.CULPEPPER DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2017

2017 ENTRY POINT SCHEDULE

OH2400612 JEFFERSONVILLE VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 2454044 SMP ID: EP001	Facility Name: JEFFERSONVILLE PWS Facility Source: Ground Water	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2017 and 10/31/2017
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017
RADIOLOGICALS	1 Sample(s) Required between 6/1/2017 and 10/31/2017
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2017 and 5/31/2017
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2017 and 10/31/2017



OH2400612 JEFFERSONVILLE VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: JEFFERSONVILLE, VILLAGE DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100

2 Sample(s) Required between	1/1/2017	and	1/31/2017
2 Sample(s) Required between	2/1/2017	and	2/28/2017
2 Sample(s) Required between	3/1/2017	and	3/31/2017
2 Sample(s) Required between	4/1/2017	and	4/30/2017
2 Sample(s) Required between	5/1/2017	and	5/31/2017
2 Sample(s) Required between	6/1/2017	and	6/30/2017
2 Sample(s) Required between	7/1/2017	and	7/31/2017
2 Sample(s) Required between	8/1/2017	and	8/31/2017
2 Sample(s) Required between	9/1/2017	and	9/30/2017
2 Sample(s) Required between	10/1/2017	and	10/31/2017
2 Sample(s) Required between	11/1/2017	and	11/30/2017
2 Sample(s) Required between	12/1/2017	and	12/31/2017

TOTAL CHLORINE - 1000

2 Sample(s) Required between	1/1/2017	and	1/31/2017
2 Sample(s) Required between	2/1/2017	and	2/28/2017
2 Sample(s) Required between	3/1/2017	and	3/31/2017
2 Sample(s) Required between	4/1/2017	and	4/30/2017
2 Sample(s) Required between	5/1/2017	and	5/31/2017
2 Sample(s) Required between	6/1/2017	and	6/30/2017
2 Sample(s) Required between	7/1/2017	and	7/31/2017
2 Sample(s) Required between	8/1/2017	and	8/31/2017
2 Sample(s) Required between	9/1/2017	and	9/30/2017
2 Sample(s) Required between	10/1/2017	and	10/31/2017
2 Sample(s) Required between	11/1/2017	and	11/30/2017
2 Sample(s) Required between	12/1/2017	and	12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: JEFFERSONVILLE, VILLAGE DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

OH2400612 JEFFERSONVILLE VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: JEFFERSONVILLE, VILLAGE DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH2400714 WASHINGTON COURT HOUSE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 2454045	Facility Name: WASHINGTON COURT HOUSE PWS	Facility Class: CLASS 3
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 1/1/2017 and 5/31/2017

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2017 and 1/31/2017

1 Sample(s) Required between 2/1/2017 and 2/28/2017

1 Sample(s) Required between 3/1/2017 and 3/31/2017

1 Sample(s) Required between 4/1/2017 and 4/30/2017

1 Sample(s) Required between 5/1/2017 and 5/31/2017

1 Sample(s) Required between 6/1/2017 and 6/30/2017

1 Sample(s) Required between 7/1/2017 and 7/31/2017

1 Sample(s) Required between 8/1/2017 and 8/31/2017

1 Sample(s) Required between 9/1/2017 and 9/30/2017

1 Sample(s) Required between 10/1/2017 and 10/31/2017

1 Sample(s) Required between 11/1/2017 and 11/30/2017

1 Sample(s) Required between 12/1/2017 and 12/31/2017

RADIOLOGICALS Not Required

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 4/1/2017 and 6/30/2017

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 1/1/2017 and 5/31/2017



OH2400714 WASHINGTON COURT HOUSE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 2454045	Facility Name: WASHINGTON COURT HOUSE PWS
Location	SMP ID: EP001/LT2001	Facility Source: Surface Water
		Facility Class: CLASS 3

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

Chemicals

Monitoring Requirements

TOTAL MICROCYSTINS

1 Sample Set Required WEEKLY*

Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. A week is defined as Sunday through Saturday.

**Weekly sampling unless requirements for seasonal reduced monitoring are met (November through April). Biweekly raw seasonal reduced monitoring must be conducted at the same time as cyanobacteria screening sample. Any microcystins detection during seasonal reduced monitoring triggers collection of raw and finished samples within 24 hours and a return to weekly monitoring at both raw and finished sample points. For questions about seasonal reduced monitoring please contact your Ohio EPA District Office HAB Coordinator.*



OH2400714 WASHINGTON COURT HOUSE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 2454045	Facility Name: WASHINGTON COURT HOUSE PWS
Location	SMP ID: LT2001	Facility Source: Surface Water
		Facility Class: CLASS 3

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

Chemicals

Monitoring Requirements

CYANOBACTERIA SCREENING	1 Sample(s) Required between	1/8/2017 and	1/14/2017
	1 Sample(s) Required between	1/22/2017 and	1/28/2017
	1 Sample(s) Required between	2/5/2017 and	2/11/2017
	1 Sample(s) Required between	2/19/2017 and	2/25/2017
	1 Sample(s) Required between	3/5/2017 and	3/11/2017
	1 Sample(s) Required between	3/19/2017 and	3/25/2017
	1 Sample(s) Required between	4/2/2017 and	4/8/2017
	1 Sample(s) Required between	4/16/2017 and	4/22/2017
	1 Sample(s) Required between	4/30/2017 and	5/6/2017
	1 Sample(s) Required between	5/14/2017 and	5/20/2017
	1 Sample(s) Required between	5/28/2017 and	6/3/2017
	1 Sample(s) Required between	6/11/2017 and	6/17/2017
	1 Sample(s) Required between	6/25/2017 and	7/1/2017
	1 Sample(s) Required between	7/9/2017 and	7/15/2017
	1 Sample(s) Required between	7/23/2017 and	7/29/2017
	1 Sample(s) Required between	8/6/2017 and	8/12/2017
	1 Sample(s) Required between	8/20/2017 and	8/26/2017
	1 Sample(s) Required between	9/3/2017 and	9/9/2017
	1 Sample(s) Required between	9/17/2017 and	9/23/2017
	1 Sample(s) Required between	10/1/2017 and	10/7/2017
1 Sample(s) Required between	10/15/2017 and	10/21/2017	
1 Sample(s) Required between	10/29/2017 and	11/4/2017	
1 Sample(s) Required between	11/12/2017 and	11/18/2017	
1 Sample(s) Required between	11/26/2017 and	12/2/2017	
1 Sample(s) Required between	12/10/2017 and	12/16/2017	
1 Sample(s) Required between	12/24/2017 and	12/30/2017	

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 and must be collected at the same time as the raw total microcystins sample. SAMPLES MUST BE SHIPPED OVERNIGHT ON ICE ON THE DAY OF COLLECTION AND ARRIVE AT OHIO EPA DIVISION OF ENVIRONMENTAL SERVICES (DES) BY NOON MONDAY THROUGH THURSDAY ONLY! If lab capacity is found to be adequate, cyanobacteria screening samples will no longer be analyzed, free of charge, by Ohio EPA DES beginning June 1, 2017.

LT2 MONITORING	1 Sample(s) Required between	1/1/2017 and	1/5/2017
	1 Sample(s) Required between	2/5/2017 and	2/9/2017
	1 Sample(s) Required between	3/5/2017 and	3/9/2017
	1 Sample(s) Required between	4/2/2017 and	4/6/2017
	1 Sample(s) Required between	4/30/2017 and	5/4/2017
	1 Sample(s) Required between	6/4/2017 and	6/8/2017
	1 Sample(s) Required between	7/9/2017 and	7/13/2017
	1 Sample(s) Required between	7/30/2017 and	8/3/2017
	1 Sample(s) Required between	9/3/2017 and	9/7/2017
	1 Sample(s) Required between	10/1/2017 and	10/5/2017
	1 Sample(s) Required between	11/5/2017 and	11/9/2017
	1 Sample(s) Required between	12/3/2017 and	12/7/2017

Monitor for: Cryptosporidium - 2078, E-coli count - 3014, Turbidity - 0100

OH2400714 WASHINGTON COURT HOUSE PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: WASHINGTON COURT HOUSE DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

TOTAL COLIFORM (TCR) - 3100	15 Sample(s) Required between 1/1/2017 and 1/31/2017
	15 Sample(s) Required between 2/1/2017 and 2/28/2017
	15 Sample(s) Required between 3/1/2017 and 3/31/2017
	15 Sample(s) Required between 4/1/2017 and 4/30/2017
	15 Sample(s) Required between 5/1/2017 and 5/31/2017
	15 Sample(s) Required between 6/1/2017 and 6/30/2017
	15 Sample(s) Required between 7/1/2017 and 7/31/2017
	15 Sample(s) Required between 8/1/2017 and 8/31/2017
	15 Sample(s) Required between 9/1/2017 and 9/30/2017
	15 Sample(s) Required between 10/1/2017 and 10/31/2017
	15 Sample(s) Required between 11/1/2017 and 11/30/2017
	15 Sample(s) Required between 12/1/2017 and 12/31/2017

TOTAL CHLORINE - 1000	15 Sample(s) Required between 1/1/2017 and 1/31/2017
	15 Sample(s) Required between 2/1/2017 and 2/28/2017
	15 Sample(s) Required between 3/1/2017 and 3/31/2017
	15 Sample(s) Required between 4/1/2017 and 4/30/2017
	15 Sample(s) Required between 5/1/2017 and 5/31/2017
	15 Sample(s) Required between 6/1/2017 and 6/30/2017
	15 Sample(s) Required between 7/1/2017 and 7/31/2017
	15 Sample(s) Required between 8/1/2017 and 8/31/2017
	15 Sample(s) Required between 9/1/2017 and 9/30/2017
	15 Sample(s) Required between 10/1/2017 and 10/31/2017
	15 Sample(s) Required between 11/1/2017 and 11/30/2017
	15 Sample(s) Required between 12/1/2017 and 12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: WASHINGTON COURT HOUSE DISTRIBUTION 1551 ROBINSON ROAD	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 2/8/2017 and 2/14/2017 at: DS201
	Dual Sample Required between 5/8/2017 and 5/14/2017 at: DS201
	Dual Sample Required between 8/8/2017 and 8/14/2017 at: DS201
	Dual Sample Required between 11/8/2017 and 11/14/2017 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

OH2400714 WASHINGTON COURT HOUSE PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: WASHINGTON COURT HOUSE DISTRIBUTION 810 HIGHLAND AVENUE	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS	Dual Sample Required between 2/8/2017 and 2/14/2017 at: DS202
	Dual Sample Required between 5/8/2017 and 5/14/2017 at: DS202
	Dual Sample Required between 8/8/2017 and 8/14/2017 at: DS202
	Dual Sample Required between 11/8/2017 and 11/14/2017 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2017

2017 ENTRY POINT SCHEDULE

OH2400912 RANCH OF OPPORTUNITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 2454046	Facility Name: RANCH OF OPPORTUNITY	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2017 and 10/31/2017
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020	
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017
RADIOLOGICALS	1 Sample(s) Required between 6/1/2017 and 10/31/2017
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2017 and 5/31/2017
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2017 and 10/31/2017



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

OH2400912 RANCH OF OPPORTUNITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: RANCH OF OPPORTUNITY DISTRIBUTION
	SMP ID: DS000	

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2017 and 9/30/2017

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Form 5105 with appendix must be submitted to Ohio EPA within ten days from the end of the month(s) in which samples are collected. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>. For questions contact your Ohio EPA District Office representative.

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between	1/1/2017	and	1/31/2017
1 Sample(s) Required between	2/1/2017	and	2/28/2017
1 Sample(s) Required between	3/1/2017	and	3/31/2017
1 Sample(s) Required between	4/1/2017	and	4/30/2017
1 Sample(s) Required between	5/1/2017	and	5/31/2017
1 Sample(s) Required between	6/1/2017	and	6/30/2017
1 Sample(s) Required between	7/1/2017	and	7/31/2017
1 Sample(s) Required between	8/1/2017	and	8/31/2017
1 Sample(s) Required between	9/1/2017	and	9/30/2017
1 Sample(s) Required between	10/1/2017	and	10/31/2017
1 Sample(s) Required between	11/1/2017	and	11/30/2017
1 Sample(s) Required between	12/1/2017	and	12/31/2017

Sampling Location	Facility ID: DS1	Facility Name: RANCH OF OPPORTUNITY DISTRIBUTION
	SMP ID: DS201	ADDRESS NOT KNOWN

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH2430012 ODOT REST AREA 6-9 PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: ODOT REST AREA 6-9 DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System

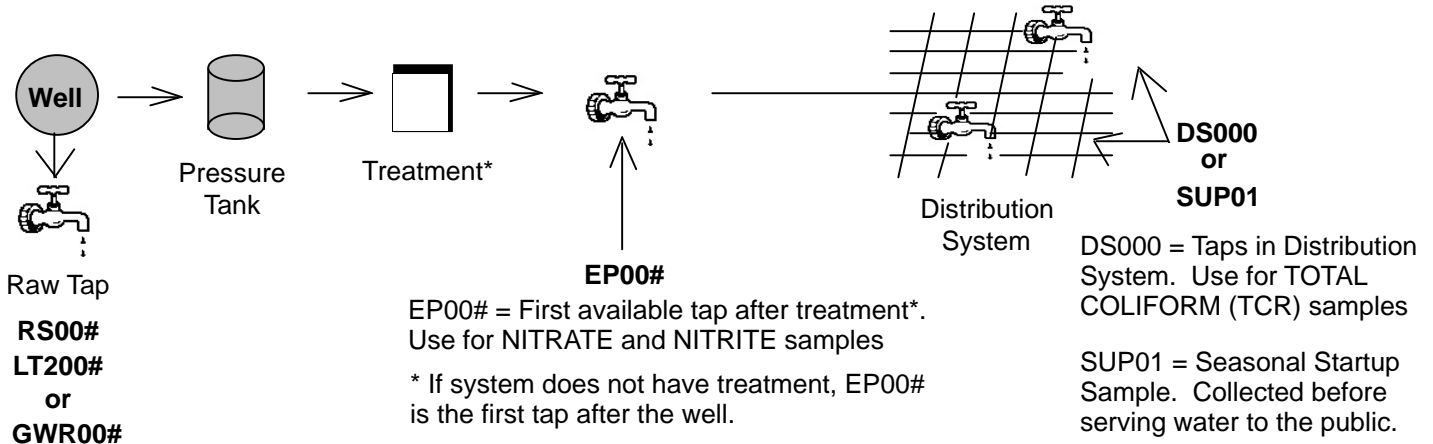

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2430012 ODOT REST AREA 6-9 PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 2454048	Facility Name: ODOT REST AREA 6-9	
Location SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System

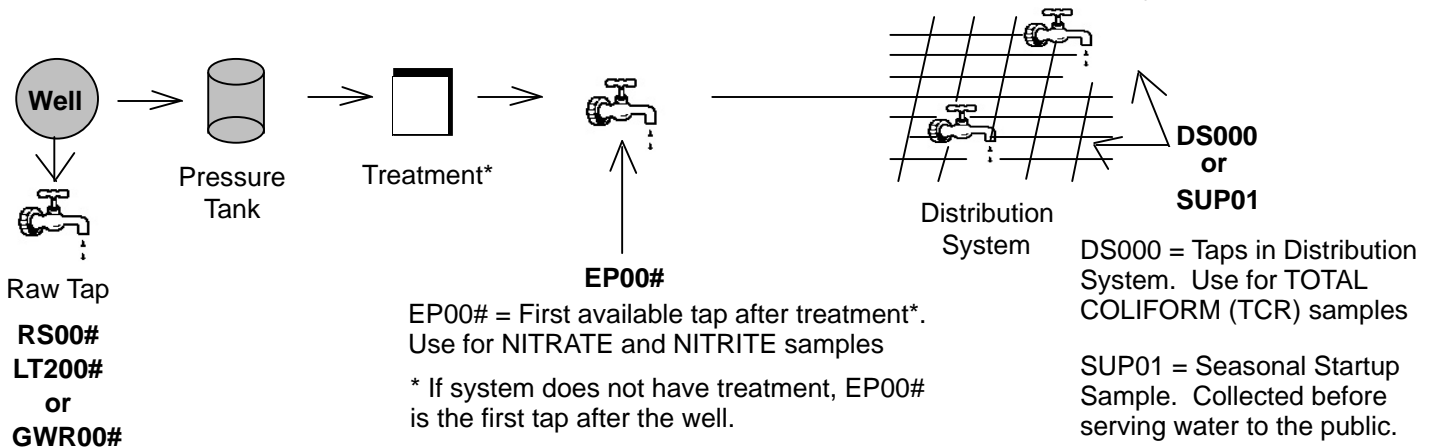

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2430112 ODOT REST AREA 6-10 PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: ODOT REST AREA 6-10 DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System

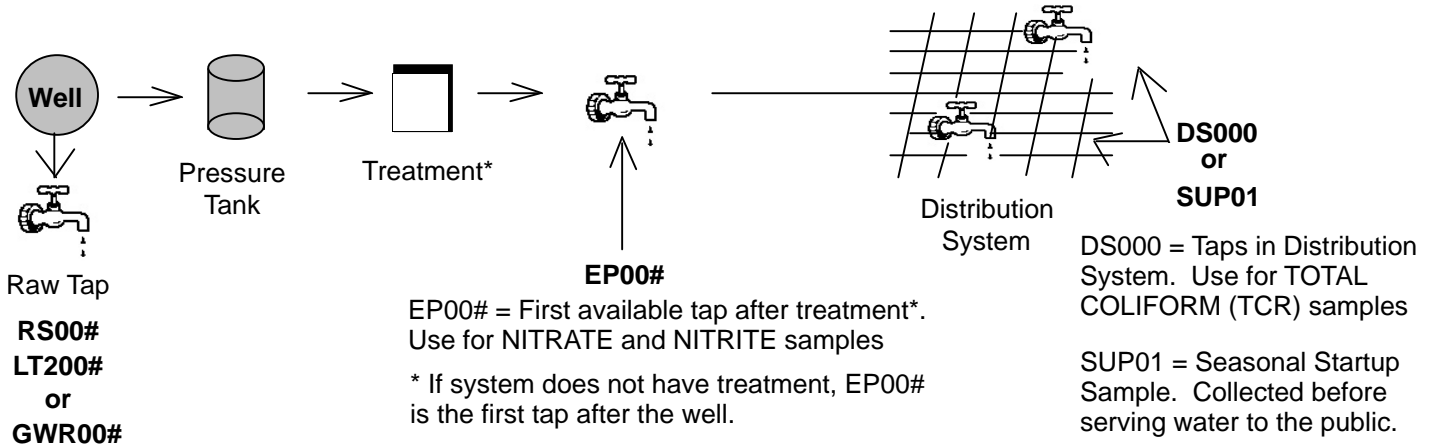

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2430112 ODOT REST AREA 6-10 PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 2454049	Facility Name: ODOT REST AREA 6-10	
Location SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System

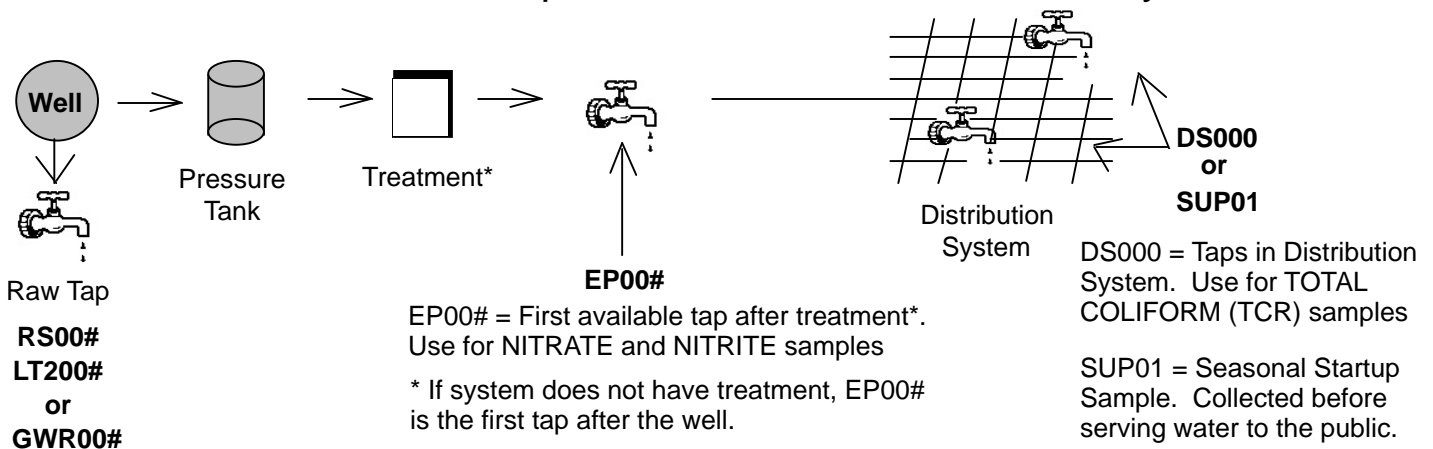

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2430612 BUCKEYE HILLS COUNTRY CLUB INC

System Type: Transient Noncommunity

Operating Period: 3/1 to 11/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE


Sampling Facility ID: DS1 Facility Name: BUCKEYE HILLS COUNTRY CL DISTRIBUTION
Location SMP ID: SUP01 Facility Source: Ground Water

Chemicals Monitoring Requirements

TOTAL COLIFORM - SEASONAL STARTUP At least 1 negative Total Coliform
 Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

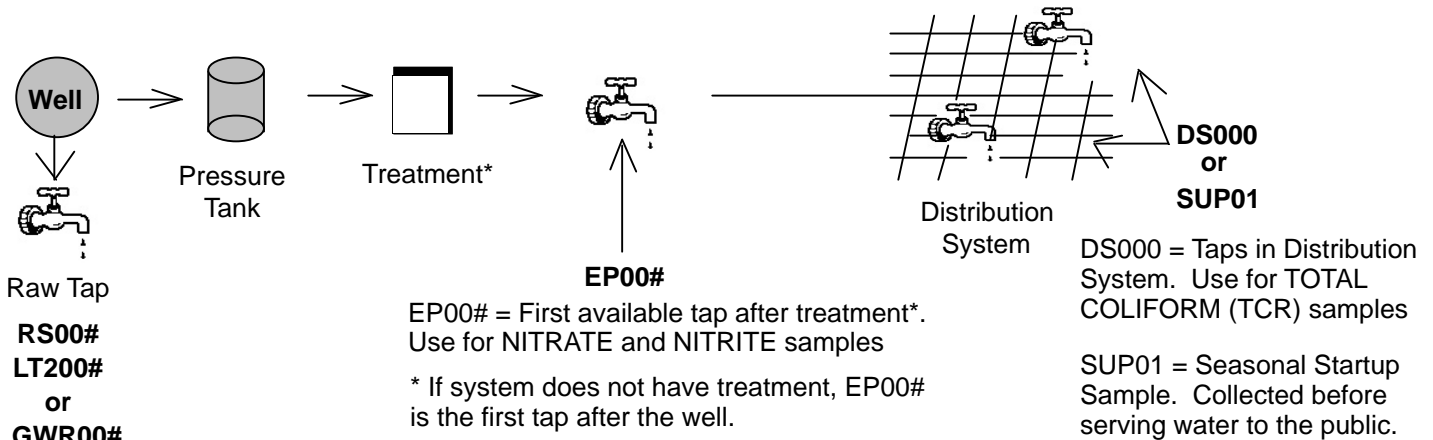

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2430612 BUCKEYE HILLS COUNTRY CLUB INC

System Type: Transient Noncommunity

Operating Period: 3/1 to 11/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: BUCKEYE HILLS COUNTRY CL DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 3/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System

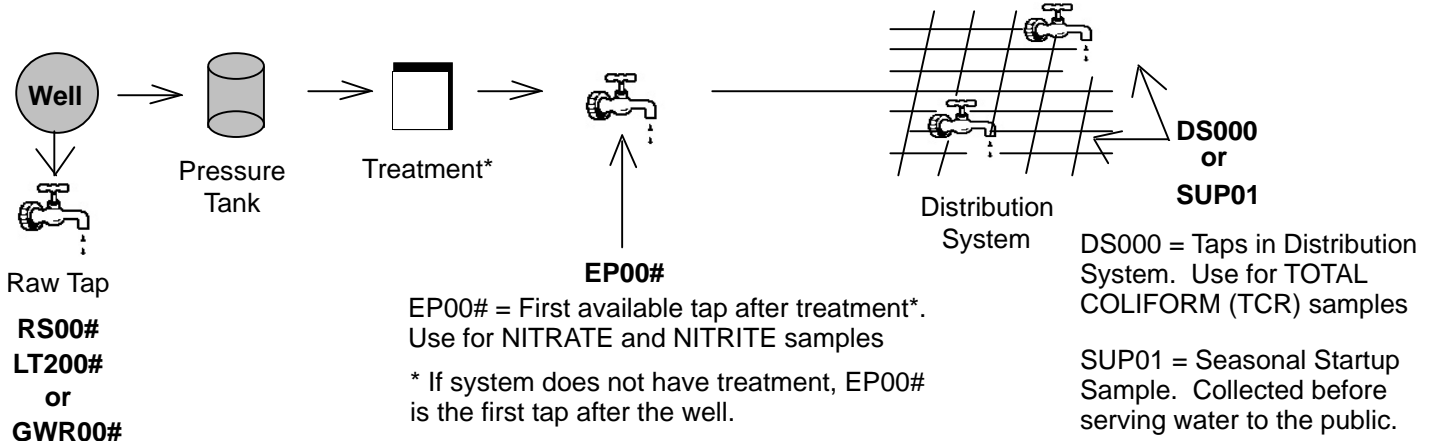

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2430612 BUCKEYE HILLS COUNTRY CLUB INC

System Type: Transient Noncommunity

Operating Period: 3/1 to 11/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 2454050 Facility Name: BUCKEYE HILLS COUNTRY CLUB
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System

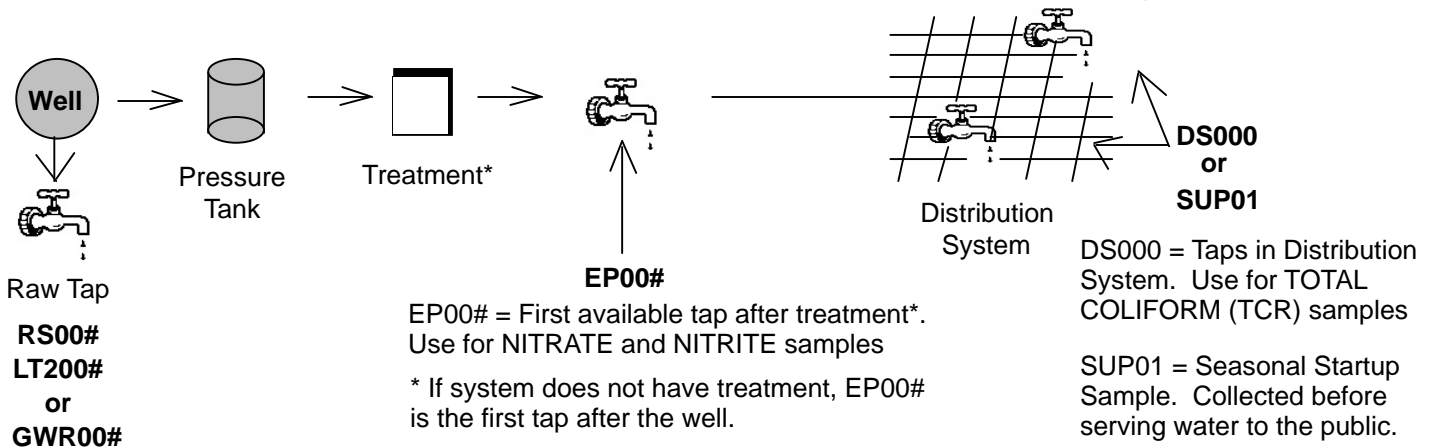

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2435612 WALNUT LAKE CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: WALNUT LAKE CAMPGROUND DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System

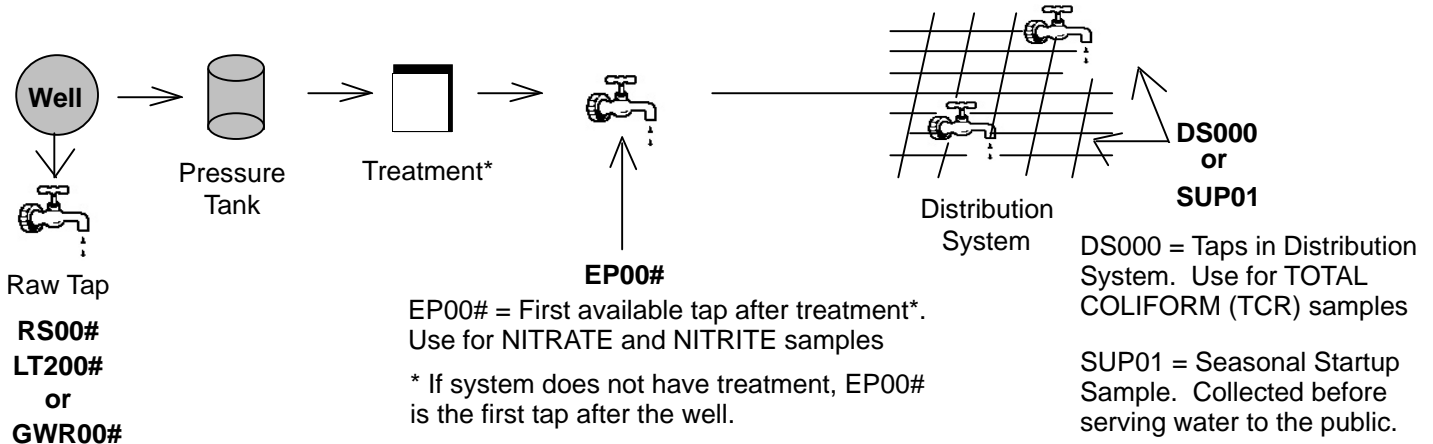

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2435612 WALNUT LAKE CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 2454064	Facility Name: WALNUT LAKE CAMPGROUND	
Location SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System

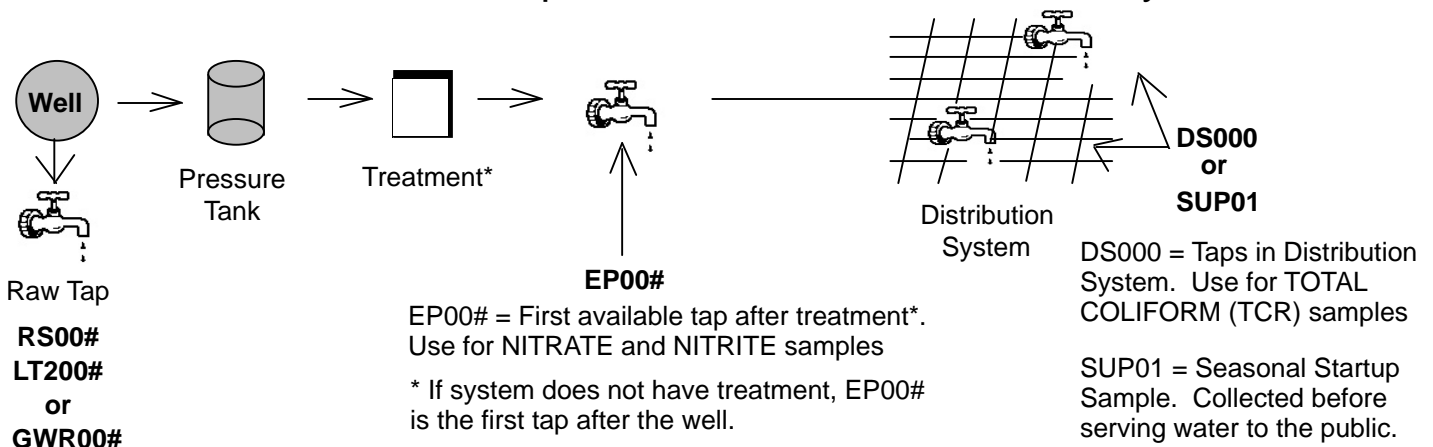

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2017

2017 ENTRY POINT SCHEDULE

OH2437412 I-71 & SR-35 PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 2454071 SMP ID: EP001	Facility Name: I-71 & ST RTE 35 PWS Facility Source: Ground Water	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2017 and 10/31/2017
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017
RADIOLOGICALS	1 Sample(s) Required between 6/1/2017 and 10/31/2017
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2017 and 5/31/2017
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH2437412 I-71 & SR-35 PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: I-71 & SR-35 PWS DIST	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2017 and 9/30/2017

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Form 5105 with appendix must be submitted to Ohio EPA within ten days from the end of the month(s) in which samples are collected. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>. For questions contact your Ohio EPA District Office representative.

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between 1/1/2017 and 1/31/2017

1 Sample(s) Required between 2/1/2017 and 2/28/2017

1 Sample(s) Required between 3/1/2017 and 3/31/2017

1 Sample(s) Required between 4/1/2017 and 4/30/2017

1 Sample(s) Required between 5/1/2017 and 5/31/2017

1 Sample(s) Required between 6/1/2017 and 6/30/2017

1 Sample(s) Required between 7/1/2017 and 7/31/2017

1 Sample(s) Required between 8/1/2017 and 8/31/2017

1 Sample(s) Required between 9/1/2017 and 9/30/2017

1 Sample(s) Required between 10/1/2017 and 10/31/2017

1 Sample(s) Required between 11/1/2017 and 11/30/2017

1 Sample(s) Required between 12/1/2017 and 12/31/2017

TOTAL CHLORINE - 1000

1 Sample(s) Required between 1/1/2017 and 1/31/2017

1 Sample(s) Required between 2/1/2017 and 2/28/2017

1 Sample(s) Required between 3/1/2017 and 3/31/2017

1 Sample(s) Required between 4/1/2017 and 4/30/2017

1 Sample(s) Required between 5/1/2017 and 5/31/2017

1 Sample(s) Required between 6/1/2017 and 6/30/2017

1 Sample(s) Required between 7/1/2017 and 7/31/2017

1 Sample(s) Required between 8/1/2017 and 8/31/2017

1 Sample(s) Required between 9/1/2017 and 9/30/2017

1 Sample(s) Required between 10/1/2017 and 10/31/2017

1 Sample(s) Required between 11/1/2017 and 11/30/2017

1 Sample(s) Required between 12/1/2017 and 12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.



OH2437412 I-71 & SR-35 PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2017**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: I-71 & SR-35 PWS DIST ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: I-71 & SR-35 PWS DIST ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH2438112 MAYER FARM EQUIPMENT PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: MAYER FARM EQUIPMENT DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System

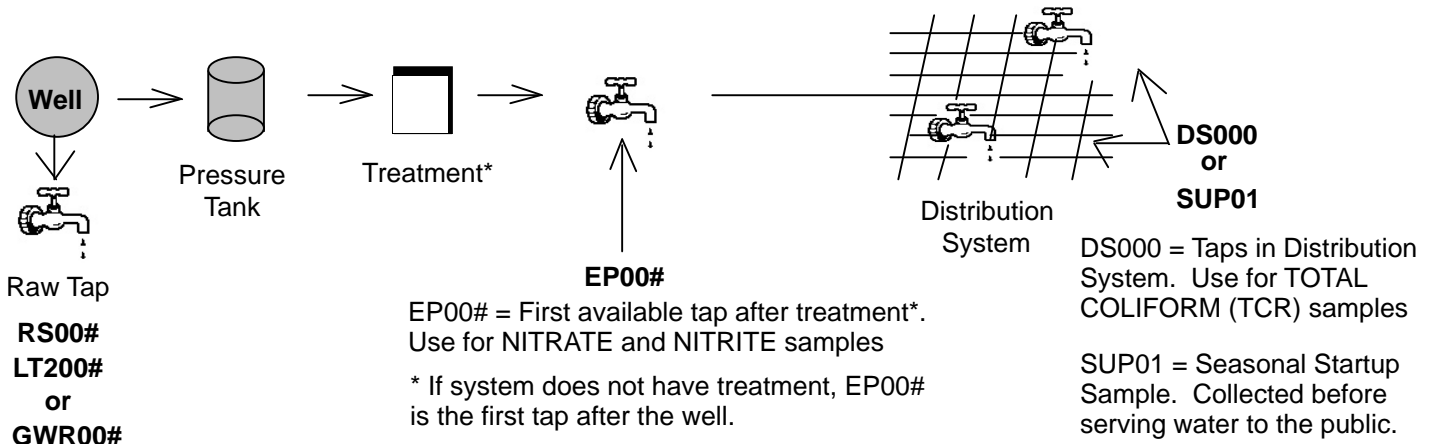

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2438112 MAYER FARM EQUIPMENT PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 2461531 Facility Name: MAYER FARM EQUIPMENT
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System

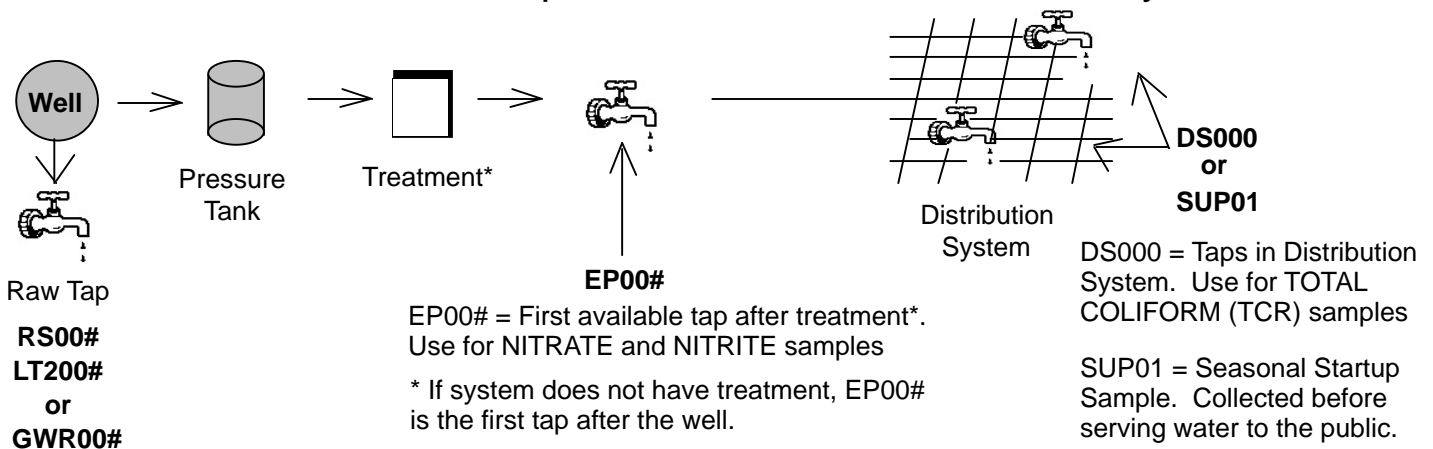

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2438312 CARTER LUMBER PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: CARTER LUMBER 22-20 DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System

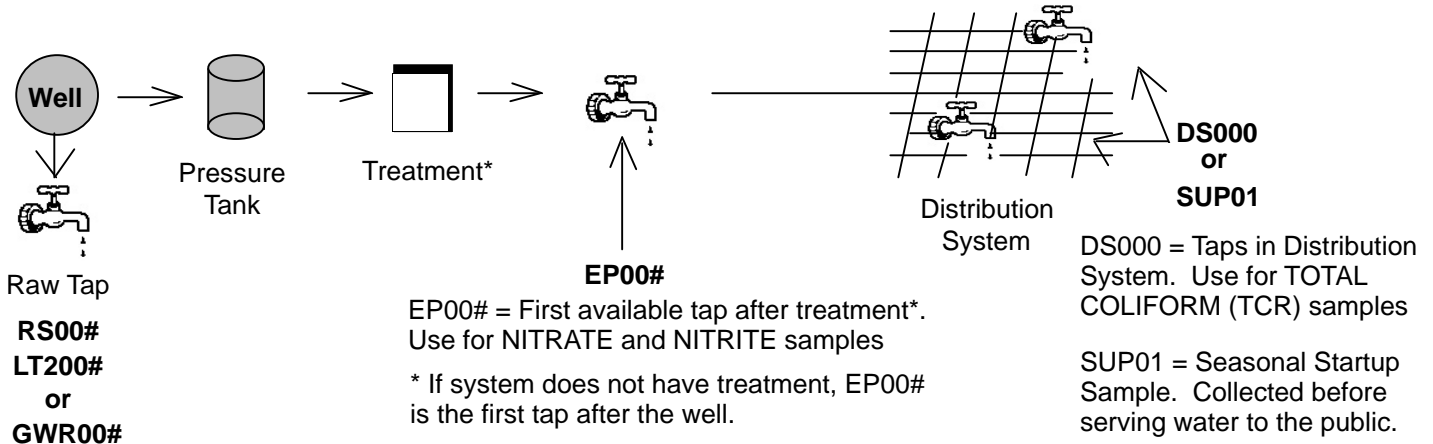

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2438312 CARTER LUMBER PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 2461567 Facility Name: CARTER LUMBER
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System

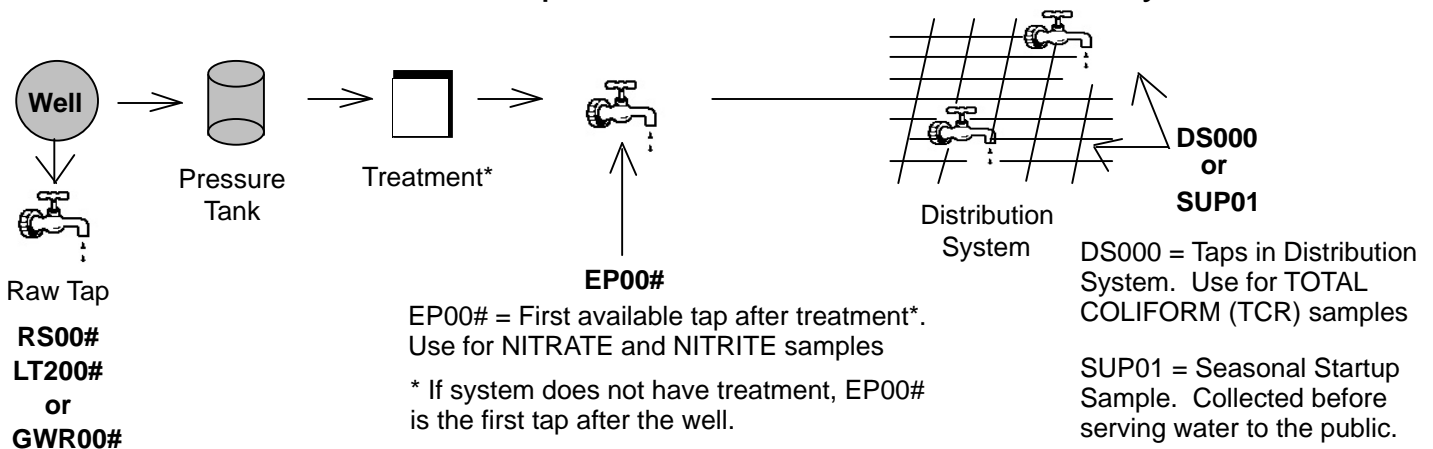

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2438512 UNITY FELLOWSHIP CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: UNITY FELLOWSHIP CHURCH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System

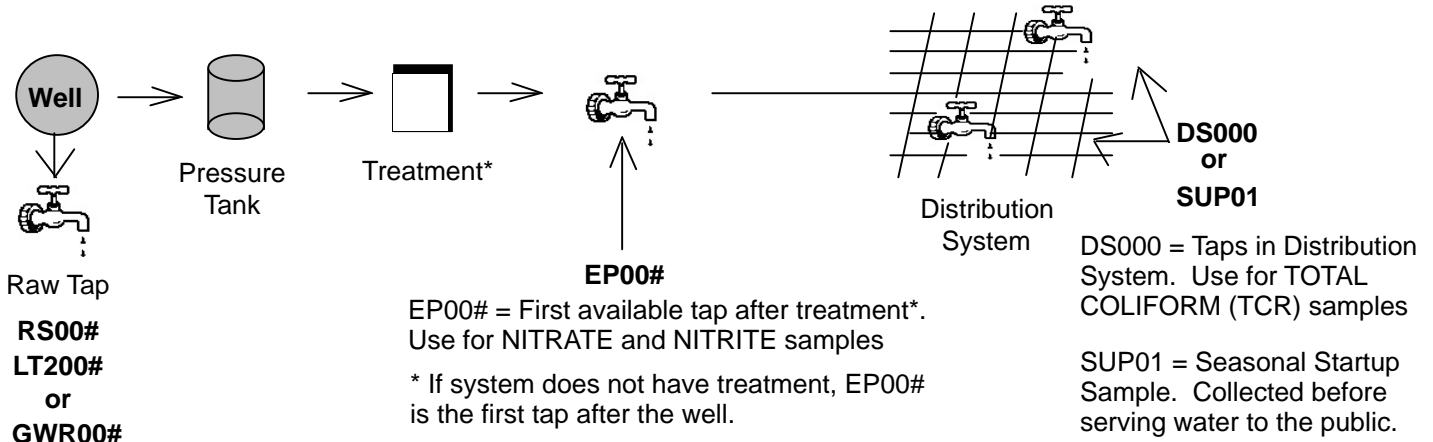

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2438512 UNITY FELLOWSHIP CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 2462074 Facility Name: UNITY FELLOWSHIP CHURCH
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System

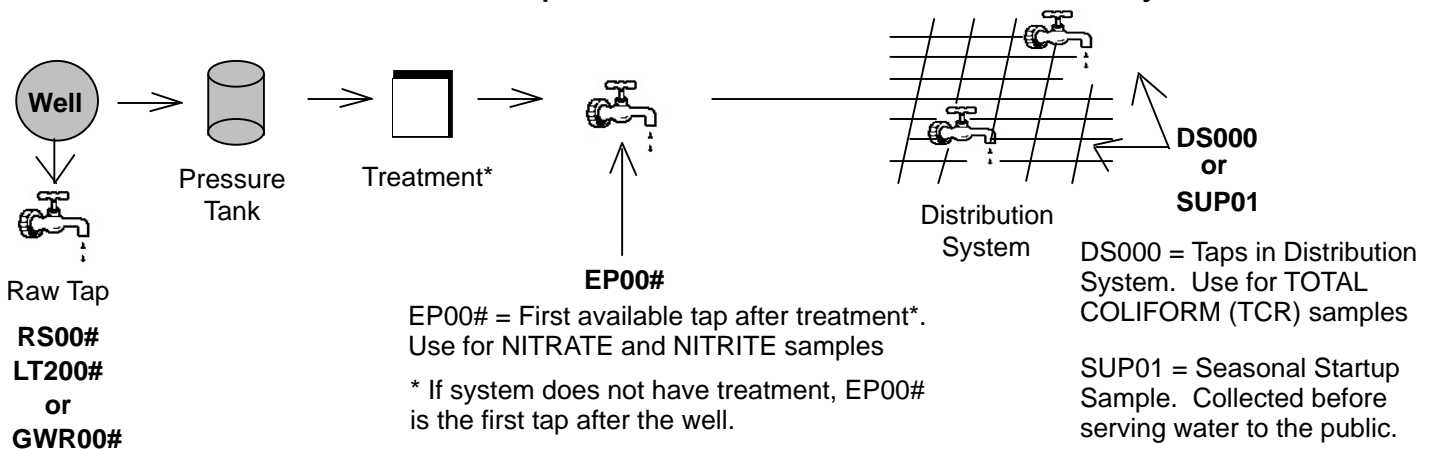

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2438713 HOLLAND PYKE FARMS PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

Where to Collect Samples For a Small Public Water System

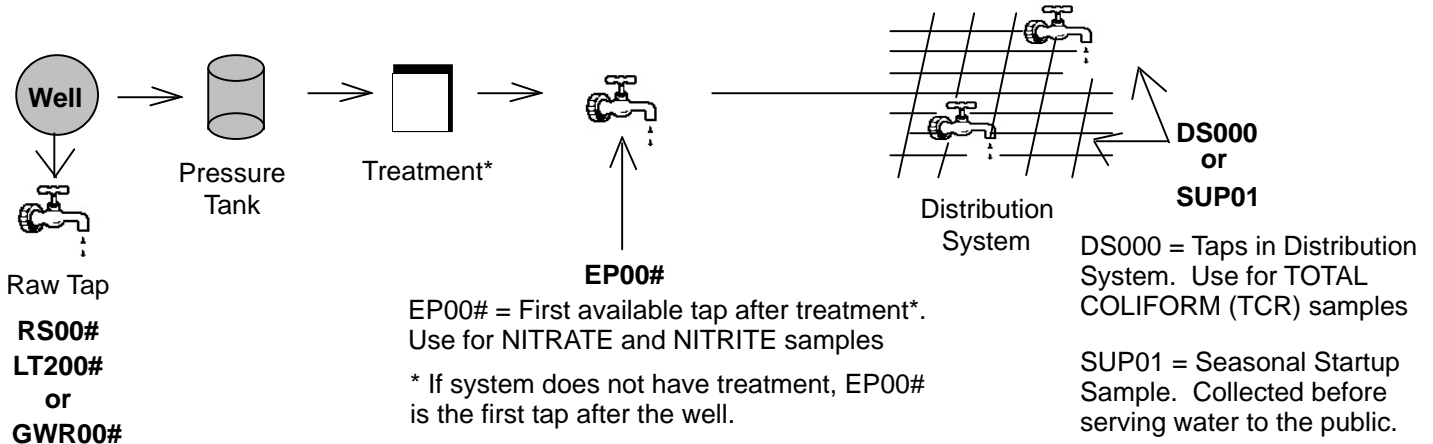

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2438713 HOLLAND PYKE FARMS PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 2462353 Facility Name: HOLLAND PYKE FARMS
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2017 and 5/31/2017
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

Where to Collect Samples For a Small Public Water System

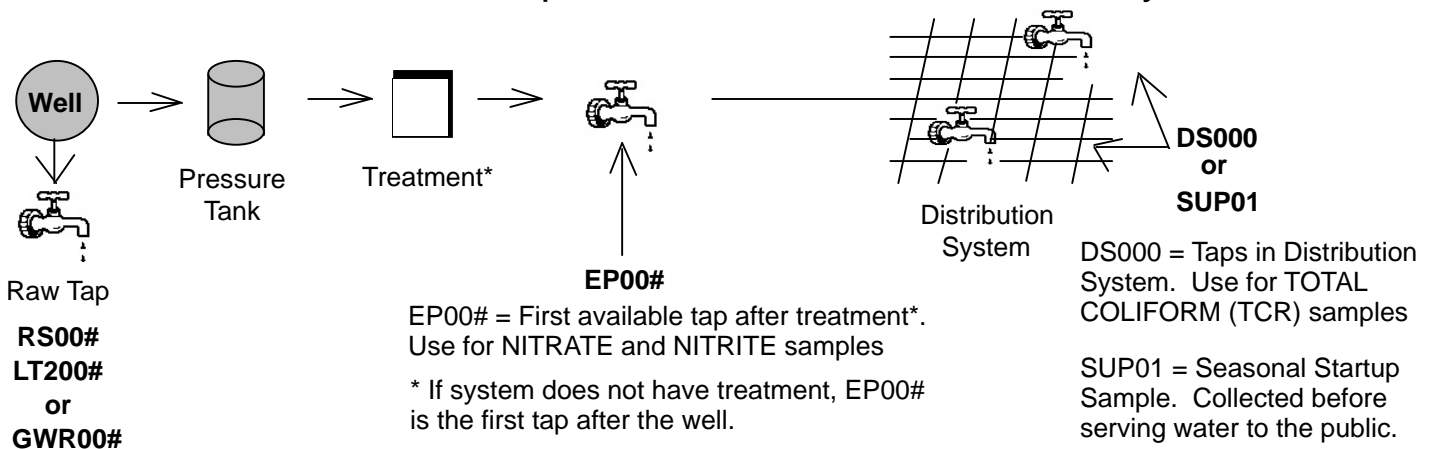

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!