



OH3000111 CAMBRIDGE, CITY OF

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>3054707</b>	Facility Name: <b>WTP-CAMBRIDGE</b>	Facility Class: <b>CLASS 4</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Surface Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 1/1/2017 and 5/31/2017
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020	
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 1/31/2017 1 Sample(s) Required between 2/1/2017 and 2/28/2017 1 Sample(s) Required between 3/1/2017 and 3/31/2017 1 Sample(s) Required between 4/1/2017 and 4/30/2017 1 Sample(s) Required between 5/1/2017 and 5/31/2017 1 Sample(s) Required between 6/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 7/31/2017 1 Sample(s) Required between 8/1/2017 and 8/31/2017 1 Sample(s) Required between 9/1/2017 and 9/30/2017 1 Sample(s) Required between 10/1/2017 and 10/31/2017 1 Sample(s) Required between 11/1/2017 and 11/30/2017 1 Sample(s) Required between 12/1/2017 and 12/31/2017
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2017 and 6/30/2017
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2017 and 5/31/2017
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 1/1/2017 and 1/31/2017 1 Paired Sample Set Required between 2/1/2017 and 2/28/2017 1 Paired Sample Set Required between 3/1/2017 and 3/31/2017 1 Paired Sample Set Required between 4/1/2017 and 4/30/2017 1 Paired Sample Set Required between 5/1/2017 and 5/31/2017 1 Paired Sample Set Required between 6/1/2017 and 6/30/2017 1 Paired Sample Set Required between 7/1/2017 and 7/31/2017 1 Paired Sample Set Required between 8/1/2017 and 8/31/2017 1 Paired Sample Set Required between 9/1/2017 and 9/30/2017 1 Paired Sample Set Required between 10/1/2017 and 10/31/2017 1 Paired Sample Set Required between 11/1/2017 and 11/30/2017 1 Paired Sample Set Required between 12/1/2017 and 12/31/2017

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



Effective Date: 01/01/2017

2017 ENTRY POINT SCHEDULE

**OH3000111 CAMBRIDGE, CITY OF**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>3054707</b>	Facility Name: <b>WTP-CAMBRIDGE</b>	
<b>Location</b>	SMP ID: <b>EP001/LT2001</b>	Facility Source: <b>Surface Water</b>	Facility Class: <b>CLASS 4</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017**

**Chemicals**

**Monitoring Requirements**

TOTAL MICROCYSTINS

1 Sample Set Required WEEKLY\*

*Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. A week is defined as Sunday through Saturday.*

*\*Weekly sampling unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. Reduced monitoring is contingent on a PWS continuing to experience NO raw or finished water total microcystins detections. Any total microcystins detections during routine (weekly) or reduced sampling will trigger additional sampling. Please refer to the website above for specifics on follow-up sampling requirements.*



OH3000111 CAMBRIDGE, CITY OF

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>3054707</b>	Facility Name: <b>WTP-CAMBRIDGE</b>	Facility Class: <b>CLASS 4</b>
	SMP ID: <b>LT2001</b>	Facility Source: <b>Surface Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017

Chemicals	Monitoring Requirements
-----------	-------------------------

CYANOBACTERIA SCREENING	1 Sample(s) Required between 1/8/2017 and 1/14/2017
	1 Sample(s) Required between 1/22/2017 and 1/28/2017
	1 Sample(s) Required between 2/5/2017 and 2/11/2017
	1 Sample(s) Required between 2/19/2017 and 2/25/2017
	1 Sample(s) Required between 3/5/2017 and 3/11/2017
	1 Sample(s) Required between 3/19/2017 and 3/25/2017
	1 Sample(s) Required between 4/2/2017 and 4/8/2017
	1 Sample(s) Required between 4/16/2017 and 4/22/2017
	1 Sample(s) Required between 4/30/2017 and 5/6/2017
	1 Sample(s) Required between 5/14/2017 and 5/20/2017
	1 Sample(s) Required between 5/28/2017 and 6/3/2017
	1 Sample(s) Required between 6/11/2017 and 6/17/2017
	1 Sample(s) Required between 6/25/2017 and 7/1/2017
	1 Sample(s) Required between 7/9/2017 and 7/15/2017
	1 Sample(s) Required between 7/23/2017 and 7/29/2017
	1 Sample(s) Required between 8/6/2017 and 8/12/2017
	1 Sample(s) Required between 8/20/2017 and 8/26/2017
	1 Sample(s) Required between 9/3/2017 and 9/9/2017
	1 Sample(s) Required between 9/17/2017 and 9/23/2017
	1 Sample(s) Required between 10/1/2017 and 10/7/2017
	1 Sample(s) Required between 10/15/2017 and 10/21/2017
	1 Sample(s) Required between 10/29/2017 and 11/4/2017
	1 Sample(s) Required between 11/12/2017 and 11/18/2017
	1 Sample(s) Required between 11/26/2017 and 12/2/2017
	1 Sample(s) Required between 12/10/2017 and 12/16/2017
	1 Sample(s) Required between 12/24/2017 and 12/30/2017
	1 Sample(s) Required between 1/7/2018 and 1/13/2018

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001. SAMPLES MUST BE SHIPPED OVERNIGHT ON ICE ON THE DAY OF COLLECTION AND ARRIVE AT OHIO EPA DIVISION OF ENVIRONMENTAL SERVICES (DES) BY NOON MONDAY THROUGH THURSDAY ONLY! Ohio EPA has agreed to fund the analysis of cyanobacteria screening samples until December 31, 2017. Public water systems remain responsible for ensuring that samples are shipped via approved regional shipping hubs or other means. Please review the website for http://epa.ohio.gov/ddagw/HAB.aspx for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections.

LT2 MONITORING	1 Sample(s) Required between 1/7/2017 and 1/11/2017
	1 Sample(s) Required between 2/11/2017 and 2/15/2017
	1 Sample(s) Required between 3/11/2017 and 3/15/2017
	1 Sample(s) Required between 4/8/2017 and 4/12/2017
	1 Sample(s) Required between 5/6/2017 and 5/10/2017
	1 Sample(s) Required between 6/10/2017 and 6/14/2017
	1 Sample(s) Required between 7/8/2017 and 7/12/2017
	1 Sample(s) Required between 8/15/2017 and 8/19/2017
	1 Sample(s) Required between 9/9/2017 and 9/13/2017
	1 Sample(s) Required between 10/7/2017 and 10/11/2017
	1 Sample(s) Required between 11/11/2017 and 11/15/2017



Effective Date: 01/01/2017

2017 ENTRY POINT SCHEDULE

OH3000111 CAMBRIDGE, CITY OF

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling</b>	Facility ID: <b>3054707</b>	Facility Name: <b>WTP-CAMBRIDGE</b>	
<b>Location</b>	SMP ID: <b>LT2001</b>	Facility Source: <b>Surface Water</b>	Facility Class: <b>CLASS 4</b>

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017

Chemicals

Monitoring Requirements

LT2 MONITORING 1 Sample(s) Required between 12/9/2017 and 12/13/2017

Monitor for: Cryptosporidium - 2078, E-coli count - 3014, Turbidity - 0100

LT2 MATRIX SPIKE SAMPLE 1 Sample(s) Required between 11/11/2017 and 11/15/2017



**OH3000111 CAMBRIDGE, CITY OF**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>DISTRIBUTION-CAMBRIDGE</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	30 Sample(s) Required between 6/1/2017 and 9/30/2017
-------------------------------	--

*Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Form 5105 with appendix must be submitted to Ohio EPA within ten days from the end of the month(s) in which samples are collected. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>. For questions contact your Ohio EPA District Office representative.*

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	10 Sample(s) Required between 1/1/2017 and 1/31/2017
	10 Sample(s) Required between 2/1/2017 and 2/28/2017
	10 Sample(s) Required between 3/1/2017 and 3/31/2017
	10 Sample(s) Required between 4/1/2017 and 4/30/2017
	10 Sample(s) Required between 5/1/2017 and 5/31/2017
	10 Sample(s) Required between 6/1/2017 and 6/30/2017
	10 Sample(s) Required between 7/1/2017 and 7/31/2017
	10 Sample(s) Required between 8/1/2017 and 8/31/2017
	10 Sample(s) Required between 9/1/2017 and 9/30/2017
	10 Sample(s) Required between 10/1/2017 and 10/31/2017
	10 Sample(s) Required between 11/1/2017 and 11/30/2017
	10 Sample(s) Required between 12/1/2017 and 12/31/2017

TOTAL CHLORINE - 1000	10 Sample(s) Required between 1/1/2017 and 1/31/2017
	10 Sample(s) Required between 2/1/2017 and 2/28/2017
	10 Sample(s) Required between 3/1/2017 and 3/31/2017
	10 Sample(s) Required between 4/1/2017 and 4/30/2017
	10 Sample(s) Required between 5/1/2017 and 5/31/2017
	10 Sample(s) Required between 6/1/2017 and 6/30/2017
	10 Sample(s) Required between 7/1/2017 and 7/31/2017
	10 Sample(s) Required between 8/1/2017 and 8/31/2017
	10 Sample(s) Required between 9/1/2017 and 9/30/2017
	10 Sample(s) Required between 10/1/2017 and 10/31/2017
	10 Sample(s) Required between 11/1/2017 and 11/30/2017
	10 Sample(s) Required between 12/1/2017 and 12/31/2017

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>DISTRIBUTION-CAMBRIDGE</b> <b>9900 BRICK CHURCH RD.</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2017 and 2/7/2017 at: DS201
	Dual Sample Required between 5/1/2017 and 5/7/2017 at: DS201

**OH3000111 CAMBRIDGE, CITY OF**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>DISTRIBUTION-CAMBRIDGE</b> <b>9900 BRICK CHURCH RD.</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 8/1/2017 and 8/7/2017 at: DS201 Dual Sample Required between 11/1/2017 and 11/7/2017 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>DISTRIBUTION-CAMBRIDGE</b> <b>1000 WATER ST.</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2017 and 2/7/2017 at: DS202 Dual Sample Required between 5/1/2017 and 5/7/2017 at: DS202 Dual Sample Required between 8/1/2017 and 8/7/2017 at: DS202 Dual Sample Required between 11/1/2017 and 11/7/2017 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS203</b>	Facility Name: <b>DISTRIBUTION-CAMBRIDGE</b> <b>1300 CLARK ST.</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2017 and 2/7/2017 at: DS203 Dual Sample Required between 5/1/2017 and 5/7/2017 at: DS203 Dual Sample Required between 8/1/2017 and 8/7/2017 at: DS203 Dual Sample Required between 11/1/2017 and 11/7/2017 at: DS203

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS204</b>	Facility Name: <b>DISTRIBUTION-CAMBRIDGE</b> <b>9547 CADIZ ROAD</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2017 and 2/7/2017 at: DS204 Dual Sample Required between 5/1/2017 and 5/7/2017 at: DS204 Dual Sample Required between 8/1/2017 and 8/7/2017 at: DS204 Dual Sample Required between 11/1/2017 and 11/7/2017 at: DS204

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH3000603 GUERNSEY CO. WATER DEPT.**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\*** Consumer Confidence Report (CCR) is due July 1, 2017

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Location** Facility ID: **DS1** Facility Name: **DISTRIBUTION-GUERNSEY CO. WATER DEPT.** Facility Class: **CLASS 1**  
SMP ID: **DS000**

**Chemicals**

**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 20 Sample(s) Required between 6/1/2017 and 9/30/2017

*Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Form 5105 with appendix must be submitted to Ohio EPA within ten days from the end of the month(s) in which samples are collected. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>. For questions contact your Ohio EPA District Office representative.*

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100  
10 Sample(s) Required between 1/1/2017 and 1/31/2017  
10 Sample(s) Required between 2/1/2017 and 2/28/2017  
10 Sample(s) Required between 3/1/2017 and 3/31/2017  
10 Sample(s) Required between 4/1/2017 and 4/30/2017  
10 Sample(s) Required between 5/1/2017 and 5/31/2017  
10 Sample(s) Required between 6/1/2017 and 6/30/2017  
10 Sample(s) Required between 7/1/2017 and 7/31/2017  
10 Sample(s) Required between 8/1/2017 and 8/31/2017  
10 Sample(s) Required between 9/1/2017 and 9/30/2017  
10 Sample(s) Required between 10/1/2017 and 10/31/2017  
10 Sample(s) Required between 11/1/2017 and 11/30/2017  
10 Sample(s) Required between 12/1/2017 and 12/31/2017

TOTAL CHLORINE - 1000  
10 Sample(s) Required between 1/1/2017 and 1/31/2017  
10 Sample(s) Required between 2/1/2017 and 2/28/2017  
10 Sample(s) Required between 3/1/2017 and 3/31/2017  
10 Sample(s) Required between 4/1/2017 and 4/30/2017  
10 Sample(s) Required between 5/1/2017 and 5/31/2017  
10 Sample(s) Required between 6/1/2017 and 6/30/2017  
10 Sample(s) Required between 7/1/2017 and 7/31/2017  
10 Sample(s) Required between 8/1/2017 and 8/31/2017  
10 Sample(s) Required between 9/1/2017 and 9/30/2017  
10 Sample(s) Required between 10/1/2017 and 10/31/2017  
10 Sample(s) Required between 11/1/2017 and 11/30/2017  
10 Sample(s) Required between 12/1/2017 and 12/31/2017

*Samples should be collected at the same time and place as the Total Coliform samples.*

**Sampling Location** Facility ID: **DS1** Facility Name: **DISTRIBUTION-GUERNSEY CO. WATER DEPT.** Facility Class: **CLASS 1**  
SMP ID: **DS201** **16869 CADIZ RD. LORE CITY**

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS  
Dual Sample Required between 3/1/2017 and 3/7/2017 at: DS201  
Dual Sample Required between 6/1/2017 and 6/7/2017 at: DS201



**OH3000603 GUERNSEY CO. WATER DEPT.**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>DISTRIBUTION-GUERNSEY CO. WATER DEPT.</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>DS201</b>	<b>16869 CADIZ RD. LORE CITY</b>	

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 9/1/2017 and 9/7/2017 at: DS201

Dual Sample Required between 12/1/2017 and 12/7/2017 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>DISTRIBUTION-GUERNSEY CO. WATER DEPT.</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>DS202</b>	<b>SR 313 AND SR 660 CAMBRIDGE</b>	

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 3/1/2017 and 3/7/2017 at: DS202

Dual Sample Required between 6/1/2017 and 6/7/2017 at: DS202

Dual Sample Required between 9/1/2017 and 9/7/2017 at: DS202

Dual Sample Required between 12/1/2017 and 12/7/2017 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950





Effective Date: 01/01/2017

2017 ENTRY POINT SCHEDULE

OH3000912 PLEASANT CITY, VILLAGE OF

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>3054714</b>	Facility Name: <b>WTP-PLEASANT CITY</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017

Chemicals	Monitoring Requirements
ARSENIC - 1005	1 Sample(s) Required between 1/1/2017 and 3/31/2017 1 Sample(s) Required between 4/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 9/30/2017 1 Sample(s) Required between 10/1/2017 and 12/31/2017
INORGANICS	1 Sample(s) Required between 6/1/2017 and 10/31/2017
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTAL - 1015 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL	
NITRITE - 1041	1 Sample(s) Required between 1/1/2017 and 3/31/2017 1 Sample(s) Required between 4/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 9/30/2017 1 Sample(s) Required between 10/1/2017 and 12/31/2017
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2017 and 10/31/2017

**OH3000912 PLEASANT CITY, VILLAGE OF**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>DISTRIBUTION-PLEASANT CITY</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2017 and 1/31/2017
	1 Sample(s) Required between	2/1/2017 and 2/28/2017
	1 Sample(s) Required between	3/1/2017 and 3/31/2017
	1 Sample(s) Required between	4/1/2017 and 4/30/2017
	1 Sample(s) Required between	5/1/2017 and 5/31/2017
	1 Sample(s) Required between	6/1/2017 and 6/30/2017
	1 Sample(s) Required between	7/1/2017 and 7/31/2017
	1 Sample(s) Required between	8/1/2017 and 8/31/2017
	1 Sample(s) Required between	9/1/2017 and 9/30/2017
	1 Sample(s) Required between	10/1/2017 and 10/31/2017
	1 Sample(s) Required between	11/1/2017 and 11/30/2017
	1 Sample(s) Required between	12/1/2017 and 12/31/2017

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2017 and 1/31/2017
	1 Sample(s) Required between	2/1/2017 and 2/28/2017
	1 Sample(s) Required between	3/1/2017 and 3/31/2017
	1 Sample(s) Required between	4/1/2017 and 4/30/2017
	1 Sample(s) Required between	5/1/2017 and 5/31/2017
	1 Sample(s) Required between	6/1/2017 and 6/30/2017
	1 Sample(s) Required between	7/1/2017 and 7/31/2017
	1 Sample(s) Required between	8/1/2017 and 8/31/2017
	1 Sample(s) Required between	9/1/2017 and 9/30/2017
	1 Sample(s) Required between	10/1/2017 and 10/31/2017
	1 Sample(s) Required between	11/1/2017 and 11/30/2017
	1 Sample(s) Required between	12/1/2017 and 12/31/2017

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>DISTRIBUTION-PLEASANT CITY</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

**OH3000912 PLEASANT CITY, VILLAGE OF**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>DISTRIBUTION-PLEASANT CITY</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH3001011 QUAKER CITY**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>DISTRIBUTION-QUAKER CITY</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 1/31/2017 1 Sample(s) Required between 2/1/2017 and 2/28/2017 1 Sample(s) Required between 3/1/2017 and 3/31/2017 1 Sample(s) Required between 4/1/2017 and 4/30/2017 1 Sample(s) Required between 5/1/2017 and 5/31/2017 1 Sample(s) Required between 6/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 7/31/2017 1 Sample(s) Required between 8/1/2017 and 8/31/2017 1 Sample(s) Required between 9/1/2017 and 9/30/2017 1 Sample(s) Required between 10/1/2017 and 10/31/2017 1 Sample(s) Required between 11/1/2017 and 11/30/2017 1 Sample(s) Required between 12/1/2017 and 12/31/2017
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2017 and 1/31/2017 1 Sample(s) Required between 2/1/2017 and 2/28/2017 1 Sample(s) Required between 3/1/2017 and 3/31/2017 1 Sample(s) Required between 4/1/2017 and 4/30/2017 1 Sample(s) Required between 5/1/2017 and 5/31/2017 1 Sample(s) Required between 6/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 7/31/2017 1 Sample(s) Required between 8/1/2017 and 8/31/2017 1 Sample(s) Required between 9/1/2017 and 9/30/2017 1 Sample(s) Required between 10/1/2017 and 10/31/2017 1 Sample(s) Required between 11/1/2017 and 11/30/2017 1 Sample(s) Required between 12/1/2017 and 12/31/2017

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>DISTRIBUTION-QUAKER CITY</b> <b>STATE ROUTE 800</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 1/1/2017 and 1/7/2017 at: DS201 Dual Sample Required between 4/1/2017 and 4/7/2017 at: DS201 Dual Sample Required between 7/1/2017 and 7/7/2017 at: DS201 Dual Sample Required between 10/1/2017 and 10/7/2017 at: DS201
-------------------------	--

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH3001011 QUAKER CITY**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>DISTRIBUTION-QUAKER CITY</b> <b>126 FAIR STREET</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

<b>Chemicals</b>	<b>Monitoring Requirements</b>		
DISINFECTION BYPRODUCTS	Dual Sample Required between	1/1/2017 and	1/7/2017 at: DS202
	Dual Sample Required between	4/1/2017 and	4/7/2017 at: DS202
	Dual Sample Required between	7/1/2017 and	7/7/2017 at: DS202
	Dual Sample Required between	10/1/2017 and	10/7/2017 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH3001103 WESTERN GUERNSEY REGIONAL WATER DISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017

DISTRIBUTION MONITORING SCHEDULE

Table with 4 columns: Sampling Location, Facility ID, Facility Name, Facility Class. Values: DS1, DS000, DISTRIBUTION-WESTERN GUERNSEY, CLASS 1

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2017 and 9/30/2017

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results.

TOTAL COLIFORM (TCR) - 3100 3 Sample(s) Required between 1/1/2017 and 1/31/2017 ... 3 Sample(s) Required between 12/1/2017 and 12/31/2017

TOTAL CHLORINE - 1000 3 Sample(s) Required between 1/1/2017 and 1/31/2017 ... 3 Sample(s) Required between 12/1/2017 and 12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.

Table with 4 columns: Sampling Location, Facility ID, Facility Name, Facility Class. Values: DS1, DS201, DISTRIBUTION-WESTERN GUERNSEY, CLASS 1

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 2/1/2017 and 2/7/2017 at: DS201 ... Dual Sample Required between 8/1/2017 and 8/7/2017 at: DS201



**OH3001103 WESTERN GUERNSEY REGIONAL WATER DISTRICT**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>DISTRIBUTION-WESTERN GUERNSEY</b> <b>2703 BLOOMFIELD ROAD</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 11/1/2017 and 11/7/2017 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>DISTRIBUTION-WESTERN GUERNSEY</b> <b>56032 CLAYSVILLE ROAD</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 2/1/2017 and 2/7/2017 at: DS202

Dual Sample Required between 5/1/2017 and 5/7/2017 at: DS202

Dual Sample Required between 8/1/2017 and 8/7/2017 at: DS202

Dual Sample Required between 11/1/2017 and 11/7/2017 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH3001212 BYESVILLE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>3054706</b>	Facility Name: <b>WTP-PLANT #2</b>	Facility Class: <b>CLASS 3</b>
	SMP ID: <b>EP002</b>	Facility Source: <b>Surface Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 1/1/2017 and 5/31/2017
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 1/31/2017 1 Sample(s) Required between 2/1/2017 and 2/28/2017 1 Sample(s) Required between 3/1/2017 and 3/31/2017 1 Sample(s) Required between 4/1/2017 and 4/30/2017 1 Sample(s) Required between 5/1/2017 and 5/31/2017 1 Sample(s) Required between 6/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 7/31/2017 1 Sample(s) Required between 8/1/2017 and 8/31/2017 1 Sample(s) Required between 9/1/2017 and 9/30/2017 1 Sample(s) Required between 10/1/2017 and 10/31/2017 1 Sample(s) Required between 11/1/2017 and 11/30/2017 1 Sample(s) Required between 12/1/2017 and 12/31/2017
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2017 and 6/30/2017
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2017 and 5/31/2017





Effective Date: 01/01/2017

2017 ENTRY POINT SCHEDULE

OH3001212 BYESVILLE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>3054706</b>	Facility Name: <b>WTP-PLANT #2</b>	Facility Class: <b>CLASS 3</b>
	SMP ID: <b>LT2002</b>	Facility Source: <b>Surface Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017

Chemicals	Monitoring Requirements
CYANOBACTERIA SCREENING	1 Sample(s) Required between 1/8/2017 and 1/14/2017
	1 Sample(s) Required between 1/22/2017 and 1/28/2017
	1 Sample(s) Required between 2/5/2017 and 2/11/2017
	1 Sample(s) Required between 2/19/2017 and 2/25/2017
	1 Sample(s) Required between 3/5/2017 and 3/11/2017
	1 Sample(s) Required between 3/19/2017 and 3/25/2017
	1 Sample(s) Required between 4/2/2017 and 4/8/2017
	1 Sample(s) Required between 4/16/2017 and 4/22/2017
	1 Sample(s) Required between 4/30/2017 and 5/6/2017
	1 Sample(s) Required between 5/14/2017 and 5/20/2017
	1 Sample(s) Required between 5/28/2017 and 6/3/2017
	1 Sample(s) Required between 6/11/2017 and 6/17/2017
	1 Sample(s) Required between 6/25/2017 and 7/1/2017
	1 Sample(s) Required between 7/9/2017 and 7/15/2017
	1 Sample(s) Required between 7/23/2017 and 7/29/2017
	1 Sample(s) Required between 8/6/2017 and 8/12/2017
	1 Sample(s) Required between 8/20/2017 and 8/26/2017
	1 Sample(s) Required between 9/3/2017 and 9/9/2017
	1 Sample(s) Required between 9/17/2017 and 9/23/2017
	1 Sample(s) Required between 10/1/2017 and 10/7/2017
1 Sample(s) Required between 10/15/2017 and 10/21/2017	
1 Sample(s) Required between 10/29/2017 and 11/4/2017	
1 Sample(s) Required between 11/12/2017 and 11/18/2017	
1 Sample(s) Required between 11/26/2017 and 12/2/2017	
1 Sample(s) Required between 12/10/2017 and 12/16/2017	
1 Sample(s) Required between 12/24/2017 and 12/30/2017	
1 Sample(s) Required between 1/7/2018 and 1/13/2018	

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2002. SAMPLES MUST BE SHIPPED OVERNIGHT ON ICE ON THE DAY OF COLLECTION AND ARRIVE AT OHIO EPA DIVISION OF ENVIRONMENTAL SERVICES (DES) BY NOON MONDAY THROUGH THURSDAY ONLY! Ohio EPA has agreed to fund the analysis of cyanobacteria screening samples until December 31, 2017. Public water systems remain responsible for ensuring that samples are shipped via approved regional shipping hubs or other means. Please review the website for http://epa.ohio.gov/ddagw/HAB.aspx for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections.



**OH3001212 BYESVILLE**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>DISTRIBUTION-BYESVILLE</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	5 Sample(s) Required between 1/1/2017 and 1/31/2017
	5 Sample(s) Required between 2/1/2017 and 2/28/2017
	5 Sample(s) Required between 3/1/2017 and 3/31/2017
	5 Sample(s) Required between 4/1/2017 and 4/30/2017
	5 Sample(s) Required between 5/1/2017 and 5/31/2017
	5 Sample(s) Required between 6/1/2017 and 6/30/2017
	5 Sample(s) Required between 7/1/2017 and 7/31/2017
	5 Sample(s) Required between 8/1/2017 and 8/31/2017
	5 Sample(s) Required between 9/1/2017 and 9/30/2017
	5 Sample(s) Required between 10/1/2017 and 10/31/2017
	5 Sample(s) Required between 11/1/2017 and 11/30/2017
	5 Sample(s) Required between 12/1/2017 and 12/31/2017

TOTAL CHLORINE - 1000	5 Sample(s) Required between 1/1/2017 and 1/31/2017
	5 Sample(s) Required between 2/1/2017 and 2/28/2017
	5 Sample(s) Required between 3/1/2017 and 3/31/2017
	5 Sample(s) Required between 4/1/2017 and 4/30/2017
	5 Sample(s) Required between 5/1/2017 and 5/31/2017
	5 Sample(s) Required between 6/1/2017 and 6/30/2017
	5 Sample(s) Required between 7/1/2017 and 7/31/2017
	5 Sample(s) Required between 8/1/2017 and 8/31/2017
	5 Sample(s) Required between 9/1/2017 and 9/30/2017
	5 Sample(s) Required between 10/1/2017 and 10/31/2017
	5 Sample(s) Required between 11/1/2017 and 11/30/2017
	5 Sample(s) Required between 12/1/2017 and 12/31/2017

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>DISTRIBUTION-BYESVILLE</b> <b>431 CARL STREET</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 3/1/2017 and 3/7/2017 at: DS201
	Dual Sample Required between 6/1/2017 and 6/7/2017 at: DS201
	Dual Sample Required between 9/1/2017 and 9/7/2017 at: DS201



**OH3001212 BYESVILLE**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>DISTRIBUTION-BYESVILLE</b> <b>431 CARL STREET</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS Dual Sample Required between 12/1/2017 and 12/7/2017 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>DISTRIBUTION-BYESVILLE</b> <b>357 NORTH CAMBRIDGE STREET</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 3/1/2017 and 3/7/2017 at: DS202

Dual Sample Required between 6/1/2017 and 6/7/2017 at: DS202

Dual Sample Required between 9/1/2017 and 9/7/2017 at: DS202

Dual Sample Required between 12/1/2017 and 12/7/2017 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

**OH3033712 MWCD PIEDMONT CAMP P2 PWS**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1 Facility Name: MWCD,PIEDMONT CAMP P2 DISTRIBUTION**  
**Location SMP ID: SUP01 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**

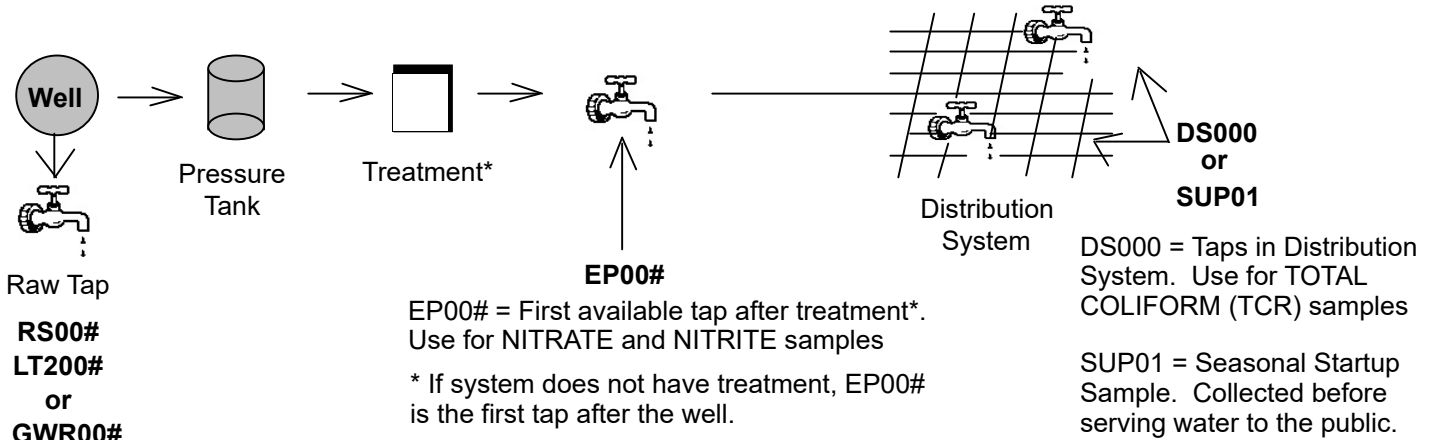

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3033712 MWCD PIEDMONT CAMP P2 PWS**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> MWCD,PIEDMONT CAMP P2 DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

**Where to Collect Samples For a Small Public Water System**

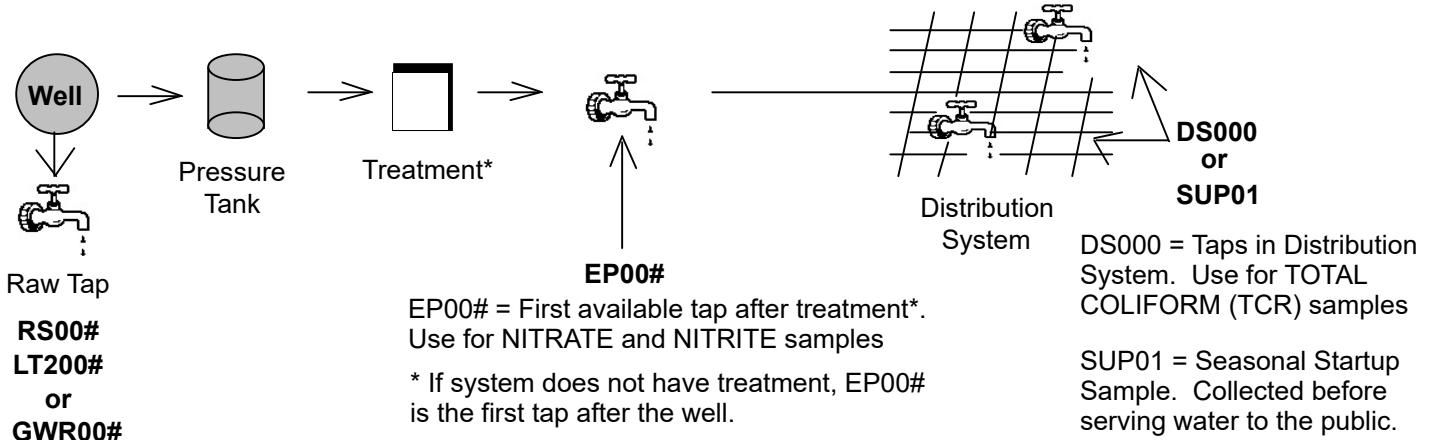

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3033712 MWCD PIEDMONT CAMP P2 PWS**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 3054726 Facility Name: MWCD PIEDMONT CAMP P2**

**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

**Where to Collect Samples For a Small Public Water System**

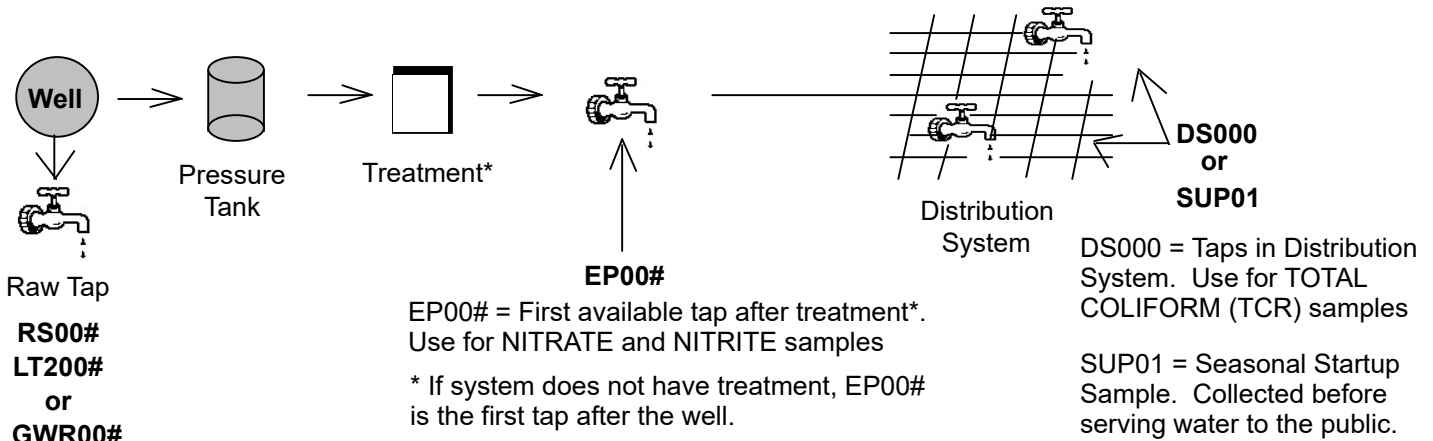

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3033912 THE SHACK**

System Type: Transient Noncommunity

Operating Period: 4/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **SUGARSHACK DISTRIBUTION**  
**Location** SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**

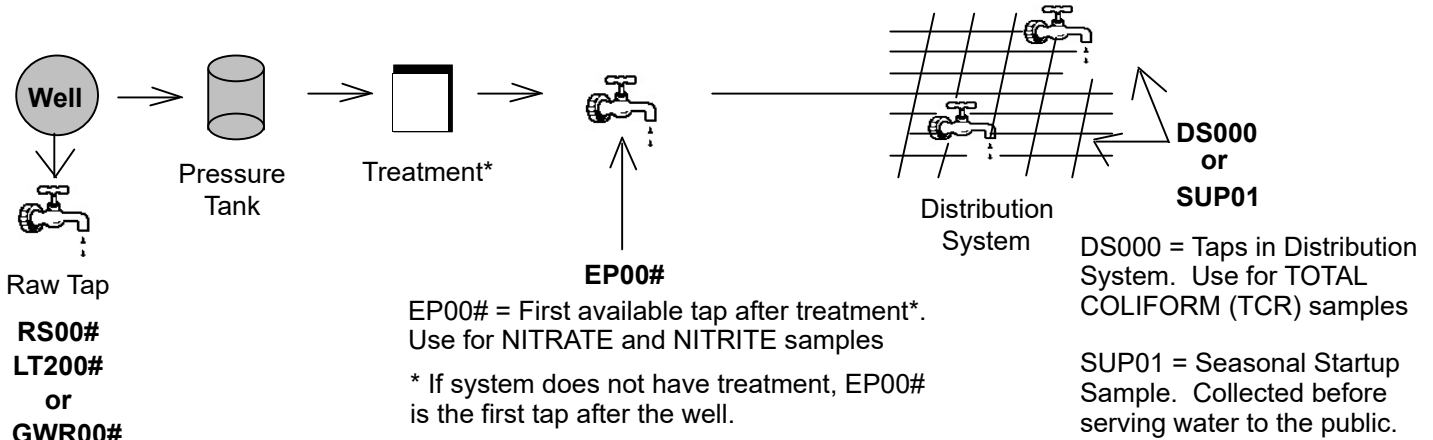

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3033912 THE SHACK**

System Type: Transient Noncommunity

Operating Period: 4/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1 Facility Name: SUGARSHACK DISTRIBUTION**  
**Location SMP ID: DS000 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2017 and 4/30/2017
	1 Sample(s) Required between 5/1/2017 and 5/31/2017
	1 Sample(s) Required between 6/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 7/31/2017
	1 Sample(s) Required between 8/1/2017 and 8/31/2017
	1 Sample(s) Required between 9/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 10/31/2017
	1 Sample(s) Required between 11/1/2017 and 11/30/2017
	1 Sample(s) Required between 12/1/2017 and 12/31/2017

**Where to Collect Samples For a Small Public Water System**

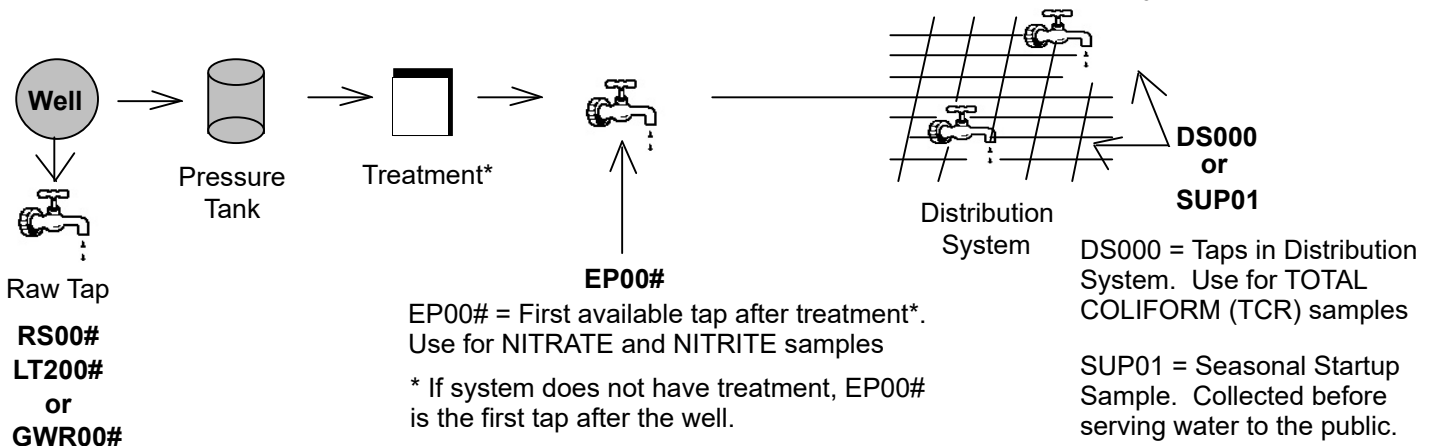

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH3033912 THE SHACK**

System Type: Transient Noncommunity

Operating Period: 4/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 3054727 Facility Name: SUGARSHACK**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

**Where to Collect Samples For a Small Public Water System**

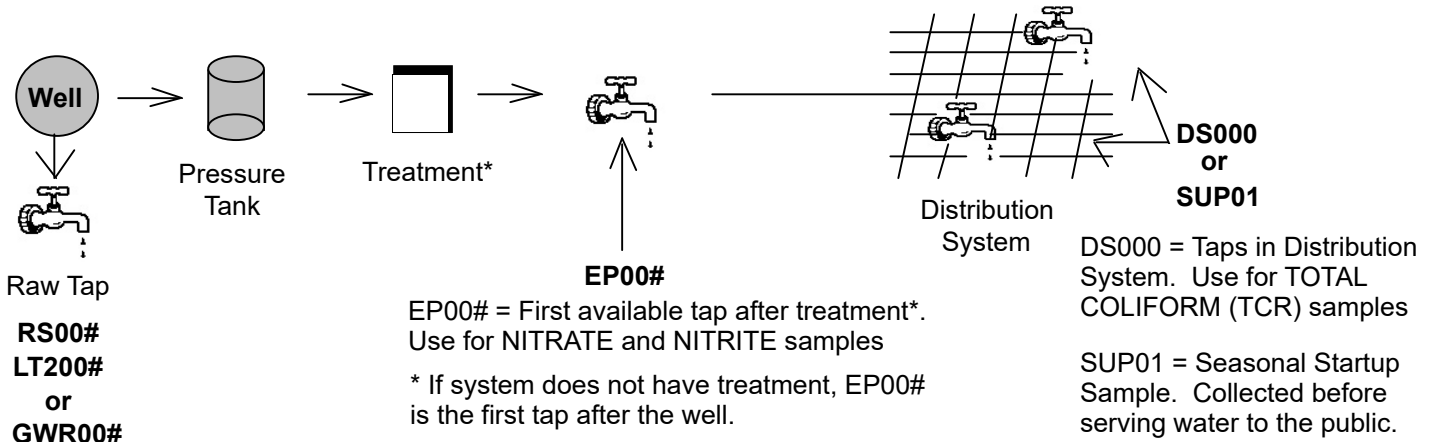

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3034212 I70 FUEL MART 727**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> I70 FUEL MART 727 DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

**Where to Collect Samples For a Small Public Water System**

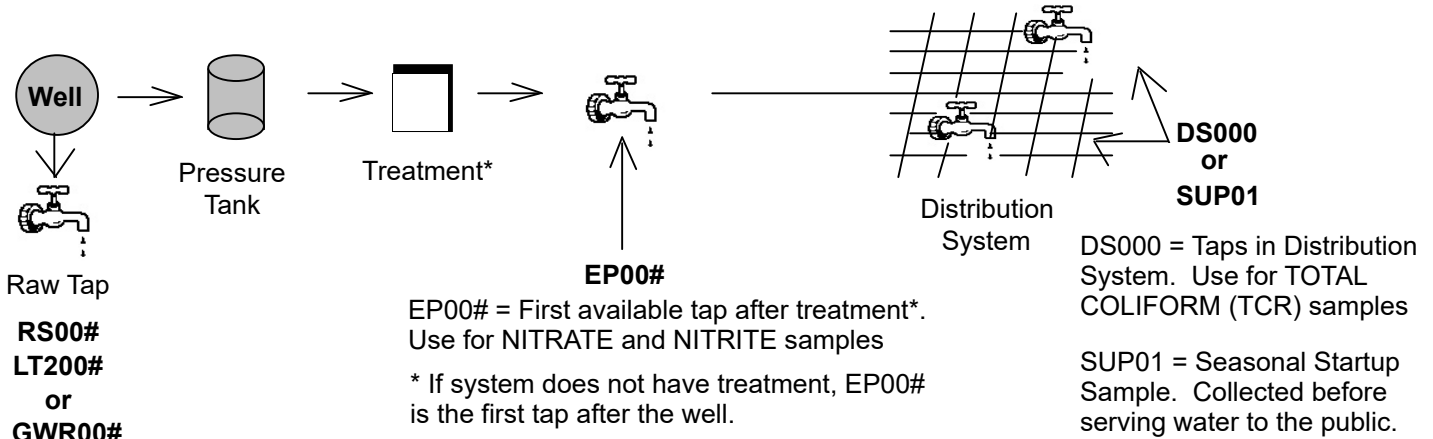

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3034212 I70 FUEL MART 727**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 3054728 Facility Name: PORTS PETROLEUM CO INC GAS MART NO 727**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

**Where to Collect Samples For a Small Public Water System**

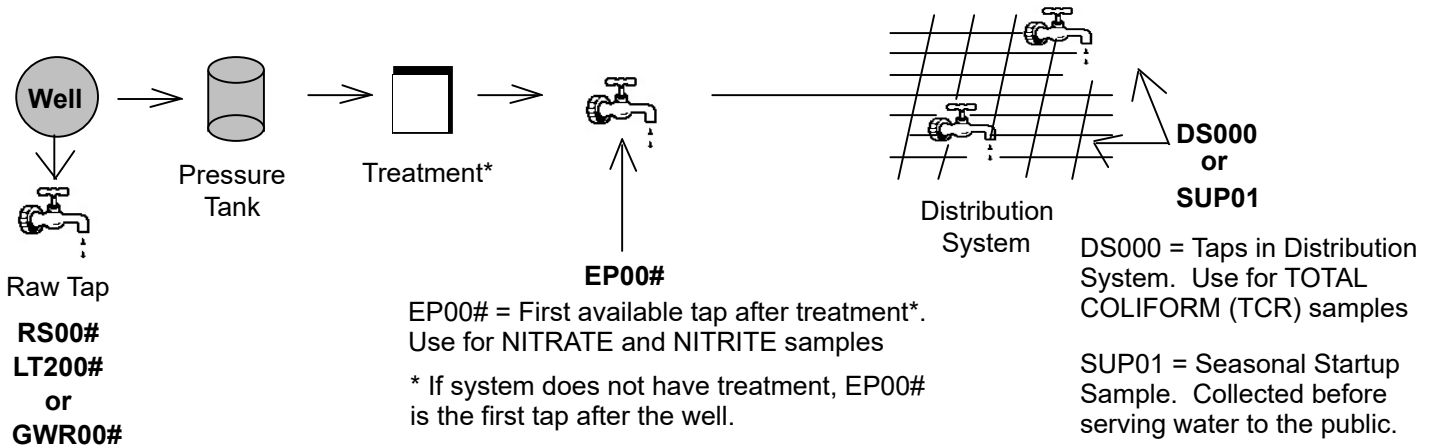

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3034312 SPRING VALLEY OUTDOORS, INC**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **SPRING VALLEY CAMPGROUND DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

**Where to Collect Samples For a Small Public Water System**

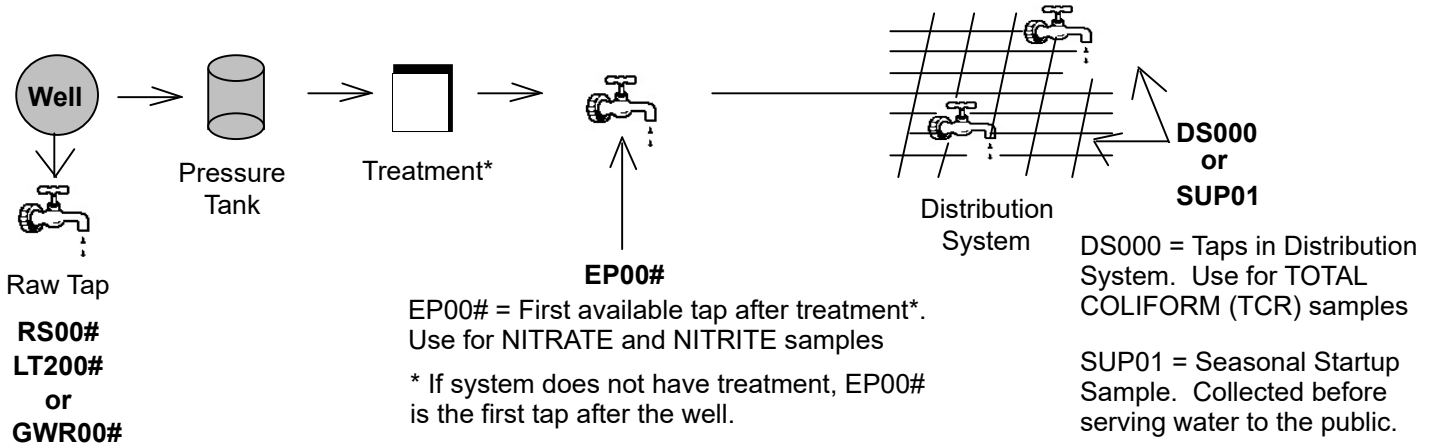

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3034312 SPRING VALLEY OUTDOORS, INC**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 3054729 Facility Name: SPRING VALLEY CAMPGROUND**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3053012 SALT FORK UTILITY CO.**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> SALT FORK UTILITY CO. DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water
	<b>Facility Class:</b> CLASS 1

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2017 and 1/31/2017
	2 Sample(s) Required between 2/1/2017 and 2/28/2017
	2 Sample(s) Required between 3/1/2017 and 3/31/2017
	2 Sample(s) Required between 4/1/2017 and 4/30/2017
	2 Sample(s) Required between 5/1/2017 and 5/31/2017
	2 Sample(s) Required between 6/1/2017 and 6/30/2017
	2 Sample(s) Required between 7/1/2017 and 7/31/2017
	2 Sample(s) Required between 8/1/2017 and 8/31/2017
	2 Sample(s) Required between 9/1/2017 and 9/30/2017
	2 Sample(s) Required between 10/1/2017 and 10/31/2017
	2 Sample(s) Required between 11/1/2017 and 11/30/2017
	2 Sample(s) Required between 12/1/2017 and 12/31/2017

**Where to Collect Samples For a Small Public Water System**

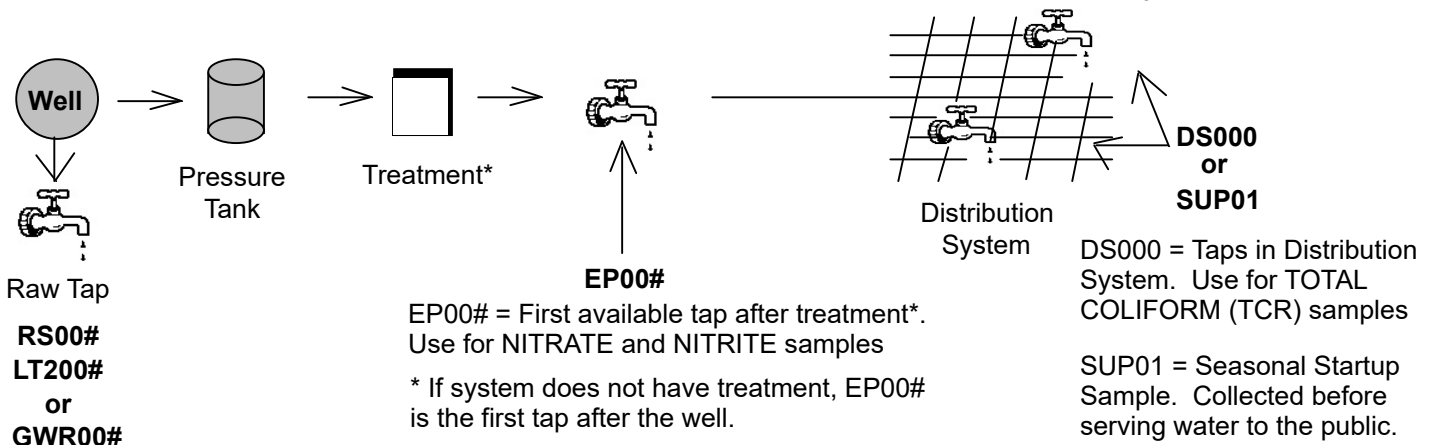

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3053012 SALT FORK UTILITY CO.**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 3054731	<b>Facility Name:</b> SALT FORK UTILITY CO
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water
<b>Facility Class:</b> CLASS 1	

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

**Where to Collect Samples For a Small Public Water System**

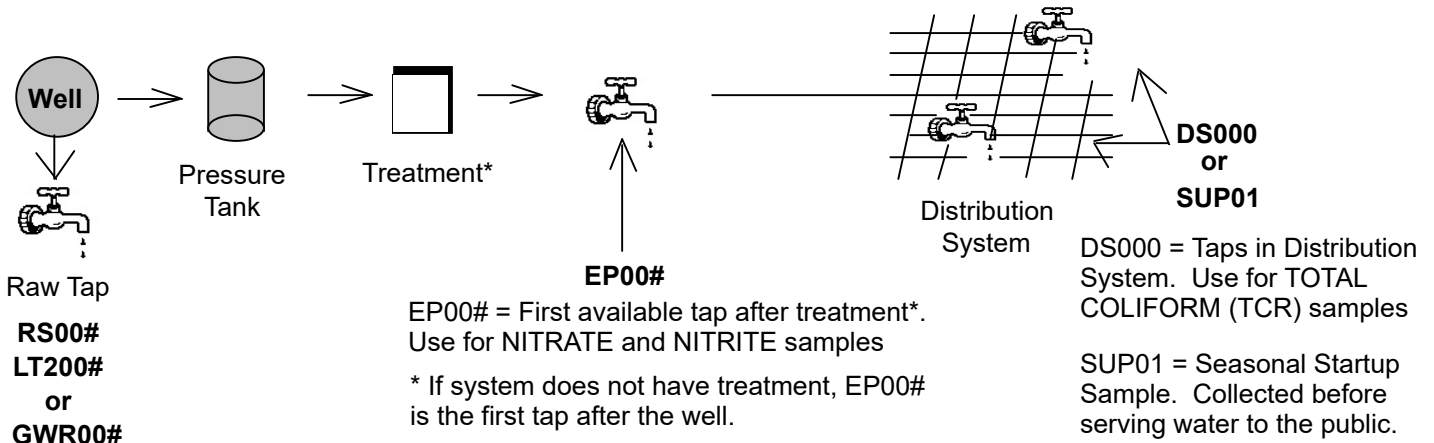

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3053312 GENIE MANAGEMENT, LLC PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1 Facility Name: B P FOOD MART DISTRIBUTION**  
**Location SMP ID: DS000 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017 1 Sample(s) Required between 4/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 9/30/2017 1 Sample(s) Required between 10/1/2017 and 12/31/2017

**Where to Collect Samples For a Small Public Water System**

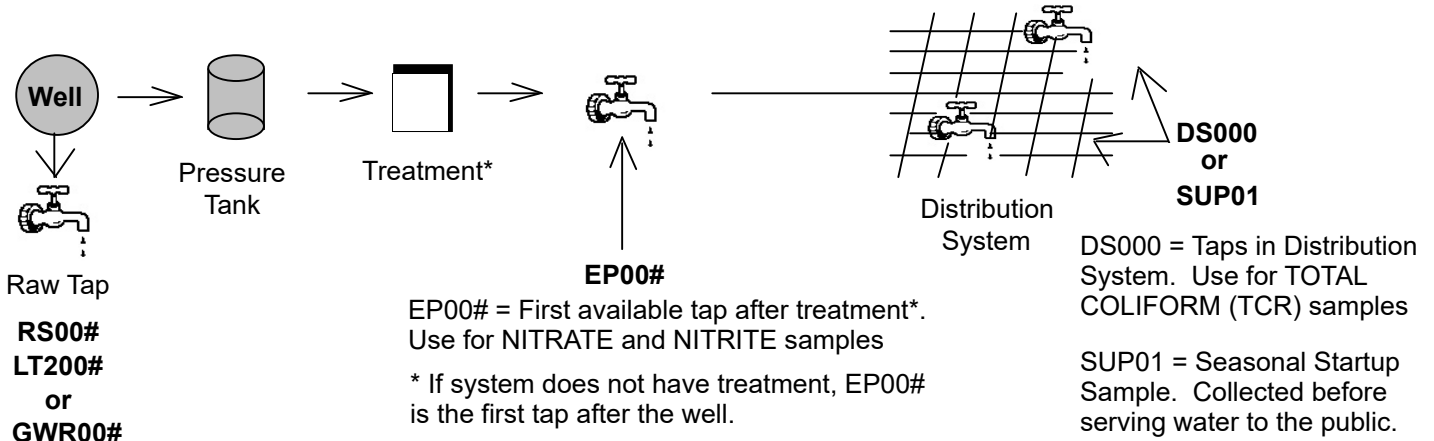

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH3053312 GENIE MANAGEMENT, LLC PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: 3054732 Facility Name: GENIE MANAGEMENT LLC  
**Location** SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3053912 GARYS BP PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **GARYS BP DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

**Where to Collect Samples For a Small Public Water System**

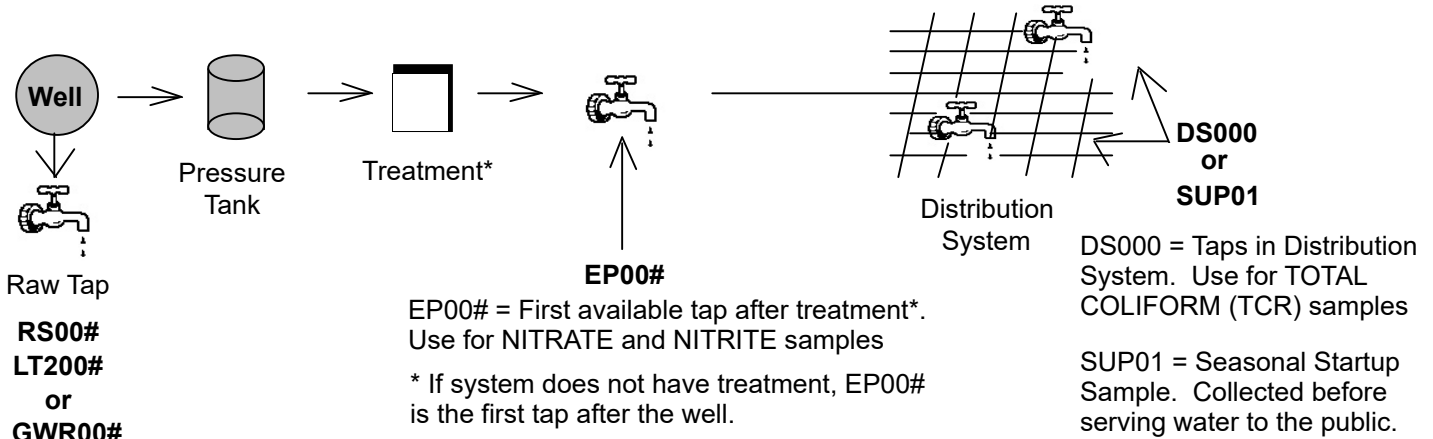

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3053912 GARYS BP PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 3054736 Facility Name: GARYS BP**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

**Where to Collect Samples For a Small Public Water System**

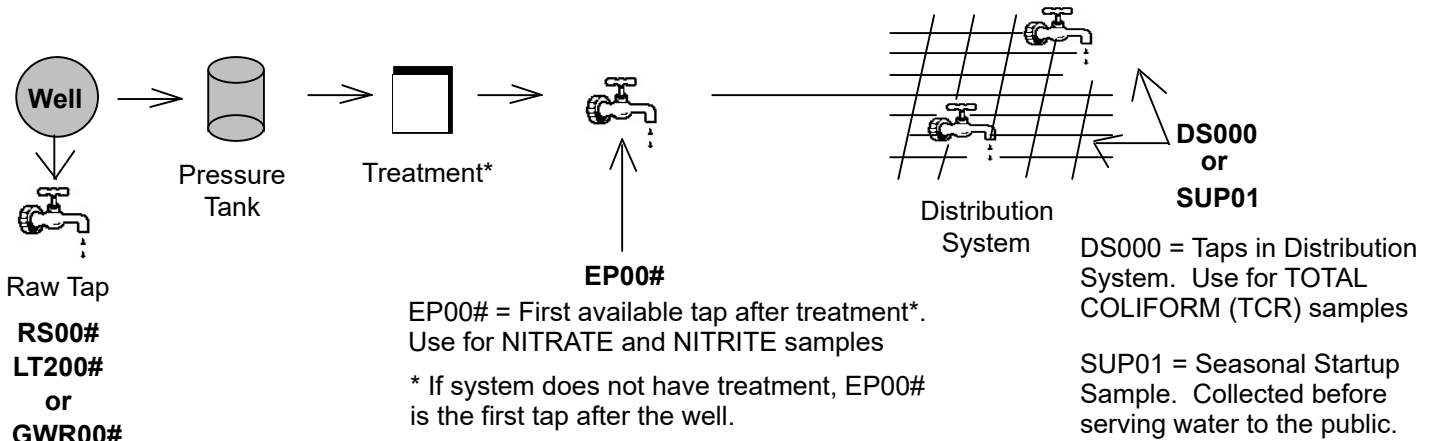

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3054212 BIG SKY CAMPGROUND**

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1 Facility Name: BIG SKY CAMPGROUND DISTRIBUTION**  
**Location SMP ID: SUP01 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**

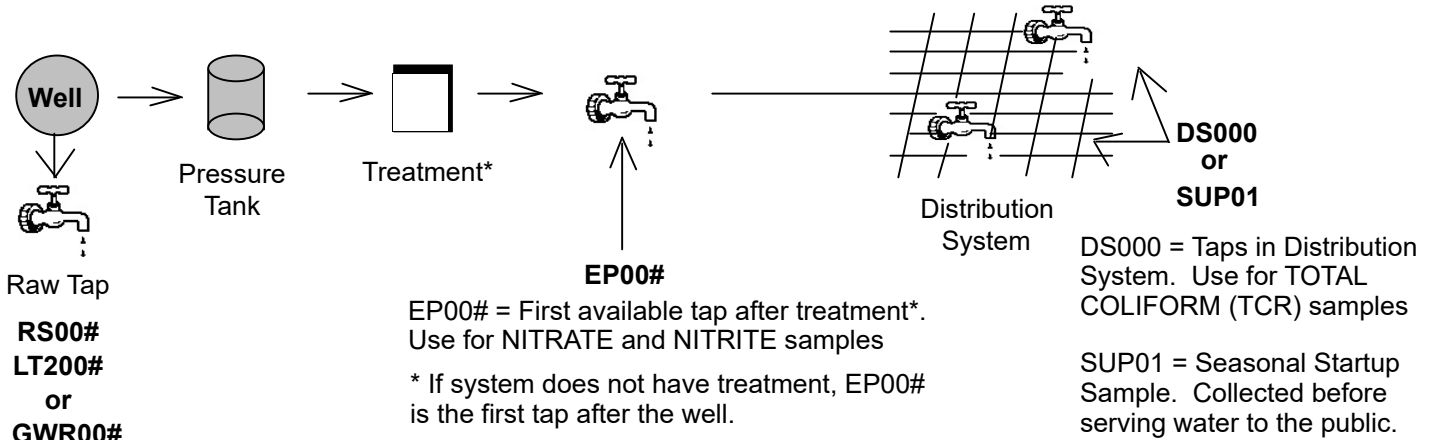

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3054212 BIG SKY CAMPGROUND**

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1 Facility Name: BIG SKY CAMPGROUND DISTRIBUTION**  
**Location SMP ID: DS000 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 9/30/2017

**Where to Collect Samples For a Small Public Water System**

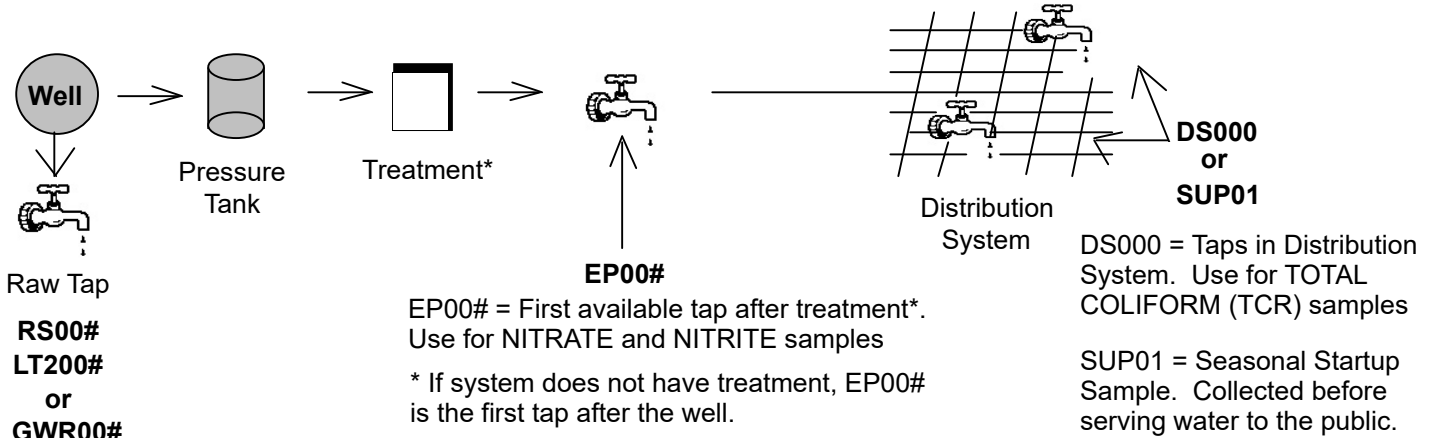

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3054212 BIG SKY CAMPGROUND**

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 3054739 Facility Name: BIG SKY CAMPGROUND**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

**Where to Collect Samples For a Small Public Water System**

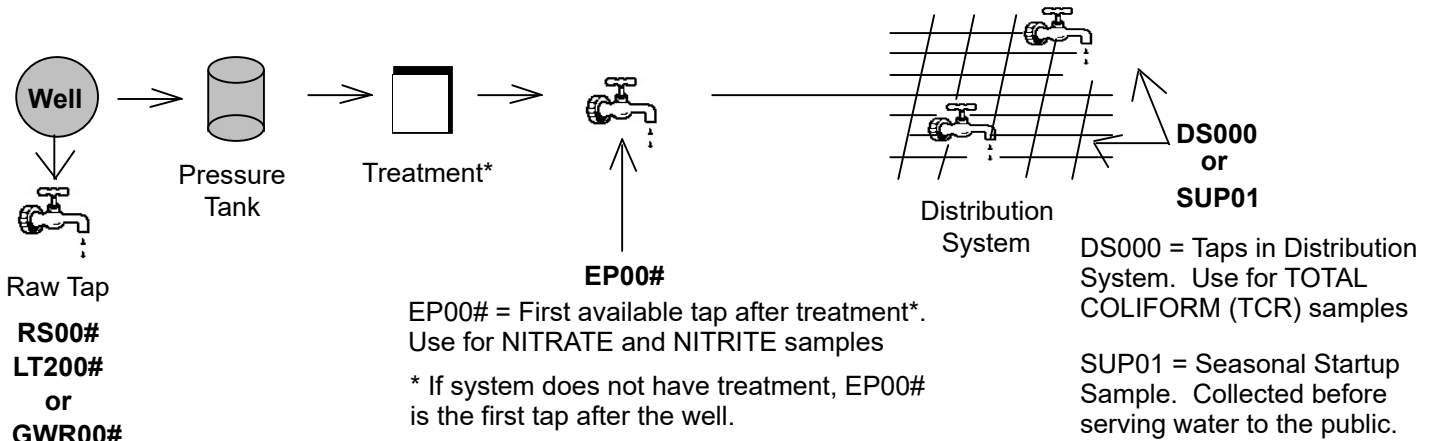

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3054312 JACKIES FAMILY RESTAURANT**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> JACKIES FAMILY RESTAURANT DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

**Where to Collect Samples For a Small Public Water System**

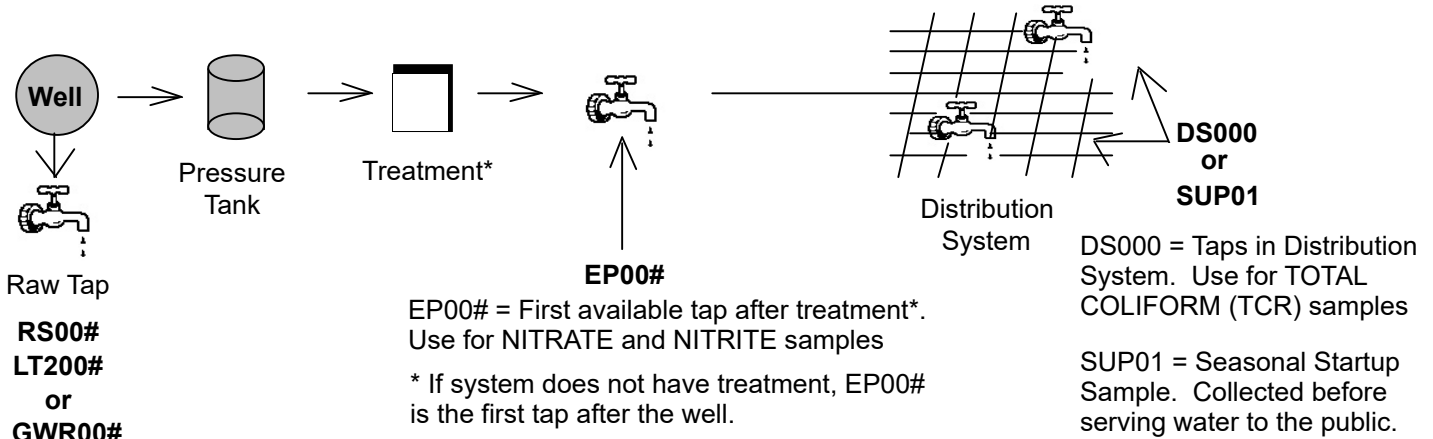

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3054312 JACKIES FAMILY RESTAURANT**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 3054740 Facility Name: JACKIES FAMILY RESTAURANT**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 3/31/2017 1 Sample(s) Required between 4/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 9/30/2017 1 Sample(s) Required between 10/1/2017 and 12/31/2017

**Where to Collect Samples For a Small Public Water System**

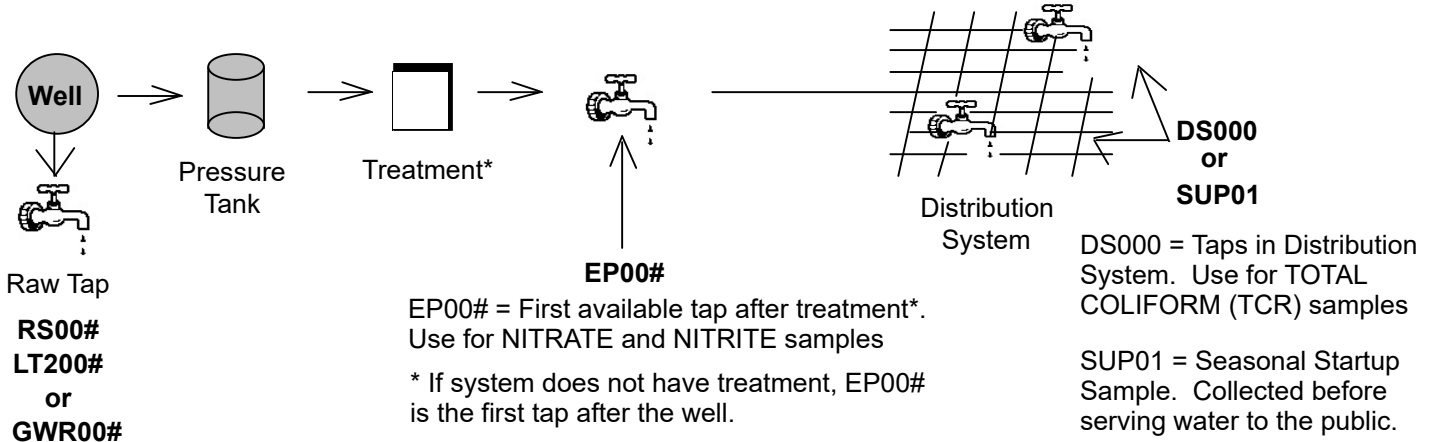

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH3054512 GEORGETOWN WINERY PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: 3062156 Facility Name: GEORGETOWN WINERY  
**Location** SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2017 and 5/31/2017

**Where to Collect Samples For a Small Public Water System**

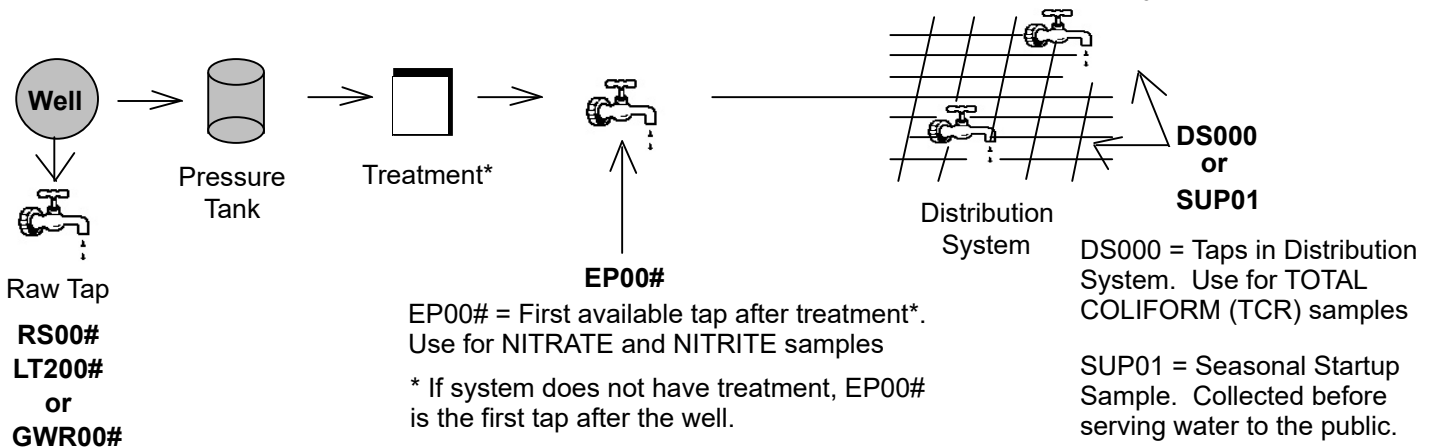

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**