



Effective Date: 01/01/2017

2017 ENTRY POINT SCHEDULE

**OH5800112 CHESTERHILL VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>5856720</b>	Facility Name: <b>CHESTERHILL VILLAGE</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 6/1/2017 and 10/31/2017
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH5800112 CHESTERHILL VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>CHESTERHILL, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2017 and 9/30/2017

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Form 5105 with appendix must be submitted to Ohio EPA within ten days from the end of the month(s) in which samples are collected. Forms are available online at: http://epa.ohio.gov/ddagw/reporting.aspx. For questions contact your Ohio EPA District Office representative.

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between 1/1/2017 and 1/31/2017

1 Sample(s) Required between 2/1/2017 and 2/28/2017

1 Sample(s) Required between 3/1/2017 and 3/31/2017

1 Sample(s) Required between 4/1/2017 and 4/30/2017

1 Sample(s) Required between 5/1/2017 and 5/31/2017

1 Sample(s) Required between 6/1/2017 and 6/30/2017

1 Sample(s) Required between 7/1/2017 and 7/31/2017

1 Sample(s) Required between 8/1/2017 and 8/31/2017

1 Sample(s) Required between 9/1/2017 and 9/30/2017

1 Sample(s) Required between 10/1/2017 and 10/31/2017

1 Sample(s) Required between 11/1/2017 and 11/30/2017

1 Sample(s) Required between 12/1/2017 and 12/31/2017

TOTAL CHLORINE - 1000

1 Sample(s) Required between 1/1/2017 and 1/31/2017

1 Sample(s) Required between 2/1/2017 and 2/28/2017

1 Sample(s) Required between 3/1/2017 and 3/31/2017

1 Sample(s) Required between 4/1/2017 and 4/30/2017

1 Sample(s) Required between 5/1/2017 and 5/31/2017

1 Sample(s) Required between 6/1/2017 and 6/30/2017

1 Sample(s) Required between 7/1/2017 and 7/31/2017

1 Sample(s) Required between 8/1/2017 and 8/31/2017

1 Sample(s) Required between 9/1/2017 and 9/30/2017

1 Sample(s) Required between 10/1/2017 and 10/31/2017

1 Sample(s) Required between 11/1/2017 and 11/30/2017

1 Sample(s) Required between 12/1/2017 and 12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.



**OH5800112 CHESTERHILL VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>CHESTERHILL, VILLAGE OF DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>CHESTERHILL, VILLAGE OF DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

**OH5800212 RIVERS EDGE OF MALTA**

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **RIVERS EDGE OF MALTA DISTRIBUTION**  
**Location** SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5800212 RIVERS EDGE OF MALTA**

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1 Facility Name: RIVERS EDGE OF MALTA DISTRIBUTION**

**Location SMP ID: DS000 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 9/30/2017

**Where to Collect Samples For a Small Public Water System**

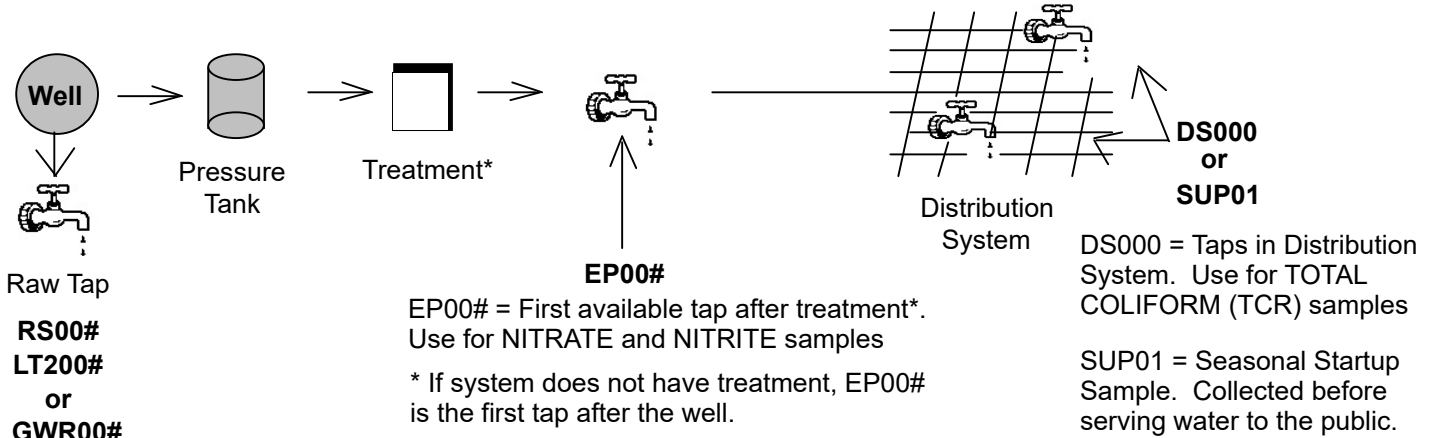

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5800212 RIVERS EDGE OF MALTA**

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5856721 Facility Name: RIVERS EDGE OF MALTA**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



Effective Date: 01/01/2017

2017 ENTRY POINT SCHEDULE

**OH5800412 MALTA VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>5856722</b> SMP ID: <b>EP001</b>	Facility Name: <b>MALTA WTP</b> Facility Source: <b>Ground Water</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 6/1/2017 and 10/31/2017
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2017 and 10/31/2017



OH5800412 MALTA VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>MALTA, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between 1/1/2017 and 1/31/2017

1 Sample(s) Required between 2/1/2017 and 2/28/2017

1 Sample(s) Required between 3/1/2017 and 3/31/2017

1 Sample(s) Required between 4/1/2017 and 4/30/2017

1 Sample(s) Required between 5/1/2017 and 5/31/2017

1 Sample(s) Required between 6/1/2017 and 6/30/2017

1 Sample(s) Required between 7/1/2017 and 7/31/2017

1 Sample(s) Required between 8/1/2017 and 8/31/2017

1 Sample(s) Required between 9/1/2017 and 9/30/2017

1 Sample(s) Required between 10/1/2017 and 10/31/2017

1 Sample(s) Required between 11/1/2017 and 11/30/2017

1 Sample(s) Required between 12/1/2017 and 12/31/2017

TOTAL CHLORINE - 1000

1 Sample(s) Required between 1/1/2017 and 1/31/2017

1 Sample(s) Required between 2/1/2017 and 2/28/2017

1 Sample(s) Required between 3/1/2017 and 3/31/2017

1 Sample(s) Required between 4/1/2017 and 4/30/2017

1 Sample(s) Required between 5/1/2017 and 5/31/2017

1 Sample(s) Required between 6/1/2017 and 6/30/2017

1 Sample(s) Required between 7/1/2017 and 7/31/2017

1 Sample(s) Required between 8/1/2017 and 8/31/2017

1 Sample(s) Required between 9/1/2017 and 9/30/2017

1 Sample(s) Required between 10/1/2017 and 10/31/2017

1 Sample(s) Required between 11/1/2017 and 11/30/2017

1 Sample(s) Required between 12/1/2017 and 12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>MALTA, VILLAGE OF DISTRIBUTION</b> <b>149 SOUTH MAIN STREET</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950





Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

**OH5800412 MALTA VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>MALTA, VILLAGE OF DISTRIBUTION</b> <b>260 FRONT STREET</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH5800512 MCCONNELSVILLE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>MCCONNELSVILLE, VILLAGE DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

TOTAL COLIFORM (TCR) - 3100

2 Sample(s) Required between	1/1/2017	and	1/31/2017
2 Sample(s) Required between	2/1/2017	and	2/28/2017
2 Sample(s) Required between	3/1/2017	and	3/31/2017
2 Sample(s) Required between	4/1/2017	and	4/30/2017
2 Sample(s) Required between	5/1/2017	and	5/31/2017
2 Sample(s) Required between	6/1/2017	and	6/30/2017
2 Sample(s) Required between	7/1/2017	and	7/31/2017
2 Sample(s) Required between	8/1/2017	and	8/31/2017
2 Sample(s) Required between	9/1/2017	and	9/30/2017
2 Sample(s) Required between	10/1/2017	and	10/31/2017
2 Sample(s) Required between	11/1/2017	and	11/30/2017
2 Sample(s) Required between	12/1/2017	and	12/31/2017

TOTAL CHLORINE - 1000

2 Sample(s) Required between	1/1/2017	and	1/31/2017
2 Sample(s) Required between	2/1/2017	and	2/28/2017
2 Sample(s) Required between	3/1/2017	and	3/31/2017
2 Sample(s) Required between	4/1/2017	and	4/30/2017
2 Sample(s) Required between	5/1/2017	and	5/31/2017
2 Sample(s) Required between	6/1/2017	and	6/30/2017
2 Sample(s) Required between	7/1/2017	and	7/31/2017
2 Sample(s) Required between	8/1/2017	and	8/31/2017
2 Sample(s) Required between	9/1/2017	and	9/30/2017
2 Sample(s) Required between	10/1/2017	and	10/31/2017
2 Sample(s) Required between	11/1/2017	and	11/30/2017
2 Sample(s) Required between	12/1/2017	and	12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>MCCONNELSVILLE, VILLAGE DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
- 2) TTHM - 2950



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

**OH5800512 MCCONNELSVILLE VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>MCCONNELSVILLE, VILLAGE DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>DS202</b>	<b>ADDRESS NOT KNOWN</b>	

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2017

2017 ENTRY POINT SCHEDULE

OH5800712 WOODLAND HILLS ESTATES II

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>5856724</b>	Facility Name: <b>WOODLAND HILLS ESTATES</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 6/1/2017 and 10/31/2017
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



**OH5800712 WOODLAND HILLS ESTATES II**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017**

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Location** Facility ID: **DS1** Facility Name: **WOODLAND HILLS ESTATES DISTRIBUTION**  
SMP ID: **DS000**

**Chemicals**

**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022

Not Required

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between 1/1/2017 and 1/31/2017  
1 Sample(s) Required between 2/1/2017 and 2/28/2017  
1 Sample(s) Required between 3/1/2017 and 3/31/2017  
1 Sample(s) Required between 4/1/2017 and 4/30/2017  
1 Sample(s) Required between 5/1/2017 and 5/31/2017  
1 Sample(s) Required between 6/1/2017 and 6/30/2017  
1 Sample(s) Required between 7/1/2017 and 7/31/2017  
1 Sample(s) Required between 8/1/2017 and 8/31/2017  
1 Sample(s) Required between 9/1/2017 and 9/30/2017  
1 Sample(s) Required between 10/1/2017 and 10/31/2017  
1 Sample(s) Required between 11/1/2017 and 11/30/2017  
1 Sample(s) Required between 12/1/2017 and 12/31/2017

TOTAL CHLORINE - 1000

1 Sample(s) Required between 1/1/2017 and 1/31/2017  
1 Sample(s) Required between 2/1/2017 and 2/28/2017  
1 Sample(s) Required between 3/1/2017 and 3/31/2017  
1 Sample(s) Required between 4/1/2017 and 4/30/2017  
1 Sample(s) Required between 5/1/2017 and 5/31/2017  
1 Sample(s) Required between 6/1/2017 and 6/30/2017  
1 Sample(s) Required between 7/1/2017 and 7/31/2017  
1 Sample(s) Required between 8/1/2017 and 8/31/2017  
1 Sample(s) Required between 9/1/2017 and 9/30/2017  
1 Sample(s) Required between 10/1/2017 and 10/31/2017  
1 Sample(s) Required between 11/1/2017 and 11/30/2017  
1 Sample(s) Required between 12/1/2017 and 12/31/2017

*Samples should be collected at the same time and place as the Total Coliform samples.*

**Sampling Location** Facility ID: **DS1** Facility Name: **WOODLAND HILLS ESTATES DISTRIBUTION**  
SMP ID: **DS201** ADDRESS NOT KNOWN

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2017

2017 ENTRY POINT SCHEDULE

**OH5800912 STOCKPORT VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>5856725</b> SMP ID: <b>EP001</b>	Facility Name: <b>STOCKPORT VILLAGE</b> Facility Source: <b>Ground Water</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 6/1/2017 and 10/31/2017
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH5800912 STOCKPORT VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>STOCKPORT, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between 1/1/2017 and 1/31/2017

1 Sample(s) Required between 2/1/2017 and 2/28/2017

1 Sample(s) Required between 3/1/2017 and 3/31/2017

1 Sample(s) Required between 4/1/2017 and 4/30/2017

1 Sample(s) Required between 5/1/2017 and 5/31/2017

1 Sample(s) Required between 6/1/2017 and 6/30/2017

1 Sample(s) Required between 7/1/2017 and 7/31/2017

1 Sample(s) Required between 8/1/2017 and 8/31/2017

1 Sample(s) Required between 9/1/2017 and 9/30/2017

1 Sample(s) Required between 10/1/2017 and 10/31/2017

1 Sample(s) Required between 11/1/2017 and 11/30/2017

1 Sample(s) Required between 12/1/2017 and 12/31/2017

TOTAL CHLORINE - 1000

1 Sample(s) Required between 1/1/2017 and 1/31/2017

1 Sample(s) Required between 2/1/2017 and 2/28/2017

1 Sample(s) Required between 3/1/2017 and 3/31/2017

1 Sample(s) Required between 4/1/2017 and 4/30/2017

1 Sample(s) Required between 5/1/2017 and 5/31/2017

1 Sample(s) Required between 6/1/2017 and 6/30/2017

1 Sample(s) Required between 7/1/2017 and 7/31/2017

1 Sample(s) Required between 8/1/2017 and 8/31/2017

1 Sample(s) Required between 9/1/2017 and 9/30/2017

1 Sample(s) Required between 10/1/2017 and 10/31/2017

1 Sample(s) Required between 11/1/2017 and 11/30/2017

1 Sample(s) Required between 12/1/2017 and 12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>STOCKPORT, VILLAGE OF DISTRIBUTION</b> <b>2771 SOUTH RIVERVIEW RD.</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

**OH5800912 STOCKPORT VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>STOCKPORT, VILLAGE OF DISTRIBUTION</b> <b>1850 ROSEWOOD STREET</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950





OH5801003 MORGAN MEIGSVILLE RURAL

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: DS1 SMP ID: DS000 Facility Name: MORGAN MEIGSVILLE RURAL DISTRIBUTION Facility Class: CLASS 1

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

TOTAL COLIFORM (TCR) - 3100 1 Sample(s) Required between 1/1/2017 and 1/31/2017
1 Sample(s) Required between 2/1/2017 and 2/28/2017
1 Sample(s) Required between 3/1/2017 and 3/31/2017
1 Sample(s) Required between 4/1/2017 and 4/30/2017
1 Sample(s) Required between 5/1/2017 and 5/31/2017
1 Sample(s) Required between 6/1/2017 and 6/30/2017
1 Sample(s) Required between 7/1/2017 and 7/31/2017
1 Sample(s) Required between 8/1/2017 and 8/31/2017
1 Sample(s) Required between 9/1/2017 and 9/30/2017
1 Sample(s) Required between 10/1/2017 and 10/31/2017
1 Sample(s) Required between 11/1/2017 and 11/30/2017
1 Sample(s) Required between 12/1/2017 and 12/31/2017

TOTAL CHLORINE - 1000 1 Sample(s) Required between 1/1/2017 and 1/31/2017
1 Sample(s) Required between 2/1/2017 and 2/28/2017
1 Sample(s) Required between 3/1/2017 and 3/31/2017
1 Sample(s) Required between 4/1/2017 and 4/30/2017
1 Sample(s) Required between 5/1/2017 and 5/31/2017
1 Sample(s) Required between 6/1/2017 and 6/30/2017
1 Sample(s) Required between 7/1/2017 and 7/31/2017
1 Sample(s) Required between 8/1/2017 and 8/31/2017
1 Sample(s) Required between 9/1/2017 and 9/30/2017
1 Sample(s) Required between 10/1/2017 and 10/31/2017
1 Sample(s) Required between 11/1/2017 and 11/30/2017
1 Sample(s) Required between 12/1/2017 and 12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: DS1 SMP ID: DS201 Facility Name: MORGAN MEIGSVILLE RURAL DISTRIBUTION Facility Class: CLASS 1 ADDRESS NOT KNOWN

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

**OH5801003 MORGAN MEIGSVILLE RURAL**

System Type: Community

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>MORGAN MEIGSVILLE RURAL DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>DS202</b>	<b>ADDRESS NOT KNOWN</b>	

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH5801103 MORGAN MEIGSVILLE - WEST MALTA PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>MORGAN MEIGSVILLE - WEST MALTA DIST</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between	1/1/2017	and	1/31/2017
1 Sample(s) Required between	2/1/2017	and	2/28/2017
1 Sample(s) Required between	3/1/2017	and	3/31/2017
1 Sample(s) Required between	4/1/2017	and	4/30/2017
1 Sample(s) Required between	5/1/2017	and	5/31/2017
1 Sample(s) Required between	6/1/2017	and	6/30/2017
1 Sample(s) Required between	7/1/2017	and	7/31/2017
1 Sample(s) Required between	8/1/2017	and	8/31/2017
1 Sample(s) Required between	9/1/2017	and	9/30/2017
1 Sample(s) Required between	10/1/2017	and	10/31/2017
1 Sample(s) Required between	11/1/2017	and	11/30/2017
1 Sample(s) Required between	12/1/2017	and	12/31/2017

TOTAL CHLORINE - 1000

1 Sample(s) Required between	1/1/2017	and	1/31/2017
1 Sample(s) Required between	2/1/2017	and	2/28/2017
1 Sample(s) Required between	3/1/2017	and	3/31/2017
1 Sample(s) Required between	4/1/2017	and	4/30/2017
1 Sample(s) Required between	5/1/2017	and	5/31/2017
1 Sample(s) Required between	6/1/2017	and	6/30/2017
1 Sample(s) Required between	7/1/2017	and	7/31/2017
1 Sample(s) Required between	8/1/2017	and	8/31/2017
1 Sample(s) Required between	9/1/2017	and	9/30/2017
1 Sample(s) Required between	10/1/2017	and	10/31/2017
1 Sample(s) Required between	11/1/2017	and	11/30/2017
1 Sample(s) Required between	12/1/2017	and	12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>MORGAN MEIGSVILLE - WEST MALTA DIST</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
- 2) TTHM - 2950



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

**OH5801103 MORGAN MEIGSVILLE - WEST MALTA PWS**

System Type: Community

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>MORGAN MEIGSVILLE - WEST MALTA DIST</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH5801203 MORGAN MEIGSVILLE - SR 376 PWS**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017**

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Location** Facility ID: **DS1** Facility Name: **MORGAN MEIGSVILLE - SR 376 DISTRIBUTION**  
SMP ID: **DS000**

**Chemicals**

**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022

Not Required

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between 1/1/2017 and 1/31/2017  
1 Sample(s) Required between 2/1/2017 and 2/28/2017  
1 Sample(s) Required between 3/1/2017 and 3/31/2017  
1 Sample(s) Required between 4/1/2017 and 4/30/2017  
1 Sample(s) Required between 5/1/2017 and 5/31/2017  
1 Sample(s) Required between 6/1/2017 and 6/30/2017  
1 Sample(s) Required between 7/1/2017 and 7/31/2017  
1 Sample(s) Required between 8/1/2017 and 8/31/2017  
1 Sample(s) Required between 9/1/2017 and 9/30/2017  
1 Sample(s) Required between 10/1/2017 and 10/31/2017  
1 Sample(s) Required between 11/1/2017 and 11/30/2017  
1 Sample(s) Required between 12/1/2017 and 12/31/2017

TOTAL CHLORINE - 1000

1 Sample(s) Required between 1/1/2017 and 1/31/2017  
1 Sample(s) Required between 2/1/2017 and 2/28/2017  
1 Sample(s) Required between 3/1/2017 and 3/31/2017  
1 Sample(s) Required between 4/1/2017 and 4/30/2017  
1 Sample(s) Required between 5/1/2017 and 5/31/2017  
1 Sample(s) Required between 6/1/2017 and 6/30/2017  
1 Sample(s) Required between 7/1/2017 and 7/31/2017  
1 Sample(s) Required between 8/1/2017 and 8/31/2017  
1 Sample(s) Required between 9/1/2017 and 9/30/2017  
1 Sample(s) Required between 10/1/2017 and 10/31/2017  
1 Sample(s) Required between 11/1/2017 and 11/30/2017  
1 Sample(s) Required between 12/1/2017 and 12/31/2017

*Samples should be collected at the same time and place as the Total Coliform samples.*

**Sampling Location** Facility ID: **DS1** Facility Name: **MORGAN MEIGSVILLE - SR 376 DISTRIBUTION**  
SMP ID: **DS201** ADDRESS NOT KNOWN

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2017 and 9/30/2017 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

**OH5830312 MOOSE LODGE**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1 Facility Name: MOOSE LODGE DISTRIBUTION**  
**Location SMP ID: DS000 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 1/31/2017
	1 Sample(s) Required between 2/1/2017 and 2/28/2017
	1 Sample(s) Required between 3/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 4/30/2017
	1 Sample(s) Required between 5/1/2017 and 5/31/2017
	1 Sample(s) Required between 6/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 7/31/2017
	1 Sample(s) Required between 8/1/2017 and 8/31/2017
	1 Sample(s) Required between 9/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 10/31/2017
	1 Sample(s) Required between 11/1/2017 and 11/30/2017
	1 Sample(s) Required between 12/1/2017 and 12/31/2017

**Where to Collect Samples For a Small Public Water System**

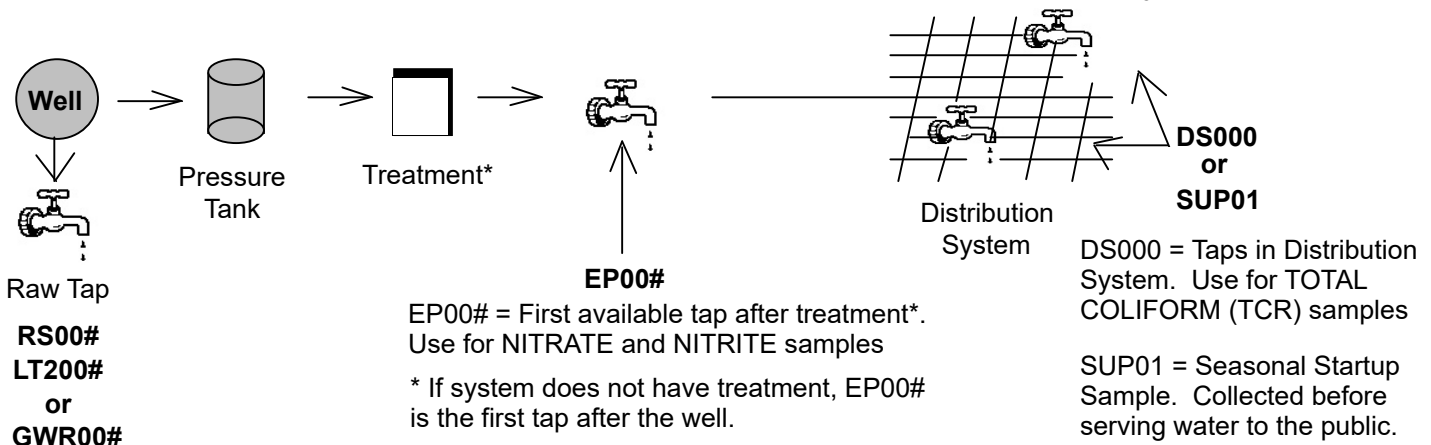

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5830312 MOOSE LODGE**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5856728 Facility Name: MOOSE LODGE**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



Effective Date: 01/01/2017

2017 ENTRY POINT SCHEDULE

OH5831112 MIBA BEARINGS US LLC

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>5856730</b>	Facility Name: <b>MIBA BEARINGS US LLC</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 6/1/2017 and 10/31/2017
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required





Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

**OH5831112 MIBA BEARINGS US LLC**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>MIBA BEARINGS US LLC DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals**

**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2017 and 9/30/2017
-------------------------------	---

*Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Form 5105 with appendix must be submitted to Ohio EPA within ten days from the end of the month(s) in which samples are collected. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>. For questions contact your Ohio EPA District Office representative.*

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

**OH5831212 OHIO POWER/HOOK LAKE-A1**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **OHIO POWER/HOOK LAKE-A1 DISTRIBUTION**  
**Location** SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5831212 OHIO POWER/HOOK LAKE-A1**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> OHIO POWER/HOOK LAKE-A1 DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 9/30/2017

**Where to Collect Samples For a Small Public Water System**

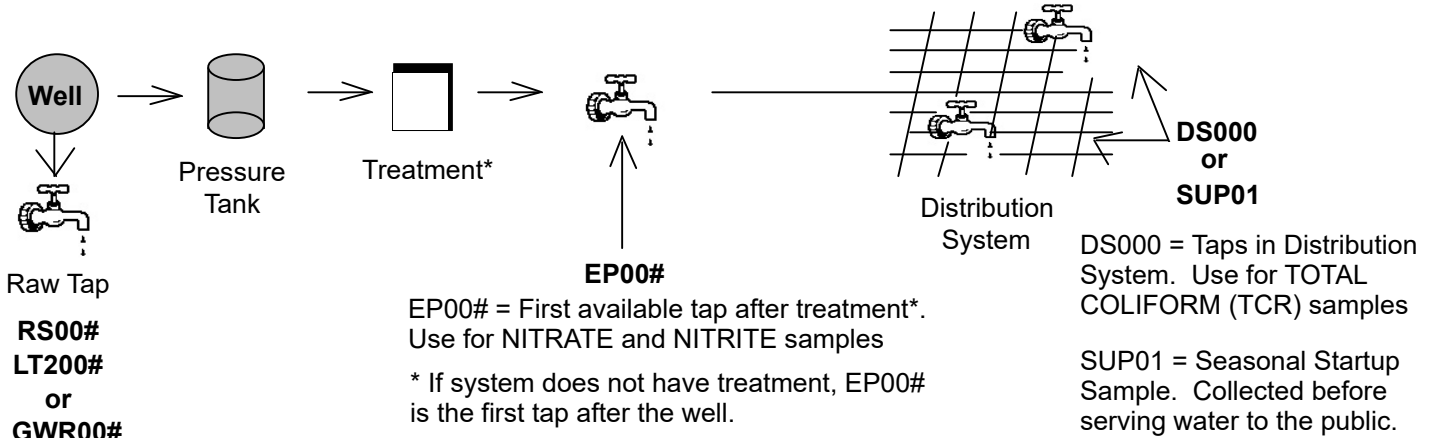

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5831212 OHIO POWER/HOOK LAKE-A1**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5856731 Facility Name: OHIO POWER HOOK LAKE A1**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5831312 OHIO POWER/HOOK LAKE-A3**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **OHIO POWER/HOOK LAKE-A3 DISTRIBUTION**  
**Location** SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5831312 OHIO POWER/HOOK LAKE-A3**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> OHIO POWER/HOOK LAKE-A3 DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 9/30/2017

**Where to Collect Samples For a Small Public Water System**

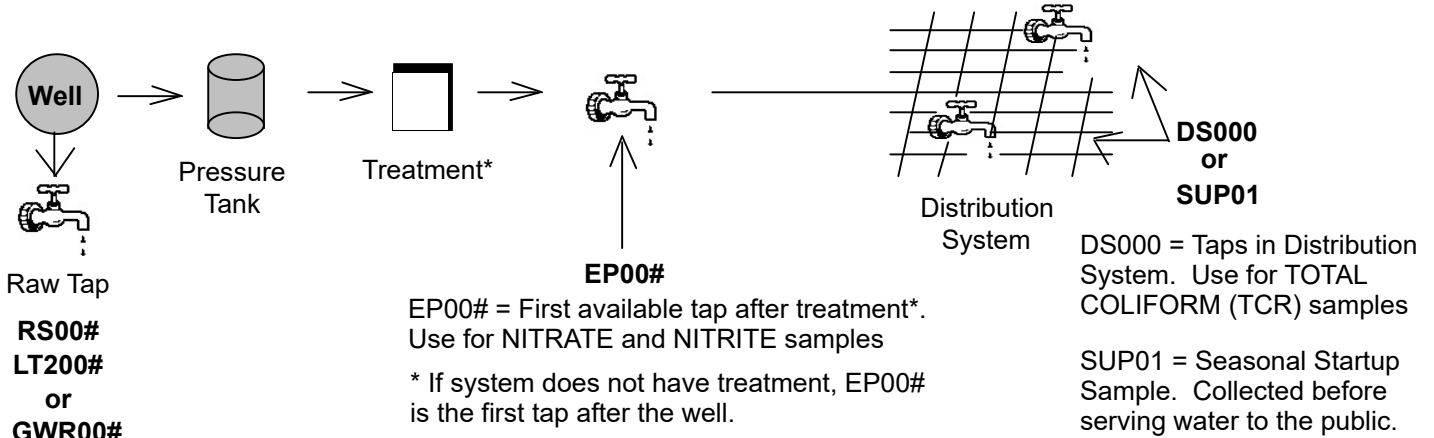

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5831312 OHIO POWER/HOOK LAKE-A3**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5856732 Facility Name: OHIO POWER HOOK LAKE A3**

**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017

**Where to Collect Samples For a Small Public Water System**

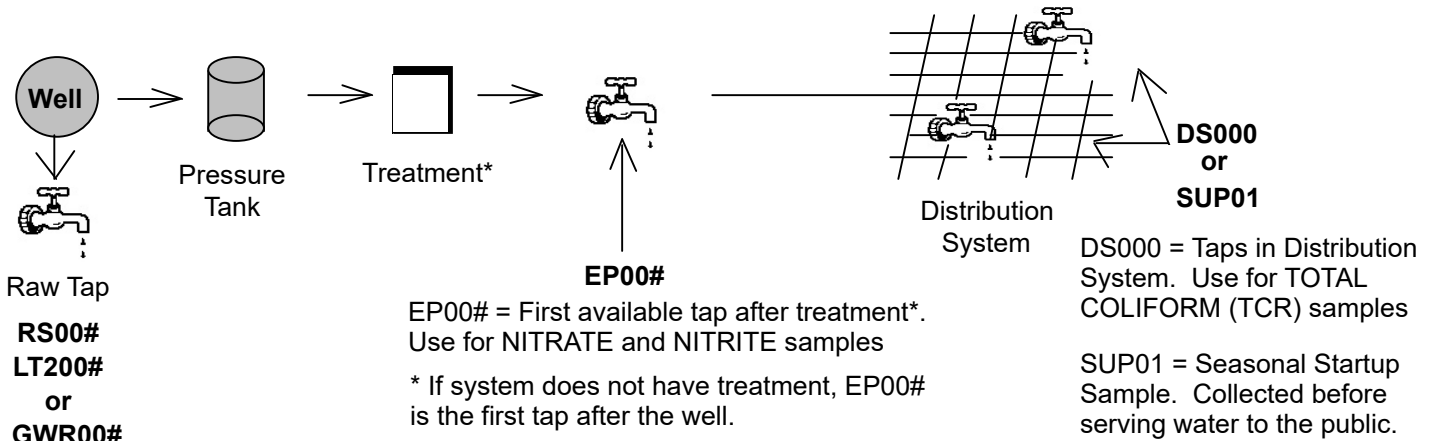

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5832912 OHIO POWER/SAND HOLLOW-C1**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> OHIO POWER/SAND HOLLOW-C DISTRIBUTION
<b>Location SMP ID:</b> SUP01	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**

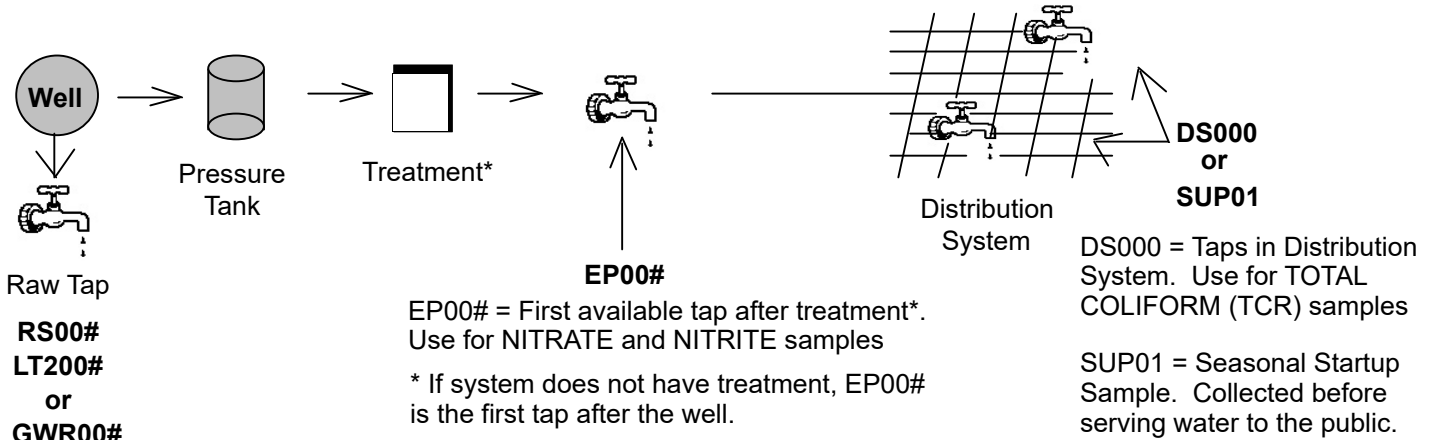

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH5832912 OHIO POWER/SAND HOLLOW-C1**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> OHIO POWER/SAND HOLLOW-C DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 9/30/2017

**Where to Collect Samples For a Small Public Water System**

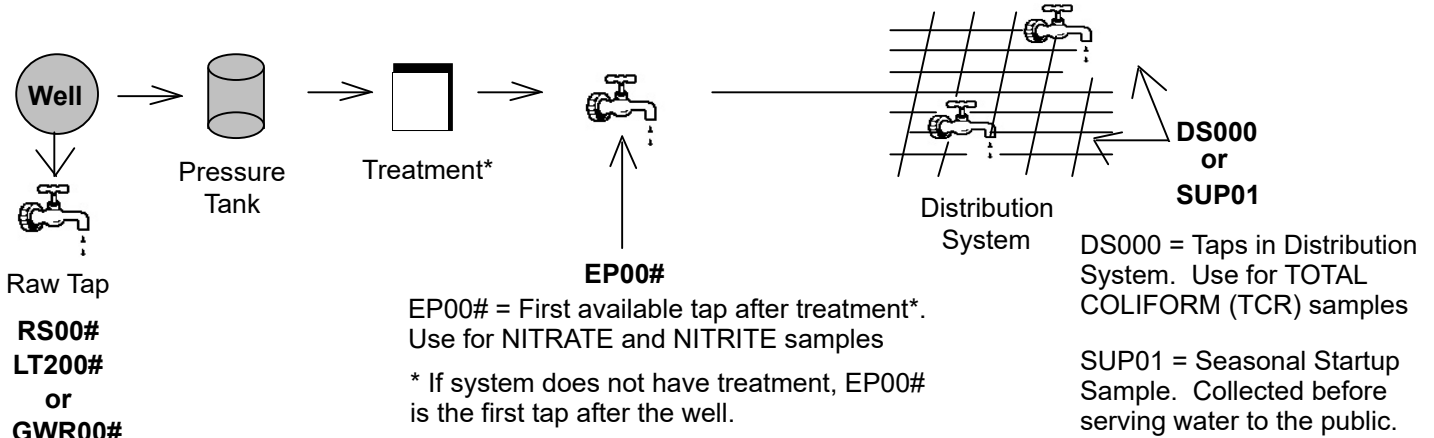

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5832912 OHIO POWER/SAND HOLLOW-C1**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5856740 Facility Name: OHIO POWER SAND HOLLOW C1**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017

**Where to Collect Samples For a Small Public Water System**

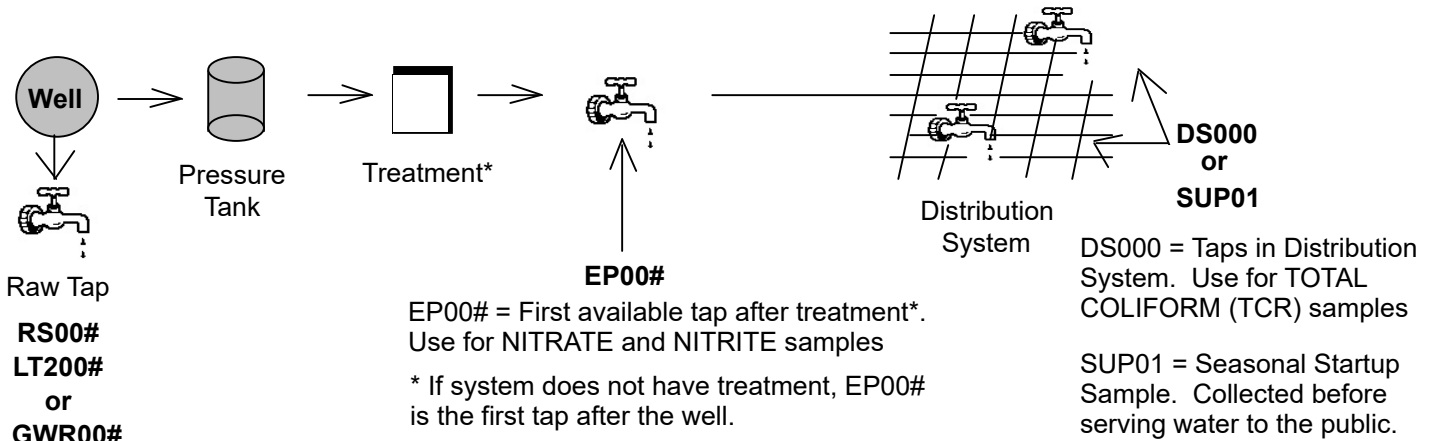

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5833112 OHIO POWER/SAND HOLLOW-C3**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **OHIO POWER/SAND HOLLOW-C DISTRIBUTION**  
**Location** SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**

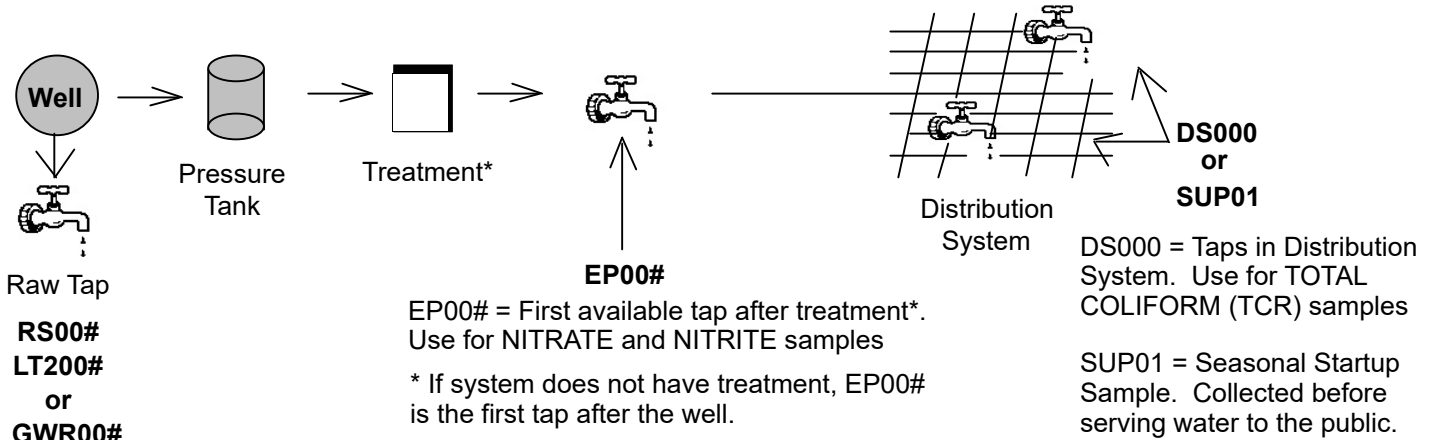

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5833112 OHIO POWER/SAND HOLLOW-C3**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1 Facility Name: OHIO POWER/SAND HOLLOW-C DISTRIBUTION**  
**Location SMP ID: DS000 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 9/30/2017

**Where to Collect Samples For a Small Public Water System**

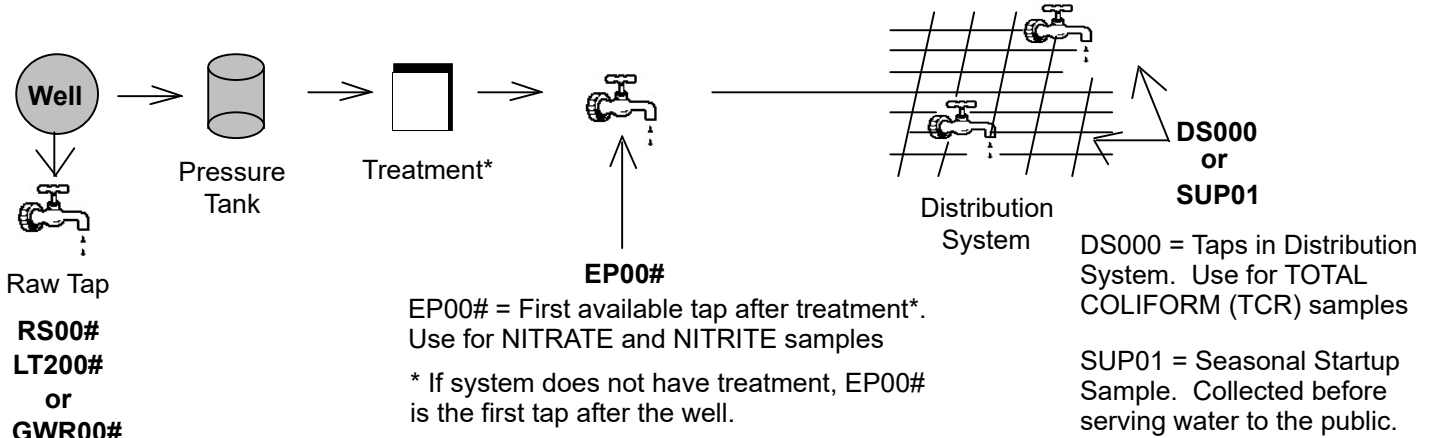

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5833112 OHIO POWER/SAND HOLLOW-C3**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5856742 Facility Name: OHIO POWER SAND HOLLOW C3**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5833312 OHIO POWER/SAWMILL-D1**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **OHIO POWER/SAWMILL-D1 DISTRIBUTION**  
**Location** SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5833312 OHIO POWER/SAWMILL-D1**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1 Facility Name: OHIO POWER/SAWMILL-D1 DISTRIBUTION**  
**Location SMP ID: DS000 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2017 and 4/30/2017
	1 Sample(s) Required between 5/1/2017 and 5/31/2017
	1 Sample(s) Required between 6/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 7/31/2017
	1 Sample(s) Required between 8/1/2017 and 8/31/2017
	1 Sample(s) Required between 9/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 10/31/2017
	1 Sample(s) Required between 11/1/2017 and 11/30/2017

**Where to Collect Samples For a Small Public Water System**

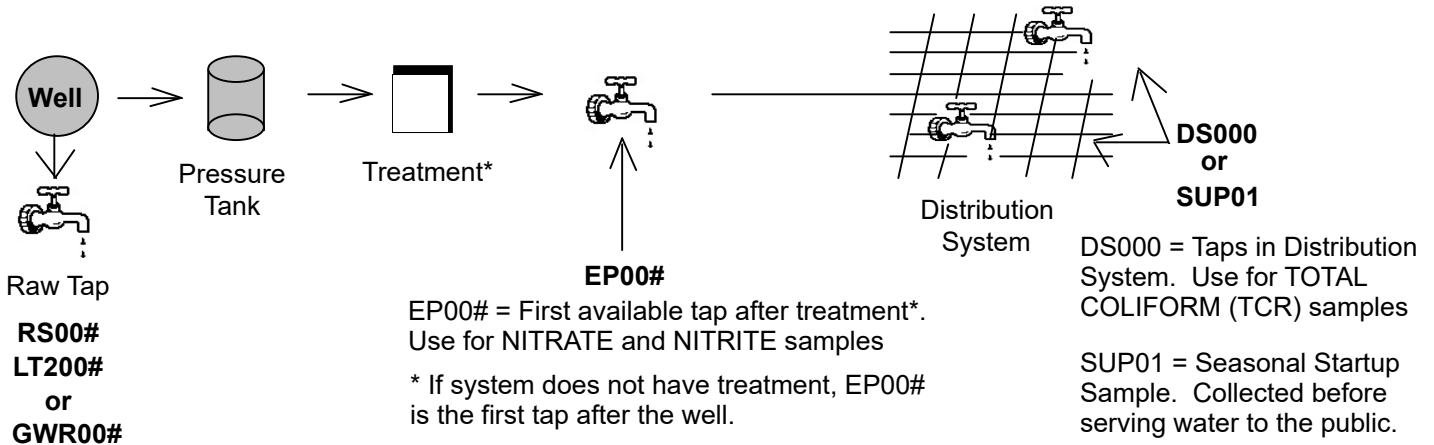

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5833312 OHIO POWER/SAWMILL-D1**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5856743 Facility Name: OHIO POWER SAWMILL D1**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 6/1/2017 and 10/31/2017
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**





Effective Date: 04/14/2017

2017 ENTRY POINT SCHEDULE

OH5833712 MALTA INDUSTRIAL PARK, LTD

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>5856746</b>	Facility Name: <b>MALTA INDUSTRIAL PARK, LTD</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 1/1/2017 and 5/31/2017

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020  
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 6/1/2017 and 10/31/2017

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 6/1/2017 and 10/31/2017

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2017 and 10/31/2017



Effective Date: 04/14/2017

2017 DISTRIBUTION SCHEDULE

**OH5833712 MALTA INDUSTRIAL PARK, LTD**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>MALTA INDUSTRIAL PARK, LTD DISTRIBUTION</b>
	SMP ID: <b>DS000</b>	

**Chemicals**

**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between	6/1/2017	and	9/30/2017
-------------------------------	------------------------------	----------	-----	-----------

*Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Form 5105 with appendix must be submitted to Ohio EPA within ten days from the end of the month(s) in which samples are collected. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>. For questions contact your Ohio EPA District Office representative.*

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	4/1/2017	and	4/30/2017
	1 Sample(s) Required between	5/1/2017	and	5/31/2017
	1 Sample(s) Required between	6/1/2017	and	6/30/2017
	1 Sample(s) Required between	7/1/2017	and	7/31/2017
	1 Sample(s) Required between	8/1/2017	and	8/31/2017
	1 Sample(s) Required between	9/1/2017	and	9/30/2017
	1 Sample(s) Required between	10/1/2017	and	10/31/2017
	1 Sample(s) Required between	11/1/2017	and	11/30/2017
	1 Sample(s) Required between	12/1/2017	and	12/31/2017

**OH5833812 OHIO POWER/WINDY HILL-E**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> OHIO POWER/WINDY HILL-E DISTRIBUTION
<b>Location SMP ID:</b> SUP01	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

### Where to Collect Samples For a Small Public Water System

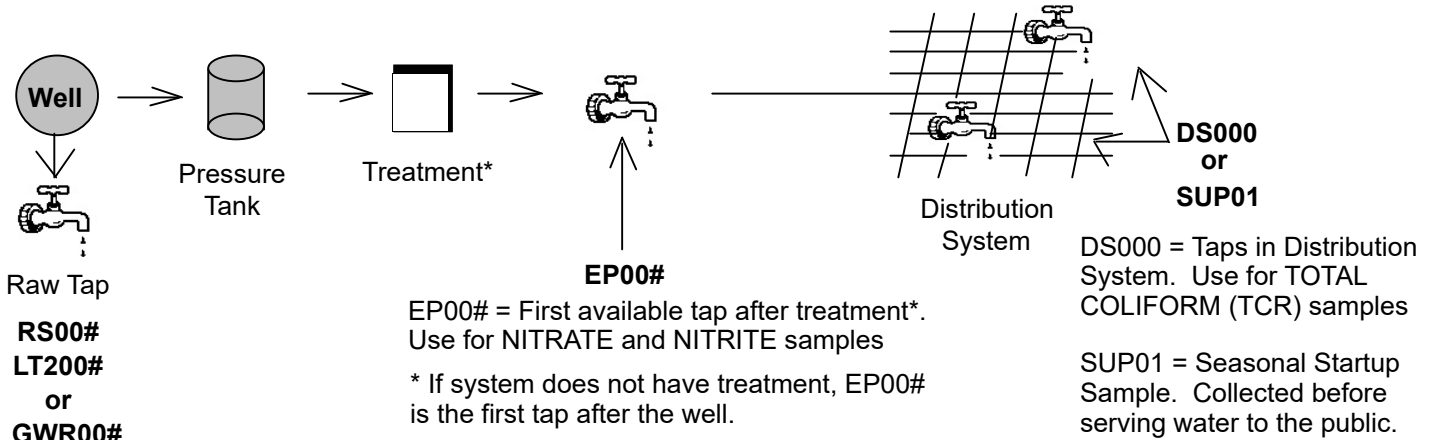

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5833812 OHIO POWER/WINDY HILL-E**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> OHIO POWER/WINDY HILL-E DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 9/30/2017

**Where to Collect Samples For a Small Public Water System**

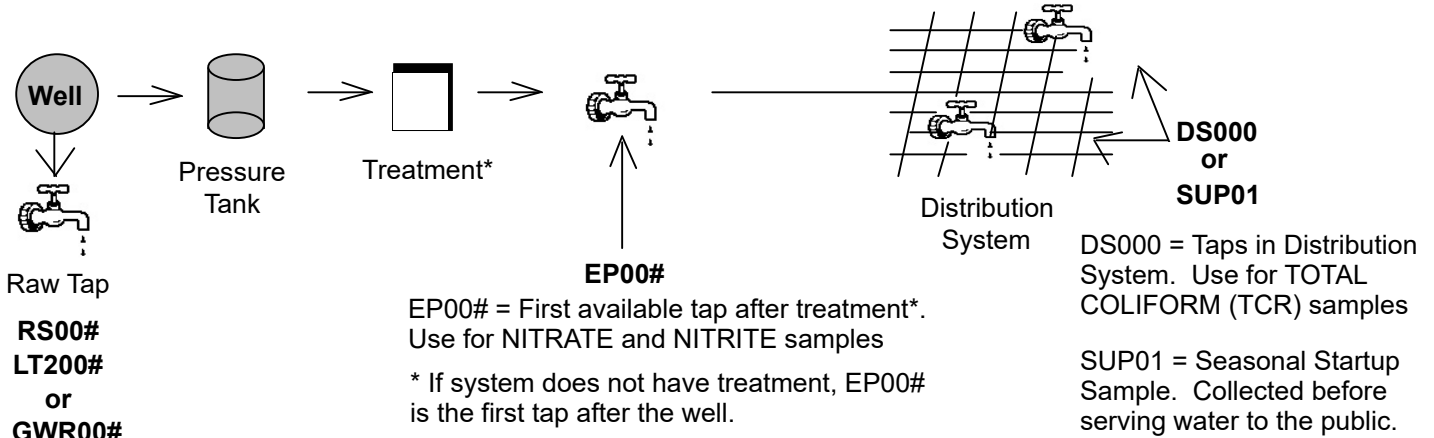

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5833812 OHIO POWER/WINDY HILL-E**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5856747 Facility Name: OHIO POWER WINDY HILL E**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5833912 OHIO POWER/WOOD GROVE-H**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **OHIO POWER/WOOD GROVE-H DISTRIBUTION**  
**Location** SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**

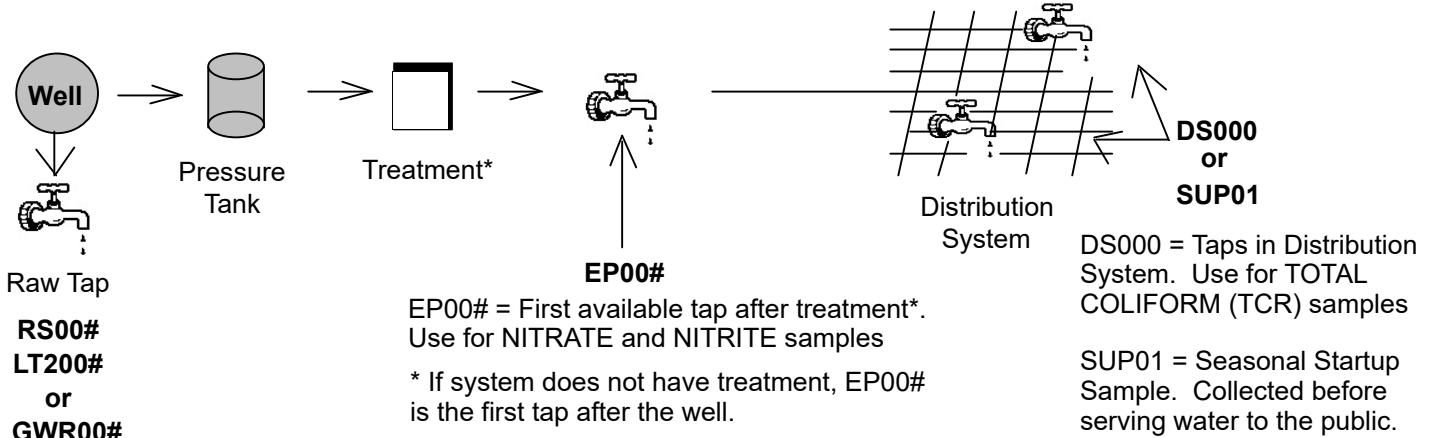

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5833912 OHIO POWER/WOOD GROVE-H**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> OHIO POWER/WOOD GROVE-H DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

**Where to Collect Samples For a Small Public Water System**

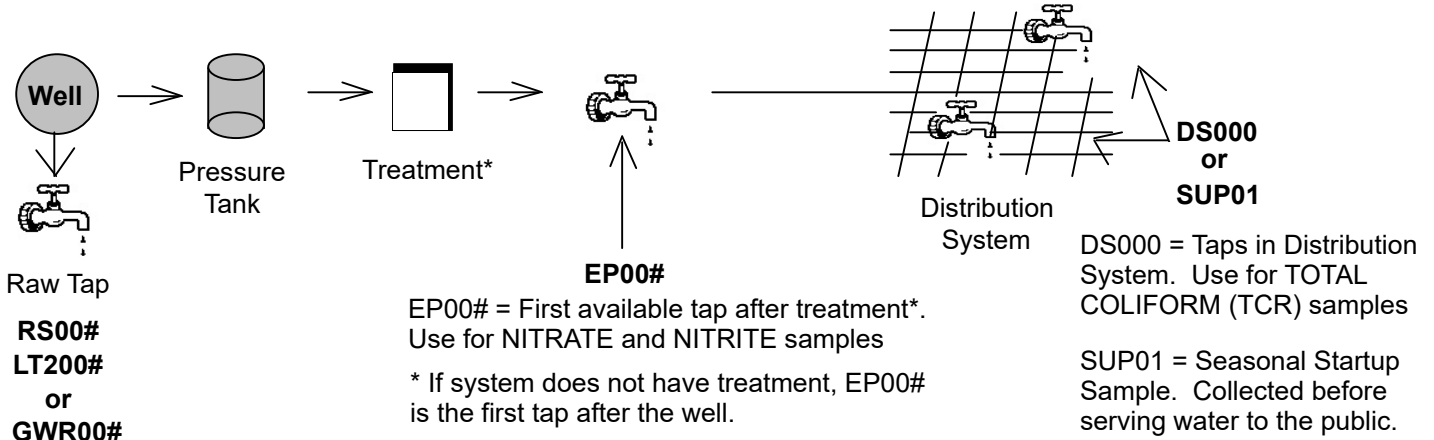

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5833912 OHIO POWER/WOOD GROVE-H**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5856748 Facility Name: OHIO POWER WOOD GROVE H**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017

**Where to Collect Samples For a Small Public Water System**

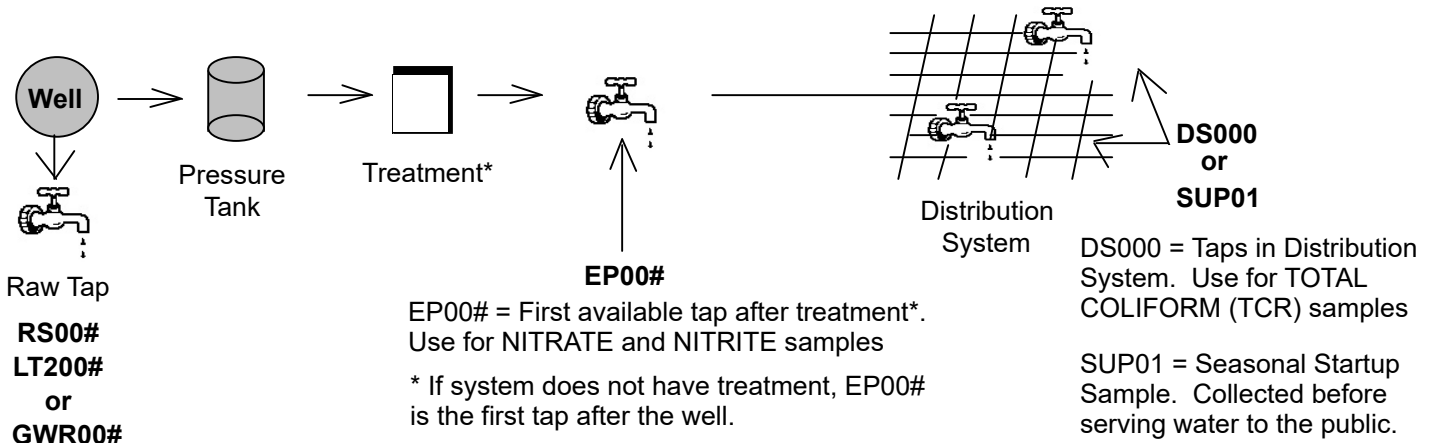

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH5836412 OHIO POWER/BICENT-K1**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**


<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> OHIO POWER/BICENT-K1 DISTRIBUTION
<b>Location SMP ID:</b> SUP01	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
-----------	-------------------------

TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public
-----------------------------------	--

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**

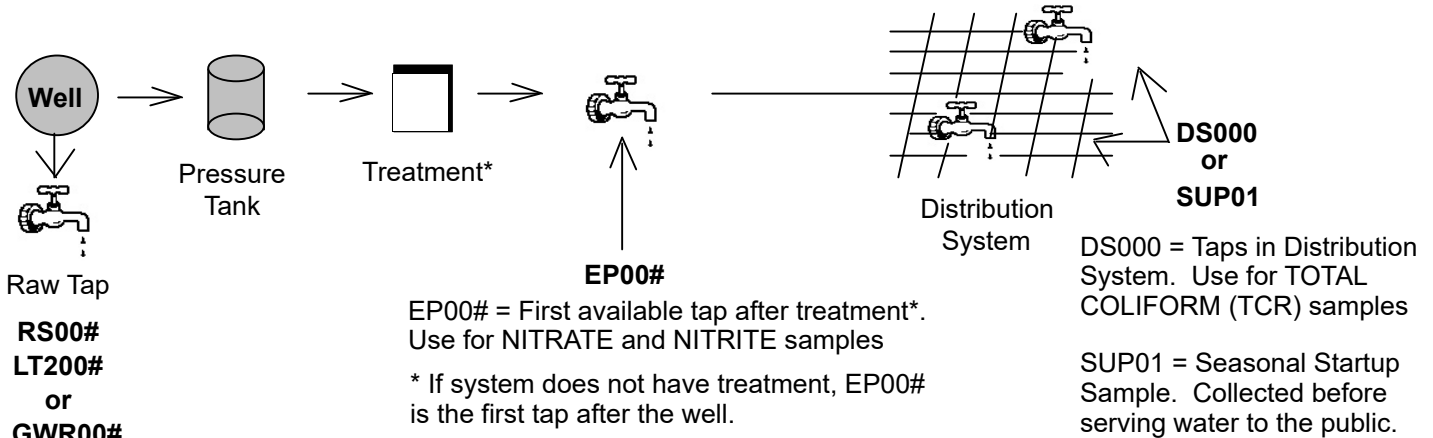

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5836412 OHIO POWER/BICENT-K1**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> OHIO POWER/BICENT-K1 DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 9/30/2017

**Where to Collect Samples For a Small Public Water System**

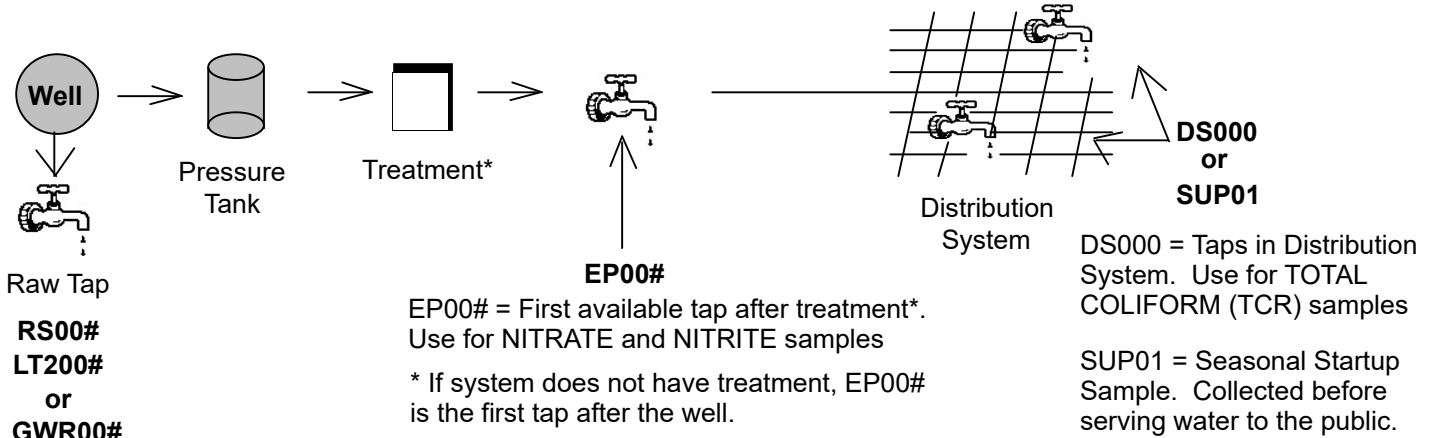

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5836412 OHIO POWER/BICENT-K1**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 6156756 Facility Name: OHIO POWER BICENTENNIAL K1**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5836512 OHIO POWER/BICENT-K2**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **OHIO POWER/BICENT-K2 DISTRIBUTION**  
**Location** SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**

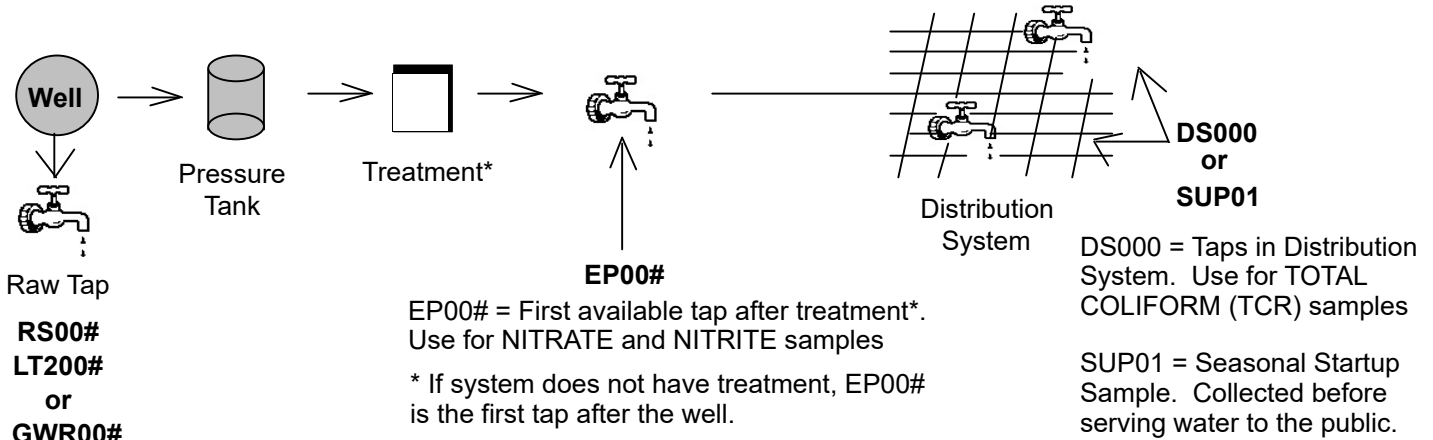

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5836512 OHIO POWER/BICENT-K2**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: 6156757 Facility Name: OHIO POWER BICENTENNIAL K2  
**Location** SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



Effective Date: 01/01/2017

2017 ENTRY POINT SCHEDULE

**OH5836612 MAHLE ENGINE COMPONENTS**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>5860713</b> SMP ID: <b>EP001</b>	Facility Name: <b>MAHLE ENGINE COMPONENTS</b> Facility Source: <b>Ground Water</b>	Facility Class: <b>CLASS A</b>
--------------------------	---	---	--------------------------------

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 6/1/2017 and 10/31/2017
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

**OH5836612 MAHLE ENGINE COMPONENTS**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>MAHLE ENG COMP DISTRIBUTION</b>
	SMP ID: <b>DS000</b>	

**Chemicals**

**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022

Not Required

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between	1/1/2017	and	3/31/2017
1 Sample(s) Required between	4/1/2017	and	6/30/2017
1 Sample(s) Required between	7/1/2017	and	9/30/2017
1 Sample(s) Required between	10/1/2017	and	12/31/2017

**OH5836712 MORGAN HARDWARE**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> MORGAN HARDWARE DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

**Where to Collect Samples For a Small Public Water System**

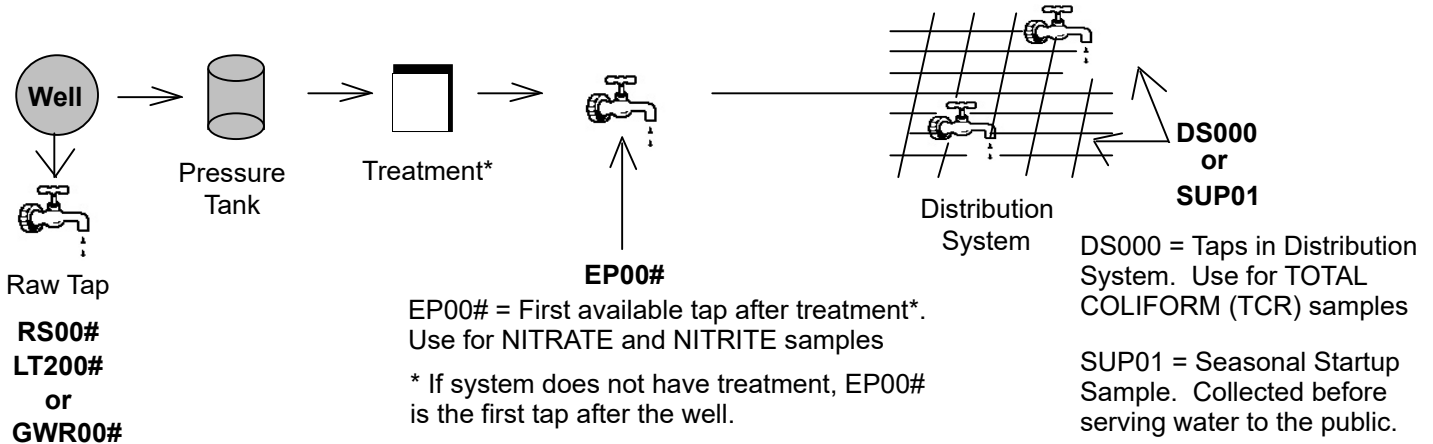

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH5836712 MORGAN HARDWARE**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5861411 Facility Name: MORGAN HARDWARE TREATMENT PLANT**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5836713 BOONDOCKS BBQ & GRILL PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> BOONDOCKS BBQ & GRILL DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5836713 BOONDOCKS BBQ & GRILL PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5861412 Facility Name: BOONDOCKS BBQ & GRILL**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**