



Effective Date: 01/01/2017

2017 ENTRY POINT SCHEDULE

**OH5900112 CARDINGTON VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>5956758</b>	Facility Name: <b>CARDINGTON WTP</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 6/1/2017 and 10/31/2017
<i>Sample for all the analytes listed below:</i>	
<i>ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037</i>	
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

**OH5900112 CARDINGTON VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>CARDINGTON DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 Not Required

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100

2 Sample(s) Required between	1/1/2017	and	1/31/2017
2 Sample(s) Required between	2/1/2017	and	2/28/2017
2 Sample(s) Required between	3/1/2017	and	3/31/2017
2 Sample(s) Required between	4/1/2017	and	4/30/2017
2 Sample(s) Required between	5/1/2017	and	5/31/2017
2 Sample(s) Required between	6/1/2017	and	6/30/2017
2 Sample(s) Required between	7/1/2017	and	7/31/2017
2 Sample(s) Required between	8/1/2017	and	8/31/2017
2 Sample(s) Required between	9/1/2017	and	9/30/2017
2 Sample(s) Required between	10/1/2017	and	10/31/2017
2 Sample(s) Required between	11/1/2017	and	11/30/2017
2 Sample(s) Required between	12/1/2017	and	12/31/2017

TOTAL CHLORINE - 1000

2 Sample(s) Required between	1/1/2017	and	1/31/2017
2 Sample(s) Required between	2/1/2017	and	2/28/2017
2 Sample(s) Required between	3/1/2017	and	3/31/2017
2 Sample(s) Required between	4/1/2017	and	4/30/2017
2 Sample(s) Required between	5/1/2017	and	5/31/2017
2 Sample(s) Required between	6/1/2017	and	6/30/2017
2 Sample(s) Required between	7/1/2017	and	7/31/2017
2 Sample(s) Required between	8/1/2017	and	8/31/2017
2 Sample(s) Required between	9/1/2017	and	9/30/2017
2 Sample(s) Required between	10/1/2017	and	10/31/2017
2 Sample(s) Required between	11/1/2017	and	11/30/2017
2 Sample(s) Required between	12/1/2017	and	12/31/2017

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>CARDINGTON DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2017 and 9/30/2017at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

**OH5900112 CARDINGTON VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>CARDINGTON DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2017 and 9/30/2017at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2017

2017 ENTRY POINT SCHEDULE

OH5900412 M & H MHP, LLC

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>5956761</b>	Facility Name: <b>M &amp; H MHP WTP</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 6/1/2017 and 10/31/2017
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

OH5900412 M & H MHP, LLC

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: M & H MHP DIST
Location SMP ID: DS000

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022

Not Required

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between 1/1/2017 and 1/31/2017
1 Sample(s) Required between 2/1/2017 and 2/28/2017
1 Sample(s) Required between 3/1/2017 and 3/31/2017
1 Sample(s) Required between 4/1/2017 and 4/30/2017
1 Sample(s) Required between 5/1/2017 and 5/31/2017
1 Sample(s) Required between 6/1/2017 and 6/30/2017
1 Sample(s) Required between 7/1/2017 and 7/31/2017
1 Sample(s) Required between 8/1/2017 and 8/31/2017
1 Sample(s) Required between 9/1/2017 and 9/30/2017
1 Sample(s) Required between 10/1/2017 and 10/31/2017
1 Sample(s) Required between 11/1/2017 and 11/30/2017
1 Sample(s) Required between 12/1/2017 and 12/31/2017

TOTAL CHLORINE - 1000

1 Sample(s) Required between 1/1/2017 and 1/31/2017
1 Sample(s) Required between 2/1/2017 and 2/28/2017
1 Sample(s) Required between 3/1/2017 and 3/31/2017
1 Sample(s) Required between 4/1/2017 and 4/30/2017
1 Sample(s) Required between 5/1/2017 and 5/31/2017
1 Sample(s) Required between 6/1/2017 and 6/30/2017
1 Sample(s) Required between 7/1/2017 and 7/31/2017
1 Sample(s) Required between 8/1/2017 and 8/31/2017
1 Sample(s) Required between 9/1/2017 and 9/30/2017
1 Sample(s) Required between 10/1/2017 and 10/31/2017
1 Sample(s) Required between 11/1/2017 and 11/30/2017
1 Sample(s) Required between 12/1/2017 and 12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Facility ID: DS1 Facility Name: M & H MHP DIST
Location SMP ID: DS201 7117 COUNTY ROAD 59

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2017 and 9/30/2017at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



Effective Date: 01/01/2017

2017 ENTRY POINT SCHEDULE

**OH5900512 LAKEVIEW ESTATES MHC**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>5956762</b>	Facility Name: <b>LAKEVIEW ESTATES MHC</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 6/1/2017 and 10/31/2017
<i>Sample for all the analytes listed below:</i>	
<b>ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037</b>	
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



**OH5900512 LAKEVIEW ESTATES MHC**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017**

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1 Facility Name: LAKEVIEW ESTATES MHC DIST**  
**Location SMP ID: DS000**

**Chemicals**

**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2017 and 9/30/2017

*Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Form 5105 with appendix must be submitted to Ohio EPA within ten days from the end of the month(s) in which samples are collected. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>. For questions contact your Ohio EPA District Office representative.*

TOTAL COLIFORM (TCR) - 3100  
1 Sample(s) Required between 1/1/2017 and 1/31/2017  
1 Sample(s) Required between 2/1/2017 and 2/28/2017  
1 Sample(s) Required between 3/1/2017 and 3/31/2017  
1 Sample(s) Required between 4/1/2017 and 4/30/2017  
1 Sample(s) Required between 5/1/2017 and 5/31/2017  
1 Sample(s) Required between 6/1/2017 and 6/30/2017  
1 Sample(s) Required between 7/1/2017 and 7/31/2017  
1 Sample(s) Required between 8/1/2017 and 8/31/2017  
1 Sample(s) Required between 9/1/2017 and 9/30/2017  
1 Sample(s) Required between 10/1/2017 and 10/31/2017  
1 Sample(s) Required between 11/1/2017 and 11/30/2017  
1 Sample(s) Required between 12/1/2017 and 12/31/2017

TOTAL CHLORINE - 1000  
1 Sample(s) Required between 1/1/2017 and 1/31/2017  
1 Sample(s) Required between 2/1/2017 and 2/28/2017  
1 Sample(s) Required between 3/1/2017 and 3/31/2017  
1 Sample(s) Required between 4/1/2017 and 4/30/2017  
1 Sample(s) Required between 5/1/2017 and 5/31/2017  
1 Sample(s) Required between 6/1/2017 and 6/30/2017  
1 Sample(s) Required between 7/1/2017 and 7/31/2017  
1 Sample(s) Required between 8/1/2017 and 8/31/2017  
1 Sample(s) Required between 9/1/2017 and 9/30/2017  
1 Sample(s) Required between 10/1/2017 and 10/31/2017  
1 Sample(s) Required between 11/1/2017 and 11/30/2017  
1 Sample(s) Required between 12/1/2017 and 12/31/2017

**Samples should be collected at the same time and place as the Total Coliform samples.**



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

**OH5900512 LAKEVIEW ESTATES MHC**

System Type: Community

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>LAKEVIEW ESTATES MHC DIST</b>
<b>Location</b>	SMP ID: <b>DS201</b>	<b>ADDRESS NOT KNOWN</b>

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2017 and 9/30/2017at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950





**OH5900712 MT GILEAD VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>5956763</b>	Facility Name: <b>MT GILEAD WTP</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
ARSENIC - 1005	1 Sample(s) Required between 1/1/2017 and 3/31/2017 1 Sample(s) Required between 4/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 9/30/2017 1 Sample(s) Required between 10/1/2017 and 12/31/2017
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 6/1/2017 and 10/31/2017
<i>Sample for all the analytes listed below:</i>	
<b>ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037</b>	
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

OH5900712 MT GILEAD VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>MT GILEAD DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100

4 Sample(s) Required between 1/1/2017 and 1/31/2017

4 Sample(s) Required between 2/1/2017 and 2/28/2017

4 Sample(s) Required between 3/1/2017 and 3/31/2017

4 Sample(s) Required between 4/1/2017 and 4/30/2017

4 Sample(s) Required between 5/1/2017 and 5/31/2017

4 Sample(s) Required between 6/1/2017 and 6/30/2017

4 Sample(s) Required between 7/1/2017 and 7/31/2017

4 Sample(s) Required between 8/1/2017 and 8/31/2017

4 Sample(s) Required between 9/1/2017 and 9/30/2017

4 Sample(s) Required between 10/1/2017 and 10/31/2017

4 Sample(s) Required between 11/1/2017 and 11/30/2017

4 Sample(s) Required between 12/1/2017 and 12/31/2017

TOTAL CHLORINE - 1000

4 Sample(s) Required between 1/1/2017 and 1/31/2017

4 Sample(s) Required between 2/1/2017 and 2/28/2017

4 Sample(s) Required between 3/1/2017 and 3/31/2017

4 Sample(s) Required between 4/1/2017 and 4/30/2017

4 Sample(s) Required between 5/1/2017 and 5/31/2017

4 Sample(s) Required between 6/1/2017 and 6/30/2017

4 Sample(s) Required between 7/1/2017 and 7/31/2017

4 Sample(s) Required between 8/1/2017 and 8/31/2017

4 Sample(s) Required between 9/1/2017 and 9/30/2017

4 Sample(s) Required between 10/1/2017 and 10/31/2017

4 Sample(s) Required between 11/1/2017 and 11/30/2017

4 Sample(s) Required between 12/1/2017 and 12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>MT GILEAD DISTRIBUTION</b> <b>900 ORCHARD DRIVE</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2017 and 9/30/2017at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

**OH5900712 MT GILEAD VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>MT GILEAD DISTRIBUTION</b> <b>165 FAIRWAY LANE</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2017 and 9/30/2017at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH5901012 CANDLEWOOD LAKE ASSOCIATION INC**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>5956765</b>	Facility Name: <b>CANDLEWOOD LAKE WTP</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
ARSENIC - 1005	1 Sample(s) Required between 1/1/2017 and 3/31/2017 1 Sample(s) Required between 4/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 9/30/2017 1 Sample(s) Required between 10/1/2017 and 12/31/2017
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 6/1/2017 and 10/31/2017
<i>Sample for all the analytes listed below:</i>	
<b>ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037</b>	
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

OH5901012 CANDLEWOOD LAKE ASSOCIATION INC

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: DS1 SMP ID: DS000 Facility Name: CANDLEWOOD LAKE ASSN INC DISTRIBUTIOI Facility Class: CLASS 1

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

TOTAL COLIFORM (TCR) - 3100 2 Sample(s) Required between 1/1/2017 and 1/31/2017 2 Sample(s) Required between 2/1/2017 and 2/28/2017 2 Sample(s) Required between 3/1/2017 and 3/31/2017 2 Sample(s) Required between 4/1/2017 and 4/30/2017 2 Sample(s) Required between 5/1/2017 and 5/31/2017 2 Sample(s) Required between 6/1/2017 and 6/30/2017 2 Sample(s) Required between 7/1/2017 and 7/31/2017 2 Sample(s) Required between 8/1/2017 and 8/31/2017 2 Sample(s) Required between 9/1/2017 and 9/30/2017 2 Sample(s) Required between 10/1/2017 and 10/31/2017 2 Sample(s) Required between 11/1/2017 and 11/30/2017 2 Sample(s) Required between 12/1/2017 and 12/31/2017

TOTAL CHLORINE - 1000 2 Sample(s) Required between 1/1/2017 and 1/31/2017 2 Sample(s) Required between 2/1/2017 and 2/28/2017 2 Sample(s) Required between 3/1/2017 and 3/31/2017 2 Sample(s) Required between 4/1/2017 and 4/30/2017 2 Sample(s) Required between 5/1/2017 and 5/31/2017 2 Sample(s) Required between 6/1/2017 and 6/30/2017 2 Sample(s) Required between 7/1/2017 and 7/31/2017 2 Sample(s) Required between 8/1/2017 and 8/31/2017 2 Sample(s) Required between 9/1/2017 and 9/30/2017 2 Sample(s) Required between 10/1/2017 and 10/31/2017 2 Sample(s) Required between 11/1/2017 and 11/30/2017 2 Sample(s) Required between 12/1/2017 and 12/31/2017

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: DS1 SMP ID: DS201 Facility Name: CANDLEWOOD LAKE ASSN INC DISTRIBUTIOI Facility Class: CLASS 1 ADDRESS NOT KNOWN

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2017 and 9/30/2017at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

**OH5901012 CANDLEWOOD LAKE ASSOCIATION INC**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2017**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>CANDLEWOOD LAKE ASSN INC DISTRIBUTIOI</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>DS202</b>	<b>ADDRESS NOT KNOWN</b>	

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2017 and 9/30/2017at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

**OH5931712 CLEARFORK MARINA**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> CLEARFORK MARINA DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

**Where to Collect Samples For a Small Public Water System**

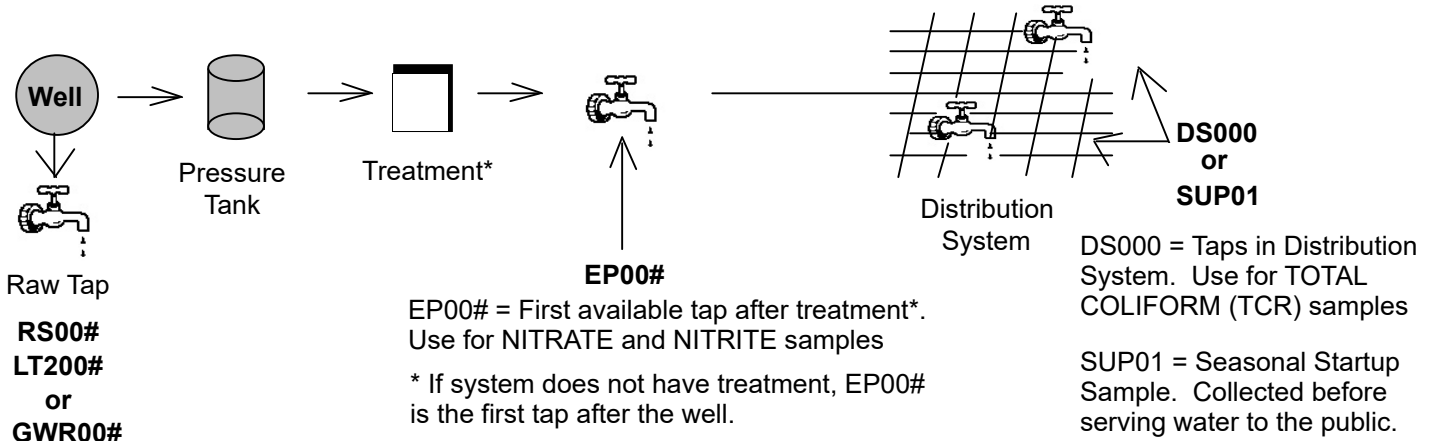

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5931712 CLEARFORK MARINA**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5956768 Facility Name: CLEARFORK MARINA**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017

**Where to Collect Samples For a Small Public Water System**

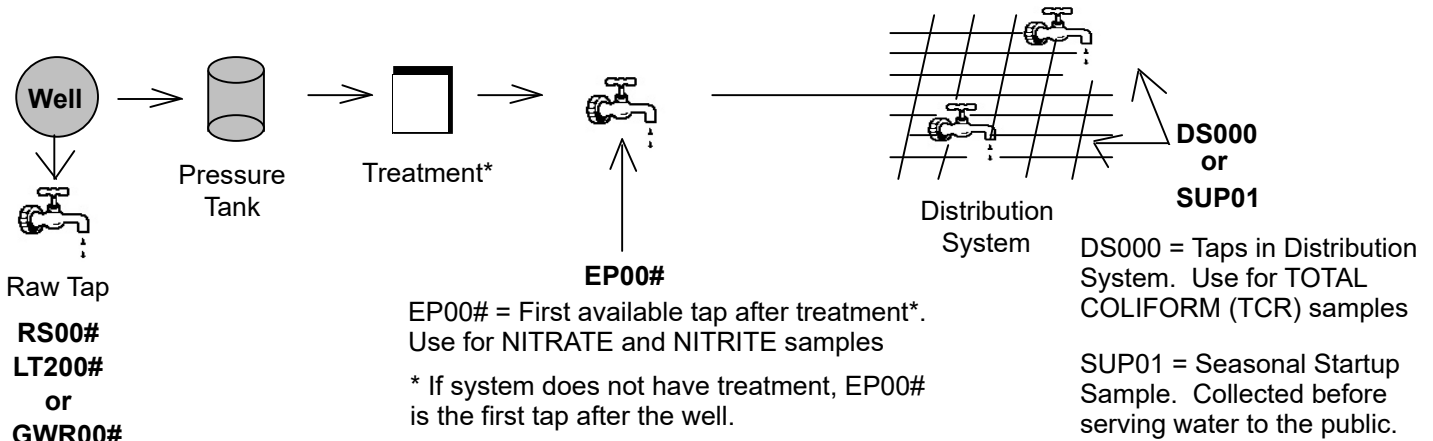

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH5931812 CLEARFORK CAMPGROUND**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **CLEARFORK CAMPGROUND DISTRIBUTION**  
**Location** SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**

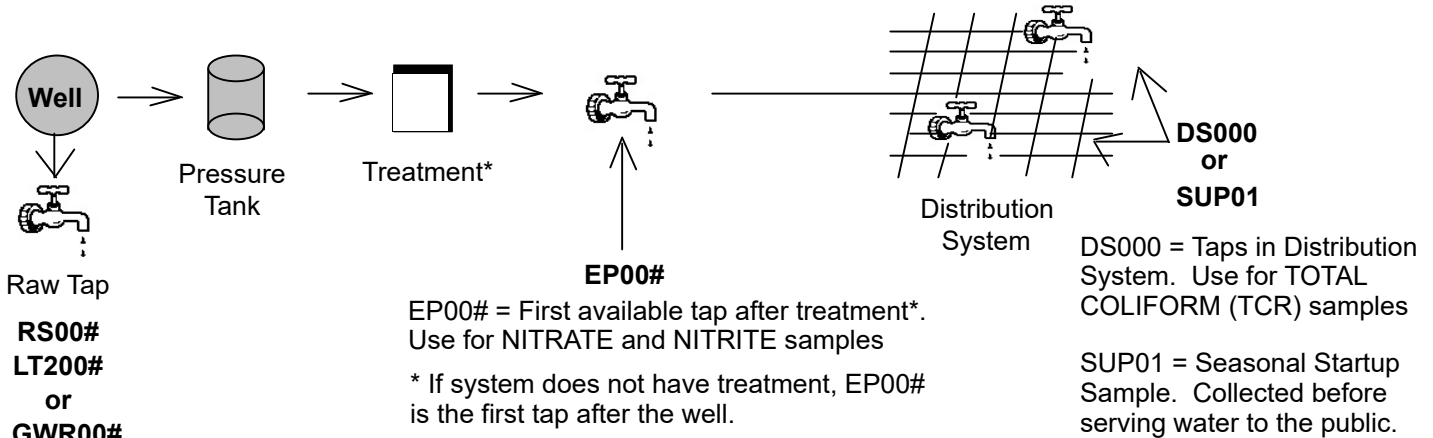

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5931812 CLEARFORK CAMPGROUND**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> CLEARFORK CAMPGROUND DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

**Where to Collect Samples For a Small Public Water System**

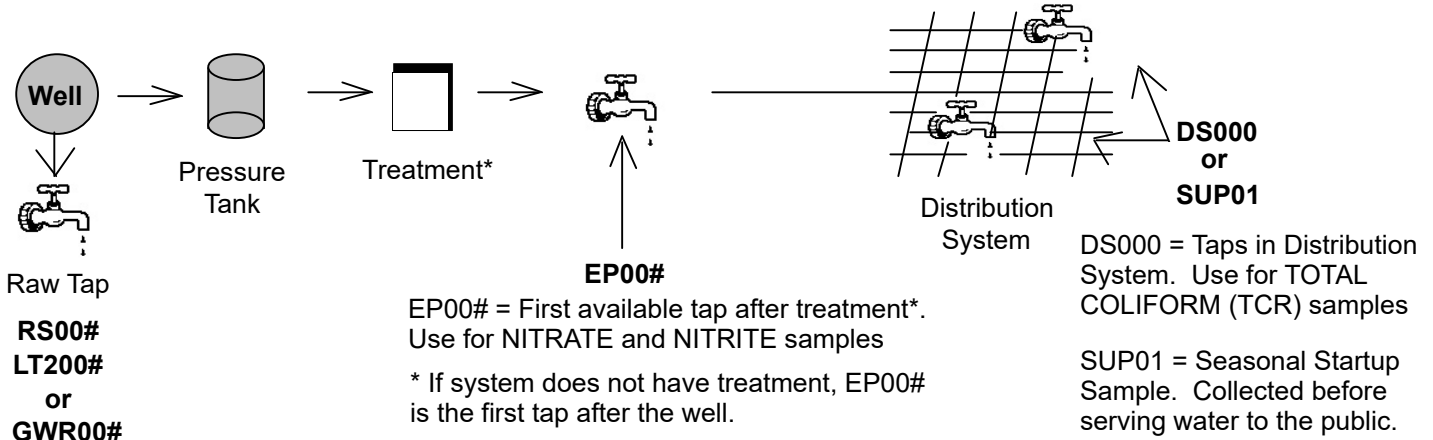

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5931812 CLEARFORK CAMPGROUND**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5956769 Facility Name: CLEARFORK CAMPGROUND**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017

**Where to Collect Samples For a Small Public Water System**

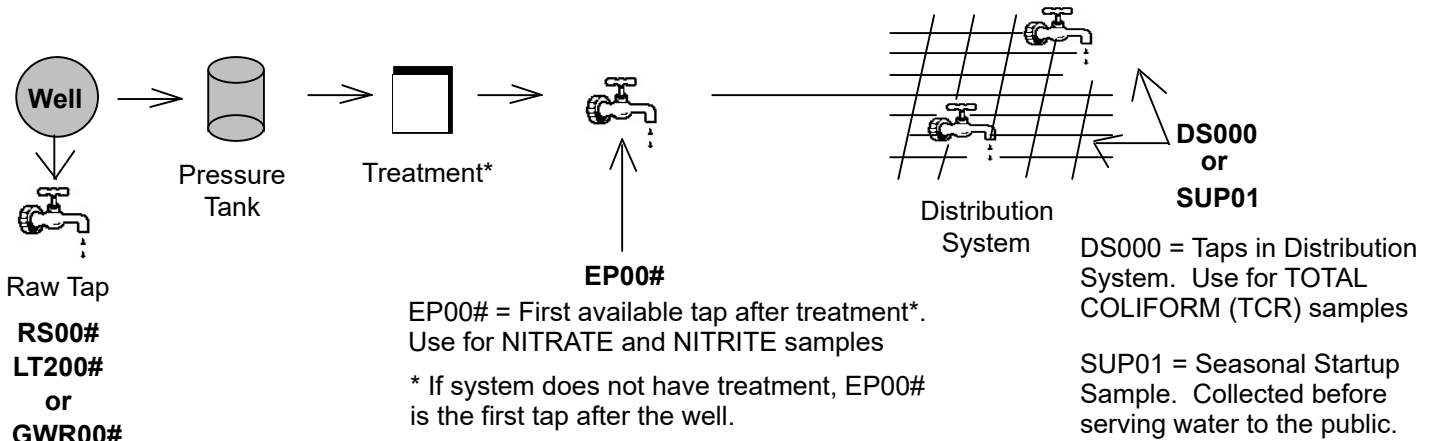

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5935712 MID-OHIO SPORTS MAINTENANCE**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **MID-OHIO SPORTS MAINTENA DISTRIBUTION**  
**Location** SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**

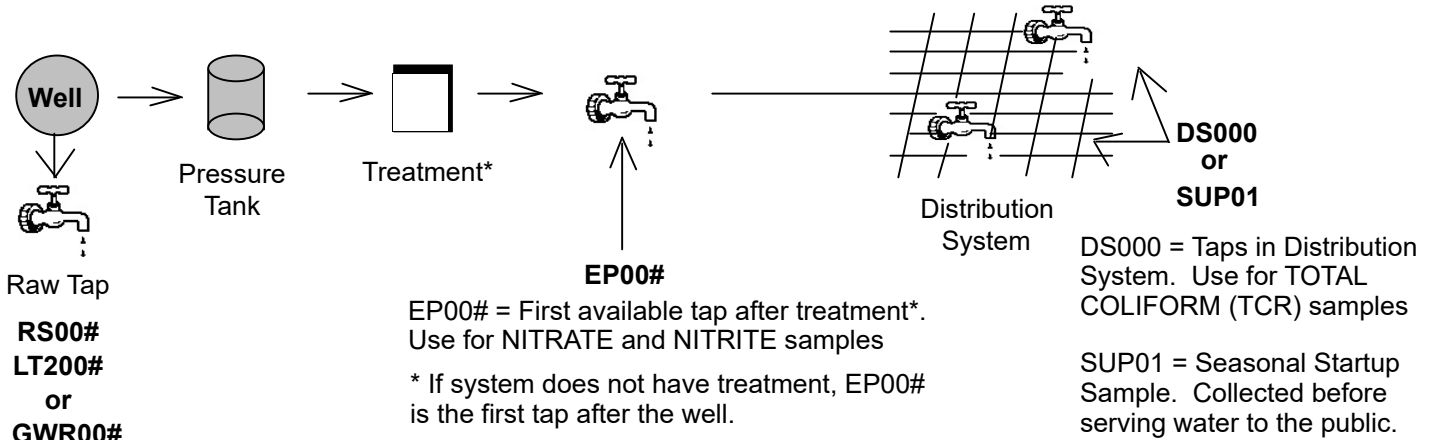

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5935712 MID-OHIO SPORTS MAINTENANCE**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> MID-OHIO SPORTS MAINTENANCE DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

**Where to Collect Samples For a Small Public Water System**

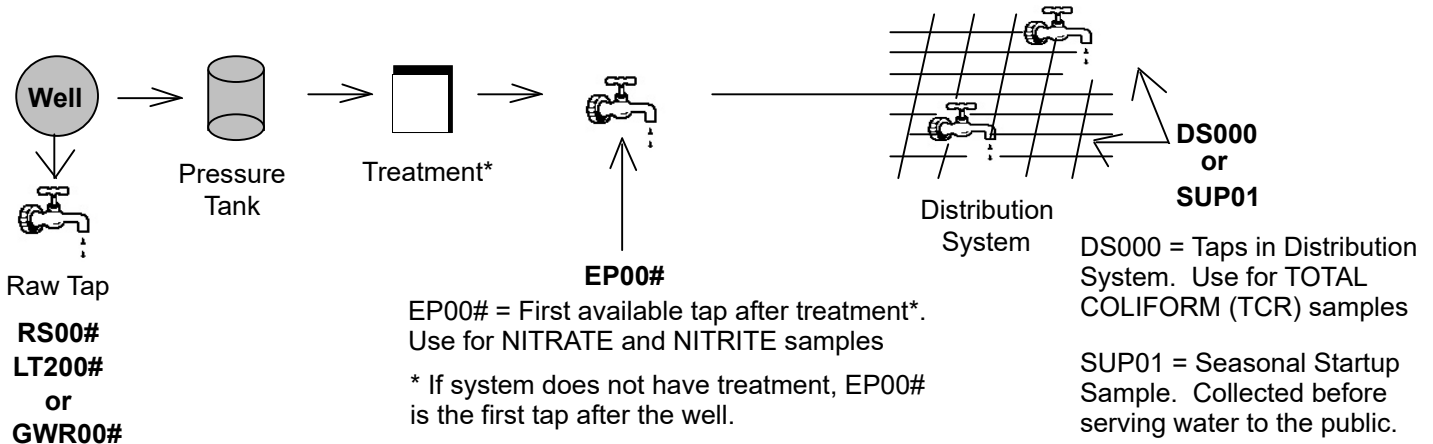

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5935712 MID-OHIO SPORTS MAINTENANCE**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5956779 Facility Name: MID-OHIO SPORTS MAINTENANCE**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017

**Where to Collect Samples For a Small Public Water System**

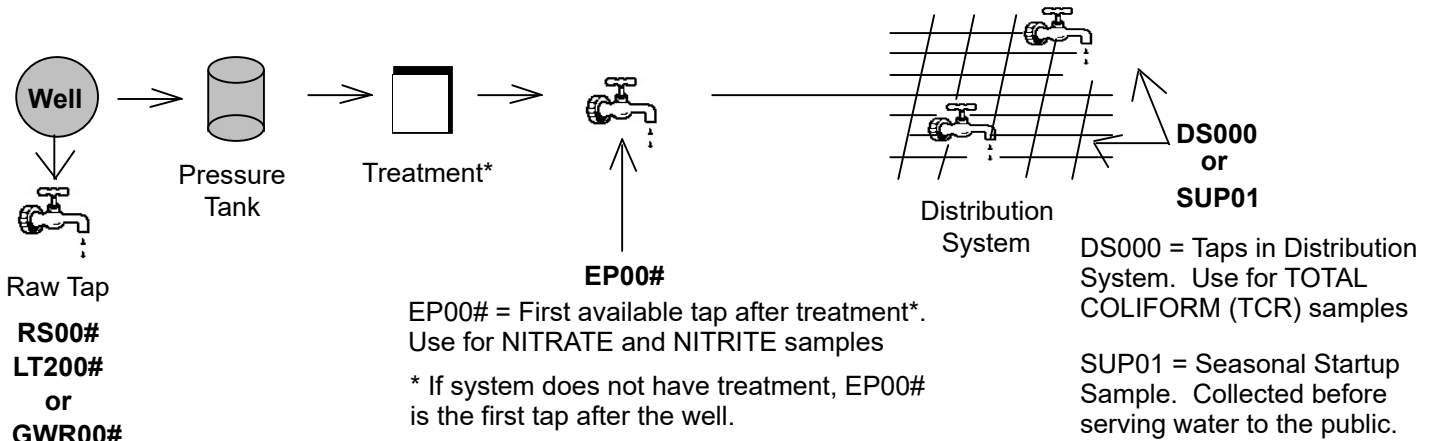

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5935812 MID-OHIO SPORTS TOWER**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> MID-OHIO SPORTS/TOWER DISTRIBUTION
<b>Location SMP ID:</b> SUP01	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**

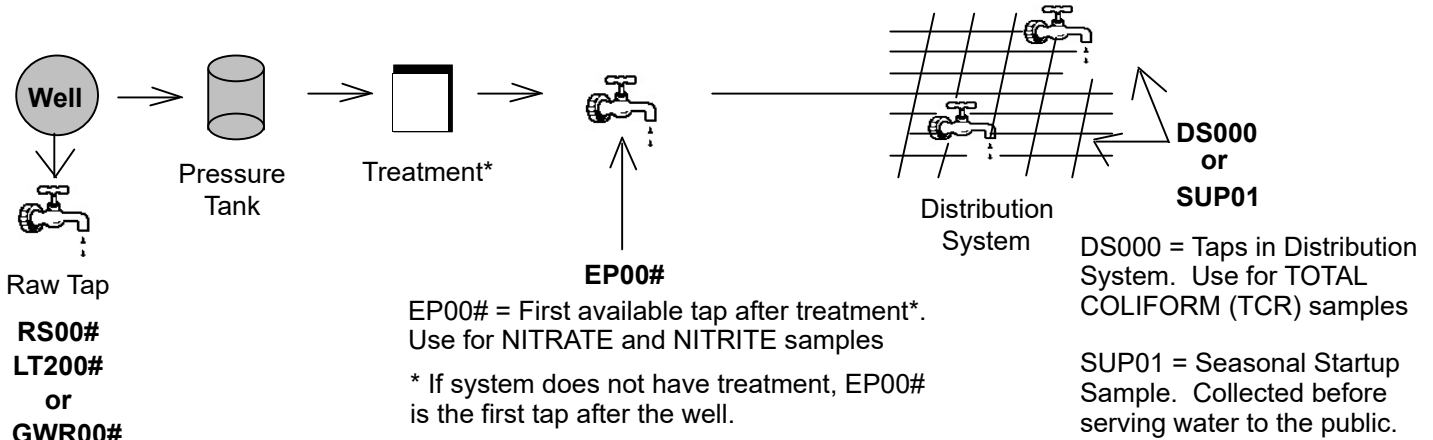

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5935812 MID-OHIO SPORTS TOWER**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> MID-OHIO SPORTS/TOWER DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

**Where to Collect Samples For a Small Public Water System**

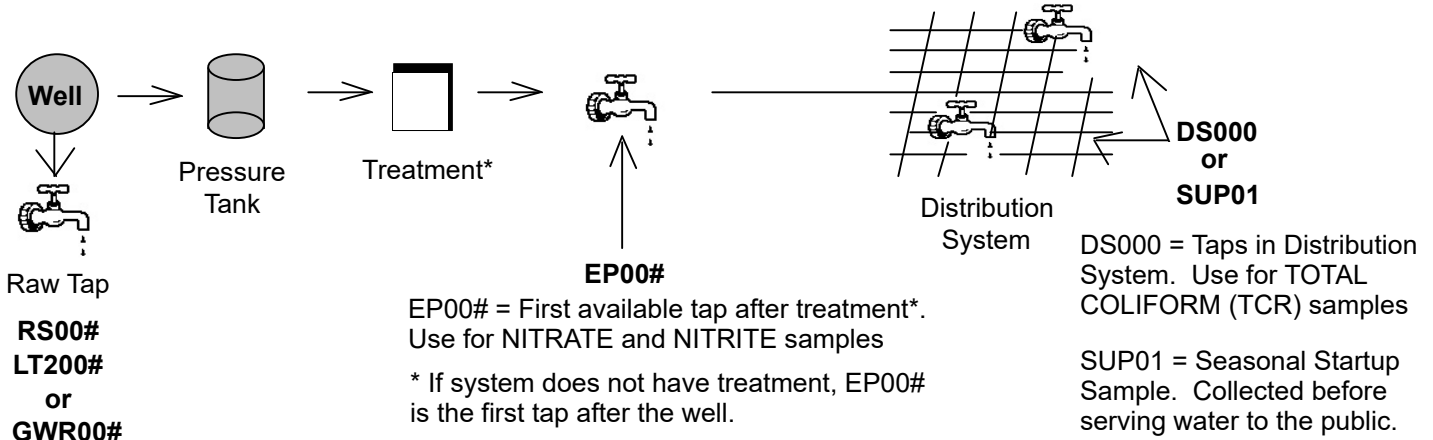

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH5935812 MID-OHIO SPORTS TOWER**

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5956780 Facility Name: MID-OHIO SPORTS/TOWER**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017

**Where to Collect Samples For a Small Public Water System**

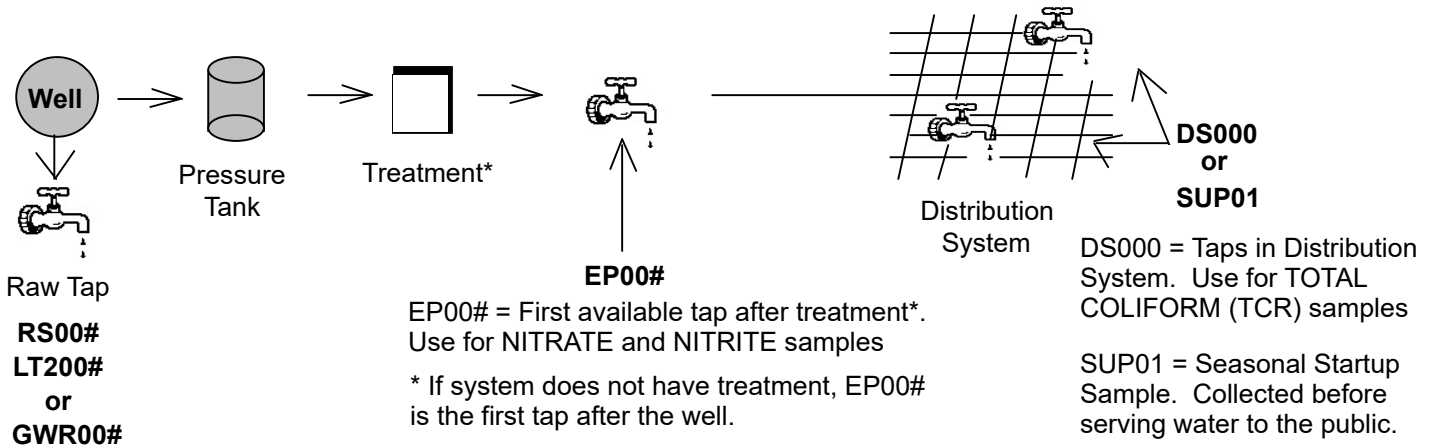

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



Effective Date: 01/01/2017

2017 ENTRY POINT SCHEDULE

OH5936212 NORTHMOR ADMINISTRATIVE OFFICE

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>5956783</b>	Facility Name: <b>NORTHMOR ADMINISTRATIVE OFFICE</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 6/1/2017 and 10/31/2017
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

**OH5936212 NORTHMOR ADMINISTRATIVE OFFICE**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>NORTHMOR ADMIN. OFFICE DISTRIBUTION</b>
	SMP ID: <b>DS000</b>	

**Chemicals**

**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022

Not Required

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between	1/1/2017	and	3/31/2017
1 Sample(s) Required between	4/1/2017	and	6/30/2017
1 Sample(s) Required between	7/1/2017	and	9/30/2017
1 Sample(s) Required between	10/1/2017	and	12/31/2017

**OH5936712 PLEASANT GROVE CHURCH OF CHRIST**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> PLEASANT GROVE CHURCH OF DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

**Where to Collect Samples For a Small Public Water System**

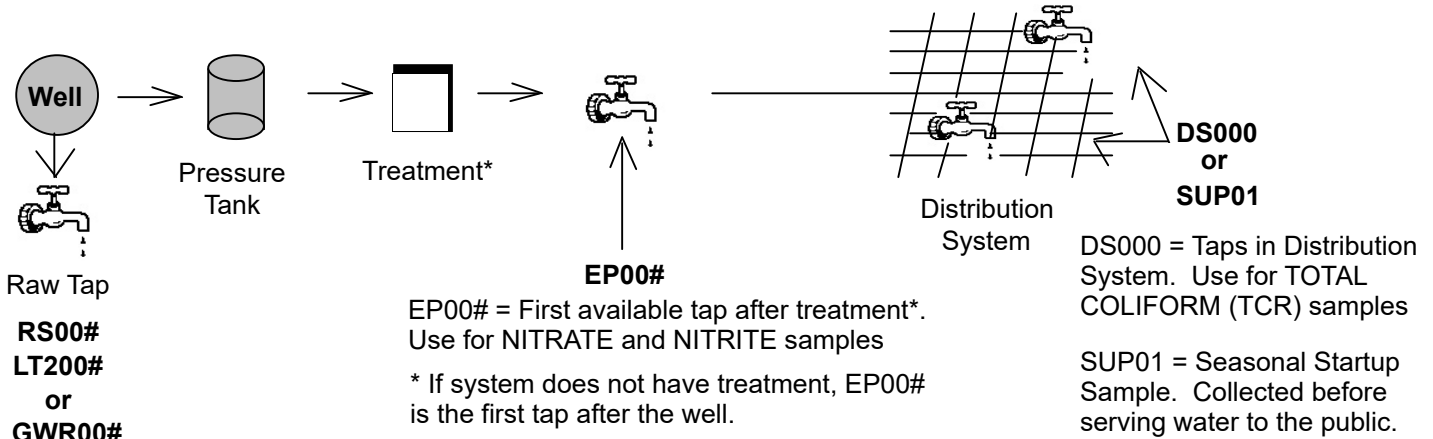

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5936712 PLEASANT GROVE CHURCH OF CHRIST**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5956788 Facility Name: PLEASANT GROVE CHURCH OF CHRST**

**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017

**Where to Collect Samples For a Small Public Water System**

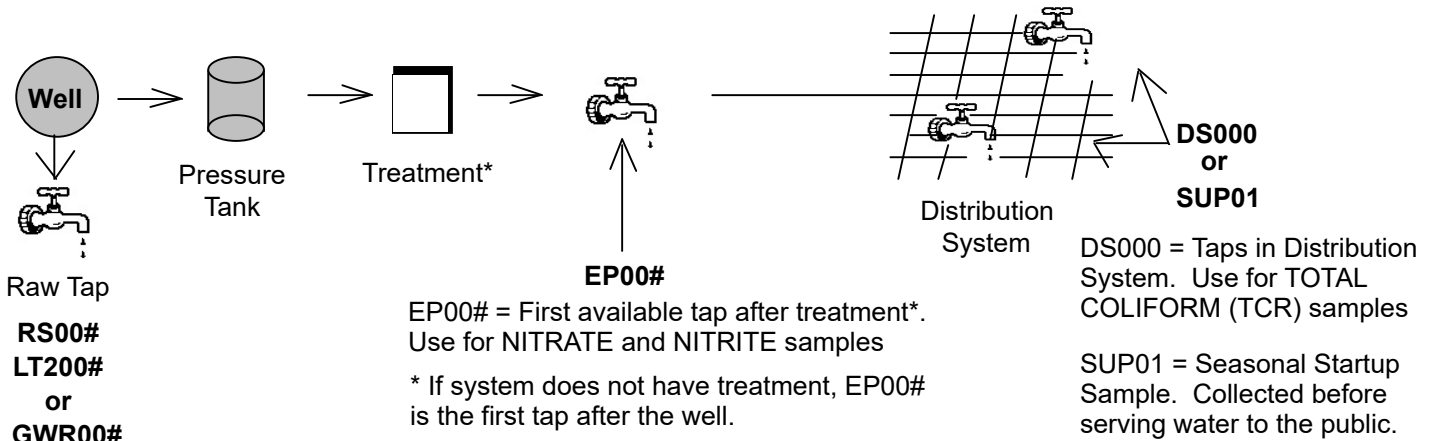

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5941222 SYCAMORE CREEK GOLF COURSE LODGE PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> SYCAMORE CREEK GOLF COURSE LODG DIST
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

**Where to Collect Samples For a Small Public Water System**

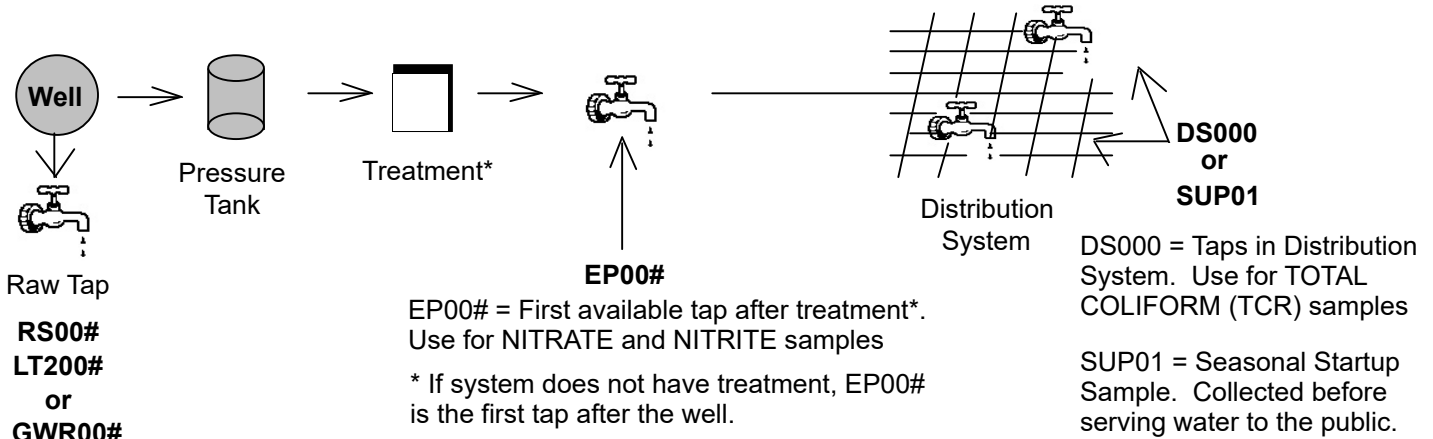

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5941222 SYCAMORE CREEK GOLF COURSE LODGE PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5956805 Facility Name: SYCAMORE CREEK GOLF COURSE LODGE**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5941912 GRANT GALBRAITH MD, INC. PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **GRANT GALBRAITH MD, INC. DISTRIBUTION**  
**Location** SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

**Where to Collect Samples For a Small Public Water System**

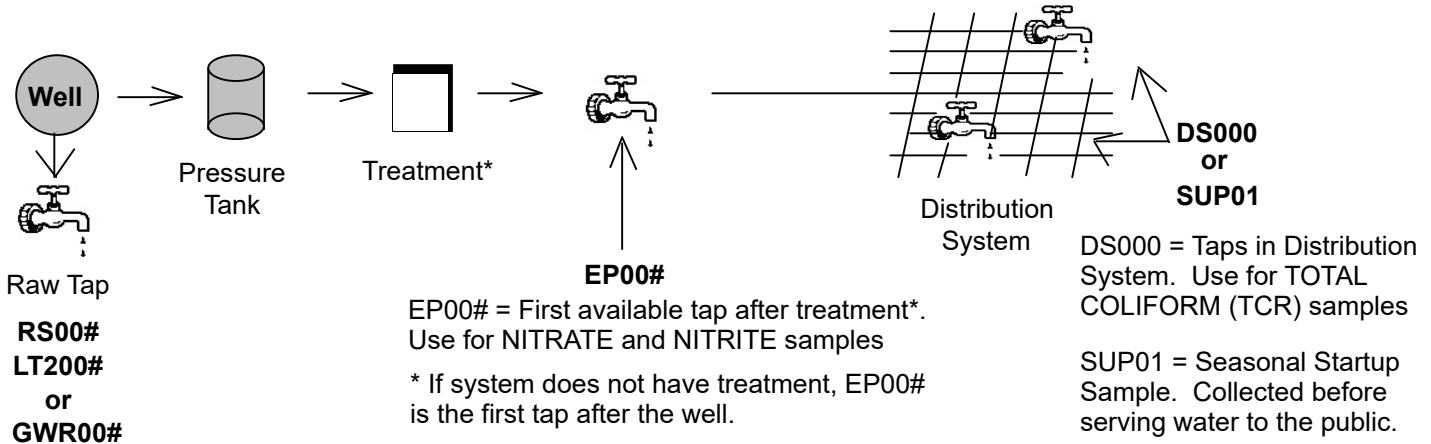

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH5941912 GRANT GALBRAITH MD, INC. PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5961626 Facility Name: GRANT GALBRAITH MD, INC.**

**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 6/1/2017 and 10/31/2017
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017

**Where to Collect Samples For a Small Public Water System**

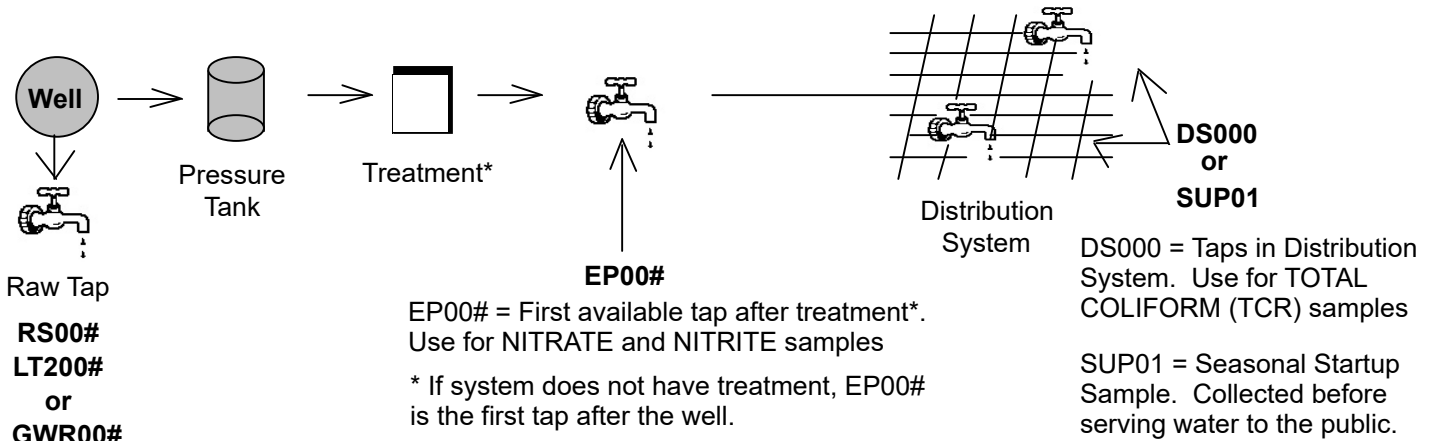

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5942012 NORTHFIELD MEDICAL BLDG PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> NORTHFIELD MEDICAL BLDG DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

**Where to Collect Samples For a Small Public Water System**

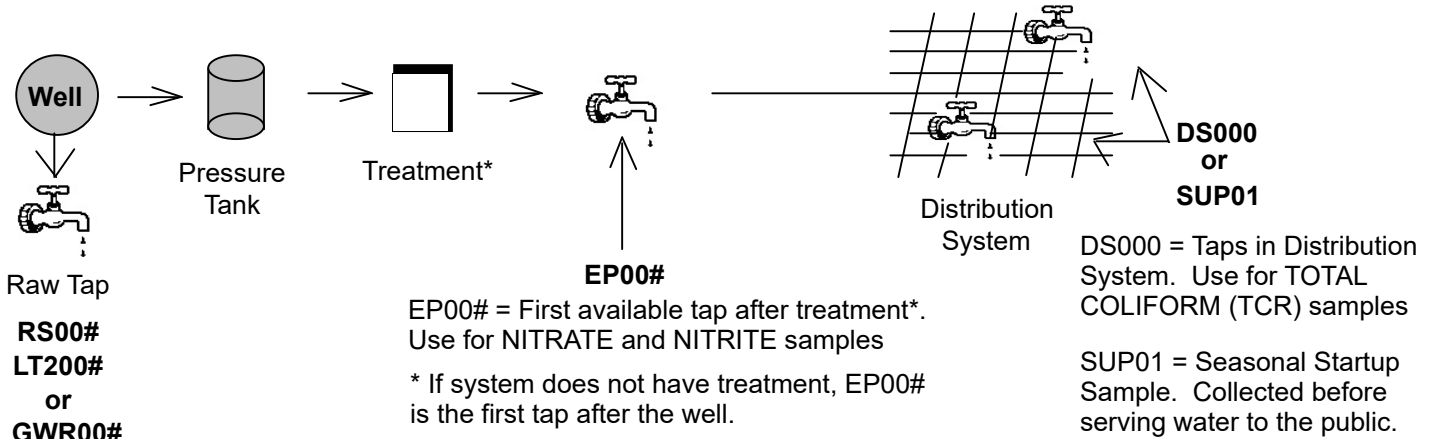

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5942012 NORTHFIELD MEDICAL BLDG PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5961627 Facility Name: NORTHFIELD MEDICAL BLDG**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 6/1/2017 and 10/31/2017
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017

**Where to Collect Samples For a Small Public Water System**

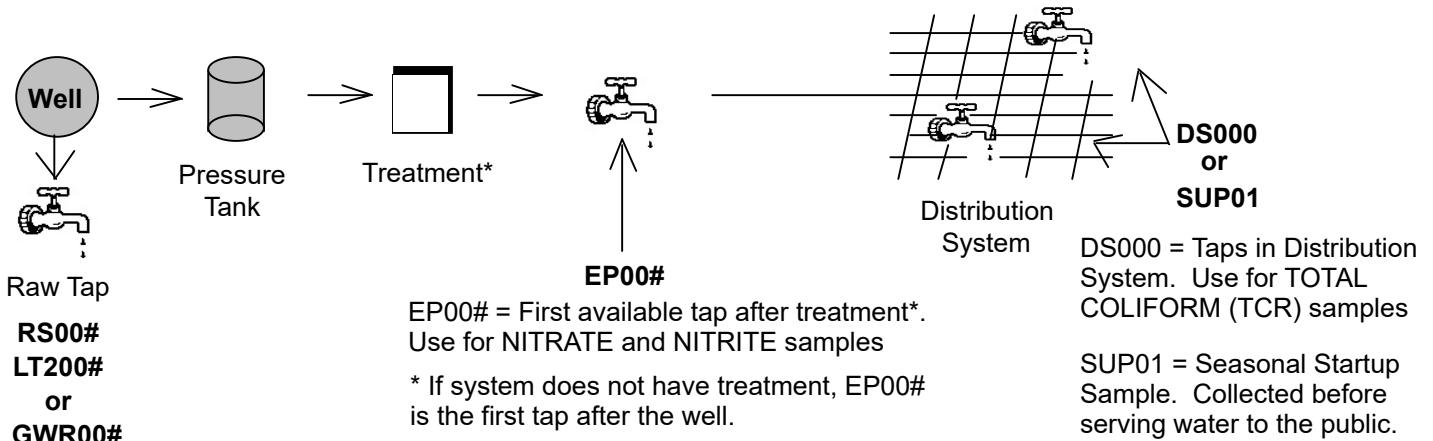

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5942212 FRESH FAITH COMMUNITY CHURCH PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> FRESH FAITH COMM CHURCH DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

**Where to Collect Samples For a Small Public Water System**

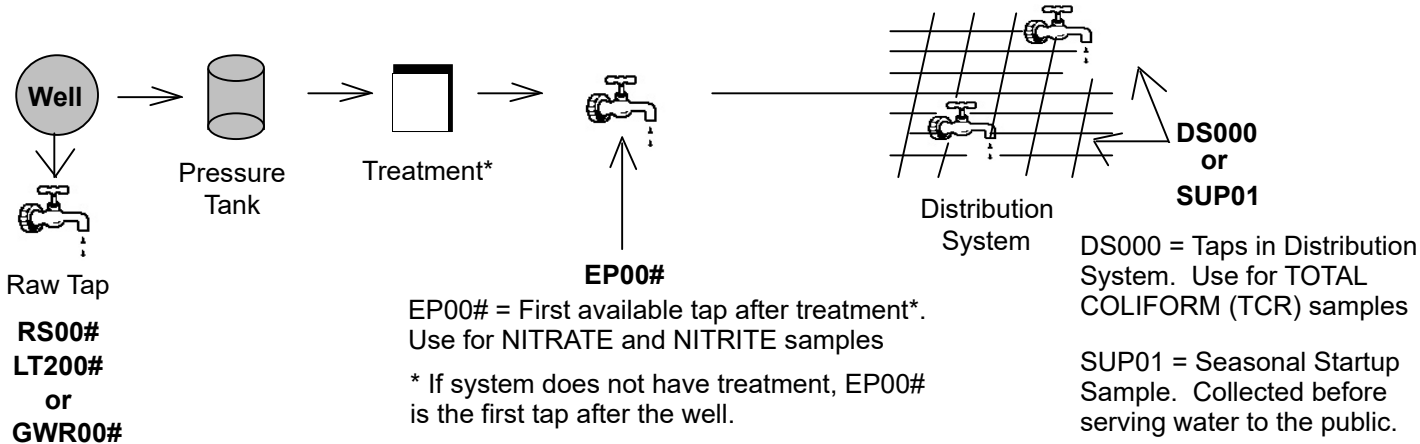

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5942212 FRESH FAITH COMMUNITY CHURCH PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5962148 Facility Name: FRESH FAITH COMMUNITY CHURCH**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 6/1/2017 and 10/31/2017
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017

**Where to Collect Samples For a Small Public Water System**

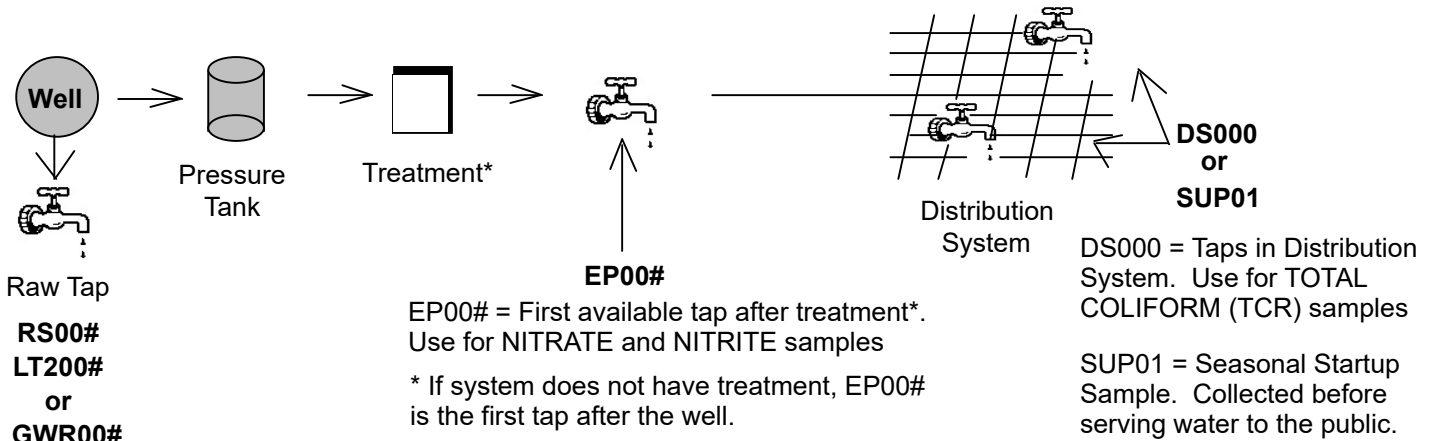

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5942512 PENIEL BIBLE CAMP PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> PENIEL BIBLE CAMP DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

**Where to Collect Samples For a Small Public Water System**

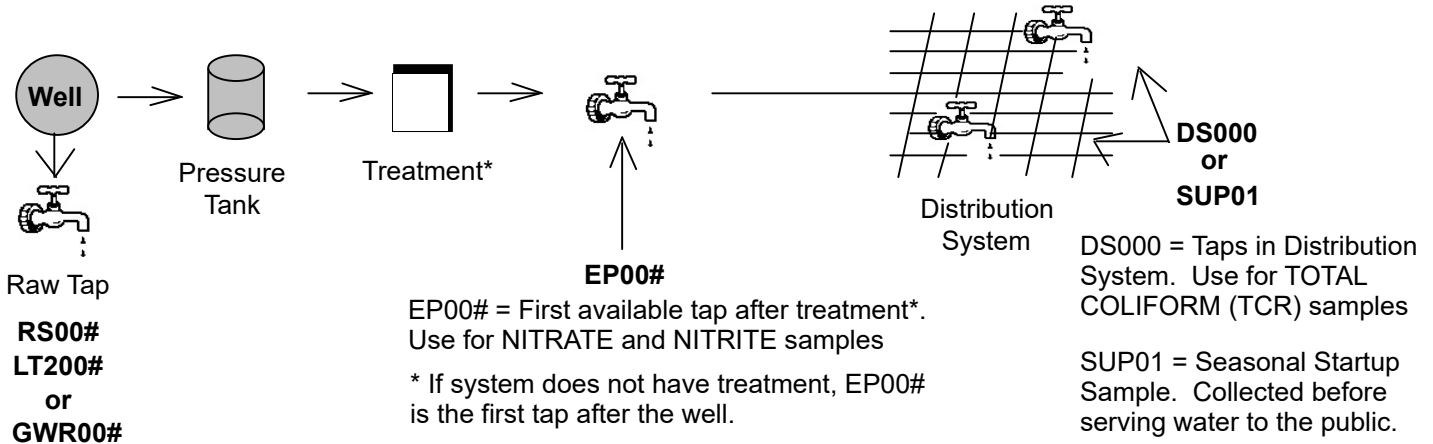

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5942512 PENIEL BIBLE CAMP PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5962264 Facility Name: PENIEL BIBLE CAMP**  
**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017

**Where to Collect Samples For a Small Public Water System**



**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5942612 HIGHLAND PIZZA AND ICE CREAM PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1 Facility Name: HIGHLAND PIZZA AND ICE CREAM DISTRIBUTIO**  
**Location SMP ID: DS000 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2017 and 3/31/2017
	1 Sample(s) Required between 4/1/2017 and 6/30/2017
	1 Sample(s) Required between 7/1/2017 and 9/30/2017
	1 Sample(s) Required between 10/1/2017 and 12/31/2017

**Where to Collect Samples For a Small Public Water System**

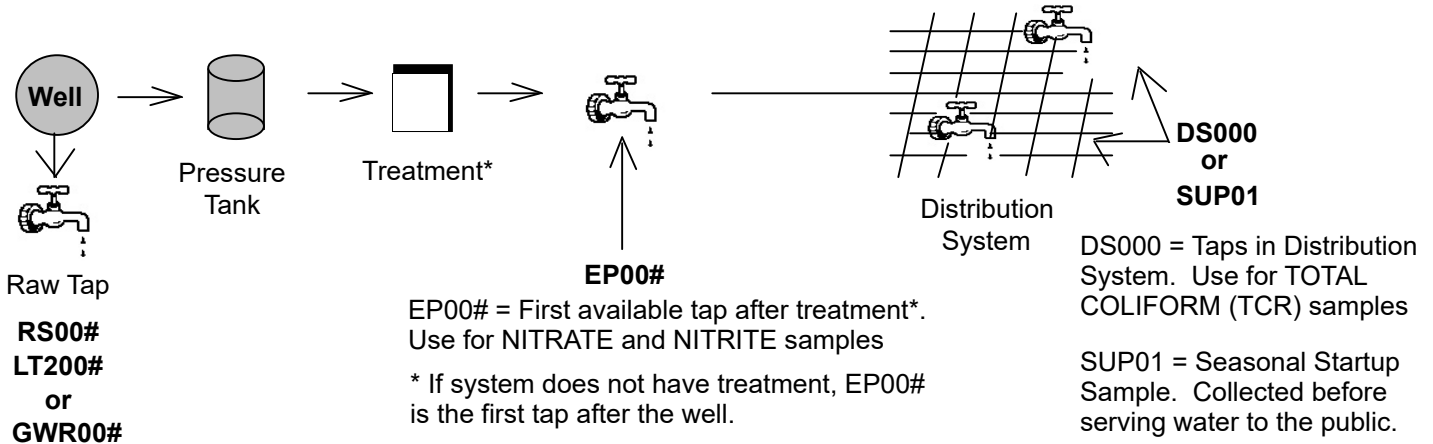

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH5942612 HIGHLAND PIZZA AND ICE CREAM PWS**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5962265 Facility Name: HIGHLAND PIZZA AND ICE CREAM**

**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017

**Where to Collect Samples For a Small Public Water System**

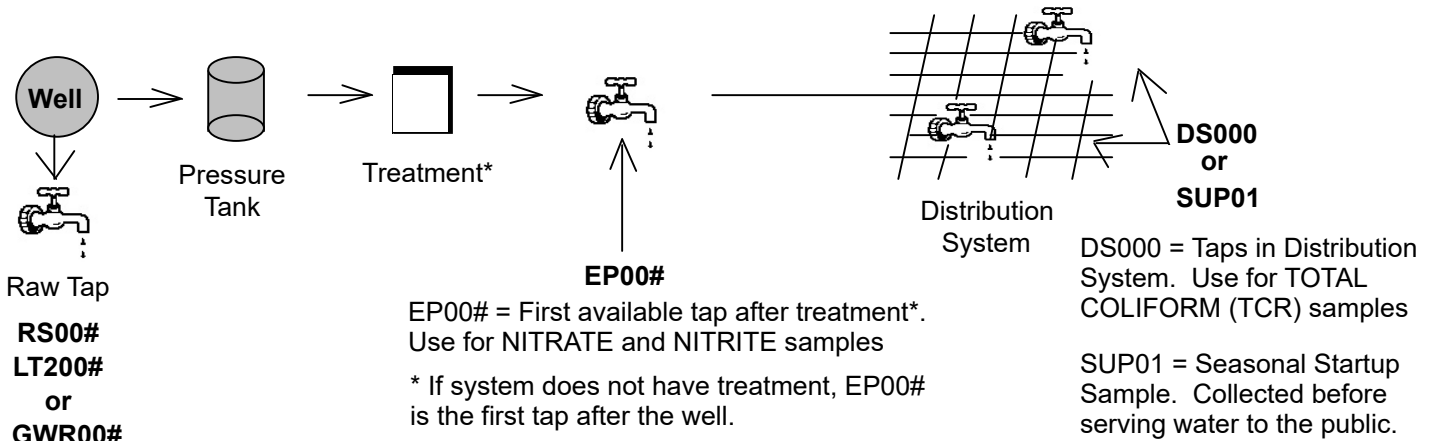

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH5942712 NORTHMOR SCHOOL PWS**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>5962375</b>	Facility Name: <b>NORTHMOR SCHOOL</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
ARSENIC - 1005	1 Sample(s) Required between 1/1/2017 and 3/31/2017 1 Sample(s) Required between 4/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 9/30/2017 1 Sample(s) Required between 10/1/2017 and 12/31/2017
INORGANICS	1 Sample(s) Required between 6/1/2017 and 10/31/2017
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTAL - 1015 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 6/1/2017 and 10/31/2017
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH5942712 NORTHMOR SCHOOL PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>NORTHMOR SCHOOL DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2017 and 9/30/2017

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Form 5105 with appendix must be submitted to Ohio EPA within ten days from the end of the month(s) in which samples are collected. Forms are available online at: http://epa.ohio.gov/ddagw/reporting.aspx. For questions contact your Ohio EPA District Office representative.

TOTAL COLIFORM (TCR) - 3100

2 Sample(s) Required between 1/1/2017 and 1/31/2017

2 Sample(s) Required between 2/1/2017 and 2/28/2017

2 Sample(s) Required between 3/1/2017 and 3/31/2017

2 Sample(s) Required between 4/1/2017 and 4/30/2017

2 Sample(s) Required between 5/1/2017 and 5/31/2017

2 Sample(s) Required between 6/1/2017 and 6/30/2017

2 Sample(s) Required between 7/1/2017 and 7/31/2017

2 Sample(s) Required between 8/1/2017 and 8/31/2017

2 Sample(s) Required between 9/1/2017 and 9/30/2017

2 Sample(s) Required between 10/1/2017 and 10/31/2017

2 Sample(s) Required between 11/1/2017 and 11/30/2017

2 Sample(s) Required between 12/1/2017 and 12/31/2017

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>NORTHMOR SCHOOL DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS

Dual Sample Required between 1/8/2017 and 1/14/2017at: DS201

Dual Sample Required between 4/8/2017 and 4/14/2017at: DS201

Dual Sample Required between 7/8/2017 and 7/14/2017at: DS201

Dual Sample Required between 10/8/2017 and 10/14/2017at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>NORTHMOR SCHOOL DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS

Dual Sample Required between 1/8/2017 and 1/14/2017at: DS202

Dual Sample Required between 4/8/2017 and 4/14/2017at: DS202

Dual Sample Required between 7/8/2017 and 7/14/2017at: DS202



Effective Date: 01/01/2017

2017 DISTRIBUTION SCHEDULE

**OH5942712 NORTHMOR SCHOOL PWS**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>NORTHMOR SCHOOL DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 10/8/2017 and 10/14/2017at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH5942713 CARDINGTON LINCOLN HIGH SCHOOL**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	------------------------------------	--------------------------------

**Chemicals Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2017 and 9/30/2017

*Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Form 5105 with appendix must be submitted to Ohio EPA within ten days from the end of the month(s) in which samples are collected. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>. For questions contact your Ohio EPA District Office representative.*

TOTAL COLIFORM (TCR) - 3100  
1 Sample(s) Required between 1/1/2017 and 3/31/2017  
1 Sample(s) Required between 4/1/2017 and 6/30/2017  
1 Sample(s) Required between 7/1/2017 and 9/30/2017  
1 Sample(s) Required between 10/1/2017 and 12/31/2017

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2017 and 9/30/2017at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2017 and 9/30/2017at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

**OH5942714 MID-OHIO SPORTS INFIELD PWS**

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**


**Sampling** Facility ID: **DS1** Facility Name: **DISTRIBUTION**  
**Location** SMP ID: **SUP01** Facility Source: **Ground Water**

**Chemicals Monitoring Requirements**

TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public
-----------------------------------	--

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**

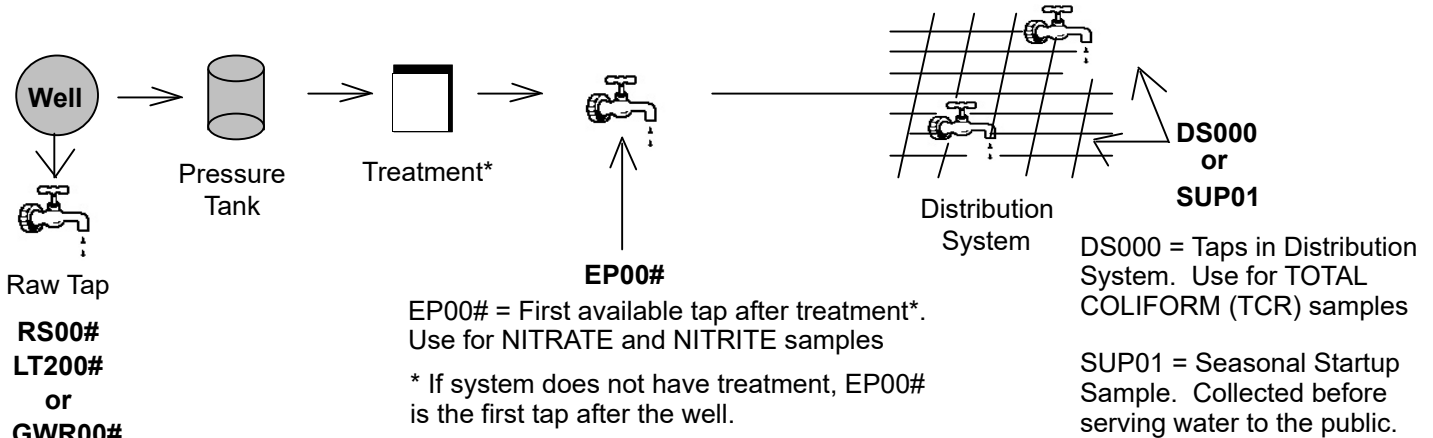

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5942714 MID-OHIO SPORTS INFIELD PWS**

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1 Facility Name: DISTRIBUTION**  
**Location SMP ID: DS000 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2017 and 6/30/2017 1 Sample(s) Required between 7/1/2017 and 9/30/2017

**Where to Collect Samples For a Small Public Water System**

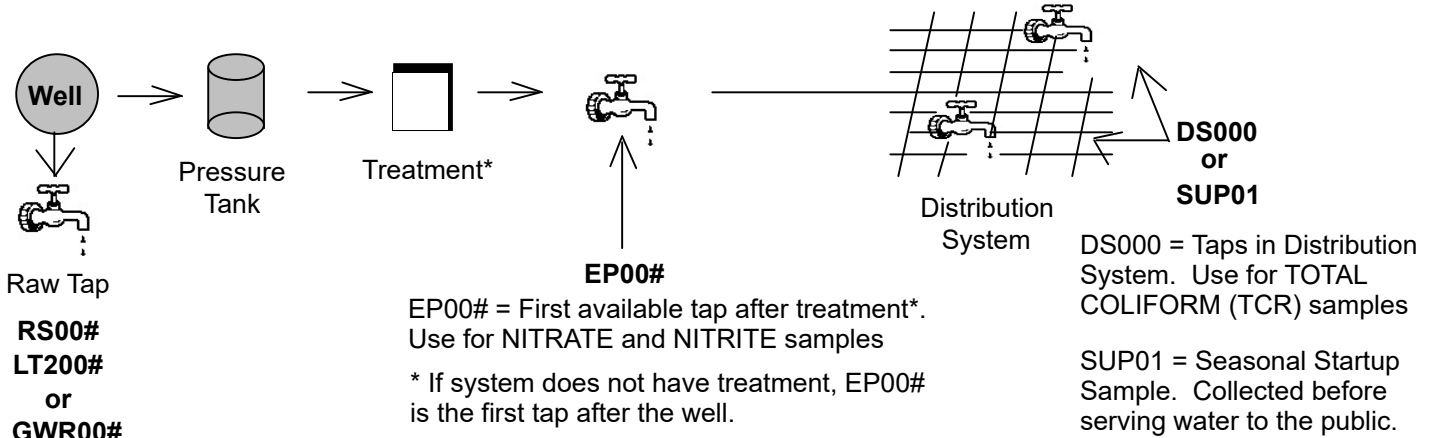

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH5942714 MID-OHIO SPORTS INFIELD PWS**

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 5962377 Facility Name: MID-OHIO SPORTS INFIELD**

**Location SMP ID: EP001 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2017 and 10/31/2017

**Where to Collect Samples For a Small Public Water System**

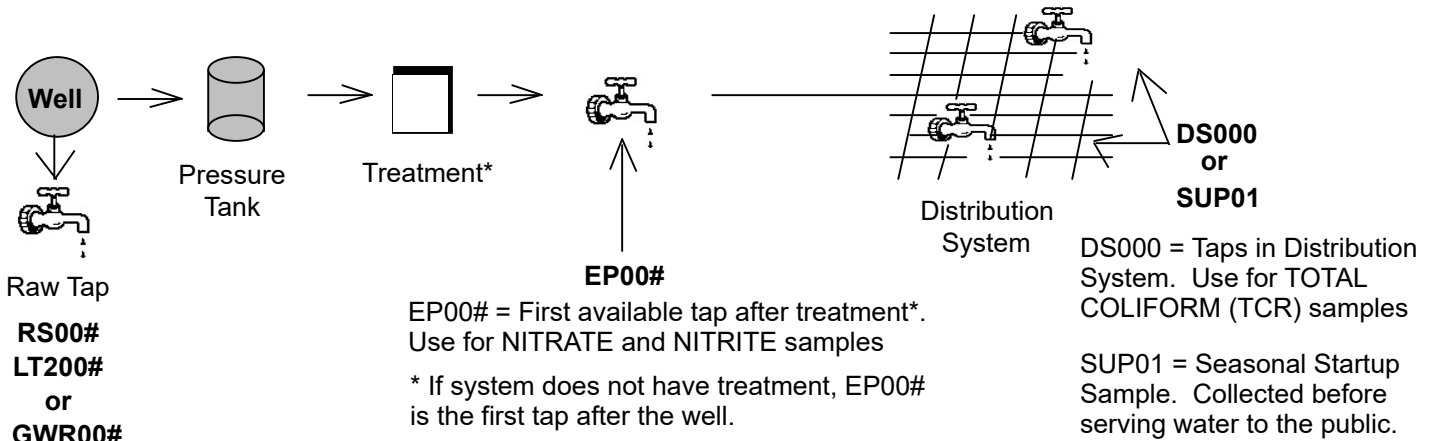

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**