

OH6200412 CATAWBA SHORES M H COURT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256887 Facility Name: CATAWBA SHORES MHP
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

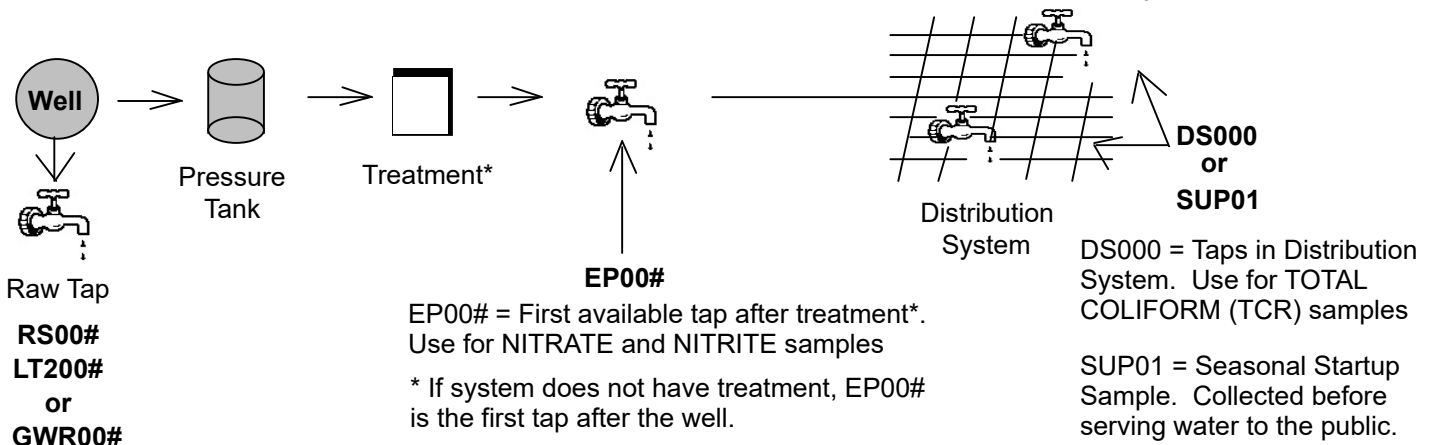

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH6200712 ELMORE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 6256889	Facility Name: ELMORE VILLAGE	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required

OH6200712 ELMORE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: ELMORE, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

ASBESTOS - 1094	Not Required
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2018 and 1/31/2018 2 Sample(s) Required between 2/1/2018 and 2/28/2018 2 Sample(s) Required between 3/1/2018 and 3/31/2018 2 Sample(s) Required between 4/1/2018 and 4/30/2018 2 Sample(s) Required between 5/1/2018 and 5/31/2018 2 Sample(s) Required between 6/1/2018 and 6/30/2018 2 Sample(s) Required between 7/1/2018 and 7/31/2018 2 Sample(s) Required between 8/1/2018 and 8/31/2018 2 Sample(s) Required between 9/1/2018 and 9/30/2018 2 Sample(s) Required between 10/1/2018 and 10/31/2018 2 Sample(s) Required between 11/1/2018 and 11/30/2018 2 Sample(s) Required between 12/1/2018 and 12/31/2018
TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2018 and 1/31/2018 2 Sample(s) Required between 2/1/2018 and 2/28/2018 2 Sample(s) Required between 3/1/2018 and 3/31/2018 2 Sample(s) Required between 4/1/2018 and 4/30/2018 2 Sample(s) Required between 5/1/2018 and 5/31/2018 2 Sample(s) Required between 6/1/2018 and 6/30/2018 2 Sample(s) Required between 7/1/2018 and 7/31/2018 2 Sample(s) Required between 8/1/2018 and 8/31/2018 2 Sample(s) Required between 9/1/2018 and 9/30/2018 2 Sample(s) Required between 10/1/2018 and 10/31/2018 2 Sample(s) Required between 11/1/2018 and 11/30/2018 2 Sample(s) Required between 12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: ELMORE, VILLAGE OF DISTRIBUTION 805 OHIO AVE	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH6200712 ELMORE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: ELMORE, VILLAGE OF DISTRIBUTION 633 STATE ST	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2018 and 9/30/2018at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: ELMORE, VILLAGE OF DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required



OH6201003 GENOA VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: GENOA, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	3 Sample(s) Required between	1/1/2018	and	1/31/2018
	3 Sample(s) Required between	2/1/2018	and	2/28/2018
	3 Sample(s) Required between	3/1/2018	and	3/31/2018
	3 Sample(s) Required between	4/1/2018	and	4/30/2018
	3 Sample(s) Required between	5/1/2018	and	5/31/2018
	3 Sample(s) Required between	6/1/2018	and	6/30/2018
	3 Sample(s) Required between	7/1/2018	and	7/31/2018
	3 Sample(s) Required between	8/1/2018	and	8/31/2018
	3 Sample(s) Required between	9/1/2018	and	9/30/2018
	3 Sample(s) Required between	10/1/2018	and	10/31/2018
	3 Sample(s) Required between	11/1/2018	and	11/30/2018
	3 Sample(s) Required between	12/1/2018	and	12/31/2018

TOTAL CHLORINE - 1000	3 Sample(s) Required between	1/1/2018	and	1/31/2018
	3 Sample(s) Required between	2/1/2018	and	2/28/2018
	3 Sample(s) Required between	3/1/2018	and	3/31/2018
	3 Sample(s) Required between	4/1/2018	and	4/30/2018
	3 Sample(s) Required between	5/1/2018	and	5/31/2018
	3 Sample(s) Required between	6/1/2018	and	6/30/2018
	3 Sample(s) Required between	7/1/2018	and	7/31/2018
	3 Sample(s) Required between	8/1/2018	and	8/31/2018
	3 Sample(s) Required between	9/1/2018	and	9/30/2018
	3 Sample(s) Required between	10/1/2018	and	10/31/2018
	3 Sample(s) Required between	11/1/2018	and	11/30/2018
	3 Sample(s) Required between	12/1/2018	and	12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: GENOA, VILLAGE OF DISTRIBUTION 3998 EDINBOURGH CT. GENOA	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS	Dual Sample Required between	2/8/2018	and	2/14/2018	at: DS201
	Dual Sample Required between	5/8/2018	and	5/14/2018	at: DS201
	Dual Sample Required between	8/8/2018	and	8/14/2018	at: DS201
	Dual Sample Required between	11/8/2018	and	11/14/2018	at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH6201003 GENOA VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: GENOA, VILLAGE OF DISTRIBUTION 22038 W. ST. RT. 579 WILLISTON	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/8/2018 and 2/14/2018at: DS202
	Dual Sample Required between 5/8/2018 and 5/14/2018at: DS202
	Dual Sample Required between 8/8/2018 and 8/14/2018at: DS202
	Dual Sample Required between 11/8/2018 and 11/14/2018at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: GENOA, VILLAGE OF DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	20 Sample(s) Required between 1/1/2018 and 6/30/2018
	20 Sample(s) Required between 7/1/2018 and 12/31/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH6201212 GREEN VALLEY MOBILE HOME PARK

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 6256894 SMP ID: EP001	Facility Name: GREEN VALLEY MHP Facility Source: Ground Water	Facility Class: CLASS A
--------------------------	---	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH6201212 GREEN VALLEY MOBILE HOME PARK

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: DS1 Facility Name: GREEN VALLEY MHP DISTRIBUTION SMP ID: DS000

Table with 2 columns: Chemicals and Monitoring Requirements. Lists monitoring schedules for TOTAL COLIFORM (TCR) - 3100 and TOTAL CHLORINE - 1000.

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: DS1 Facility Name: GREEN VALLEY MHP DISTRIBUTION SMP ID: DS201 LOT #29 (2.0)

Table with 2 columns: Chemicals and Monitoring Requirements. Lists monitoring schedule for DISINFECTION BYPRODUCTS.

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH6201312 GREENWOOD MOBILE HOME PK

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 6256895 SMP ID: EP001	Facility Name: GREENWOOD MHP Facility Source: Ground Water	Facility Class: CLASS A
--------------------------	---	---	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required

OH6201312 GREENWOOD MOBILE HOME PK

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: GREENWOOD MOBILE HOME PK DISTRIBUTIC
	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: GREENWOOD MOBILE HOME PK DISTRIBUTIC
	SMP ID: DS201	ADDRESS NOT KNOWN

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 05/25/2018

2018 DISTRIBUTION SCHEDULE

OH6201312 GREENWOOD MOBILE HOME PK

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: GREENWOOD MOBILE HOME PK DISTRIBUTIC
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH6201911 LAKE ERIE UTILITIES COMP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: LAKE ERIE UTILITIES COMP DISTRIBUTION
Location SMP ID: DS000	Facility Source: Surface Water
	Facility Class: CLASS 1

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	4 Sample(s) Required between 1/1/2018 and 1/31/2018
	4 Sample(s) Required between 2/1/2018 and 2/28/2018
	4 Sample(s) Required between 3/1/2018 and 3/31/2018
	4 Sample(s) Required between 4/1/2018 and 4/30/2018
	4 Sample(s) Required between 5/1/2018 and 5/31/2018
	4 Sample(s) Required between 6/1/2018 and 6/30/2018
	4 Sample(s) Required between 7/1/2018 and 7/31/2018
	4 Sample(s) Required between 8/1/2018 and 8/31/2018
	4 Sample(s) Required between 9/1/2018 and 9/30/2018
	4 Sample(s) Required between 10/1/2018 and 10/31/2018
	4 Sample(s) Required between 11/1/2018 and 11/30/2018
	4 Sample(s) Required between 12/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

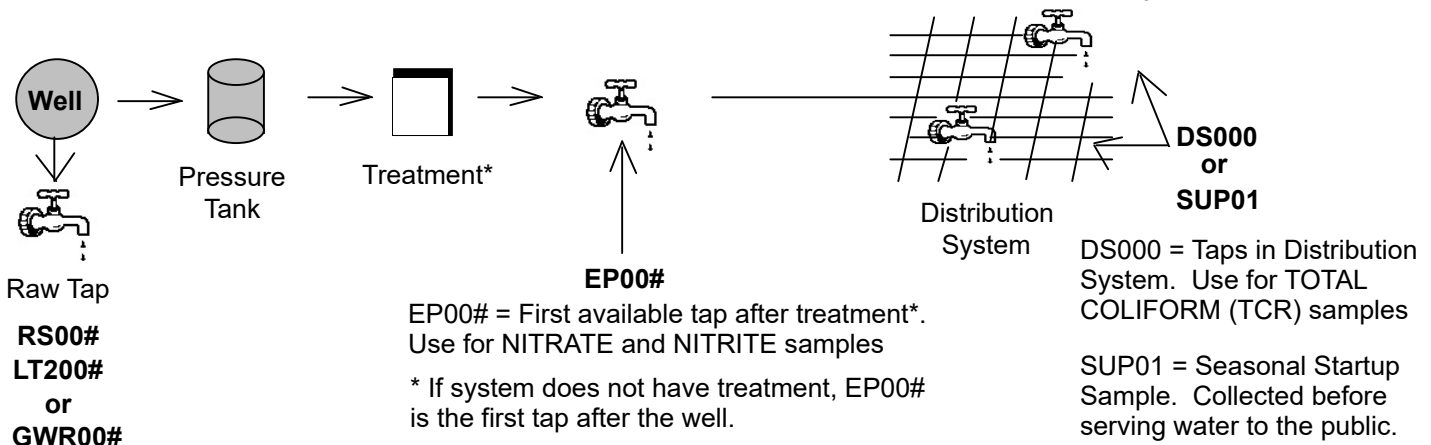

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH6201911 LAKE ERIE UTILITIES COMP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6262096	Facility Name: LAKE ERIE UTILITIES CO 2
Location SMP ID: LT2001	Facility Source: Surface Water
	Facility Class: CLASS 3

Chemicals	Monitoring Requirements
CYANOBACTERIA SCREENING	1 Sample(s) Required between 12/31/2017 and 1/6/2018
	1 Sample(s) Required between 1/14/2018 and 1/20/2018
	1 Sample(s) Required between 1/28/2018 and 2/3/2018
	1 Sample(s) Required between 2/11/2018 and 2/17/2018
	1 Sample(s) Required between 2/25/2018 and 3/3/2018
	1 Sample(s) Required between 3/11/2018 and 3/17/2018
	1 Sample(s) Required between 3/25/2018 and 3/31/2018
	1 Sample(s) Required between 4/8/2018 and 4/14/2018
	1 Sample(s) Required between 4/22/2018 and 4/28/2018
	1 Sample(s) Required between 5/6/2018 and 5/12/2018
	1 Sample(s) Required between 5/20/2018 and 5/26/2018
	1 Sample(s) Required between 6/3/2018 and 6/9/2018
	1 Sample(s) Required between 6/17/2018 and 6/23/2018
	1 Sample(s) Required between 7/1/2018 and 7/7/2018
	1 Sample(s) Required between 7/15/2018 and 7/21/2018
	1 Sample(s) Required between 7/29/2018 and 8/4/2018
	1 Sample(s) Required between 8/12/2018 and 8/18/2018
	1 Sample(s) Required between 8/26/2018 and 9/1/2018
	1 Sample(s) Required between 9/9/2018 and 9/15/2018
	1 Sample(s) Required between 9/23/2018 and 9/29/2018
1 Sample(s) Required between 10/7/2018 and 10/13/2018	
1 Sample(s) Required between 10/21/2018 and 10/27/2018	
1 Sample(s) Required between 11/4/2018 and 11/10/2018	
1 Sample(s) Required between 11/18/2018 and 11/24/2018	
1 Sample(s) Required between 12/2/2018 and 12/8/2018	

OH6201911 LAKE ERIE UTILITIES COMP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6262096	Facility Name: LAKE ERIE UTILITIES CO 2
Location SMP ID: LT2001	Facility Source: Surface Water
Facility Class: CLASS 3	

Chemicals	Monitoring Requirements
CYANOBACTERIA SCREENING	1 Sample(s) Required between 12/16/2018 and 12/22/2018

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 and must be collected at the same time as the raw total microcystins sample. SAMPLES MUST BE SHIPPED OVERNIGHT ON ICE ON THE DAY OF COLLECTION AND ARRIVE AT OHIO EPA DIVISION OF ENVIRONMENTAL SERVICES (DES) BY NOON MONDAY THROUGH THURSDAY ONLY! If lab capacity is found to be adequate, cyanobacteria screening samples will no longer be analyzed, free of charge, by Ohio EPA DES beginning June 1, 2017.

Where to Collect Samples For a Small Public Water System

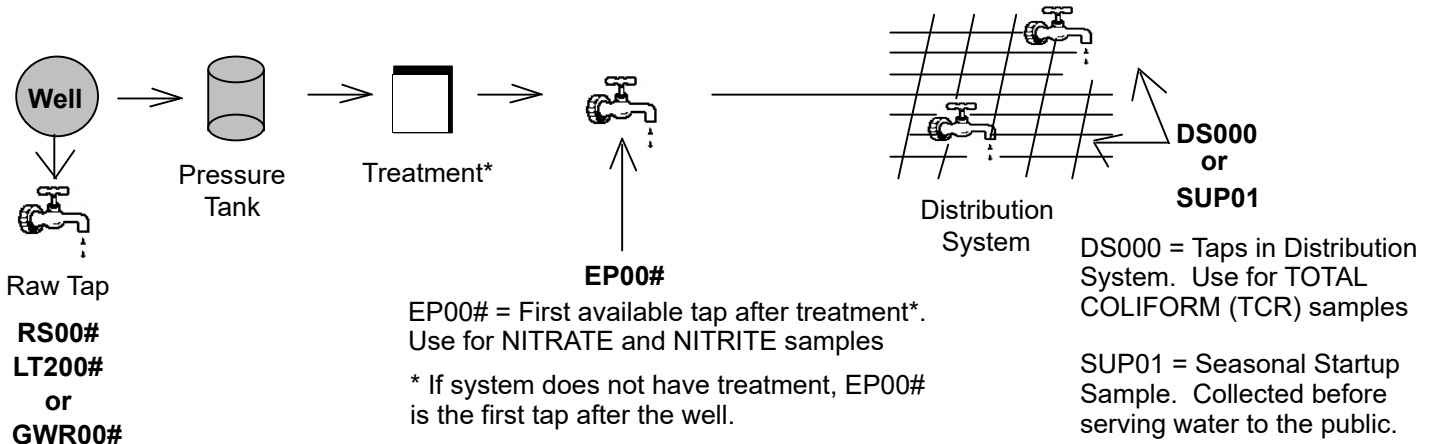

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6201911 LAKE ERIE UTILITIES COMP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6262096	Facility Name: LAKE ERIE UTILITIES CO 2	
Location SMP ID: EP002/LT200	Facility Source: Surface Water	Facility Class: CLASS 3


Chemicals	Monitoring Requirements
-----------	-------------------------

TOTAL MICROCYSTINS	1 Sample Set Required WEEKLY*
--------------------	-------------------------------

Total microcystins sample set refers to one raw source water sample at LT200# and one finished water sample at EP00#. A week is defined as Sunday through Saturday.

*Weekly sampling unless requirements for seasonal reduced monitoring are met (November through April). Biweekly raw seasonal reduced monitoring must be conducted at the same time as cyanobacteria screening sample. Any microcystins detection during seasonal reduced monitoring triggers collection of raw and finished samples within 24 hours and a return to weekly monitoring at both raw and finished sample points. For questions about seasonal reduced monitoring please contact your Ohio EPA District Office HAB Coordinator.

Where to Collect Samples For a Small Public Water System

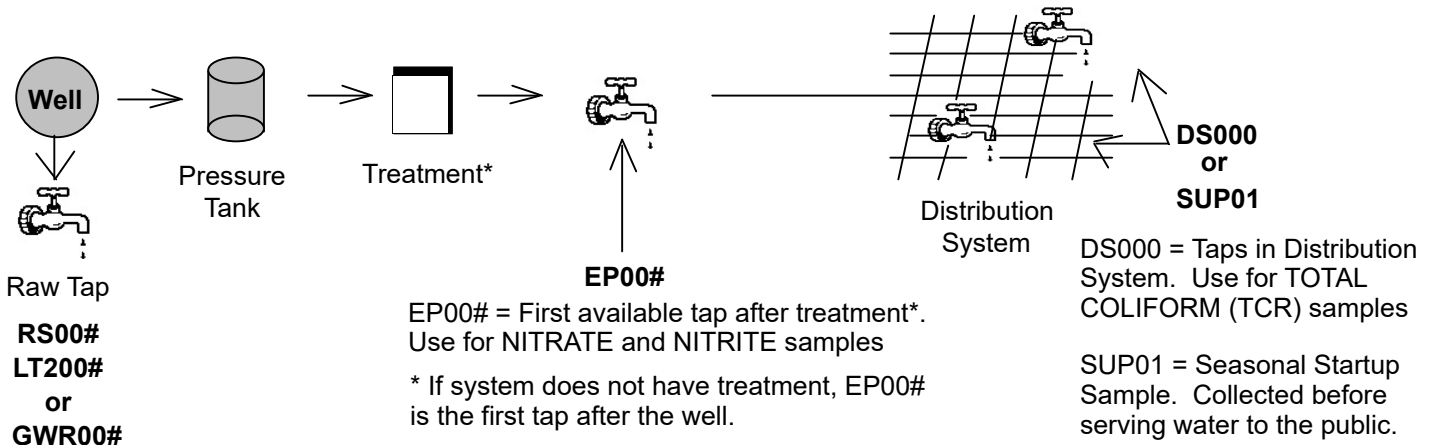

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH6201911 LAKE ERIE UTILITIES COMP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6262096	Facility Name: LAKE ERIE UTILITIES CO 2
Location SMP ID: EP002	Facility Source: Surface Water Facility Class: CLASS 3

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 1/31/2018 1 Sample(s) Required between 2/1/2018 and 2/28/2018 1 Sample(s) Required between 3/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 4/30/2018 1 Sample(s) Required between 5/1/2018 and 5/31/2018 1 Sample(s) Required between 6/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 7/31/2018 1 Sample(s) Required between 8/1/2018 and 8/31/2018 1 Sample(s) Required between 9/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 10/31/2018 1 Sample(s) Required between 11/1/2018 and 11/30/2018

OH6201911 LAKE ERIE UTILITIES COMP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6262096	Facility Name: LAKE ERIE UTILITIES CO 2
Location SMP ID: EP002	Facility Source: Surface Water
Facility Class: CLASS 3	

Chemicals	Monitoring Requirements
NITRATE - 1040	1 Sample(s) Required between 12/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

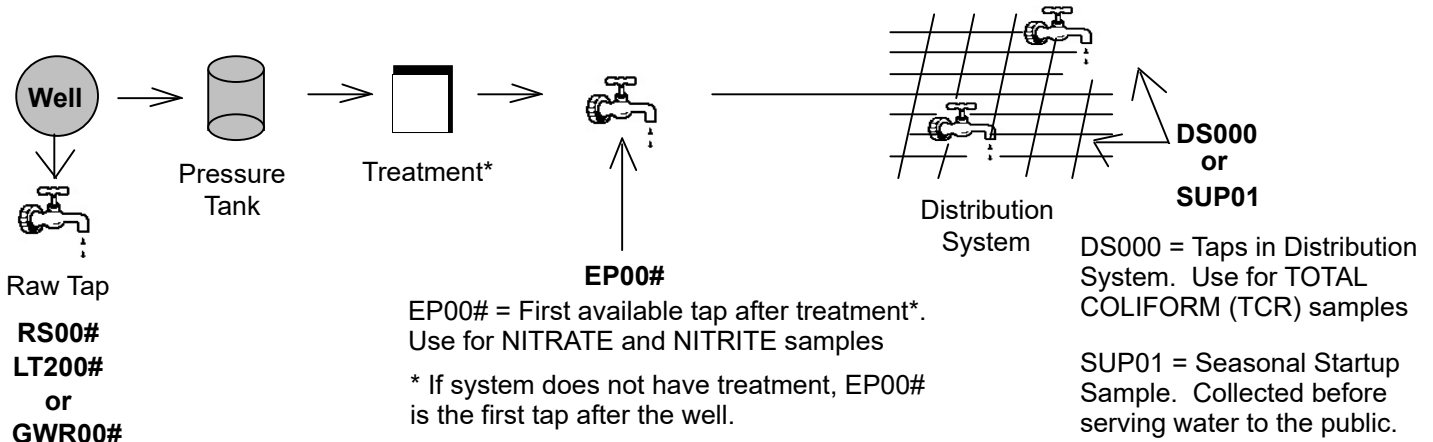

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH6202411 MARBLEHEAD VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 6256904 SMP ID: EP001	Facility Name: MARBLEHEAD VILLAGE Facility Source: Surface Water	Facility Class: CLASS 3
--------------------------	---	---	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 1/31/2018 1 Sample(s) Required between 2/1/2018 and 2/28/2018 1 Sample(s) Required between 3/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 4/30/2018 1 Sample(s) Required between 5/1/2018 and 5/31/2018 1 Sample(s) Required between 6/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 7/31/2018 1 Sample(s) Required between 8/1/2018 and 8/31/2018 1 Sample(s) Required between 9/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 10/31/2018 1 Sample(s) Required between 11/1/2018 and 11/30/2018 1 Sample(s) Required between 12/1/2018 and 12/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2018 and 6/30/2018
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2018 and 10/31/2018
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 1/1/2018 and 1/31/2018 1 Paired Sample Set Required between 2/1/2018 and 2/28/2018 1 Paired Sample Set Required between 3/1/2018 and 3/31/2018 1 Paired Sample Set Required between 4/1/2018 and 4/30/2018 1 Paired Sample Set Required between 5/1/2018 and 5/31/2018 1 Paired Sample Set Required between 6/1/2018 and 6/30/2018 1 Paired Sample Set Required between 7/1/2018 and 7/31/2018 1 Paired Sample Set Required between 8/1/2018 and 8/31/2018 1 Paired Sample Set Required between 9/1/2018 and 9/30/2018 1 Paired Sample Set Required between 10/1/2018 and 10/31/2018 1 Paired Sample Set Required between 11/1/2018 and 11/30/2018 1 Paired Sample Set Required between 12/1/2018 and 12/31/2018

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH6202411 MARBLEHEAD VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 6256904	Facility Name: MARBLEHEAD VILLAGE	
Location	SMP ID: EP001/LT2001	Facility Source: Surface Water	Facility Class: CLASS 3

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

Chemicals

Monitoring Requirements

TOTAL MICROCYSTINS

1 Sample Set Required WEEKLY*

Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. A week is defined as Sunday through Saturday.

**Weekly sampling unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. Reduced monitoring is contingent on a public water system continuing to experience NO raw or finished water total microcystins detections. Any total microcystins detections during routine (weekly) or reduced sampling will trigger additional sampling. Please refer to the website above for specifics on follow-up sampling requirements.*



OH6202411 MARBLEHEAD VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 6256904	Facility Name: MARBLEHEAD VILLAGE	
Location	SMP ID: LT2001	Facility Source: Surface Water	Facility Class: CLASS 3

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
CYANOBACTERIA SCREENING	1 Sample(s) Required between 12/31/2017 and 1/6/2018
	1 Sample(s) Required between 1/14/2018 and 1/20/2018
	1 Sample(s) Required between 1/28/2018 and 2/3/2018
	1 Sample(s) Required between 2/11/2018 and 2/17/2018
	1 Sample(s) Required between 2/25/2018 and 3/3/2018
	1 Sample(s) Required between 3/11/2018 and 3/17/2018
	1 Sample(s) Required between 3/25/2018 and 3/31/2018
	1 Sample(s) Required between 4/8/2018 and 4/14/2018
	1 Sample(s) Required between 4/22/2018 and 4/28/2018
	1 Sample(s) Required between 5/6/2018 and 5/12/2018
	1 Sample(s) Required between 5/20/2018 and 5/26/2018
	1 Sample(s) Required between 6/3/2018 and 6/9/2018
	1 Sample(s) Required between 6/17/2018 and 6/23/2018
	1 Sample(s) Required between 7/1/2018 and 7/7/2018
	1 Sample(s) Required between 7/15/2018 and 7/21/2018
	1 Sample(s) Required between 7/29/2018 and 8/4/2018
	1 Sample(s) Required between 8/12/2018 and 8/18/2018
	1 Sample(s) Required between 8/26/2018 and 9/1/2018
	1 Sample(s) Required between 9/9/2018 and 9/15/2018
	1 Sample(s) Required between 9/23/2018 and 9/29/2018
1 Sample(s) Required between 10/7/2018 and 10/13/2018	
1 Sample(s) Required between 10/21/2018 and 10/27/2018	
1 Sample(s) Required between 11/4/2018 and 11/10/2018	
1 Sample(s) Required between 11/18/2018 and 11/24/2018	
1 Sample(s) Required between 12/2/2018 and 12/8/2018	
1 Sample(s) Required between 12/16/2018 and 12/22/2018	

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. As of 12/31/17, all public water systems are responsible for contracting with a lab certified to perform cyanobacteria screening (qPCR). Please review the website for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections, and certified labs that can perform analysis.

OH6202411 MARBLEHEAD VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: MARBLEHEAD VILLAGE DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	4 Sample(s) Required between 1/1/2018 and 1/31/2018
	4 Sample(s) Required between 2/1/2018 and 2/28/2018
	4 Sample(s) Required between 3/1/2018 and 3/31/2018
	4 Sample(s) Required between 4/1/2018 and 4/30/2018
	4 Sample(s) Required between 5/1/2018 and 5/31/2018
	4 Sample(s) Required between 6/1/2018 and 6/30/2018
	4 Sample(s) Required between 7/1/2018 and 7/31/2018
	4 Sample(s) Required between 8/1/2018 and 8/31/2018
	4 Sample(s) Required between 9/1/2018 and 9/30/2018
	4 Sample(s) Required between 10/1/2018 and 10/31/2018
	4 Sample(s) Required between 11/1/2018 and 11/30/2018
	4 Sample(s) Required between 12/1/2018 and 12/31/2018
TOTAL CHLORINE - 1000	4 Sample(s) Required between 1/1/2018 and 1/31/2018
	4 Sample(s) Required between 2/1/2018 and 2/28/2018
	4 Sample(s) Required between 3/1/2018 and 3/31/2018
	4 Sample(s) Required between 4/1/2018 and 4/30/2018
	4 Sample(s) Required between 5/1/2018 and 5/31/2018
	4 Sample(s) Required between 6/1/2018 and 6/30/2018
	4 Sample(s) Required between 7/1/2018 and 7/31/2018
	4 Sample(s) Required between 8/1/2018 and 8/31/2018
	4 Sample(s) Required between 9/1/2018 and 9/30/2018
	4 Sample(s) Required between 10/1/2018 and 10/31/2018
	4 Sample(s) Required between 11/1/2018 and 11/30/2018
	4 Sample(s) Required between 12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: MARBLEHEAD VILLAGE DISTRIBUTION 10269 E BAYSHORE RD	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2018 and 2/7/2018at: DS201
	Dual Sample Required between 5/1/2018 and 5/7/2018at: DS201
	Dual Sample Required between 8/1/2018 and 8/7/2018at: DS201
	Dual Sample Required between 11/1/2018 and 11/7/2018at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH6202411 MARBLEHEAD VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: MARBLEHEAD VILLAGE DISTRIBUTION 113 LAKE BREEZE CIRCLE	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2018 and 2/7/2018at: DS202 Dual Sample Required between 5/1/2018 and 5/7/2018at: DS202 Dual Sample Required between 8/1/2018 and 8/7/2018at: DS202 Dual Sample Required between 11/1/2018 and 11/7/2018at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: MARBLEHEAD VILLAGE DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH6202603 OAK HARBOR VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: OAK HARBOR VILLAGE DISTRIBUTION SYSTE Facility Class: CLASS 1
Location SMP ID: DS000

Chemicals Monitoring Requirements

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100 5 Sample(s) Required between 1/1/2018 and 1/31/2018
5 Sample(s) Required between 2/1/2018 and 2/28/2018
5 Sample(s) Required between 3/1/2018 and 3/31/2018
5 Sample(s) Required between 4/1/2018 and 4/30/2018
5 Sample(s) Required between 5/1/2018 and 5/31/2018
5 Sample(s) Required between 6/1/2018 and 6/30/2018
5 Sample(s) Required between 7/1/2018 and 7/31/2018
5 Sample(s) Required between 8/1/2018 and 8/31/2018
5 Sample(s) Required between 9/1/2018 and 9/30/2018
5 Sample(s) Required between 10/1/2018 and 10/31/2018
5 Sample(s) Required between 11/1/2018 and 11/30/2018
5 Sample(s) Required between 12/1/2018 and 12/31/2018

TOTAL CHLORINE - 1000 5 Sample(s) Required between 1/1/2018 and 1/31/2018
5 Sample(s) Required between 2/1/2018 and 2/28/2018
5 Sample(s) Required between 3/1/2018 and 3/31/2018
5 Sample(s) Required between 4/1/2018 and 4/30/2018
5 Sample(s) Required between 5/1/2018 and 5/31/2018
5 Sample(s) Required between 6/1/2018 and 6/30/2018
5 Sample(s) Required between 7/1/2018 and 7/31/2018
5 Sample(s) Required between 8/1/2018 and 8/31/2018
5 Sample(s) Required between 9/1/2018 and 9/30/2018
5 Sample(s) Required between 10/1/2018 and 10/31/2018
5 Sample(s) Required between 11/1/2018 and 11/30/2018
5 Sample(s) Required between 12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Facility ID: DS1 Facility Name: OAK HARBOR VILLAGE DISTRIBUTION SYSTE Facility Class: CLASS 1
Location SMP ID: DS201 9735 W. SR 163

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 1/1/2018 and 1/7/2018at: DS201
Dual Sample Required between 4/1/2018 and 4/7/2018at: DS201
Dual Sample Required between 7/1/2018 and 7/7/2018at: DS201
Dual Sample Required between 10/1/2018 and 10/7/2018at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



OH6202603 OAK HARBOR VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: OAK HARBOR VILLAGE DISTRIBUTION SYSTE 601 N. BENTON ST.	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 1/1/2018 and 1/7/2018at: DS202
	Dual Sample Required between 4/1/2018 and 4/7/2018at: DS202
	Dual Sample Required between 7/1/2018 and 7/7/2018at: DS202
	Dual Sample Required between 10/1/2018 and 10/7/2018at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: OAK HARBOR VILLAGE DISTRIBUTION SYSTE Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	20 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH6203211 PORT CLINTON CITY

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: PORT CLINTON CITY DISTRIBUTION SYSTEM	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100	7 Sample(s) Required between	1/1/2018	and	1/31/2018
	7 Sample(s) Required between	2/1/2018	and	2/28/2018
	7 Sample(s) Required between	3/1/2018	and	3/31/2018
	7 Sample(s) Required between	4/1/2018	and	4/30/2018
	7 Sample(s) Required between	5/1/2018	and	5/31/2018
	7 Sample(s) Required between	6/1/2018	and	6/30/2018
	7 Sample(s) Required between	7/1/2018	and	7/31/2018
	7 Sample(s) Required between	8/1/2018	and	8/31/2018
	7 Sample(s) Required between	9/1/2018	and	9/30/2018
	7 Sample(s) Required between	10/1/2018	and	10/31/2018
	7 Sample(s) Required between	11/1/2018	and	11/30/2018
	7 Sample(s) Required between	12/1/2018	and	12/31/2018

TOTAL CHLORINE - 1000	7 Sample(s) Required between	1/1/2018	and	1/31/2018
	7 Sample(s) Required between	2/1/2018	and	2/28/2018
	7 Sample(s) Required between	3/1/2018	and	3/31/2018
	7 Sample(s) Required between	4/1/2018	and	4/30/2018
	7 Sample(s) Required between	5/1/2018	and	5/31/2018
	7 Sample(s) Required between	6/1/2018	and	6/30/2018
	7 Sample(s) Required between	7/1/2018	and	7/31/2018
	7 Sample(s) Required between	8/1/2018	and	8/31/2018
	7 Sample(s) Required between	9/1/2018	and	9/30/2018
	7 Sample(s) Required between	10/1/2018	and	10/31/2018
	7 Sample(s) Required between	11/1/2018	and	11/30/2018
	7 Sample(s) Required between	12/1/2018	and	12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: PORT CLINTON CITY DISTRIBUTION SYSTEM 1868 EAST PERRY ST	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS	Dual Sample Required between	2/1/2018	and	2/7/2018	at: DS201
	Dual Sample Required between	5/1/2018	and	5/7/2018	at: DS201
	Dual Sample Required between	8/1/2018	and	8/7/2018	at: DS201
	Dual Sample Required between	11/1/2018	and	11/7/2018	at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH6203211 PORT CLINTON CITY

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: PORT CLINTON CITY DISTRIBUTION SYSTEM 716 W THIRD ST	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2018 and 2/7/2018at: DS202
	Dual Sample Required between 5/1/2018 and 5/7/2018at: DS202
	Dual Sample Required between 8/1/2018 and 8/7/2018at: DS202
	Dual Sample Required between 11/1/2018 and 11/7/2018at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: PORT CLINTON CITY DISTRIBUTION SYSTEM Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	20 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH6203311 PUT-IN-BAY VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 6256913	Facility Name: PUT-IN-BAY VILLAGE	Facility Class: CLASS 3
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020	
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 1/31/2018 1 Sample(s) Required between 2/1/2018 and 2/28/2018 1 Sample(s) Required between 3/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 4/30/2018 1 Sample(s) Required between 5/1/2018 and 5/31/2018 1 Sample(s) Required between 6/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 7/31/2018 1 Sample(s) Required between 8/1/2018 and 8/31/2018 1 Sample(s) Required between 9/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 10/31/2018 1 Sample(s) Required between 11/1/2018 and 11/30/2018 1 Sample(s) Required between 12/1/2018 and 12/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2018 and 6/30/2018
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2018 and 10/31/2018



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH6203311 PUT-IN-BAY VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 6256913	Facility Name: PUT-IN-BAY VILLAGE	
Location	SMP ID: EP001/LT2001	Facility Source: Surface Water	Facility Class: CLASS 3

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

Chemicals

Monitoring Requirements

TOTAL MICROCYSTINS

1 Sample Set Required WEEKLY*

Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. A week is defined as Sunday through Saturday.

**Weekly sampling unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. Reduced monitoring is contingent on a public water system continuing to experience NO raw or finished water total microcystins detections. Any total microcystins detections during routine (weekly) or reduced sampling will trigger additional sampling. Please refer to the website above for specifics on follow-up sampling requirements.*



OH6203311 PUT-IN-BAY VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 6256913	Facility Name: PUT-IN-BAY VILLAGE	
Location	SMP ID: LT2001	Facility Source: Surface Water	Facility Class: CLASS 3

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
CYANOBACTERIA SCREENING	1 Sample(s) Required between 12/31/2017 and 1/6/2018
	1 Sample(s) Required between 1/14/2018 and 1/20/2018
	1 Sample(s) Required between 1/28/2018 and 2/3/2018
	1 Sample(s) Required between 2/11/2018 and 2/17/2018
	1 Sample(s) Required between 2/25/2018 and 3/3/2018
	1 Sample(s) Required between 3/11/2018 and 3/17/2018
	1 Sample(s) Required between 3/25/2018 and 3/31/2018
	1 Sample(s) Required between 4/8/2018 and 4/14/2018
	1 Sample(s) Required between 4/22/2018 and 4/28/2018
	1 Sample(s) Required between 5/6/2018 and 5/12/2018
	1 Sample(s) Required between 5/20/2018 and 5/26/2018
	1 Sample(s) Required between 6/3/2018 and 6/9/2018
	1 Sample(s) Required between 6/17/2018 and 6/23/2018
	1 Sample(s) Required between 7/1/2018 and 7/7/2018
	1 Sample(s) Required between 7/15/2018 and 7/21/2018
	1 Sample(s) Required between 7/29/2018 and 8/4/2018
	1 Sample(s) Required between 8/12/2018 and 8/18/2018
	1 Sample(s) Required between 8/26/2018 and 9/1/2018
	1 Sample(s) Required between 9/9/2018 and 9/15/2018
	1 Sample(s) Required between 9/23/2018 and 9/29/2018
1 Sample(s) Required between 10/7/2018 and 10/13/2018	
1 Sample(s) Required between 10/21/2018 and 10/27/2018	
1 Sample(s) Required between 11/4/2018 and 11/10/2018	
1 Sample(s) Required between 11/18/2018 and 11/24/2018	
1 Sample(s) Required between 12/2/2018 and 12/8/2018	
1 Sample(s) Required between 12/16/2018 and 12/22/2018	

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. As of 12/31/17, all public water systems are responsible for contracting with a lab certified to perform cyanobacteria screening (qPCR). Please review the website for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections, and certified labs that can perform analysis.

OH6203311 PUT-IN-BAY VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: PUT-IN-BAY VILLAGE DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

TOTAL COLIFORM (TCR) - 3100	4 Sample(s) Required between 1/1/2018 and 1/31/2018
	4 Sample(s) Required between 2/1/2018 and 2/28/2018
	4 Sample(s) Required between 3/1/2018 and 3/31/2018
	4 Sample(s) Required between 4/1/2018 and 4/30/2018
	6 Sample(s) Required between 5/1/2018 and 5/31/2018
	6 Sample(s) Required between 6/1/2018 and 6/30/2018
	6 Sample(s) Required between 7/1/2018 and 7/31/2018
	6 Sample(s) Required between 8/1/2018 and 8/31/2018
	6 Sample(s) Required between 9/1/2018 and 9/30/2018
	4 Sample(s) Required between 10/1/2018 and 10/31/2018
	4 Sample(s) Required between 11/1/2018 and 11/30/2018
	4 Sample(s) Required between 12/1/2018 and 12/31/2018

TOTAL CHLORINE - 1000	4 Sample(s) Required between 1/1/2018 and 1/31/2018
	4 Sample(s) Required between 2/1/2018 and 2/28/2018
	4 Sample(s) Required between 3/1/2018 and 3/31/2018
	4 Sample(s) Required between 4/1/2018 and 4/30/2018
	6 Sample(s) Required between 5/1/2018 and 5/31/2018
	6 Sample(s) Required between 6/1/2018 and 6/30/2018
	6 Sample(s) Required between 7/1/2018 and 7/31/2018
	6 Sample(s) Required between 8/1/2018 and 8/31/2018
	6 Sample(s) Required between 9/1/2018 and 9/30/2018
	4 Sample(s) Required between 10/1/2018 and 10/31/2018
	4 Sample(s) Required between 11/1/2018 and 11/30/2018
	4 Sample(s) Required between 12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: PUT-IN-BAY VILLAGE DISTRIBUTION 70 PARK	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 3/1/2018 and 3/7/2018at: DS201
	Dual Sample Required between 6/1/2018 and 6/7/2018at: DS201
	Dual Sample Required between 9/1/2018 and 9/7/2018at: DS201
	Dual Sample Required between 12/1/2018 and 12/7/2018at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH6203311 PUT-IN-BAY VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: PUT-IN-BAY VILLAGE DISTRIBUTION 1550 PIB ROAD	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 3/1/2018 and 3/7/2018at: DS202
	Dual Sample Required between 6/1/2018 and 6/7/2018at: DS202
	Dual Sample Required between 9/1/2018 and 9/7/2018at: DS202
	Dual Sample Required between 12/1/2018 and 12/7/2018at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: PUT-IN-BAY VILLAGE DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH6204112 CEDAR CREEK ESTATES

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 6256919	Facility Name: CEDAR CREEK ESTATES TP	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
ARSENIC - 1005	1 Sample(s) Required between 1/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 12/31/2018
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH6204112 CEDAR CREEK ESTATES

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: CEDAR CREEK ESTATES DISTRIBUTION
	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

Sampling Location	Facility ID: DS1	Facility Name: CEDAR CREEK ESTATES DISTRIBUTION
	SMP ID: DS201	ADDRESS NOT KNOWN

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1	Facility Name: CEDAR CREEK ESTATES DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH6205011 OTTAWA COUNTY REGIONAL WATER DISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 6256925 SMP ID: EP001	Facility Name: OTTAWA COUNTY REGIONAL WATER DISTRICT Facility Source: Surface Water	Facility Class: CLASS 4
--------------------------	---	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 1/31/2018 1 Sample(s) Required between 2/1/2018 and 2/28/2018 1 Sample(s) Required between 3/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 4/30/2018 1 Sample(s) Required between 5/1/2018 and 5/31/2018 1 Sample(s) Required between 6/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 7/31/2018 1 Sample(s) Required between 8/1/2018 and 8/31/2018 1 Sample(s) Required between 9/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 10/31/2018 1 Sample(s) Required between 11/1/2018 and 11/30/2018 1 Sample(s) Required between 12/1/2018 and 12/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2018 and 6/30/2018
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 4/1/2018 and 6/30/2018
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 1/1/2018 and 1/31/2018 1 Paired Sample Set Required between 2/1/2018 and 2/28/2018 1 Paired Sample Set Required between 3/1/2018 and 3/31/2018 1 Paired Sample Set Required between 4/1/2018 and 4/30/2018 1 Paired Sample Set Required between 5/1/2018 and 5/31/2018 1 Paired Sample Set Required between 6/1/2018 and 6/30/2018 1 Paired Sample Set Required between 7/1/2018 and 7/31/2018 1 Paired Sample Set Required between 8/1/2018 and 8/31/2018 1 Paired Sample Set Required between 9/1/2018 and 9/30/2018 1 Paired Sample Set Required between 10/1/2018 and 10/31/2018 1 Paired Sample Set Required between 11/1/2018 and 11/30/2018 1 Paired Sample Set Required between 12/1/2018 and 12/31/2018

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH6205011 OTTAWA COUNTY REGIONAL WATER DISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 6256925	Facility Name: OTTAWA COUNTY REGIONAL WATER DISTRICT
Location	SMP ID: EP001/LT2001	Facility Source: Surface Water Facility Class: CLASS 4

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

Chemicals	Monitoring Requirements
------------------	--------------------------------

TOTAL MICROCYSTINS	1 Sample Set Required WEEKLY*
--------------------	-------------------------------

Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. A week is defined as Sunday through Saturday.

**Weekly sampling unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. Reduced monitoring is contingent on a public water system continuing to experience NO raw or finished water total microcystins detections. Any total microcystins detections during routine (weekly) or reduced sampling will trigger additional sampling. Please refer to the website above for specifics on follow-up sampling requirements.*



OH6205011 OTTAWA COUNTY REGIONAL WATER DISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 6256925	Facility Name: OTTAWA COUNTY REGIONAL WATER DISTRICT
Location	SMP ID: LT2001	Facility Source: Surface Water Facility Class: CLASS 4

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
CYANOBACTERIA SCREENING	1 Sample(s) Required between 12/31/2017 and 1/6/2018
	1 Sample(s) Required between 1/14/2018 and 1/20/2018
	1 Sample(s) Required between 1/28/2018 and 2/3/2018
	1 Sample(s) Required between 2/11/2018 and 2/17/2018
	1 Sample(s) Required between 2/25/2018 and 3/3/2018
	1 Sample(s) Required between 3/11/2018 and 3/17/2018
	1 Sample(s) Required between 3/25/2018 and 3/31/2018
	1 Sample(s) Required between 4/8/2018 and 4/14/2018
	1 Sample(s) Required between 4/22/2018 and 4/28/2018
	1 Sample(s) Required between 5/6/2018 and 5/12/2018
	1 Sample(s) Required between 5/20/2018 and 5/26/2018
	1 Sample(s) Required between 6/3/2018 and 6/9/2018
	1 Sample(s) Required between 6/17/2018 and 6/23/2018
	1 Sample(s) Required between 7/1/2018 and 7/7/2018
	1 Sample(s) Required between 7/15/2018 and 7/21/2018
	1 Sample(s) Required between 7/29/2018 and 8/4/2018
	1 Sample(s) Required between 8/12/2018 and 8/18/2018
	1 Sample(s) Required between 8/26/2018 and 9/1/2018
	1 Sample(s) Required between 9/9/2018 and 9/15/2018
	1 Sample(s) Required between 9/23/2018 and 9/29/2018
1 Sample(s) Required between 10/7/2018 and 10/13/2018	
1 Sample(s) Required between 10/21/2018 and 10/27/2018	
1 Sample(s) Required between 11/4/2018 and 11/10/2018	
1 Sample(s) Required between 11/18/2018 and 11/24/2018	
1 Sample(s) Required between 12/2/2018 and 12/8/2018	
1 Sample(s) Required between 12/16/2018 and 12/22/2018	

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. As of 12/31/17, all public water systems are responsible for contracting with a lab certified to perform cyanobacteria screening (qPCR). Please review the website for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections, and certified labs that can perform analysis.



OH6205011 OTTAWA COUNTY REGIONAL WATER DISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: OTTAWA COUNTY REGIONAL DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	20 Sample(s) Required between 1/1/2018 and 1/31/2018
	20 Sample(s) Required between 2/1/2018 and 2/28/2018
	20 Sample(s) Required between 3/1/2018 and 3/31/2018
	20 Sample(s) Required between 4/1/2018 and 4/30/2018
	20 Sample(s) Required between 5/1/2018 and 5/31/2018
	20 Sample(s) Required between 6/1/2018 and 6/30/2018
	20 Sample(s) Required between 7/1/2018 and 7/31/2018
	20 Sample(s) Required between 8/1/2018 and 8/31/2018
	20 Sample(s) Required between 9/1/2018 and 9/30/2018
	20 Sample(s) Required between 10/1/2018 and 10/31/2018
	20 Sample(s) Required between 11/1/2018 and 11/30/2018
	20 Sample(s) Required between 12/1/2018 and 12/31/2018
TOTAL CHLORINE - 1000	20 Sample(s) Required between 1/1/2018 and 1/31/2018
	20 Sample(s) Required between 2/1/2018 and 2/28/2018
	20 Sample(s) Required between 3/1/2018 and 3/31/2018
	20 Sample(s) Required between 4/1/2018 and 4/30/2018
	20 Sample(s) Required between 5/1/2018 and 5/31/2018
	20 Sample(s) Required between 6/1/2018 and 6/30/2018
	20 Sample(s) Required between 7/1/2018 and 7/31/2018
	20 Sample(s) Required between 8/1/2018 and 8/31/2018
	20 Sample(s) Required between 9/1/2018 and 9/30/2018
	20 Sample(s) Required between 10/1/2018 and 10/31/2018
	20 Sample(s) Required between 11/1/2018 and 11/30/2018
	20 Sample(s) Required between 12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: OTTAWA COUNTY REGIONAL DISTRIBUTION DANBURY TOWER	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2018 and 2/7/2018at: DS201
	Dual Sample Required between 5/1/2018 and 5/7/2018at: DS201
	Dual Sample Required between 8/1/2018 and 8/7/2018at: DS201
	Dual Sample Required between 11/1/2018 and 11/7/2018at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH6205011 OTTAWA COUNTY REGIONAL WATER DISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: OTTAWA COUNTY REGIONAL DISTRIBUTION CATAWBA TOWER	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2018 and 2/7/2018at: DS202
	Dual Sample Required between 5/1/2018 and 5/7/2018at: DS202
	Dual Sample Required between 8/1/2018 and 8/7/2018at: DS202
	Dual Sample Required between 11/1/2018 and 11/7/2018at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS203	Facility Name: OTTAWA COUNTY REGIONAL DISTRIBUTION STATE OF OHIO ST.RT. 2 REST AREA	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2018 and 2/7/2018at: DS203
	Dual Sample Required between 5/1/2018 and 5/7/2018at: DS203
	Dual Sample Required between 8/1/2018 and 8/7/2018at: DS203
	Dual Sample Required between 11/1/2018 and 11/7/2018at: DS203

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS204	Facility Name: OTTAWA COUNTY REGIONAL DISTRIBUTION 9400 NORTH SHORE BLVD	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2018 and 2/7/2018at: DS204
	Dual Sample Required between 5/1/2018 and 5/7/2018at: DS204
	Dual Sample Required between 8/1/2018 and 8/7/2018at: DS204
	Dual Sample Required between 11/1/2018 and 11/7/2018at: DS204

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: OTTAWA COUNTY REGIONAL DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required



OH6205111 CARROLL WATER AND SEWER

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 6256927	Facility Name: CARROLL WATER AND SEWER	Facility Class: CLASS 3
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
BROMATE - 1011	1 Sample(s) Required between 1/1/2018 and 1/31/2018 1 Sample(s) Required between 2/1/2018 and 2/28/2018 1 Sample(s) Required between 3/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 4/30/2018 1 Sample(s) Required between 5/1/2018 and 5/31/2018 1 Sample(s) Required between 6/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 7/31/2018 1 Sample(s) Required between 8/1/2018 and 8/31/2018 1 Sample(s) Required between 9/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 10/31/2018 1 Sample(s) Required between 11/1/2018 and 11/30/2018 1 Sample(s) Required between 12/1/2018 and 12/31/2018
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 1/31/2018 1 Sample(s) Required between 2/1/2018 and 2/28/2018 1 Sample(s) Required between 3/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 4/30/2018 1 Sample(s) Required between 5/1/2018 and 5/31/2018 1 Sample(s) Required between 6/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 7/31/2018 1 Sample(s) Required between 8/1/2018 and 8/31/2018 1 Sample(s) Required between 9/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 10/31/2018 1 Sample(s) Required between 11/1/2018 and 11/30/2018 1 Sample(s) Required between 12/1/2018 and 12/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2018 and 6/30/2018
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 10/1/2018 and 12/31/2018
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 1/1/2018 and 1/31/2018 1 Paired Sample Set Required between 2/1/2018 and 2/28/2018 1 Paired Sample Set Required between 3/1/2018 and 3/31/2018 1 Paired Sample Set Required between 4/1/2018 and 4/30/2018 1 Paired Sample Set Required between 5/1/2018 and 5/31/2018 1 Paired Sample Set Required between 6/1/2018 and 6/30/2018 1 Paired Sample Set Required between 7/1/2018 and 7/31/2018



OH6205111 CARROLL WATER AND SEWER

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 6256927	Facility Name: CARROLL WATER AND SEWER	
Location	SMP ID: EP001	Facility Source: Surface Water	Facility Class: CLASS 3

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

Chemicals	Monitoring Requirements		
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between	8/1/2018 and	8/31/2018
	1 Paired Sample Set Required between	9/1/2018 and	9/30/2018
	1 Paired Sample Set Required between	10/1/2018 and	10/31/2018
	1 Paired Sample Set Required between	11/1/2018 and	11/30/2018
	1 Paired Sample Set Required between	12/1/2018 and	12/31/2018

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH6205111 CARROLL WATER AND SEWER

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 6256927	Facility Name: CARROLL WATER AND SEWER	
Location	SMP ID: EP001/LT2001	Facility Source: Surface Water	Facility Class: CLASS 3

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

Chemicals

Monitoring Requirements

TOTAL MICROCYSTINS

1 Sample Set Required WEEKLY*

Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. A week is defined as Sunday through Saturday.

**Weekly sampling unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. Reduced monitoring is contingent on a public water system continuing to experience NO raw or finished water total microcystins detections. Any total microcystins detections during routine (weekly) or reduced sampling will trigger additional sampling. Please refer to the website above for specifics on follow-up sampling requirements.*



OH6205111 CARROLL WATER AND SEWER

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 6256927	Facility Name: CARROLL WATER AND SEWER	
Location	SMP ID: LT2001	Facility Source: Surface Water	Facility Class: CLASS 3

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
-----------	-------------------------

CYANOBACTERIA SCREENING	1 Sample(s) Required between 12/31/2017 and 1/6/2018
	1 Sample(s) Required between 1/14/2018 and 1/20/2018
	1 Sample(s) Required between 1/28/2018 and 2/3/2018
	1 Sample(s) Required between 2/11/2018 and 2/17/2018
	1 Sample(s) Required between 2/25/2018 and 3/3/2018
	1 Sample(s) Required between 3/11/2018 and 3/17/2018
	1 Sample(s) Required between 3/25/2018 and 3/31/2018
	1 Sample(s) Required between 4/8/2018 and 4/14/2018
	1 Sample(s) Required between 4/22/2018 and 4/28/2018
	1 Sample(s) Required between 5/6/2018 and 5/12/2018
	1 Sample(s) Required between 5/20/2018 and 5/26/2018
	1 Sample(s) Required between 6/3/2018 and 6/9/2018
	1 Sample(s) Required between 6/17/2018 and 6/23/2018
	1 Sample(s) Required between 7/1/2018 and 7/7/2018
	1 Sample(s) Required between 7/15/2018 and 7/21/2018
	1 Sample(s) Required between 7/29/2018 and 8/4/2018
	1 Sample(s) Required between 8/12/2018 and 8/18/2018
	1 Sample(s) Required between 8/26/2018 and 9/1/2018
	1 Sample(s) Required between 9/9/2018 and 9/15/2018
	1 Sample(s) Required between 9/23/2018 and 9/29/2018
	1 Sample(s) Required between 10/7/2018 and 10/13/2018
	1 Sample(s) Required between 10/21/2018 and 10/27/2018
	1 Sample(s) Required between 11/4/2018 and 11/10/2018
	1 Sample(s) Required between 11/18/2018 and 11/24/2018
	1 Sample(s) Required between 12/2/2018 and 12/8/2018
	1 Sample(s) Required between 12/16/2018 and 12/22/2018

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. As of 12/31/17, all public water systems are responsible for contracting with a lab certified to perform cyanobacteria screening (qPCR). Please review the website for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections, and certified labs that can perform analysis.

OH6205111 CARROLL WATER AND SEWER

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: CARROLL WATER AND SEWER DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between	6/1/2018	and	6/30/2018
	2 Sample(s) Required between	7/1/2018	and	7/31/2018
	2 Sample(s) Required between	8/1/2018	and	8/31/2018
	2 Sample(s) Required between	9/1/2018	and	9/30/2018
	2 Sample(s) Required between	10/1/2018	and	10/31/2018
	2 Sample(s) Required between	11/1/2018	and	11/30/2018
	2 Sample(s) Required between	12/1/2018	and	12/31/2018

TOTAL CHLORINE - 1000	2 Sample(s) Required between	6/1/2018	and	6/30/2018
	2 Sample(s) Required between	7/1/2018	and	7/31/2018
	2 Sample(s) Required between	8/1/2018	and	8/31/2018
	2 Sample(s) Required between	9/1/2018	and	9/30/2018
	2 Sample(s) Required between	10/1/2018	and	10/31/2018
	2 Sample(s) Required between	11/1/2018	and	11/30/2018
	2 Sample(s) Required between	12/1/2018	and	12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: CARROLL WATER AND SEWER DISTRIBUTION 11861 W SALEM CARROLL RD	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS	Dual Sample Required between	2/8/2018	and	2/14/2018	at: DS201
	Dual Sample Required between	5/8/2018	and	5/14/2018	at: DS201
	Dual Sample Required between	8/8/2018	and	8/14/2018	at: DS201
	Dual Sample Required between	11/8/2018	and	11/14/2018	at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: CARROLL WATER AND SEWER DISTRIBUTION 11080 W TOUSSAINT E RD	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS	Dual Sample Required between	2/8/2018	and	2/14/2018	at: DS202
	Dual Sample Required between	5/8/2018	and	5/14/2018	at: DS202
	Dual Sample Required between	8/8/2018	and	8/14/2018	at: DS202
	Dual Sample Required between	11/8/2018	and	11/14/2018	at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2018

2018 DISTRIBUTION SCHEDULE

OH6205111 CARROLL WATER AND SEWER

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: CARROLL WATER AND SEWER DISTRIBUTION	Facility Class: CLASS 1
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs	

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022

Not Required

OH6230412 BENCHMORE FARMS AMLC 2

System Type: Transient Noncommunity

Operating Period: 7/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **BENCHMORE FARMS AMLC 2 DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

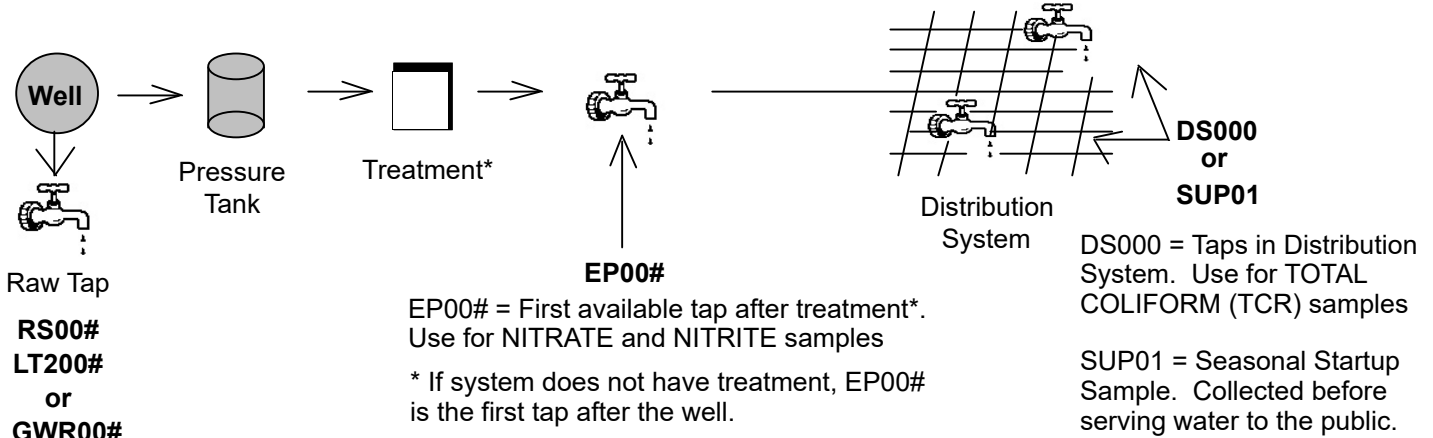

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6230412 BENCHMORE FARMS AMLC 2

System Type: Transient Noncommunity

Operating Period: 7/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256928 Facility Name: BENCHMORE FARMS AMLC NO 2

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6230512 BETHEL UNITED BROTHERS CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **BETHEL UNITED BROTHERS C DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6230512 BETHEL UNITED BRETHREN CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256929 Facility Name: BETHEL UNITED BRETHREN CHURCH
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6230612 BLACKBERRY CORNERS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **BLACKBERRY CORNERS DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

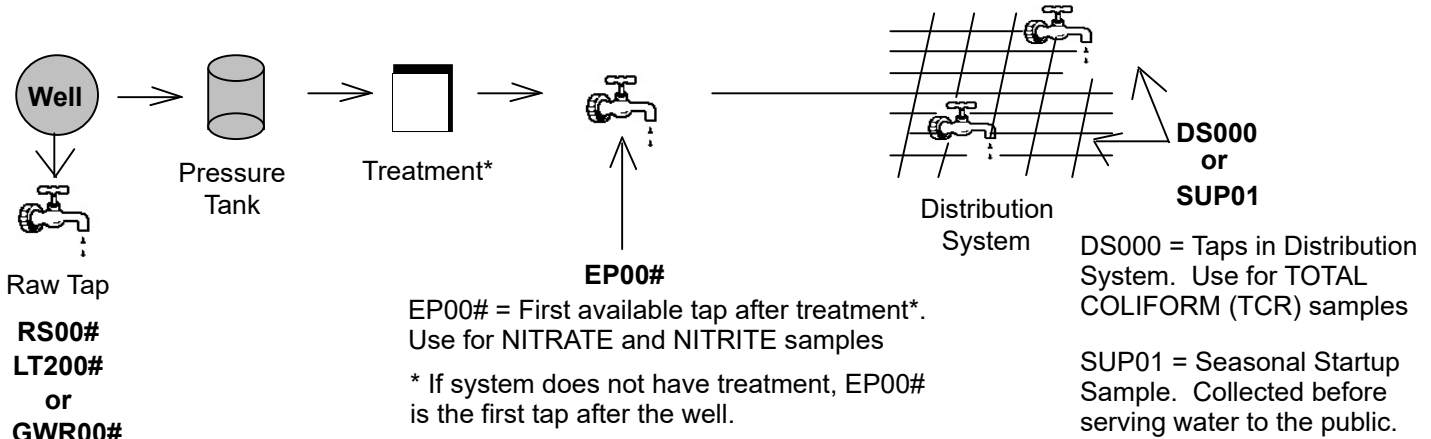

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6230612 BLACKBERRY CORNERS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256930 Facility Name: BLACKBERRY CORNERS
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6230912 ERNESTOS RESTAURANT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ERNESTOS RESTAURANT DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6230912 ERNESTOS RESTAURANT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256932 Facility Name: ERNESTOS RESTAURANT
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6232012 COUNTRY KEG RESTAURANT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: COUNTRY KEG, LLC DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6232012 COUNTRY KEG RESTAURANT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256941 Facility Name: COUNTRY KEG RESTAURANT

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6232612 HILLE/ROTHERT AMLC

System Type: Transient Noncommunity

Operating Period: 5/1 to 11/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **HILLE/ROTHERT AMLC DISTRIBUTION**
 Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

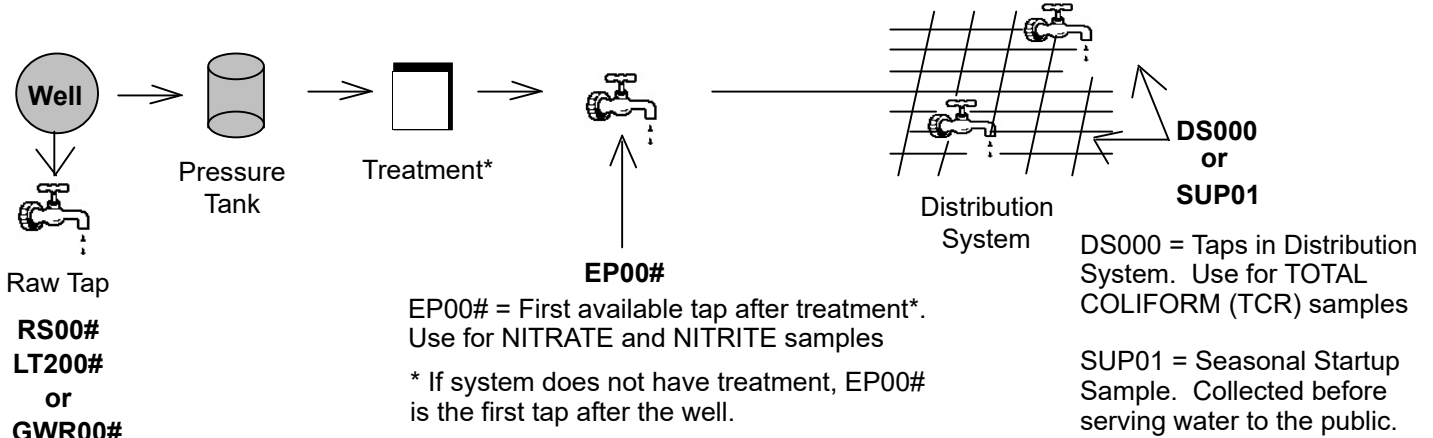

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6232612 HILLE/ROTHERT AMLC

System Type: Transient Noncommunity

Operating Period: 5/1 to 11/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: HILLE/ROTHERT AMLC DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/15/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018

Where to Collect Samples For a Small Public Water System

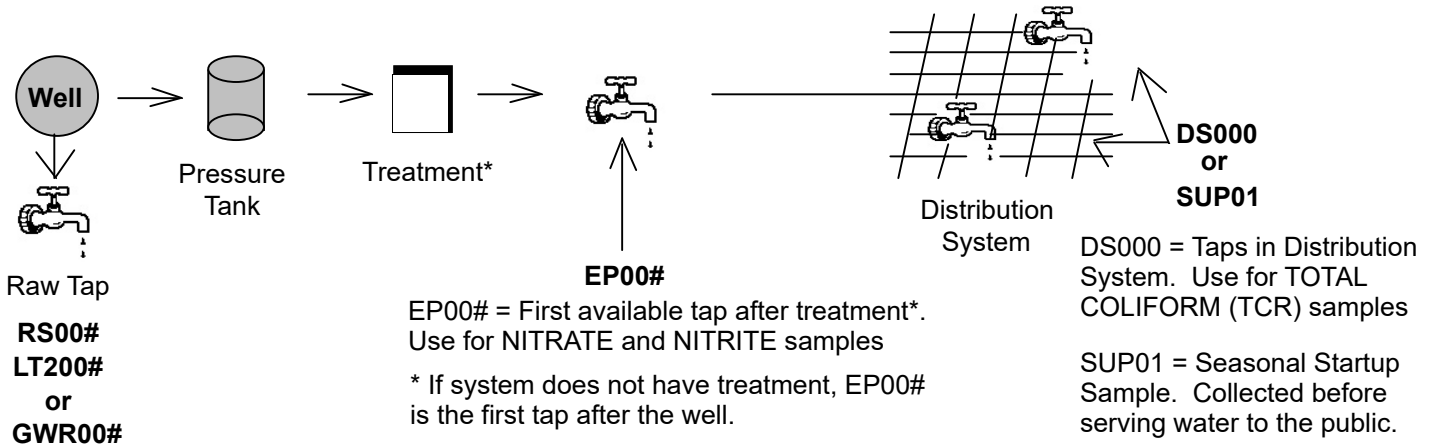

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6232612 HILLE/ROTHERT AMLC

System Type: Transient Noncommunity

Operating Period: 5/1 to 11/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256944 Facility Name: HILLE/ROTHERT AMLC
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

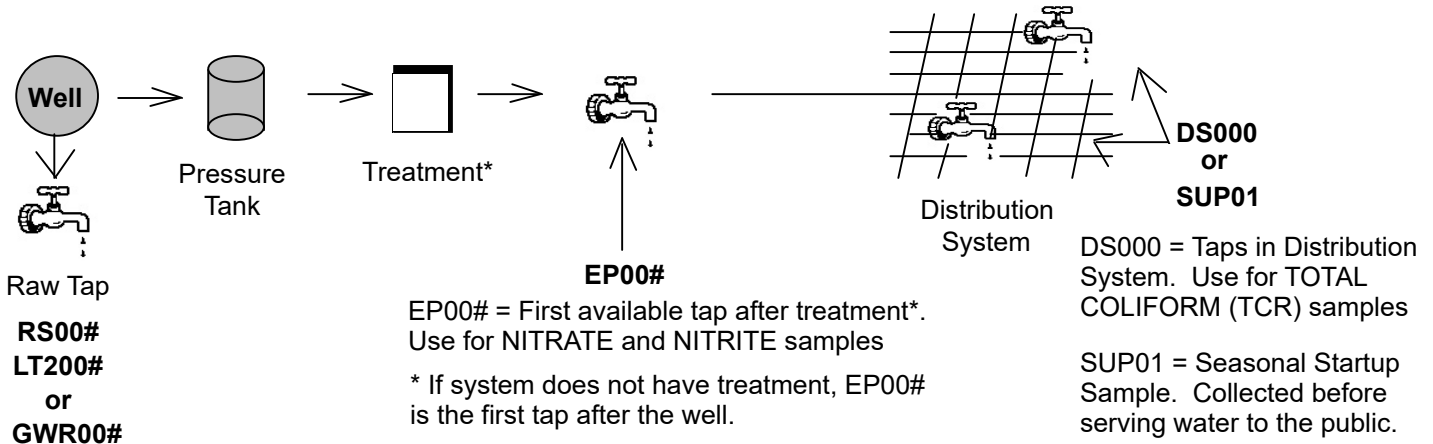

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6233212 TRI MOTOR SALES

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **TRI MOTOR SALES INC. DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6233212 TRI MOTOR SALES

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256948 Facility Name: TRI MOTOR SALES INC
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6233512 GRACE LUTHERAN CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: GRACE LUTHERAN CHURCH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6233512 GRACE LUTHERAN CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256949 Facility Name: GRACE LUTHERAN CHURCH
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH6233812 NORTH POINT EDUCATION SERVICE CTR OTTAWA

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 6256952	Facility Name: NORTH POINT EDUCATION SERVICE CTR SCHOOL	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH6233812 NORTH POINT EDUCATION SERVICE CTR OTTAWA

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: NORTH POINT EDUCATION SERV DISTRIBUTIC
--------------------------	---	--

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 12/31/2018

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: NORTH POINT EDUCATION SERV DISTRIBUTIC ADDRESS NOT KNOWN
--------------------------	---	--

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: NORTH POINT EDUCATION SERV DISTRIBUTIC Refer to your Lead and Copper plan for SMP IDs
--------------------------	---	---

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH6234112 HASSELKUS AMLC

System Type: Transient Noncommunity

Operating Period: 5/1 to 8/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **6256953** Facility Name: **HASSELKUS AMLC**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

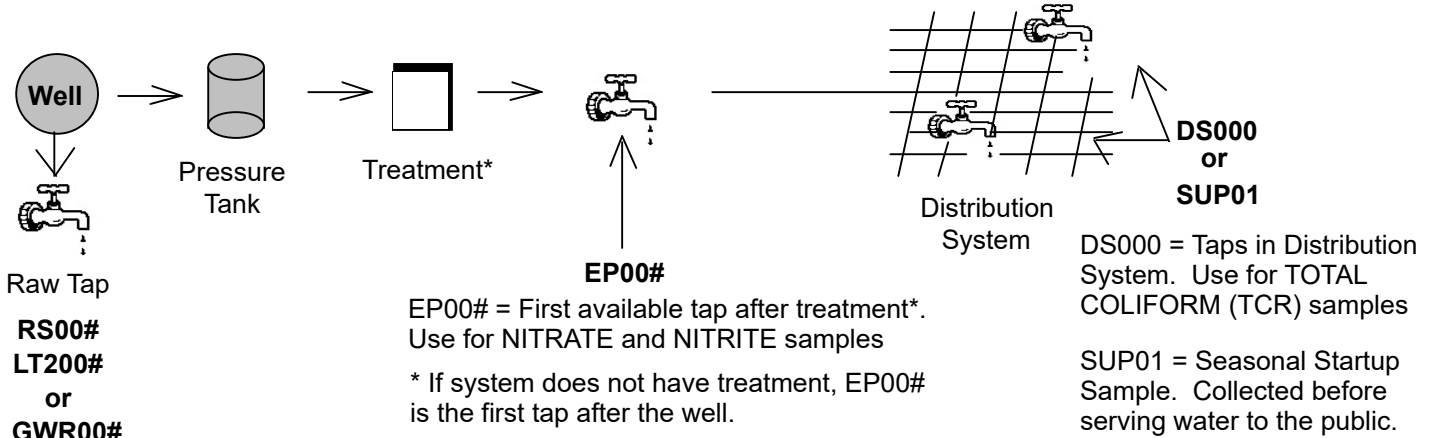

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6234412 LUCKEY HOMESTEAD FARMS AMLC PWS

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **LUCKEY HOMESTEAD FARM AM DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

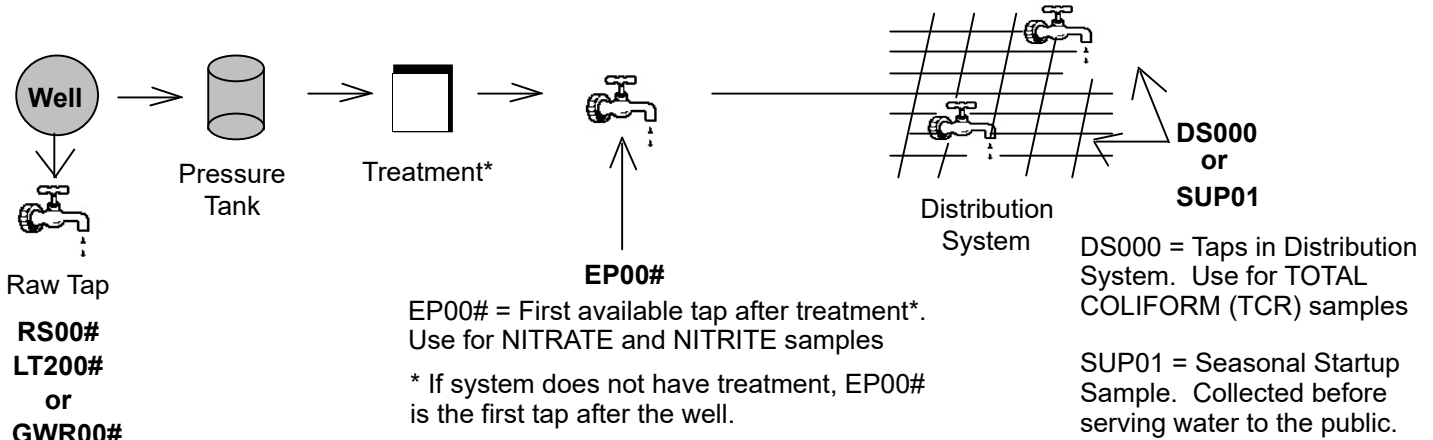

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6234412 LUCKEY HOMESTEAD FARMS AMLC PWS

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: LUCKEY HOMESTEAD FARM AM DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 6/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018

Where to Collect Samples For a Small Public Water System

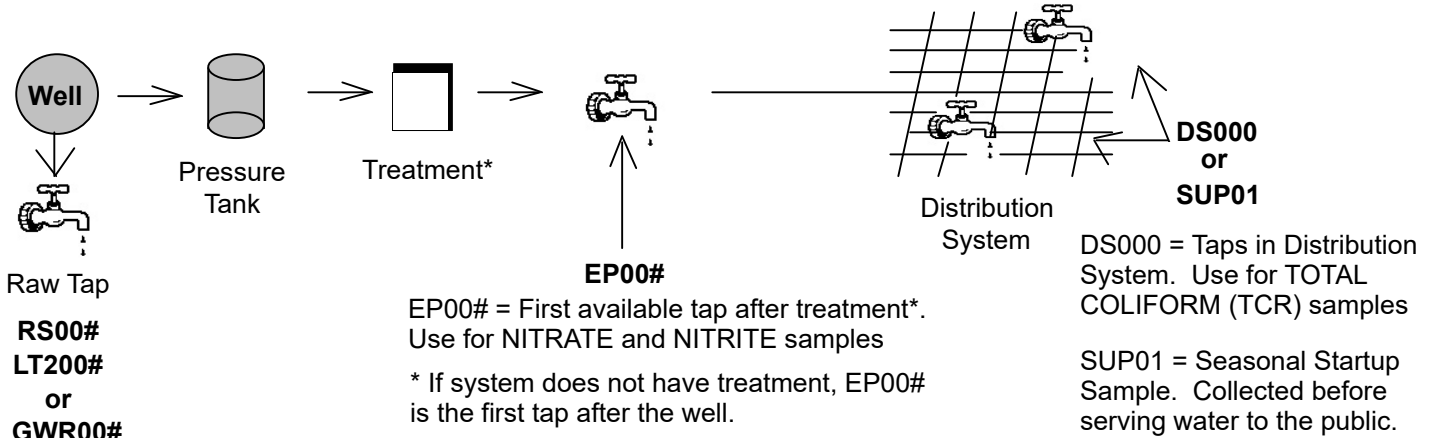

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6234412 LUCKEY HOMESTEAD FARMS AMLC PWS

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256955 Facility Name: LUCKEY HOMESTEAD FARMS AMLC
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6235212 LIMESTONE TAVERN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: LIMESTONE TAVERN DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

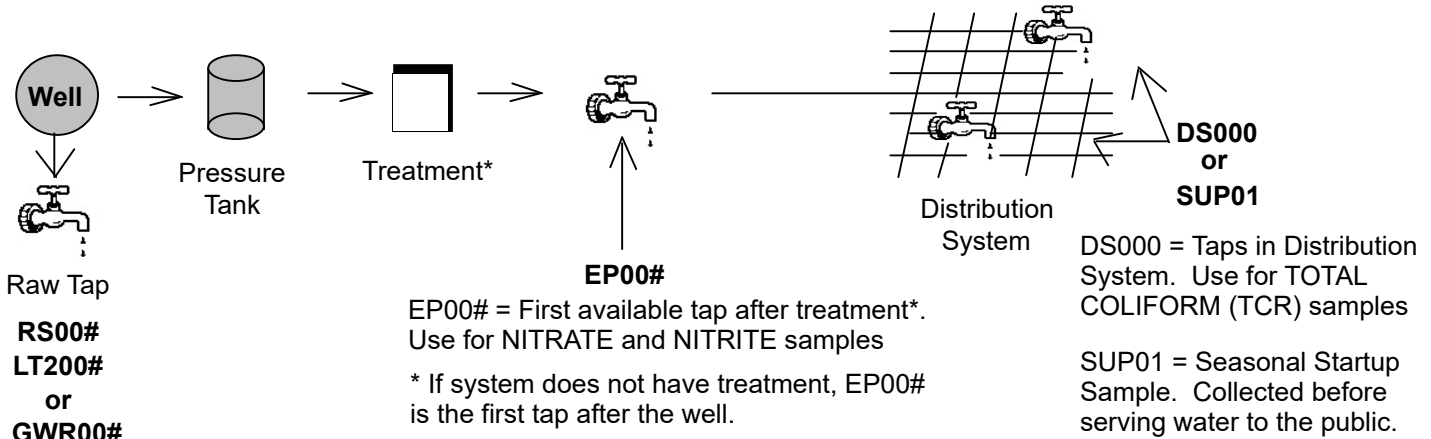

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6235212 LIMESTONE TAVERN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256956 Facility Name: LIMESTONE TAVERN
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6237012 ROTHERT AMLC

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **ROTHERT AMLC DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6237012 ROTHERT AMLC

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: ROTHERT AMLC DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/24/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

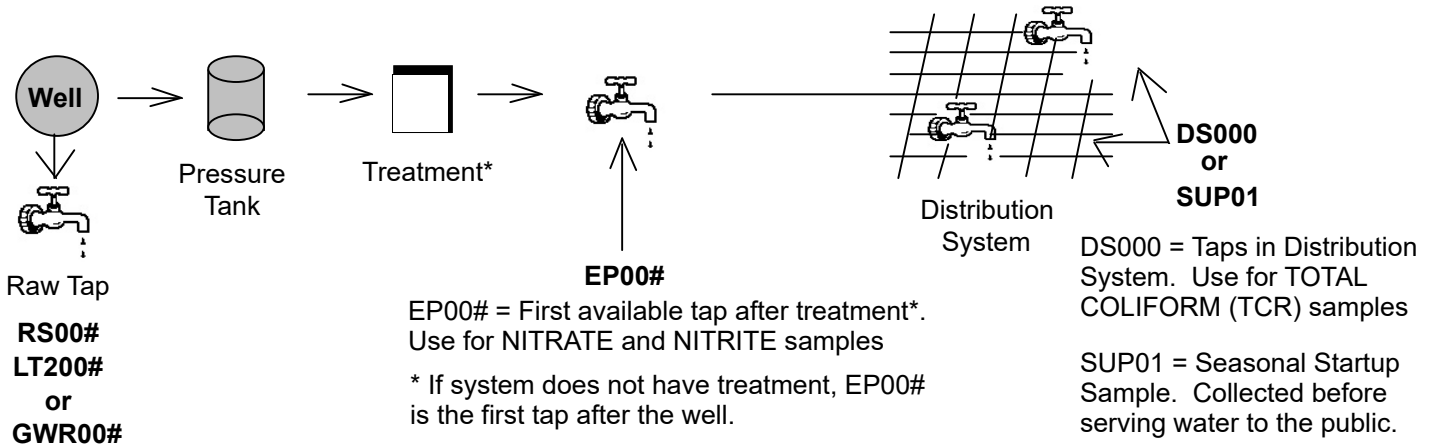

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6237012 ROTHERT AMLC

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **6256965** Facility Name: **ROTHERT AMLC**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

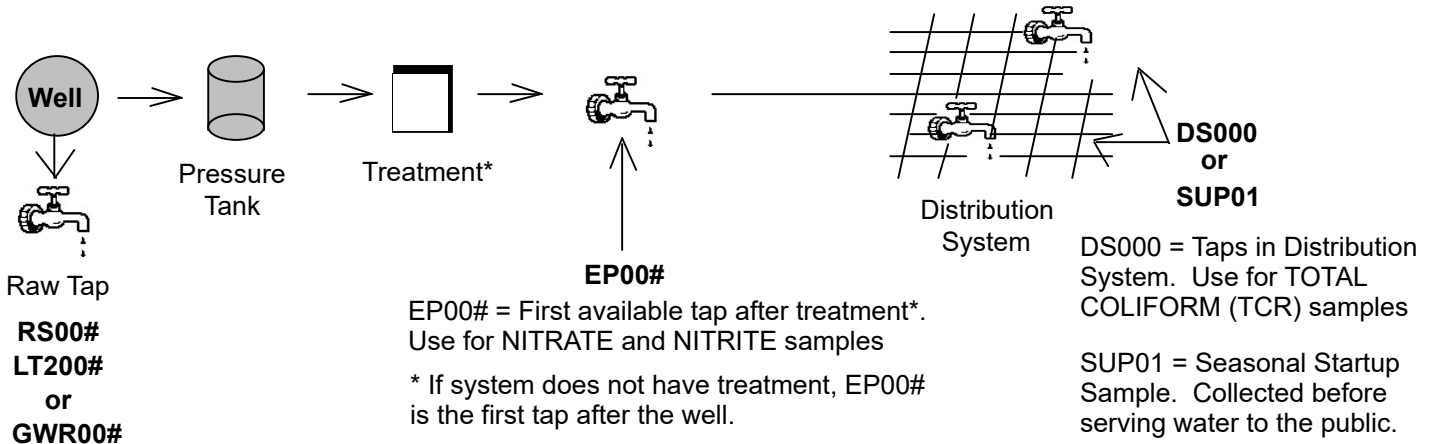

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6238012 ST JOHN LUTHERAN CHURCH ROCKY RIDGE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ST JOHN LUTHERAN CHURCH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

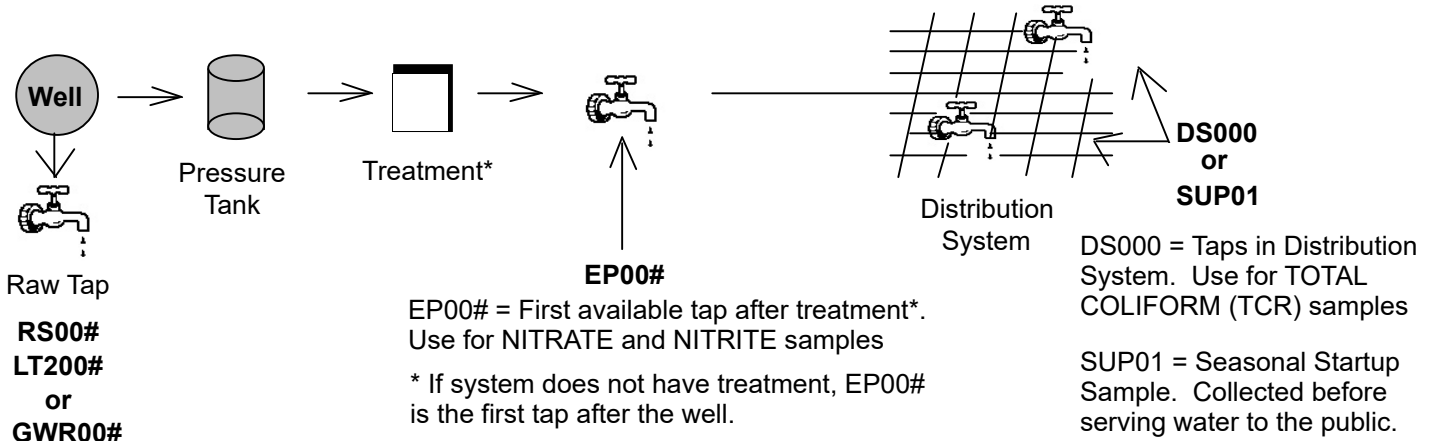

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6238012 ST JOHN LUTHERAN CHURCH ROCKY RIDGE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256970 Facility Name: SAINT JOHN LUTHERAN CHURCH
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6238112 ST PETERS LUTHERAN CHURCH/PRESCHOOL

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ST PETERS LUTHERAN CHURCH & DAYCARE DIST
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 7/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

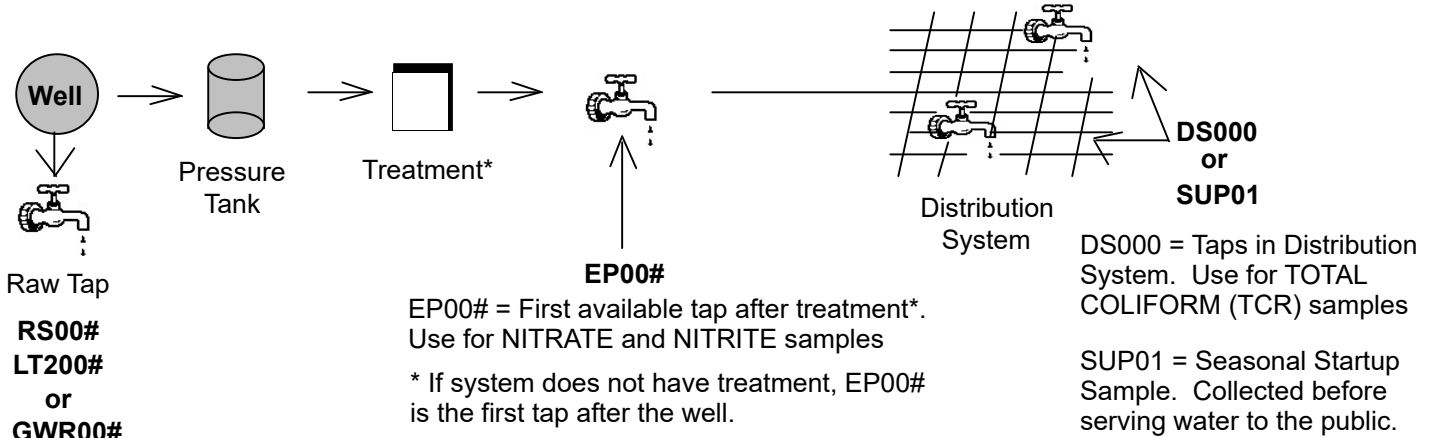

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6238112 ST PETERS LUTHERAN CHURCH/PRESCHOOL

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ST PETERS LUTHERAN CHURCH & DAYCARE DIST
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

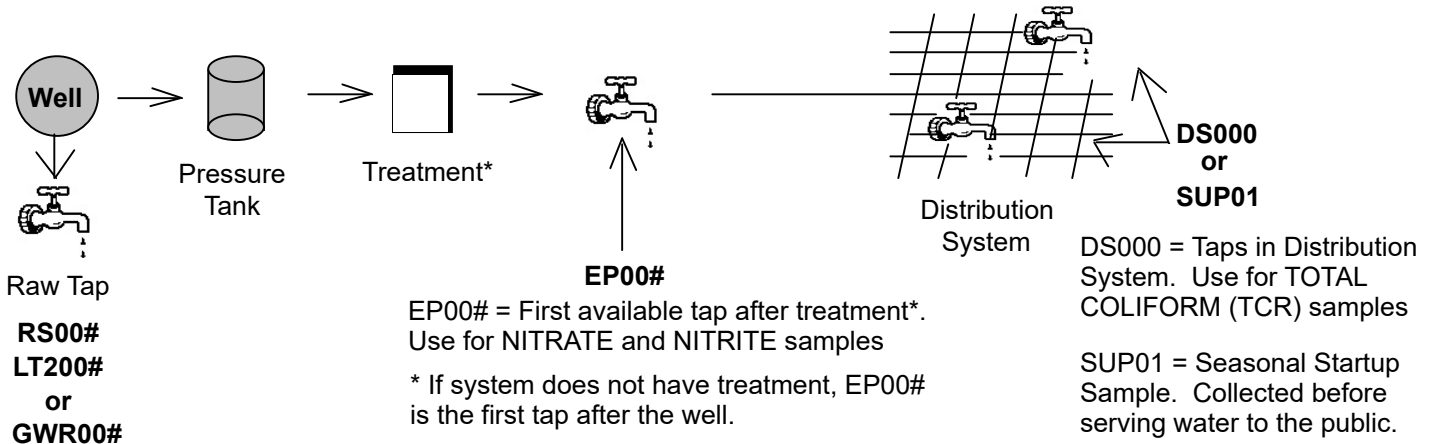

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6238112 ST PETERS LUTHERAN CHURCH/PRESCHOOL

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256971 Facility Name: ST PETERS LUTHERAN CHURCH & DAYCARE
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
SYNTHETIC ORGANIC CHEMICALS (SOC) GROU	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 7/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

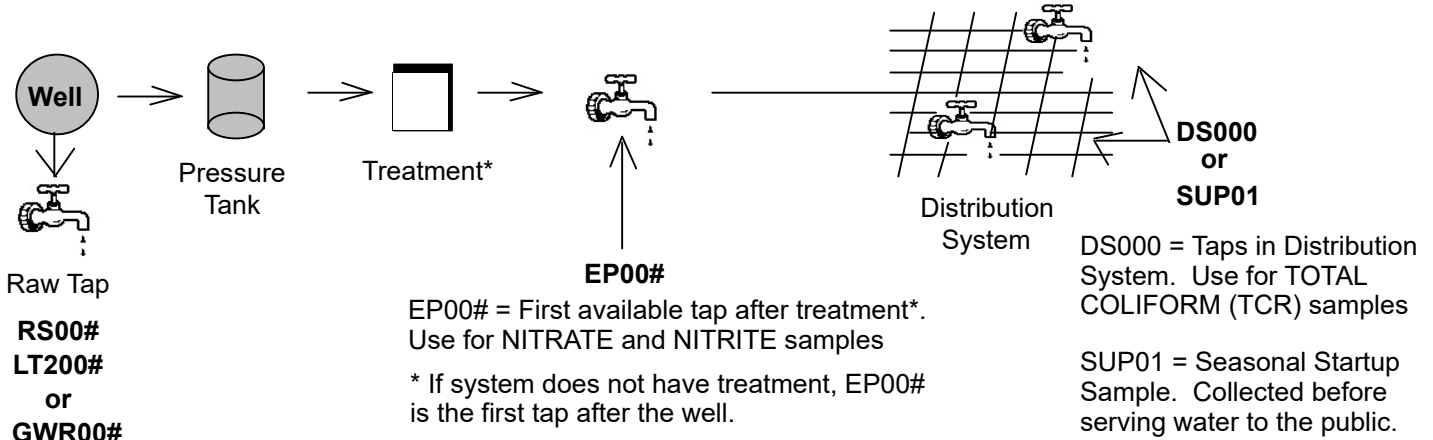

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6238412 CRAZY LADY SALOON

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CRAZY LADY SALOON DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6238412 CRAZY LADY SALOON

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256972 Facility Name: CRAZY LADY SALOON
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6238812 BENCH-SCHULTE FARMS AMLC PWS

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **BENCH-SCHULTE FARMS AMLC DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

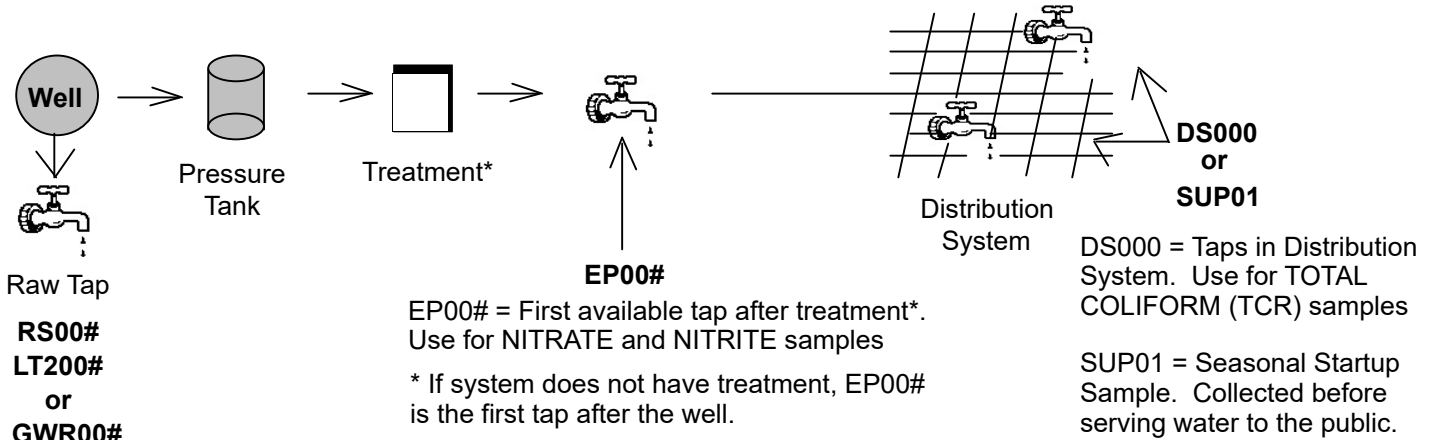

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6238812 BENCH-SCHULTE FARMS AMLC PWS

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: BENCH-SCHULTE FARMS AMLC DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 6/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018

Where to Collect Samples For a Small Public Water System

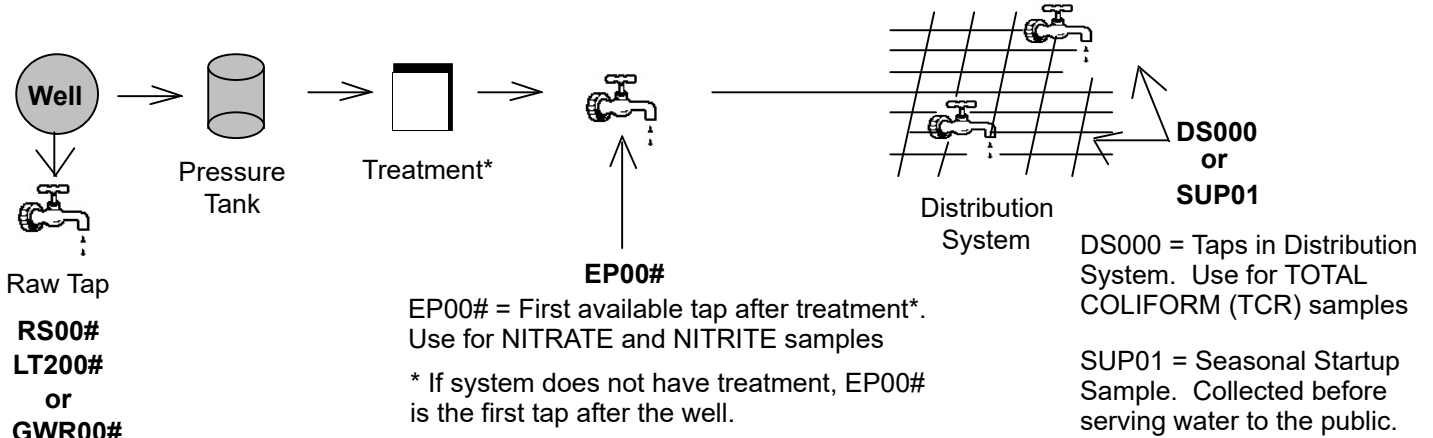

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6238812 BENCH-SCHULTE FARMS AMLC PWS

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256973 Facility Name: SCHULTE AMLC

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

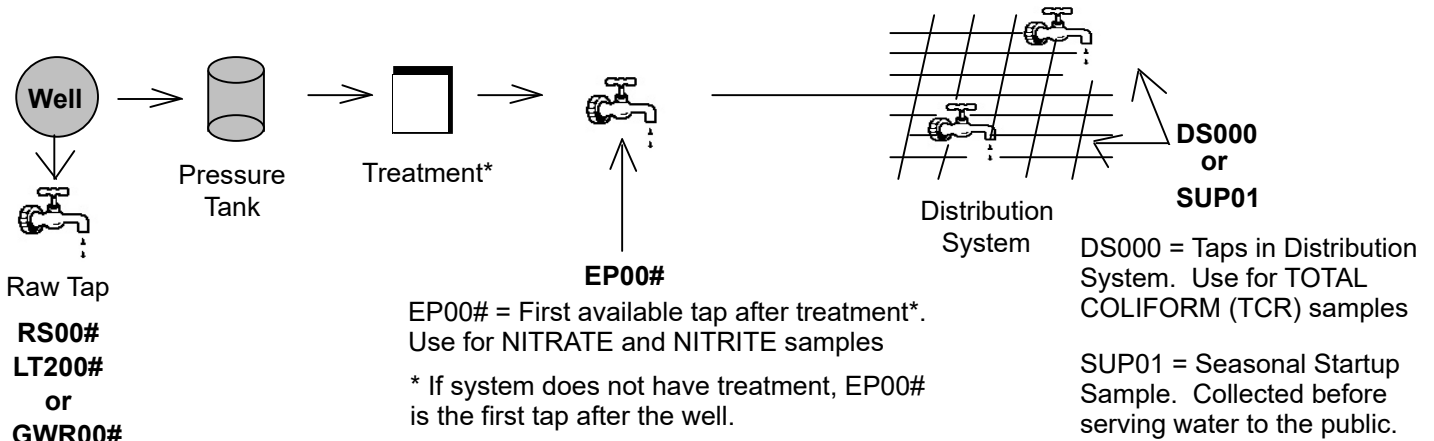

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6240712 CEDARLANE RV PARK

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **CEDARLANE RV PARK DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

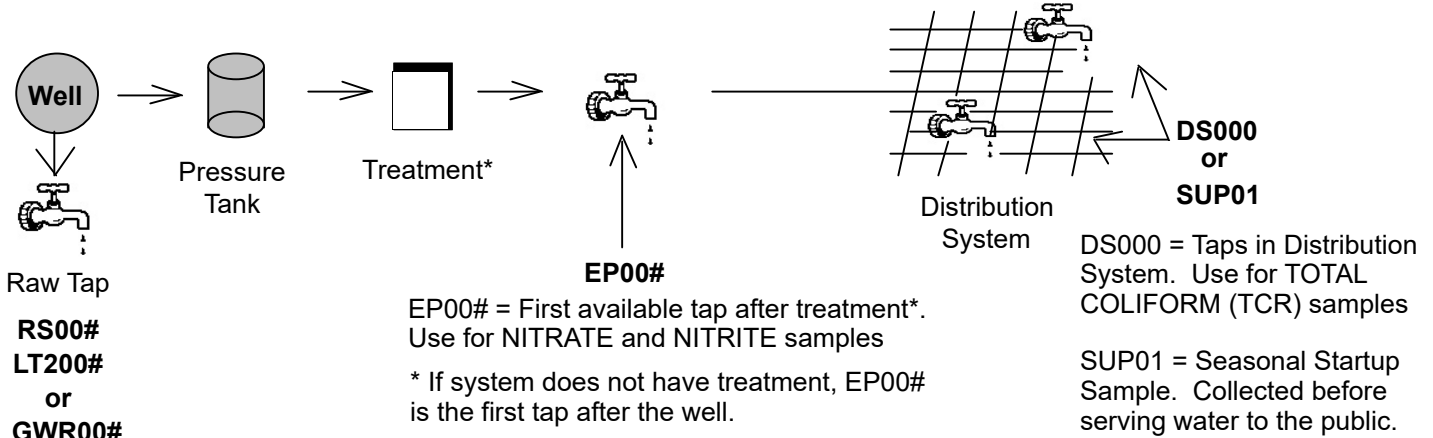

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6240712 CEDARLANE RV PARK

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: CEDARLANE RV PARK DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/15/2018

Where to Collect Samples For a Small Public Water System

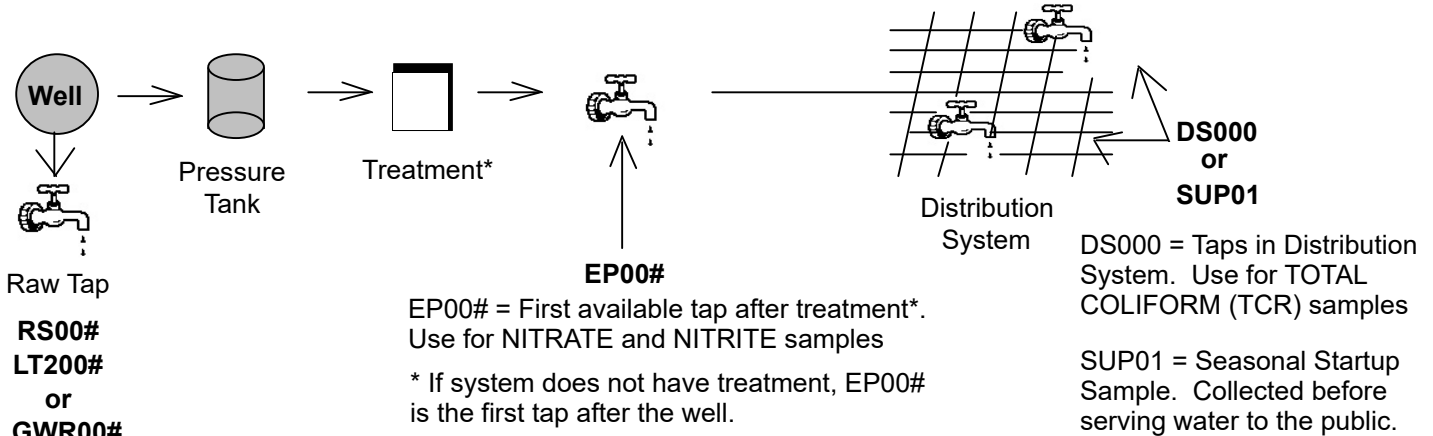

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6240712 CEDARLANE RV PARK

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256980	Facility Name: CEDARLANE CAMPGROUND
Location SMP ID: EP001	Facility Source: Ground Water
	Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

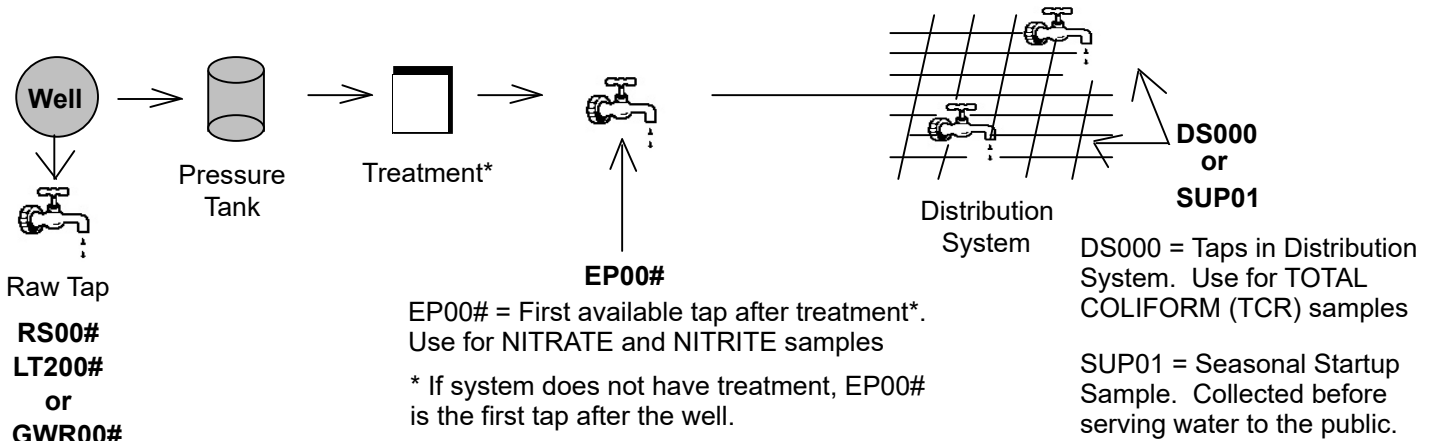

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6241012 CHIPPEWA GOLF CLUB

System Type: Transient Noncommunity

Operating Period: 4/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **CHIPPEWA GOLF CLUB DISTRIBUTION**
 Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6241012 CHIPPEWA GOLF CLUB

System Type: Transient Noncommunity

Operating Period: 4/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CHIPPEWA GOLF CLUB DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

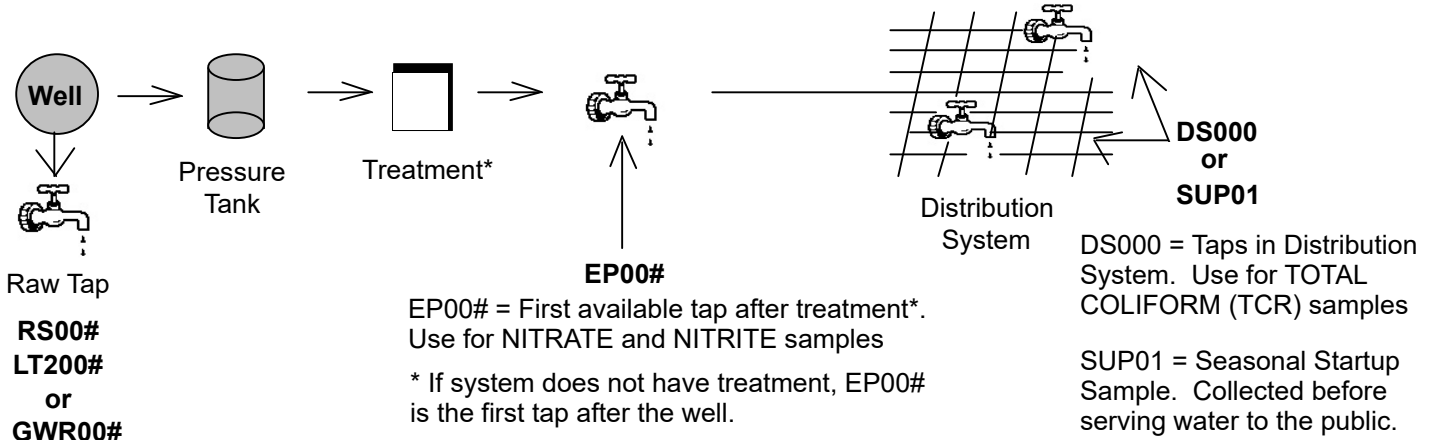

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6241012 CHIPPEWA GOLF CLUB

System Type: Transient Noncommunity

Operating Period: 4/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256981 Facility Name: CHIPPEWA GOLF CLUB

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6242112 HANKS ON THE BAY REAR WELL

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **HANKS PLACE-WEST-WELL DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

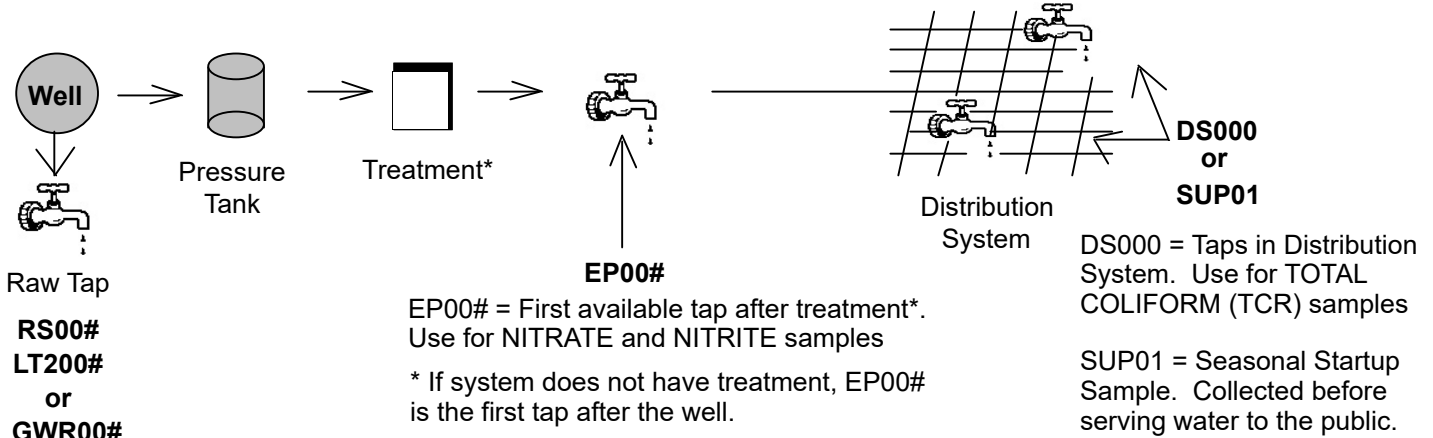

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6242112 HANKS ON THE BAY REAR WELL

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: HANKS PLACE-WEST-WELL DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/15/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/15/2018

Where to Collect Samples For a Small Public Water System

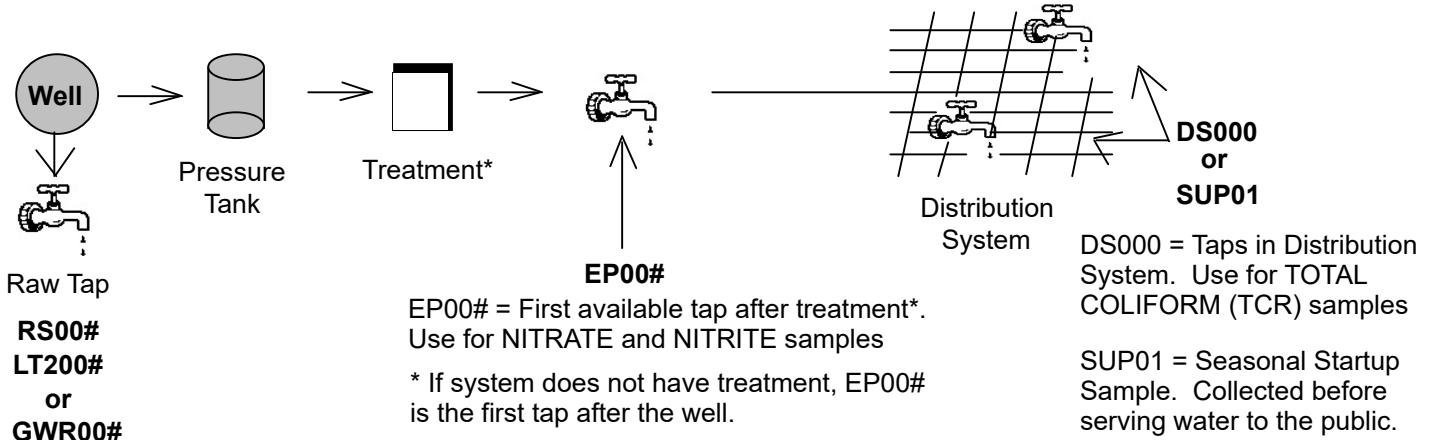

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6242112 HANKS ON THE BAY REAR WELL

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256990 Facility Name: HANKS PLACE WEST WELL
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6242212 HANKS ON THE BAY FRONT WELL

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: HANKS PLACE-EAST WELL DISTRIBUTION
Location SMP ID: SUP01	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

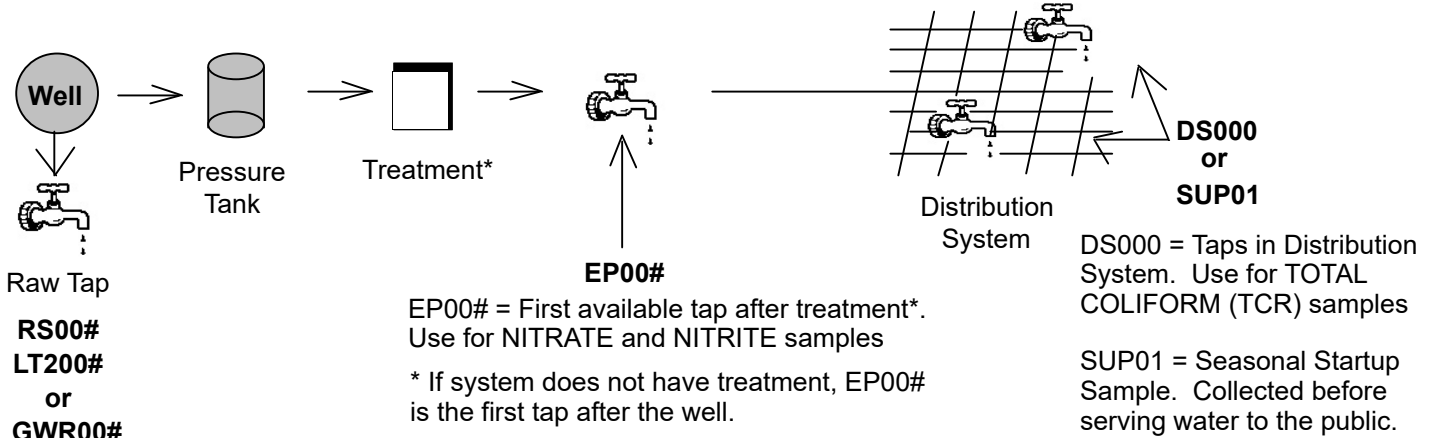

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6242212 HANKS ON THE BAY FRONT WELL

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: HANKS PLACE-EAST WELL DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/15/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/15/2018

Where to Collect Samples For a Small Public Water System

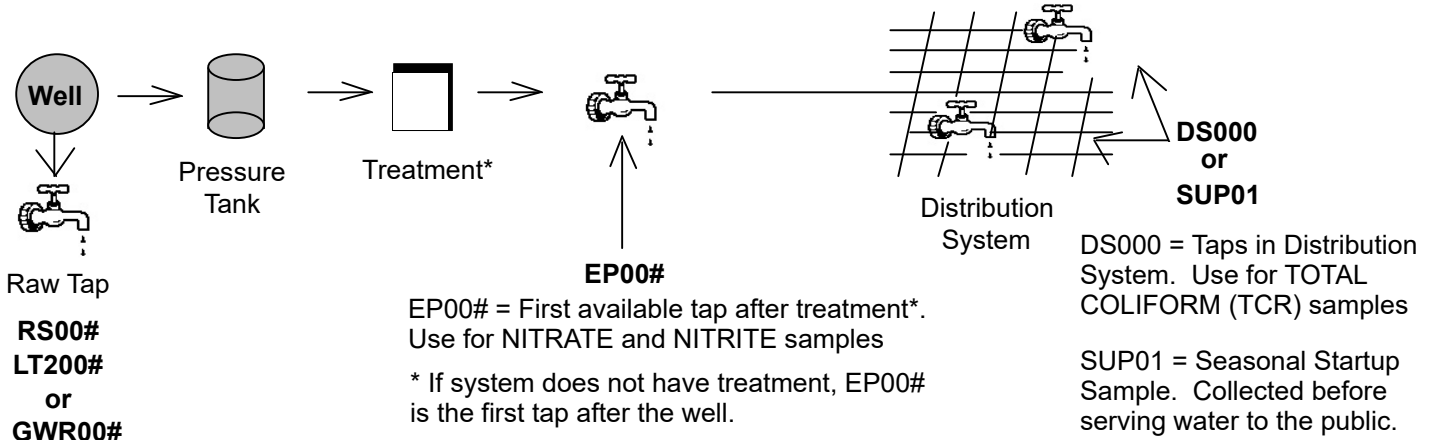

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6242212 HANKS ON THE BAY FRONT WELL

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256991 Facility Name: HANKS PLACE EAST WELL
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6245212 SHADE ACRES CAMPGROUND AND RV PARK

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: SHADE ACRES CAMPGROUND & DISTRIBUTION
Location SMP ID: SUP01 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

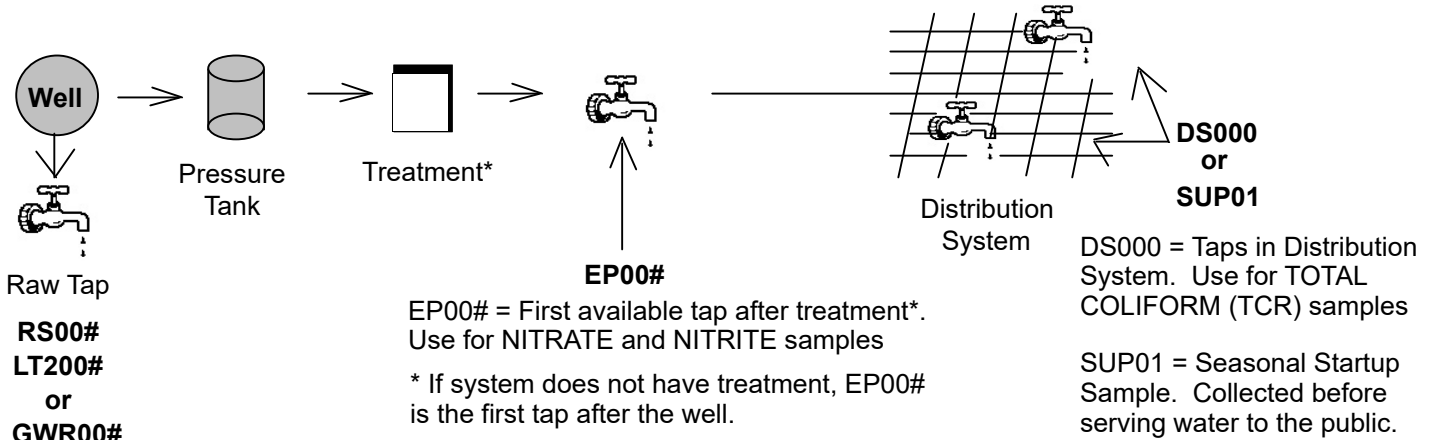

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6245212 SHADE ACRES CAMPGROUND AND RV PARK

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: SHADE ACRES CAMPGROUND & DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/15/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

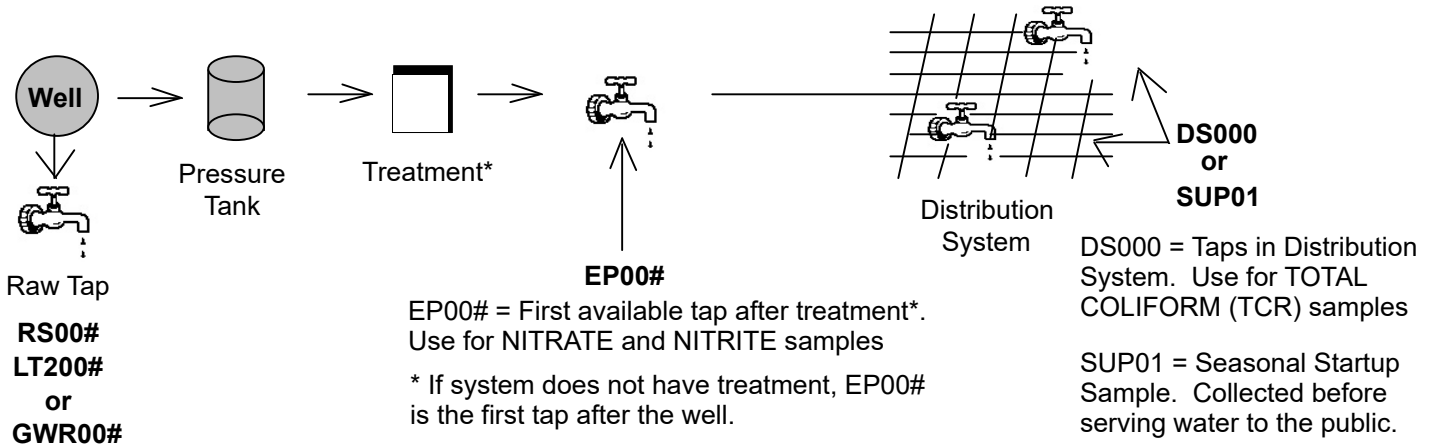

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6245212 SHADE ACRES CAMPGROUND AND RV PARK

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6257010 Facility Name: SHADE ACRES CAMPGROUND & RV PK

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6246212 SUGAR CREEK GOLF CLUB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: SUGAR CREEK GOLF CLUB DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

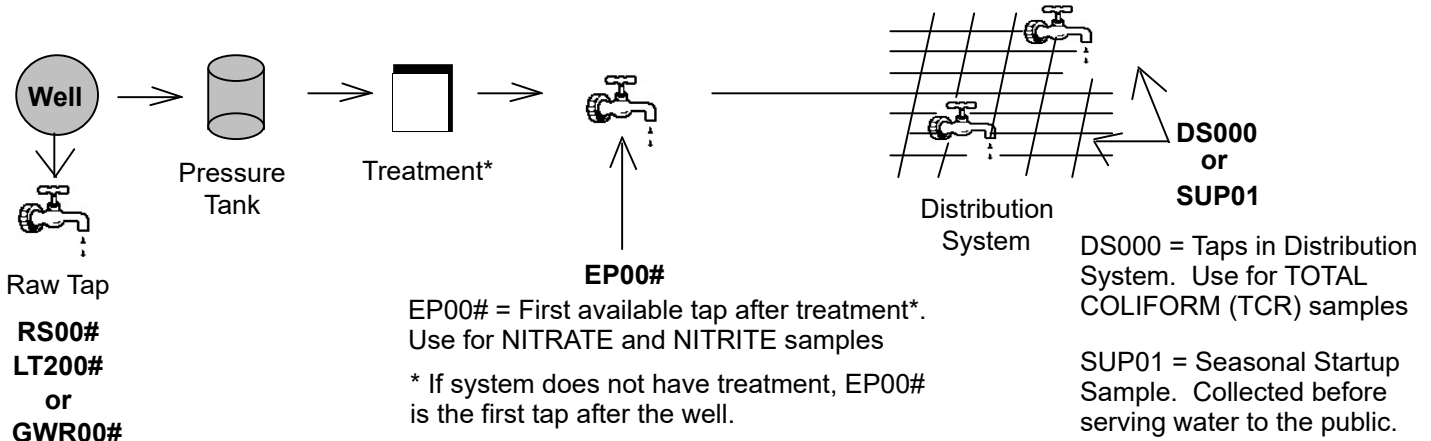

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6246212 SUGAR CREEK GOLF CLUB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6257015 Facility Name: SUGAR CREEK GOLF CLUB
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH6254112 GRAYMONT DOLIME (OH)

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 6257057	Facility Name: GRAYMONT DOLIME OH INC	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH6254112 GRAYMONT DOLIME (OH)

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: GRAYMONT DOLIME (OH) INC DISTRIBUTION
Location SMP ID: DS000

Table with 2 columns: Chemicals, Monitoring Requirements. Rows include TOTAL COLIFORM (TCR) - 3100 and TOTAL CHLORINE - 1000 with their respective sampling frequencies and dates.

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Facility ID: DS1 Facility Name: GRAYMONT DOLIME (OH) INC DISTRIBUTION
Location SMP ID: DS201 ADDRESS NOT KNOWN

Table with 2 columns: Chemicals, Monitoring Requirements. Row includes DISINFECTION BYPRODUCTS with a dual sample requirement between 7/1/2018 and 9/30/2018.

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950

Sampling Facility ID: DS1 Facility Name: GRAYMONT DOLIME (OH) INC DISTRIBUTION
Location SMP ID: LC### Refer to your Lead and Copper plan for SMP IDs

Table with 2 columns: Chemicals, Monitoring Requirements. Row includes LEAD - 1030 AND COPPER - 1022 with 5 sample(s) required between 6/1/2018 and 9/30/2018.

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/19/2018

2018 ENTRY POINT SCHEDULE

OH6254612 THE RESORT AT ERIE LANDINGS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 6257062	Facility Name: THE RESORT AT ERIE LANDINGS	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 4/1/2018 and 6/30/2018



OH6254612 THE RESORT AT ERIE LANDINGS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: RESORT ERIE LANDINGS DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2018 and 9/30/2018at: DS000

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
- 2) TTHM - 2950

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: RESORT ERIE LANDINGS DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 1/1/2018 and 6/30/2018 5 Sample(s) Required between 7/1/2018 and 12/31/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/01/2018

2018 DISTRIBUTION SCHEDULE

OH6254612 THE RESORT AT ERIE LANDINGS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: SUP01	Facility Name: RESORT ERIE LANDINGS DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public
-----------------------------------	---

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.*****

OH6254712 BENCHMORE FARMS AMLC 1

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **BENCHMORE FARMS AMLC 1 DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6254712 BENCHMORE FARMS AMLC 1

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6257063 Facility Name: BENCHMORE FARMS AMLC NO 1
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6256812 BENCH-DICKINSON AMLC PWS

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: BENCH-DICKINSON AMLC DISTRIBUTION
Location SMP ID: SUP01	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

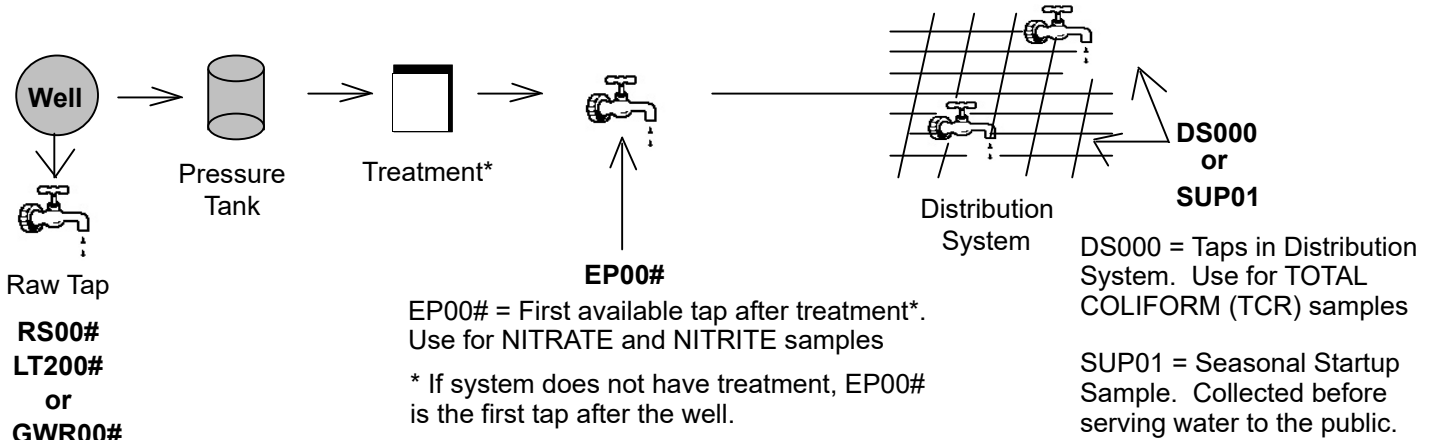

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6256812 BENCH-DICKINSON AMLC PWS

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: BENCH-DICKINSON AMLC DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 6/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018

Where to Collect Samples For a Small Public Water System

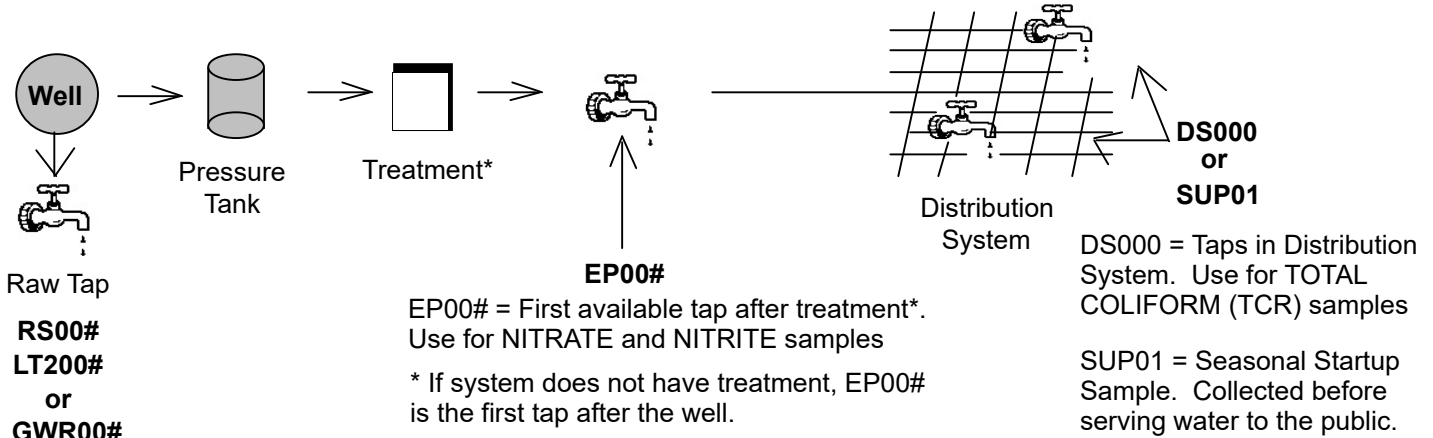

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6256812 BENCH-DICKINSON AMLC PWS

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6257079 Facility Name: DICKINSON AMLC

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

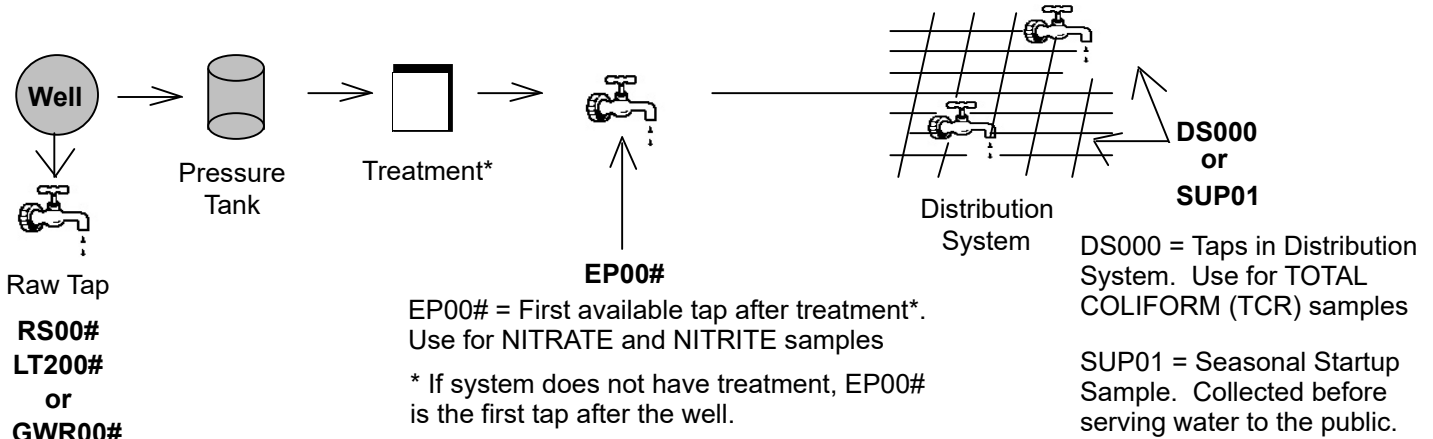

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6256912 BENCH, ROBERT AMLC PWS

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **BENCH, ROBERT AMLC DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6256912 BENCH, ROBERT AMLC PWS

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: BENCH, ROBERT AMLC DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/8/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018

Where to Collect Samples For a Small Public Water System

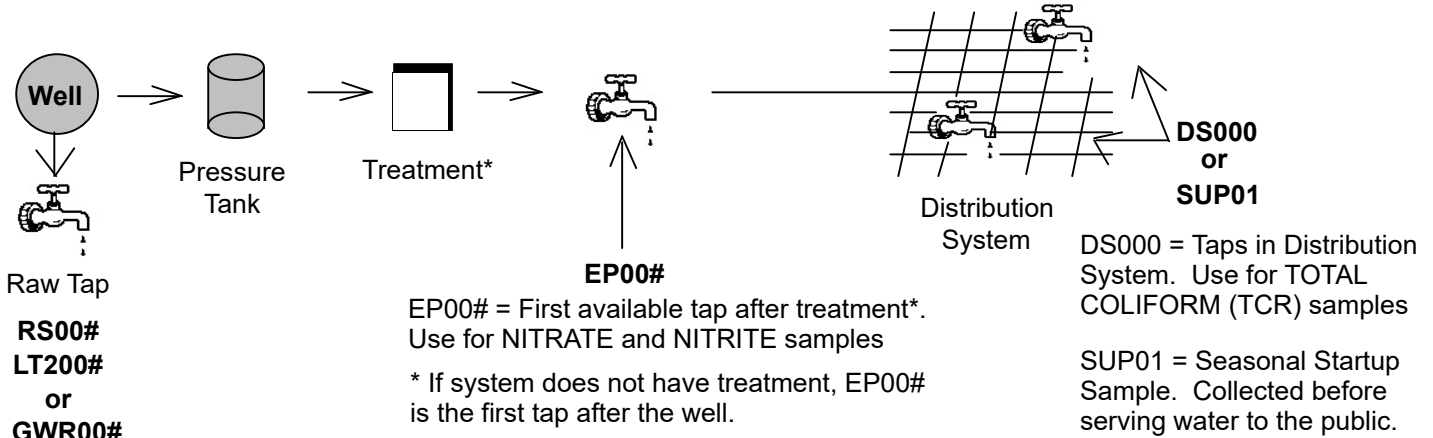

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6256912 BENCH, ROBERT AMLC PWS

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6257080 Facility Name: BENCH ROBERT AMLC

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH6257412 GRACE BAPTIST CHURCH- OAK HARBOR

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 6257085	Facility Name: GRACE BAPTIST CHURCH	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
ARSENIC - 1005	1 Sample(s) Required between 1/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 12/31/2018
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between and



OH6257412 GRACE BAPTIST CHURCH- OAK HARBOR

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: GRACE BAPTIST CHURCH DISTRIBUTION
	SMP ID: DS000	

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	4/1/2018	and	6/30/2018
	1 Sample(s) Required between	7/1/2018	and	9/30/2018
	1 Sample(s) Required between	10/1/2018	and	12/31/2018

Sampling Location	Facility ID: DS1	Facility Name: GRACE BAPTIST CHURCH DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between	6/1/2018	and	9/30/2018
-------------------------------	------------------------------	----------	-----	-----------

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH6258112 ST HAZARDS

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **ST. HAZARDS DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6258112 ST HAZARDS

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: ST. HAZARDS DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/20/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 11/30/2018

Where to Collect Samples For a Small Public Water System

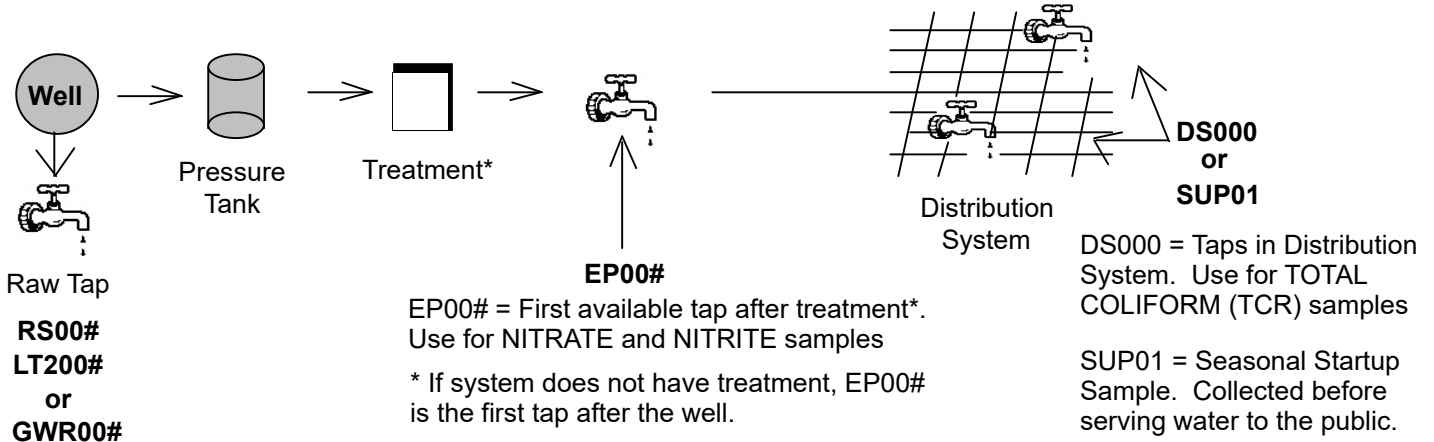

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6258112 ST HAZARDS

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6257089	Facility Name: ST HAZARDS	
Location SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

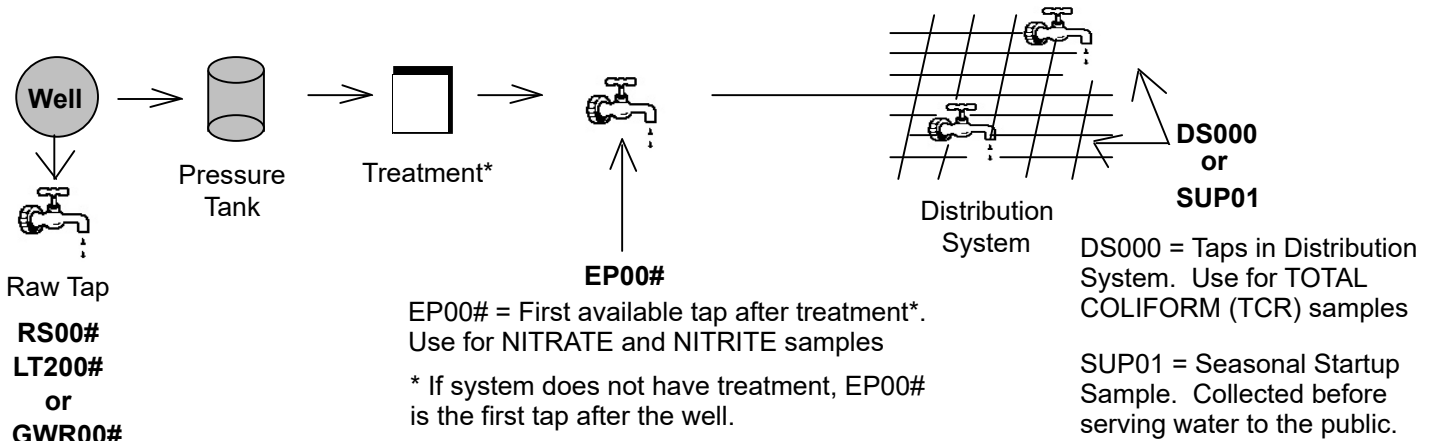

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6258712 FISHY BUSINESS, INC DBA J.F. WALLEYE

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **J.F. WALLEYE MICRO-BREWE DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

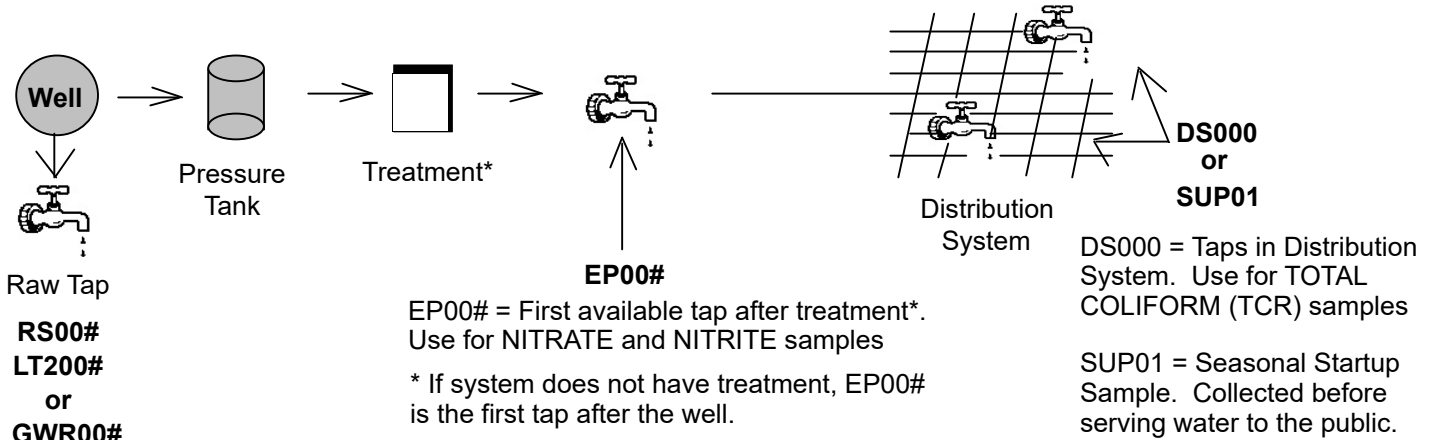

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6258712 FISHY BUSINESS, INC DBA J.F. WALLEYE

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6257094	Facility Name: JF WALLEYE MICRO BREWERY
Location SMP ID: EP001	Facility Source: Ground Water
	Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6259112 ZION UNITED METHODIST CHURCH -GRAYTOWN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: ZION UNITED METHODIST CHURCH DISTRIBUTIO
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

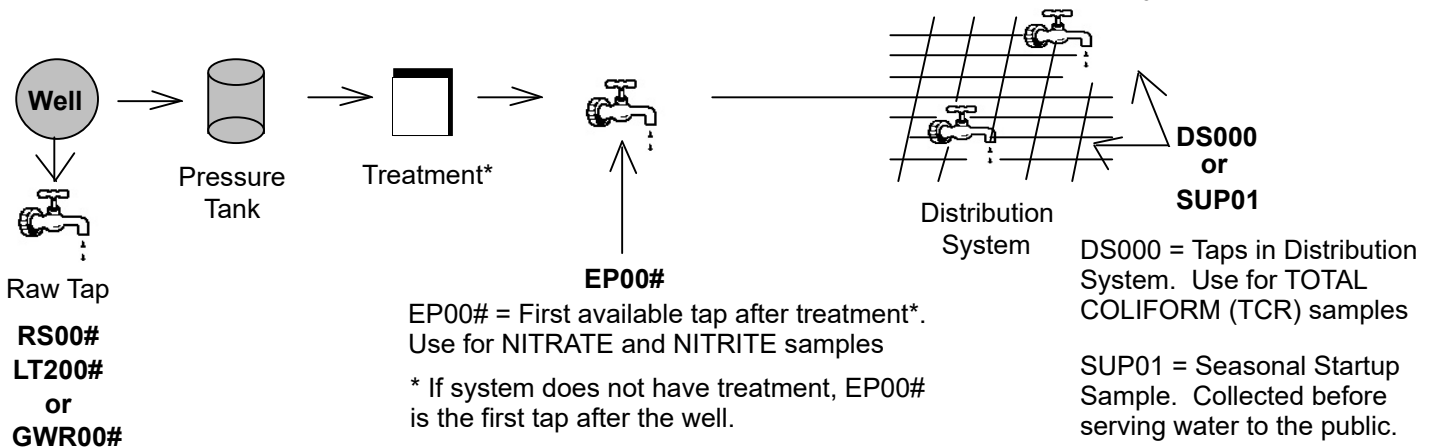

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6259112 ZION UNITED METHODIST CHURCH -GRAYTOWN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6260732 Facility Name: ZION UNITED METHODIST CHURCH

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

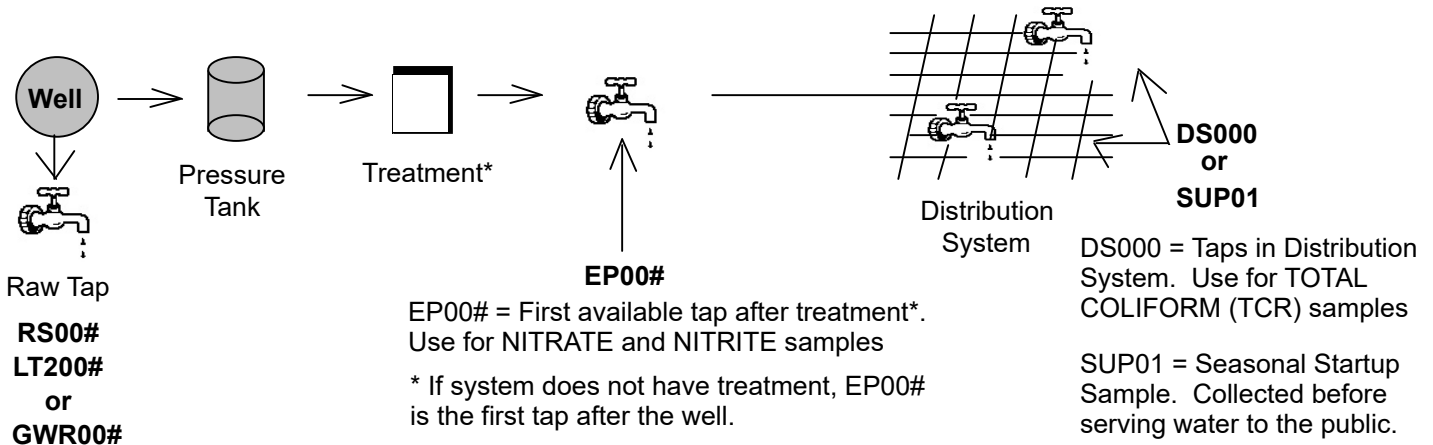

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!